AGENDA
SPECIAL COMMISSION MEETING
10:00 AM - Saturday, February 1, 2025
Commission Chambers

Page

1. CALL TO ORDER
2. PLEDGE OF ALLEGIANCE
3. ROLL CALL
4. DELETIONS OR WITHDRAWALS TO THE AGENDA
5. PRESENTATIONS
   - 5.1. Wastewater Master Plan - Craig A. Smith and Associates, LLC — 3 - 663
     Agenda Item Report - AIR-25-036
   - 5.2. Stormwater Master Plan - Kimley-Horn and Associates, Inc. — 664 - 1295
     Agenda Item Report - AIR-25-037
   - 5.3. Vulnerability Assessment - Kimley-Horn and Associates, Inc. — 1296 - 1424
     Agenda Item Report - AIR-25-038
6. ATTORNEY COMMENTS
7. TOWN MANAGER COMMENTS
8. COMMISSIONER COMMENTS
   Commissioner Jacobs
   Acting Clerk Commissioner Kashem
   Clerk Commissioner Hodgkins
   Vice Mayor Morrissette
   Mayor Mohammed
9. ANNOUNCEMENTS
   - 9.1. Collective Bargaining Session, Wednesday, February 5, 2025 at 10:00 a.m.
     Regular Commission Meeting, Wednesday, February 12, 2025 at 7:00 p.m.
     Special Magistrate Hearing, Wednesday, February 19, 2025 at 9:00 a.m.
     Workshop Commission Meeting, Wednesday, February 26, 2025 at 6:00 p.m.

     CALENDAR OF EVENTS
     Food Drive, Saturday, February 15, 2025 at 10:00 a.m.
10. ADJOURNMENT

IN ACCORDANCE WITH THE PROVISIONS OF F.S. SECTION 286.0105, IF A PERSON DECIDES TO APPEAL ANY DECISION MADE BY THE BOARD, AGENCY, OR COMMISSION WITH RESPECT TO ANY MATTER CONSIDERED AT THIS MEETING OR HEARING, HE OR SHE WILL NEED A RECORD OF THE PROCEEDINGS, AND, FOR SUCH PURPOSE, HE OR SHE MAY NEED TO ENSURE THAT A VERBATIM RECORD OF THE PROCEEDINGS IS MADE, WHICH RECORD INCLUDES THE TESTIMONY AND EVIDENCE UPON WHICH THE APPEAL IS TO BE BASED.

ANY PERSON REQUIRING AUXILIARY AIDS AND SERVICES AT THIS MEETING MAY CALL THE TOWN CLERKS OFFICE AT 954-966-4600 AT LEAST TWO CALENDAR DAYS PRIOR TO THE MEETING. IF YOU ARE HEARING OR SPEECH IMPAIRED PLEASE CONTACT THE FLORIDA RELAY SERVICES BY USING THE FOLLOWING NUMBERS: 1-800-955-8770 (VOICE) OR 1-800-955-8771 (TDD)

DECORUM - ALL COMMENTS MUST BE ADDRESSED TO THE COMMISSION AS A BODY AND NOT TO INDIVIDUALS. ANY PERSON MAKING IMPERTINENT OR SLANDEROUS REMARKS, OR WHO BECOMES BOISTEROUS WHILE ADDRESSING THE COMMISSION, SHALL BE BARRED FROM FURTHER AUDIENCE BEFORE THE COMMISSION BY THE PRESIDING OFFICER, UNLESS PERMISSION TO CONTINUE OR AGAIN ADDRESS THE COMMISSION IS GRANTED BY THE MAJORITY VOTE OF THE COMMISSION MEMBERS PRESENT. NO CLAPPING, APPLAUDING, HECKLING OR VERBAL OUTBURSTS IN SUPPORT OR IN OPPOSITION TO A SPEAKER OR HIS/HER REMARKS SHALL BE PERMITTED. NO SIGNS OR PLACARDS SHALL BE ALLOWED IN THE COMMISSION CHAMBERS. PLEASE MUTE OR TURN OFF YOUR CELL PHONE OR PAGER AT THE START OF THE MEETING. FAILURE TO DO SO MAY RESULT IN BEING BARRED FROM THE MEETING. PERSONS EXITING THE CHAMBER SHALL DO SO QUIETLY.

Cynthia Garcia-Lima
Town Clerk

Agenda Item Report

Subject:	Wastewater Master Plan - Craig A. Smith and Associates, LLC
Meeting Date:	Agenda for Special Commission Meeting - February 1, 2025
Prepared For:	Town Commission
Staff Contact:	Stanley Merantus, Public Services Director
Dept/Group:	Public Works
Recommendation for Counsel to consider:	
Background Information:	Presentation of the Wastewater Master Plan
Staff Recommendations:	
Financial Implications:	There is no financial impact.
Alternatives:	

ATTACHMENTS:

TPP_Sanitary_Sewer_Master_Plan-12-30-24
ExhibitA
ExhibitB
ExhibitC
ExhibitD
ExhibitE
ExhibitF
ExhibitG
ExhibitH
ExhibitI

TOWN OF PEMBROKE PARK

SANITARY SEWER SYSTEM MASTER PLAN

JANUARY 2025

Project No. 08-22-025

PREPARED BY

CRAIG A. SMITH & ASSOCIATES
Consulting Engineers, Planners, Surveyors
1425 E. Newport Center Drive, Deerfield Beach, FL 33442
(954) 782-8222

TABLE OF CONTENTS

BOOK 1

1.0 General Information

1.1 History

1.2 Service Area

1.3 Existing Facilities

1.4 Growth

2.0 Scope of Services

2.1 Scope of Project

2.2 Lift Station Evaluation

2.3 Determine Flows of Lift Station Collection Areas

2.4 Determine Future System Flows

2.5 System Modeling

2.6 Update Sewer Atlas

2.7 Report Preparation

3.0 Lift Station Introduction

3.1 Introduction

3.2 Lift Station Service Areas and Review of Existing Conditions

4.0 Lift Station Evaluation and Collection West Meter Outfall to Broward County

4.1 Lift Station #14

4.2 Lift Station # 17

4.3 Lift Station # 37

4.4 Lift Station # 40 (Broward County School (Lake Forest Elementary))

4.5 Lift Station # 42 (Privately Owned)

4.6 Lift Station # 43 (Privately Owned)

5.0 Lift Station Evaluation and Collection East Meter Outfall to City of Hollywood

5.1 Lift Station #1

5.2 Lift Station #2

5.3 Lift Station #3

5.4 Lift Station #4

5.5 Lift Station #5

5.6 Lift Station #6

5.7 Lift Station #7

5.8 Lift Station #8 (Does Not Exist – Abandoned)

5.9 Lift Station #9 (Privately Owned)

5.10 Lift Station #10 (Privately Owned)

5.11 Lift Station #11 (Privately Owned)

5.12 Lift Station #12 (Privately Owned)

5.13 Lift Station #13

5.14 Lift Station #15

5.15 Lift Station #16

5.16 Lift Station #18

5.17 Lift Station #18A

5.18 Lift Station #19

5.19 Lift Station #20 (Does Not Exist – Abandoned)

5.20 Lift Station #21 (Does Not Exist – Abandoned)

5.21 Lift Station #22 (Inactive)

5.22 Lift Station #23

5.23 Lift Station #24

5.24 Lift Station #25

5.25 Lift Station #26 Trinity (Inactive)

5.26 Lift Station #27 (Does Not Exist – Abandoned)

5.27 Lift Station #28 (Does Not Exist – Abandoned)

5.28 Lift Station #29

5.29 Lift Station #30

5.30 Lift Station #31

5.31 Lift Station #32

5.32 Lift Station #33 (Privately Owned)

5.33 Lift Station # 34

5.34 Lift Station # 35 (Privately Owned)

5.35 Lift Station # 36

5.36 Lift Station # 38

5.37 Lift Station #39 (Privately Owned)

5.38 Lift Station #41 (Privately Owned)

5.39 Lift Station #44 (Privately Owned)

5.40 Lift Station #45 (Privately Owned)

5.41 Lift Station #46 (Privately Owned)

5.42 Lift Station #47 (Privately Owned)

5.43 Lift Station #48 (Privately Owned)

5.44 Summary

6.0 SYSTEM FLOWS AND MODELING

6.1 Constructing the Hydraulic Model

6.2 Water Use and Billing Data Supplied by the Town of Pembroke Park

6.3 Determination of Lift Station Service Areas and Wastewater Demands from Utility Data

6.4 Models of the Existing Wastewater Lift Station

6.5 Hydraulic Models of the Future Lift Stations and Force Main System

6.6 Hydraulic Models of the Analysis of Current and Future Gravity Sewer Systems

6.7 Town Outfall and Treatment Plant Capacity

7.0 Supporting Documents

7.1 Large User Agreement

7.2 Broward County Interlocal

7.3 Coca Cola Rate Agreement

8.0 Conclusions and Recommendations

8.1 Recommended Improvements

9.0 Exhibits

A. City of Hollywood Large User Agreement
   A1. Current Flows

B. Broward County Interlocal Agreement (Resolution Passed Around (2003-2005)

C. Coca Cola Rate Agreement:
   C1. Resolution Passed Around 2010 Reduction in Volume Based On Production Distribution
   C2. City of Hollywood Excessive Wastewater PH and Acidity Concentration Resolution Executed Around 1996

D. Model Data Report 2025 Existing Conditions
    - D1. Gravity Sewer Data Table Report
    - D2. Sewer Manhole Data Table Report
    - D3. Force Main Data Table Report
    - D4. Pressure Node Data Table Report
    - D5. Pump Data Table Report
    - D6. Outfall Data Table Report

E. Model Data Report 25 Unit Per Acre Build-Out
    - E1. Gravity Sewer Data Table Report
    - E2. Sewer Manhole Data Table Report
    - E3. Force Main Data Table Report
    - E4. Pressure Node Data Table Report
    - E5. Pump Data Table Report
    - E6. Outfall Data Table Report

F. Model Data Report 50 Unit Per Acre Build-Out
    - F1. Gravity Sewer Data Table Report
    - F2. Sewer Manhole Data Table Report
    - F3. Force Main Data Table Report
    - F4. Pressure Node Data Table Report
    - F5. Pump Model Data Table Report
    - F6. Outfall Data Table Report

G. Pump Inventory Table

H. Letter Request for Additional Sewer Allocation

I. 2025 Town Atlas

SANITARY SEWER SYSTEM MASTER PLAN

1.0 GENERAL INFORMATION

1.1 History

In the 1950's, the area known today as the Town of Pembroke Park was being developed as an industrial area with some of the less attractive industries being constructed within its municipal boundaries. At that time, the Town's municipal boundaries were confined to what today makes up the eastern section of the Town. By 1957, several chemical plants had been established within the Town.

Many industrial plants were becoming operational, and several landowners in the area formed a consensus and petitioned the Legislature of the State of Florida in a special session to create the municipality of Pembroke. The Legislature approved this petition and the Town of Pembroke was formed. Shortly after its formation, the Town on December 16, 1957 passed and adopted its first zoning regulations to control the spread of objectionable industry. These regulations were most likely drafted as a direct result of the type of development that had been occurring in the area prior to it becoming a municipality.

Shortly after the Town of Pembroke was created by the Legislature of the State of Florida, this same body abolished the municipality. However, the Town of Pembroke Park was established and State Law adopted its Charter on June 20, 1959 (House Bill No. 2477). The Town's utilities consisted of small lift stations, which were built as commercial properties developed. Small forcemains interconnected these small lift stations and pumped them to the City of Hollywood's regional wastewater treatment plant. Since that time a series of small annexations and attempted annexations has slowly increased the Town's area, specifically toward the west. The final annexation was in 1978 of Hollywood Ridge Farms, which added approximately 3/8 of a square mile to the Town's area along its western boundary, which increased the Town's size to approximately 1.65 square miles.

The development of the Town of Pembroke Park occurred primarily prior to 1980 and slowed somewhat during the period between 1980 and 1990. During the period between 1990 and 1995, growth within the Town of Pembroke Park was nearly non-existent. Recently (after 1996), the Town of Pembroke Park has been experiencing a significant increase in development. During the period between 1996 and 2008 an additional 800 housing units were developed on the west side of Pembroke Park.

Between 2000 and 2020 Meekins Lake was filled to create additional industrial land. More than 2.4 million square feet of industrial warehouse was built, or is currently being built, on the infilled lake sections. The Town is undergoing a

redevelopment of the older commercial and industrial properties with single story warehouses being torn down and multi-story commercial buildings being erected in their place. This trend is expected to continue.

The ground water table is considerably high throughout the Town of Pembroke Park. This, along with ageing infrastructure (sewer pipes and sewer structures), has attributed to significant Inflow and Infiltration throughout the Town. Which has significantly impacted the operation and maintenance cost in the Town.

Many of the lift stations throughout the Town are in need of significant maintenance or replacement to address the current deterioration and improve operation and maintenance cost due to emergency breakdowns.

1.2 Service Area

The service area for the Town of Pembroke Park is zoned as commercial, light industrial, or residential.

1.3 Existing Facilities

The Town of Pembroke Park currently has an inventory of 49 lift stations. Of which 5 are abandoned or no longer exist, 2 are inactive, 15 are owned, operated and maintained privately, and 27 are publicly owned and operated.

The sewer collection is conveyed out of the Town by two separate systems. The East System collects all the sewage in the Town East of 48th Street and conveys this to the County System connection on Pembroke Road near lift station 19 in front of Coca Cola. The West system collects all sewage West of 48th Street and conveys the sewage the County System connection at the North East Corner of the Town Park on 48th Street. The sewage is pumped from the individual lift stations to the City of Hollywood where it is eventually treated at Hollywood's wastewater treatment facility.

Many private lift stations have been added to the east and west systems in the last two decades since the last Master Plan was drafted. The Seneca Commerce Center added one new station that is to be turned over to the Town upon certification. Private lift stations have been added at Westwind II on Coca Cola Drive, the Dollar General, the Polo Club, and the service station on Park Road and Pembroke Road.

1.4 Growth

Between 1996 and 2008 the Town of Pembroke Park experienced a dramatic increase in residential development. The Town is a leader in providing its fair share of affordable housing in Broward County. In 1996, the Town of Pembroke Park constituted less than 1% of Broward County's total developable land area and was home to approximately 11% of the total mobile or modular homes in

Broward County. The development of additional affordable housing continues to occur, primarily concentrated in the southwest portion of the Town.

Industrial growth between 1998 and present has continued to add additional large-scale Industrial buildings. There are currently two large industrial buildings in the Seneca Commerce Center that will bring the total to over 2.4 million square feet of industrial development. Very few parcels remain available for development and future development will occur on smaller parcels (mostly less than 2 acres) and redevelopment of older commercial and industrial properties including the superfund site that is proposed for demolition, cleanup and rebuilding in the next few years.

TABLE 1.1
TOWN OF PEMBROKE PARK DEVELOPMENT
2015 – 2022 (As of 11/22)

PROJECT	TOTAL SQUARE FEET
Seneca Commerce Center	**252,776**
Westwind II Plat	**108,000**
Lions Den Storage	**49,745**
Value Storage	**42,991**
Timely Property	**14,882**
4250 Hallandale Plaza	**9,442**

Commercial and industrial development continues with additional projects approved or under construction.

TABLE 1.2
TOWN OF PEMBROKE PARK
APPROVED DEVELOPMENT

PROJECT	TOTAL SQ. FT	STATUS
Seneca Commerce Center	**378,400**	**Under Construction**

As for future development within the Town of Pembroke Park, there are approximately seven (6) lots designated for future residential use remaining in the southwest portion of the Town. It is estimated that each lot could be developed with 24-50 dwelling units at the maximum allowable density of 16-25 dwelling units per acre. Currently, two of these lots contain single family homes while two are vacant. Therefore, the Town estimates that the four (4) remaining lots could be developed in the next five (5) years. This could add an additional 144 dwelling units.

Population estimates and projections are included in the Broward County Estimates. The Broward County Plan shows population decreasing slowly. This decrease is largely due to the fact that more of the mobile home tenants are seasonal and therefore no longer counted in the population. Many of the mobile home parks that were 50% year-round residents twenty years ago are now less than 10 percent.

TABLE 1.3
POPULATION ESTIMATES AND PROJECTIONS

YEAR	2010	2020	2022*	2025*
Residents	6102	6266	6115	6260

*Based upon estimates and projections from Broward County.

2.0 SCOPE OF SERVICES

2.1 Scope of Project

The purpose of this project is to evaluate the existing force-main network within the Town for existing conditions and proposed future conditions. We also propose evaluating the existing lift stations within the collection area. From this data the master plan will be created indicating to the Town proposed improvements required for the sanitary sewer system.

The scope of the project is to create an overall Sanitary Sewer System Master Plan to identify needed improvements to serve the existing customers and potential future customers. Through the modeling efforts of the study, we will be able to identify system improvements that will increase the efficiency of the existing pump stations and pipe network. The study will provide a list of proposed improvements with estimated probable costs of construction for both short term and long-term goals.

2.2 Lift Station Evaluation

The September 2001 Wastewater Collection Pumping System Improvements Preliminary Engineering Report regarding the condition of the existing Town lift stations within the sewer collection system was performed and many of the proposed improvements have been implemented. Between 2004 and 2008 the Town rehabilitated 22 lift stations. The 5 lift stations along SW 30th Street and the two Town lift stations on the west side of Town were not addressed due to funding limits. CAS conducted site visits at each Town lift station and identified

deficiencies of each station. A list of improvements, has been included in this report.

2.3 Determine Flows of Lift Station Collection Areas

We identified each lift station collection area and have provided the Town with a map showing these areas (see Figure-1). Information was gathered regarding the flow of each lift station collection area by verifying densities and lot counts and comparing these flows with the monthly water billing records.

This information was utilized in evaluating proposed improvements to the pipe network.

2.4 Determine Future System Flows

CAS evaluated the potential future flows by utilizing existing land uses, future land uses, and existing plots. We evaluated the potential for future sewer flows within the system in order to develop future flow characteristics. This data was utilized in the modeling of the system to determine proposed improvements to the pipe network.

2.5 System Modeling

A. CAS analyzed the forcemain network utilizing a computer flow model for both the existing and future conditions. The model identified the existing deficiencies within the pipe network.

B. In addition, we looked at the forcemain network model to determine potential future improvements to the pumping patterns within the force main network that would allow for more efficient pumping throughout the Town's network.

2.6 Update Sewer Atlas

The existing 2001 Sewer Atlas has been updated into an electronic CADD file. This will facilitate future upgrades with minimal effort.

2.7 Report Preparation

A Capital Improvement Plan with respect to the sanitary sewer system identifying all of the Town's needs has been provided with a list of proposed improvements with estimated probable project cost to be determined when project is added to the CIP and updated during funding application to ensure project's have the funds required to complete construction and design years after the funding application is drafted.

3.0 LIFT STATION INTRODUCTION

3.1 Introduction

This section of the report will provide a general review of the existing conditions of the lift stations and will categorize the present equipment, safety, and security needs of the existing lift stations. The primary purpose of this report is to provide a comprehensive analysis of the present conditions of the Town's entire lift station network. Please refer to Exhibits D, E, F, and G which show the lift station sewer atlas number, ownership, location, initial design capacity, pump data. In most cases, the initial design capacity is estimated due to the lack of actual flow data and the lack of available records for each lift station. The needs of the existing stations are outlined with an emphasis placed on the most urgent needs. Several of the lift stations require immediate attention to remedy critical safety, health, and maintenance concerns.

The Town sanitary sewer system is divided into two separate systems. The two systems are roughly divided East and West along 48th Ave. The West System pumps to the Broward County force main which discharges to the City of Hollywood Wastewater Treatment Facility through a metered tie-in located at the Northeast Corner of the Town park on 48th Ave. The West system includes the following lift stations and contributing gravity sewers: 14, 17, 37, 40, 42, 43.

The East System pumps to the City of Hollywood Force Main which conveys the flows to the City of Hollywood Wastewater Treatment Facility. The East system includes the following lift stations and contributing gravity sewers: 1, 2, 3, 4, 5, 6, 7, 9, 10, 11, 12, 13, 15, 16, 18a, 18, 19, 22, 23, 34, 25, 26, 29, 30, 31, 32, 33, 34, 35, 36, 38, 39, 41, 44, 45, 46, 47, 48.

The initial gravity systems were not designed and/or built deep enough to accommodate additional development. Each residential development has a gravity pipe system that transports the sewage to a lift station that is usually located within the development. In addition to the general review of the existing conditions of the various lift stations, the review section will identify maintenance, safety and security problems with specific lift stations that should be addressed.

Although the majority of the Town has been developed, additional growth and future development has occurred. Most of the gravity sanitary sewer located throughout the Town is too shallow to tie into, most sewage from any new development will have to be pumped with a lift station into the existing forcemain. Many of the existing lift stations will have to be repaired or replaced in the near future. In order to reduce the number and types of maintenance problems encountered, it is recommended that the Town adopt a standard lift station specification to ensure specific pumps, materials, and control panels, and SCADA systems are utilized or constructed within the Town. If any of the existing lift stations need to be replaced in the future, they can be retrofitted to meet the requirements of the standard lift station specifications.

3.2 Lift Station Service Areas and Review of Existing Conditions

The lift stations located in Pembroke Park have been numbered for inclusion on the Sewer Atlas in chronological order. For the purposes of this report, they will be discussed here in the order that they enter the forcemain system and not by chronological or numerical order.

The majority of these systems are vitrified clay pipe, most of which is nearing the end or has surpassed the end of the service life. These systems are experiencing much Inflow and infiltration issues. These inflow and infiltration issues have been attributed to a substantial increase in flow to the lift stations throughout the Town causing increased operation, maintenance, and treatment costs. These increased flows are also simultaneously having an adverse effect on the Town's capacity for economic growth by limiting the available sewer capacity for future growth. The *Southern Regional Wastewater Treatment Plant July 2023 Large User Capacity Report* indicates that the Town was over capacity by nearly 160,698 Gallons/Day. The Town has a history of sewer camera work and lining of existing pipes to mitigate these Inflow and Infiltration issues. The most current lining project last occurred on Southwest 52nd Avenue in 2020. No pipe lining projects have been complete since the 2020 project while simultaneously the vitrified clay pipe is meeting or exceeding the product life limits without maintenance.

Photographs taken of the existing lift stations are included at the end of this section.

4.0 LIFT STATION EVALUATION AND COLLECTION WEST METER OUTFALL TO BROWARD COUNTY

4.1 Lift Station #14 (Public) (West System)

Lift Station #14 is located off the right-of-way of Hallandale Beach Boulevard in the Northeast corner of the Peninsula Health Care facility. In addition to the flow from the Peninsula Adult Living facility, Azure Villas, the Holly Ridge Apartments, Town Hall, Koinonia Worship Center, Swifty's Laundromat this lift station services the Dale Village subdivision, located on the North side of Hallandale Beach Blvd. The station receives flow from Lift Station # 38 on 55th Avenue and the private lift station serving the Marathon Gas Station on Hallandale Beach Blvd. The effluent runs through a 10" PVC forcemain through Ryan Park and The Preserve at Pembroke Park to the Meter and into the Broward County force main on SW 48th Avenue. The Broward County force main takes the sewerage to the City of Hollywood for treatment. This lift station is in fair condition. It has a pair of above ground 6-inch Gorman Rupp pumps, and an emergency generator.

This lift station is equipped with two 6" Gorman-Rupp pumps (model number T6A60B) that are powered by two 30 HP motors. The control panel has an emergency high-water alarm light and an automatic power transfer switch for the

on-site generator. There is also a water service for wash down and a security fence that encloses the lift station site.

The gravity system is currently having inflow and infiltration work completed and more is planned for the system. The panel is not in good condition, it has no alarm light, broken breaker for the generator. The panel along with the meter can and conduit is leaning over and should be replaced.

The pipes in the wet well are corroded and pumps do not have proper safety barriers including belt guards and safety fence. The station does not have backflow prevention in the piping and relies on in pump check valves to prevent sewage from flowing back into the station. This type of backflow is not reliable. The station, other than the generator, should be replaced with a new station with submersible pumps, a new panel and new piping to the adjacent 10-inch force main.

4.2 Lift Station #17 (Public) (West System)

Lift Station #17 is located off the right-of-way of SW 52nd Avenue in the Southeast corner of the Watkins Elementary School Tract. This lift station services all of the development located within Holly Tree Apartments, Pembroke Park Apartments, Forest Park Villas, Park Point Apartments, Park Apartments, Pembroke Gardens Apartments, Pembroke Park Townhomes, Pembroke Villas, Condo Real, La Estancia Apartments, Pembroke Place I and II, Plaza Assisted Living, and Glenwood Court Apartments. The effluent from lift station #17 feeds directly into an 8” HDPE forcemain, which ties into the 8" PVC forcemain halfway up SW 52nd Ave. It then connects to the 10-inch PVC force main in front of lift station #14. However, none of the sewerage flows pump into lift station #14.

lift station #17 is a wetwell/drywell type station that is equipped with two 6-inch Gorman-Rupp self-priming pumps. The pumps are powered by two 30 HP electric motors. Additionally, this lift station is equipped with an emergency high-water alarm light, a 100-amp emergency generator, and an emergency pump-out connection. The control panel is equipped with hand/auto/off switches for control to each pump, and the control panel is equipped with elapsed time meters (ETM), which keep track of motor running time. The Town is in the process of doing inflow and infiltration remediation in the system, reducing excess flows. The station piping is in poor condition and the dry pit along with the electrical system has been flooded and dried out. The station needs to be rebuilt including new control panel (raised to prevent flooding) and conversion to a wet well system to remove the hazards of the existing dry pit. The generator is in good condition and could be used with the replacement system.

4.3 Lift Station # 37 (Public) (West System)

Lift Station #37 is located on the right-of-way of SW 55th Avenue between 32nd Street and 33rd Street. In addition to the flow from the Lee Mills Subdivision the lift station also receives the flow from McTeer Park, the Montessori School and

the private lift station for the Pollo Club. The lift station was built by the Town in 2008 and is in good condition.

4.4 Lift Station #40 (Broward County School (Lake Forest Elementary) (West System)

Lift Station #40 is located on the north side of the Lake Forest Elementary School Parcel and services the school and the Police Athletic League Facilities. This lift station is owned and maintained by the Broward County School System and pumps through a force main along 48th Ave North to the Town-County tie-In location at the Northeast corner of the Town.

4.5 Lift Station #42 (Private) (West System)

Lift Station #42 is a private lift station that services the Marathon Service Station located at the Intersection 56th Avenue and Hallandale Beach Boulevard. The effluent from this station is designed to flow through a 4-inch DIP force main to the gravity system to lift station #14. Lift station and force main is private, and CAS had limited access to inspect. The lift station appears to be in a poor condition and may need maintenance.

4.6 Lift Station #43 (Private) (West System)

Lift station #43 is a private lift station located at the Pollo Club at the intersection of 56th Avenue and Hallandale Beach Boulevard. The lift station is a converted septic system and pumps through a force main to a gravity sewer manhole at the intersection of 32 Street and 56th Ave., which flows to lift station #37 on SW 55nd Street. This lift station is a private lift station and CAS had limited access. The lift station appears to be operational as per observation from the public right of way.

5.0 LIFT STATION EVALUATION AND COLLECTION EAST METER OUTFALL TO CITY OF HOLLYWOOD

5.1 Lift Station #1 (Public) (East System)

Lift Station #1 is located in the Park Lake Estates Trailer Park. This lift station re-pumps the flows from lift station #6 and the northern one-third population of Park Lake Estates Mobile Home Park, and Sanders Mobile Home Park. The effluent from this lift station discharges through 4-inch piping directly into the 8-inch CIP forcemain from lift station #7.

lift station #1 is equipped with two Sulzer submersible pumps that are powered by two 7.5-HP motors. The station is equipped with 4" check valves and 4" gate valves on the discharge side of the pumps. This lift station is equipped with an emergency high-water alarm light, emergency generator connection, and an emergency pump-out connection. The station was rebuilt in 2005 and is in good

condition.

5.2 Lift Stations #2 (Public) (East System)

Lift station #2 is located in the Park Lake Estates Trailer Park at the intersection of Marine Dr. and Marine Circle. Lift Station #2 services approximately one-third of the trailer park. The effluent from lift station #2 discharges through 4" piping directly into the gravity flow pipe system which flows directly into the wetwell of lift station #3.

Lift station #2 is equipped with two Sulzer Submersible pumps, which are powered by two 2.7 HP motors. This lift station is equipped with 4-inch check valves and 4-inch gate valves on the discharge side of the pumps. There is an emergency generator receptacle, emergency high-water alarm light or emergency pump-out connection provided for this lift station. The pump station is in good condition, with some corrosion of wet well and piping. The system shows signs of moderate inflow and infiltration with clear flow and 1 to 1.5 hours per day of operation while the neighborhood is seasonally largely unoccupied.

5.3 Lift Stations #3 (Public) (East System)

Lift station # 3 is located in Park Lake Estates at the intersection of Lake Shore Drive, East Lake Shore Drive and West Lake Shore drive. The effluent from lift station #3 discharges directly into a 6" ACP forcemain that runs East along West Lake Shore Drive and turns North and runs North along the Seaboard R.R. right-of-way.
Ift station #3 is equipped with two Sulzer submersible pumps, which are powered by two 7.5HP motors. This lift station is equipped with 4-inch check valves and 4-inch gate valves on the discharge side of the pumps. The control panel is equipped with an emergency generator receptacle, high-water alarm light, a main circuit breaker, and overloads. The station is in good condition but shows signs of moderately high infiltration with 7 plus hours of operation per day with occupancy less than 10%. The system needs to have an inflow and infiltration study and repairs.

5.4 Lift Station #4 (Public) (East System)

Lift Station #4 is located in the Pembroke Park Lakes Mobile Home Park at the intersection of West Lake Court and West Lake Drive. This lift station services the North half of the mobile home park, and the commercial tract S Block 37 Leke Forest Sec. 4 resub. The effluent from lift station #4 discharges through 4-inch piping directly into the 4-inch ACP forcemain that runs South along the West side of the park property. This forcemain eventually discharges into the gravity system of lift station #5.

Lift station #4 is equipped with two ABS submersible pumps that are powered by two 6.2 HP motors. The control is in good condition. The system should have its force main reworked to pump directly, through the force main, to the master lift

station. In the past, the system was altered when the force main was damaged prior to lift station #5.

5.5 Lift Station #5 (Public) (East System)

Lift Station #5 is located in the Pembroke Park Lakes Mobile Home Park on West Lake Drive nearly 2350 feet South of the intersection of West Lake Drive and West Lake Court. This lift station services the South half of the mobile home park and receives the flow from lift station #4. The effluent from lift station #5 discharges directly into the 4-inch ACP force main. The combined flows eventually discharge into manhole at lift station #3. The odor elimination system for this lift station is taped closed and corrosion is occurring in the station due to the sealed lid and inoperable gas removal system.

Lift station #5 is equipped with two 3-inch submersible ABS pumps with a 2.4-HP motor. The flow requirements for this lift station should be evaluated and this lift station should be increased in capacity and have the effluent from pump station #4 pumped directly into the force main and not repumped. The station is often surcharged. The gravity sewers contributing to this lift station are clay and may be experiencing issues with inflow and infiltration.

5.6 Lift Station #6 (Public) (East System)

Lift Station #6 is located in the La Siesta Mobile Home Park at Lat: 25°59'2.18"N & Long: 80°10'16.20"W. The effluent from this lift station discharges through 3-inch piping into a gravity flow pipe system that flows directly into the wetwell of lift station #1 for re-pumping.

Lift station #6 is equipped with two submersible, 2.4 HP ABS pumps. The lift station is equipped with an emergency high-water alarm, emergency generator connection, and an emergency pump-out connection. The lift station was rebuilt in 2008 and is in good condition. The gravity sewers contributing to this lift station are clay and may be experiencing issues with inflow and infiltration.

5.7 Lift Station #7 (Public) (East System)

Lift station #7 is located in the Lone Pine Mobile Home Park nearly 270 West of the intersection of 10th street and Green Acres Rd. This lift station services the Lone Pine Mobile Home Park and the effluent from lift station #7 discharges through 4-inch piping directly into the 6" ACP forcemain from lift station #3. It is at this location that the forcemain increases in size to an 8-inch diameter.

Lift station #7 is a submersible type lift station that is equipped with two 4-inch, 4.7 HP ABS pumps. The lift station is equipped with 4-inch check valves and 4-inch gate valves on the discharge side of the pumps, an emergency high-water alarm light, emergency generator receptacle, and emergency pump-out connection are provided for this lift station. The station was rebuilt in 2008 and is

in good condition. The majority of the gravity sewer contributing flow to this lift station are PVC and may not be experiencing issues with inflow and infiltration.

5.8 Lift Station #8 (Abandon, Removed, Does Not Exist) (East System)

5.9 Lift Station #9 (Private) (East System)

Lift station #9 is a privately owned lift station that is located in the Lake Villa Apartments located along Park Road near the Lake Villa Recreational Center. The effluent from this lift station discharges through 3-inch piping directly into the 4-inch PVC force main that runs South along Park Road to Lift station #34. This lift station is in good condition.

Lift station #9 is equipped with two 3-inch submersible pumps with 5-HP motors series SGV @ 3450 RPM, 115 volt, 3-phase 208/230V control panel. The controls are in good condition with lightning arrestors, alarm light, elapsed time meters, alternator, overloads and a stainless steel control panel.

5.10 Lift Station #10 (Private) (East System)

Lift station #10 is located off the right-of-way of SW 30th St. on the South side of Lot 27 in Block 40. This lift station services the development on Lots 26 -29 and the North 100 feet of tract R in Block 40. The effluent from this lift station discharges through 4-inch piping directly into the 6-inch ACP forcemain that runs along SW 30th St.

Lift station #10 was equipped with two 3-inch submersible pumps. This lift station is presently not equipped with an emergency high-water alarm light, an emergency generator receptacle or an emergency pump-out connection. These items need to be provided to identify and bypass a lift station failure. This lift station is secured with a fence. The station is private and no further information is available at this time.

The lift station should be replaced along with all the stations on SW 30th Street with a new gravity sewer system with fewer pumps, new gravity sewer system, and new force main to replace the current asbestos concrete one.

5.11 Lift Station #11 (Privately Owned) (East System)

Lift station #11 is located off the right-of-way of SW 30th St. on the South side of Lot 20 in Block 40. This lift station is a privately owned lift station that services the development on Lots 20 & 21. The effluent from this lift station discharges through 4-inch galvanized steel piping directly into the 6-inch ACP forcemain that runs along SW 30th St.

Lift station #11 is equipped with two 3-inch Hydromatic self-priming pumps that are powered by two 2-HP motors. This lift station is equipped with 3-inch gate valves on the discharge side of the pumps and a single 4-inch check valve on the

effluent line. The control panel is equipped with an elapsed time meter and an emergency high-water alarm light. The lift station is presently not equipped with an emergency pump-out connection or an emergency generator receptacle. These items are needed to provide a means to pump the sewage in the event of a lift station failure.

The lift station should be replaced along with all the stations on SW 30th Street with a new gravity sewer system with fewer pumps, new gravity sewer system, and new force main to replace the current asbestos cement one.

5.12 Lift Station #12 (Private) (East System)

This lift station is a small privately owned lift station along 30th St. which is utilized to collect sanitary sewer from the fuel service station located 128 feet West of the intersection of 37th Ave and 30th Street. This lift station is privately owned, and CAS was not able to access or inspect this lift station. An assumed pump was utilized for sewer modeling.

5.13 Lift Station #13 (Public) (East System)

Lift station #13 is located off the right-of-way of S.W. 30th St. on the South side of Lot 20 in Block 50. This lift station services the buildings located on Lots 17-28 of Block 50. The effluent from this lift station discharges through 6-inch DIP piping directly into the 6-inch ACP forcemain that runs along SW 30th Ave. This lift station should be replaced due to its poor condition.

Lift station #13 is a wetwell/drywell type lift station that is equipped with two 4-inch Gorman-Rupp self-priming pumps that are powered by two 10-HP motors. This lift station is presently not equipped with an emergency pump-out connection or an emergency generator receptacle. These items are needed to provide a means to pump the sewage in the event of a lift station failure.

The drywell to this lift station has standing water which needs to accumulate to about 6 inches before being pumped to 2 inches. This can be an electrical hazard and can also potentially cause damage to the motors. Additionally, pump # 2 is not operational and the station runs with single 110V float directly wired through the starter. The lift station should be replaced along with all the stations on SW 30th Street with a new gravity sewer system with fewer pumps, new gravity sewer system, and new force main to replace the current asbestos cement one.

5.14 Lift Station #15 (Public) (East System)

Lift station #15 is located off the right-of-way of SW 30th Street in the Southeast corner of Lot 13 in Block 50. This lift station services the Newman Building, (located on Lots 13 - 17 in Block 50) and the plaza (located on lots 9 – 13) and Block B. The effluent discharges through 4-inch DIP piping directly into the 6-inch ACP forcemain that runs along SW 30th St. This lift station should be

replaced due to its extremely poor electrical and mechanical condition.

Lift station #15 is equipped with one 3-inch submersible pump. The level control is by means of a single float switch, with no thermo protection. Lift station #15 is presently not equipped with an emergency high-water alarm light, an emergency pump-out connection nor an emergency generator receptacle. A fence provides security for the lift station site and is in poor condition. The wet well is a pipe sitting on a manhole and is in poor condition.

The lift station should be replaced along with all the stations on SW 30th Street with a new gravity sewer system with fewer pumps, new gravity sewer system, and new force main to replace the current asbestos cement one.

5.15 Lift Station #16 (Public) (East System)

Lift Station #16 is located at the corner of Prairie Ave. and Alabama St. This lift station services the commercial development on the East and West side of Prairie Avenue at this location along with the RV section of Lake Trinity. The effluent from this lift station discharges through 4-inch piping directly into the 6-inch forcemain that runs west along Alabama St. to Park Road where it enters the 8-inch CIP forcemain that runs along Park Road.

Lift station #16 is equipped with two 4-inch ABS/Sulzer pumps that are powered by two 10.1-HP motors. The lift station is equipped with an emergency generator receptacle, an emergency high-water alarm light and an emergency pump-out connection. The station was rehabilitated in 2008 and is in good condition.

5.16 Lift Station #18 (Public) (East System)

Lift Station #18 is located in Holiday RV Park. The effluent from this lift station discharges through 3-inch piping directly into the 8" CIP forcemain from lift station #7.

Lift station #18 is equipped with two submersible ABS pumps of 1.3 horsepower. The station is equipped with an emergency high-water alarm light, an emergency generator receptacle or an emergency pump-out connection. The station was rehabbed in 2005 and is in good condition. This station services the rear of Holiday Mobile Home Park and RV park. The majority of the gravity sewer contributing flow to this lift station are clay pipes and may be experiencing issues with inflow and infiltration.

5.17 Lift Station #18A (Public) (East System)

Lift Station #18 and # 18A are located in the Holiday RV Park. The effluent from these lift stations discharges through 3-inch piping directly into the 8-inch CIP forcemain from lift station #3.

Lift Station #18 A is equipped with two submersible Hydromatic pumps of 3

horsepower. The station is equipped with an emergency high-water alarm light, an emergency generator receptacle and an emergency pump out connection. The station was rehabbed in 2005 and is in good condition. This station services the front section of Holiday Mobile Home Park. The majority of the gravity sewer contributing flow to this lift station are PVC and may not be experiencing issues with inflow and infiltration.

5.18 Lift Station #19 (Public) (East System)

Lift Station #19 is located on Pembroke Road in front of the Coca Cola Plant and services the Coca Cola Plant. The effluent from this lift station discharges directly into the 8-inch CIP force main that runs along Pembroke Road. The effluent then passes through a flow meter that belongs to the City of Hollywood. The force main runs West along Pembroke Road and then North along North Park Road where they eventually discharge into the wet well of lift station #15 that is owned by the City of Hollywood.

Lift station #19 is equipped with two Sulzer/ABS submersible pumps that are powered by two 24.8-HP motors. This station is equipped with 8-inch gate valves and 8-inch check valves on the discharge side of the pumps and with 8-inch gate valves on the suction side of the pumps. The station is equipped with an emergency high-water alarm light, an emergency generator receptacle and an emergency pump-out connection. The station piping, pumps and concrete is deteriorated by the corrosive nature of the wastewater from the Coca Cola Bottling Plant. The system has insufficient storage and has a history of overflows.

It is recommended that the lift station be rebuilt with a larger lined wet well and corrosion resistant (stainless steel) pipes and pumps. The system should be equipped with telemetry to inform of issues to prevent overflows. The system is already equipped with an emergency generator.

5.19 Lift Station #20 (Abandon, Removed, Does Not Exist) (East System)

5.20 Lift Station #21 (Abandon, Removed, Does Not Exist) (East System)

5.21 Lift Station #22 (Public) (East System)

Lift station #22 is located in the Lakeside Park Estates Mobile Home/RV Park along Trinity Lane. This lift station re-pumps the flow from lift station #26 and gravity flow from the North part of Lakeside Park Estates Mobile Home/RV Park. The effluent from this station discharges through 4-inch piping directly into the 4-inch PVC forcemain that runs East and North to Pembroke Road where it enters the 8-inch CIP forcemain that runs along Pembroke Road towards the flow meter to Hollywood.

Lift station #22 is equipped with two Sulzer submersible pumps that are powered by two 10.1-HP motors. This lift station is equipped with 4-inch gate valves and

4-inch check valves on the discharge side of the pumps. The lift station is equipped with an emergency high-water alarm light, an emergency generator receptacle, and an emergency pump-out connection. The station was rehabilitated in 2008 and had pump replacements in 2020 and 2021 and is in good condition. The majority of the gravity sewer contributing flow to this lift station are clay pipes and may be experiencing issues with inflow and infiltration. Most of the mobile homes and permitted RVs are removed from the Mobile Home Park. Much of the system is in poor condition and plugs should be put in place at removed Mobile Home locations to reduce inflow and infiltration.

5.22 Lift Station #23 (Public) (East System)

Lift station #23 is located on the East side of the Seaboard R.R. right-of-way, behind the building located at 2930 SW 30th Avenue. This lift station services the flows from this street, 2910 – 3040 SW 30th Avenue and 3000 W. Hallandale Beach Blvd. The effluent from this lift station discharges through a 4-inch ACP force main that increases to 6-inch ACP. This force main enters the 6-inch ACP force main from lift station #3.

Lift station #23 is equipped with two ABS pumps that are powered by a 4.7-HP motor. The station is equipped with a high-water alarm, emergency generator receptacle and an emergency pump-out connection. There is a security fence enclosure. During heavy rains the station becomes submerged, but not up to the electrical box. The top slab and manhole should be raised to above flood grade. The majority of the gravity sewer contributing flow to this lift station are clay pipes and may be experiencing issues with inflow and infiltration.

5.23 Lift Stations #24 (Public) (East System)

This lift station is located in the Green Acres Mobile Home Park. These lift stations service the Green Acres Mobile Home Park. The effluent from this lift station discharges through 3-inch PVC piping directly into the 6-inch ACP force main that begin at lift station #3.

This lift station is submersible-type station with two 3-inch submersible pumps, 2-HP ABS pumps. Both lift stations are equipped with emergency high-water alarm lights and 3-inch emergency pump-out connections, and an emergency generator receptacle. The station was rebuilt in 2008 and is in good condition. The majority of the gravity sewer contributing flow to this lift station are clay pipes and may be experiencing issues with inflow and infiltration.

5.24 Lift Stations #25 (Public) (East System)

This lift station is located in the Green Acres Mobile Home Park. This lift station services the Green Acres Mobile Home Park. The effluent from this station discharges through 3-inch PVC piping directly into the 6-inch ACP forcemain that begins at lift station #3.

Both lift stations are submersible-type stations with two 3-inch submersible, 2-HP ABS pumps. Both lift stations are equipped with emergency high-water alarm lights and 3-inch emergency pump-out connections, and an emergency generator receptacle. The stations were rebuilt in 2008 and are in good condition. The majority of the gravity sewer inflow and infiltration.

5.25 Lift Station #26 (Public) (East System)

Lift station #26 is located in the Lakeside Park Estates Mobile Home/RV Park. This lift station services the residential development in the Southeast corner of the trailer park. The lift station effluent discharges through 3-inch piping directly into the gravity sanitary pipe system that discharges into the wetwell of lift station #22.

Lift station #26 is equipped with two ABS/Sulzer submersible 2.4 HP pumps. The lift station is equipped with an emergency high-water alarm light, an emergency generator receptacle, and an emergency pump-out connection. The lift station was rehabilitated in 2008 and had one pump replaced in 2021 and is in good working order. The property owner is in the process of evicting all tenants and the future use of the property is yet to be determined.

5.26 Lift Station #27 (Abandon, Removed, Does Not Exist) (East System)

5.27 Lift Station #28 (Abandon, Removed, Does Not Exist) (East System)

5.28 Lift Stations #29 (Public) (East System)

Lift station #29 is located in Bamboo Paradise Mobile Home Park. The lift station services all of Bamboo Paradise Mobile Home Park. The effluent from this lift station is pumped through a forcemain into the elevated manhole located on SW 31st Place where it then gravity flows through piping that eventually discharges into the wetwell of lift station #34. The lift station is equipped with two submersible ABS/Sulzer pumps with 2.4 HP motors. The station was rehabbed in 2008 and is in good condition. Much of this system has been replaced with PVC pipe and may not be experiencing many inflow and infiltration issues.

5.29 Lift Stations #30 (Public) (East System)

Lift station #30 is located in the Bamboo Lakes Mobile Home Park. This lift station services Bamboo Lakes Mobile Home Park. The effluent from this lift stations is pumped through a force main into the elevated manhole located on SW 31st Place where it then gravity flows through piping that eventually discharges into the wet well of lift station #34. This lift station is equipped with two ABS submersible pumps and 2.4 HP motors. The station was rebuilt in 2008 and is in good condition. Much of the gravity sewer in this location is clay pipe and may be experiencing inflow and infiltration issues.

5.30 Lift Station #31 (Public) (East System)

Lift station #31 is located on SW 31st Avenue. This lift station services the commercial area along SW 31st Ave. The effluent from this lift station discharges through 4-inch piping directly into the 4-inch PVC force main that runs South along SW 31st Ave. and then West along Carolina St. to Park Road where it ties into the 8-inch CIP force main that runs along Park Road.

Lift station #31 is equipped with two ABS submersible pumps that are powered by two 10-HP motors. This lift station is equipped with an emergency high-water alarm light, an emergency generator receptacle, and an emergency pump-out connection. The station was rehabilitated in 2008 and is in good condition. Much of the gravity sewer in this location is PVC and may not be experiencing issues with inflow and infiltration.

5.31 Lift Station #32 (Public) (East System)

Lift station #32 is in the Curci commercial development. The effluent from this lift station discharges through 4-inch piping directly into the 4-inch PVC force main that runs East along SW 25th St. to Park Road where it connects to the existing 8-inch force main. Lift station #32 is equipped with two submersible 4-inch ABS pumps. The pumps are 4.7 HP. The station is equipped with an emergency high-water alarm light, an emergency generator receptacle or an emergency pump-out connection. The station was rehabbed in 2008 and is in good condition. Much of the gravity sewer in this location is PVC and may not be experiencing issues with inflow and infiltration.

5.32 Lift Station #33 (Private) (East System)

Lift station #33 is located off the right-of-way of SW 30th St. on the South side of Lot 2 in Block 40. This lift station services the Orion convenience store located on Lots 1 and 2 in Block 40. This lift station is privately owned. The effluent from this lift station discharges through 4-inch PVC piping directly into the 6-inch ACP forcemain that runs along SW 30th St.

The lift station is a submersible type of lift station and is equipped with an emergency high-water alarm light, an emergency generator receptacle and an emergency pump-out connection. A locked fence secures the lift station site and the wetwell hatch has been provided with a locking hasp, which helps eliminate access by unauthorized individuals. No further information was available on this lift station at the time of this report.

5.33 Lift Station #34 (Public) (East System)

Lift station #34 is located on Park Road at the easement site at Lakeside Warehouse Park. This lift station is equipped with three ABS/Sulzer pumps, powered by three 60 HP motors. The station is equipped with an emergency

high-water alarm light and an emergency pump out connection in the event of pump failures. This station is also equipped with a diesel-powered emergency generator for use as a back up power supply. The drywell is equipped with a ventilation blower and a sump pump to prevent damage to electrical equipment from moisture. Additionally, the pumps are provided with gate valves on the discharge side of the pumps and check valves on the discharge side of the pumps. The effluent from this station discharges directly into the 8-inch CIP forcemain that runs North along Park Road where it splits into a 12-inch and 8-inch parallel forcemains, which then extends West along Pembroke Road. As discussed previously, the effluent proceeds to Hollywood where it is treated at the Hollywood Sewage Treatment Plant. The generator is in poor condition and has been unreliable. It should be replaced.

The lift station 34 repumps many of the southeast lift station flows to the county main located near the lift station. Lift stations that contribute to lift station 34 flows are: 1, 2, 3, 4, 5, 6, 7, 9, 10, 11, 12, 13, 15, 18a, 18, 23, 24, 25, 29, 30, 32, 33, 35, 44, 45, 46, 47, 48 to the City of Hollywood where it is eventually treated Much of the gravity sewers attributed to this lift station are clay pipe and may be experiencing issues with inflow and infiltration.

5.34 Lift Station # 35 (Public) (East System)

Lift station #35 services the Pembroke Commerce Center and collects flows from public lift station #38 and private lift station #39. The lift station consists of a pair of 10 HP EMU submersible pumps. Wastewater is pumped through a 4-inch poly force main to the 12-inch force main adjacent to the meter at Coca Cola.

The station is generally in good condition except that water is standing in the bottom of the control cabinet due to holes in rear of the cabinet and the meter can allowing water to enter. This is causing some corrosion in the cabinet and needs repair. This lift station is gravity collection system that is PVC and may not be experiencing issues with the inflow and infiltration.

5.35 Station #36 (Private) (East System)

This is a new submersible lift station installed by Seneca Development to service their industrial site. The lift station consists of a pair of submersible Fairbanks-Morse pumps, rated at 320 GPM at 144' TDH with 30 HP motors. This lift station is connected to a 6-inch PVC forcemain that extends approximately 1350 feet and enter the 8-inch forcemain on the North side of Hallandale Beach Blvd. Little else is known about this lift station since it was not visited as part of this study. Flow from private TV Station lift station #48 is pumped into lift station #36 gravity sewer. This lift station is gravity collection system that is PVC and may not be experiencing issues with the inflow and infiltration.

5.36 Lift Station #38 (To be Public Upon Completion of Construction) (East System)

Lift station # 38 is located within the Seneca Commerce Center and was built by

the developer and scheduled to be deeded to the Town upon completion. The station is still under the operation of the developer and is badly overgrown. The condition of the station and the drawings and specifications have not been available for inspection. Data was later provided, and planned pumps were incorporated into the model.

5.37 Lift Station #39 (Private) (East System)

Lift station #39 is located at Southwest 20th Street and 37th Ave. This lift station services the commercial development on the South side of 20th Street. The effluent from this lift station runs through 2-inch piping directly into the terminal manhole at lift station #35. This lift station is a private lift station and CAS had limited access. The lift station appears to be operational and in good condition as per observation form the public Right of Way.

5.38 Lift Station #41 (Private)

Lift station #41 is a private lift station owned by the service station located at 3250 Pembroke Road. The effluent from this station is pumped directly, via 1.25-inch force main into the 8-inch force main directly across the street. The station only services the service station. This lift station is a private lift station and CAS has limited access. The lift station appears to be operational and in good condition as per observation form the public Right of Way.

5.39 Lift Station #44 (Private) (East System)

Lift station #44 is a private lift station located at the Dollar General located at SW 48th Avenue and Hallandale Beach Boulevard. The lift station pumps the effluent, through a 2-inch force main to the 6 inch AC force main located on SW 48th Avenue. This lift station is a private lift station and CAS had limited access. The lift station appears to be operational and in good condition as per observation from the public Right of Way

5.40 Lift Station #45 (Private) (East System)

Lift station #45 is a private lift station located at 3744 Hallandale Beach Blvd. This is a lift station which collects sewer for Two Quad Plex Apartment Buildings.. The lift station appears to be operational and in good condition as per observation from the public Right of Way. The Station converted the septic tank to a wet well.

5.41 Lift Station #46 (Private Constructed to service club house) (East System)

Lift Station #46 is a private lift station located at the Holiday Mobile Home Park Club House to service the Club House. The lift station appears to be operational and in good condition as per observation form the public Right of Way.

5.42 Lift Station #47 (Public) (East System)

Lift station #47 is a public lift station located at the town owned Bamboo Recreational Center on SW 31st Place. The lift station appears to be operational and in good condition as per observation. This is a very small lift station which only services one customer and the Rec-Center.

5.43 Lift Station #48 (Private) (East System)

Lift station #48 is a private lift station located at Channel 10 TV Station on 28th Street. The lift station pumps the effluent, through a force main to the gravity system of lift station #36. This lift station is a private lift station and CAS had limited access. The lift station appears to be operational and in good condition as per observation form the public Right of Way. Pump sizes in model were assumed due to lack of as-built plans and pump data.

5.44 Summary

Additionally, this report has provided a comprehensive analysis of the existing lift stations. Several of the existing lift stations have safety and electrical hazards that need to be corrected immediately, and it is recommended that the Town have its electrical and building inspectors check each lift station for violations.

Several of the lift stations require immediate rehabilitation or replacement. These are primarily the lift stations not completed in the 2005-2008 lift station rehabilitation program. The stations along SW 30th Street and 14, 17, and 19 need immediate attention. Along with these stations, many of the private stations feeding the Town are inoperable or in poor condition.

6.0 SYSTEM FLOWS AND MODELING

6.1 Constructing the Hydraulic Models

The computer models used for the hydraulic analyses of the wastewater distribution systems were constructed using Sewer CAD version 10.3.4.53. The Sewer CAD software allows a graphical version of the piping system to be constructed, including all lift station pumps and appurtenances. These models can be used to perform long-range planning and to test different pipe sizes and demand configurations.

Sewer CAD was utilized in conjunction with AutoCAD 2020 to map and model all components of the sanitary sewer system. Much of the gravity sewer data was collected from archived as-built and construction plans from the Town. The remaining potions of the model were created via field gathered information or general engineering interpolation. Many of the gravity sewer inverts, pipe sizes and material in the Town have no archived as-built data. CAS could, in most cases, with direction of the Town, interpolate such missing data or extrapolate

missing data from known data upstream and downstream. In some cases, site visits or visual confirmations were used to identify missing data. Data was also obtained from firsthand accounts from current and former Town of Pembroke Park sanitary sewer employees. This invert elevation data should only be used for flow model purposes and survey data should be obtained for design and construction projects. Ground or rim elevation were gathered from public lidar sources such as: www.Labins.org or www.noaa.gov. Detailed information at lift station were gathered by CAS Survey Crews.

Each pipe, manhole, wet well and junction node was modeled. Each pipe is associated with title, length, diameter, roughness coefficient or C-factor, minor loss coefficient, and the status of the pipe (either open or closed).

A junction node is defined as a location where two or more pipes meet or if a pipe diameter or material change occurs or at a component such as a valve or a pump, this point is a junction node. The pressure in the system can be calculated at any junction node where the elevation is specified. For each junction node a title, elevation, and flow can be specified. The atlas of the Pembroke Park distribution system is shown in the Appendix.

The gravity sewer system was modeled as well and design model. Invert elevations have been applied to all manholes in the system. This data can be found in the Town atlas or in the manhole report produced by the Model. The gravity sewer pipes have been modeled and mapped. The data for this pipe can be found in the gravity sewer model pipe report with properties such as material, slope, flow, % capacity, invert, and diameter can be found in the report or atlas.

The public lift stations throughout Town were inspected. In locations that were accessible the lift station pump models, pump make, pump horsepower, wetwell size, controls and inverts were verified. Most of the private lift stations in the Town were not accessible and much of the data from these lift stations was taken from design or as-built plans if available. If no data was available, data from a similar lift station was applied which shared similar physical and design property parameters.

Sanitary sewer Town design flows were used for much of the Town derived from Chapter 13.5 of the Town municipal code. These calculated local sewer loads were applied to the closest sewer manhole or wet well. Nodal demands were determined using the billing records for the commercial and residential accounts and counting the lots and commercial properties from the aerial photographs of the Town.

According to reports and information contained within the Town's Code of Ordinances the following wastewater flow projections were used to determine the Lift Station service area's flow rates.

Single family residence	358 gallons per day per unit
Mobile Home	108 gallons per day per unit
Multi-family residence	270 gallons per day per unit
Commercial/Industrial	Based on Land development code and use

The actual design flow rates for each lift station were designed with a peak factor as recommended in the Ten-States Standards and the Broward County Lift Station Design Criteria. Ten States Standards is a board of state public health and environmental standards utilized by Illinois, Indiana, Iowa, Michigan, Minnesota, Missouri, New York, Ohio, Ontario, Pennsylvania, and Wisconsin.

The following peak factors were utilized:

Flow Range Average Daily Flow (ADF)	Peak Factor
0.01 to 0.05 MGD	3.5
0.05 to 0.25 MGD	3.0
0.25 to 2.00 MGD	2.5

The Town supplied data from individual billing records, which were also used to determine the lift station flow rates.

The pipe materials were determined from maps and data received from the Town. There were several types of pipe in the system including ductile iron, polyvinyl chloride (PVC), asbestos cement, cast iron, and galvanized steel. The initial roughness coefficients, C-factors, were assigned to the existing pipes based on the type of material and their age.

Pipe	C-factor
Ductile Iron	120
PVC	120
Asbestos Cement	100
Cast Iron	115
Galvanized Steel	95

6.2 Water Use and Billing Data Supplied by the Town of Pembroke Park

The Town was not able to obtain residential and commercial billing water meter flow records from the County. These records contain the monthly billings of the residential accounts and the monthly billings of the commercial/multi-family accounts. The accounts contained the average water consumption (by address) and the Town would be able to compare the water flow data to the sewer model and sewer meter reading to identify areas experiencing inflow and infiltration issues.

6.3 Determination of Lift Station Service Areas and Wastewater Demands from Utility Data

Sanitary sewer flow loads were determined utilizing the Chapter 13.5 Land Development Pembroke Park Town code design flows. The loads were applied to nealy all the parcels/customers in Town. Coca Cola flows do not have a standard design flow so this flow could only be determined by obtaining information from the customer or by metering lift station #19 flows.

Next, the wastewater atlas, aerial photographs, and County Property Appraiser data were carefully studied and used to determine unit flow type and quantities for each lift station service. Sewer flow unit loads were applied for each manhole in the gravity system or wetwell based on the number of units or facility type. A peaking factor for each unit load in each lift station basin was determined utilizing the Broward County Standards for wastewater system wetwell sizing requirements. This factor was multiplied by the unit load gallons per day (gpd) and the resulting lift station system design sewer flows. This process was continued throughout the Town for every lift station. These provide a view as to how the wastewater demands are currently placed and distributed throughout the Town. These methods also establish the lift station service areas. The wastewater usage demand data for both the commercial/multi-family and residential units.

The wastewater lift station pump curves were analyzed, and their design flow rates were compared to the service area flow rates previously established. The existing lift stations, in all but a few instances, were found to be adequately sized for the service area required flow rates.

6.4 Models Of The Existing Wastewater Lift Stations and Force Main

Please note that all of the modeling data and reports generated in this study are contained in ***Exhibit D, E, F****.*

After establishing the unit loads and flow for each customer as described in section 6.3 the loads were applied to the nearest system manhole. The loads were then utilized to generate flows in the gravity sewer system. A capacity analysis was assessed for every gravity sewer pipe in the system for current conditions. This assessment was then utilized to identify gravity sewer pipes which are near or at max capacity.

These design flows are also applied to the wet well and pumps. The model was utilized to identify lift station flows and deficiencies.

After establishing the forcemain service areas and determining the existing pipe sizes and materials, the existing lift stations had to be investigated to determine their pump specifications. The individual pump curves were then entered into the model and the model was able to run based on existing conditions of the lift

stations that connect into the Town's East and West systems.

A base model was established where all of the lift stations were simulated as running simultaneously. All lift Town public lift stations were able to operate simultaneously simulating a worst case scenario similar to a wet weather event during peak hour in which all lift stations could be operating at the same time. No pumps were overloaded, and all were able to maintain a reduced operational flow to overcome high head demand from the excessive flows in the force main system.

In conclusion, these models were simulations of the existing forcemain system in the Town of Pembroke Park with their original pump curve data or in some cases new pump curves. The hydraulic model utilizes the pump curve to simulate pump performance. The age and condition of the pump is not taken into account. Therefore, these existing computer simulations may not reflect the actual pump performance of the existing pumps. Without doing actual field tests this is the next best way to analyze the existing forcemain system.

These simulations give little evidence that the smaller private lift stations are adequately powered with enough horsepower or discharge head to run simultaneously with some of the newer larger pump stations. A couple of the small private lift stations were assumed to be operating, but CAS had no data to verify pump models, size, head or flow. These lift stations would have minimal impact on the system. Lift Station 14, 17 and 19 have components which are at capacity and the Town is currently in design on all 3 of these lift stations to resolve any deficiencies.

6.5 Hydraulic Models of the Future Lift Stations and Forcemain System

Areas of growth in the Town have been identified and outlined below. The possible impacts for growth of code designation of Medium High (MH) of 25 units per acre and a code variance allowing 50 units per acre are outlined below for future growth scenarios. The respective sewer lift stations and sewer systems have been projected for areas of underdeveloped land in following lift station collection areas:

Future Growth Areas with Medium High (MH) development of 25 units per acre:

- Lift Station #14 future flows due to development growth:
    - Parcel 514230390010 at the intersection of Hallandale Beach Boulevard and 52nd Avenue. This 7.09 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) applied at 25 units per Acre to allow 175 units at 270 gallons per day. This load is applied at manhole M14C4. The sewer load due to this development would add an addition of 47,250 gallons per day to the lift station #14 basin.

- The projected model future peak hour design flow for lift station 14 in the 25 unit per acre scenario applied to the parcel listed above would result in wet well flows of nearly 752 gallons per minute.

- Lift Station #17 future flows due to development growth:

  - Parcel 514230130010 at the intersection of County Line Road and SW 56th Ave. This 1.63-acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) at 25 units per acre; 40 units at 270 gallons per day. The load is applied at Manhole M17F4. The sewer load due to this development would add an addition of 10,800 gallons per day to the lift station #17 basin.

  - Parcel 514230130130 at the intersection of County Line Road and SW 52nd Avenue. This 2.034 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) at 25 units per acre. 50 units at 270 gallons per day. This load was applied at Manhole M17A12. The sewer load due to this development would add an addition of 13,500 gallons per day to the lift station #17 basin.

  - Parcel 514230130162 at 327 feet West of the intersection of Southwest 48th Avenue. This 2.078-acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) at 25 units per acre. 51 units at 270 gallons per day. This load was applied to Manhole M17B6. The sewer load due to this development would add an addition of 14,026 gallons per day to the lift station #17 basin.

  - The projected model future peak hour design flow for lift station #17 in the 25 unit per acre scenario applied to the parcel listed above would result in wetwell flows of nearly 884 Gallons Per Minute.

- Lift Station #22 future flows due to development growth:
  - Parcel 514220000370 located on the south side of West Pembroke Road 680 feet west of the intersection of West Pembroke Road and South Park Road. This 10.6-acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 25 units per acre. 265 units at 270 gallons per day. This load was applied to Manhole M22B1. The sewer load due to this development would add an addition of 71,550 gallons per day to the lift station #22 basin.

  - Parcel 514220000330 located on the south side of West Pembroke Road 321 feet west of the intersection of West Pembroke Road and

South Park Road. This 17.5-acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 25 units per acre. 437.5 units at 270 gallons per day. This load is applied at Manhole M22A5. The sewer load due to this development would add an addition of 118,125 gallons per day to the lift station #22 basin.

- The projected model future peak hour design flow for Lift Station 22 in the 25 unit per acre scenario applied to the parcel listed above would result in wet well flows of nearly 389 Gallons Per Minute.

Future Growth Areas with Medium High (MH) development of 50 units per acre:

- Lift Station #14 future flows due to development growth of 50 Units Per Acre:

  - Parcel 514230390010 at the intersection of Hallandale Beach Boulevard and 52nd Avenue. This 7.09 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 50 units per Acre to allow 350 units at 270 gallons per day. This load was applied to Manhole M14C4. The sewer load due to this development would add an addition of 94,500 gallons per day to the lift station 14 basin.

  - The projected model future peak hour design flow for Lift Station 14 in the 50 unit per acre scenario applied to the parcel listed above would result in wetwell flows of nearly 877Gallons Per Minute.

- Lift Station #17 future flows due to development growth of 50 Units per Acre:

  - Parcel 514230130010 at the intersection of County Line Road and SW 56th AVE. This 1.63 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 50 units per acre. 81 units at 270 gallons per day. This load is applied at manhole M17F4. The sewer load due to this development would add an addition of 22,005 gallons per day to the lift station #17 basin.

  - Parcel 514230130130 at the intersection of County Line Road and SW 52nd Avenue. This 2.034 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 50 units per acre. 101 units at 270 gallons per day. This load is applied at manhole M17A12. The sewer load due to this development would add an

addition of 27,459 gallons per day to the lift station #17 basin.

- Parcel 514230130162 at 327 feet West of the intersection of Southwest 48th Avenue. This 2.078 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 50 units per acre. 103 units at 270 gallons per day. This load is applied at M17B6. The sewer load due to this development would add an addition of 28,0253 gallons per day to the lift station #17 basin.

- The projected model future peak hour design flow for Lift Station 17 in the 50 unit per acre scenario applied to the parcels listed above would result in wetwell flows of nearly 985 Gallons Per Minute.

- Lift Station #22 future flows due to development growth of 50 units per acre:
  - Parcel 514220000370 located on the south side of West Pembroke Road 680 feet west of the intersection of West Pembroke Road and South Park Road. This 10.6 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 50 units per acre. 530 units at 270 gallons per day. This load is applied at manhole M22B1. The sewer load due to this development would add an addition of 143,100 gallons per day to the lift station #22 basin.

  - Parcel 514220000330 located on the south side of West Pembroke Road 321 feet west of the intersection of West Pembroke Road and South Park Road. This 17.5 acre parcel is proposed in this master plan for full future build out classified in Land Use Category of Medium High (MH) with a variance applied at 50 units per acre. 875 units at 270 gallons per day. This load was applied at manhole M22A5. The sewer load due to this development would add an addition of 236,250 gallons per day to the lift station #22 basin.

  - The projected model future peak hour design flow for lift station #22 in the 50 unit per acre scenario applied to the parcels listed above would result in wetwell flows of nearly 587 Gallons Per Minute.

- Abandon the 6-inch forcemain along S.W. 30th Street and remove Lift Stations #13, 14, 33, 12, 11 and 10. The existing lots will be tied into the proposed gravity collection system on S.W. 30th Street. Remaining lift stations 15 and 12 on SW 30th Street will collect proposed gravity sewer.

- Increase the existing 8-inch forcemain on Park Road to 12-inch diameter. This will start from Hallandale Beach Boulevard and run North to Carolina Street, where it will connect to the existing 12-inch forcemain.

Three hydraulic model scenarios have been created:

- The Base Model which is a depiction of the existing conditions: This model and the result from it utilize existing conditions and provide insight into the immediate needs and issues of the Town.
- The 25 Unit per Acre Medium High Density Future Growth Scenarios for all undeveloped or underdeveloped parcels listed herein.
- The 50 Unit per Acre Variance High Density Future Growth Scenarios for underdeveloped parcels listed herein.

Please refer to the individual model results that explain in detail each pump flow rate and discharge head pressure. Pump curves were identified for each model lift station pump found in the field. CAS did not have access to some small private lift stations, so a standard small pump was assumed for these situations. The model provides individual model scenario Junction Reports, Force Main Reports, Pump Reports, and Gravity Sewer Reports. The individual model maps are color coded by pipe size with flow arrows indicating the direction of flow.

6.6 Hydraulic Models Of The Analysis Of Current And Future Gravity Sewers Systems

The Town of Pembroke park has a vast gravity sewer system much of which is shallow and small diameter. We have outlined below the lift station basins existing and future states based on the model scenarios cited herein in section 4.5 and inflow and infiltration issues which may be adversely impacting the operation of lift station throughout Town. Much of the Town gravity sewers utilize vitrified clay pipe which is old and may be reaching the end of it material lift span. These clay pipe areas have been experiencing increase in lift station flow from ground water inflow and infiltration. The two main issues regarding the Town gravity sewers are (I and I) Inflow and Infiltration, and gravity capacity. These issues have been outlined below:

- (I and I) Inflow and Infiltration:
  I and I is a term used for excess water that flows into sanitary sewer pipes from groundwater and stormwater. Infiltration refers to groundwater that infiltrates or leaks into pipes and inflow refers to storm or surface water that enters pipes from sources other than infiltration. Infiltration seeps into sewer pipes through holes, cracks, joint failures, and faulty sewer pipe connections. Inflow flows into sewers via roof drain downspouts, foundation drains, storm drain cross-connections, and through holes in maintenance hole covers. The ground water tables are high and in many locations above the gravity sewer pipes. These locations which the gravity sewers are below the water table and where the material is clay are highly susceptible to Inflow and Infiltration issues.

  CAS has utilized the Broward County Future Conditions Average Wet Season Groundwater maps that which are also used to aid in the design of infrastructure to be resilient with anticipated climate change effects. The Future Conditions Average Wet Season Groundwater Elevation Map

provides the antecedent conditions for new or major modifications to surface water permitted projects. The map utilized the County's hydrologic models with anticipated future sea level rise (USACE NRC Curve 3) and future precipitation patterns (COAPS CCSM) and averages the groundwater elevations over the May-October periods during the years of 2060-2069.

To identify gravity sewers in the Town that may have infiltration issues due to ground water the future ground water elevation have been cited from the Broward County GIS and noted in each Atlas Page. Elevations are NAVD88 datum. Any pipes below these elevations have been identified via the Atlas to be susceptible to ground water infiltration.

- Gravity Sewer Capacity:
  Gravity sewer analysis for the entire sewer system has been conducted for every gravity sewer segment in the Town. Many gravity sewer systems have been identified to be currently operating at or above capacity in the existing base model scenario. These pipes operate at or above capacity in the exist base scenario: O2L34SA9, O1L14SA2, O2L34SA3, O2L34SA6, O1L14SC1, O1L14SC2, O1L14SC3, O2L34SA8, O1L14SC4, O1L17SA10, O1L14SC5, O2L3SA1, O1L17SA9, O2L35SA1. The future growth scenario medium density with 25 units per acre build-out cited herein 4.5 indicates slightly more gravity sewer capacity issues. These pipes operate at or above capacity in the 25 unit build out scenario: O2L34SA9, O1L14SA2, O2L34SA3, O2L34SA6, O1L14SC1, O1L14SC2, O1L14SC3, O2L34SA8, O1L14SC4, O1L17SA10, O1L14SC5, O1L17SA9, O2L35SA1, O1L17SA11, O1L14SC5, O2L3SA1, O2L22SA2, O1L17SA2. The future growth scenario high density with 50 units per acre build out cited herein 4.5 indicate slightly more gravity sewer capacity issues. These pipes operate at or above capacity in the 50 unit build out scenario: O2L34SA9, O1L14SA2, O2L34SA3, O2L34SA6, O1L14SC1, O1L14SC2, O1L14SC3, O2L34SA8, O1L14SC4, O1L17SA10, O1L14SC5, O2L3SA1, O1L17SA9, O2L35SA1, O1L17SA11, O1L14SC5, O2L22SA2, O1L17SA2, O1L14SC4, O1L17SA10, O1L17SA1, O1L17SA3, O2L22SA4. These issues have been addressed herein in the conclusions and recommendations identifying the gravity sewer capacity deficiencies and remedies.

6.7 Town Outfall and Treatment Plant Capacity:

- Capacity at outfalls:
  - Outfall One or O1 is located near the entrance to lift station 19 nearly 1,080 feet from the intersection of Pembroke Park Road and South Park Road. The Town forcemain ties into the City of Hollywood Force main at this location. The capacity of this tie-in is the limited to the difference of Town Outfall Two or O2 and the Large User Agreement Capacity with the City of Hollywood.
  - Outfall Two or O2 is located in the Northeast Corner of the Town

Park or Pembroke Park Preserve; on the West side of 48th street, nearly 90 feet south of the intersection of 48th street and SW 31st St. The Town ties into an existing county force main that flows to the City of Hollywood System. The capacity at this outfall is limit by the interconnect agreement with the Town of Pembroke Park and the County executed via Town Resolution when the town tied into the County force main. Retired City Staff recall this tie in may have been completed around 2004. The flow through this outfall is limited to the difference between the flow out of Outfall One and the City of Hollywood Large User Agreement Capacity. The flow is also limited by the physical constraints of the existing infrastructure of the town, Broward County and the City of Hollywood.

- The physical constraints or capacity are detailed in the Node Reports and Force Main Report in the sewer model.

- Capacity at Hollywood Sewer Treatment Plant
  The Town of Pembroke Park utilizes the City of Hollywood to treat the sanitary sewage. As per the Southern Regional Wastewater Treatment Plant July 2024 Large User Capacity Report (GPD) the Town of Pembroke Park is currently exceeding capacity at nearly -98,850 gpd. This is placing the Town currently at nearly 109% capacity encumbered. The Town of Pembroke Park requested Craig A. Smith and Associates to draft and submit a Future Sewerage Usage Letter to for a future allocation of 2,335,176 Gallons per Day. See attached City of Hollywood Large User Agreement, Large User Capacity Report, and Town of Pembroke Park Future Sewage Use Treatment Capacity Allocation letter by Craig A. Smith and Associates.
- Inflow and Infiltration impact on capacity: Inflow and infiltration can have a significate impact on actual usage. The Town has taken steps toward eliminating the I and I issues in the Town. A noticeable decline in usage was identified with lining and eliminating Inflow and infiltration issues in the lift station #17 area. CAS highly recommends continuing these gravity sewer lining projects for the remaining clay gravity sewers in the Town to reduce the Inflow and Infiltration flow being collected by Pembroke Park and sent to the Hollywood treatment plant. It the Town can complete the I and I work there is high likelihood that sewerage flow to the Hollywood plant could be reduced to levels below 100% capacity allowing the Town to grow and add developments and not be impacted by fees for flows exceeding 100% the Town of Pembroke Park sewer flow allocation.
- Future growth Medium High development density of 25 units per acre build-out impacts will increase flows and require the more allocation sewer capacity allocations from the City of Hollywood.
- Future growth Medium High development density of 25 units per acre build out impacts will increase flows and require the more allocation sewer capacity allocations from the City of Hollywood.

7.0 Supporting Documents

7.1 Large User Agreement

See Exhibit 9.A for the Large User Agreement, including the correct flows.

7.2 Broward County Interlocal

See Exhibit 9.B for the Broward County Interlocal, including the agreement to Hollywood and the treatment facility.

7.3 Coca Cola Rate Agreement

See Exhibit 9.C for the Coca Cola Rate Argument, which includes 2010 resolution, the reduction in volume based on product distribution, and the City of Hollywood's excess wastewater pH and Acidity concentration Resolution per 1996.

8.0 CONCLUSIONS AND RECOMMENDED IMPROVEMENTS

8.1 Recommended Improvements

The Town of Pembroke Park should address their forcemain and gravity sewer collection system to incorporate the following modifications:

- **Lift Station 35 Basin Gravity Sewer Pipe Size Increase:**
  This 8" gravity sewer pipe # O2L35SA1 located at lift station 35 is at nearly 91% capacity. Adding a 10% Inflow and Infiltration to flow to this scenario will put this pipe at 100% capacity. It is recommended that this pipe be increased to a 12" pipe to ensure this pipe systems does not surcharge in the future.

- **Lift Station 35 Basin Gravity Sewer Pipe Size Increase:**
  This 8" gravity sewer pipe # O2L3SA1 located at lift station 3 is at nearly 100% capacity. Adding a 10% Inflow and Infiltration to flow to this scenario will put this pipe above capacity. It is recommended that this pipe be increased to a 12" pipe to ensure this pipe systems does not surcharge in the future.

- **Lift Station 17 Basin Gravity Sewer Pipe Size Increase:**
  These 8" gravity sewer pipe #s: O1L17SA9, O1L17SA10 located at lift station 17 gravity system is at capacity. Adding a 10% Inflow and Infiltration to flow to this scenario will put this pipe above capacity. It is recommended that this pipe be increased to a 12" pipe to ensure this pipe systems does not surcharge in the future.

- **Lift Station 14 Basin Gravity Sewer Pipe Size Increase:**
  These 8" gravity sewer pipe #s: O1L14SC5, O1L14SC4, O1L14SC3, O1L14SC2, O1L14SC1, O1L14SA2 located at lift station 14 gravity system is at capacity as shown on the Atlas. Adding a 10% Inflow and Infiltration to flow to this scenario will put this pipe above capacity. It is recommended that this pipe be increased to a 12" pipe to ensure this pipe systems does not surcharge in the future.

- **Lift Station 34 Basin Gravity Sewer Pipe Size Increase:**
  These 8" gravity sewer pipe #s: O2L34SA9, O2L34SA3, O2L34SA6, O2L34SA8 located at lift station 34 gravity system is at capacity as shown on the Atlas. Adding a 10% Inflow and Infiltration to flow to this scenario will put this pipe above capacity. It is recommended that this pipe be increased to a 12" pipe to ensure this pipe systems does not surcharge in the future.

- **Force Main Pipe Size Increase:**
  Force are typically are designed not to exceed a velocity of 10 ft/s capacity. These 10 inch pipes located near Outfall 2, Lift Station 19 are exceeding the 10 ft/s second design criteria. Pipe sizes for these force mains should be increased to 12 in to reduces excessive pump head requirements, reduce pump energy cost and increase pump flow through the system for these pipes: O2L19FB2, O2L19F2, O2L19F1, O2L34F1, O2L34F2.

- **Capacity conclusion and recommendations**:
  The Town of Pembroke Park is highly recommended to seek additional capacity from the City of Hollywood in the Southern Regional Wastewater Treatment Plant. Currently the Town has 1.11 million GPD allocated

- **Southwest 30th Street Project**
  Complete the SW 30th Street project which includes abandonment of all existing private and public lift stations (#13, 15, 33, 12, 11, and 10). along SW 30th Street. Install two new lift stations and gravity collection system. Connect the East lift station to the Town's East system and connect the proposed West lift station to the Town's West system.

- **Southwest 30th Avenue Project**
  Install a gravity sewer collection system, including a lift station and force main, to take the SW. 30th Avenue area between Pembroke Rd. and Hallandale Beach Blvd. off septic tanks.

- **Southwest 25th Court Project**
  Install a gravity sewer collection system, including a lift station and force main, to take the SW. 30th Court area between Dale Village and SW 56th Ave off septic tanks.

- **Lift Station #14 Project**
  Replace lift station #14 with a modern submersible lift station and valve box, constructed of concrete and supplied with modern electrical controls. The typical small duplex pump station will most likely have a pair of 10 to 15 HP pumps rated at 100 to 200 gpm at 100 feet total dynamic head (TDH).

- **Dale Village Sewer Rehabilitation Project**
  Rehabilitate gravity sewer system for Dale Village located in the lift station #14 system. Line all Clay pipe in Dale Village to eliminate Inflow and Infiltration.

- **Lift Station #17 Project**
  Replace lift station #17 with a modern submersible lift station and valve box, constructed of concrete and supplied with modern electrical controls. The typical small duplex pump station will most likely have a pair of 10 to 15 HP pumps rated at 100 to 200 gpm at 100 feet total dynamic head (TDH). Line degraded gravity sewer system throughout the lift station #17 Basin.

- **Lift Station 22 & Lift Station 26 System Abandonment Project**
  The gravity sewer systems affiliated to lift station #22 and #26 have considerable inflow and infiltration issues. The mobile home / RV park formally known as the Lakeside Mobile Home Park has no residents, . The system may be experiencing Inflow and Infiltration issues due to improper service disconnects during mobile home removal upon Mobile Home/RV Park closure. The majority of the sewer systems in this location could be sealed off and abandoned to alleviate the Town of continual operation, maintenance, inflow and infiltration from these systems and lift stations.

- **Town Code Enforcement Project**
  Enforce the Town code requiring all the properties with sanitary sewer access to connect into the system and pay sewer fees.

- **Lift Station 4 & Lift Station 5 Rehabilitation Project**
  Rehabilitate Systems for lift station #5 and lift station #4 in Pembroke Park Lakes Mobile Home Park, by lining the gravity sewer and replacing the force main, redirecting the flow to the force main to SW 32 Avenue and Hallandale beach Blvd with backflow protection. Upgrade lift station #4 and #5 pumps, panels, and add SCADA.

- **Lift Station 18A Replacement, Gravity Sewer and Force Main Installation:** Combine gravity systems for lift station #6, 7, 18, 18a, 23, 24, 25 and replace with one lift station at the current lift station #18A location, lining clay pipe and replacing lines as necessary to redirect flow to the new station. Install gravity sewer and new lift station at a depth necessary to combine all gravity systems associated with the said lift

stations. replace forcemain from new lift station at 18a to park road forcemain at the intersection of Park Road and Hallandale Beach Blvd.

- **Phase I:** 18A lift station replacement and gravity sewer Installation and force main. Install SCADA system and generator.
- **Phase II:** Lift station #24 and #25 abandonment and connect by gravity to new lift station #18A. Rehabilitation of gravity systems for lift station #24 and #25.
- **Phase III:** Lift station #7 and #23 abandonment. Install gravity sewer from Systems #7 and #23 to new lift station #18A. Abandon old forcemain.
- **Phase IV:** Lift station #1 and #6 abandonment. Install gravity sewer from systems #1 and #6 to new lift station #18A. Abandon old forcemain.

- **Lift Station 2 and Lift Station 3 System Rehabilitation Project**
  Line gravity system 3 and replace the force main from lift station #3 to lift station 5 on West Lake Drive. Line gravity system for lift station #2 and replace and reroute lift station force main along Lakeshore Drive to forcemain at lift station #3.

- **Park Road Sewer Phase 1:** Install Gravity Sewer along Park Road from Carolina Street to Pembroke Road Rehabilitation lift station #16 to serve additional flows.

- **Park Road Sewer Phase 2:** Combine gravity sewer system for lift station #29, lift station #30, lift station #31, by installing gravity system from lift station #31 along SW 30th Court collect lift station #30 and lift station #29. Install gravity sewer from Carolina Street to SW 24th Street. This project will also eliminate approximately 10 septic systems along Park Road. Upgrade forcemain from 24th Street to Carolina St.

- **Park Road Sewer Phase 3:** Combine gravity systems for lift station 9, 32, by installing a gravity sewer line along Park Road from 24th Street to lift station #34 / Master lift station. Add gravity sewer along SW 25th Street from lift station #32 to proposed gravity sewer on Park Road. Add gravity sewer from lift station #9 to proposed gravity sewer on Park Road. Upgrade Park Road forcemain up Park Road from Hallandale Beach Blvd.

9.0 Exhibits

EXHIBIT A
CITY OF HOLLYWOOD LARGE USER'S AGREEMENT

R-90-121
9/5/90

LARGE USER WASTEWATER AGREEMENT

Between

THE CITY OF HOLLYWOOD, FLORIDA

and

PEMBROKE PARK, FLORIDA

LARGE USER WASTEWATER AGREEMENT
TABLE OF CONTENTS

ARTICLES		PAGE
ARTICLE I.	DEFINITIONS	2
ARTICLE II.	CONNECTION TO THE HOLLYWOOD SYSTEM . . .	8
	1. Points of Connection	8
	2. Easement Points of Connection . . .	8
	3. Maintenance of Pembroke Park's Facilities	8
	4. Service Area	9
	5. Future Flow Projections	10
	6. a. Hollywood's Obligation to. . . . Provide Wastewater Treatment Services	10 10
	b. Projected Flows (ADF).	11
	7. Meters	13
	8. Meter Maintenance	13
	9. Meter Accuracy	13
	10. Meter Failure	14
	11. Registration of Meter	14
	12. Meter Reading	14
ARTICLE III.	LIMITATIONS ON DISCHARGE OF CERTAIN WASTES	15
	1. Type of Waste to be Discharged . . .	15
	2. Compliance	19
	3. Sampling	21
	4. Regulatory Action	22
	5. Additional Charge for Wastes of Unusual Strength	23
	6. Emergency Action	24
ARTICLE IV.	CHARGES AND BILLING	25
	1. Annual Estimate	25
	2. Billings Procedure	25
	3. Additional Capacity	31
	4. Payment and Penalties for Nonpayment	32
	5. Dispute Over Amounts Billed	32
	6. Access to Records	33
ARTICLE V.	ADDITIONAL OBLIGATIONS OF THE PARTIES . .	34
	1. Expansion of the Hollywood Regional Wastewater Treatment Facilities . .	34
	2. Cost of Expansion of the Hollywood Regional Wastewater Treatment Facilities	34

	3. Pembroke Park's Obligation to Deliver Wastewater	35
	4. Pembroke Park's Cooperation	36
	5. Changes Required by Outside Agencies	36
	6. Adequate Rate Schedule	37
ARTICLE VI.	PROVISIONS RELATING TO TERMINATION OF AGREEMENT AND ASSIGNMENT OF HOLLYWOOD'S RIGHTS AND OBLIGATIONS . . .	38
	1. Termination Clause	38
	2. Sale, Lease or Transfer of the Hollywood System	41
ARTICLE VII.	PROVISIONS RELATING TO DEFAULT	44
	1. Default	44
	2. Dispute Over Monthly Billings . . .	45
	3. Non-Monetary Default	46
	4. Arbitration	46
	5. Litigation and Arbitration Costs . .	47
	6. Fines	47
	7. Force Majeure	47
ARTICLE VIII.	ADMINISTRATION	49
	1. Execution and Agreement	49
	2. LUAC	49
	3. Invalidity of Provision	50
	4. Legal Requirements	50
	5. Notice	50
	6. Prior Agreements	51
	7. Modification, Amendment or Alteration	51
	8. Findings	51
	9. Counterpart Execution	52

EXHIBITS:

A MAP OF HOLLYWOOD SYSTEM SERVICE AREA

B MAP OF PEMBROKE PARK'S SERVICE AREA

C MAP SHOWING POINTS OF CONNECTION AND METER LOCATIONS

D REPORT RELATING TO OPERATING, MAINTENANCE AND ADMINISTRATIVE COST DATA AND COMPUTATIONS AND ILLUSTRATIONS RELATING TO SAME

LARGE USER WASTEWATER AGREEMENT

THIS AGREEMENT made and entered into in Broward County, Florida, as of this 1st day of October, 1990, by and between the CITY OF HOLLYWOOD, a municipal corporation of the State of Florida (hereinafter referred to as "HOLLYWOOD"), and the PEMBROKE PARK, a municipal corporation of the State of Florida (hereinafter referred to as "PEMBROKE PARK")

W I T N E S S E T H:

WHEREAS, HOLLYWOOD and PEMBROKE PARK entered into that certain Large User Wastewater Agreement dated the 7th day of March, 1973, as amended, to provide for utilization of a common area wide wastewater collection, treatment and disposal facility (collectively the "Prior Agreement"); and

WHEREAS, the parties deem it mutually beneficial to continue to utilize the Hollywood Regional Wastewater Treatment and Disposal Facilities and the HOLLYWOOD Transmission Facilities, as such terms are defined herein; and

WHEREAS, the parties hereto have therefore determined to replace the Prior Agreement with this Agreement in order to provide for the technological advances, more stringent environmental regulations and governmental requirements which have occurred and which have caused the Prior Agreement to be inadequate to address current issues.

NOW, THEREFORE, for and in consideration of the mutual terms and conditions, promises, and covenants hereinafter set forth, HOLLYWOOD and PEMBROKE PARK agree as follows:

ARTICLE I. DEFINITIONS

Unless otherwise specifically set forth elsewhere herein, the following words and phrases used in this Agreement shall have the following meanings:

Any word or term related to "water" or "wastewater" shall have the definitions listed in the "Glossary - Water and Wastewater Control Engineering" 1981, Third Edition, published by the American Public Health Association, American Society of Civil Engineers, American Water Works Association and Water Pollution Control Federation.

1. "Annual Average Daily Flow" or "ADF" shall mean the flow determined by the total flow in gallons for a one year period divided by 365 days (or 366 days in the event of a leap year). The one year period shall be a Fiscal Year as defined herein.

2. "Consulting Engineer" shall mean that professional engineer or engineering firm selected and retained from time to time by HOLLYWOOD to perform engineering services pursuant to this Agreement.

3. "Debt Service Charges" (Treatment, Disposal and/or Transmission) shall include PEMBROKE PARK's applicable share of principal, interest, and coverage requirements on presently outstanding or new issues of revenue bonds, refunding bonds, bank financings or other obligations and including, but not limited to, bond agent fees, credit enhancement fees or service charges, heretofore or hereafter issued by HOLLYWOOD for the benefit of the Large Users and the HOLLYWOOD System. Each Large User's

applicable share of Debt Service Charges for upgrading and expansion shall be based on the formulae set forth in Article IV 2(b) hereof.

4. "Depreciation Charges" A proportionate share of the three (3%) percent per year depreciation on those portions of the HOLLYWOOD System constructed from revenues of HOLLYWOOD other than HOLLYWOOD sewer system bond proceeds and federal grants, as more particularly set forth in Article IV 2(c) below.

5. "Domestic Wastewater" shall mean such wastewater as is derived from residential dwellings, business buildings, institutions and the like.

6. "Financial Consultant" shall mean a firm of certified public accountants, engineers, economists, financial advisors, or any other qualified entity, selected by HOLLYWOOD from time to time to provide financial consultation services pertaining to this Agreement.

7. "Fiscal Year" shall mean a twelve (12) month period which commences on October 1st of each year and ends on September 30th of the following year.

8. "Hollywood Transmission Facilities" shall mean those facilities within the municipal jurisdiction of HOLLYWOOD, owned or operated, or both, by HOLLYWOOD, and shall include present facilities as well as any future facilities that are used now or will be used in the future for the purpose of transmitting wastewater to the Hollywood Treatment Facilities.

9. "Hollywood Regional Wastewater Treatment and Disposal Facilities" or "Hollywood Treatment Facilities" shall

mean those facilities owned or operated, or both, by HOLLYWOOD for the purpose of wastewater treatment and disposal, including any future additions, improvements or modifications to or extensions of these facilities that may occur from time to time, whether said facilities are within the municipal jurisdiction of HOLLYWOOD or not.

10. "Hollywood System" shall mean collectively the HOLLYWOOD Regional Wastewater Treatment and Disposal Facilities and the HOLLYWOOD Transmission Facilities, which System is hereby deemed to be a Publicly Owned Treatment Works (POTW) under 40 CFR 403. This term shall not include any physical facility that relates solely to the retail collection system of HOLLYWOOD. A map depicting the HOLLYWOOD System Service Area is attached hereto as Exhibit "A".

11. "PEMBROKE PARK System" shall mean the entire wastewater system including manholes, laterals, gravity sewers, lift stations, pumping stations, force mains, and the appurtenances thereto, and belonging to PEMBROKE PARK, whether within the corporate limits of PEMBROKE PARK or not.

12. "PEMBROKE PARK Service Area" shall mean the geographic boundaries in which: (i) PEMBROKE PARK is responsible for providing wastewater collection and transmission services to the HOLLYWOOD System, and (ii) HOLLYWOOD is responsible for providing treatment services to PEMBROKE PARK, both as more particularly described in Exhibit "B" attached hereto and made a part hereof. The parties agree that PEMBROKE PARK Service Area, as defined herein, shall also include any modifications to such

Service Area as a result of annexations, deannexations, or by mutual written agreement of the parties. Any change in PEMBROKE PARK's Service Area shall be deemed to automatically amend Exhibit B hereto, as necessary to correct the PEMBROKE PARK Service Area map.

13. "Industrial User" shall mean a user as defined in 40 CFR, as amended.

14. "Industrial Wastes" shall mean liquid wastes from any industrial process, cooling water discharge, or wastes exclusive of those which are Domestic Wastewater as defined in paragraph 5 of this Article.

15. "Infiltration and Inflow" shall mean water entering the sewer system and service connections from the ground (Infiltration) or water discharged into a sewer system or service connections from a roof, yard or street drains, cooling water discharges, manhole covers removed for storm drainage (Inflow). Infiltration and Inflow are mutually exclusive terms.

16. "Large User" shall mean any county, municipality, special district and any other entity which operates wastewater collection or transmission facilities which connect into the Hollywood System. The term "Large User" shall refer only to those counties, municipalities, special districts and other entities which have executed this form of agreement containing substantially the same terms and conditions. HOLLYWOOD shall be included within the defined term "Large User" when said term is used in conjunction with the obligations of the Large User for Debt Service Charges; Renewal, Replacement and Improvement

Account Charges; Depreciation Charges; and Operation, Maintenance and Administrative Costs; the flow projections contained in Article II hereof; the pretreatment requirements contained in Article III hereof; any penalty or compensatory charges set forth herein; and the non-monetary default provisions contained in Article VII hereof. When Hollywood is included as a Large User as set forth above, then Hollywood shall be bound by all terms, conditions, liabilities and obligations of all Large Users as set forth herein.

17. "Large Users' Advisory Committee" shall mean an advisory committee comprised of the appropriate and technically qualified representative of each of the Large Users, including HOLLYWOOD, and which shall have the rights and responsibilities set forth in Article VIII hereof.

18. "MGD" as used herein is an abbreviation for the term "million gallons per day."

19. "Operation, Maintenance and Administrative Costs" shall mean any reasonable and necessary expenses of operation, maintenance and administration of the HOLLYWOOD System, including but not limited to all HOLLYWOOD Treatment Facilities expenses, (including all costs attributable to the General Pretreatment Regulations, 40 CFR 403), allocable transmission expenses, allocable utility administration expenses, allocable utility accounting expenses, allocable general fund administration expenses, all as set forth more completely in composite Exhibit "D" attached hereto and made a part hereof.

20. "Points of Connection" shall mean those points where PEMBROKE PARK's system connects to the HOLLYWOOD System for the purpose of delivering PEMBROKE PARK's wastewater into the HOLLYWOOD System from PEMBROKE PARK's System, which points of connection are more particularly described as set forth in Article II below.

21. "Renewal, Replacement and Improvement Account Contribution" shall mean a monthly contribution, as more particularly described in Article IV 2(d) below, which contribution shall be in addition to all other charges due to HOLLYWOOD from PEMBROKE PARK, and shall be deposited into an account ("Renewal, Replacement and Improvement Account") to be established and utilized by HOLLYWOOD for renewal, replacement and improvement of the HOLLYWOOD System, as more particularly described in Article IV 2(d) below. The account established for PEMBROKE PARK shall be, through standard accounting techniques, segregated from any Renewal, Replacement and Improvement Account established by HOLLYWOOD for any other Large User.

ARTICLE II. CONNECTION TO THE HOLLYWOOD SYSTEM

1. Points of Connection.

The parties hereto agree that the points of connection of PEMBROKE PARK's System to the HOLLYWOOD System and meter locations shall be as set forth in Exhibit "C", attached hereto and made a part hereof.

2. Easement Points of Connection. HOLLYWOOD may locate the points of connection as per Exhibit "C" and provide for meter locations, and may locate meters on property currently being used by PEMBROKE PARK for wastewater transmission facilities. PEMBROKE PARK shall convey at no cost to HOLLYWOOD, an appropriate easement to the property as needed by HOLLYWOOD for the point of connection, meter locations, as necessary to provide ingress and egress to said facilities.

3. Maintenance of PEMBROKE PARK's Facilities.

a. PEMBROKE PARK agrees to keep facilities located within its Service Area or under control of PEMBROKE PARK through any agreement with the State, a county, or municipal government or authority or private party, in such condition so as to reasonably prevent any Infiltration or Inflow which would result in extraordinary levels of groundwater or storm water into PEMBROKE PARK's System, and thereby into the HOLLYWOOD System.

b. PEMBROKE PARK agrees to adopt, enact and enforce such rules, regulations or ordinances as may be required from time to time to ensure that PEMBROKE PARK, or users of PEMBROKE PARK's system are not discharging or causing to be discharged waters or waste which would cause PEMBROKE PARK's wastewater to

be unacceptable under the provisions of Article III of this Agreement.

c. PEMBROKE PARK agrees to be responsible for prompt implementation in its system of all actions required by any federal, state or local regulations imposed on HOLLYWOOD or the HOLLYWOOD System, or PEMBROKE PARK, either now or in the future with regard to the collection, treatment, transportation and disposal of wastewater, including, but not limited to, EPA general pretreatment requirements as contained in 40 CFR 403, and as same may be amended from time to time.

4. Service Area. PEMBROKE PARK agrees that it shall not accept wastewater from outside its Service Area for transmission to the HOLLYWOOD System unless PEMBROKE PARK receives approval from HOLLYWOOD and any regulatory agencies that have jurisdiction over the matter for said connection prior to its being made, with such approval being the subject of a written supplement or agreement which shall be attached hereto and made a part hereof. The parties hereto acknowledge that all contractual obligations regarding connection to and transmission to the HOLLYWOOD System existing as of the date of this Agreement, have been disclosed by each party to the other. Any agreement(s) between Large Users to exchange, trade, sell, assign or otherwise agree with respect to the use of each others flows within their respective Service Areas must be approved, in writing, by HOLLYWOOD. Unless otherwise expressly agreed to in writing, HOLLYWOOD has no obligation to accept or provide service for any wastewater which originates outside of PEMBROKE PARK's Service

Area. Subject to Article II, Section 6.B. hereof, PEMBROKE PARK agrees that it shall cause all wastewater flow generated within its present Service Area as defined in Exhibit "B", to be transmitted to the HOLLYWOOD System.

5. Future Flow Projections. PEMBROKE PARK agrees that it shall annually review its needs for wastewater transmission, treatment and disposal service, and shall, with advice and counsel of a professional engineer project its future ADF needs to the best of its knowledge and ability, for both the next ensuing Fiscal Year and the tenth year projection to HOLLYWOOD, by written notice, on or before March 1st of each year. Said projections shall be in such a format as may be requested by HOLLYWOOD from time to time and shall provide the following information:

(1) Average Daily Flow (MGD) for the next ensuing Fiscal Year; and

(2) Average Daily Flow (MGD) anticipated during the three months of greatest flow.

6.A. HOLLYWOOD's Obligation to Provide Wastewater Treatment Services. HOLLYWOOD acknowledges and agrees that in accordance with the terms and conditions of this Agreement and the other Large User Agreements, it has an affirmative, continuing obligation to provide wastewater treatment services to PEMBROKE PARK and the other Large Users with respect to wastewater flows within the Hollywood Service Area as shown on Exhibit A. HOLLYWOOD's obligation to provide wastewater services to PEMBROKE PARK shall continue until such time as this Agreement

is terminated in accordance with Article VI hereof, or until such time, if any, as HOLLYWOOD is ordered to stop treating PEMBROKE PARK's flows by injunction or final order of a court of competent jurisdiction or by a regulatory agency with the jurisdiction to issue such an order or injunction.

6.B. Projected Flows (ADF). PEMBROKE PARK acknowledges that HOLLYWOOD will rely on PEMBROKE PARK's future flow projections for ADF for the Fiscal Year 1999-2000, as set forth herein, in calculating and planning for the initial HOLLYWOOD System capacity expansion and the financing for same, and that any material increase or decrease in the amount of actual ADF from that disclosed or projected could seriously impact on HOLLYWOOD and the other Large Users with regard to their obligations concerning plant expansion and financing of same. Accordingly, except for those "Excess Flows" as defined herein, which PEMBROKE PARK elects to flow to an alternate system, PEMBROKE PARK agrees that it shall cause all wastewater collected within its Service Area as defined in Exhibit "B" hereto to be transmitted to the HOLLYWOOD System throughout the term of this Agreement. In addition, PEMBROKE PARK agrees that it shall not cause any wastewater collected within its Service Area, as defined in Exhibit "B" hereto, to be transmitted to the HOLLYWOOD System in excess of its projected flows set forth herein for the Fiscal Year 1999-2000 throughout the term of this Agreement, unless PEMBROKE PARK acquires or leases additional flow capacity from another Large User as set forth in Article II, Section 4, herein or unless HOLLYWOOD makes a further plant

capacity expansion to accommodate PEMBROKE PARK's additional flow needs. Debt Service Charges relating to any additional plant capacity expansions shall be borne by those Large Users who require said expansions in proportion to their respective needs.

PEMBROKE PARK hereby makes the following ADF Flow projections for the Fiscal Years indicated.

FISCAL YEAR 10/1-9/30	ADF (RESERVE CAPACITY MGD)
1988-1989	0.69
1999-2000*	1.00

* Fiscal Year 1999-2000 projections to be used by HOLLYWOOD for purposes of planning HOLLYWOOD System capacity expansion to the year 2000.

HOLLYWOOD shall have the right and power to enforce the limitation of its obligations hereunder either by suit or other proceedings at law or in equity and to take such action as necessary to prohibit PEMBROKE PARK from transmitting wastewater into HOLLYWOOD's Transmission and Treatment Facilities which exceeds 110% of the amount of PEMBROKE PARK's Annual Average Daily Flow as projected for a given Fiscal Year. Subject to obtaining HOLLYWOOD's and any regulatory agency's prior written consents, which consent from HOLLYWOOD shall not be unreasonably withheld, PEMBROKE PARK may transmit only those flows from within its Service Area which exceeds the ADF projected for Fiscal Year 1999-2000 (the "Excess Flows") as set forth above to available alternate systems for wastewater treatment. HOLLYWOOD shall have

no obligations or liabilities with respect to any Excess Flows which PEMBROKE PARK elects to transmit to any alternate system.

7. Meters. To the extent that HOLLYWOOD has not already done so, HOLLYWOOD shall furnish and install wastewater metering, recording and transmitting devices to be located at the sites as set forth in Exhibit "C". HOLLYWOOD shall retain ownership of the metering, recording and transmitting devices, together with any appurtenances thereto. PEMBROKE PARK shall reimburse HOLLYWOOD for the design, construction, calibration, and financing costs of such devices, to the extent that PEMBROKE PARK has not already done so, within thirty (30) days of receiving the invoice for said costs. The type of equipment selected shall be at the discretion of HOLLYWOOD; however, HOLLYWOOD shall require the manufacturer of the equipment to submit certified calibration tests to PEMBROKE PARK and HOLLYWOOD.

8. Meter Maintenance. HOLLYWOOD shall have a semi-annual inspection report prepared regarding the condition and accuracy of the metering device by a representative of the meter manufacturer. The expense for the annual inspection shall be an operating charge of the HOLLYWOOD facilities. A copy of this semi-annual report shall be furnished to PEMBROKE PARK.

9. Meter Accuracy. The parties hereto agree that should the metering equipment installed by HOLLYWOOD be found to be inaccurate beyond the manufacturer's range of accuracy, the meter will be assumed to be inaccurate since the last meter check or for a period of three (3) months, which ever time is less, and

the following month's billing will be adjusted to show a credit or additional charge to PEMBROKE PARK for metered flow for that period. If PEMBROKE PARK, for whatever reason, requests a meter report in addition to the semiannual reports, HOLLYWOOD will comply. If the meter was malfunctioning or required calibration, the expense associated with PEMBROKE PARK's request will be an operating expense to the HOLLYWOOD System. If the meter report indicates the meter was operating properly within the manufacturer's guaranteed range of accuracy, PEMBROKE PARK will be charged in the subsequent monthly bill for the expenses associated with the inspection.

10. Meter Failure. The parties agree that if at any time during this Agreement a metering device shall in any way fail to tabulate the flow into the HOLLYWOOD collection and treatment facilities, each successive monthly charge shall be based on the last available meter reading and adjusted to equal the same percent of total plant flow each month until the meter is once again fully operational.

11. Registration of Meter. Registration of a meter, when maintained as above, shall be binding on both parties for all wastewater flow charges. Access to the meters shall be available to PEMBROKE PARK upon request and in the presence of a representative of HOLLYWOOD.

12. Meter Reading. Meter reading for billing purposes shall occur as nearly as possible on the 25th day of each month.

ARTICLE III. LIMITATION ON DISCHARGE OF CERTAIN WASTES

1. Type of Waste to be Discharged.

a. Except as hereinafter provided, PEMBROKE PARK shall not discharge nor cause to be discharged any of the waters or wastes described in paragraph b. below, into the HOLLYWOOD System. All of the quality limitations enumerated below apply to concentrations or other physical characteristics obtained from analysis by HOLLYWOOD of representative samples of the waste collected, which samples upon request of PEMBROKE PARK in writing will be divided between HOLLYWOOD and PEMBROKE PARK. Such analysis as set forth herein shall be made in accordance with the latest edition of "Standard Methods for the Examination of Water and Wastewater" prepared and published jointly by the American Public Health Association, the American Waterworks Association and the Water Pollution Control Federation for so long as same is continued to be published. In the event these standards are no longer published, the parties shall agree on the standard for such analysis.

b. No person shall discharge or cause to be discharged any of the following described waters or wastes into the HOLLYWOOD System.

(1) Any inflow and that infiltration which can be deemed cost effective to correct.

(2) Any wastewater or vapor having a temperature higher than one hundred fifty (150^{o}) degrees Fahrenheit ($65^{o}C$).

(3) Any gasoline, benzene, naphtha, fuel oil or other flammable or explosive liquid, solid or gas.

(4) Any waters or wastes having a pH lower than 5.5 or higher than 9.5, or having any other corrosive property capable of causing damage or hazard to structures, equipment, or personnel of HOLLYWOOD.

(5) Any wastewater containing constituents in concentrations which are in excess of the concentrations set forth for normal wastewater:

BOD5	400 ppm
TSS	400 ppm
TKN	30 ppm
Phosphorus (P)	15 ppm
COD	800 ppm
TDS	2000 ppm

(6) Any waters containing toxic or poisonous solids, liquids or gases in sufficient quantities, which either singly or by interaction with other wastes, may injure or interfere with any waste treatment process, constitute a hazard to humans or animals, create a public nuisance, or create any hazard in the wastewater treatment plant, as sampled at or in the immediate vicinity of the point of discharge to the HOLLYWOOD System. The maximum limits for the below listed substances are:

Antimony	0.200 ppm
Arsenic	0.100 ppm
Barium	5.000 ppm
Beryllium	0.010 ppm
Bismuth	0.045 ppm
Boron	1.000 ppm
Cadmium	0.500 ppm
Chlorides	600.000 ppm
Chromium, Hexavalent	0.500 ppm
Chromium, Total	1.000 ppm
Cobalt	1.000 ppm
Copper, (Total)	2.000 ppm
Cyanides	0.250 ppm
Hydrogen Sulfide	3.000 ppm
Iron	10.000 ppm
Lead	0.400 ppm
Manganese	1.000 ppm

Mercury	0.100 ppm
Molybdenum	0.500 ppm
Nickel	1.800 ppm
Phenols	0.005 ppm
Selenium	0.100 ppm
Silver	0.240 ppm
Strontium	0.200 ppm
Tellurium	0.001 ppm
Tin	0.800 ppm
Toxic Radioactive Isotopes without a special permit	0.000 ppm
Zinc, (Total)	1.000 ppm
Pesticides	0.010 ppm
Herbicides	0.010 ppm
Fungicides	0.010 ppm

The maximum allowable values of the substances listed above may from time to time be revised by federal, state, local regulatory agencies, or HOLLYWOOD, if determined by the Consulting Engineer to be in the best interest of the Hollywood System, in which case PEMBROKE PARK agrees not to exceed such revised maximum limits. HOLLYWOOD shall provide PEMBROKE PARK, written notice, of any amendment or change to said schedule.

(7) Any solid or viscous substance in quantities or of such size capable of causing obstruction to the flow in the sewers or an interference with the proper operation of the wastewater facilities, such as, but not limited to, ashes, cans, sand, straw, shavings, metal, glass, tar, wax, lime slurry, lime residues, chemical residues and paint residues.

(8) Any wastewater containing more than twenty-five (25) milligrams per liter of petroleum oil, non-biodegradable cutting oils, or products of mineral oil origin.

(9) Any water or waste containing more than one hundred (100) milligrams per liter of biodegradable oils, fat,

grease or any oily substances, whether singularly or in a combination.

(10) Any water or wastes containing suspended solids or color or other such characteristics in quantity that unusual attention or expense is required to handle such material at the HOLLYWOOD facility, without a special permit.

(11) Any noxious or malodorous gas or substance which either singularly or by interaction with other wastes, is capable of creating a public nuisance or hazard to life, or which prevents or makes unduly hazardous the entry into sewers for maintenance and repair.

(12) Any water or wastes containing substances which are not amenable to treatment or reduction by the wastewater treatment processes employed, or are amenable to treatment only to such degree that the wastewater treatment plant effluent cannot meet the requirements of other agencies having jurisdiction over discharge to the receiving waters.

(13) Any waters or wastes which constitute a hazard to any structure or appurtenances of the HOLLYWOOD System.

(14) Any water or waste which singularly or in combination with other waters or wastes that inhibit or interfere with the treatment process or may render the treatment plant effluent toxic as determined by regulatory permit requirements.

(15) Any waters or wastes that render the sludge produced by the treatment plant to be other than a Class-I sludge as defined by Florida's Department of Environmental Regulation.

(16) Any substance or constituent in violation of "Federal (National) Categorical Pretreatment Standards" as issued by the United States Environmental Protection Agency, including any amendments or successor enactments thereto, or which exceeds, or would exceed, federal, state or local quality requirement, unless the discharge is allowable by a duly issued operating permit from the Broward County Environmental Quality Control Board.

2. Compliance.

(a) If at any time PEMBROKE PARK shall not comply with the restrictions imposed upon it in the preceding portion of this Article, or if PEMBROKE PARK shall create any condition which HOLLYWOOD should determine destructive to any part of HOLLYWOOD's System, HOLLYWOOD shall give thirty (30) days written notice to PEMBROKE PARK to discontinue such operation or practice, within which period PEMBROKE PARK agrees to comply. If PEMBROKE PARK does not initiate and/or establish a compliance program within ninety (90) days of notification, and/or if any damages result from the discharge of improper wastes by PEMBROKE PARK, HOLLYWOOD reserves the right to provide such preliminary treatment facilities or establish such programs as required to bring PEMBROKE PARK's discharge into compliance. PEMBROKE PARK will be responsible to HOLLYWOOD for all charges, both capital and operational for the establishment of these programs or facilities as described herein. Additionally, failure to comply with the conditions stipulated in Section 1 hereof, shall place PEMBROKE PARK in default of this Agreement.

(b) PEMBROKE PARK recognizes and agrees that HOLLYWOOD has the obligation and authority to perform the below as well as any future activities required by Environmental Protection Agency General Pretreatment Regulations, 40 CFR 403, Section 403.8, as set forth below: HOLLYWOOD agrees to notify PEMBROKE PARK, in writing, and will give PEMBROKE PARK the opportunity to take the appropriate action, prior to HOLLYWOOD taking any of the following actions.

(1) deny or condition new or increased contributions or pollutants, or changes in the nature of pollutants, to the HOLLYWOOD System by industrial user;

(2) require compliance with applicable pretreatment standards and requirements by industrial users;

(3) control, through permit, contract, order, or similar means, the contribution to the HOLLYWOOD System by each industrial user to ensure compliance with applicable pretreatment standards and requirements;

(4) require (a) the development of a compliance schedule by each industrial user for the installation of technology required to meet applicable pretreatment standards and requirements and (b) the submission of all notices and self-monitoring reports from industrial users as are necessary to assess and assure compliance by industrial users with pretreatment standards and requirements, including, but not limited to, the reports required in Paragraph 403.12;

(5) carry out all inspection, surveillance and monitoring procedures necessary to determine, independent of

information supplied by industrial users, compliance or non-compliance with applicable pretreatment standards and requirements by industrial users;

(6) obtain remedies for non-compliance by an industrial user with any pretreatment standard and requirement.

(c) The parties mutually agree that no statement contained herein shall be construed as preventing any special agreement or arrangement between HOLLYWOOD and PEMBROKE PARK or any user within PEMBROKE PARK's Service Area, whereby an industrial waste of unusual strength or charter may be accepted by HOLLYWOOD for treatment, subject to additional payment by PEMBROKE PARK, or said user.

(d) HOLLYWOOD agrees to provide PEMBROKE PARK with written notification of changes to the Regulations and a copy of the EPA required Pretreatment Annual Report.

(e) Nothing contained herein shall obligate PEMBROKE PARK to pay any costs incurred by HOLLYWOOD for pretreatment facilities required as a direct result of discharge of improper wastes into the HOLLYWOOD System by other Large Users.

3. Sampling.

a. PEMBROKE PARK agrees to include in the design of its wastewater delivery system a sampling station so that HOLLYWOOD can take representative samples of the wastewater as a means of monitoring the characteristics of the wastewater received from PEMBROKE PARK, and PEMBROKE PARK shall further provide to HOLLYWOOD such right-of-way or easements as may be

necessary to assure HOLLYWOOD of access to the sampling station site. HOLLYWOOD shall, upon notification to PEMBROKE PARK, have the right at any time to collect samples of sewage and industrial wastes at selected locations within PEMBROKE PARK's facilities for the purpose of making laboratory analysis of these wastes. The cost of collecting and then testing such samples shall be considered a HOLLYWOOD facility treatment and effluent disposal operating expense.

b. PEMBROKE PARK shall, upon written request, submit annually to HOLLYWOOD, no later than April 1 of each year, a laboratory analysis conducted by a State certified laboratory of composite samples of the combined Industrial and Domestic Wastes leaving PEMBROKE PARK's facilities at each point of connection. The costs for said submission shall be borne by PEMBROKE PARK. PEMBROKE PARK shall give HOLLYWOOD five (5) days written notice exclusive of Saturday, Sunday and holidays, of its intent to take the required samples, in order that HOLLYWOOD may be present at the time the sample is taken. The analysis made pursuant to this paragraph shall be made on twenty-four (24) hour representative samples and may include temperature, pH, and those substances listed in paragraph 1b(3), (5), (6), (8) and (9) above. HOLLYWOOD shall direct PEMBROKE PARK as to the particular samples, including pesticides, herbicides and/or fungicides for which analysis is required.

4. Regulatory Action.

a. PEMBROKE PARK agrees to adopt, enact and enforce such necessary rules, regulations and/or ordinances as

may be required so as to ensure that the users of PEMBROKE PARK's system do not discharge or cause to be discharged waters or wastes which would cause PEMBROKE PARK's wastewater to be unacceptable under the provisions of this Article, and to furnish to HOLLYWOOD certified copies of said regulations, rules and/or ordinances within one hundred eighty (180) days from the date of enactment of same or one hundred eighty (180) days from the date of this Agreement, whichever shall first occur.

b. PEMBROKE PARK shall be responsible for implementation in its system of federal, state or local regulations imposed on HOLLYWOOD or PEMBROKE PARK, either now or in the future.

5. Additional Charge for Wastes of Unusual Strength. In lieu of the remedies set forth in paragraph 2 of the Article above, in the event of a violation or default by PEMBROKE PARK pursuant to this Article, PEMBROKE PARK shall be subject to an additional charge which shall, upon imposition, be included in PEMBROKE PARK's monthly billing(s) subsequent to said determination by HOLLYWOOD. Designation of waste as being of unusual strength or character shall occur when the contributed wastewater parameters exceed those set forth in paragraph 1 of this Article. The additional charge shall be based upon HOLLYWOOD's total cost incurred in providing treatment, additional treatment programs, or additional facilities for the treatment of such wastes of unusual strengths. Any monies received from this Section shall be applied by HOLLYWOOD first to pay for the cost of correcting the problem caused by PEMBROKE

PARK and then to reduce the relevant operating expense of the HOLLYWOOD System.

6. Emergency Action. Notwithstanding anything to the contrary contained above, if at any time during the term of this Agreement, HOLLYWOOD determines, in its sole and absolute discretion, that PEMBROKE PARK's failure to comply with the restrictions imposed upon it by this Agreement constitutes such an immediate threat to the HOLLYWOOD System and/or the public health or safety so as to constitute an emergency situation requiring immediate remedial action, then, in that event, HOLLYWOOD may declare an emergency situation to exist and upon written notice to PEMBROKE PARK, may proceed to take whatever corrective action it deems necessary as to said emergency to prevent further nuisance or damage to HOLLYWOOD's System without the necessity of giving notice (other than notice of the emergency situation) to PEMBROKE PARK or affording PEMBROKE PARK an opportunity to remedy the situation. Any costs incurred by HOLLYWOOD in response to an emergency situation shall be charged to PEMBROKE PARK, and shall be the sole responsibility of PEMBROKE PARK to pay.

ARTICLE IV. CHARGES AND BILLING

1. Annual Estimate. HOLLYWOOD shall estimate all costs (on a Fiscal Year basis) of providing wastewater transmission, treatment, and disposal services to PEMBROKE PARK beginning with Fiscal Year 88-89. This annual estimate shall be the basis for PEMBROKE PARK's monthly billings during the next succeeding Fiscal Year. Adjustments will be made annually as described below based upon actual flows and actual costs when known.

2. Billings Procedure. The parties hereto agree that HOLLYWOOD shall provide wastewater transmission, treatment and disposal services to PEMBROKE PARK, at rates and charges constituting the full and actual costs of such service, including but not limited to Operation, Maintenance and Administrative costs, Renewal, Replacement and Improvement Account Contributions, Debt Service Charges, Depreciation Charges, and compensatory charges, and HOLLYWOOD shall set the same proportionate rates and charges for all Large Users of the HOLLYWOOD System. PEMBROKE PARK shall pay a monthly charge to HOLLYWOOD, as calculated pursuant to Section IV-1. above, for wastewater transmission, treatment and disposal services provided by HOLLYWOOD, commencing on the date of execution of this Agreement. Such charges shall be paid to HOLLYWOOD by PEMBROKE PARK monthly, and shall include the following components:

a. Operation, Maintenance and Administrative Costs. Operation, Maintenance and Administrative Costs are defined in Article I, paragraph 19 hereof, and will be estimated

for each Fiscal Year. The portion of the monthly charge to PEMBROKE PARK for Operation, Maintenance and Administrative Costs shall be based on the estimated rate per thousand gallons and shall be applied on actual flow used by PEMBROKE PARK during the billing period.

(1) Adjustment to Operation, Maintenance and Administrative Costs. At the end of each Fiscal Year, an annual adjustment shall be computed to determine PEMBROKE PARK's share of the actual Operation, Maintenance and Administrative Costs. This computation will be based upon the actual operation, maintenance and administrative expenses recorded for the HOLLYWOOD System for that Fiscal Year, multiplied by PEMBROKE PARK's percentage of the actual number of gallons of wastewater treated and disposed of through the HOLLYWOOD System for that Fiscal Year. Each adjustment in the operation, maintenance and administrative monthly charges shall be made subsequent to, and subject to final verification of the operation, maintenance and administrative expenses incurred which verification shall be included in the annual review of said charges. The above-referenced annual review shall be performed by an independent Financial Consultant selected by HOLLYWOOD and shall be distributed to PEMBROKE PARK on or before March 31 of the year following the end of each Fiscal Year. In the event the annual adjustment reflects that an underpayment has been made by PEMBROKE PARK with regard to Operation, Maintenance and Administrative Costs, then the amount due and owing for said underpayment shall be shown as a separate line item on the next

monthly bill sent to PEMBROKE PARK after the adjustment has been made. In the event the annual adjustment reflects that an overpayment has been made by PEMBROKE PARK, with regard to Operation, Maintenance and Administrative Costs, then in that event the amount of said overpayment shall be credited to PEMBROKE PARK as a separate line item on the next monthly bill after the adjustment has been made.

b. Debt Service Charges. Debt Service Charges, as defined in Article I, paragraph 3, for the HOLLYWOOD System shall be computed annually as follows: (i) with respect to projects relating to improvement and upgrading of the HOLLYWOOD System, PEMBROKE PARK's Debt Service Charges shall be computed annually by taking the ratio of the amount of PEMBROKE PARK's actual flow to the total flow of the HOLLYWOOD System for each Fiscal Year, multiplied annually by the total debt service due in that Fiscal Year for such upgrading project(s); (ii) with respect to projects relating to the initial plant capacity expansion of the HOLLYWOOD System, PEMBROKE PARK's Debt Service Charges shall be computed annually by taking the difference between PEMBROKE PARK's actual ADF Flows for Fiscal Year 1988-89 and PEMBROKE PARK's projected ADF Flow for the Fiscal Year 1999-2000 and then dividing that difference by the projected increase in capacity in the HOLLYWOOD System over and above the total System capacity for the Fiscal Year 1988-1989 as a result of such planned capacity expansion; and then multiplying that fraction by the total debt service due in that Fiscal Year for such expansion project(s); provided however, PEMBROKE PARK's Debt Service Charges with

respect to this initial capacity expansion financing will be adjusted pursuant to Article II, Section 6.B. in the event that PEMBROKE PARK's actual flows exceed its projected flows for Fiscal Year 1999-2000; and (iii) with respect to projects relating to transmission pipes and related transmission facilities within the HOLLYWOOD System, PEMBROKE PARK's Debt Service Charges shall be computed annually by multiplying the proportional cost, based on design, of the new transmission facilities which are required by PEMBROKE PARK by the total debt service due in that Fiscal Year for such transmission project. In addition, except as otherwise set forth in Exhibit "D" hereto, any Debt Service Charges which may be due HOLLYWOOD from PEMBROKE PARK by reason of any financings relating to the HOLLYWOOD System under the Prior Agreement (other than financings for transmission) shall be recalculated in accordance with the applicable formulae set forth above. The above described formulae are illustrated in Exhibit "D" attached hereto. In determining which projects are related to upgrading or expansion of the Hollywood System, prudent engineering judgment shall be used. The Debt Service Charges relating to any additional plant capacity expansions of the HOLLYWOOD System shall be borne by the Large Users who require said expansion in proportion to their respective needs.

c. Depreciation Charges. Depreciation Charges as defined in Article I, paragraph 4 above, shall be computed based on PEMBROKE PARK's proportionate share (as established in the Prior Agreement) of the three (3%) percent per year depreciation

on the existing facilities constructed from revenues of HOLLYWOOD other than the HOLLYWOOD Sewer System Bond proceeds and federal grants; the cost of said facilities being One Million Ninety-Six Thousand Eight Hundred Sixty and 74/100 ($1,096,860.74) Dollars.

d. Renewal, Replacement and Improvement Account Contribution.

(1) Funds from the Renewal, Replacement and Improvement Account, shall be used for the improvement, repair and replacement of the HOLLYWOOD System. Said Account shall be funded through contributions made monthly by PEMBROKE PARK to said account. As of October 1, 1988, the balance in PEMBROKE PARK's Account is deemed to be zero, and all other amounts on deposit in said account shall be carried forward. HOLLYWOOD shall maintain a separate Renewal, Replacement and Improvement Account for each Large User. Any amounts collected by HOLLYWOOD for PEMBROKE PARK's Account shall be utilized by HOLLYWOOD only for renewals, replacements and improvements to the HOLLYWOOD System. HOLLYWOOD shall use prudent engineering judgment in determining the need for renewal, replacement and improvement projects. Expenditure of funds on deposit in each Large User's RR&I Account shall be made based on their respective percentage of the total System flows. The contributions made by PEMBROKE PARK to the Account shall be in addition to all other charges collected by HOLLYWOOD set forth herein. Except as otherwise provided herein, PEMBROKE PARK's monthly contribution to this Account shall be ten percent (10%) of PEMBROKE PARK's monthly total bill for wastewater transmission and treatment, including,

but not limited to, Debt Service Charges, Depreciation Charges, and Operation, Maintenance and Administrative Costs. Payments to said Account shall continue to be made monthly at the aforestated rate until such time as PEMBROKE PARK's Account contains funds equal to PEMBROKE PARK's share of a maximum amount of five (5%) percent of the actual cost of the HOLLYWOOD System, and as said System may be expanded from time to time. During any period in which PEMBROKE PARK's Account is maintained at a level equaling its pro rata share of five percent (5%) of the actual cost of the HOLLYWOOD System, as expanded, no monthly payments shall be due from PEMBROKE PARK to this Account; provided, however, that pursuant to this Article, the maximum level may be modified from time to time, in which event PEMBROKE PARK shall resume making monthly payments to this Account until its required contribution level is reached. In the event the balance in PEMBROKE PARK's Account shall at any time fall below the maximum prescribed level set forth herein, then at that time PEMBROKE PARK shall resume making monthly payments in accordance with this paragraph so as to bring the balance in said Account to the maximum prescribed level. Said Account shall include any unexpended monies deposited since October 1, 1988, remaining on deposit in the special renewal or replacement and improvement fund established under the Prior Agreement between the parties. Contributions to the Renewal, Replacement and Improvement Account shall earn interest at HOLLYWOOD's pooled fund interest rate, which interest shall be credited annually based on the average monthly balance in PEMBROKE PARK's Account.

(2) In the event it is necessary to renew, replace or improve an element of the HOLLYWOOD System for which sufficient funds are not available in the Renewal, Replacement and Improvement Account established for PEMBROKE PARK, HOLLYWOOD shall notify PEMBROKE PARK of the deficiency in said Account. PEMBROKE PARK shall have a period of sixty (60) days from the date of said notification to contribute any said deficiency to the Renewal, Replacement and Improvement Account. In the event PEMBROKE PARK has not made said deficiency contribution within sixty (60) days of the date of notification of the deficiency by HOLLYWOOD, HOLLYWOOD, at its option may: (i) obtain financing necessary to fund the deficiency, in which event PEMBROKE PARK shall pay the cost of said financing as additional Debt Service Charges; or (ii) HOLLYWOOD may fund the deficiency internally, in which event PEMBROKE PARK shall repay HOLLYWOOD the amount of the deficiency, plus interest at HOLLYWOOD's earned interest rate as an additional monthly charge to PEMBROKE PARK, over a period of not less than sixty (60) months and not greater than one hundred twenty (120) months.

3. Additional Capacity. At such time as financing is secured for construction of additional facilities as contemplated in Article V below, so as to service the various Large Users, or it becomes necessary for PEMBROKE PARK to secure additional transmission or treatment capacity, PEMBROKE PARK shall pay all additional Debt Service Charges based on the formulae set forth in Article IV, 2(b) hereof.

4. Payment and Penalties for Nonpayment. The parties agree that HOLLYWOOD shall bill PEMBROKE PARK for providing the services necessary for wastewater treatment, transmission and disposal, on a monthly basis in accordance with HOLLYWOOD's standard billing procedures. PEMBROKE PARK shall pay such billings within forty-five (45) days of the receipt of the monthly bill. Should a billing or a portion of the billing be outstanding for a period of more than forty-five (45) days from the date of receipt of the original billing, then PEMBROKE PARK shall be considered in default of this Agreement. Should PEMBROKE PARK not pay within the forty-five (45) day period set forth herein, PEMBROKE PARK shall pay interest on the unpaid balance at the rate of twelve percent (12%) per annum.

5. Dispute Over Amounts Billed. PEMBROKE PARK agrees that in the event of a dispute as to a billing invoice or the amount PEMBROKE PARK owes on a monthly bill, and which dispute the parties cannot resolve within forty-five (45) days from the date of receipt of the original invoice, then PEMBROKE PARK shall automatically deliver to HOLLYWOOD the total amount billed and an adjustment of the billing invoice amount, if any, shall be made subject to subsequent agreement or adjudication. The amount of such charge that is in dispute shall be held in escrow by HOLLYWOOD until the dispute is resolved, provided however, that in the event the disputed amount relates to Debt Service Charges, then HOLLYWOOD shall be entitled to apply such disputed amount to make debt service payments when due.

6. Access to Records. HOLLYWOOD agrees that it shall maintain accurate accounting records for the wastewater collection, treatment and disposal facilities, and that HOLLYWOOD will make available to PEMBROKE PARK for inspection or review said records upon reasonable advance notice (at least fifteen 15 days) and specific written request as to the records requested. Any questions or explanations necessary as to the information contained in such records shall be addressed at the Large Users' Advisory Committee meetings.

ARTICLE V. ADDITIONAL OBLIGATIONS OF THE PARTIES

1. Expansion of the Hollywood Regional Wastewater Treatment Facilities. HOLLYWOOD and PEMBROKE PARK acknowledge that the present rated capacity of the HOLLYWOOD Regional Wastewater Treatment Facilities is 38 MGD, and that subsequent to the execution of this Agreement and similar agreements between HOLLYWOOD and the other Large Users, that the HOLLYWOOD System is planned to be initially expanded to treat the total projected flow requirements for the year 1999-2000 of all Large Users, including HOLLYWOOD. In the event that any further plant expansion(s) become necessary, then the costs, including the Debt Service Charges, relating to such additional expansion(s) shall be borne by those Large Users who require said expansion(s) in proportion to their respective needs. In the event that the HOLLYWOOD System is rerated without any capital expenditure to an MGD in excess of its then current capacity by an agency with regulatory authority to rerate the capacity of the plant, then each of the Large Users, including HOLLYWOOD, shall be given credit for such increased capacity on a pro rata basis in proportion to their maximum projected reserved flows set forth in Article II, Section 6.B. hereof as adjusted or amended, as a percentage of total projected reserved flows for all Large Users into the HOLLYWOOD System at the time of rerating.

2. Cost of Expansion of the Hollywood Regional Wastewater Treatment Facilities. At such time as HOLLYWOOD, determines it is necessary, in order to respond to the needs of the Large Users utilizing the HOLLYWOOD System, to expand the

HOLLYWOOD System, HOLLYWOOD shall charge PEMBROKE PARK monthly one-twelfth (1/12) of PEMBROKE PARK's annual Debt Service Charges then due attributable to said expansion which shall be computed in accordance with the formulae set forth in Article IV, 2(b) hereof. Said Debt Service Charges will be imposed at the time that HOLLYWOOD incurs the debt.

Nothing contained herein shall obligate HOLLYWOOD to undertake financing, either by issuing wastewater system revenue bonds, or any other financial mechanism, without the cooperation of PEMBROKE PARK, and the other Large Users and PEMBROKE PARK agrees to cooperate and execute any reasonably necessary document that may be required by the credit enhancement provider, bond insurer or rating agencies in order for HOLLYWOOD to obtain the financing for the expansion contemplated herein, including, documents, representations and consents, if any, required by bond rating agencies and municipal bond insurers or credit enhancement providers in connection with obtaining a credit rating or bond insurance on the bonded obligations; provided however, that PEMBROKE PARK shall not be required to execute any document or note that creates a bonded indebtedness directly to PEMBROKE PARK.

3. PEMBROKE PARK's Obligation to Deliver Wastewater. Except as otherwise provided in Article II hereof, PEMBROKE PARK agrees that during the term of this Agreement, it shall deliver all existing, and future wastewater flows collected by it, from within its Service Area as set forth in Exhibit "B", to the HOLLYWOOD System, and HOLLYWOOD agrees to accept such wastewater

flows from PEMBROKE PARK's Service Area on the terms and conditions set forth herein.

4. PEMBROKE PARK's Cooperation. PEMBROKE PARK agrees to cooperate and execute any necessary documents to effect the agreements contained herein, and to cooperate with HOLLYWOOD under the terms of the Florida Intergovernmental Cooperation Act as may be required from time to time in furtherance of this Agreement, and PEMBROKE PARK further agrees that it shall take no action which would jeopardize the tax exempt status, pursuant to the Internal Revenue Code, as amended from time to time, of the interest on any debt now or hereafter issued to finance the HOLLYWOOD System.

5. Changes Required by Outside Agencies. Notwithstanding HOLLYWOOD's obligations with respect to treating and disposing PEMBROKE PARK's flows as provided herein, HOLLYWOOD may revise the schedule of flows set forth herein in the event any federal, state or local agency having jurisdiction promulgates rules and regulations that would affect the amount or quality of flow HOLLYWOOD can treat or dispose. In that event, the parties agree to comply with any such rule or regulation and make such amendments to this Agreement as may be necessary, provided, however, that should there be a determination by either party that the rules or regulations so promulgated are unreasonable or not binding, the parties hereto reserve the right to challenge said regulations. HOLLYWOOD and PEMBROKE PARK acknowledge that certain federal, state and local agencies have jurisdiction or control over pollution matters and, should such

agency issue legal and enforceable orders or rules that may alter any of the terms and conditions of this Agreement, there shall be no liability on either party by reason of such action, provided that HOLLYWOOD shall not be precluded from making any necessary adjustments to the sewage collection and treatment rates; provided further, that any increased costs incurred by HOLLYWOOD from any such action shall be assessed pro rata to PEMBROKE PARK based on PEMBROKE PARK's actual flows; unless said adjustments are occasioned solely by the acts of Large Users other than PEMBROKE PARK, in which case PEMBROKE PARK shall not be liable for said adjustments.

6. Adequate Rate Schedule. PEMBROKE PARK agrees that it shall establish and maintain rates and service charges or other means of obtaining funds within its Service Area which shall be sufficient to provide the monthly payments to HOLLYWOOD for the wastewater collection and treatment service contemplated herein, and such rates and charges shall be revised as may be required from time to time to provide sufficient funds to pay any sums due HOLLYWOOD under the terms of this Agreement.

ARTICLE VI. PROVISIONS RELATING TO TERMINATION OF AGREEMENT AND ASSIGNMENT OF HOLLYWOOD'S RIGHTS AND OBLIGATIONS

1. Termination Clause. Except as otherwise provided in Section 2 of this Article VI, this Contract may be terminated at any time by either participating party on one (1) years notice (or such shorter time as the parties shall mutually agree) to the other in writing by certified mail, only under the following conditions:

a. Termination by PEMBROKE PARK.

(1) Subject to subsection (3) below, PEMBROKE PARK shall pay to HOLLYWOOD in advance of termination all Debt Service Charges which would otherwise have been chargeable to PEMBROKE PARK under the terms of this Agreement (based upon a weighted average for future years using projected flows). If such Debt Service Charges can be reduced by calling bonds for redemption or otherwise providing for their payment prior to maturity under the terms of their issuance and if PEMBROKE PARK provides HOLLYWOOD with sufficient money to cover its Debt Service Charges and all expenses in connection with such call for redemption, including premiums, legal fees and costs, publication costs, and trustees and paying agents fees and mailing costs, then HOLLYWOOD shall call for redemption as many of such bonds as may be called under their terms with the money paid by PEMBROKE PARK to HOLLYWOOD. HOLLYWOOD reserves the right to determine which bonds to call.

(2) Subject to subsection (3) below, PEMBROKE PARK shall, in addition to Debt Service Charges, pay to HOLLYWOOD a sum equal to the then present value of all other

payments which, in the absence of such termination, would be made by PEMBROKE PARK to HOLLYWOOD hereunder during the period when HOLLYWOOD would receive and treat wastewater from PEMBROKE PARK, through and including five (5) years from the date of termination using PEMBROKE PARK's annual payment in the year of termination. The "then present value" as used above means the value on the termination date of the various sums payable thereafter, discounted at the then prevailing Prime interest rate plus all payments due and past due with interest at the then prevailing Prime interest rate from the date due to the termination date. In making such determination, PEMBROKE PARK shall be given full credit for all actual reductions, if any, in HOLLYWOOD's expenses of operation and maintenance, and administration which reductions are attributable to the termination of this Agreement. Hollywood shall also have an affirmative obligation to take such actions as are available in order to mitigate its expenses.

(3) There shall be deducted from the sums of the amounts payable by PEMBROKE PARK under subparagraphs (1) and (2) above any amount of liability (not in excess of said sum) assumed in writing by any other municipality, political subdivision or other entity, simultaneous with or prior to such termination if (a) capability of municipality, the political subdivision or other entity assuming such liability to satisfy the same shall be found satisfactory by HOLLYWOOD, (b) such municipality, political subdivision or other entity shall execute an agreement with HOLLYWOOD substantially the same as this Agreement, (c) whenever any revenue bonds of the CITY OF HOLLYWOOD payable in whole or in

part from sewer revenues are then outstanding which are secured by ordinance, resolution or indenture empowering a trustee or other agent on behalf of the holders of such bonds to consent to said assumption of liability, if such trustee or other agent's consent shall have been obtained in writing, and (d) PEMBROKE PARK shall execute and deliver to HOLLYWOOD, in a form acceptable to HOLLYWOOD, an agreement releasing and holding HOLLYWOOD harmless and indemnifying HOLLYWOOD from any responsibility, liability or claim for or relating to collecting and/or treating PEMBROKE PARK's wastewater from and after the date of termination of this Agreement.

b. Termination by HOLLYWOOD.

(1) There shall be a readily available alternative means of treating and disposing of the wastewater of PEMBROKE PARK which HOLLYWOOD would otherwise be required to treat and dispose of under this Agreement and such alternative means must meet all state, federal and local requirements pertaining to the public health, the pollution of public water and the protection of the environment generally.

(2) Any revenue bonds of the CITY OF HOLLYWOOD payable in whole or in part from wastewater revenues are secured by ordinance, resolution or indenture which requires a trustee or other agent for the holders of such bonds to consent to such termination on their behalf, such trustee or agent shall so consent in writing.

(3) HOLLYWOOD shall pay to PEMBROKE PARK an amount equal to the sum of (a) the actual expenses incurred by

ARTICLE VII. PROVISIONS RELATING TO DEFAULT

1. Default.

a. The parties agree that in the event either party commits an act of default under any of the terms or provisions of this Agreement, the party so defaulting shall be liable to the other party for any expenses, loss or damage occasioned by reason of such default.

b. The parties acknowledge that in order to construct the planned expansion of the HOLLYWOOD System, it is necessary for revenue bonds to be issued from time to time to provide the funding source for said expansion program and, by reason of such obligations incurred by HOLLYWOOD with regard to said bond financing, it is imperative that HOLLYWOOD be paid in a timely fashion the sums due from PEMBROKE PARK pursuant to this Agreement. In light of the obligations to the bondholders, and the acknowledgments that HOLLYWOOD has relied on PEMBROKE PARK's representation that payment of all sums due HOLLYWOOD under the terms of this Agreement shall be prompt in their remittal, the parties hereby agree to resolve disputes over monthly billings in accordance with Section 2 hereof. In the event that PEMBROKE PARK shall have committed an act of monetary default by failing to pay a monthly service bill within forty-five (45) days of receipt of said bill, then PEMBROKE PARK shall pay an interest penalty on the unpaid balance at the rate of 12% per annum and HOLLYWOOD shall have, in addition to any other rights and remedies provided for herein, the right and power, by suit, action, mandamus or other such proceedings at law or in equity,

3. Non-Monetary Default. Except as otherwise expressly provided herein, with respect to non-monetary defaults only, committed by PEMBROKE PARK, the default, if not otherwise resolved after due and diligent effort by both parties, shall be submitted to binding arbitration as set forth in paragraph 4 below.

4. Arbitration. Any non-monetary dispute between HOLLYWOOD and PEMBROKE PARK arising from this Agreement which cannot otherwise be resolved after due and diligent effort by both parties, shall be the subject of binding arbitration. Said arbitration shall be conducted by a board of three arbitrators, each of whom shall be qualified as a licensed engineer or a certified public accountant, or otherwise qualified person, and who shall not be employed by either party on a regular salaried basis. Each party to this Agreement shall choose one arbitrator, and the two so chosen shall choose a third who shall act as chairperson. The fees, charges and expenses of such arbitrators shall be borne equally by the parties hereto. PEMBROKE PARK agrees that during any such period of arbitration, it will continue to promptly make all payments due HOLLYWOOD, pursuant to the terms of this Agreement and Hollywood shall continue to provide wastewater treatment services to PEMBROKE PARK in accordance with the terms hereof.

5. Litigation and Arbitration Costs.

a. PEMBROKE PARK agrees that, to the extent legally permitted, it shall indemnify and hold HOLLYWOOD harmless from and against any and all costs or expenses incurred by HOLLYWOOD in the event of any litigation in which PEMBROKE PARK or HOLLYWOOD is or may become a party as either Plaintiff or Defendant, which results from and is determined to be caused in whole or in part from the effects of the improper introduction of materials by PEMBROKE PARK or any users of PEMBROKE PARK's System into the HOLLYWOOD System, or any portion thereof which may cause damage within or without the HOLLYWOOD System.

b. In the event of litigation between the parties to enforce the terms of this Agreement, then in that event the prevailing party shall be entitled to recover all costs and fees incurred, including but not limited to reasonable attorneys' fees.

6. Fines. In the event any fines, penalties or damages are incurred or imposed by or on HOLLYWOOD by reason of PEMBROKE PARK's violation or default of its obligations under this Agreement, then, in that event, PEMBROKE PARK shall be solely responsible for the payment of same.

7. Force Majeure. The parties agree that in the event of a temporary cessation of wastewater transmission which results from an act of God, hurricane, lightning, fire, strike, casualty, necessary maintenance work, breakdown of machinery, insurrection or riot, that said temporary cessation shall not constitute a default in this Agreement on the part of either of

the parties, and neither party shall be liable to the other for any damage resulting from such cessation, and unless written notice to the contrary is received from any federal, state or local agency, or any court having jurisdiction over the subject matter, HOLLYWOOD shall continue to accept and dispose the wastewater transmitted to it by PEMBROKE PARK if possible, regardless of the degree of treatment available and PEMBROKE PARK, during any such period of interruption or reduced treatment shall continue to pay its share of Debt Service Charges due and the actual costs incurred by HOLLYWOOD. In the event the amount of the Debt Service Charges and actual costs incurred during any period of temporary cessation cannot be determined by reason of no flow, or insufficient flow of wastewater, then the Debt Service Charges and actual costs incurred paid by PEMBROKE PARK shall be based on the twelve (12) month period prior to said interruption of service or reduced treatment.

ARTICLE VIII. ADMINISTRATION

1. Execution and Agreement. The parties hereto agree that upon execution of this Agreement by the appropriate officials of HOLLYWOOD and PEMBROKE PARK, that said Agreement shall be in full force and effect as of the date of said execution, provided that the effective date for billing purposes and calculations of amounts owed shall be as of October 1, 1988. Upon execution, this Agreement shall be filed with the official records of the Broward County Clerk's Office.

2. Large Users Advisory Committee (LUAC). The parties agree that HOLLYWOOD shall, subject to the terms contained herein, have sole and exclusive authority as to the administration, operation and maintenance of the HOLLYWOOD System, including establishment of the annual budget, establishment and amendment of service fees, rates and other charges necessary for the efficient operation and maintenance of the HOLLYWOOD System; provided however, that commencing with the charges to be paid by PEMBROKE PARK during the 1991-92 Fiscal Year and each Fiscal Year thereafter, Hollywood will consult with PEMBROKE PARK and each of the other members of the Large User's Advisory Committee on or before May 15 of each Fiscal Year with respect to establishing the proposed respective fees, rates, RR&I contributions and other charges to be paid by the Large Users in the next ensuing Fiscal Year. In addition, HOLLYWOOD shall have the obligation to meet with the Large Users Advisory Committee at least quarterly to review rate and budgeting matters and the Committee shall have the right to make recommendations to

HOLLYWOOD concerning these matters. HOLLYWOOD also agrees to meet with the Large User's Advisory Committee and discuss any plans relating to relocation of System facilities prior to any definitive action.

3. Invalidity of Provision. In the event it is determined that any section, clause, sentence, or provision of this Agreement shall be invalid, then same shall not affect the validity of any other part of this Agreement which can be given effect without such invalid part or parts. The parties agree that this Agreement shall be binding upon the successors and assigns of the parties hereto and may be enforced by appropriate action of court, or courts of competent jurisdiction.

4. Legal Requirements. The parties agree that each has complied with all necessary legal requirements for execution of this Agreement, including but not limited to due consideration of the terms and conditions hereof by the appropriate governing body of each municipality and its city attorney, and public hearing on this matter; and each party hereto agrees to exchange with the other, certified copies of any official records of its governing body authorizing the execution of this Agreement on its behalf.

5. Notice. Any notice required to be given hereunder in writing shall be considered to be properly given if the same has been sent in writing by certified or registered mail to the following:

HOLLYWOOD: City of Hollywood
2600 Hollywood Boulevard
Hollywood, FL 33021

Attention: City Utilities Director
Copy to: City Attorney

PEMBROKE PARK: _____

_____

_____

6. Prior Agreements. This document, upon its execution by both parties shall supersede any and all prior negotiations, correspondence, conversations, Large User agreements, including the Prior Agreement and any amendments thereto, or understandings applicable to the matters contained herein and the parties agree that there are no commitments, agreements or understandings concerning the subject matter of this Agreement that are not contained in this document. Accordingly, it is agreed by the parties that there shall be no deviation from the terms hereof which shall be predicated upon any prior representation or agreements whether oral or written, unless said are specifically provided for herein.

7. Modification, Amendment or Alteration. Except as otherwise expressly provided herein as to certain matters which only require written notice, no modification or amendment to the terms or conditions of this Agreement shall be effective unless contained in a supplemental document executed with the same formality of this Agreement and attached hereto.

8. Findings. All of the recitations contained in the preamble of this Agreement are true and correct and incorporated herein by reference.

9. Counterpart Execution. This Agreement may be executed in counterpart originals, each of which shall be deemed an original. PEMBROKE PARK shall provide HOLLYWOOD with a certified copy of PEMBROKE PARK's resolution or evidence of other such action authorizing PEMBROKE PARK to execute this Agreement.

IN WITNESS WHEREOF, the parties hereto have made and executed this Agreement on the respective dates under each signature.

Signed, sealed and delivered
in the presence of:

Suzanne Torres

Carole Glover

HOLLYWOOD:

CITY OF HOLLYWOOD, a
Municipal Corporation of
the State of Florida

By: Sal Oliveri, Mayor

Dated: Oct. 30, 1990

Attest:

Martha S. Lambos, City Clerk

Prepared and approved as to
form and legality by:

Alan B. Koslow
City Attorney

(See prior page for additional signatures)
(Additional signatures to the Large User Wastewater Agreement between HOLLYWOOD and PEMBROKE PARK)

Approved:

Paul E. Wimberly
Finance Director

for Acting Director

Robert A. Creighton
Utilities Director

PEMBROKE PARK:
a municipal corporation of
the State of Florida

By: Bill Lyddon
BILL LYDDON
Mayor-Commissioner


Dated: October 26, 1990

Attest: Theresa Ciummo
Clerk-Commissioner
THERESA CIUMMO

Approved as to Form and Legality:

A. J. RYAN, JR.
Town Attorney

By:_____

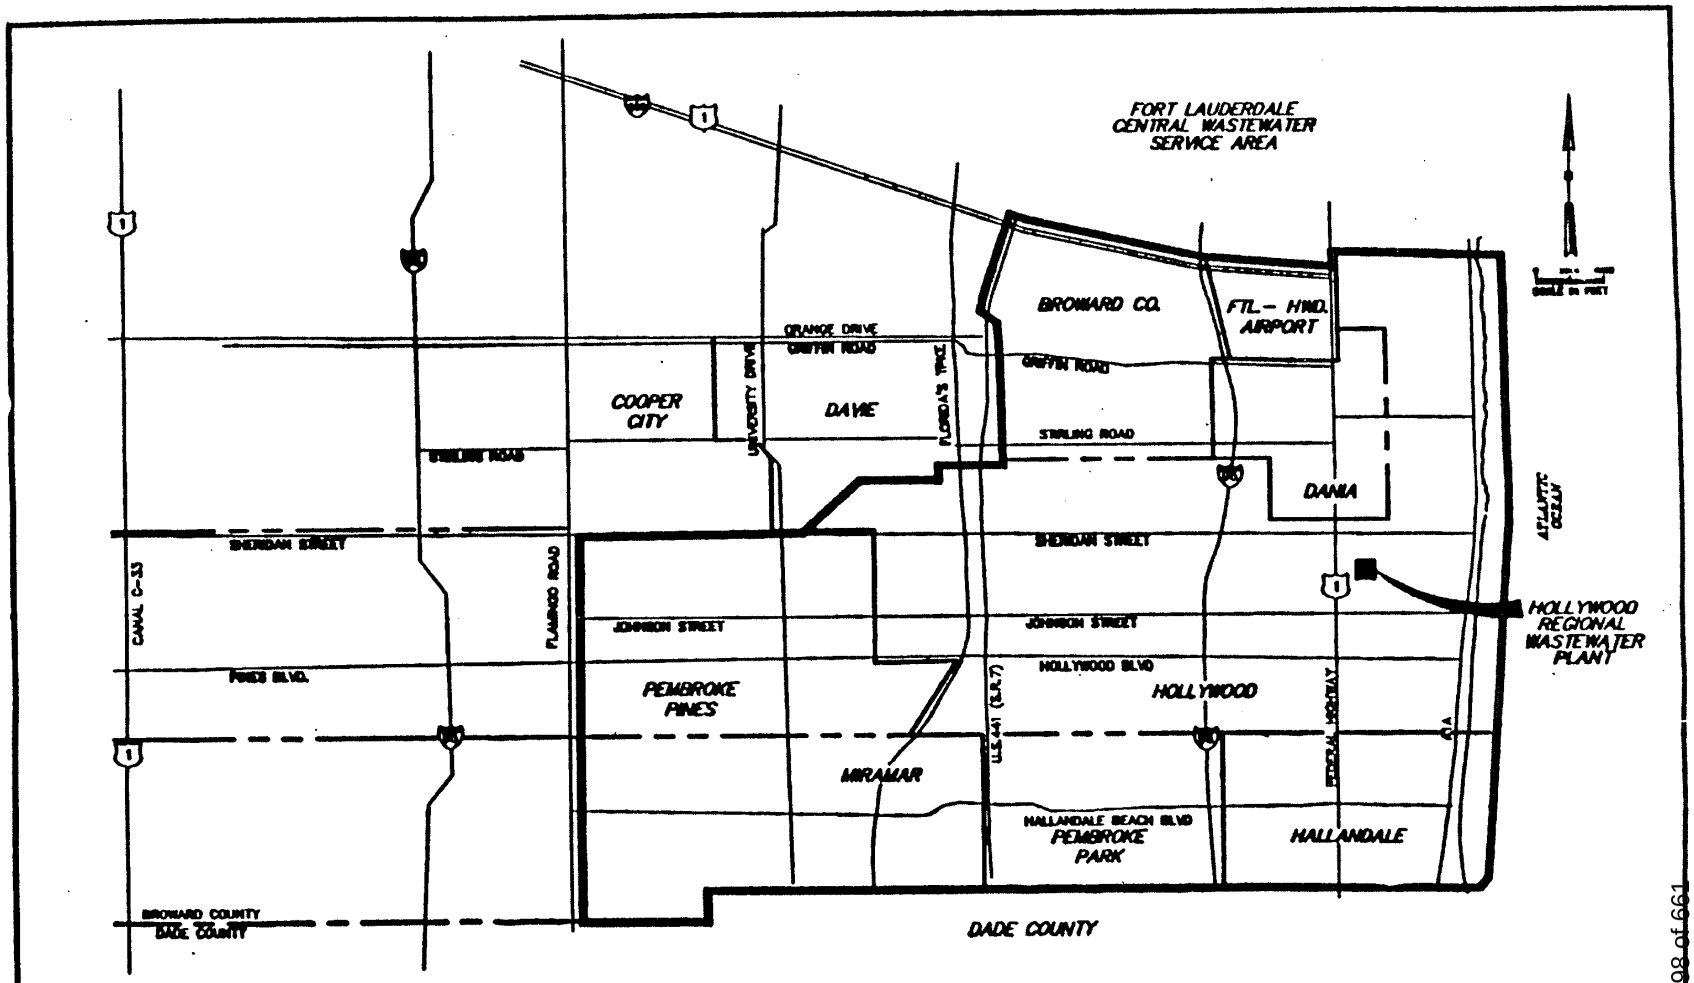

LEGEND

SOUTH BROWARD REGIONAL SERVICE AREA

CITY LIMITS

4840X100

SOUTH BROWARD REGIONAL SERVICE AREA

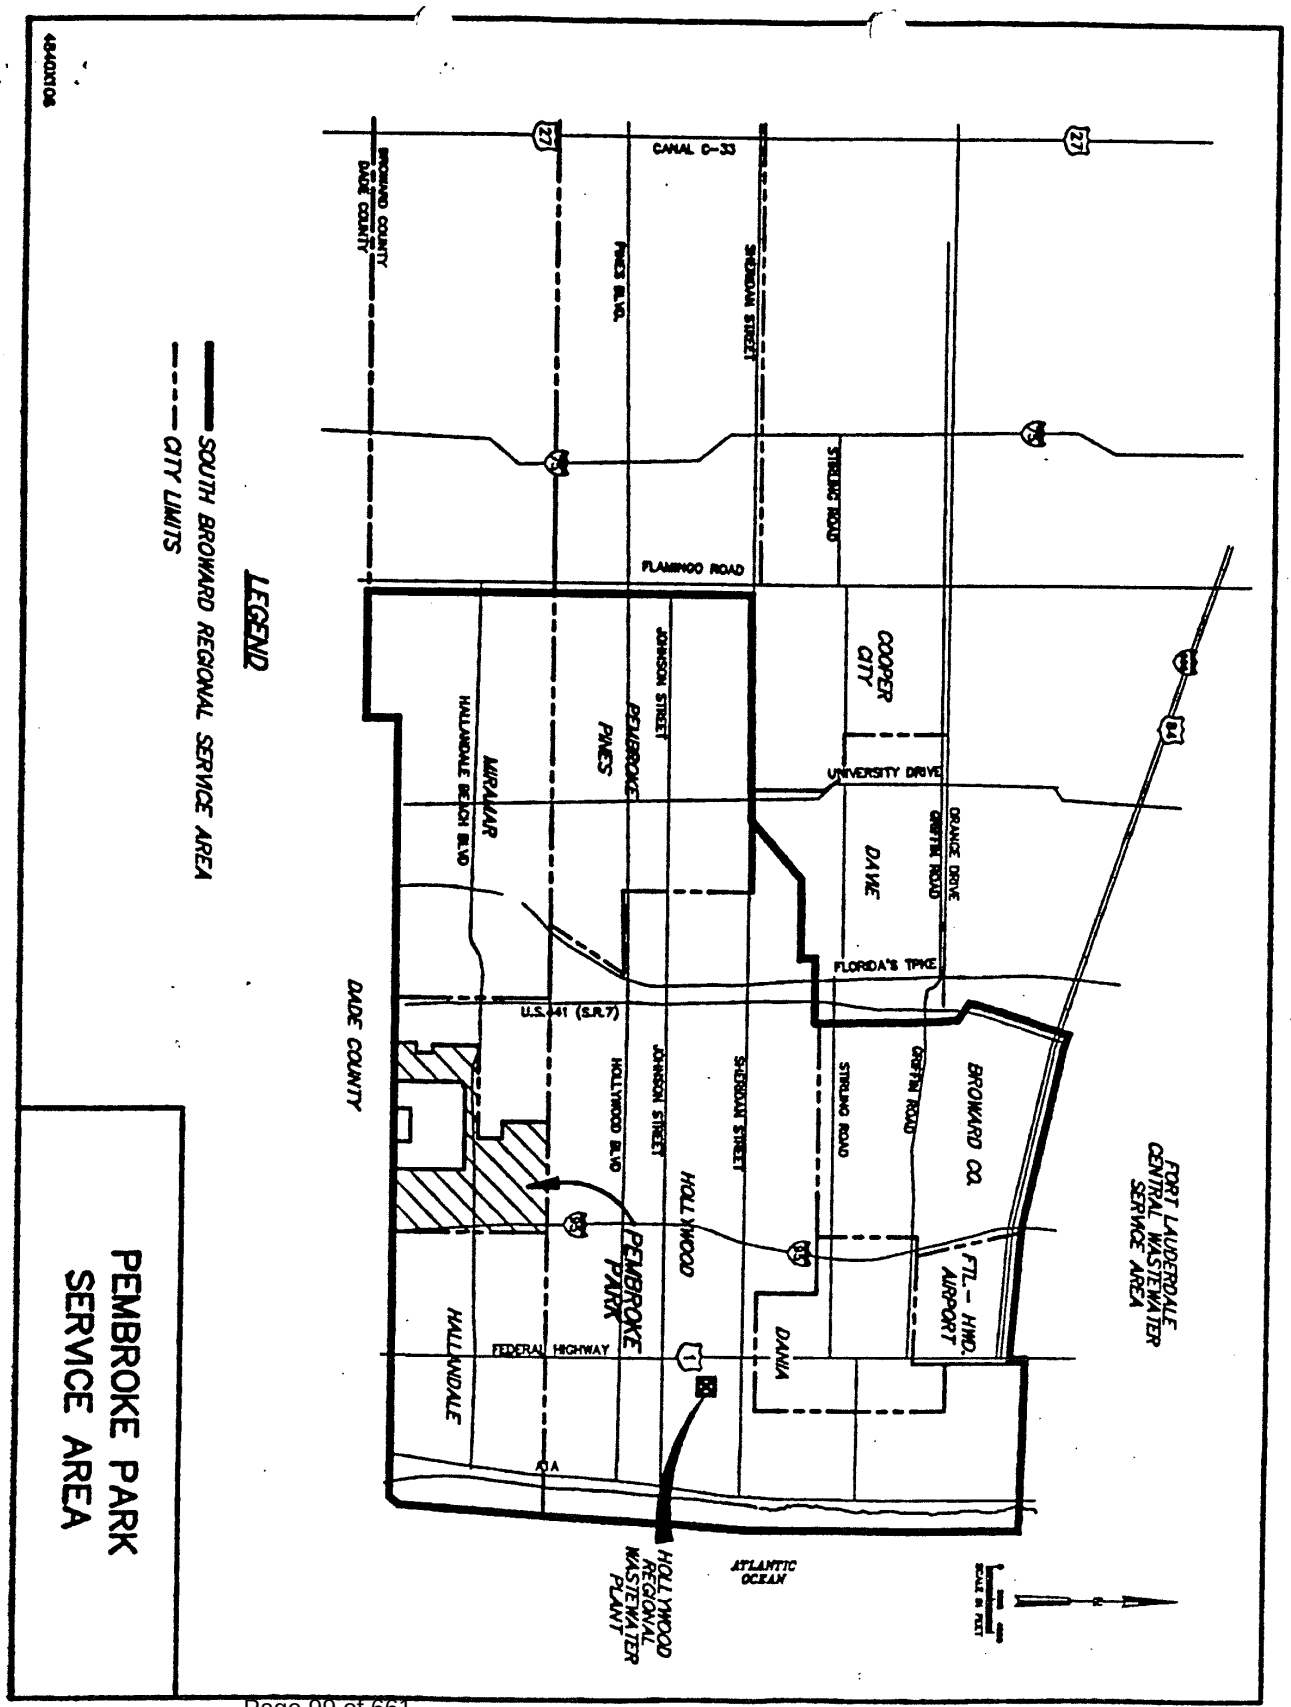

PEMBROKE PARK
SERVICE AREA
LEGEND
SOUTH BROWARD REGIONAL SERVICE AREA
CITY LIMITS
BROWARD COUNTY
DADE COUNTY
CANAL C-33
PINES BLVD.
SHERIDAN STREET
STIRLING ROAD
FLAMINGO ROAD
COOPER CITY
UNIVERSITY DRIVE
ORANGE DRIVE
GRIFFIN ROAD
DAVIE
MIRAMAR
HALLANDALE BEACH BLVD
PEMBROKE PINES
JOHNSON STREET
FLORIDA'S TPKE
U.S. 441 (S.R.7)
HOLLYWOOD BLVD
PEMBROKE PARK
HOLLYWOOD
HALLANDALE
FEDERAL HIGHWAY
DANIA
BROWARD CO.
FTL. - HWD. AIRPORT
FORT LAUDERDALE CENTRAL WASTEWATER SERVICE AREA
A1A
ATLANTIC OCEAN
HOLLYWOOD REGIONAL WASTEWATER PLANT

EXHIBIT "B"

HOLLYWOOD SOUTHERN REGIONAL WWTP

LARGE USER METER AND INTERCONNECT LOCATIONS

1. HALLANDALE
   METER AT LIFT STATION E-8, 800 THREE ISLAND BLVD.
   INTER-CONNECTION AT 13TH AVENUE WASHINGTON STREET
   MANHOLE #B334N

2. HALLANDALE
   METER AT LIFT STATION E-6, 1350 FUNSTON STREET
   INTER-CONNECTION AT 14TH & JACKSON STREET, VANBUREN ALLEY
   MANHOLE B27

3. HALLANDALE
   METER AT U.S. 1 & PEMBROKE ROAD
   INTER-CONNECTION AT 19TH AVENUE & PLUNKETT STREET
   MANHOLE 401A

4. HALLANDALE
   METER AT FLETCHER STREET & 22ND AVENUE
   INTER-CONNECTION AT 23RD TAFT STREET

5. PEMBROKE PARK
   COCA COLA PLANT, PEMBROKE ROAD
   INTER-CONNECTION AT 620 S. RAINBOW
   MANHOLE 353

6. MIRAMAR SEWER PLANT
   INTER-CONNECTION AT JOHNSON STREET & 62ND AVENUE

7. PEMBROKE PINES
   METER AT N.W. 77 WAY, 13TH STREET
   INTER-CONNECTION AT TAFT STREET AND 56TH

8. DANIA
   METER AT SHERIDAN & S.E. 5TH AVENUE
   INTER-CONNECTION AT 14TH & HARDING STREET
   MANHOLE 1002

9. COOPER CITY, DAVIE (TREATED)
   METER AT COOPER CITY AND DAVIE SEWER PLANTS
   INTER-CONNECTION AT HOLLYWOOD SEWER PLANT

10. BROWARD COUNTY
    METERS: S. 40TH AVE. AT 3A WTP
            S. 40TH AVE. AT STIRLING
    INTERCONNECT: N. 56TH AVE. AT TAFT STREET

Exhibit "C" (Continued)

EXHIBIT A.1
Current Flows

EXHIBIT A.1 CURRENT FLOWS

SOUTHERN REGIONAL WASTEWATER TREATMENT PLANT
July 2024 Large User Capacity Report (GPD)

Large User	Encumbered Flow*	Annual Average Daily Flow / Last 12 Months	Total Flow AADF + Enc.	Capacity** Allocations	% of Cap Used	% of Cap Used or Encumbered	Available Capacity
Broward County	756,117	3,877,153	4,633,270	5,883,000	65.90%	78.76%	1,249,730
Dania Beach	2,254,105	3,928,288	6,182,393	5,217,000	75.30%	118.50%	-965,393
Hallandale Beach	1,819,158	7,751,430	9,570,588	8,713,500	88.96%	109.84%	-857,088
Hollywood	1,387,989	18,754,011	20,142,000	21,811,500	85.98%	92.35%	1,669,500
Miramar ***	0	26,449	26,449	1,665,000	1.59%	1.59%	1,638,551
Pembroke Park	258,543	950,309	1,208,852	1,110,000	85.61%	108.91%	-98,852
Pembroke Pines	256,970	7,819,359	8,076,329	11,100,000	70.44%	72.76%	3,023,671
Total	6,732,881	43,107,000	49,839,881	55,500,000			5,660,119

WWTP AADF	**43.1**
Encumbered Flow	**6.7**
Total MGD	**49.8**

* Encumbered flows updated to reflect most recent activity

** 9/30/2012 Plant Capacity Officially Rated at 55.5 MGD

***Miramar Discontinued Monthly Flows to the SRWWTP on 01/10/2011 per Signed Agreement but open their interconnect as an emergency measure.

Updated 8/13/2024

EXHIBIT B
Broward County Interlocal Agreement

See Town Clerk for Resolution

(Resolution Passed Approx. 2003 – 2005)

EXHIBIT C
Coca Cola Rate Agreement

See Town Clerk for Agreement

EXHIBIT C.1
REDUCTION IN VOLUME BASED ON PRODUCTION DISTRIBUTION

See Town Clerk for Agreement

(RESOLUTION PASSED APPROX. 2010)

EXHIBIT C.2
CITY OF HOLLYWOOD EXCESSIVE WASTEWATER PH AND ACIDITY CONCENTRATION

See Town Clerk for Agreement

(RESOLUTION PASSED APPROX. 1996)

EXHIBIT D

MODEL DATA REPORT 2025 EXISTING CONDITIONS

EXHIBIT D.1
GRAVITY SEWER DATA TABLE REPORT

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1466	O2L34SA9	M34A9	0.1	M34A8	0	92.2	0.001	8	0.013	1.39	217.91	138.37	157.5	Vitrified Clay
536	O1L14SA2	M14A2	-3.6	M14A1	-4	102.8	0.004	8	0.013	3.42	536.17	346.58	154.7	Vitrified Clay
1517	O2L34SA3	M34A3	-4.4	M34A2	-4.5	34	0.004	8	0.01	4.12	645.2	418.76	154.1	PVC
998	O2L34SA6	M34A6	-1.9	M34A5	-2.1	77	0.002	8	0.013	2.33	365.33	247.26	147.8	Vitrified Clay
1120	O1L14SC1	M14C1	-2.7	M14A2	-3.6	279.4	0.003	8	0.013	2.8	438.06	302.61	144.8	Vitrified Clay
1115	O1L14SC2	M14C2	-2.4	M14C1	-2.7	92.4	0.003	8	0.013	2.08	326.45	298.52	109.4	Vitrified Clay
1113	O1L14SC3	M14C3	-2.3	M14C2	-2.4	22.4	0.003	8	0.013	2.08	326.45	303.48	107.6	Vitrified Clay
1353	O2L34SA8	M34A8	0	M34A7	-0.5	319.7	0.002	8	0.013	1.62	239.64	224.95	106.5	Vitrified Clay
1110	O1L14SC4	M14C4	-1.4	M14C3	-2.3	315.6	0.003	8	0.013	1.95	305.93	297.54	102.8	Vitrified Clay
1322	O1L17SA10	M17A10	0.6	M17A9	0	160.9	0.004	8	0.013	2.36	334.06	325.59	102.6	Vitrified Clay
1108	O1L14SC5	M14C5	-0.4	M14C4	-1.4	315.1	0.003	8	0.013	1.93	302.05	297.81	101.4	Vitrified Clay
360	O2L3SA1	M3A1	-1.8	W-3	-1.7	17.9	-0.004	8	0.013	2.32	363.07	362.33	100.2	
1323	O1L17SA9	M17A9	0	M17A8	-0.4	88.8	0.005	8	0.013	2.65	360.43	364.07	99	Vitrified Clay
3510	O2L35SA1	W-35	-1.4	M35A1	-1.3	20.3	0.005	8	0.01	3.58	452.83	494.45	91.6	PVC
1089	O1L17SA11	M17A11	1.6	M17A10	0.6	245.1	0.004	8	0.013	2.45	287.75	342.94	83.9	Vitrified Clay
1518	O2L34SA3	M34A4	-3	M34A3	-4.3	313	0.004	8	0.01	3.22	365.33	454.36	80.4	PVC
1057	O1L17SA2	M17A2	-6.6	M17A1	-7	144.5	0.002	12	0.013	2.44	618.26	775.54	79.7	Vitrified Clay
4001	O1L17SA1	M17A1	-7	W-17	-7.1	39.9	0.003	12	0.013	2.87	723.71	912.44	79.3	Vitrified Clay
988	O2L34SI1	M34A7	-0.5	M34A6	-1.9	332.4	0.004	8	0.013	2.43	255.24	349.46	73	Vitrified Clay
1465	O2L34SA10	M34A10	0.8	M34A9	0.1	233.6	0.003	8	0.013	2.06	213.65	296.91	72	Vitrified Clay
1032	O1L17SA3	M17A3	-6.4	M17A2	-6.6	112	0.002	12	0.013	2.13	492.86	692.29	71.2	Vitrified Clay
1459	O2L34SA11	M34A11	1.5	M34A10	0.8	233.9	0.003	8	0.013	2.12	213.13	307.09	69.4	Vitrified Clay
3993	O2L36SB1	M36A1	-5.2	M36B1	-4	279.6	0.004	8	0.01	3	263.87	452.17	58.4	PVC
4142	O2L1SA5	M1A4	1	M1A5	1.1	43.1	0.004	8	0.013	2.25	193.2	342.52	56.4	Vitrified Clay
4143	O2L1SA6	M1A5	1.1	M1A6	1.4	72.8	0.004	8	0.013	2.25	192.3	343.57	56	Vitrified Clay
376	O2L3SA2	M3A2	-1.3	M3A1	-1.8	107.4	0.005	8	0.013	2.42	204.57	370.12	55.3	Vitrified Clay
4081	O2L1SA4	M1A3	-0.1	M1A4	1	240.7	0.004	8	0.013	2.35	196.2	359.94	54.5	Vitrified Clay
733	O2L3SH1	M3H1	-0.1	M3A2	-1.3	318.9	0.004	8	0.013	2.15	178.63	329.9	54.1	Vitrified Clay
4285	O1L17SA4	M17A5	-5.7	M17A4	-6.3	285.4	0.002	12	0.013	2.17	405.47	751.26	54	Vitrified Clay
1100	O1L14SD1	M14D1	0.4	M14C5	-0.4	279.3	0.003	8	0.013	1.02	159.55	299.18	53.3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
646	O2L36SA4	M36A4	-2.2	M36A3	-2.4	220.4	0.001	8	0.01	1.38	112.69	212.41	53.1	PVC
1275	O2L22SA2	M22A2	-0.8	M22A1	-1.4	133.8	0.005	8	0.013	2.41	197.08	372.16	53	Vitrified Clay
737	O2L3SH2	M3H2	1.3	M3H1	-0.1	388.5	0.004	8	0.013	2.08	168.66	322.05	52.4	Vitrified Clay
3683	O2L22SA4	M22A3	0.9	M22A4	1.6	180.6	0.004	8	0.013	2.09	162.43	327.87	49.5	Vitrified Clay
4282	O1L17SA4	M17A4	-6.3	M17A3	-6.4	27.9	0.003	12	0.013	2.4	405.47	856.88	47.3	Vitrified Clay
4136	O2L1SA7	M1A6	1.4	M1A7	1.7	46.6	0.006	8	0.013	2.65	191.4	426.48	44.9	Vitrified Clay
1283	O2L22SA3	M22A3	0.9	M22A2	-0.8	259.4	0.007	8	0.013	2.68	179.44	442.87	40.5	
3863	O2L3SF1	M3A1	-1.8	M3F1	-0.4	341.2	0.004	8	0.013	2.09	139.17	344.92	40.3	Vitrified Clay
870	O2L1SA2	M1A2	-0.8	M1A1	-1	82.6	0.003	10	0.013	2.16	225.15	558.68	40.3	Vitrified Clay
3957	O2L3SF3	M3F2	1.5	M3F3	3.2	459.3	0.004	8	0.013	1.99	132.9	329.96	40.3	Vitrified Clay
1168	O1L14SB2	M14B2	-1.4	M14B1	-1.7	285.5	0.001	8	0.013	1.16	76.633	192.58	39.8	Vitrified Clay
1124	O1L14SC6	M14C6	0.5	M14C5	-0.4	305.7	0.003	8	0.013	0.75	116.85	299.16	39.1	Vitrified Clay
1126	O1L14SC7	M14C7	1	M14C6	0.5	170	0.003	8	0.013	0.71	111.15	288.2	38.6	Vitrified Clay
1617	O2L3SF2	M3F2	1.5	M3F1	-0.4	437.2	0.004	8	0.013	2.13	136.04	357.52	38.1	Vitrified Clay
653	O2L36SA2	M36A2	-4.1	M36A1	-5.2	310.1	0.003	8	0.01	2.46	156.76	414.13	37.9	PVC
1104	O1L14SD3	M14D3	2.1	M14D2	1.3	284.2	0.003	8	0.013	0.69	108.25	296.6	36.5	Vitrified Clay
1106	O1L14SD4	M14D4	2.8	M14D3	2.1	226.8	0.003	8	0.013	0.67	105.4	296.94	35.5	Vitrified Clay
4080	O2L2SR2	M1A2	-0.8	M1A3	-0.1	208.8	0.003	10	0.013	2.1	199.5	562.18	35.5	Vitrified Clay
707	O2L3SJ1	M3J1	3	M3H2	1.3	234.4	0.007	8	0.013	2.71	162.53	465.9	34.9	Vitrified Clay
1000	O2L34SA5	M34A5	-2.1	M34A4	-3	23.2	0.039	8	0.013	6.17	365.33	1067.6	34.2	Vitrified Clay
902	O2L23SB1	M23B1	1.9	M17A1	0.3	399.2	0.004	8	0.035	0.74	43.167	128.33	33.6	
419	O2L2SA1	M2A1	-2.1	W-2	-2.2	15.7	0.006	6	0.013	2.03	64.5	200.89	32.1	Vitrified Clay
651	O2L36SA3	M36A3	-2.4	M36A2	-4.1	354.7	0.005	8	0.01	2.7	148.91	479.4	31.1	PVC
1396	O1L17SB2	M17B1	2.2	M17B2	2.6	99.6	0.004	8	0.01	2.51	136.8	446.82	30.6	PVC
1710	O2L38SA2	M38A2	-7.2	M38A1	-8.8	395.9	0.004	8	0.01	2.47	127.39	449.63	28.3	PVC
3884	O2L38SA1	M38A1	-8.9	W-38	-9.1	23.9	0.008	8	0.01	3.53	182.2	644.52	28.3	PVC
1324	O1L17SA8	M17A8	-2.1	M17A6	-3.4	159.5	0.008	12	0.013	3.51	405.47	1443.4	28.1	Vitrified Clay
1402	O1L17SB4	M17B3	3.6	M17B4	4.2	217.7	0.003	8	0.01	2.02	102.6	370.1	27.7	PVC
683	O2L36SB2	M36B2	-3	M36B1	-4	327.4	0.003	8	0.01	2.16	108.22	397.39	27.2	PVC
3372	O2L7SC2	M7C2	-0.1	M7C1	-0.9	162.5	0.005	8	0.013	2.06	102.99	380.57	27.1	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1102	O1L14SD2	M14D2	3.2	M14D1	0.4	281.8	0.01	8	0.013	2.88	142.45	533.77	26.7	Vitrified Clay
1156	O1L14SA5	M14A5	-2.4	M14A4	-3.1	172.3	0.004	8	0.013	1.84	88.999	343.16	25.9	Vitrified Clay
1398	O1L17SB3	M17B3	3.4	M17B2	2.6	147.7	0.006	8	0.01	2.87	136.8	538.07	25.4	PVC
645	O2L36SA5	M36A5	-2	M36A4	-2.2	84.2	0.003	8	0.01	2.2	104.84	413.76	25.3	PVC
404	O2L1SA1	M1A1	-1	W-1	-1.2	11	0.012	10	0.013	3.65	270.45	1071.6	25.2	Vitrified Clay
4010	O2L19SA1	W-9	-0.4	M9A1	-0.3	20.8	0.005	8	0.01	2.56	116.55	488.56	23.9	PVC
589	O2L7SA2	M7A2	-2	M7A1	-5.5	246.6	0.014	6	0.013	2.76	68.033	300.43	22.6	Vitrified Clay
1404	O1L17SB5	M17B5	4.7	M17B4	4	146.5	0.004	8	0.01	2.35	102.6	454.91	22.6	PVC
3378	O2L7SC3	M7C3	0.7	M7C2	-0.1	139.7	0.006	8	0.013	2.1	91.361	410.39	22.3	Vitrified Clay
644	O2L36SA6	M36A6	-1.7	M36A5	-2	90.5	0.003	8	0.01	2.05	88.673	399.19	22.2	PVC
569	O2L7SD2	M7D2	1.8	M7D1	1	157	0.005	6	0.013	1.66	39.533	184.22	21.5	Vitrified Clay
457	O2L7SA1	M7A1	-5.5	W-7	-6.4	7.7	0.116	6	0.013	2.08	183.32	857.64	21.4	
524	O2L34SA2	M34A2	-4.6	M34A1	-5.5	25.8	0.036	12	0.012	7.36	694	3269.3	21.2	Ductile Iron
570	O2L7SD1	M7D1	1	M7A3	-0.6	136.4	0.012	6	0.013	2.43	56.333	272.74	20.7	Vitrified Clay
3512	O2L35SA2	M35A1	-1.2	M35A2	-0.1	286.5	0.004	8	0.01	2.19	89.89	436.87	20.6	PVC
4023	O2L5SA1	M5A1	-2.9	W-5	-3	10.6	0.005	6	0.01	2.01	46.17	225.16	20.5	PVC
1333	O1L40SA5	M40A4	2.7	M40A5	3.7	263.3	0.004	8	0.01	2.17	88.078	434.47	20.3	PVC
1551	O1L17SF1	M17F1	2.8	M17A11	1.6	282.2	0.004	8	0.013	1.79	72.577	358.04	20.3	Vitrified Clay
1329	O1L40SA3	M40A2	0.3	M40A3	1.4	286.8	0.004	8	0.01	2.18	88.078	436.66	20.2	PVC
3103	O2L34SG1	M34G1	3.8	M34F2	0.3	401.3	0.009	6	0.013	2.09	47.493	236.19	20.1	Vitrified Clay
3514	O2L35SA3	M35A2	0	M35A3	1.5	393.5	0.004	8	0.01	2.13	83.012	433.85	19.1	PVC
1016	O1L17SM1	M17M1	-0.8	M17A3	-1.3	132	0.004	8	0.01	2.21	85.5	450.98	19	PVC
1331	O1L40SA4	M40A3	1.5	M40A4	2.7	275	0.004	8	0.01	2.28	88.078	465.75	18.9	PVC
1327	O1L40SA2	M40A1	-0.6	M40A2	0.2	190.5	0.004	8	0.01	2.29	88.078	468.18	18.8	PVC
4128	O2L1SA8	M1A7	1.7	M1A8	1.9	44.8	0.004	12	0.013	2.19	187.8	1007.9	18.6	
912	O2L5SA2	M5A2	-2.7	M5A1	-2.9	53.7	0.005	6	0.01	1.94	41.445	223.47	18.5	PVC
643	O2L36SA7	M36A7	-0.7	M36A6	-1.7	299.2	0.003	8	0.01	1.92	72.508	395.17	18.3	PVC
4284	O1L17SA6	M17A6	-3.4	M17A5	-5.7	118.8	0.019	12	0.013	4.8	405.47	2230.1	18.2	Vitrified Clay
1408	O1L17SB6	M17B6	5.6	M17B5	4.7	229.2	0.004	8	0.01	2.15	79.8	444.28	18	PVC
4129	O2L1SA9	M1A8	1.9	M1A9	3	256.4	0.004	12	0.013	2.26	186.3	1056.8	17.6	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1304	O1L14SC8	M14C8	1.3	M14C7	1	89.7	0.003	8	0.01	0.45	71.25	407.81	17.5	PVC
588	O2L7SA3	M7A3	-0.6	M7A2	-2	283.5	0.005	8	0.013	1.82	65.633	379.78	17.3	Vitrified Clay
3247	O2L18SC9	M18C9	3.4	M18C2	3	99.5	0.004	8	0.01	2.11	75.649	441.38	17.1	PVC
1502	O2L18ASA5	M18A-A5	0.7	M18A-A4	0.2	162.3	0.003	8	0.01	1.88	67.499	395.19	17.1	PVC
1496	O2L18ASA3	M18A-A3	-0.3	M18A-A2	-0.7	102.4	0.004	8	0.01	0.49	76.004	446.05	17	PVC
1704	O2L38SA3	M38A3	-5.5	M38A2	-7.2	382.4	0.004	8	0.013	1.69	59.324	358.4	16.6	
1306	O1L14SC9	M14C9	1.7	M14C8	1.3	115.8	0.004	8	0.01	2.08	71.25	444.4	16	PVC
538	O1L14SA4	M14A4	-3.1	M14A3	-2.6	57	-0.008	8	0.01	0.63	98.119	619.43	15.8	PVC
1412	O1L17SB7	M17B6	5.3	M17B7	5.7	143.6	0.003	8	0.01	1.69	57	362.66	15.7	PVC
537	O1L14SA3	M14A3	-2.6	M14A2	-3.6	68.4	0.013	8	0.013	2.92	98.119	628.94	15.6	
1500	O2L18ASA4	M18A-A4	0.2	M18A-A3	-0.3	112.6	0.004	8	0.01	2.07	69.074	445.71	15.5	PVC
1172	O1L14SA7	M14A7	-1.6	M14A6	-0.5	131	-0.008	8	0.013	0.49	76.174	492.39	15.5	Vitrified Clay
1088	O1L17A12	M17A12	4	M17A11	3.1	217.3	0.004	8	0.013	1.67	55.575	362.32	15.3	Vitrified Clay
3995	O2L36SC2	M36C1	-2	M36C2	-0.5	271.5	0.005	8	0.01	2.41	80.072	522.31	15.3	PVC
1014	O1L17SM2	M17M2	-0.3	M17M1	-0.8	94.7	0.005	8	0.01	2.26	74.1	491.29	15.1	PVC
1553	O1L17SF2	M17F2	3.9	M17F1	2.8	296.1	0.004	8	0.013	1.53	49.777	335.02	14.9	Vitrified Clay
1012	O1L17SM3	M17M3	0.6	M17M2	-0.3	244	0.004	8	0.01	1.98	62.7	437.59	14.3	PVC
642	O2L36SA8	M36A8	0.2	M36A7	-0.7	292.1	0.003	8	0.01	1.8	56.344	399.96	14.1	PVC
1425	O2L32SA1	W-32	-1.6	M32A1	-1.2	120.4	0.004	8	0.01	1.95	59.743	435.71	13.7	PVC
1506	O2L18ASA6	M18A-A6	1.2	M18A-A5	0.7	121.8	0.004	8	0.01	2.04	61.199	460.67	13.3	PVC
3643	O2L18ASA2	M18A-A2	-0.7	M18A-A1	0.4	95.8	-0.011	8	0.013	0.49	76.004	575.97	13.2	
3846	O2L4SA3	M4A2	0.3	M4A3	0.7	92.3	0.005	6	0.013	1.34	22.365	171.88	13	Vitrified Clay
3365	O2L7SC1	M7C1	-0.9	M7A1	-5.5	181.5	0.025	8	0.013	3.77	109.59	864.45	12.7	Vitrified Clay
3994	O2L36SC1	M36B1	-4	M36C1	-2	190.4	0.011	8	0.01	3.16	90.812	724.35	12.5	PVC
3426	O2L36SA1	M36A1	-5.2	W-36	-9	68	0.057	12	0.013	7	473.73	3804.2	12.5	
568	O2L7SD3	M7D3	2.7	M7D2	1.8	157.5	0.005	6	0.013	1.42	22.733	182.79	12.4	Vitrified Clay
1512	O2L18ASA8	M18A-A8	2.1	M18A-A7	1.7	100.8	0.004	8	0.01	1.95	54.899	449.6	12.2	PVC
1377	O1L37SC1	M37A2	-2.8	M37A1	-3.2	98.7	0.004	8	0.01	2.01	56.185	465.32	12.1	PVC
1510	O2L18ASA7	M18A-A7	1.7	M18A-A6	1.2	120	0.004	8	0.01	2	55.844	464.08	12	PVC
1555	O1L17SF3	M17F3	4	M17F2	3.9	16.5	0.006	8	0.013	1.81	49.777	421.82	11.8	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1008	O1L17SM5	M17M5	1.9	M17M4	1	215.3	0.004	8	0.01	1.88	51.3	440.44	11.6	PVC
1010	O1L17SM4	M17M4	1	M17M3	0.6	105.8	0.004	8	0.01	1.89	51.3	444.2	11.5	PVC
1448	O2L31SA2	M31A2	-2.3	M31A1	-4	387.1	0.004	8	0.01	1.98	53.693	465.86	11.5	PVC
1606	O1L17SO1	M17O1	1.7	M17N1	0.1	315.6	0.005	8	0.01	2.11	57	498.88	11.4	PVC
682	O2L36SB3	M36B3	-0.1	M36B2	-3	325.9	0.009	8	0.01	2.78	73.19	660.47	11.1	PVC
865	O2L1SE3	M1E3	1.5	M1E2	0.7	171.5	0.005	6	0.013	1.28	18.75	172.65	10.9	Vitrified Clay
1166	O1L14SB1	M14B1	-1.7	M14A1	-4	304.2	0.007	10	0.013	2.27	91.913	847.57	10.8	Vitrified Clay
689	O2L36SD2	M36D2	1.9	M36D1	1	353.5	0.003	8	0.013	1.15	29.802	276.67	10.8	
1072	O1L17SQ1	M17Q2	-3.4	M17Q1	-4	143.7	0.004	8	0.013	0.24	37.05	344.55	10.8	Vitrified Clay
924	O2L5SA4	M5A4	-0.7	M5A3	-2.4	308.2	0.005	6	0.013	1.38	19.71	186.47	10.6	Vitrified Clay
794	O2L2SA2	M2A2	-1.3	M2A1	-2.1	174.8	0.005	8	0.013	1.52	38.7	366.74	10.6	Vitrified Clay
4012	O2L9SB1	M9A1	-0.3	M9B1	0.5	194.7	0.004	8	0.01	1.87	47.25	452	10.5	PVC
1128	O1L14SF1	M14F1	1.8	M14C7	1	250.4	0.003	8	0.013	1.25	31.35	302.71	10.4	Vitrified Clay
1414	O1L17SB9	M17B9	6.5	M17B7	6.1	98.6	0.004	8	0.01	1.83	45.6	443.5	10.3	PVC
1702	O2L38SA4	M38A4	-3.8	M38A3	-5.4	393.5	0.004	8	0.01	1.86	46.198	452.36	10.2	PVC
926	O2L5SA6	M5A6	0.5	M5A4	-0.7	280.1	0.005	6	0.013	1.24	17.19	169.58	10.1	Vitrified Clay
699	O1L17SL3	M17L3	1.8	M17L2	1.2	152.2	0.004	8	0.01	1.83	45.041	446.39	10.1	PVC
697	O1L17SL2	M17L2	1.2	M17L1	0.9	75.7	0.004	8	0.01	1.84	45.041	451.18	10	PVC
1373	O1L37SA3	M37A3	-1.6	M37A2	-2.8	245.7	0.005	8	0.01	1.96	47.831	482.4	9.9	PVC
1592	O2L16SA5	M16A5	0.6	M16A4	-0.3	203.9	0.004	8	0.013	1.38	31.711	348.09	9.1	Vitrified Clay
986	O2L34SF1	M34F1	0.8	M34A6	-0.3	324.1	0.004	12	0.013	1.68	86.002	952.5	9	
1006	O1L17SM6	M17M6	2.5	M17M5	1.9	150.5	0.004	8	0.01	1.76	39.9	445.1	9	PVC
1371	O1L37SA4	M37A4	-0.4	M37A3	-1.6	236.2	0.005	8	0.01	1.98	44.699	500.45	8.9	PVC
4321	O2L18SC1	M18A1	-3.1	M18C1	2.5	150.6	0.037	8	0.013	4.1	92.029	1041.2	8.8	Vitrified Clay
1712	O2L38SB1	M38A1	-2.9	M38B1	-1.6	300.5	0.004	8	0.01	1.83	40.853	465.5	8.8	PVC
1196	O1L14SA8	M14A8	-0.6	M14A7	-1.6	247.4	0.004	8	0.013	1.34	29.64	342.71	8.6	Vitrified Clay
928	O2L5SA7	M5A7	1.8	M5A6	0.5	282.1	0.005	6	0.013	1.18	14.67	169.64	8.6	Vitrified Clay
4475	O2L4SA2	M4A2	0.3	M4A1	0.1	16.8	0.011	6	0.013	1.81	22.365	260.6	8.6	Vitrified Clay
701	O1L17SL4	M17L4	2.3	M17L3	1.8	130.1	0.004	8	0.01	1.73	37.916	445.75	8.5	PVC
856	O2L1SJJ1	M1JJ1	1.7	M1D2	0.9	131.3	0.006	6	0.013	1.31	15.9	191.56	8.3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1586	O2L16SA3	M16A3	-1.4	M16A2	-2.6	24.9	0.045	8	0.013	4.44	95.475	1150.3	8.3	Vitrified Clay
680	O2L36SI1	M36I1	1.5	M36B3	-0.1	300.2	0.005	8	0.01	1.99	42.6	514.71	8.3	PVC
1170	O1L14SA6	M14A6	-0.5	M14A5	-2.4	64.2	0.029	8	0.013	3.56	76.174	923.17	8.3	Vitrified Clay
659	O2L36SC3	M36C3	3.9	M36C2	-0.5	309.8	0.014	8	0.01	3.24	69.331	843.1	8.2	PVC
3278	O2L18SC2	M18C2	3	M18C1	2.5	140.1	0.004	12	0.013	1.75	83.839	1019.8	8.2	
3429	O2L25SA2	M25A2	-0.4	M25A1	-1	132.9	0.004	8	0.013	1.37	29.097	355.25	8.2	Vitrified Clay
1198	O1L14SA9	M14A9	0.4	M14A8	-0.6	249.5	0.004	8	0.013	1.31	27.93	342.65	8.2	Vitrified Clay
532	O1L14SA1	M14A1	-4	W-14	-8.2	6.8	0.617	10	0.013	18.16	628.09	7726.2	8.1	
4014	O2L9SB2	M9B1	0.5	M9B2	1.5	123	0.008	6	0.01	2.01	23.625	295.15	8	PVC
953	O2L4SA4	M4A4	1.2	M4A3	0.7	103.7	0.005	6	0.013	1.15	13.545	169.51	8	Vitrified Clay
528	O2L34SA1	M34A1	-5.5	W-34	-11.1	5.9	0.953	13.8	0.012	29.8	1913.6	24545	7.8	Ductile Iron
1228	O1L14SA10	M14A10	1.2	M14A9	0.4	205.2	0.004	8	0.013	1.3	26.22	342.81	7.6	
1031	O1L17SN1	M17N1	0.1	M17A2	-1.9	188.1	0.011	12	0.013	2.77	125.4	1652.8	7.6	
1319	O1L17SQ4	M17Q4	4.1	M17Q3	3.3	199.6	0.004	8	0.013	1.29	25.65	343.31	7.5	Vitrified Clay
1582	O2L16SB2	M16B2	-1.7	M16B1	-2	109.3	0.003	8	0.013	1.16	22.896	311.19	7.4	Vitrified Clay
1698	O2L38SA5	M38A4	-3.7	M38A5	-2.1	397.1	0.004	8	0.01	1.68	33.072	450.33	7.3	PVC
1431	O2L32SB2	M32A2	0.8	M32A1	-1.2	242.9	0.008	8	0.01	2.34	45.938	630.08	7.3	PVC
3083	O2L16SA1	M16A1	-2.8	W-16	-7.3	31.2	0.145	8	0.013	7	149	2064.8	7.2	Vitrified Clay
930	O2L5SA8	M5A8	3.1	M5A7	1.8	281.1	0.005	6	0.013	1.11	12.15	169.28	7.2	Vitrified Clay
1605	O1L17SO2	M17O2	2.9	M17O1	1.7	258.3	0.005	8	0.01	1.76	34.2	476.53	7.2	PVC
3516	O2L35SD1	M35A3	1.5	M35D1	2	109.8	0.005	8	0.01	1.78	34.432	480.46	7.2	PVC
4096	O2L1SA10	M1A9	3	M1A10	4.3	221.4	0.006	8	0.013	1.51	28.75	410.73	7	Vitrified Clay
1718	O2L16SA2	M16A2	-2.6	M16A1	-2.8	25.6	0.007	12	0.013	2.24	95.475	1378.3	6.9	
692	O2L36SB4	M36B4	0.5	M36B3	-0.1	188.5	0.003	8	0.01	1.5	28.201	410.79	6.9	PVC
863	O2L1SK2	M1E4	3	M1E3	1.5	125.9	0.012	6	0.013	1.78	18.75	274.92	6.8	Vitrified Clay
4273	O2L32SC2	M32C1	0	M32C2	1	151.6	0.007	6	0.013	1.32	13.805	204.55	6.7	Vitrified Clay
1130	O1L14SF2	M14F2	2.5	M14F1	1.8	250.2	0.003	8	0.013	1.08	19.95	296.94	6.7	Vitrified Clay
3990	O2L35SA4	M35A3	1.5	M35A4	2.7	270.8	0.004	8	0.01	1.7	31.4	469.34	6.7	PVC
667	O2L36SG1	M36G1	5	M36C3	3.9	232.8	0.005	8	0.013	1.34	24.739	371.09	6.7	
1588	O2L16SD1	M16D1	-0.1	M16A3	-1.4	285.7	0.005	8	0.013	1.34	24.462	371.41	6.6	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
3713	O2L22SA1	M22A1	-1.4	W-23	-2.2	16.1	0.048	12	0.013	5.59	224.49	3518.3	6.4	
1433	O2L32SA3	M32A2	0.8	M32A3	1.1	73.4	0.005	8	0.01	1.78	31.068	500.5	6.2	PVC
793	O2L2SD1	M2D1	-1.7	M2A1	-2.1	55.3	0.007	6	0.013	1.31	12.9	207.87	6.2	Vitrified Clay
796	O2L2SC1	M2C1	-1.8	M2A1	-2.1	40	0.007	6	0.013	1.28	12.6	203.11	6.2	Vitrified Clay
1356	O2L16SA6	M16A6	1.1	M16A5	0.6	98.2	0.005	8	0.01	1.82	31.711	512.97	6.2	PVC
1394	O1L17SB1	M17B1	2.2	M17A11	1.6	20.6	0.03	10	0.01	5.03	136.8	2218.4	6.2	PVC
1477	O2L39SA1	W-39	-2	M39A1	-1.6	76	0.005	8	0.01	0.2	31.501	511.59	6.2	PVC
1418	O1L17SB10	M17B10	7	M17B9	6.5	112.2	0.004	8	0.012	1.32	22.8	372.14	6.1	Ductile Iron
869	O2L1SE1	M1E1	-0.3	M1A2	-0.8	104.8	0.005	8	0.013	1.35	23.25	382.92	6.1	Vitrified Clay
867	O2L1SE2	M1E2	0.7	M1E1	-0.3	210.7	0.004	8	0.013	1.27	21.45	363.06	5.9	Vitrified Clay
4182	O2L7SB2	M1D1	-0.2	M1A1	-1	175.9	0.005	8	0.013	1.28	21.6	366.44	5.9	Vitrified Clay
1444	O2L31SA3	M31A3	-0.1	M31A2	-2.3	325.9	0.007	8	0.01	2.03	34.205	581.9	5.9	PVC
1442	O2L31SA4	M31A4	0.4	M31A3	-0.1	326.6	0.001	8	0.01	0.92	15.54	264.6	5.9	PVC
703	O1L17SL5	M17L5	3.6	M17L4	2.3	301.8	0.004	8	0.01	1.59	26.516	455.56	5.8	PVC
911	O2L5SA3	M5A3	-2.4	M5A2	-2.7	54.7	0.005	8	0.01	1.66	27.585	476.76	5.8	PVC
3198	O2L18SA1	W-18	-5.2	M18A1	-3.1	11.3	0.186	8	0.013	0.86	134.55	2339.4	5.8	Vitrified Clay
1522	O2L34SC2	M34C2	-0.3	M34C1	-1	152.4	0.005	8	0.01	1.64	26.396	480.62	5.5	PVC
4181	O2L7SB2	M1D2	0.9	M1D1	-0.2	268.1	0.004	8	0.013	1.22	19.5	358.58	5.4	Vitrified Clay
3187	O2L30SE1	M30B2	0	M30B1	-0.5	58.1	0.009	6	0.013	1.41	12.6	233.56	5.4	Vitrified Clay
976	O2L34SF2	M34F2	1.9	M34F1	-0.8	304.3	0.009	12	0.013	2.23	78.915	1480.9	5.3	
3193	O2L30SB4	M30B4	1.7	M30B3	1	143.5	0.005	4	0.01	1.05	4.095	77.556	5.3	PVC
1351	O2L34SL	M34L1	1.6	M34A8	0	389.1	0.004	8	0.013	1.16	18.058	343.39	5.3	Vitrified Clay
1714	O2L38SB3	M38B1	-1.6	M38B2	0.1	298.2	0.006	8	0.01	1.77	27.236	527.58	5.2	PVC
4002	O1L17SQ0	M17Q0	0.6	W-17	-0.1	26.7	0.027	8	0.01	3.86	59.217	1150	5.1	PVC
1083	O1L17SG1	M17G1	4.8	M17A10	4.1	172.1	0.004	8	0.01	1.49	22.8	446.44	5.1	PVC
1174	O1L14SM1	M14M1	-0.4	M14A7	-1.6	293.9	0.004	8	0.013	1.15	17.385	343.06	5.1	Vitrified Clay
1593	O2L16SA4	M16A4	-0.3	M16A3	-1.4	188.8	0.006	12	0.013	1.85	62.92	1253.3	5	
848	O2L1SJJ2	M1JJ2	2.1	M1JJ1	1.7	66.2	0.007	6	0.013	1.21	10.2	203.87	5	Vitrified Clay
1563	O1L14SH2	M14H2	3.4	M14H1	3	117.6	0.004	8	0.013	1.14	17.1	342.84	5	Vitrified Clay
859	O2L1SB1	M1A1	-1	M1B1	-0.4	124.3	0.005	8	0.013	1.24	18.6	375.29	5	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1321	O1L17SQ3	M17Q3	3.3	M17Q2	-3.4	341	0.02	8	0.013	2.51	37.05	759.03	4.9	Vitrified Clay
4020	O2L5SD2	M5D1	-1	M5D2	-0.8	43.7	0.005	6	0.01	1.3	10.71	221.39	4.8	PVC
1055	O1L17ST2	M17T2	-3.3	M17T1	-3.5	39.8	0.004	12	0.013	1.48	48.45	1013.6	4.8	
1021	O1L17SO3	M17O3	4.1	M17O2	2.9	270.1	0.005	8	0.01	1.57	22.8	477.74	4.8	PVC
1450	O2L31SB3	M31B2	0.8	M31B1	-0.4	235.1	0.005	8	0.01	1.61	23.338	493.11	4.7	PVC
4021	O2L5SD3	M5D2	-0.8	M5D3	0.7	341.9	0.005	6	0.013	0.98	7.875	169	4.7	Vitrified Clay
3657	O2L31SB1	M31A1	-4	W-31	-9.6	36.6	0.153	8	0.01	8.32	125.43	2756.8	4.5	PVC
1208	O1L14SS2	M14S2	2.1	M14S1	1	288.3	0.004	8	0.013	1.05	14.82	325.73	4.5	Vitrified Clay
3992	O2L35SA5	M35A4	2.8	M35A4	3.6	218.5	0.004	8	0.01	1.36	19.14	423.99	4.5	PVC
1312	O1L14SG1	M14G1	2.4	M14C9	1.7	177.5	0.004	8	0.01	1.42	19.95	442.78	4.5	PVC
1696	O2L38SA5	M38A6	-1.1	M38A5	-2	224.6	0.004	8	0.01	1.45	19.946	451.2	4.4	PVC
1613	O2L3SD1	M3D1	-0.2	M3A1	-1.8	527	0.003	8	0.013	0.96	13.11	296.95	4.4	Vitrified Clay
1776	O2L30SA4	M30A4	1.4	M30A3	0.6	183.3	0.005	6	0.013	0.98	7.56	171.47	4.4	Vitrified Clay
3476	O1L40SA1	M40A1	-0.6	W-40	-1.5	10.6	0.085	8	0.01	6.6	90.528	2054.1	4.4	PVC
1202	O1L14SS1	M14S1	1	M14A7	-1.6	247.7	0.011	8	0.013	1.78	24.368	556.67	4.4	Vitrified Clay
732	O2L3SL1	M3L1	0.4	M3H1	-0.1	113.6	0.005	6	0.013	0.97	7.41	170.35	4.3	Vitrified Clay
661	O2L36SC4	M36C4	5.1	M36C3	3.9	227.5	0.005	8	0.01	1.58	21.482	494.65	4.3	PVC
4064	O2L2SP1	M2P1	0	M2A2	-1.3	292.9	0.004	8	0.013	1.14	15.3	357.43	4.3	Vitrified Clay
1053	O1L17ST3	M17T3	-2.8	M17T2	-3.3	99.7	0.005	12	0.013	1.6	48.45	1132.6	4.3	
576	O2L7SE1	M7E1	4.9	M7D3	2.7	432.8	0.005	6	0.013	1.02	7.7333	181.57	4.3	Vitrified Clay
4218	O2L25SA3	M25A2	-0.4	M25A3	0.2	107.7	0.006	8	0.013	1.29	17.127	404.83	4.2	Vitrified Clay
963	O2L4SA5	M4A5	1.8	M4A4	1.2	122.9	0.005	6	0.013	0.97	7.245	171.5	4.2	Vitrified Clay
3192	O2L30SF1	M30B3	1	M30B2	0	167.7	0.006	6	0.013	1.1	8.19	194.44	4.2	Vitrified Clay
137	O1L17SJ1	M17J1	3.7	M17A9	2.6	254	0.004	8	0.013	1.13	14.962	356.87	4.2	
1567	O1L14SH4	M14H4	4.2	M14H3	3.8	105.9	0.004	8	0.013	1.08	14.25	341.52	4.2	Vitrified Clay
3175	O2L30SA2	M30B1	-0.5	M30A1	-0.9	23.9	0.018	6	0.013	1.85	13.545	333.55	4.1	Vitrified Clay
1706	O2L38SC1	M38A2	-2	M38C1	-0.7	296.3	0.004	12	0.013	1.42	41.003	1030.2	4	
860	O2L1SB2	M1B1	-0.4	M1B2	1.2	373.3	0.004	8	0.013	1.09	13.8	354.63	3.9	Vitrified Clay
1612	O2L3SD2	M3D2	0.6	M3D1	-0.2	284.2	0.003	8	0.013	0.89	11.115	287.73	3.9	Vitrified Clay
735	O2L3SA3	M3A3	0.4	M3A2	-1.3	474.8	0.004	8	0.013	0.99	12.255	321.66	3.8	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1565	O1L14SH3	M14H3	3.8	M14H2	3.4	53.6	0.007	8	0.013	1.38	17.1	450.68	3.8	Vitrified Clay
1447	O2L31SB1	M31B1	-0.4	M31A1	-4	231.3	0.015	8	0.01	2.67	32.788	875.9	3.7	PVC
1025	O1L17SN2	M17N2	3.7	M17N1	0.1	202.6	0.018	8	0.01	2.84	34.2	935.91	3.7	PVC
1481	O2L39SA2	M39A1	-1.6	M39A2	-0.3	346.5	0.004	8	0.01	0.1	15.75	440.09	3.6	PVC
1435	O2L32SA4	M32A4	1.9	M32A3	1.1	179	0.004	8	0.01	1.4	16.517	465.42	3.5	PVC
3121	O2L29SB1	M29B1	-1	M29A1	-1.6	116	0.005	6	0.01	1.24	8.19	231.48	3.5	PVC
1749	O2L31SB3	M31B3	1.7	M31B2	0.8	175	0.005	8	0.01	1.52	17.767	505.55	3.5	PVC
4451	O2L18SB1	M18A1	-3.1	M18B1	-2.4	108	0.007	8	0.013	0.1	15.435	439.69	3.5	Vitrified Clay
1081	O1L17SH1	M17H1	2.6	M17A10	2.3	40.6	0.006	8	0.01	1.65	19.237	553.53	3.5	PVC
676	O2L36SB6	M36B6	3	M36B5	2.1	238.2	0.004	8	0.01	1.31	14.901	442.9	3.4	PVC
1210	O1L14SS3	M14S3	2.9	M14S2	2.1	210.9	0.004	8	0.013	0.99	11.115	334.02	3.3	Vitrified Clay
742	O2L3SA4	M3A4	1.4	M3A3	0.4	285.6	0.004	8	0.013	0.94	10.545	320.92	3.3	Vitrified Clay
1070	O1L17SQ1	M17Q1	-4	M17Q0	0.6	105.3	-0.043	8	0.013	0.24	37.05	1128.7	3.3	Vitrified Clay
1716	O2L38SB3	M38B2	0.1	M38B3	1.5	395.4	0.003	8	0.01	1.22	13.618	416.54	3.3	PVC
786	O2L2SD3	M2D3	1.5	M2D2	0	255.5	0.006	6	0.013	1.01	6.3	192.96	3.3	Vitrified Clay
3384	O2L25SB2	M25B2	0.9	M25B1	0.3	267.7	0.002	8	0.013	0.79	8.76	269.31	3.3	Vitrified Clay
1079	O1L17SH2	M17H2	3	M17H1	2.6	95.1	0.005	8	0.01	1.48	16.388	506.06	3.2	PVC
1308	O1L14SG1	M14C10	2.6	M14C9	1.7	204.6	0.004	8	0.01	1.3	14.25	446.3	3.2	PVC
691	O2L36SB5	M36B5	2.1	M36B4	0.5	346.3	0.004	8	0.01	1.36	14.901	467.13	3.2	PVC
1796	O2L26SA1	M26A1	-0.1	W-26	-0.3	30.7	0.007	6	0.019	0.72	4.41	139.01	3.2	
610	O2L2SA4	M2A4	1.5	M2A3	0.3	385.4	0.003	8	0.013	0.88	9.6	302.61	3.2	Vitrified Clay
1379	O1L37SC1	M37C1	-2.6	M37A1	-3.2	151.6	0.004	8	0.01	1.25	13.574	428.51	3.2	PVC
1349	O2L34SU1	M34U1	2.6	M34L1	1.6	241.1	0.004	8	0.013	1.02	10.978	351.02	3.1	Vitrified Clay
705	O1L17SL6	M17L6	4	M17L5	3.6	88.8	0.005	8	0.01	1.4	15.116	484.91	3.1	PVC
990	O2L34SI1	M34J1	0.1	M34A7	-0.5	104.2	0.006	6	0.013	1	6.0375	194.22	3.1	Vitrified Clay
3349	O2L25SA4	M25A4	1	M25A3	0.2	124.4	0.006	8	0.01	1.6	17.127	554.7	3.1	PVC
3390	O2L25SA5	M25A4	1	M25A5	1.5	128.6	0.004	8	0.01	1.28	13.662	443.97	3.1	PVC
3392	O2L25SA6	M25A6	1.9	M25A5	1.5	110	0.004	8	0.01	1.26	13.347	435.75	3.1	PVC
767	O2L2SA3	M2A3	0.3	M2A2	-1.3	170.1	0.009	8	0.013	1.48	15.6	517.85	3	Vitrified Clay
1610	O2L3SD3	M3D3	1.5	M3D2	0.6	298.5	0.003	8	0.013	0.85	8.835	299.44	3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4478	O2L4SG1	M4G1	3	M4A1	0.1	347.6	0.008	6	0.013	1.16	6.7725	230.02	2.9	Vitrified Clay
567	O2L7SD4	M7D4	4.4	M7D3	2.7	329.2	0.005	6	0.013	0.93	5.4	183.62	2.9	
932	O2L5SD4	M5D4	2.2	M5D3	0.7	315.1	0.005	6	0.013	0.87	5.04	173.17	2.9	Vitrified Clay
3518	O2L35SB1	M35A1	-1.3	M35B1	2	326.2	0.01	8	0.01	2.01	20.636	709.15	2.9	PVC
3358	O2L25SB1	M25B1	0.3	M25A1	-1	149.3	0.008	8	0.013	1.39	14.115	494.2	2.9	Vitrified Clay
3195	O2L30SF1	M30F1	1.8	M30B3	1	205.5	0.004	4	0.01	0.77	1.89	69.272	2.7	PVC
804	O2L2SC2	M2C2	-1.3	M2C1	-1.8	83.4	0.006	6	0.013	0.98	5.4	198.28	2.7	Vitrified Clay
666	O2L36SG2	M36G2	6	M36G1	5	235.8	0.004	8	0.01	1.26	12.37	454.49	2.7	PVC
1719	O2L16SB1	M16B1	-2	M16A1	-2.8	114.9	0.006	12	0.013	1.58	34.912	1283.3	2.7	
3113	O2L29SA2	M29A2	-0.7	M29A1	-1.6	160.7	0.006	8	0.01	1.46	14.175	527.71	2.7	PVC
595	O2L7SF1	M7F1	4.1	M7D2	1.8	335.2	0.007	6	0.013	1.01	5.4	207.68	2.6	
3996	O2L36SD1	M36B1	-4	M36D1	1	188.9	0.026	8	0.01	3.13	29.802	1147.1	2.6	PVC
1406	O1L17SI1	M17I1	4.9	M17B5	4.7	64.3	0.004	8	0.01	1.2	11.4	439.57	2.6	PVC
4269	O1L14SF3	M14F2	2.5	M14F3	3	132.3	0.004	8	0.013	0.9	8.55	330.07	2.6	Vitrified Clay
4418	O2L30SA2	M30A2	-0.2	M30A1	-0.9	85.8	0.009	8	0.013	1.37	12.915	501.36	2.6	
1416	O1L17SE1	M17E1	7	M17B9	6.5	115	0.004	8	0.01	1.21	11.4	445.98	2.6	PVC
1004	O1L17SM7	M17M7	3.8	M17M6	2.5	319.4	0.004	8	0.01	1.21	11.4	446.35	2.6	PVC
1410	O1L17SD1	M17D1	6.2	M17B6	5.6	164.6	0.004	8	0.01	1.21	11.4	446.41	2.6	PVC
1420	O1L17SB11	M17B11	7.8	M17B10	7	190.4	0.004	8	0.01	1.23	11.4	457.07	2.5	PVC
842	O2L1SJJ3	M1JJ3	2.7	M1JJ2	2.1	81.2	0.007	6	0.013	0.98	5.1	205.35	2.5	Vitrified Clay
637	O2L36SA9	M36A9	1	M36A8	0.2	86.2	0.009	8	0.01	1.81	16.625	670.63	2.5	PVC
3414	O2L18SA2	M18A2	-2.5	M18A1	-3.1	163.8	0.004	12	0.013	0.07	24.57	991.79	2.5	
784	O2L2SD4	M2D4	3	M2D3	1.5	383.8	0.004	6	0.013	0.75	3.9	157.44	2.5	Vitrified Clay
3419	O2L18SA3	M18A3	-1.6	M18A2	-2.5	255	0.003	8	0.013	0.05	7.875	320.4	2.5	Vitrified Clay
709	O2L3SH3	M3H3	1.8	M3H2	1.3	115.2	0.005	6	0.013	0.81	4.135	169.18	2.4	Vitrified Clay
3179	O2L30SB5	M30B5	2.2	M30B4	1.7	110.8	0.005	6	0.013	0.8	4.095	169.15	2.4	Vitrified Clay
3331	O2L25SC1	M25C1	0.6	M25A2	-0.4	133.3	0.008	6	0.013	1.05	5.355	221.35	2.4	Vitrified Clay
673	O2L36SF1	M36F1	3	M36D2	1.9	139.7	0.008	8	0.01	1.66	14.901	619.99	2.4	PVC
1427	O2L32SC1	M32A1	-0.6	M32C1	-0.4	27.1	0.007	8	0.01	1.53	13.805	574.73	2.4	PVC
1186	O1L14SM3	M14M3	3	M14M2	2.2	209.2	0.004	8	0.013	0.93	8.265	347.74	2.4	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
3305	O2L24SA1	M24D1	-0.9	M24A1	-1.6	169.2	0.004	6	0.013	0.75	3.78	159.65	2.4	Vitrified Clay
1027	O1L17SN3	M17N3	4.7	M17N2	3.7	210.4	0.005	8	0.01	1.28	11.4	483.64	2.4	PVC
639	O2L36SH2	M36H2	5.1	M36H1	3	229.5	0.009	8	0.01	1.77	15.703	669.54	2.3	PVC
1230	O1L14SA11	M14A11	2	M14A10	1.2	138.9	0.006	8	0.013	1.1	9.69	415.7	2.3	Vitrified Clay
3411	O2L18SE1	M18E1	-1.8	M18A2	-2.5	142.4	0.005	8	0.013	0.06	8.82	380.31	2.3	Vitrified Clay
663	O2L36SC5	M36C5	6	M36C4	5.1	220.1	0.004	8	0.01	1.22	10.741	463.16	2.3	PVC
4063	O2L2SR1	M2R1	1.8	M2P1	0	423.6	0.004	8	0.013	0.93	8.1	352.99	2.3	Vitrified Clay
1029	O1L17SN4	M17N4	5.3	M17N3	4.7	122.5	0.005	8	0.01	1.31	11.4	497.52	2.3	PVC
1603	O2L38SD1	M38D1	0.1	M38A6	-1	190.5	0.006	8	0.01	1.4	12.154	530.84	2.3	PVC
4479	O2L4SA1	M4A1	0.1	W-4	-4.6	7.7	0.602	6	0.013	8.39	44.529	1953.9	2.3	Vitrified Clay
592	O2L7SG1	M7G1	3.9	M7D1	1	328.7	0.009	6	0.013	1.11	5.4	237.34	2.3	
4018	O2L5SD1	M5A2	-2.7	M5D1	-1	360.5	0.005	8	0.01	1.25	10.71	475.56	2.3	PVC
1526	O2L34SC4	M34C4	2.9	M34C3	1.7	308.5	0.004	12	0.013	1.17	22.604	1009.7	2.2	Vitrified Clay
1561	O1L14SH1	M14H1	3	M14D2	1.3	47	0.036	8	0.013	2.67	22.8	1025.4	2.2	Vitrified Clay
1537	O2L34SB3	M34B3	2.9	M34B2	2.3	139.3	0.004	8	0.01	1.23	10.427	470.36	2.2	PVC
1535	O2L34SB2	M34B2	2.3	M34B1	1.7	122.7	0.004	8	0.01	1.23	10.427	471.99	2.2	PVC
647	O2L36SE1	M36E1	2.2	M36A3	-2.4	311.1	0.015	8	0.01	2.24	18.913	864.78	2.2	PVC
4028	O2L3SB1	M3A4	1.4	M3B1	1.9	100.8	0.005	6	0.013	0.78	3.705	170.08	2.2	Vitrified Clay
4066	O2L2SP2	M2P1	0	M2P2	0.5	91.8	0.006	6	0.013	0.9	4.2	196.19	2.1	
1463	O2L34SA12	M34A12	1.7	M34A11	1.5	31.8	0.004	8	0.013	0.92	7.6125	359.79	2.1	Vitrified Clay
1462	O2L34SA13	M34A13	2.1	M34A12	1.7	127.9	0.003	8	0.013	0.8	6.5625	314.43	2.1	Vitrified Clay
1528	O2L34SC5	M34C5	4.1	M34C4	2.9	308.2	0.004	12	0.013	1.15	21	1010.1	2.1	Vitrified Clay
1182	O1L14SM2	M14M2	2.2	M14M1	-0.4	216.3	0.012	8	0.013	1.51	12.255	591.62	2.1	Vitrified Clay
1068	O1L17SQ0	M17T1	-3.5	M17A1	-7	161.1	0.022	12	0.013	2.67	48.45	2353.3	2.1	
728	O2L3SL2	M3L2	0.9	M3L1	0.4	83.1	0.005	6	0.013	0.82	3.705	181.11	2	Vitrified Clay
4387	O2L32SB2	M32B1	2	M32B2	3	272.8	0.004	8	0.01	1.08	8.699	426.9	2	PVC
3181	O2L30SB6	M30B6	2.7	M30B5	2.2	91.7	0.005	6	0.013	0.84	3.78	186	2	Vitrified Clay
788	O2L2SD2	M2D2	0	M2D1	-1.7	68.4	0.025	6	0.013	1.8	8.1	398.66	2	Vitrified Clay
974	O2L34SF2	M34F3	2.7	M34F2	1.9	281.3	0.003	8	0.013	0.77	6.1235	303.34	2	Vitrified Clay
947	O2L4SB1	M4B1	2.5	M4A3	0.7	377.4	0.005	6	0.013	0.78	3.465	172.94	2	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1214	O1L14SS4	M14S4	3.7	M14S3	2.9	209.4	0.004	8	0.013	0.87	6.84	343.46	2	Vitrified Clay
3190	O2L30SE1	M30E1	1.5	M30B2	0	205.1	0.007	4	0.01	0.95	1.89	94.953	2	PVC
798	O2L2SF1	M2F1	0.4	M2C1	-1.8	420.7	0.005	6	0.013	0.81	3.6	182.25	2	Vitrified Clay
638	O2L36SH1	M36H1	3	M36A8	0.2	96.2	0.029	8	0.01	3.01	23.555	1198.8	2	PVC
3900	O2L34SA14	M34A13	2.1	M34A14	2.3	50.2	0.003	8	0.013	0.74	5.775	296.44	1.9	
4417	O2L30SA3	M30A3	0.6	M30A2	-0.2	86.2	0.009	8	0.013	1.25	9.765	501.36	1.9	
1533	O2L34SD1	M34D1	2.9	M34B1	1.7	285.9	0.004	8	0.01	1.13	8.778	451.03	1.9	PVC
3136	O2L34SL2	M34L2	2.3	M34L1	1.6	126.4	0.006	6	0.01	1.1	4.8225	248.74	1.9	PVC
1358	O2L16SA7	M16A7	2.8	M16A6	1.1	397.2	0.004	8	0.01	1.14	8.8737	458.56	1.9	PVC
3988	O1L37SC1	M14D5	3.5	M14D4	2.8	225.2	0.003	8	0.013	0.74	5.7	298.04	1.9	Vitrified Clay
1314	O1L14SG2	M14G2	3.3	M14G1	2.4	203	0.004	8	0.01	1.11	8.55	448.05	1.9	PVC
1539	O2L34SB4	M34B4	3.5	M34B3	2.9	146.2	0.004	8	0.01	1.13	8.6771	455.49	1.9	PVC
3126	O2L29SB2	M29B2	0	M29B1	-1	152.4	0.007	6	0.01	1.18	5.04	265.2	1.9	PVC
3225	O2L18SB2	M18B2	-1.6	M18B1	-2.4	137	0.006	8	0.013	0.05	7.875	422.13	1.9	Vitrified Clay
821	O2L1SB3	M1B2	1.2	M1B3	2.4	277.1	0.004	8	0.013	0.88	6.6	357.79	1.8	Vitrified Clay
1531	O2L34SD2	M34D2	3.6	M34D1	2.9	139.4	0.005	8	0.01	1.18	8.778	481.37	1.8	PVC
378	O2L3SG1	M3G1	0.2	M3A2	-1.3	398.5	0.004	8	0.013	0.81	5.985	330.52	1.8	Vitrified Clay
3902	O2L13SA1	W-13	2.7	M13A1	3.2	115.4	0.004	8	0.01	1.14	8.33	464.05	1.8	PVC
1601	O2L38SD2	M38D2	0.7	M38D1	0.2	191.8	0.002	8	0.01	0.83	6.0769	341.53	1.8	PVC
671	O2L36SD3	M36D3	3	M36D2	1.9	76.5	0.014	8	0.01	2.03	14.901	837.85	1.8	PVC
967	O2L4SG2	M4G2	5.4	M4G1	3	360.7	0.007	6	0.013	0.88	3.6225	205.41	1.8	Vitrified Clay
769	O2L2SJ1	M2A3	0.3	M2J1	0.1	127.5	-0.001	8	0.013	0.02	3.3	192.16	1.7	Vitrified Clay
695	O1L17SL1	M17L1	0.9	M17A8	-2.1	21.4	0.139	8	0.01	6.35	45.041	2631.4	1.7	PVC
636	O2L36SA10	M36A10	1.4	M36A9	1	88	0.005	8	0.01	1.17	8.3125	487.09	1.7	PVC
1520	O2L34SC1	M34C1	-1	M34A2	-4.6	374	0.01	12	0.01	2.17	34.417	2030.2	1.7	PVC
640	O2L36SH3	M36H3	6	M36H2	5.1	213.5	0.004	8	0.01	1.12	7.8517	465.33	1.7	PVC
585	O2L7SA4	M7A4	1.3	M7A3	-0.6	364.9	0.005	8	0.013	0.94	6.6	391.35	1.7	Vitrified Clay
757	O2L3SA6	M3A6	2.9	M3A5	1.7	259.6	0.005	6	0.013	0.72	2.85	169.07	1.7	Vitrified Clay
992	O2L34SJ2	M34K1	1.1	M34J1	0.1	182.5	0.006	6	0.013	0.8	3.15	187.35	1.7	Vitrified Clay
934	O2L5SD5	M5D5	3.4	M5D4	2.2	254	0.005	6	0.013	0.72	2.835	169.45	1.7	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1569	O1L14SH5	M14H5	5.2	M14H4	4.2	246.4	0.004	8	0.013	0.82	5.7	343.76	1.7	Vitrified Clay
3418	O2L18ASA4	M18A4	-0.9	M18A3	-1.6	164.1	0.004	8	0.013	0.04	5.67	343.92	1.6	Vitrified Clay
4104	O2L1SBB1	M1A7	1.7	M1BB1	2.4	89.8	0.008	6	0.013	0.93	3.6	218.9	1.6	Vitrified Clay
823	O2L1SB4	M1B3	2.4	M1B4	3.5	154.1	0.007	4	0.013	0.7	1.2	73.532	1.6	Vitrified Clay
4477	O2L4SH1	M4H1	2.5	M4A1	0.1	404.3	0.006	6	0.013	0.82	3.15	194.02	1.6	Vitrified Clay
1037	O1L17ST4	M17T4	1.1	M17T3	-2.8	190.2	0.021	12	0.013	2.41	37.05	2289.8	1.6	
1590	O2L16SD2	M16D2	2	M16D1	-0.1	279	0.008	8	0.013	1.11	7.5542	470.5	1.6	Vitrified Clay
1310	O1L14SC11	M14C11	3.1	M14C10	2.6	135.7	0.004	8	0.01	1.05	7.125	444.74	1.6	PVC
4009	O2L9SA2	M9A1	-0.3	M9A2	1.1	236.1	0.006	12	0.013	1.29	19.688	1231.2	1.6	
3981	O2L15SA1	W-15	3.5	M15A1	4.5	266.7	0.004	8	0.01	1.01	6.7375	431.72	1.6	PVC
894	O2L1SA11	M1A10	5.9	M1A11	6.4	146.8	0.003	8	0.01	0.96	6.25	411.46	1.5	PVC
1437	O2L32SD1	M32D1	1.4	M32A3	1.1	78.3	0.003	8	0.01	0.93	6.02	398.51	1.5	PVC
758	O2L3SA5	M3A5	1.7	M3A4	1.4	87.5	0.004	8	0.013	0.75	4.845	322.82	1.5	Vitrified Clay
3950	O2L29SA3	M29A2	-0.7	M29A3	0.2	149.9	0.006	8	0.01	1.23	7.875	529.4	1.5	PVC
1524	O2L34SC3	M34C3	1.7	M34C2	-0.3	30.9	0.064	8	0.01	4.12	26.396	1782.6	1.5	PVC
4153	O2L1SV1	M1U1	2.6	M1V1	3	43.4	0.009	4	0.013	0.76	1.2	81.985	1.5	Vitrified Clay
711	O2L3SH4	M3H4	2.5	M3H3	1.8	81.3	0.009	4	0.013	0.73	1.14	79.253	1.4	Vitrified Clay
4159	O2L1SS1	M1A4	1	M1S1	1.8	120.9	0.007	6	0.013	0.85	3	208.66	1.4	Vitrified Clay
613	O2L2SA5	M2A5	1.9	M2A4	1.5	124.8	0.004	8	0.013	0.77	4.8	336.41	1.4	Vitrified Clay
3435	O1L37SA1	M37A1	-3.2	W-37	-3.7	8.4	0.056	12	0.01	4.99	69.759	4904.3	1.4	PVC
1739	O2L16SB3	M16B3	-1.5	M16B2	-1.7	50.3	0.004	12	0.013	1.03	14.321	1008.4	1.4	
618	O2L3SD4	M3D4	2	M3D3	1.5	115	0.004	8	0.013	0.8	4.845	350.41	1.4	Vitrified Clay
4428	O2L16SC1	M16A1	-2.8	M16C1	2.2	437.7	0.011	8	0.013	1.3	7.875	576.76	1.4	
4057	O2L2ST1	M2R1	1.8	M2T1	2.3	85.8	0.006	6	0.013	0.8	2.7	198.53	1.4	Vitrified Clay
4030	O2L3SB2	M3B1	1.9	M3B2	2.8	214	0.005	6	0.013	0.68	2.28	169.53	1.3	Vitrified Clay
4271	O2L4SG3	M4G2	5.4	M4G3	6.2	100.2	0.008	6	0.013	0.9	2.9925	224.99	1.3	Vitrified Clay
1542	O2L34SB1	M34B1	1.7	M34A1	-5.5	102.4	0.071	8	0.01	4.2	24.795	1873.1	1.3	PVC
1039	O1L17SV1	M17V1	1.8	M17T4	1.1	162.6	0.005	12	0.013	1.07	14.25	1086	1.3	
4162	O2L1SS2	M1S1	1.8	M1S2	2.5	60.4	0.012	4	0.013	0.82	1.2	91.915	1.3	Vitrified Clay
1095	O1L17SP2	M17P2	4.1	M17P1	2.9	316.4	0.004	8	0.01	0.98	5.7	441.35	1.3	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1097	O1L17SP3	M17P3	4.5	M17P2	4.1	90	0.004	8	0.01	0.99	5.7	445.84	1.3	PVC
3644	O2L18ASA1	M18A-A1	-1	W-18A	-4	21.7	0.139	12	0.013	5.51	76.004	5961.7	1.3	
980	O2L34SH2	M34H1	-0.2	M34H2	0.9	195.1	0.006	6	0.013	0.74	2.3625	186.95	1.3	Vitrified Clay
835	O2L1SH3	M1H2	3.3	M1H3	3.6	46.6	0.007	4	0.013	0.64	0.9	71.885	1.3	Vitrified Clay
1773	O2L30SA5	M30A5	2.2	M30A4	1.4	174.9	0.004	8	0.013	0.77	4.41	355.13	1.2	Vitrified Clay
1093	O1L17SP1	M17P1	2.9	M17A1	-7	91.4	0.108	8	0.01	5.02	28.5	2316.4	1.2	PVC
3144	O2L34SL3	M34L3	2.9	M34L2	2.3	91.7	0.006	6	0.01	0.99	3.09	254.72	1.2	PVC
4098	O2L1SHH1	M1A9	3	M1HH1	3.5	77.2	0.006	6	0.013	0.77	2.4	198.6	1.2	Vitrified Clay
4050	O2L2SR3	M2R2	3.2	M2R3	3.7	81.2	0.006	6	0.013	0.77	2.4	198.81	1.2	Vitrified Clay
3320	O2L24SA2	M24A2	-1	M24A1	-1.6	142.9	0.004	6	0.013	0.62	1.89	159.05	1.2	Vitrified Clay
755	O2L3SA7	M3A7	3.5	M3A6	2.9	148.7	0.005	6	0.013	0.65	1.995	169.06	1.2	Vitrified Clay
819	O2L1SF1	M1F1	2.5	M1B2	1.2	315.9	0.004	8	0.013	0.76	4.2	356.39	1.2	Vitrified Clay
806	O2L2SC3	M2C3	0.9	M2C2	-1.3	422.1	0.005	6	0.013	0.7	2.1	182.37	1.2	Vitrified Clay
800	O2L2SF2	M2F2	2.1	M2F1	0.4	318	0.005	6	0.013	0.69	2.1	183.59	1.1	Vitrified Clay
649	O2L36SE2	M36E2	6	M36E1	2.2	273.3	0.014	8	0.01	1.76	9.4567	827	1.1	PVC
1786	O2L30SA1	M30A1	-0.9	W-30	-5.5	19.7	0.23	8	0.013	5.12	29.61	2601.4	1.1	
581	O2L7SA6	M7A6	4.9	M7A5	3.3	302.5	0.005	6	0.013	0.69	2.1	184.85	1.1	Vitrified Clay
1046	O1L17ST7	M17T7	2.4	M17T6	2.1	93.7	0.004	12	0.013	0.95	11.4	1004.7	1.1	
1048	O1L17ST6	M17T6	2.1	M17T5	1.8	68.2	0.004	12	0.013	0.95	11.4	1006.3	1.1	
3948	O2L10SA1	W-10	4.4	M10A1	5.5	238.1	0.005	6	0.01	0.83	2.4792	222.53	1.1	PVC
1708	O2L38SC2	M38C1	-0.6	M38C2	1	264.1	0.006	12	0.013	1.18	13.938	1252.3	1.1	
1400	O1L17SC1	M17C1	3.7	M17B3	3.4	65.6	0.004	12	0.013	0.97	11.4	1025.7	1.1	
901	O2L23SB2	M23B2	3.5	M23B1	1.9	401.3	0.004	8	0.013	0.72	3.7917	342.43	1.1	Vitrified Clay
3410	O2L18SE2	M18E2	-0.6	M18E1	-1.8	282.2	0.004	8	0.013	0.02	3.78	343.2	1.1	Vitrified Clay
827	O2L1SH1	M1B3	2.4	M1H1	2.9	94.6	0.006	8	0.013	0.86	4.5	409.82	1.1	Vitrified Clay
584	O2L7SA5	M7A5	3.3	M7A4	1.3	399.6	0.005	8	0.013	0.8	4.2	383.71	1.1	Vitrified Clay
978	O2L34SH1	M34F1	0.8	M34H1	-0.2	109.3	-0.01	8	0.013	0.04	5.775	530.12	1.1	Vitrified Clay
3984	O1L37SC2	M37C1	-2.6	M37C2	-1.4	255.1	0.005	8	0.01	1.03	5.2208	497.45	1	PVC
4122	O2L1SEE1	M1BB1	2.4	M1EE1	2.9	49.2	0.01	4	0.013	0.71	0.9	86.119	1	Vitrified Clay
1049	O1L17ST5	M17T5	1.8	M17T4	1.1	145.9	0.005	12	0.013	1.02	11.4	1107.6	1	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1232	O1L14SBB1	M14BB1	3.3	M14A11	2	308.7	0.004	8	0.013	0.7	3.42	342.62	1	Vitrified Clay
1190	O1L14SM4	M14M4	4.3	M14M3	3	319.5	0.004	8	0.013	0.7	3.42	343.3	1	Vitrified Clay
1246	O1L14SZ1	M14Z1	4.2	M14A10	1.2	321.9	0.009	8	0.013	1.05	5.13	519.69	1	Vitrified Clay
1508	O2L18ASD1	M18A-D1	2.5	M18A-A6	1.2	315.6	0.004	8	0.01	0.91	4.41	447.27	1	PVC
4072	O2L2SJ2	M2J1	0.1	M2J2	1	78.1	0.012	4	0.013	0.74	0.9	91.672	1	Vitrified Clay
3428	O2L25SA1	M25A1	-1	W-25	-5.9	50.8	0.097	12	0.013	4.35	48.252	4982.7	1	
722	O2L3SL3	M3L3	1.7	M3L2	0.9	125.3	0.007	6	0.013	0.74	1.995	207.43	1	Vitrified Clay
764	O2L2SB2	M2B2	2	M2B1	1	179.7	0.006	6	0.013	0.67	1.8	187.85	1	Vitrified Clay
1360	O2L16SA8	M16A8	3.5	M16A7	2.8	165.8	0.005	8	0.01	0.96	4.5675	477.36	1	PVC
4004	O2L13SA2	M13A1	3.2	M13A2	4.5	310.7	0.004	8	0.013	0.7	3.3337	350.8	1	
4107	O2L1SKK1	M1BB1	2.4	M1KK1	3.5	48.2	0.023	4	0.013	1.03	1.2	129.03	0.9	Vitrified Clay
611	O2L2SO1	M2O1	2.4	M2A4	1.5	315.3	0.003	8	0.013	0.59	2.7	297.71	0.9	Vitrified Clay
782	O2L2SI1	M2I1	4	M2D4	3	162	0.006	4	0.013	0.53	0.6	67.101	0.9	Vitrified Clay
1148	O1L14SJ1	M14J1	-1.9	M14A4	-2.9	254.3	0.004	8	0.01	0.88	3.99	446.55	0.9	PVC
1362	O2L16SA9	M16A9	3.9	M16A8	3.5	76.3	0.005	8	0.01	1.01	4.5675	516.97	0.9	PVC
1218	O1L14SS5	M14S5	4.7	M14S4	3.7	280	0.004	8	0.013	0.63	2.85	324.1	0.9	Vitrified Clay
380	O2L3SG2	M3G2	1.7	M3G1	0.2	419.3	0.004	8	0.013	0.63	2.85	324.4	0.9	Vitrified Clay
4105	O2L1SBB2	M1BB1	2.4	M1BB2	3	127.3	0.005	6	0.013	0.6	1.5	172.91	0.9	Vitrified Clay
619	O2L3SE1	M3E1	2.4	M3D3	1.5	300.9	0.003	8	0.013	0.58	2.565	296.6	0.9	Vitrified Clay
4032	O2L3SB3	M3B2	2.8	M3B3	3.3	104.3	0.005	6	0.013	0.58	1.425	169.07	0.8	Vitrified Clay
1317	O1L17SQ5	M17Q5	5.3	M17Q4	4.1	301.2	0.004	8	0.013	0.66	2.85	340.88	0.8	Vitrified Clay
3684	O2L22SA4	M22A4	1.6	M22A5	2.2	112.5	0.005	8	0.013	0.74	3.15	386.07	0.8	
4112	O2L1SBB3	M1BB2	3	M1BB3	3.9	118.3	0.008	4	0.013	0.57	0.6	74.498	0.8	Vitrified Clay
614	O2L2SA6	M2A6	2.8	M2A5	1.9	296.5	0.003	8	0.013	0.57	2.4	298.8	0.8	Vitrified Clay
1774	O2L30SI1	M30I1	2	M30A4	1.4	69.2	0.009	4	0.013	0.6	0.63	79.509	0.8	Vitrified Clay
1754	O2L31SB4	M31B4	3.4	M31B3	1.7	470.5	0.004	12	0.013	0.83	7.7198	975.16	0.8	
355	O1L17SJ2	M17J2	4.8	M17J1	3.7	259	0.004	8	0.01	0.86	3.5625	451.05	0.8	PVC
812	O2L2SR2	M2R2	3.2	M2R1	1.8	334.5	0.004	8	0.013	0.67	2.7	355.61	0.8	Vitrified Clay
1035	O1L17SU1	M17U1	-2.3	M17T3	-2.8	61.2	0.009	12	0.013	1.25	11.4	1501.6	0.8	
4160	O2L1SU1	M1S1	1.8	M1U1	2.6	83.5	0.01	6	0.013	0.81	1.8	246.46	0.7	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
909	O2L5SB1	M5B1	3	M5A3	-2.4	287.8	0.019	6	0.013	1.14	2.52	345.61	0.7	Vitrified Clay
1770	O2L30SA6	M30A6	2.7	M30A5	2.2	104.2	0.005	6	0.013	0.57	1.26	174.43	0.7	Vitrified Clay
3903	O2L5SC1	M5A1	-2.9	M5C1	2	250.8	0.02	6	0.013	1.15	2.52	352.74	0.7	Vitrified Clay
1158	O1L14SL1	M14L1	0.1	M14A5	-2.4	327.2	0.007	8	0.01	1.11	4.275	607.64	0.7	PVC
1142	O1L14SI1	M14I1	-0.8	M14A4	-2	306.5	0.004	8	0.01	0.82	3.135	446.62	0.7	PVC
4208	O2L30SA6	M30A7	2.8	M30A6	2.7	29.1	0.005	6	0.013	0.59	1.26	180.73	0.7	Vitrified Clay
4234	O2L7SC4	M7C3	0.7	M7C4	3	468.5	0.005	6	0.013	0.57	1.2	176.44	0.7	Vitrified Clay
1366	O2L16SG1	M16G1	2.5	M16A6	1.1	320.9	0.004	12	0.013	0.84	7.0875	1048.7	0.7	
4034	O2L3SB4	M3B3	3.3	M3B4	3.6	62.9	0.005	6	0.013	0.55	1.14	171.05	0.7	Vitrified Clay
4229	O2L25SJ1	M25B2	0.9	M25J1	3	400.1	0.005	6	0.013	0.58	1.2	181.15	0.7	Vitrified Clay
766	O2L2SB1	M2B1	1	M2A2	-1.3	308.4	0.007	8	0.013	0.83	3	467.41	0.6	Vitrified Clay
1077	O1L17SG1	M17H3	4.5	M17H2	3	366.1	0.004	8	0.01	0.79	2.85	445.26	0.6	PVC
1771	O2L30SK1	M30K1	3.1	M30A5	2.2	70.4	0.014	4	0.013	0.71	0.63	99.254	0.6	Vitrified Clay
1772	O2L30SJ1	M30J1	3.5	M30A5	2.2	99	0.014	4	0.013	0.71	0.63	99.722	0.6	Vitrified Clay
3172	O2L30SC1	M30C1	-0.5	M30A1	-0.9	29.6	0.014	6	0.013	0.95	1.89	300.19	0.6	Vitrified Clay
1204	O1L14SX1	M14X1	2	M14S1	1	246.8	0.004	8	0.013	0.61	2.1375	341.77	0.6	Vitrified Clay
1737	O2L16SH1	M16H1	-1.9	M16B1	-2	32.1	0.004	12	0.013	0.8	6.3	1017.5	0.6	
4214	O2L25SD1	M25C1	0.6	M25D1	2.3	116.5	0.014	4	0.013	0.72	0.63	102.26	0.6	Vitrified Clay
831	O2L1SI1	M1H1	2.9	M1H2	3.3	61.4	0.007	8	0.013	0.78	2.7	444.36	0.6	Vitrified Clay
771	O2L2SL1	M2L1	0.6	M2J1	0.1	86	0.006	6	0.013	0.62	1.2	197.66	0.6	Vitrified Clay
1236	O1L14SAA2	M14AA1	3.9	M14A10	1.2	248.8	0.011	8	0.013	1	3.42	568.69	0.6	Vitrified Clay
617	O2L3SD4	M3D5	4	M3D4	2	318.4	0.006	8	0.013	0.75	2.565	426.62	0.6	Vitrified Clay
955	O2L4SD1	M4D1	3.5	M4A4	1.2	332.6	0.007	6	0.013	0.65	1.26	210.31	0.6	Vitrified Clay
4198	O2L34SA15	M34A15	3.3	M34A14	2.3	255.6	0.004	8	0.01	0.77	2.625	445.41	0.6	PVC
1423	O2L34SE2	M34E2	1.5	M34E1	-0.9	213.2	0.011	6	0.01	1.08	2.0417	349.5	0.6	PVC
4238	O2L7SM1	M7C2	-0.1	M7M1	3	463.4	0.007	6	0.013	0.63	1.2	205.96	0.6	Vitrified Clay
904	O2L23SA2	M17A2	2.1	M17A1	0.3	327.5	0.006	8	0.013	0.7	2.3333	404.28	0.6	
1150	O1L14SJ2	M14J2	-0.7	M14J1	-1.9	303.7	0.004	8	0.01	0.77	2.565	445.06	0.6	PVC
1368	O2L16SG2	M16G2	3.4	M16G1	2.5	220.8	0.004	8	0.013	0.62	2.0475	361.35	0.6	
4287	O1L14SC7	M14C6	0.5	M14E1	4.8	106.4	0.041	6	0.013	1.55	2.85	508.53	0.6	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
972	O2L34SF2	M34F4	3.4	M34F3	2.7	291.5	0.002	12	0.013	0.59	4.286	772.29	0.6	
4388	O2L32SB1	M32B1	2	W-32	0	46.8	0.043	12	0.013	2.5	17.974	3305.6	0.5	
1335	O1L40SB2	M40A1	1.2	M40B2	1.9	188.5	0.004	8	0.01	0.77	2.45	453.49	0.5	PVC
1775	O2L30SH1	M30H1	3.1	M30A4	1.4	86.1	0.02	4	0.013	0.81	0.63	120.01	0.5	Vitrified Clay
3166	O2L30SA11	M30A11	4.4	M30A10	4	70.5	0.005	4	0.013	0.4	0.315	60.183	0.5	Vitrified Clay
1220	O1L14ST1	M14T1	3.1	M14S2	2.1	276.9	0.004	8	0.013	0.56	1.71	332.36	0.5	Vitrified Clay
4149	O2L1SU2	M1U1	2.6	M1U2	3.6	52.8	0.019	4	0.013	0.78	0.6	117.52	0.5	Vitrified Clay
1734	O2L16SF1	M16F1	3	M16B2	-1.7	436	0.011	8	0.013	0.93	2.8583	560.08	0.5	
4175	O2L1SK1	M1E2	0.7	M1K1	2	66.3	0.02	6	0.013	1.05	1.8	353.44	0.5	Vitrified Clay
790	O2L2SE1	M2E1	2	M2D1	-1.7	414.5	0.009	6	0.013	0.7	1.2	238.36	0.5	Vitrified Clay
753	O2L3SA8	M3A8	4.3	M3A7	3.5	166.7	0.005	6	0.013	0.5	0.855	170.04	0.5	Vitrified Clay
1234	O1L14SBB2	M14BB2	4.2	M14BB1	3.3	246.9	0.004	8	0.013	0.57	1.71	342.35	0.5	Vitrified Clay
1176	O1L14SN1	M14N1	0.9	M14M1	-0.4	327.3	0.004	8	0.013	0.57	1.71	342.87	0.5	Vitrified Clay
4207	O2L30SA8	M30A8	3.1	M30A7	2.8	52.5	0.006	6	0.013	0.56	0.945	190.42	0.5	Vitrified Clay
1733	O2L16SE1	M16E1	3	M16B1	-2	435.3	0.012	8	0.013	0.96	2.8583	581.84	0.5	
762	O2L2SB2	M2B3	3	M2B2	2	176.5	0.006	6	0.013	0.55	0.9	189.57	0.5	Vitrified Clay
228	O1L17SJ3	M17J3	5.2	M17J2	4.8	51.5	0.009	6	0.01	0.87	1.425	302.67	0.5	PVC
385	O2L23SA1	M17A1	0.3	W-23	-6.4	11	0.608	12	0.013	8.78	58.625	12469	0.5	
4044	O2L2SG1	M2F2	2.1	M2G1	2.8	135	0.006	4	0.013	0.41	0.3	64.717	0.5	Vitrified Clay
4220	O2L25SF1	M25A1	-1	M25F1	2	115.2	0.026	4	0.013	0.9	0.63	137.14	0.5	Vitrified Clay
4091	O2L1SQ1	M1A3	-0.1	M1Q1	2	86.1	0.024	6	0.013	1.12	1.8	392.33	0.5	Vitrified Clay
4224	O2L25SI1	M25B1	0.3	M25I1	3	105.6	0.026	4	0.013	0.9	0.63	137.33	0.5	Vitrified Clay
3106	O2L34SO1	M34O1	2.9	M34A9	0.1	177.4	0.016	6	0.01	1.17	1.89	412.04	0.5	PVC
802	O2L2SF3	M2F3	2.6	M2F2	2.1	89.5	0.006	4	0.013	0.43	0.3	66.799	0.4	Vitrified Clay
3599	O1L37SE1	M37C1	-2.6	M37E1	-1.6	235	0.004	8	0.01	0.75	2.0883	471.24	0.4	PVC
3598	O1L37SB1	M37A2	-2.8	M37B1	-1.7	233.9	0.005	8	0.01	0.77	2.0883	476.91	0.4	PVC
4118	O2L1SCC2	M1CC1	3.5	M1CC2	4	77.5	0.006	4	0.013	0.43	0.3	68.59	0.4	Vitrified Clay
825	O2L1SB5	M1B4	3.5	M1B5	4.5	152.8	0.007	4	0.013	0.43	0.3	69.091	0.4	Vitrified Clay
850	O2L1SOO1	M1JJ1	1.7	M1OO1	4.5	402.4	0.007	6	0.013	0.6	0.9	210.2	0.4	Vitrified Clay
1498	O2L18ASB1	M18A-B1	0.9	M18A-A3	-0.3	279.5	0.004	8	0.01	0.71	1.89	446.28	0.4	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1768	O2L30SA9	M30A9	3.8	M30A8	3.1	198.2	0.004	6	0.013	0.42	0.63	149.65	0.4	Vitrified Clay
1240	O1L14SA12	M14A12	3.5	M14A11	2	375.3	0.004	8	0.013	0.54	1.425	342.87	0.4	Vitrified Clay
1162	O1L14SK1	M14K1	0.6	M14A5	-2.4	260.8	0.012	8	0.01	1.18	3.135	757.49	0.4	PVC
4169	O2L1SM1	M1E1	-0.3	M1M1	2	75.2	0.03	4	0.013	0.9	0.6	147.72	0.4	Vitrified Clay
3520	O2L35SC1	M35A1	-1.3	M35C1	0	95.3	0.014	8	0.01	1.28	3.3168	823.44	0.4	PVC
3156	O2L30SL1	M30A7	2.8	M30L1	3.8	118.5	0.008	4	0.013	0.47	0.315	78.474	0.4	Vitrified Clay
4109	O2L1SKK2	M1KK1	3.5	M1KK2	4.5	130.6	0.008	4	0.013	0.45	0.3	74.737	0.4	Vitrified Clay
1192	O1L14SR1	M14R1	4.4	M14M4	4.3	130.4	0.001	6	0.013	0.2	0.285	73.133	0.4	Vitrified Clay
4100	O2L1SII1	M1HH1	3.5	M1II1	5	181.6	0.008	4	0.013	0.48	0.3	77.63	0.4	Vitrified Clay
1144	O1L14SI2	M14I2	0.5	M14I1	-0.8	310.4	0.004	8	0.01	0.69	1.71	447.43	0.4	PVC
4114	O2L1SBB4	M1BB3	3.9	M1BB4	5.1	138.4	0.009	4	0.013	0.49	0.3	79.521	0.4	Vitrified Clay
4185	O2L7SB2	M1D3	3	M1D4	4	114.4	0.009	4	0.013	0.49	0.3	79.857	0.4	Vitrified Clay
4197	O2L34SA16	M34A16	4.9	M34A15	3.3	402.3	0.004	4	0.01	0.43	0.2625	70.459	0.4	PVC
4247	O2L7SJ1	M7C1	-0.9	M7J1	4	296.3	0.017	6	0.013	0.87	1.2	323.84	0.4	Vitrified Clay
4068	O2L2SP3	M2P2	0.5	M2P3	3	262.3	0.009	4	0.013	0.5	0.3	82.722	0.4	Vitrified Clay
4102	O2L1SHH2	M1HH1	3.5	M1HH2	5.2	180.7	0.009	4	0.013	0.5	0.3	82.851	0.4	Vitrified Clay
4059	O2L2ST2	M2T1	2.3	M2T2	4.2	196	0.01	4	0.013	0.5	0.3	83.315	0.4	Vitrified Clay
3153	O2L34ST1	M34T1	3.5	M34A14	2.3	287.1	0.004	4	0.01	0.44	0.2625	73.273	0.4	PVC
4200	O2L29SA4	M29A3	0.2	M29A4	1.1	166	0.006	8	0.01	0.8	1.89	527.72	0.4	PVC
4078	O2L2SB2	M2B3	3	M2B4	4	102.3	0.01	4	0.013	0.51	0.3	84.454	0.4	Vitrified Clay
4061	O2L2SU1	M2T1	2.3	M2U1	3.5	125.5	0.01	4	0.013	0.51	0.3	84.562	0.4	Vitrified Clay
4054	O2L2SS1	M2R3	3.7	M2S1	4.7	101.9	0.01	4	0.013	0.51	0.3	85.33	0.4	Vitrified Clay
4036	O2L3SB5	M3B4	3.6	M3B5	4.4	85.4	0.009	4	0.013	0.49	0.285	81.087	0.4	Vitrified Clay
751	O2L3SA9	M3A9	5.2	M3A8	4.3	99.2	0.009	4	0.013	0.49	0.285	81.353	0.4	Vitrified Clay
4157	O2L1SW1	M1V1	3	M1W1	4	98.6	0.01	4	0.013	0.52	0.3	86.013	0.3	Vitrified Clay
3108	O2L34SO2	M34O2	3.3	M34O1	2.9	118.2	0.003	6	0.01	0.49	0.63	183.2	0.3	PVC
591	O2L7SG2	M7G2	5.6	M7G1	3.9	342.6	0.005	6	0.013	0.47	0.6	177.4	0.3	
223	O1L17SK1	M17K1	5.6	M17J2	4.8	50.6	0.017	6	0.01	1.12	1.425	421.99	0.3	PVC
566	O2L7SD5	M7D5	6.1	M7D4	4.4	340.5	0.005	6	0.013	0.47	0.6	177.93	0.3	
594	O2L7SF2	M7F2	5.8	M7F1	4.1	338.4	0.005	6	0.013	0.47	0.6	178.48	0.3	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4420	O2L30SD1	M30A2	-0.2	M30D1	2	201.5	0.011	8	0.013	0.84	1.89	565.04	0.3	Vitrified Clay
1541	O2L34SB5	M34B5	4.3	M34B4	3.5	176.1	0.005	8	0.01	0.7	1.5799	475.18	0.3	PVC
713	O2L3SH5	M3H4	2.5	M3H5	4	149.7	0.01	4	0.013	0.51	0.285	85.772	0.3	Vitrified Clay
3164	O2L30SA10	M30A10	4	M30A9	3.8	35.3	0.006	6	0.013	0.5	0.63	189.65	0.3	Vitrified Clay
815	O2L1SG1	M1G1	4	M1F1	2.5	130.2	0.011	4	0.013	0.54	0.3	91.187	0.3	Vitrified Clay
1557	O1L17SF4	M17F4	5.2	M17F3	4	350.6	0.003	8	0.013	0.47	1.0417	317.28	0.3	Vitrified Clay
3427	O2L24SA1	M24A1	-1.6	W-24	-3.9	70.8	0.033	12	0.013	1.55	9.45	2895	0.3	
4120	O2L1SDD1	M1CC1	3.5	M1DD1	4	42.2	0.012	4	0.013	0.55	0.3	93.003	0.3	Vitrified Clay
1152	O1L14SJ3	M14J3	0.3	M14J2	-0.7	247	0.004	8	0.01	0.64	1.425	446.35	0.3	PVC
1188	O1L14SQ1	M14Q1	4.3	M14M3	3	115	0.011	6	0.013	0.7	0.855	268.8	0.3	Vitrified Clay
4093	O2L1SQ2	M1Q1	2	M1Q2	3.5	122	0.012	4	0.013	0.56	0.3	94.728	0.3	Vitrified Clay
4205	O2L29SB3	M29B3	2	M29B2	0	401.7	0.005	8	0.01	0.71	1.575	497.47	0.3	PVC
3138	O2L34SM1	M34M1	2.8	M34L2	2.3	85.6	0.006	6	0.01	0.64	0.7875	256.41	0.3	PVC
1422	O2L34SE1	M34A6	-1.9	M34E1	-0.9	335.6	0.003	10	0.01	0.62	2.0417	687.31	0.3	PVC
1279	O2L22SB2	M22B2	2.5	M22B1	1.2	179.2	0.007	6	0.013	0.53	0.63	213.64	0.3	
1277	O2L22SB1	M22B1	1.2	M22A2	-0.8	70.3	0.028	8	0.01	1.66	3.465	1177.4	0.3	PVC
3094	O2L29SA1	M29A1	-1.6	W-29	-5.9	16.2	0.267	12	0.013	4.7	24.255	8266.1	0.3	
575	O2L7SH1	M7H1	4.7	M7D2	1.8	426.1	0.007	6	0.013	0.51	0.6	207.04	0.3	Vitrified Clay
4453	O2L38SA7	M38A6	-1.1	M38A7	-0.5	81.2	0.007	8	0.01	0.84	1.715	596	0.3	PVC
4151	O2L1SU3	M1U2	3.6	M1U3	4.5	58.4	0.015	4	0.013	0.58	0.3	105.99	0.3	Vitrified Clay
4212	O2L25SC2	M25C1	0.6	M25C2	2.3	212.1	0.008	6	0.013	0.55	0.63	223.47	0.3	Vitrified Clay
1041	O1L17SV2	M17V2	2.8	M17V1	1.8	228.9	0.004	12	0.013	0.63	2.85	1013.8	0.3	
1738	O2L16SB4	M16B4	5	M16B3	-1.5	334.2	0.019	12	0.013	1.37	6.2417	2221.4	0.3	
4095	O2L1SR1	M1Q1	2	M1R1	4	122.7	0.016	4	0.013	0.59	0.3	109.04	0.3	Vitrified Clay
715	O2L3SI1	M3I1	4	M3H3	1.8	143.3	0.015	4	0.013	0.57	0.285	106.05	0.3	Vitrified Clay
4006	O2L10SA2	M10A1	5.5	M10A2	6	103.8	0.005	6	0.013	0.43	0.46667	174.81	0.3	
4124	O2L1SEE2	M1EE1	2.9	M1EE2	4	62.7	0.018	4	0.013	0.61	0.3	113.11	0.3	Vitrified Clay
982	O2L34SH3	M34H2	0.9	M34H3	2.5	261.6	0.006	6	0.013	0.48	0.525	199.95	0.3	Vitrified Clay
4179	O2L1SK2	M1K1	2	M1K2	4.5	137.6	0.018	4	0.013	0.62	0.3	115.13	0.3	Vitrified Clay
574	O2L7SI2	M7I2	4.6	M7D1	1	430	0.008	6	0.013	0.56	0.6	231.06	0.3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4177	O2L1SL1	M1K1	2	M1L1	4.5	131	0.019	4	0.013	0.63	0.3	118.02	0.3	Vitrified Clay
4267	O1L37SA4	M37A4	-0.4	M37A5	3	204.8	0.017	6	0.01	1.01	1.0442	423.66	0.2	PVC
4216	O2L25SE1	M25A2	-0.4	M25E1	3	293.9	0.012	6	0.013	0.63	0.63	270.86	0.2	Vitrified Clay
3986	O1L37SC3	M37C2	-1.4	M37C3	-0.4	241.4	0.004	8	0.01	0.59	1.0442	451.48	0.2	PVC
1289	O2L26SA2	M26A1	0.8	M26A2	2.7	261.3	0.007	6	0.01	0.64	0.63	278.43	0.2	PVC
1242	O1L14SA13	M14A13	5	M14A12	3.5	145.1	0.01	6	0.013	0.59	0.57	256.01	0.2	Vitrified Clay
4195	O2L34SS1	M34A13	2.1	M34S1	3.8	85.5	0.02	4	0.013	0.62	0.2625	120.45	0.2	
3146	O2L34SL4	M34L4	3.9	M34L3	2.9	193.5	0.006	6	0.01	0.55	0.525	242.9	0.2	PVC
744	O2L3S132	M3C2	2	M3A4	1.4	213.7	0.003	6	0.013	0.3	0.285	134.54	0.2	Vitrified Clay
984	O2L34SI1	M34I1	1.5	M34H1	-0.2	169.9	0.01	6	0.013	0.58	0.525	253.69	0.2	Vitrified Clay
777	O2L2SL2	M2L2	3	M2L1	0.6	78.1	0.03	4	0.013	0.76	0.3	148.79	0.2	
4415	O2L30SG1	M30A3	0.6	M30G1	2	193.9	0.007	8	0.013	0.6	0.945	468.97	0.2	Vitrified Clay
773	O2L2SM1	M2M1	3	M2L1	0.6	77	0.031	4	0.013	0.76	0.3	149.83	0.2	Vitrified Clay
717	O2L3SK1	M3H3	1.8	M3K1	-5.1	102.4	-0.067	6	0.013	0.01	1.285	652.28	0.2	Vitrified Clay
907	O2L5SB2	M5B2	4	M5B1	3	247.1	0.004	6	0.013	0.36	0.315	160.2	0.2	Vitrified Clay
936	O2L5SA9	M5A9	4.5	M5A8	3.1	319	0.005	6	0.013	0.38	0.315	169.18	0.2	Vitrified Clay
938	O2L5SD6	M5D6	4.6	M5D5	3.4	274.1	0.005	6	0.013	0.38	0.315	169.39	0.2	Vitrified Clay
969	O2L4SA6	M4A6	4	M4A5	1.8	491.3	0.005	6	0.013	0.38	0.315	169.66	0.2	Vitrified Clay
949	O2L4SB2	M4B2	4.3	M4B1	2.5	390	0.005	6	0.013	0.38	0.315	171.56	0.2	Vitrified Clay
3403	O2L18ASA5	M18A5	0.3	M18A4	-0.9	301.5	0.004	8	0.013	0	0.63	343.58	0.2	Vitrified Clay
941	O2L4SH2	M4H2	4	M4H1	2.5	316.8	0.005	6	0.013	0.38	0.315	173.3	0.2	Vitrified Clay
3171	O2L30SC2	M30C2	1.3	M30C1	-0.5	360.4	0.005	6	0.013	0.39	0.315	177.98	0.2	Vitrified Clay
4138	O2L1SAA1	M1A6	1.4	M1AA1	4	65	0.04	4	0.013	0.84	0.3	169.78	0.2	Vitrified Clay
4126	O2L1SEE3	M1EE1	2.9	M1EE3	4	27.8	0.04	4	0.013	0.84	0.3	169.96	0.2	Vitrified Clay
3185	O2L30SM1	M30M1	4	M30B6	2.7	258.1	0.005	6	0.013	0.39	0.315	178.71	0.2	Vitrified Clay
1216	O1L14SW1	M14W1	4.2	M14S4	3.7	118.6	0.004	6	0.013	0.36	0.285	161.86	0.2	Vitrified Clay
4040	O2L2SD5	M2D4	3	M2D5	4.5	322.1	0.005	6	0.013	0.36	0.3	171.84	0.2	Vitrified Clay
3912	O2L7SA7	M7A6	4.9	M7A7	6.1	243.7	0.005	6	0.013	0.37	0.3	176.7	0.2	
1224	O1L14ST2	M14T2	3.4	M14T1	3.1	76.5	0.004	6	0.013	0.35	0.285	167.92	0.2	Vitrified Clay
1364	O2L30SA10	M16A10	5.1	M16A9	3.9	259.9	0.004	8	0.01	0.55	0.7875	466.92	0.2	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
573	O2L7SB2	M7B2	4.9	M7B1	3.6	269.8	0.005	6	0.013	0.37	0.3	178.14	0.2	Vitrified Clay
1222	O1L14SU1	M14U1	3.5	M14T1	3.1	85	0.005	6	0.013	0.35	0.285	170.58	0.2	Vitrified Clay
838	O2L1SJJ4	M1JJ4	4.5	M1JJ3	2.7	353.7	0.005	6	0.013	0.37	0.3	181.13	0.2	Vitrified Clay
1206	O1L14SX2	M14X2	3.3	M14X1	2	203.2	0.006	8	0.013	0.51	0.7125	432.09	0.2	Vitrified Clay
1248	O1L14SZ2	M14Z2	5.5	M14Z1	4.2	324.6	0.004	8	0.013	0.41	0.57	345.84	0.2	Vitrified Clay
1212	O1L14SV1	M14V1	3.9	M14S3	2.9	244	0.004	8	0.013	0.41	0.57	350.68	0.2	Vitrified Clay
808	O2L2SC4	M2C4	2.3	M2C3	0.9	265.7	0.005	6	0.013	0.38	0.3	184.63	0.2	Vitrified Clay
4070	O2L2SQ1	M2P2	0.5	M2Q1	1.9	253.9	0.005	6	0.013	0.38	0.3	185.02	0.2	Vitrified Clay
1238	O1L14SAA2	M14AA2	4.8	M14AA1	3.9	190	0.004	8	0.013	0.42	0.57	356.31	0.2	Vitrified Clay
4052	O2L2SR4	M2R3	3.7	M2R4	4.7	172.7	0.006	6	0.013	0.39	0.3	188.12	0.2	Vitrified Clay
4232	O2L25SB3	M25B2	0.9	M25B3	5	164.1	0.025	6	0.013	0.81	0.63	396.55	0.2	Vitrified Clay
1244	O1L14SBB3	M14BB3	5.2	M14BB2	4.2	191.8	0.005	6	0.013	0.37	0.285	180.39	0.2	Vitrified Clay
833	O2L1SI1	M1H2	3.3	M1I1	4.5	208.8	0.006	6	0.013	0.39	0.3	190.11	0.2	Vitrified Clay
779	O2L2SN1	M2N1	0.9	M2J1	0.1	139.6	0.006	6	0.013	0.39	0.3	190.42	0.2	Vitrified Clay
4145	O2L1SX1	M1A5	1.1	M1X1	4	57.3	0.05	4	0.013	0.92	0.3	190.78	0.2	Vitrified Clay
4184	O2L7SB2	M1D2	0.9	M1D3	3	413.4	0.005	8	0.013	0.45	0.6	383.21	0.2	Vitrified Clay
4455	O2L38SA8	M38A7	-0.5	M38A8	7	308.6	0.024	8	0.01	1.28	1.715	1099.1	0.2	PVC
994	O2L34SK2	M34K2	3	M34K1	1.1	410	0.005	6	0.013	0.35	0.2625	171.43	0.2	Vitrified Clay
844	O2L1SNN1	M1JJ2	2.1	M1NN1	4.5	391.2	0.006	6	0.013	0.4	0.3	196.01	0.2	Vitrified Clay
3183	O2L30SB7	M30B7	3.6	M30B6	2.7	220.4	0.004	6	0.01	0.42	0.315	209.19	0.2	PVC
916	O2L5SC2	M5C2	4	M5C1	2	273	0.007	6	0.013	0.43	0.315	215.53	0.1	Vitrified Clay
1504	O2L18ASC1	M18A-C1	2.3	M18A-A5	0.7	412.6	0.004	8	0.01	0.5	0.63	437.67	0.1	PVC
3123	O2L29SF1	M29F1	2.5	M29B1	-1	194.8	0.018	6	0.01	0.88	0.63	438.83	0.1	PVC
3425	O2L1SC1	M1C1	2	M1A1	-1	105.1	0.029	12	0.013	1.37	3.9	2718.9	0.1	
3408	O2L18SE3	M18E3	1.3	M18E2	-0.6	488.8	0.004	8	0.01	0.51	0.63	446.46	0.1	PVC
840	O2L1SKK1	M1JJ3	2.7	M1KK1	4.5	252.5	0.007	6	0.013	0.43	0.3	214.39	0.1	Vitrified Clay
957	O2L4SE1	M4E1	4	M4D1	3.5	61	0.008	6	0.013	0.45	0.315	227.98	0.1	Vitrified Clay
4155	O2L1SV2	M1V1	3	M1V2	4	15.4	0.065	4	0.013	0.95	0.3	217.54	0.1	Vitrified Clay
4038	O2L3SC1	M3B1	1.9	M3C1	4	35.5	0.061	4	0.013	0.91	0.285	210.32	0.1	Vitrified Clay
4255	O2L24SH1	M24A1	-1.6	M24H1	3	134.3	0.034	6	0.013	0.92	0.63	465.08	0.1	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4076	O2L2SK1	M2J2	1	M2K1	3	29.5	0.068	4	0.013	0.97	0.3	222.58	0.1	Vitrified Clay
792	O2L2SE2	M2E2	3	M2E1	2	126.6	0.008	6	0.013	0.44	0.3	223.85	0.1	Vitrified Clay
4083	O2L1SO1	M1A2	-0.8	M1O1	2	87.4	0.032	6	0.013	0.89	0.6	448.54	0.1	Vitrified Clay
4249	O2L24SD2	M24D1	-0.9	M24D2	3.7	130.1	0.035	6	0.013	0.94	0.63	473.45	0.1	Vitrified Clay
4074	O2L2SJ3	M2J2	1	M2J3	4	41.9	0.072	4	0.013	0.99	0.3	228.61	0.1	Vitrified Clay
1736	O2L16SH2	M16H2	4.2	M16H1	-1.9	332.4	0.018	12	0.013	1.06	2.8292	2162.4	0.1	
4085	O2L1SP1	M1O1	2	M1P1	4	27.7	0.072	4	0.013	0.99	0.3	229.54	0.1	Vitrified Clay
829	O2L1SI1	M1H1	2.9	M1J1	4.5	192.6	0.008	6	0.013	0.45	0.3	229.64	0.1	Vitrified Clay
962	O2L4SA6	M4F1	4	M4A5	1.8	243	0.009	6	0.013	0.48	0.315	242.34	0.1	Vitrified Clay
4189	O2L34SR1	M34A13	2.1	M34R1	3	16	0.056	4	0.013	0.87	0.2625	202.47	0.1	Vitrified Clay
4222	O2L25SG1	M25A1	-1	M25G1	8	237.8	0.038	6	0.013	0.96	0.63	489.09	0.1	Vitrified Clay
1160	O1L14SL2	M14L2	1.5	M14L1	0.1	355.4	0.004	8	0.01	0.49	0.57	445.64	0.1	PVC
1164	O1L14SK2	M14K2	1.6	M14K1	0.6	234.1	0.004	8	0.01	0.49	0.57	446.74	0.1	PVC
4147	O2L1SY1	M1A5	1.1	M1Y1	0	14.6	-0.078	4	0.013	0.01	0.3	238.72	0.1	Vitrified Clay
852	O2L1SOO2	M1OO1	4.5	M1OO2	5	55	0.009	6	0.013	0.47	0.3	240.13	0.1	Vitrified Clay
4171	O2L1SN3	M1M1	2	M1N3	4	24.9	0.08	4	0.013	1.04	0.3	241.96	0.1	Vitrified Clay
846	O2L1SLL1	M1JJ2	2.1	M1LL1	4.5	256.3	0.009	6	0.013	0.47	0.3	242.15	0.1	Vitrified Clay
4131	O2L1SFF1	M1A8	1.9	M1FF1	4	25.8	0.082	4	0.013	1.04	0.3	243.89	0.1	Vitrified Clay
4227	O2L25SH1	M25B1	0.3	M25H1	7	157.1	0.043	6	0.013	1	0.63	521.19	0.1	Vitrified Clay
4089	O2L1SO2	M1O1	2	M1O2	4	23.4	0.085	4	0.013	1.06	0.3	249.44	0.1	Vitrified Clay
4026	O2L4SC1	M4A3	0.7	M4C1	4	283.9	0.012	6	0.013	0.52	0.315	271.11	0.1	Vitrified Clay
1184	O1L14SP1	M14P1	3.8	M14M2	2.2	199.4	0.008	8	0.013	0.53	0.57	493.37	0.1	Vitrified Clay
1281	O2L22SE1	M22E1	2.6	M22B1	1.2	208.3	0.007	6	0.01	0.52	0.315	274.09	0.1	PVC
4173	O2L1SM2	M1M1	2	M1M2	4	21.1	0.095	4	0.013	1.11	0.3	262.71	0.1	Vitrified Clay
720	O2L3SL4	M3L4	4	M3L3	1.7	232.3	0.01	6	0.013	0.47	0.285	250.57	0.1	Vitrified Clay
4187	O2L1SH4	M1H3	3.6	M1H4	4.5	71.6	0.012	6	0.013	0.52	0.3	276.09	0.1	Vitrified Clay
959	O2L4SD2	M4D2	4	M4D1	3.5	37	0.014	6	0.013	0.55	0.315	292.76	0.1	Vitrified Clay
1180	O1L14SO1	M14O1	2.5	M14N1	0.9	135	0.012	6	0.013	0.51	0.285	275.52	0.1	Vitrified Clay
3134	O2L29SC2	M29C2	3	M29C1	2	129.4	0.008	8	0.01	0.64	0.63	619.81	0.1	PVC
615	O2L2SA7	M2A7	3.7	M2A6	2.8	300.7	0.003	8	0.013	0.31	0.3	296.71	0.1	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
612	O2L2SO2	M2O2	3.4	M2O1	2.4	316.4	0.003	8	0.013	0.31	0.3	297.16	0.1	Vitrified Clay
4245	O2L7SK1	M7C1	-0.9	M7K1	3	264.7	0.015	6	0.013	0.56	0.3	305.68	0.1	Vitrified Clay
620	O2L3SE2	M3E2	3.3	M3E1	2.4	300.9	0.003	8	0.013	0.3	0.285	296.62	0.1	Vitrified Clay
616	O2L3SD6	M3D6	3.9	M3D5	2.9	314.4	0.003	8	0.013	0.3	0.285	298.11	0.1	Vitrified Clay
996	O2L34SJ2	M34J2	2.5	M34J1	0.1	194.9	0.012	6	0.013	0.5	0.2625	280.02	0.1	Vitrified Clay
3952	O2L29SD1	M29A3	0.2	M29D1	4	421.4	0.009	8	0.01	0.68	0.63	672.56	0.1	PVC
4133	O2L1SGG1	M1A8	1.9	M1GG1	4	14.5	0.144	4	0.013	1.31	0.3	324.64	0.1	Vitrified Clay
724	O2L3SM1	M3L2	0.9	M3M1	4.5	238.9	0.015	6	0.013	0.56	0.285	311.28	0.1	Vitrified Clay
3421	O2L18SG1	M18G1	-0.6	M18A3	-1.6	235.8	0.004	8	0.013	0	0.315	344.22	0.1	Vitrified Clay
3416	O2L18SF1	M18F1	-1.5	M18A2	-2.5	237.8	0.004	8	0.013	0	0.315	344.59	0.1	Vitrified Clay
4315	O2L18A	M18C2	3	M18D1	3.2	41.8	0.004	12	0.013	0.45	0.945	1048.7	0.1	
382	O2L3SG3	M3G3	3.1	M3G2	1.7	393.5	0.004	8	0.013	0.32	0.285	323.48	0.1	Vitrified Clay
817	O2L1SF2	M1F1	2.5	M1F2	4	371.7	0.004	8	0.013	0.34	0.3	342.68	0.1	Vitrified Clay
4257	O2L24SA3	M24A2	-1	M24A3	2	142.3	0.021	6	0.013	0.64	0.315	366.3	0.1	Vitrified Clay
730	O2L3SO1	M3O1	5	M3L1	0.4	255.7	0.018	6	0.013	0.59	0.285	337.04	0.1	Vitrified Clay
1194	O1L14SM5	M14M5	5.7	M14M4	4.3	345	0.004	8	0.013	0.34	0.285	343.01	0.1	Vitrified Clay
3119	O2L29SE1	M29E1	4	M29A2	-0.7	403.4	0.012	8	0.01	0.75	0.63	759.38	0.1	PVC
4253	O2L24SG1	M24A1	-1.6	M24G1	4	59.2	0.094	6	0.013	1.34	0.63	772.83	0.1	Vitrified Clay
4140	O2L1SZ1	M1A6	1.4	M1Z1	4	13.6	0.188	4	0.013	1.45	0.3	370.46	0.1	Vitrified Clay
1178	O1L14SN2	M14N2	2.5	M14N1	0.9	79	0.02	6	0.013	0.62	0.285	360.12	0.1	Vitrified Clay
4191	O2L34SP1	M34A12	1.7	M34P1	4	14.4	0.162	4	0.013	1.32	0.2625	343.6	0.1	Vitrified Clay
4251	O2L24SA1	M24D1	-0.9	M24E1	5.4	58.1	0.108	6	0.013	1.42	0.63	829.33	0.1	Vitrified Clay
3142	O2L34SM2	M34N1	3.5	M34M1	2.8	55.5	0.012	6	0.01	0.61	0.2625	358.36	0.1	PVC
4204	O2L29SB4	M29B4	2.5	M29B3	2	127.8	0.004	8	0.01	0.4	0.315	440.96	0.1	PVC
4210	O2L25SA7	M25A6	1.9	M25A7	3.5	403.5	0.004	8	0.01	0.4	0.315	443.97	0.1	PVC
3398	O2L25SK1	M25K1	2.4	M25A4	1	345.5	0.004	8	0.01	0.41	0.315	445.62	0.1	PVC
727	O2L3SN1	M3N1	-6.1	M3L1	0.4	241.6	-0.027	6	0.013	0	0.285	413.39	0.1	Vitrified Clay
4236	O2L7SC4	M7C3	0.7	M7N1	4	105.9	0.031	6	0.013	0.73	0.3	444.49	0.1	Vitrified Clay
4263	O2L7SB1	M7A1	-5.5	M7B1	3.6	238.5	0.038	12	0.013	1.25	2.1	3118.3	0.1	
3140	O2L34SM2	M34M2	3.8	M34M1	2.8	56.2	0.017	6	0.01	0.68	0.2625	429.13	0.1	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1154	O1L14SJ	M14J4	1.4	M14J3	0.3	245	0.004	8	0.01	0.41	0.285	468.11	0.1	PVC
1146	O1L14SI3	M14I3	1.5	M14I2	0.5	226.4	0.004	8	0.01	0.41	0.285	470.9	0.1	PVC
4116	O2L1SCC1	M1BB2	3	M1CC1	3.5	46.8	0.011	12	0.013	0.63	0.9	1652.3	0.1	
4243	O2L7SL1	M7C2	-0.1	M7L1	6	104.9	0.058	6	0.013	0.9	0.3	607.2	0	Vitrified Clay
4259	O2L24SB1	M24A2	-1	M24B1	3	60.7	0.066	6	0.013	0.95	0.315	647.42	0	
3985	O1L37SD1	M37C2	-1.4	M37D1	5	56.1	0.114	8	0.01	1.92	1.0442	2376.2	0	PVC
4202	O2L29SA5	M29A4	1.1	M29A5	4.6	254.7	0.014	8	0.01	0.65	0.315	827.15	0	PVC
1200	O1L14SY1	M14Y1	4.8	M14A9	0.4	202.7	0.022	8	0.013	0.57	0.285	800.48	0	Vitrified Clay
1226	O1L14SS6	M14S6	5.8	M14S5	4.7	286.6	0.004	12	0.013	0.31	0.285	1004.1	0	
3424	O2L1SC2	M1C2	4	M1C1	2	292.2	0.007	12	0.013	0.37	0.3	1322.9	0	
3132	O2L29SC1	M29C1	2	M29A1	-1.6	16.4	0.218	8	0.01	1.96	0.63	3292.1	0	PVC
4042	O2L2SH1	M2D4	3	M2H1	3.5	25.7	0.019	12	0.013	0.56	0.3	2230.3	0	
4164	O2L1ST1	M1S2	2.5	M1T1	4	60.1	0.025	12	0.013	0.6	0.3	2526.9	0	
4167	O2L1SS3	M1S2	2.5	M1S3	4	57.6	0.026	12	0.013	0.61	0.3	2580.6	0	
4193	O2L34SQ1	M34A12	1.7	M34Q1	3.8	89	0.024	12	0.013	0.57	0.2625	2474.3	0	
354	O1L17SM8	M17M8	4.2	M17M7	3.8	110	0.004	8	0.01	0	0	450.94	0	PVC
635	O2L36SA11	M36A11	2.8	M36A10	1.4	339.1	0.004	8	0.01	0	0	454.65	0	PVC
854	O2L1SMM1	M1MM1	4.5	M1JJ1	1.7	270.1	0.01	6	0.013	0	0	256.58	0	Vitrified Clay
1044	O1L17ST8	M17T8	2.8	M17T7	2.4	88.7	0.004	12	0.013	0	0	1004.2	0	
1051	O1L17SU2	M17U2	-1	M17U1	-2.3	275.1	0.005	12	0.013	0	0	1082.2	0	
1063	O1L17SR1	M17R1	1.8	M17Q0	0.6	400	0.003	8	0.013	0	0	299.51	0	Vitrified Clay
1065	O1L17SR2	M17R2	2.9	M17R1	1.8	268.2	0.004	8	0.013	0	0	342.55	0	Vitrified Clay
1067	O1L17SR3	M17R3	3.6	M17R2	2.9	161.2	0.005	8	0.013	0	0	367.43	0	Vitrified Clay
1074	O1L17SS1	M17S1	-1.4	M17Q2	-3.4	391.3	0.005	8	0.013	0	0	381.87	0	Vitrified Clay
1085	O1L17SG2	M17G2	7	M17G1	4.8	398.5	0.006	8	0.01	0	0	527.42	0	PVC
1271	O2L22SF1	M22F1	-1.8	M22A1	-0.5	112.4	-0.011	6	0.013	0	0	266.59	0	Vitrified Clay
1683	O2L19SA2	M19A2	1.5	M19A1	1	72.8	0.007	12	0.013	0	0	1324.9	0	Vitrified Clay
1684	O2L19SA1	M19A1	1	W-19	-4.4	16.7	0.321	12	0.013	0	0	9058.2	0	Vitrified Clay
3130	O2L29SG1	M29G1	2.5	M29B2	0	130.4	0.019	6	0.01	0	0	453.23	0	PVC
3983	O2L38SD3	M38D2	0.8	M38D3	1.1	72	0.004	8	0.01	0	0	462.79	0	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1515	O2L46SA1	W-46	2	M46A1	2.4	72.7	-0.006	8	0.01	(N/A)	(N/A)	529.48	(N/A)	PVC

EXHIBIT D.2
SEWER MANHOLE DATA TABLE REPORT

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
359	M3A1	6.4	6.4	8964	-1.8	356.9	6.225	363.07	0.69	-1.1	FALSE	TRUE
456	M7A1	6.6	8.3	5184	-5.5	179.7	3.6	183.32	2.15	-3.4	FALSE	TRUE
522	M34A1	6.7	6.7	0	-5.5	1914	0	1913.6	0.85	-4.6	FALSE	TRUE
533	M14A2	5.6	7.5	0	-3.6	536.2	0	536.17	1.17	-2.4	FALSE	TRUE
535	M14A4	5.6	5.6	2872.8	-3.1	96.12	1.995	98.119	0.76	-2.3	FALSE	TRUE
598	M3D5	6.8	6.8	3283.2	2.9	0.285	2.28	2.565	1.06	4	FALSE	TRUE
712	M3H5	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
723	M3M1	5.5	5.5	410.4	4.5	0	0.285	0.285	0.01	4.5	FALSE	TRUE
725	M3N1	5.6	5.6	410.4	-6.1	0	0.285	0.285	6.58	0.5	FALSE	TRUE
816	M1F2	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
824	M1B5	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
828	M1J1	6	6	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
832	M1I1	5.8	5.8	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
839	M1KK1	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
843	M1NN1	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
845	M1LL1	6.3	6.3	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
851	M1OO2	6.4	6.4	432	5	0	0.3	0.3	0.01	5	FALSE	TRUE
897	M1D4	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
950	M4C1	5.5	5.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	TRUE
973	M34F2	4.8	4.8	36429.05	0.3	53.62	25.3	78.915	1.75	2	FALSE	TRUE
975	M34F1	4.8	4.8	1890	-0.8	84.69	1.313	86.002	1.78	1	FALSE	TRUE
977	M34H1	3.4	3.4	4158	-0.2	2.888	2.888	5.775	1.25	1	FALSE	TRUE
981	M34H3	4.1	4.1	756	2.5	0	0.525	0.525	0.02	2.5	FALSE	TRUE
985	M34A6	4.3	4.3	31753.4	-1.9	343.3	22.05	365.33	0.71	-1.2	FALSE	TRUE
1069	M17Q1	6.7	6.7	0	-4	37.05	0	37.05	4.78	0.8	FALSE	TRUE
1071	M17Q2	7.3	7.3	0	-3.4	37.05	0	37.05	4.2	0.8	FALSE	TRUE
1073	M17S1	7	7	0	-1.4	0	0	0	2.26	0.8	FALSE	TRUE
1098	M14C5	7.4	7.4	36936	-0.4	276.4	25.65	302.05	2.27	1.8	FALSE	TRUE
1099	M14D1	5.1	5.1	24624	0.4	142.5	17.1	159.55	1.66	2.1	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1103	M14D3	5.7	5.7	4104	2.1	105.4	2.85	108.25	1.4	3.5	FALSE	TRUE
1105	M14D4	6.1	6.1	16416	2.8	94	11.4	105.4	0.81	3.6	FALSE	TRUE
1107	M14C4	6.2	6.2	5582.01	-1.4	302.1	3.876	305.93	2.24	0.9	FALSE	TRUE
1109	M14C3	6.4	6.4	29548.8	-2.3	305.9	20.52	326.45	2.19	-0.1	FALSE	TRUE
1112	M14C2	6.4	6.4	0	-2.4	326.5	0	326.45	2.18	-0.2	FALSE	TRUE
1114	M14C1	6.4	6.4	0	-2.7	438.1	0	438.06	2.12	-0.6	FALSE	TRUE
1123	M14C6	7.1	7.1	4104	0.5	114	2.85	116.85	1.48	2	FALSE	TRUE
1125	M14C7	7.4	7.4	12312	1	102.6	8.55	111.15	1.08	2.1	FALSE	TRUE
1171	M14A7	6.4	6.4	6885.6	-1.6	71.39	4.782	76.174	1.41	-0.2	FALSE	TRUE
1288	M26A2	5	5	907.2	2.7	0	0.63	0.63	-0.03	2.7	FALSE	TRUE
1303	M14C8	8.1	8.1	0	1.3	71.25	0	71.25	0.78	2.1	FALSE	TRUE
1332	M40A5	9.2	9.2	126831.6	3.7	0	88.08	88.078	0.2	3.9	FALSE	TRUE
1334	M40B2	8	8	3528	4	0	2.45	2.45	-2.03	2	FALSE	TRUE
1386	M37D1	8.1	8.1	1503.6	5	0	1.044	1.0442	0.02	5	FALSE	TRUE
1464	M34A9	4.4	4.4	3402	0.1	215.5	2.363	217.91	0.65	0.7	FALSE	TRUE
1476	M39A1	5.9	5.9	22680.42	-1.6	15.75	15.75	31.501	3.6	2	FALSE	TRUE
1480	M39A2	5.9	5.9	22680.42	-0.3	0	15.75	15.75	2.25	2	FALSE	TRUE
1493	M18A-A2	5.1	5.1	0	-0.7	76	0	76.004	1.39	0.7	FALSE	TRUE
1495	M18A-A3	5.6	5.6	7257.6	-0.3	70.96	5.04	76.004	0.99	0.7	FALSE	TRUE
1516	M34A3	5.1	5.1	16068.5	-4.4	634	11.16	645.2	0.78	-3.6	FALSE	TRUE
1618	M3F3	5.9	5.9	0	3.2	132.9	0	132.9	0.29	3.5	FALSE	TRUE
1707	M38C2	7	7	20071.38	1	0	13.94	13.938	0.07	1.1	FALSE	TRUE
1715	M38B3	7.1	7.1	19609.59	1.5	0	13.62	13.618	0.08	1.6	FALSE	TRUE
3154	M30L1	4.2	4.2	453.6	3.8	0	0.315	0.315	0.02	3.8	FALSE	TRUE
3197	M18A1	5.6	5.6	3628.8	-3.1	132	2.52	134.55	4.11	1	FALSE	TRUE
3199	M18B2	5	5	11340	-1.6	0	7.875	7.875	2.57	1	FALSE	TRUE
3223	M18B1	5.1	5.1	10886.4	-2.4	7.875	7.56	15.435	3.4	1	FALSE	TRUE
3303	M24A1	6	6	3628.8	-1.6	6.93	2.52	9.45	0.68	-0.9	FALSE	TRUE
3401	M18A5	6.9	6.9	907.2	0.3	0	0.63	0.63	0.72	1	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3402	M18A4	6.3	6.3	7257.6	-0.9	0.63	5.04	5.67	1.93	1	FALSE	TRUE
3404	M18A2	5.4	5.4	10886.4	-2.5	17.01	7.56	24.57	3.48	1	FALSE	TRUE
3407	M18E2	7.1	7.1	4536	-0.6	0.63	3.15	3.78	1.65	1	FALSE	TRUE
3409	M18E1	6.2	6.2	7257.6	-1.8	3.78	5.04	8.82	2.78	1	FALSE	TRUE
3415	M18F1	6.9	6.9	453.6	-1.5	0	0.315	0.315	2.52	1	FALSE	TRUE
3417	M18A3	5.9	5.9	2721.6	-1.6	5.985	1.89	7.875	2.59	1	FALSE	TRUE
3420	M18G1	6.5	6.5	453.6	-0.6	0	0.315	0.315	1.64	1	FALSE	TRUE
3517	M35B1	6.5	6.5	29716.26	2	0	20.64	20.636	0.1	2.1	FALSE	TRUE
3519	M35C1	6	6	4776.24	0	0	3.317	3.3168	0.04	0	FALSE	TRUE
3911	M7A7	7.9	7.9	432	6.1	0	0.3	0.3	0.02	6.1	FALSE	TRUE
3951	M29D1	5.1	5.1	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
3980	M15A1	7	7	9702	4.5	0	6.738	6.7375	0.06	4.6	FALSE	TRUE
3991	M35A4	6.6	6.6	27561.66	3.6	0	19.14	19.14	0.1	3.7	FALSE	TRUE
4003	M13A2	6.2	6.2	4800.6	4.5	0	3.334	3.3337	0.05	4.5	FALSE	TRUE
4005	M10A2	9.3	9.3	672	6	0	0.467	0.46667	0.02	6	FALSE	TRUE
4008	M9A2	5.1	5.1	28350	1.1	0	19.69	19.688	0.09	1.2	FALSE	TRUE
4013	M9B2	5.3	5.3	34020	1.5	0	23.63	23.625	0.11	1.6	FALSE	TRUE
4035	M3B5	5	5	410.4	4.4	0	0.285	0.285	0.01	4.4	FALSE	TRUE
4037	M3C1	5.7	5.7	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
4039	M2D5	5.3	5.3	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4043	M2G1	5.6	5.6	432	2.8	0	0.3	0.3	0.02	2.9	FALSE	TRUE
4051	M2R4	6.2	6.2	432	4.7	0	0.3	0.3	0.02	4.7	FALSE	TRUE
4053	M2S1	6.1	6.1	432	4.7	0	0.3	0.3	0.01	4.8	FALSE	TRUE
4058	M2T2	6.1	6.1	432	4.2	0	0.3	0.3	0.01	4.2	FALSE	TRUE
4060	M2U1	6.2	6.2	432	3.5	0	0.3	0.3	0.01	3.6	FALSE	TRUE
4067	M2P3	6.1	6.1	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4069	M2Q1	6.9	6.9	432	1.9	0	0.3	0.3	0.02	1.9	FALSE	TRUE
4073	M2J3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4075	M2K1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4077	M2B4	5.5	5.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4084	M1P1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4088	M1O2	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4092	M1Q2	5.3	5.3	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	TRUE
4094	M1R1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4099	M1II1	5.8	5.8	432	5	0	0.3	0.3	0.02	5	FALSE	TRUE
4101	M1HH2	5.7	5.7	432	5.2	0	0.3	0.3	0.01	5.2	FALSE	TRUE
4108	M1KK2	6.5	6.5	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4113	M1BB4	5.6	5.6	432	5.1	0	0.3	0.3	0.01	5.1	FALSE	TRUE
4117	M1CC2	6	6	432	4	0	0.3	0.3	0.02	4	FALSE	TRUE
4119	M1DD1	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4123	M1EE2	6.1	6.1	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4125	M1EE3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4130	M1FF1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4132	M1GG1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4134	M1A6	6.5	6.5	432	1.4	192	0.3	192.3	0.36	1.8	FALSE	TRUE
4137	M1AA1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4139	M1Z1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4141	M1A5	6.5	6.5	432	1.1	192.9	0.3	193.2	0.36	1.5	FALSE	TRUE
4144	M1X1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4146	M1Y1	6.8	6.8	432	0	0	0.3	0.3	1.5	1.5	FALSE	TRUE
4150	M1U3	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4154	M1V2	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4156	M1W1	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4163	M1T1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4166	M1S3	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4170	M1N3	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4172	M1M2	5	5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4176	M1L1	5.1	5.1	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4178	M1K2	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4186	M1H4	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4188	M34R1	4.4	4.4	378	3	0	0.263	0.2625	0.01	3	FALSE	TRUE
4190	M34P1	4.8	4.8	378	4	0	0.263	0.2625	0.01	4	FALSE	TRUE
4192	M34Q1	4.3	4.3	378	3.8	0	0.263	0.2625	0.01	3.8	FALSE	TRUE
4194	M34S1	4.7	4.7	378	3.8	0	0.263	0.2625	0.01	3.8	FALSE	TRUE
4201	M29A5	5.6	5.6	453.6	4.6	0	0.315	0.315	0.01	4.6	FALSE	TRUE
4209	M25A7	4.1	4.1	453.6	3.5	0	0.315	0.315	0.01	3.5	FALSE	TRUE
4211	M25C2	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4213	M25D1	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4215	M25E1	5.3	5.3	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4219	M25F1	4.7	4.7	907.2	2	0	0.63	0.63	0.02	2	FALSE	TRUE
4221	M25G1	10	10	907.2	8	0	0.63	0.63	0.02	8	FALSE	TRUE
4223	M25I1	5.2	5.2	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4226	M25H1	10	10	907.2	7	0	0.63	0.63	0.02	7	FALSE	TRUE
4228	M25J1	5.2	5.2	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4231	M25B3	7.3	7.3	907.2	5	0	0.63	0.63	0.02	5	FALSE	TRUE
4233	M7C4	4.5	4.5	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4235	M7N1	8.2	8.2	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4237	M7M1	4.8	4.8	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4240	M7L1	9.9	9.9	432	6	0	0.3	0.3	0.01	6	FALSE	TRUE
4244	M7K1	5.3	5.3	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4246	M7J1	8.4	8.4	1728	4	0	1.2	1.2	0.03	4	FALSE	TRUE
4248	M24D2	5.7	5.7	907.2	3.7	0	0.63	0.63	0.02	3.7	FALSE	TRUE
4250	M24E1	8.4	8.4	907.2	5.4	0	0.63	0.63	0.02	5.4	FALSE	TRUE
4252	M24G1	6.8	6.8	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
4254	M24H1	5	5	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4256	M24A3	4.9	4.9	453.6	2	0	0.315	0.315	0.01	2	FALSE	TRUE
4258	M24B1	5.6	5.6	453.6	3	0	0.315	0.315	0.01	3	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4266	M37A5	5	5	1503.6	3	0	1.044	1.0442	0.02	3	FALSE	TRUE
4270	M4G3	9	9	4309.2	6.2	0	2.993	2.9925	0.04	6.2	FALSE	TRUE
4272	M32C2	5.2	5.2	19879.02	1	0	13.81	13.805	0.09	1.1	FALSE	TRUE
4286	M14E1	8	8	4104	4.8	0	2.85	2.85	0.04	4.9	FALSE	TRUE
4386	M32B2	6	6	12526.5	3	0	8.699	8.699	0.07	3.1	FALSE	TRUE
4414	M30G1	3.4	3.4	1360.8	2	0	0.945	0.945	0.02	2	FALSE	TRUE
4419	M30D1	3.5	3.5	2721.6	2	0	1.89	1.89	0.03	2	FALSE	TRUE
4427	M16C1	4.7	4.7	11340	2.2	0	7.875	7.875	0.06	2.3	FALSE	TRUE
4454	M38A8	10.3	10.3	2469.6	7	0	1.715	1.715	0.03	7	FALSE	TRUE
67	M17A9	8.5	8.5	16416	0	349	11.4	360.43	0.54	0.5	FALSE	FALSE
68	M17J1	8.8	8.8	16416	3.7	3.563	11.4	14.962	0.09	3.8	FALSE	FALSE
222	M17K1	9.3	9.3	2052	5.6	0	1.425	1.425	0.03	5.6	FALSE	FALSE
226	M17J2	8.8	8.8	1026	4.8	2.85	0.713	3.5625	0.04	4.8	FALSE	FALSE
227	M17J3	9.2	9.2	2052	5.2	0	1.425	1.425	0.03	5.2	FALSE	FALSE
352	M17M8	7.2	7.2	0	4.2	0	0	0	0	4.2	FALSE	FALSE
353	M17M7	7	7	16416	3.8	0	11.4	11.4	0.07	3.8	FALSE	FALSE
375	M3A2	6.2	6.2	11080.8	-1.3	196.9	7.695	204.57	0.36	-0.9	FALSE	FALSE
377	M3G1	6.1	6.1	4514.4	0.2	2.85	3.135	5.985	0.06	0.3	FALSE	FALSE
379	M3G2	6.2	6.2	3693.6	1.7	0.285	2.565	2.85	0.04	1.7	FALSE	FALSE
381	M3G3	6.4	6.4	410.4	3.1	0	0.285	0.285	0.01	3.1	FALSE	FALSE
384	M17A1	4.4	4.4	18900	0.3	45.5	13.13	58.625	0.15	0.5	FALSE	FALSE
403	M1A1	7.2	7.2	1728	-1	269.3	1.2	270.45	0.34	-0.7	FALSE	FALSE
418	M2A1	5.8	5.8	432	-2.1	64.2	0.3	64.5	0.19	-1.9	FALSE	FALSE
424	M3J1	5.4	5.4	820.8	3	162	0.57	162.53	0.28	3.3	FALSE	FALSE
451	M1A9	6.3	6.3	1728	3	185.1	1.2	186.3	0.28	3.3	FALSE	FALSE
523	M34A2	5.7	5.7	20709.15	-4.6	679.6	14.38	694	0.53	-4.1	FALSE	FALSE
530	M14A1	6.3	6.3	0	-4	628.1	0	628.09	0.53	-3.4	FALSE	FALSE
534	M14A3	5.9	5.9	0	-2.6	98.12	0	98.119	0.24	-2.4	FALSE	FALSE
545	M7B1	8.4	8.4	2592	3.6	0.3	1.8	2.1	0.03	3.6	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
546	M7B2	7.7	7.7	432	4.9	0	0.3	0.3	0.02	4.9	FALSE	FALSE
549	M7A3	6.1	6.1	3888	-0.6	62.93	2.7	65.633	0.19	-0.4	FALSE	FALSE
550	M7D1	6	6	15552	1	45.53	10.8	56.333	0.18	1.2	FALSE	FALSE
551	M7D2	6	6	15552	1.8	28.73	10.8	39.533	0.16	2	FALSE	FALSE
552	M7D3	6.7	6.7	13824	2.7	13.13	9.6	22.733	0.12	2.8	FALSE	FALSE
553	M7E1	7.7	7.7	11136	4.9	0	7.733	7.7333	0.07	5	FALSE	FALSE
554	M7H1	6.7	6.7	864	4.7	0	0.6	0.6	0.02	4.7	FALSE	FALSE
555	M7I2	6.1	6.1	864	4.6	0	0.6	0.6	0.02	4.6	FALSE	FALSE
559	M7D4	7.4	7.4	6912	4.4	0.6	4.8	5.4	0.06	4.5	FALSE	FALSE
560	M7G2	7.1	7.1	864	5.6	0	0.6	0.6	0.02	5.6	FALSE	FALSE
561	M7F2	7.7	7.7	864	5.8	0	0.6	0.6	0.02	5.8	FALSE	FALSE
564	M7A6	8	8	2592	4.9	0.3	1.8	2.1	0.04	5	FALSE	FALSE
565	M7D5	7.7	7.7	864	6.1	0	0.6	0.6	0.02	6.1	FALSE	FALSE
580	M7A5	7.7	7.7	3024	3.3	2.1	2.1	4.2	0.05	3.3	FALSE	FALSE
583	M7A4	6.6	6.6	3456	1.3	4.2	2.4	6.6	0.06	1.4	FALSE	FALSE
587	M7A2	6.1	6.1	3456	-2	65.63	2.4	68.033	0.19	-1.8	FALSE	FALSE
590	M7G1	6.3	6.3	6912	3.9	0.6	4.8	5.4	0.05	4	FALSE	FALSE
593	M7F1	6.5	6.5	6912	4.1	0.6	4.8	5.4	0.06	4.2	FALSE	FALSE
596	M3D4	6.7	7.5	3283.2	2	2.565	2.28	4.845	0.05	2	FALSE	FALSE
597	M3D3	6.6	6.6	2052	1.5	7.41	1.425	8.835	0.08	1.6	FALSE	FALSE
599	M3D6	6.3	6.3	410.4	3.9	0	0.285	0.285	0.11	4	FALSE	FALSE
600	M2A7	6.4	6.4	432	3.7	0	0.3	0.3	0.02	3.8	FALSE	FALSE
601	M3E1	5.4	5.4	3283.2	2.4	0.285	2.28	2.565	0.04	2.5	FALSE	FALSE
602	M3E2	5.3	5.3	410.4	3.3	0	0.285	0.285	0.02	3.3	FALSE	FALSE
603	M2O2	6.1	6.1	432	3.4	0	0.3	0.3	0.02	3.4	FALSE	FALSE
604	M2A6	6.3	6.3	3024	2.8	0.3	2.1	2.4	0.04	2.9	FALSE	FALSE
605	M2O1	6.1	6.1	3456	2.4	0.3	2.4	2.7	0.05	2.5	FALSE	FALSE
606	M2A4	7.3	7.3	3024	1.5	7.5	2.1	9.6	0.08	1.5	FALSE	FALSE
607	M2A5	7.3	7.3	3456	1.9	2.4	2.4	4.8	0.06	2	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
608	M2A3	7.1	7.1	3888	0.3	12.9	2.7	15.6	0.08	0.3	FALSE	FALSE
622	M36A11	5.8	5.8	0	2.8	0	0	0	0	2.8	FALSE	FALSE
623	M36A10	5.9	5.9	11970	1.4	0	8.313	8.3125	0.06	1.5	FALSE	FALSE
624	M36A9	5.7	5.7	11970	1	8.313	8.313	16.625	0.09	1.1	FALSE	FALSE
625	M36A8	5.9	5.9	23276.4	0.2	40.18	16.16	56.344	0.17	0.4	FALSE	FALSE
627	M36A6	5.8	5.8	23276.4	-1.7	72.51	16.16	88.673	0.21	-1.4	FALSE	FALSE
628	M36A5	6.4	6.4	23276.4	-2	88.67	16.16	104.84	0.23	-1.7	FALSE	FALSE
629	M36A4	5.9	5.9	11306.4	-2.2	104.8	7.852	112.69	0.34	-1.9	FALSE	FALSE
630	M36A3	6.1	6.1	24924.06	-2.4	131.6	17.31	148.91	0.27	-2.2	FALSE	FALSE
631	M36E1	7.1	7.1	13617.66	2.2	9.457	9.457	18.913	0.09	2.3	FALSE	FALSE
632	M36H1	8.8	8.8	11306.4	3	15.7	7.852	23.555	0.1	3.1	FALSE	FALSE
633	M36H2	9.3	9.3	11306.4	5.1	7.852	7.852	15.703	0.08	5.2	FALSE	FALSE
634	M36H3	9.4	9.4	11306.4	6	0	7.852	7.8517	0.06	6.1	FALSE	FALSE
641	M36A7	5.6	5.6	23276.4	-0.7	56.34	16.16	72.508	0.19	-0.5	FALSE	FALSE
648	M36E2	7.1	7.1	13617.66	6	0	9.457	9.4567	0.07	6.1	FALSE	FALSE
650	M36A2	6.2	6.2	11306.4	-4.1	148.9	7.852	156.76	0.28	-3.8	FALSE	FALSE
652	M36A1	5.8	5.8	76461.84	-5.2	420.6	53.1	473.73	0.43	-4.7	FALSE	FALSE
654	M36B1	6.5	6.5	50449.56	-4	228.8	35.03	263.87	0.37	-3.6	FALSE	FALSE
656	M36C2	5.3	7.9	15466.92	-0.5	69.33	10.74	80.072	0.19	-0.3	FALSE	FALSE
658	M36C3	8.2	8.2	33278.7	3.9	46.22	23.11	69.331	0.18	4.1	FALSE	FALSE
660	M36C4	8.6	8.6	15466.92	5.1	10.74	10.74	21.482	0.1	5.1	FALSE	FALSE
662	M36C5	8.5	10.4	15466.92	6	0	10.74	10.741	0.07	6.1	FALSE	FALSE
664	M36G2	8.9	8.9	17812.2	6	0	12.37	12.37	0.08	6.1	FALSE	FALSE
665	M36G1	8.8	8.8	17811.78	5	12.37	12.37	24.739	0.12	5.1	FALSE	FALSE
668	M36D2	6	6	0	1.9	29.8	0	29.802	0.15	2.1	FALSE	FALSE
670	M36D3	5.9	5.9	21457.8	3	0	14.9	14.901	0.08	3.1	FALSE	FALSE
672	M36F1	5.5	5.5	21457.8	3	0	14.9	14.901	0.08	3.1	FALSE	FALSE
674	M36B6	5.7	5.7	21457.8	3	0	14.9	14.901	0.08	3.1	FALSE	FALSE
675	M36B5	6.5	6.5	0	2.1	14.9	0	14.901	0.08	2.1	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
677	M36B3	6.4	8.3	3439.8	-0.1	70.8	2.389	73.19	0.18	0.1	FALSE	FALSE
679	M36I1	7.1	8.2	2192.4	1.5	41.08	1.523	42.6	0.14	1.6	FALSE	FALSE
681	M36B2	6.3	6.3	50449.56	-3	73.19	35.03	108.22	0.24	-2.7	FALSE	FALSE
684	M36C1	8.3	8.3	15466.5	-2	80.07	10.74	90.812	0.21	-1.8	FALSE	FALSE
687	M36D1	8.3	8.3	0	1	29.8	0	29.802	0.12	1.1	FALSE	FALSE
690	M36B4	8	8	19152	0.5	14.9	13.3	28.201	0.12	0.7	FALSE	FALSE
693	M17A8	8.4	8.4	0	-2.1	405.5	0	405.47	0.4	-1.7	FALSE	FALSE
694	M17L1	7.7	10.5	0	0.9	45.04	0	45.041	0.14	1	FALSE	FALSE
696	M17L2	8.3	8.3	0	1.2	45.04	0	45.041	0.14	1.3	FALSE	FALSE
698	M17L3	6.7	6.7	10260	1.8	37.92	7.125	45.041	0.14	1.9	FALSE	FALSE
700	M17L4	7.6	7.6	16416	2.3	26.52	11.4	37.916	0.13	2.5	FALSE	FALSE
702	M17L5	7	7	16416	3.6	15.12	11.4	26.516	0.11	3.7	FALSE	FALSE
704	M17L6	7.2	7.2	21766.4	4	0	15.12	15.116	0.08	4.1	FALSE	FALSE
706	M3H2	5.4	5.4	2872.8	1.3	166.7	1.995	168.66	0.34	1.6	FALSE	FALSE
708	M3H3	5.5	5.5	2052	1.8	2.71	1.425	4.135	0.05	1.8	FALSE	FALSE
710	M3H4	4.9	4.9	1231.2	2.5	0.285	0.855	1.14	0.03	2.5	FALSE	FALSE
714	M3I1	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
716	M3K1	5.8	5.8	410.4	-5.1	0	1.285	1.285	6.93	1.8	FALSE	FALSE
718	M3L4	5.2	5.2	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
719	M3L3	3.9	3.9	2462.4	1.7	0.285	1.71	1.995	0.03	1.7	FALSE	FALSE
721	M3L2	5.7	5.7	2052	0.9	2.28	1.425	3.705	0.05	0.9	FALSE	FALSE
726	M3L1	5.9	5.9	4514.4	0.4	4.275	3.135	7.41	0.07	0.5	FALSE	FALSE
729	M3O1	6.3	6.3	410.4	5	0	0.285	0.285	0.01	5	FALSE	FALSE
731	M3H1	5.1	5.1	3693.6	-0.1	176.1	2.565	178.63	0.35	0.2	FALSE	FALSE
734	M3A3	6.1	6.1	2462.4	0.4	10.55	1.71	12.255	0.09	0.5	FALSE	FALSE
741	M3A4	5.8	5.8	2462.4	1.4	8.835	1.71	10.545	0.08	1.5	FALSE	FALSE
743	M3C2	5.6	5.6	410.4	2	0	0.285	0.285	0.02	2	FALSE	FALSE
749	M3A9	5.3	5.3	410.4	5	0	0.285	0.285	0.21	5.2	FALSE	FALSE
750	M3A8	5.4	5.4	820.8	4.3	0.285	0.57	0.855	0.03	4.3	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
752	M3A7	5.5	5.5	1641.6	3.5	0.855	1.14	1.995	0.04	3.6	FALSE	FALSE
754	M3A6	5.3	5.3	1231.2	2.9	1.995	0.855	2.85	0.05	2.9	FALSE	FALSE
756	M3A5	6.4	6.4	2872.8	1.7	2.85	1.995	4.845	0.06	1.8	FALSE	FALSE
760	M2B3	5.6	5.6	864	3	0.3	0.6	0.9	0.02	3	FALSE	FALSE
761	M2B2	5.9	5.9	1296	2	0.9	0.9	1.8	0.03	2	FALSE	FALSE
763	M2B1	5.9	5.9	1728	1	1.8	1.2	3	0.04	1	FALSE	FALSE
765	M2A2	6.2	6.2	6912	-1.3	33.9	4.8	38.7	0.15	-1.1	FALSE	FALSE
768	M2J1	6.1	6.1	1296	0.1	2.4	0.9	3.3	0.25	0.4	FALSE	FALSE
770	M2L1	5.7	5.7	864	0.6	0.6	0.6	1.2	0.03	0.7	FALSE	FALSE
772	M2M1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
776	M2L2	6	6	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
778	M2N1	6.1	6.1	432	0.9	0	0.3	0.3	0.02	0.9	FALSE	FALSE
780	M2I1	6	6	864	4	0	0.6	0.6	0.02	4	FALSE	FALSE
781	M2D4	5.5	5.5	3888	3	1.2	2.7	3.9	0.05	3.1	FALSE	FALSE
783	M2D3	5.4	5.4	3456	1.5	3.9	2.4	6.3	0.06	1.6	FALSE	FALSE
785	M2D2	5.4	5.4	2592	0	6.3	1.8	8.1	0.06	0.1	FALSE	FALSE
787	M2D1	5.8	5.8	5184	-1.7	9.3	3.6	12.9	0.08	-1.6	FALSE	FALSE
789	M2E1	5.9	5.9	1296	2	0.3	0.9	1.2	0.03	2	FALSE	FALSE
791	M2E2	5.8	5.8	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
795	M2C1	5.8	5.8	5184	-1.8	9	3.6	12.6	0.08	-1.7	FALSE	FALSE
797	M2F1	5.7	5.7	2160	0.4	2.1	1.5	3.6	0.05	0.4	FALSE	FALSE
799	M2F2	5.8	5.8	2160	2.1	0.6	1.5	2.1	0.04	2.1	FALSE	FALSE
801	M2F3	6.1	6.1	432	2.6	0	0.3	0.3	0.02	2.6	FALSE	FALSE
803	M2C2	5.6	5.6	4752	-1.3	2.1	3.3	5.4	0.06	-1.3	FALSE	FALSE
805	M2C3	5.7	5.7	2592	0.9	0.3	1.8	2.1	0.04	0.9	FALSE	FALSE
807	M2C4	5.3	5.3	432	2.3	0	0.3	0.3	0.02	2.3	FALSE	FALSE
809	M2R1	5.7	5.7	3888	1.8	5.4	2.7	8.1	0.07	1.8	FALSE	FALSE
811	M2R2	5.8	5.8	432	3.2	2.4	0.3	2.7	0.04	3.3	FALSE	FALSE
813	M1G1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
814	M1F1	6.1	6.1	5184	2.5	0.6	3.6	4.2	0.05	2.6	FALSE	FALSE
818	M1B2	6	6	4320	1.2	10.8	3	13.8	0.09	1.2	FALSE	FALSE
820	M1B3	5.9	5.9	1296	2.4	5.7	0.9	6.6	0.06	2.4	FALSE	FALSE
822	M1B4	5.6	5.6	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
826	M1H1	5.8	5.8	2160	2.9	3	1.5	4.5	0.05	2.9	FALSE	FALSE
830	M1H2	5.9	5.9	2160	3.3	1.2	1.5	2.7	0.04	3.3	FALSE	FALSE
834	M1H3	6.1	6.1	864	3.6	0.3	0.6	0.9	0.03	3.7	FALSE	FALSE
836	M1JJ4	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	FALSE
837	M1JJ3	6.1	6.1	6480	2.7	0.6	4.5	5.1	0.05	2.7	FALSE	FALSE
841	M1JJ2	6.3	6.3	6480	2.1	5.7	4.5	10.2	0.08	2.2	FALSE	FALSE
847	M1JJ1	6.6	6.6	6912	1.7	11.1	4.8	15.9	0.1	1.8	FALSE	FALSE
849	M1OO1	6.3	6.3	864	4.5	0.3	0.6	0.9	0.02	4.5	FALSE	FALSE
853	M1MM1	6.2	6.2	0	4.5	0	0	0	0	4.5	FALSE	FALSE
855	M1D2	6.7	6.7	4320	0.9	16.5	3	19.5	0.11	1	FALSE	FALSE
858	M1B1	6.5	6.5	6912	-0.4	13.8	4.8	18.6	0.1	-0.3	FALSE	FALSE
861	M1E4	6.6	6.6	27000	3	0	18.75	18.75	0.1	3.1	FALSE	FALSE
862	M1E3	5.7	5.7	0	1.5	18.75	0	18.75	0.11	1.6	FALSE	FALSE
864	M1E2	5.4	5.4	1296	0.7	20.55	0.9	21.45	0.11	0.8	FALSE	FALSE
866	M1E1	6.3	6.3	1728	-0.3	22.05	1.2	23.25	0.11	-0.1	FALSE	FALSE
868	M1A2	6.4	6.4	2592	-0.8	223.4	1.8	225.15	0.37	-0.4	FALSE	FALSE
871	M1A4	6.5	6.5	0	1	196.2	0	196.2	0.35	1.3	FALSE	FALSE
882	M1U1	6.1	6.1	0	2.6	1.8	0	1.8	0.03	2.6	FALSE	FALSE
884	M1A7	6.5	6.5	0	1.7	191.4	0	191.4	0.31	2	FALSE	FALSE
886	M1BB2	5.9	5.9	0	3	1.5	0	1.5	0.03	3	FALSE	FALSE
891	M1A10	6.7	6.7	32400	4.3	6.25	22.5	28.75	0.12	4.4	FALSE	FALSE
893	M1A11	8.2	8.2	9000	4.8	0	6.25	6.25	1.64	6.4	FALSE	FALSE
899	M23B2	6.9	6.9	5460	3.5	0	3.792	3.7917	0.05	3.6	FALSE	FALSE
900	M23B1	5.4	5.4	56700	1.9	3.792	39.38	43.167	0.27	2.2	FALSE	FALSE
903	M17A2	6.1	7.8	3360	2.1	0	2.333	2.3333	0.04	2.2	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
905	M5B2	6	6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
906	M5B1	6.4	6.4	3175.2	3	0.315	2.205	2.52	0.04	3	FALSE	FALSE
908	M5A3	6.2	6.2	7711.2	-2.4	22.23	5.355	27.585	0.11	-2.3	FALSE	FALSE
910	M5A2	6	6	4536	-2.7	38.3	3.15	41.445	0.15	-2.5	FALSE	FALSE
913	M5C1	6.4	6.4	3175.2	2	0.315	2.205	2.52	0.04	2	FALSE	FALSE
915	M5C2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
921	M5D3	6.3	6.3	4082.4	0.7	5.04	2.835	7.875	0.07	0.8	FALSE	FALSE
923	M5A4	6	6	3628.8	-0.7	17.19	2.52	19.71	0.11	-0.6	FALSE	FALSE
925	M5A6	5.8	5.8	3628.8	0.5	14.67	2.52	17.19	0.11	0.6	FALSE	FALSE
927	M5A7	6.5	6.5	3628.8	1.8	12.15	2.52	14.67	0.1	1.9	FALSE	FALSE
929	M5A8	6.3	6.3	4082.4	3.1	0.315	11.84	12.15	0.09	3.2	FALSE	FALSE
931	M5D4	6	6	3175.2	2.2	2.835	2.205	5.04	0.06	2.3	FALSE	FALSE
933	M5D5	6.3	6.3	3628.8	3.4	0.315	2.52	2.835	0.04	3.4	FALSE	FALSE
935	M5A9	5.8	5.8	453.6	4.5	0	0.315	0.315	0.02	4.5	FALSE	FALSE
937	M5D6	5.8	5.8	453.6	4.6	0	0.315	0.315	0.02	4.6	FALSE	FALSE
939	M4H2	5.9	5.9	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
940	M4H1	6.4	6.4	4082.4	2.5	0.315	2.835	3.15	0.04	2.5	FALSE	FALSE
944	M4A3	6.7	6.7	7257.6	0.7	17.33	5.04	22.365	0.12	0.8	FALSE	FALSE
946	M4B1	6.1	6.1	4536	2.5	0.315	3.15	3.465	0.05	2.5	FALSE	FALSE
948	M4B2	6.3	6.3	453.6	4.3	0	0.315	0.315	0.02	4.3	FALSE	FALSE
952	M4A4	6.7	6.7	7257.6	1.2	8.505	5.04	13.545	0.1	1.3	FALSE	FALSE
954	M4D1	6.5	6.5	907.2	3.5	0.63	0.63	1.26	0.03	3.5	FALSE	FALSE
956	M4E1	6.4	6.4	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
958	M4D2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
960	M4F1	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
961	M4A5	6.7	6.7	9525.6	1.8	0.63	6.615	7.245	0.07	1.8	FALSE	FALSE
964	M4G1	7.6	7.6	4536	3	3.623	3.15	6.7725	0.06	3.1	FALSE	FALSE
966	M4G2	7.4	7.4	907.2	5.4	2.993	0.63	3.6225	0.05	5.4	FALSE	FALSE
968	M4A6	7.2	7.2	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
970	M34F4	4.4	4.4	6171.9	1.8	0	4.286	4.286	1.63	3.5	FALSE	FALSE
971	M34F3	4.8	4.8	2646	1.2	4.286	1.838	6.1235	1.65	2.8	FALSE	FALSE
979	M34H2	5.1	5.1	2646	0.9	0.525	1.838	2.3625	0.17	1	FALSE	FALSE
983	M34I1	3.4	3.4	756	1.5	0	0.525	0.525	0.02	1.5	FALSE	FALSE
987	M34A7	4.3	4.3	13769	-0.5	245.7	9.562	255.24	0.42	-0.1	FALSE	FALSE
989	M34J1	3.2	3.2	3780	0.1	3.413	2.625	6.0375	0.06	0.2	FALSE	FALSE
991	M34K1	4.5	4.5	4158	1.1	0.263	2.888	3.15	0.05	1.1	FALSE	FALSE
993	M34K2	4.7	4.7	378	3	0	0.263	0.2625	0.01	3	FALSE	FALSE
995	M34J2	5	5	378	2.5	0	0.263	0.2625	0.01	2.5	FALSE	FALSE
997	M34A5	4.2	4.2	0	-2.1	365.3	0	365.33	0.43	-1.6	FALSE	FALSE
999	M34A4	4.1	4.1	0	-3	365.3	0	365.33	0.45	-2.5	FALSE	FALSE
1001	M34E2	7.1	7.1	2940	1.5	0	2.042	2.0417	0.03	1.5	FALSE	FALSE
1003	M17M6	7.1	7.1	41040	2.5	11.4	28.5	39.9	0.14	2.6	FALSE	FALSE
1005	M17M5	6.8	6.8	16416	1.9	39.9	11.4	51.3	0.15	2	FALSE	FALSE
1007	M17M4	6.8	6.8	0	1	51.3	0	51.3	0.15	1.2	FALSE	FALSE
1009	M17M3	6.8	6.8	16416	0.6	51.3	11.4	62.7	0.17	0.8	FALSE	FALSE
1011	M17M2	6.9	6.9	16416	-0.3	62.7	11.4	74.1	0.19	-0.1	FALSE	FALSE
1013	M17M1	7	7	16416	-0.8	74.1	11.4	85.5	0.2	-0.6	FALSE	FALSE
1015	M17A3	9.6	9.6	2720.8	-6.4	491	1.889	492.86	0.64	-5.8	FALSE	FALSE
1017	M17A6	8	8	0	-3.4	405.5	0	405.47	0.4	-3	FALSE	FALSE
1019	M17O3	8.4	8.4	32832	4.1	0	22.8	22.8	0.1	4.2	FALSE	FALSE
1020	M17O2	6.9	6.9	16416	2.9	22.8	11.4	34.2	0.13	3	FALSE	FALSE
1022	M17N1	6.7	6.7	49248	0.1	91.2	34.2	125.4	0.22	0.3	FALSE	FALSE
1024	M17N2	6.9	6.9	32832	3.7	11.4	22.8	34.2	0.13	3.8	FALSE	FALSE
1026	M17N3	6.8	6.8	0	4.7	11.4	0	11.4	0.07	4.7	FALSE	FALSE
1028	M17N4	7.6	7.6	16416	5.3	0	11.4	11.4	0.07	5.3	FALSE	FALSE
1030	M17A2	8	8	0	-6.6	618.3	0	618.26	0.67	-6	FALSE	FALSE
1033	M17U1	6.9	6.9	16416	-2.3	0	11.4	11.4	0.06	-2.2	FALSE	FALSE
1034	M17T3	8.1	8.1	0	-2.8	48.45	0	48.45	0.14	-2.7	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1036	M17T4	8.2	8.2	16416	1.1	25.65	11.4	37.05	0.12	1.2	FALSE	FALSE
1038	M17V1	7.1	7.1	16416	1.8	2.85	11.4	14.25	0.08	1.9	FALSE	FALSE
1040	M17V2	6.8	6.8	4104	2.8	0	2.85	2.85	0.04	2.8	FALSE	FALSE
1042	M17T8	8.5	8.5	0	2.8	0	0	0	0	2.8	FALSE	FALSE
1043	M17T7	8	8	16416	2.4	0	11.4	11.4	0.07	2.5	FALSE	FALSE
1045	M17T6	7.2	7.2	0	2.1	11.4	0	11.4	0.07	2.1	FALSE	FALSE
1047	M17T5	7.7	7.7	0	1.8	11.4	0	11.4	0.07	1.9	FALSE	FALSE
1050	M17U2	7.6	7.6	0	-1	0	0	0	0	-1	FALSE	FALSE
1052	M17T2	7	7	0	-3.3	48.45	0	48.45	0.15	-3.2	FALSE	FALSE
1054	M17T1	7.4	7.4	0	-3.5	48.45	0	48.45	0.13	-3.3	FALSE	FALSE
1056	M17A1	8.6	8.6	41040	-7	695.2	28.5	723.71	0.65	-6.3	FALSE	FALSE
1060	M17Q0	7.2	7.2	31920	0.6	37.05	22.17	59.217	0.17	0.8	FALSE	FALSE
1062	M17R1	6.9	6.9	0	1.8	0	0	0	0	1.8	FALSE	FALSE
1064	M17R2	7.1	7.1	0	2.9	0	0	0	0	2.9	FALSE	FALSE
1066	M17R3	7.6	7.6	0	3.6	0	0	0	0	3.6	FALSE	FALSE
1075	M17H3	8.4	8.4	4104	4.5	0	2.85	2.85	0.04	4.5	FALSE	FALSE
1076	M17H2	8.6	8.6	19494	3	2.85	13.54	16.388	0.09	3.1	FALSE	FALSE
1078	M17H1	8.7	8.7	4104	2.6	16.39	2.85	19.237	0.09	2.6	FALSE	FALSE
1080	M17A10	8.7	8.7	6156	0.6	329.8	4.275	334.06	0.56	1.1	FALSE	FALSE
1082	M17G1	9.6	9.6	32832	4.8	0	22.8	22.8	0.1	4.9	FALSE	FALSE
1084	M17G2	9.4	9.4	0	7	0	0	0	0	7	FALSE	FALSE
1086	M17A12	9.4	9.4	80028	4	0	55.58	55.575	0.18	4.2	FALSE	FALSE
1087	M17A11	8.9	8.9	32832	1.6	265	22.8	287.75	0.47	2	FALSE	FALSE
1092	M17P1	7	8.6	32832	2.9	5.7	22.8	28.5	0.11	3	FALSE	FALSE
1094	M17P2	7.4	7.4	0	4.1	5.7	0	5.7	0.05	4.2	FALSE	FALSE
1096	M17P3	8	9.5	8208	4.5	0	5.7	5.7	0.05	4.6	FALSE	FALSE
1101	M14D2	4.9	4.9	16416	1.3	131.1	11.4	142.45	2.14	3.4	FALSE	FALSE
1121	M14D5	6.3	6.3	8208	3.5	0	5.7	5.7	0.13	3.6	FALSE	FALSE
1127	M14F1	9.2	9.2	16416	1.8	19.95	11.4	31.35	0.3	2.1	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1129	M14F2	0	7.9	16416	2.5	8.55	11.4	19.95	0.12	2.6	FALSE	FALSE
1141	M14I1	5.4	5.4	2052	-0.8	1.71	1.425	3.135	0.04	-0.8	FALSE	FALSE
1143	M14I2	5.3	5.3	2052	0.5	0.285	1.425	1.71	0.03	0.5	FALSE	FALSE
1145	M14I3	5.8	5.8	410.4	1.5	0	0.285	0.285	0.01	1.5	FALSE	FALSE
1147	M14J1	5.4	5.4	2052	-1.9	2.565	1.425	3.99	0.04	-1.9	FALSE	FALSE
1149	M14J2	5.7	5.7	1641.6	-0.7	1.425	1.14	2.565	0.04	-0.7	FALSE	FALSE
1151	M14J3	5.7	5.7	1641.6	0.3	0.285	1.14	1.425	0.03	0.3	FALSE	FALSE
1153	M14J4	5.9	5.9	410.4	1.4	0	0.285	0.285	0.01	1.4	FALSE	FALSE
1155	M14A5	5.2	5.2	7797.6	-2.4	83.58	5.415	88.999	0.23	-2.1	FALSE	FALSE
1157	M14L1	5.5	5.5	5335.2	0.1	0.57	3.705	4.275	0.04	0.1	FALSE	FALSE
1159	M14L2	5.2	5.2	820.8	1.5	0	0.57	0.57	0.02	1.5	FALSE	FALSE
1161	M14K1	5.2	5.2	3693.6	0.6	0.57	2.565	3.135	0.04	0.7	FALSE	FALSE
1163	M14K2	5.6	5.6	820.8	1.6	0	0.57	0.57	0.02	1.6	FALSE	FALSE
1165	M14B1	6.5	6.5	22002	-1.7	76.63	15.28	91.913	0.2	-1.5	FALSE	FALSE
1167	M14B2	5.3	5.3	110352	-1.4	0	76.63	76.633	0.29	-1.1	FALSE	FALSE
1169	M14A6	5.1	5.1	0	-0.5	76.17	0	76.174	0.19	-0.3	FALSE	FALSE
1173	M14M1	5.3	5.3	4924.8	-0.4	13.97	3.42	17.385	0.24	-0.2	FALSE	FALSE
1175	M14N1	5.6	5.6	1641.6	0.9	0.57	1.14	1.71	0.03	0.9	FALSE	FALSE
1177	M14N2	5.5	5.5	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1179	M14O1	5.6	5.6	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1181	M14M2	6.6	6.6	4924.8	2.2	8.835	3.42	12.255	0.07	2.2	FALSE	FALSE
1183	M14P1	6.8	6.8	820.8	3.8	0	0.57	0.57	0.02	3.8	FALSE	FALSE
1185	M14M3	7.4	7.4	5745.6	3	4.275	3.99	8.265	0.07	3.1	FALSE	FALSE
1187	M14Q1	7.3	7.3	1231.2	4.3	0	0.855	0.855	0.02	4.3	FALSE	FALSE
1189	M14M4	8	8	4104	4.3	0.57	2.85	3.42	0.05	4.3	FALSE	FALSE
1191	M14R1	7.5	7.5	410.4	4.4	0	0.285	0.285	0.02	4.4	FALSE	FALSE
1193	M14M5	9.1	9.1	410.4	5.7	0	0.285	0.285	0.01	5.7	FALSE	FALSE
1195	M14A8	6.7	6.7	2462.4	-0.6	27.93	1.71	29.64	0.43	-0.2	FALSE	FALSE
1197	M14A9	8	8	2052	0.4	26.51	1.425	27.93	0.13	0.5	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1199	M14Y1	7.8	7.8	410.4	4.8	0	0.285	0.285	0.01	4.8	FALSE	FALSE
1201	M14S1	5.3	5.3	10670.4	1	16.96	7.41	24.368	0.11	1.1	FALSE	FALSE
1203	M14X1	6.4	6.4	2052	2	0.713	1.425	2.1375	0.04	2	FALSE	FALSE
1205	M14X2	7.3	7.3	1026	3.3	0	0.713	0.7125	0.02	3.3	FALSE	FALSE
1207	M14S2	5.7	5.7	2872.8	2.1	12.83	1.995	14.82	0.1	2.1	FALSE	FALSE
1209	M14S3	6	6	5335.2	2.9	7.41	3.705	11.115	0.08	2.9	FALSE	FALSE
1211	M14V1	7.6	7.6	820.8	3.9	0	0.57	0.57	0.02	3.9	FALSE	FALSE
1213	M14S4	7.7	7.7	5335.2	3.7	3.135	3.705	6.84	0.07	3.8	FALSE	FALSE
1215	M14W1	7.2	7.2	410.4	4.2	0	0.285	0.285	0.02	4.2	FALSE	FALSE
1217	M14S5	8	8	3693.6	4.7	0.285	2.565	2.85	0.04	4.7	FALSE	FALSE
1219	M14T1	6.3	6.3	1641.6	3.1	0.57	1.14	1.71	0.03	3.1	FALSE	FALSE
1221	M14U1	5.9	5.9	410.4	3.5	0	0.285	0.285	0.02	3.5	FALSE	FALSE
1223	M14T2	6.6	6.6	410.4	3.4	0	0.285	0.285	0.02	3.4	FALSE	FALSE
1225	M14S6	8.8	8.8	410.4	5.8	0	0.285	0.285	0.01	5.8	FALSE	FALSE
1227	M14A10	8.2	8.2	11491.2	1.2	18.24	7.98	26.22	0.12	1.3	FALSE	FALSE
1229	M14A11	8.3	8.3	6976.8	2	4.845	4.845	9.69	0.07	2.1	FALSE	FALSE
1231	M14BB1	8.4	8.4	2462.4	3.3	1.71	1.71	3.42	0.05	3.3	FALSE	FALSE
1233	M14BB2	8.4	8.4	2052	4.2	0.285	1.425	1.71	0.03	4.3	FALSE	FALSE
1235	M14AA1	8.6	8.6	4104	3.9	0.57	2.85	3.42	0.04	4	FALSE	FALSE
1237	M14AA2	8.4	8.4	820.8	4.8	0	0.57	0.57	0.02	4.8	FALSE	FALSE
1239	M14A12	8.9	8.9	1231.2	3.5	0.57	0.855	1.425	0.03	3.6	FALSE	FALSE
1241	M14A13	9	9	820.8	5	0	0.57	0.57	0.02	5	FALSE	FALSE
1243	M14BB3	8.4	8.4	410.4	5.2	0	0.285	0.285	0.02	5.2	FALSE	FALSE
1245	M14Z1	8.4	8.4	6566.4	4.2	0.57	4.56	5.13	0.05	4.2	FALSE	FALSE
1247	M14Z2	8.4	8.4	820.8	5.5	0	0.57	0.57	0.02	5.5	FALSE	FALSE
1269	M22A1	5	5	39480	-1.4	197.1	27.42	224.49	0.29	-1.1	FALSE	FALSE
1270	M22F1	4.7	4.7	0	-1.8	0	0	0	1.26	-0.5	FALSE	FALSE
1274	M22A2	4.8	4.8	20412	-0.8	182.9	14.18	197.08	0.34	-0.4	FALSE	FALSE
1276	M22B1	6.2	6.2	3628.8	1.2	0.945	2.52	3.465	0.04	1.2	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1278	M22B2	5.6	5.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
1280	M22E1	5.3	5.3	453.6	2.6	0	0.315	0.315	0.01	2.6	FALSE	FALSE
1282	M22A3	5.2	5.2	24494.4	0.9	162.4	17.01	179.44	0.3	1.2	FALSE	FALSE
1284	M22A5	5.4	5.4	4536	2.2	0	3.15	3.15	0.04	2.2	FALSE	FALSE
1287	M26A1	5.4	5.4	5443.2	0	0.63	3.78	4.41	-0.03	0	FALSE	FALSE
1305	M14C9	7.3	7.3	53352	1.7	34.2	37.05	71.25	0.33	2.1	FALSE	FALSE
1307	M14C10	7.6	7.6	10260	2.6	7.125	7.125	14.25	0.08	2.6	FALSE	FALSE
1309	M14C11	8.2	8.2	10260	3.1	0	7.125	7.125	0.06	3.2	FALSE	FALSE
1311	M14G1	8	8	16416	2.4	8.55	11.4	19.95	0.1	2.5	FALSE	FALSE
1313	M14G2	8.2	8.2	12312	3.3	0	8.55	8.55	0.06	3.3	FALSE	FALSE
1315	M17Q5	7.6	7.6	4104	5.3	0	2.85	2.85	0.04	5.3	FALSE	FALSE
1316	M17Q4	7.2	7.2	32832	4.1	2.85	22.8	25.65	0.12	4.2	FALSE	FALSE
1318	M17Q3	7.2	7.2	16416	3.3	25.65	11.4	37.05	0.13	3.4	FALSE	FALSE
1325	M40A1	8	8	0	-0.6	90.53	0	90.528	0.21	-0.4	FALSE	FALSE
1326	M40A2	7.9	7.9	0	0.3	88.08	0	88.078	0.1	0.4	FALSE	FALSE
1328	M40A3	8.4	8.4	0	1.5	88.08	0	88.078	0.1	1.6	FALSE	FALSE
1330	M40A4	7.5	7.5	0	2.7	88.08	0	88.078	0.2	2.9	FALSE	FALSE
1347	M34U1	5.1	5.1	15807.75	2.6	0	10.98	10.978	0.08	2.7	FALSE	FALSE
1348	M34L1	4.7	4.7	3250.8	1.6	15.8	2.258	18.058	0.1	1.7	FALSE	FALSE
1350	M34A8	4.6	4.6	5292	0	236	3.675	239.64	0.58	0.6	FALSE	FALSE
1354	M16A5	5.8	5.8	0	0.6	31.71	0	31.711	0.14	0.7	FALSE	FALSE
1355	M16A6	5.4	5.4	22680	1.1	15.96	15.75	31.711	0.12	1.2	FALSE	FALSE
1357	M16A7	6.2	6.2	6200.88	2.8	4.568	4.306	8.8737	0.06	2.8	FALSE	FALSE
1359	M16A8	6.1	6.1	0	3.5	4.568	0	4.5675	0.05	3.6	FALSE	FALSE
1361	M16A9	7	7	5443.2	3.9	0.788	3.78	4.5675	0.04	4	FALSE	FALSE
1363	M16A10	6.9	6.9	1134	5.1	0	0.788	0.7875	0.02	5.1	FALSE	FALSE
1365	M16G1	4.2	4.2	7257.6	2.5	2.048	5.04	7.0875	0.06	2.5	FALSE	FALSE
1367	M16G2	5.5	5.5	2948.4	3.4	0	2.048	2.0475	0.04	3.5	FALSE	FALSE
1369	M37A4	5.5	5.5	1503.6	-0.4	43.66	1.044	44.699	0.14	-0.3	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1370	M37A3	5.4	5.4	4510.8	-1.6	44.7	3.133	47.831	0.15	-1.5	FALSE	FALSE
1372	M37A2	5.3	5.3	9021.6	-2.8	49.92	6.265	56.185	0.16	-2.6	FALSE	FALSE
1374	M37B1	4.8	4.8	3007.2	-1.7	0	2.088	2.0883	0.03	-1.7	FALSE	FALSE
1376	M37A1	5.7	5.7	0	-3.2	69.76	0	69.759	0.16	-3	FALSE	FALSE
1378	M37C1	6	6	9021.6	-2.6	7.309	6.265	13.574	0.08	-2.6	FALSE	FALSE
1380	M37E1	5.3	5.3	3007.2	-1.6	0	2.088	2.0883	0.03	-1.6	FALSE	FALSE
1382	M37C2	6.3	6.3	4510.8	-1.4	2.088	3.133	5.2208	0.05	-1.3	FALSE	FALSE
1384	M37C3	5.1	5.1	1503.6	-0.4	0	1.044	1.0442	0.02	-0.4	FALSE	FALSE
1393	M17B1	8.8	8.8	0	2.2	136.8	0	136.8	0.24	2.4	FALSE	FALSE
1395	M17B2	9	9	0	2.6	136.8	0	136.8	0.26	2.8	FALSE	FALSE
1397	M17B3	8	8	32832	3.4	114	22.8	136.8	0.26	3.7	FALSE	FALSE
1399	M17C1	7.7	7.7	16416	3.7	0	11.4	11.4	0.07	3.8	FALSE	FALSE
1401	M17B4	8.1	8.1	0	4	102.6	0	102.6	0.44	4.5	FALSE	FALSE
1403	M17B5	9.7	9.7	16416	4.7	91.2	11.4	102.6	0.22	4.9	FALSE	FALSE
1405	M17I1	8.1	8.1	16416	4.9	0	11.4	11.4	0.07	5	FALSE	FALSE
1407	M17B6	7.7	7.7	16416	5.6	68.4	11.4	79.8	0.19	5.8	FALSE	FALSE
1409	M17D1	8.1	8.1	16416	6.2	0	11.4	11.4	0.07	6.3	FALSE	FALSE
1411	M17B7	8.1	8.1	16416	6.1	45.6	11.4	57	-0.27	5.9	FALSE	FALSE
1413	M17B9	7.6	7.6	16416	6.5	34.2	11.4	45.6	0.15	6.7	FALSE	FALSE
1415	M17E1	8.6	8.6	16416	7	0	11.4	11.4	0.07	7.1	FALSE	FALSE
1417	M17B10	10.2	10.2	16416	7	11.4	11.4	22.8	0.11	7.1	FALSE	FALSE
1419	M17B11	10.3	10.3	16416	7.8	0	11.4	11.4	0.07	7.8	FALSE	FALSE
1421	M34E1	5.1	5.1	0	-0.9	2.042	0	2.0417	0.03	-0.9	FALSE	FALSE
1424	M32A1	5.8	5.8	0	-1.2	59.74	0	59.743	0.17	-1	FALSE	FALSE
1426	M32C1	5.7	5.7	0	0	13.81	0	13.805	-0.31	-0.3	FALSE	FALSE
1430	M32A2	7.2	7.2	21413.28	0.8	31.07	14.87	45.938	0.15	0.9	FALSE	FALSE
1432	M32A3	5.6	5.6	12285	1.1	22.54	8.531	31.068	0.12	1.3	FALSE	FALSE
1434	M32A4	5.3	5.3	23784.18	1.9	0	16.52	16.517	0.09	2	FALSE	FALSE
1436	M32D1	4.8	4.8	8668.8	1.4	0	6.02	6.02	0.06	1.4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1440	M31A4	5.5	5.5	22378.02	0.4	0	15.54	15.54	0.11	0.5	FALSE	FALSE
1441	M31A3	7.4	7.4	26877.48	-0.1	15.54	18.67	34.205	0.13	0.1	FALSE	FALSE
1443	M31A2	7.7	7.7	28061.88	-2.3	34.21	19.49	53.693	0.16	-2.1	FALSE	FALSE
1445	M31A1	6.2	6.2	56089.32	-4	86.48	38.95	125.43	0.24	-3.7	FALSE	FALSE
1446	M31B1	5.8	5.8	13608	-0.4	23.34	9.45	32.788	0.12	-0.3	FALSE	FALSE
1449	M31B2	6.3	6.3	8022	0.8	17.77	5.571	23.338	0.1	0.9	FALSE	FALSE
1451	M31B4	4.3	4.3	11116.56	3.4	0	7.72	7.7198	0.06	3.5	FALSE	FALSE
1455	M34A13	4.7	4.7	378	2.1	6.3	0.263	6.5625	0.07	2.2	FALSE	FALSE
1456	M34A11	4.4	4.4	0	1.5	213.1	0	213.13	0.41	1.9	FALSE	FALSE
1458	M34A10	4.4	4.4	756	0.8	213.1	0.525	213.65	0.42	1.2	FALSE	FALSE
1461	M34A12	4.5	4.5	756	1.7	7.088	0.525	7.6125	0.27	1.9	FALSE	FALSE
1497	M18A-B1	5.3	5.3	2721.6	0.9	0	1.89	1.89	0.03	0.9	FALSE	FALSE
1499	M18A-A4	5.5	5.5	2268	0.2	67.5	1.575	69.074	0.55	0.7	FALSE	FALSE
1501	M18A-A5	5.3	5.3	8164.8	0.7	61.83	5.67	67.499	0.19	0.9	FALSE	FALSE
1503	M18A-C1	8.2	8.2	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	FALSE
1505	M18A-A6	5.4	5.4	1360.8	1.2	60.25	0.945	61.199	0.17	1.4	FALSE	FALSE
1507	M18A-D1	9.2	9.2	6350.4	2.5	0	4.41	4.41	0.05	2.5	FALSE	FALSE
1509	M18A-A7	7.7	7.7	1360.8	1.7	54.9	0.945	55.844	0.16	1.9	FALSE	FALSE
1511	M18A-A8	8.3	8.3	2268	2.1	53.32	1.575	54.899	0.16	2.3	FALSE	FALSE
1513	M46A1	4.9	4.9	(N/A)	0.8	(N/A)	(N/A)	(N/A)	(N/A)	(N/A)	FALSE	FALSE
1519	M34C1	6.5	6.5	11550	-1	26.4	8.021	34.417	0.11	-0.9	FALSE	FALSE
1521	M34C2	7.1	7.1	0	-0.3	26.4	0	26.396	0.11	-0.2	FALSE	FALSE
1523	M34C3	7.2	7.2	5460	1.7	22.6	3.792	26.396	0.11	1.8	FALSE	FALSE
1525	M34C4	7.6	7.6	2310	2.9	21	1.604	22.604	0.1	3	FALSE	FALSE
1527	M34C5	8.5	8.5	30240	4.1	0	21	21	0.1	4.2	FALSE	FALSE
1529	M34D2	5.5	5.5	12640.25	3.6	0	8.778	8.778	0.06	3.6	FALSE	FALSE
1530	M34D1	5.7	5.7	0	2.9	8.778	0	8.778	0.06	3	FALSE	FALSE
1532	M34B1	5.8	5.8	8050	1.7	19.21	5.59	24.795	0.11	1.8	FALSE	FALSE
1534	M34B2	6.7	6.7	0	2.3	10.43	0	10.427	0.07	2.3	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1536	M34B3	5.7	5.7	2520	2.9	8.677	1.75	10.427	0.07	3	FALSE	FALSE
1538	M34B4	5.3	5.3	10220	3.5	1.58	7.097	8.6771	0.06	3.6	FALSE	FALSE
1540	M34B5	6	6	2275	4.3	0	1.58	1.5799	0.03	4.3	FALSE	FALSE
1550	M17F1	9.1	9.1	32832	2.8	49.78	22.8	72.577	0.2	3	FALSE	FALSE
1552	M17F2	8.9	8.9	0	3.9	49.78	0	49.777	0.17	4.1	FALSE	FALSE
1554	M17F3	10.9	10.9	70178.4	4	1.042	48.74	49.777	0.15	4.2	FALSE	FALSE
1556	M17F4	10	10	1500	5.2	0	1.042	1.0417	0.03	5.2	FALSE	FALSE
1560	M14H1	5.6	5.6	8208	3	17.1	5.7	22.8	0.46	3.4	FALSE	FALSE
1562	M14H2	5.6	5.6	0	3.4	17.1	0	17.1	0.1	3.5	FALSE	FALSE
1564	M14H3	5.6	5.6	4104	3.8	14.25	2.85	17.1	0.09	3.9	FALSE	FALSE
1566	M14H4	5.9	5.9	12312	4.2	5.7	8.55	14.25	0.09	4.3	FALSE	FALSE
1568	M14H5	5.7	5.7	8208	5.2	0	5.7	5.7	0.06	5.3	FALSE	FALSE
1579	M16B1	6.4	6.4	4116	-2	32.05	2.858	34.912	0.11	-1.9	FALSE	FALSE
1581	M16B2	6	6	8232	-1.7	17.18	5.717	22.896	0.12	-1.5	FALSE	FALSE
1583	M16A2	6	6	0	-2.6	95.48	0	95.475	0.19	-2.4	FALSE	FALSE
1585	M16A3	5.4	5.4	11655	-1.4	87.38	8.094	95.475	0.21	-1.2	FALSE	FALSE
1587	M16D1	6.1	6.1	24347.4	-0.1	7.554	16.91	24.462	0.12	0	FALSE	FALSE
1589	M16D2	4.8	4.8	10878	2	0	7.554	7.5542	0.06	2.1	FALSE	FALSE
1591	M16A4	4.1	4.1	44940	-0.3	31.71	31.21	62.92	0.15	-0.1	FALSE	FALSE
1599	M38D2	8	8	8750.7	0.7	0	6.077	6.0769	0.06	0.7	FALSE	FALSE
1600	M38D1	5.7	5.7	8750.7	0.1	6.077	6.077	12.154	0.07	0.2	FALSE	FALSE
1602	M38A6	6	6	8750.7	-1.1	13.87	6.077	19.946	0.1	-1	FALSE	FALSE
1604	M17O1	6.9	6.9	32832	1.7	34.2	22.8	57	0.16	1.8	FALSE	FALSE
1609	M3D2	6.3	6.3	3283.2	0.6	8.835	2.28	11.115	0.09	0.7	FALSE	FALSE
1611	M3D1	6.4	6.4	2872.8	-0.2	11.12	1.995	13.11	0.1	-0.1	FALSE	FALSE
1614	M3F1	6.6	6.6	4514.4	-0.4	136	3.135	139.17	0.29	-0.1	FALSE	FALSE
1616	M3F2	6	6	4514.4	1.5	132.9	3.135	136.04	0.29	1.8	FALSE	FALSE
1680	M19A2	5.2	5.2	0	1.5	0	0	0	0	1.5	FALSE	FALSE
1681	M19A1	5.4	5.4	0	1	0	0	0	0	1	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1695	M38A5	4.9	4.9	18901.68	-2.1	19.95	13.13	33.072	0.12	-2	FALSE	FALSE
1697	M38A4	5	5	18901.68	-3.8	33.07	13.13	46.198	0.15	-3.7	FALSE	FALSE
1701	M38A3	5.1	5.1	18901.68	-5.5	46.2	13.13	59.324	0.18	-5.4	FALSE	FALSE
1703	M38A2	6.6	6.6	38973.06	-7.2	100.3	27.07	127.39	0.25	-7	FALSE	FALSE
1705	M38C1	7	7	38973.06	-0.7	13.94	27.07	41.003	0.14	-0.6	FALSE	FALSE
1709	M38A1	6.1	6.1	20090.99	-8.9	168.3	13.95	182.2	0.3	-8.6	FALSE	FALSE
1711	M38B1	6.5	6.5	19609.59	-1.6	27.24	13.62	40.853	0.14	-1.4	FALSE	FALSE
1713	M38B2	7.1	7.1	19609.59	0.1	13.62	13.62	27.236	0.11	0.2	FALSE	FALSE
1717	M16A1	5.9	5.9	15456	-2.8	138.3	10.73	149	0.27	-2.5	FALSE	FALSE
1726	M16H1	6.4	6.4	4998	-1.9	2.829	3.471	6.3	0.06	-1.8	FALSE	FALSE
1727	M16F1	5.3	5.3	4116	3	0	2.858	2.8583	0.04	3	FALSE	FALSE
1729	M16B4	7.2	7.2	8988	5	0	6.242	6.2417	0.05	5	FALSE	FALSE
1731	M16B3	7.2	7.2	11634	-1.5	6.242	8.079	14.321	0.08	-1.4	FALSE	FALSE
1732	M16E1	5.3	5.3	4116	3	0	2.858	2.8583	0.04	3	FALSE	FALSE
1735	M16H2	6.7	6.7	4074	4.2	0	2.829	2.8292	0.03	4.2	FALSE	FALSE
1751	M31B3	5.4	5.4	14468.16	1.7	7.72	10.05	17.767	0.09	1.7	FALSE	FALSE
1755	M30A9	4.1	4.1	0	3.8	0.63	0	0.63	0.02	3.8	FALSE	FALSE
1756	M30A8	4.4	4.4	453.6	3.1	0.63	0.315	0.945	0.03	3.1	FALSE	FALSE
1757	M30A6	3.3	3.3	0	2.7	1.26	0	1.26	0.03	2.7	FALSE	FALSE
1758	M30K1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1759	M30A5	3.8	3.8	2721.6	2.2	2.52	1.89	4.41	0.05	2.2	FALSE	FALSE
1760	M30J1	4	4	907.2	3.5	0	0.63	0.63	0.02	3.5	FALSE	FALSE
1761	M30A4	3.6	3.6	2721.6	1.4	5.67	1.89	7.56	0.07	1.5	FALSE	FALSE
1762	M30I1	3.4	3.4	907.2	2	0	0.63	0.63	0.02	2	FALSE	FALSE
1763	M30H1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1764	M30A3	3.7	3.7	1814.4	0.6	8.505	1.26	9.765	0.07	0.6	FALSE	FALSE
1767	M30A1	3.5	3.5	1814.4	-0.9	28.35	1.26	29.61	0.12	-0.8	FALSE	FALSE
1836	M29A1	4.5	4.5	1814.4	-1.6	23	1.26	24.255	0.09	-1.5	FALSE	FALSE
3102	M34G1	5.2	5.2	68390	3.8	0	47.49	47.493	0.16	4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3105	M34O1	5.3	5.3	1814.4	2.9	0.63	1.26	1.89	0.03	2.9	FALSE	FALSE
3107	M34O2	5	5	907.2	3.3	0	0.63	0.63	0.02	3.3	FALSE	FALSE
3112	M29A2	4.5	4.5	8164.8	-0.7	8.505	5.67	14.175	0.08	-0.6	FALSE	FALSE
3118	M29E1	5.4	5.4	907.2	4	0	0.63	0.63	0.02	4	FALSE	FALSE
3120	M29B1	4.2	4.2	3628.8	-1	5.67	2.52	8.19	0.07	-0.9	FALSE	FALSE
3122	M29F1	4.6	4.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
3125	M29B2	4.5	4.5	4989.6	0	1.575	3.465	5.04	0.05	0.1	FALSE	FALSE
3127	M29B4	4.6	4.6	453.6	2.5	0	0.315	0.315	0.01	2.5	FALSE	FALSE
3129	M29G1	4.5	4.5	0	2.5	0	0	0	0	2.5	FALSE	FALSE
3131	M29C1	5	5	0	2	0.63	0	0.63	0.02	2	FALSE	FALSE
3133	M29C2	5.1	5.1	907.2	3	0	0.63	0.63	0.02	3	FALSE	FALSE
3135	M34L2	4.3	4.3	1360.8	2.3	3.878	0.945	4.8225	0.05	2.4	FALSE	FALSE
3137	M34M1	4.4	4.4	378	2.8	0.525	0.263	0.7875	0.02	2.9	FALSE	FALSE
3139	M34M2	4.8	4.8	378	3.8	0	0.263	0.2625	0.01	3.8	FALSE	FALSE
3141	M34N1	4.5	4.5	378	3.5	0	0.263	0.2625	0.01	3.5	FALSE	FALSE
3143	M34L3	4.2	4.2	3693.6	2.9	0.525	2.565	3.09	0.04	2.9	FALSE	FALSE
3145	M34L4	4.4	4.4	756	3.9	0	0.525	0.525	0.02	3.9	FALSE	FALSE
3147	M34A16	5	5	378	4.9	0	0.263	0.2625	0.01	4.9	FALSE	FALSE
3148	M34A14	4.3	4.3	4158	2.3	2.888	2.888	5.775	0.06	2.3	FALSE	FALSE
3152	M34T1	4	4	378	3.5	0	0.263	0.2625	0.01	3.5	FALSE	FALSE
3155	M30A10	4.6	4.6	453.6	4	0.315	0.315	0.63	0.02	4	FALSE	FALSE
3165	M30A11	4.6	4.6	453.6	4.4	0	0.315	0.315	0.02	4.4	FALSE	FALSE
3168	M30C2	4	4	453.6	1.3	0	0.315	0.315	0.02	1.3	FALSE	FALSE
3170	M30C1	4	4	2268	-0.5	0.315	1.575	1.89	0.03	-0.5	FALSE	FALSE
3174	M30B1	3.2	3.2	1360.8	-0.5	12.6	0.945	13.545	0.08	-0.4	FALSE	FALSE
3176	M30B4	4	4	0	1.7	4.095	0	4.095	0.05	1.8	FALSE	FALSE
3178	M30B5	4.8	4.8	453.6	2.2	3.78	0.315	4.095	0.05	2.3	FALSE	FALSE
3180	M30B6	4.9	4.9	4536	2.7	0.63	3.15	3.78	0.05	2.7	FALSE	FALSE
3182	M30B7	4.1	4.1	453.6	3.6	0	0.315	0.315	0.01	3.6	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3184	M30M1	4.6	4.6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
3186	M30B2	2.8	2.8	3628.8	0	10.08	2.52	12.6	0.08	0.1	FALSE	FALSE
3189	M30E1	3	3	2721.6	1.5	0	1.89	1.89	0.03	1.5	FALSE	FALSE
3191	M30B3	2.8	2.8	3175.2	1	5.985	2.205	8.19	0.07	1.1	FALSE	FALSE
3194	M30F1	2.6	2.6	2721.6	1.8	0	1.89	1.89	0.04	1.8	FALSE	FALSE
3243	M18C9	5.3	5.3	453.6	3.4	75.33	0.315	75.649	0.19	3.6	FALSE	FALSE
3246	M18C2	5.5	5.5	10432.8	3	76.59	7.245	83.839	0.19	3.2	FALSE	FALSE
3276	M18C1	5.4	5.4	11793.6	2.5	83.84	8.19	92.029	0.21	2.7	FALSE	FALSE
3304	M24D1	7.9	7.9	3628.8	-0.9	1.26	2.52	3.78	0.06	-0.8	FALSE	FALSE
3319	M24A2	5.4	5.4	1814.4	-1	0.63	1.26	1.89	0.11	-0.9	FALSE	FALSE
3328	M25A1	4.6	4.6	5443.2	-1	44.47	3.78	48.252	0.13	-0.8	FALSE	FALSE
3330	M25C1	5.6	5.6	5896.8	0.6	1.26	4.095	5.355	0.05	0.7	FALSE	FALSE
3346	M25A4	4.6	4.6	4536	1	13.98	3.15	17.127	0.09	1.1	FALSE	FALSE
3348	M25A2	5.6	5.6	8618.4	-0.4	23.11	5.985	29.097	0.13	-0.3	FALSE	FALSE
3357	M25B1	5.3	5.3	5896.8	0.3	10.02	4.095	14.115	0.08	0.3	FALSE	FALSE
3364	M7C1	8	8	7344	-0.9	104.5	5.1	109.59	0.23	-0.7	FALSE	FALSE
3377	M7C3	8.3	8.3	9936	0.7	84.46	6.9	91.361	0.21	0.9	FALSE	FALSE
3383	M25B2	5.4	5.4	9979.2	0.9	1.83	6.93	8.76	0.08	1	FALSE	FALSE
3389	M25A5	4	4	453.6	1.5	13.35	0.315	13.662	0.08	1.6	FALSE	FALSE
3391	M25A6	4.6	4.6	18765.6	1.9	0.315	13.03	13.347	0.08	2	FALSE	FALSE
3397	M25K1	4.2	4.2	453.6	2.4	0	0.315	0.315	0.01	2.4	FALSE	FALSE
3406	M18E3	7	7	907.2	1.3	0	0.63	0.63	0.02	1.3	FALSE	FALSE
3422	M1C2	6.7	6.7	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
3423	M1C1	6.4	6.4	5184	2	0.3	3.6	3.9	0.04	2	FALSE	FALSE
3509	M35A1	6	6	0	-1.3	452.8	0	452.83	0.5	-0.8	FALSE	FALSE
3511	M35A2	6.7	6.7	9904.23	-0.1	83.01	6.878	89.89	0.21	0.1	FALSE	FALSE
3513	M35A3	6.7	6.7	24740.52	1.5	65.83	17.18	83.012	0.2	1.7	FALSE	FALSE
3515	M35D1	6	6	49581.63	2	0	34.43	34.432	0.13	2.1	FALSE	FALSE
3642	M18A-A1	5.1	5.1	0	-1	76	0	76.004	0.17	-0.8	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3682	M22A4	5.5	5.5	0	1.6	162.4	0	162.43	0.33	1.9	FALSE	FALSE
3901	M13A1	5.5	5.5	7194.6	3.2	3.334	4.996	8.33	0.06	3.3	FALSE	FALSE
3947	M10A1	9.3	9.3	2898	5.5	0.467	2.013	2.4792	0.04	5.5	FALSE	FALSE
3949	M29A3	4.6	4.6	7711.2	0.2	2.52	5.355	7.875	0.06	0.2	FALSE	FALSE
3982	M38D3	6.5	6.5	0	1.1	0	0	0	0	1.1	FALSE	FALSE
3989	M35A4	6.8	6.8	17653.86	2.7	19.14	12.26	31.4	0.12	2.8	FALSE	FALSE
4007	M9A1	6.9	6.9	71442	-0.3	66.94	49.61	116.55	0.24	-0.1	FALSE	FALSE
4011	M9B1	5.8	5.8	34020	0.5	23.63	23.63	47.25	0.15	0.6	FALSE	FALSE
4017	M5D1	6	6	0	-1	10.71	0	10.71	0.07	-1	FALSE	FALSE
4019	M5D2	6.2	6.2	4082.4	-0.8	7.875	2.835	10.71	0.08	-0.8	FALSE	FALSE
4022	M5A1	6.4	6.4	3175.2	-2.9	43.97	2.205	46.17	0.16	-2.8	FALSE	FALSE
4024	M4A2	7.5	7.5	0	0.3	22.37	0	22.365	0.11	0.4	FALSE	FALSE
4027	M3B1	5.7	5.7	1641.6	1.9	2.565	1.14	3.705	0.05	1.9	FALSE	FALSE
4029	M3B2	5.8	5.8	1231.2	2.8	1.425	0.855	2.28	0.04	2.9	FALSE	FALSE
4031	M3B3	5.5	5.5	410.4	3.3	1.14	0.285	1.425	0.03	3.3	FALSE	FALSE
4033	M3B4	5.4	5.4	1231.2	3.6	0.285	0.855	1.14	0.03	3.6	FALSE	FALSE
4041	M2H1	5.5	5.5	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	FALSE
4049	M2R3	5.9	5.9	2592	3.7	0.6	1.8	2.4	0.04	3.8	FALSE	FALSE
4056	M2T1	5.9	5.9	3024	2.3	0.6	2.1	2.7	0.04	2.3	FALSE	FALSE
4062	M2P1	6	6	4320	0	12.3	3	15.3	0.09	0.1	FALSE	FALSE
4065	M2P2	6.1	6.1	5184	0.5	0.6	3.6	4.2	0.05	0.6	FALSE	FALSE
4071	M2J2	6.4	6.4	432	1	0.6	0.3	0.9	0.02	1	FALSE	FALSE
4079	M1A3	6.4	6.4	2160	-0.1	198	1.5	199.5	0.34	0.3	FALSE	FALSE
4082	M1O1	5.5	5.5	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4090	M1Q1	5.4	5.4	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4097	M1HH1	5.6	5.6	2592	3.5	0.6	1.8	2.4	0.04	3.5	FALSE	FALSE
4103	M1BB1	6.3	6.3	0	2.4	3.6	0	3.6	0.04	2.4	FALSE	FALSE
4106	M1KK1	6.8	6.8	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
4111	M1BB3	5.9	5.9	432	3.9	0.3	0.3	0.6	0.02	3.9	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4115	M1CC1	6.3	6.3	432	3.5	0.6	0.3	0.9	0.02	3.5	FALSE	FALSE
4121	M1EE1	6.2	6.2	432	2.9	0.6	0.3	0.9	0.02	2.9	FALSE	FALSE
4127	M1A8	6.4	6.4	1296	1.9	186.9	0.9	187.8	0.29	2.2	FALSE	FALSE
4148	M1U2	5.8	5.8	432	3.6	0.3	0.3	0.6	0.02	3.6	FALSE	FALSE
4152	M1V1	6.4	6.4	864	3	0.6	0.6	1.2	0.03	3	FALSE	FALSE
4158	M1S1	6.2	6.2	0	1.8	3	0	3	0.04	1.8	FALSE	FALSE
4161	M1S2	5.7	5.7	864	2.5	0.6	0.6	1.2	0.03	2.5	FALSE	FALSE
4168	M1M1	5.3	5.3	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4174	M1K1	5.1	5.1	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4180	M1D1	7	7	3024	-0.2	19.5	2.1	21.6	0.11	-0.1	FALSE	FALSE
4183	M1D3	6.4	6.4	432	3	0.3	0.3	0.6	0.02	3	FALSE	FALSE
4196	M34A15	4	4	3402	3.3	0.263	2.363	2.625	0.04	3.3	FALSE	FALSE
4199	M29A4	4.7	4.7	2268	1.1	0.315	1.575	1.89	0.03	1.1	FALSE	FALSE
4203	M29B3	4.6	4.6	1814.4	2	0.315	1.26	1.575	0.03	2	FALSE	FALSE
4206	M30A7	3.7	3.7	0	2.8	1.26	0	1.26	0.03	2.8	FALSE	FALSE
4217	M25A3	4.2	4.2	0	0.2	17.13	0	17.127	0.09	0.3	FALSE	FALSE
4239	M7C2	8.6	8.6	14580	-0.1	92.86	10.13	102.99	0.24	0.1	FALSE	FALSE
4268	M14F3	8.3	8.3	12312	3	0	8.55	8.55	0.07	3.1	FALSE	FALSE
4280	M17A4	9.5	9.5	0	-6.3	405.5	0	405.47	0.59	-5.8	FALSE	FALSE
4283	M17A5	8.4	8.4	0	-5.7	405.5	0	405.47	0.52	-5.2	FALSE	FALSE
4314	M18D1	5.2	5.2	1360.8	3.2	0	0.945	0.945	0.03	3.2	FALSE	FALSE
4384	M32B1	6.3	6.3	13356	2	8.699	9.275	17.974	0.08	2.1	FALSE	FALSE
4416	M30A2	3.6	3.6	1814.4	-0.2	11.66	1.26	12.915	0.08	-0.1	FALSE	FALSE
4452	M38A7	6.3	6.3	0	-0.5	1.715	0	1.715	0.03	-0.5	FALSE	FALSE
4476	M4A1	7.5	7.5	17628	0.1	32.29	12.24	44.529	0.16	0.3	FALSE	FALSE

EXHIBIT D.3
FORCE MAIN DATA TABLE REPORT

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3880	O1L42FB2	PMP-42a	O1L42J1		25	6.4	2	0.013	111.61	111.61	11.4	10	114%	6.74
3494	O2L19FB2	PMP-19B	O1L34J2	Steel	342	8.2	8	0.013	1747.5	1747.5	11.15	10	112%	28.55
3495	O2L19F2	O1L34J2	O2L19J1	Steel	49	6.8	8	0.013	1747.5	1747.5	11.15	10	112%	4.09
3508	O2L19F1	O2L19J1	O2L34J2	Ductile Iron		20.7	8	0.012	1747.5	1747.5	11.15	10	112%	1.06
3489	O2L34F1	O1L34J1	O-2	Ductile Iron		17.4	12	0.012	3723.9	3723.9	10.56	10	106%	0.5
3507	O2L34F2	O2L34J2	O1L34J1	Ductile Iron		23.9	12	0.012	3552.1	3552.1	10.08	10	101%	0.63
1744	O2L31FA2	PMP-31A	O2L31J2	Steel	77	8	3	0.013	201.26	201.26	9.13	10	91%	26.91
3919	O2L45FA2	PMP-45a	O2L45J2	PVC	25	7.6	2	0.01	86.238	86.238	8.81	10	88%	4.18
3921	O2L45F2	O2L45J1	O2L45J2	PVC		39.6	2	0.01	-86.238	-86.238	8.81	10	88%	6.62
3720	O2L18A-F1	O2L18AJ1	M18C9	PVC		71.5	2	0.01	75.334	75.334	7.69	10	77%	9.31
3650	O2L36F2	O2L36J2	O2L36J1	Ductile Iron		585.8	8	0.013	1194.8	1194.8	7.63	10	76%	14.88
3652	O2L36F1	M34A1	O2L36J1	Ductile Iron		48	8	0.012	-1194.8	-1194.8	7.63	10	76%	1.22
527	O2L34FA2	PMP-34A	O2L34J6	Ductile Iron	154	11.3	8	0.012	1150.9	1150.9	7.35	10	74%	3.65
2455	O2L34F5	O2L34J5	O2L34J4	Ductile Iron		2007	8	0.012	1150.9	1150.9	7.35	10	74%	47.56
3624	O2L34F6	O2L34J6	O2L34J5	Ductile Iron		46.9	8	0.012	1150.9	1150.9	7.35	10	74%	1.11
1296	O2L26F1	O2L26J1	M22A4	PVC		142.1	3	0.01	159.28	159.28	7.23	10	72%	10.27
1792	O2L26FB2	PMP-26B	O2L26J1	Steel	79	10.1	3	0.013	159.28	159.28	7.23	10	72%	9.28
446	O2L6FA2	PMP-6A	O2L6J1		74	6.9	3	0.013	153.95	153.95	6.99	10	70%	5.02
3077	O2L16FA2	PMP-16A	O2L16J2	Ductile Iron	77	7.6	4	0.012	269.04	269.04	6.87	10	69%	10.94
3739	O2L16F2	O2L16J2	O2L16J1	PVC		363.9	4	0.01	269.04	269.04	6.87	10	69%	17.1
3811	O2L32F1	O2L32J1	M34A3	PVC		681.8	4	0.01	268.71	268.71	6.86	10	69%	31.97
474	O1L14FA1	PMP-14A	O1L14J3	Steel	134	7.5	6	0.013	547.15	547.15	6.21	10	62%	5.29
3606	O1L14FA2	W-14	PMP-14A	Ductile Iron	44	7.8	6	0.012	547.15	547.15	6.21	10	62%	1.07
4399	O2L47F2	O2L47J2	O2L47J1	PVC		13.6	2	0.01	56.842	56.842	5.8	10	58%	1.05
4410	O2L47FB1	PMP-47B	O2L47J2	PVC	40	7.3	2	0.01	56.842	56.842	5.8	10	58%	3.09
3942	O2L33F2	O2L33J2	O2L33J1	PVC		32.6	2	0.01	56.531	56.531	5.77	10	58%	2.49
3944	O2L33FA2	PMP-33A	O2L33J2	Steel	70	5.9	2	0.013	56.531	56.531	5.77	10	58%	8.7
3821	O2L7FA2	PMP-7A	O2L7J2	Ductile Iron	104	7.6	4	0.012	213.42	213.42	5.45	10	55%	3.18
3825	O2L7F2	O2L7J2	O2L7J1	PVC		31.1	4	0.01	213.42	213.42	5.45	10	55%	0.95

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3927	O2L46FA2	PMP-46a	O2L46J1	PVC	25	6.3	2	0.01	53.324	53.324	5.45	10	55%	1.72
3932	O2L46F1	O2L46J1	M18A-A8	PVC		213.3	2	0.01	53.324	53.324	5.45	10	55%	14.64
3587	O2L44F2	O1L44J2	O1L44J1	PVC		124.3	2	0.01	52.785	52.785	5.39	10	54%	8.37
3695	O2L44FA2	PMP-44a	O1L44J2	PVC	25	7.1	2	0.01	52.785	52.785	5.39	10	54%	1.68
217	O2L11F1	O2L11J1	O2L10J2	PVC		477.6	6	0.01	455.24	455.24	5.17	10	52%	8.25
477	O2L10F2	O2L10J2	O2L10J1	PVC		613.4	6	0.01	455.24	455.24	5.17	10	52%	10.59
3964	O2L10F1	O2L10J1	O2L36J3	Ductile Iron		287.1	6	0.012	455.24	455.24	5.17	10	52%	4.96
3664	O2L31F2	O2L31J2	O2L31J1	PVC		1088.2	4	0.01	201.26	201.26	5.14	10	51%	29.87
3506	O2L34F3	O2L34J3	O2L34J2	Ductile Iron		21.1	12	0.012	1804.6	1804.6	5.12	10	51%	0.16
3089	O2L29FA2	PMP-29A	O2L29J2	Steel	78	11.7	3	0.013	104.88	104.88	4.76	10	48%	7.74
3095	O2L29F2	O2L29J2	O2L29J1	PVC		12.7	3	0.01	104.88	104.88	4.76	10	48%	0.42
1691	O2L22A2	PMP-22A	O2L22J2	Steel	113	7.5	4	0.013	183.34	183.34	4.68	10	47%	4.24
3716	O2L22F1	O2L22J2	O2L22J1	PVC		973.6	4	0.013	183.34	183.34	4.68	10	47%	22.48
216	O2L12F1	O2L12J1	O2L11J1	PVC		333.4	6	0.01	409.22	409.22	4.64	10	46%	4.73
4402	O2L47F1	O2L47J1	M34A11	PVC		559.7	3	0.01	100.64	100.64	4.57	10	46%	17.28
3725	O2L18F4	O2L18J3	O2L18J2	Ductile Iron		170.7	3	0.012	97.859	97.859	4.44	10	44%	5.01
163	O2L18F1	O2L18J1	O2L36J2	Ductile Iron		130.4	8	0.012	689.45	689.45	4.4	10	44%	1.2
3730	O2L18F3	O2L18J2	O2L18J1	Cast iron		1013.7	8	0.012	689.45	689.45	4.4	10	44%	13.04
3527	O2L35FA2	PMP-35A	O2L35J2	Steel	90	6.9	4	0.013	171.8	171.8	4.39	10	44%	3
3529	O2L35F2	O2L35J2	O2L35J1	PVC		9.4	4	0.01	171.8	171.8	4.39	10	44%	0.19
3536	O2L35F1	O2L35J1	O1L34J1	PVC		2583.6	4	0.01	171.8	171.8	4.39	10	44%	52.9
3975	O1L43FA1	PMP-43a	O1L43J1	PVC	25	7.5	2	0.01	42.611	42.611	4.35	10	44%	1.13
3978	O1L43F1	O1L43J1	M37A4	PVC		533.5	2	0.01	42.611	42.611	4.35	10	44%	24.17
4470	O2L48F1	O2L48J1	M36I1	PVC		570.6	2	0.01	41.077	41.077	4.19	10	42%	24.15
1798	O1LS14F1	O1L14J1	O-1	PVC		10.5	10	0.01	1019.9	1019.9	4.17	10	42%	0.07
423	O2L2F1	O2L2J1	M3J1	Asbestos Cement		569.4	4	0.011	161.96	161.96	4.13	10	41%	12.47
3865	O2L2FA2	PMP-2A	O2L2J1	Ductile Iron	112	10.6	4	0.012	161.96	161.96	4.13	10	41%	2.06
390	O2L23FB2	PMP-23B	O2L23F1	Steel	84	8.2	3	0.013	89.097	89.097	4.04	10	40%	3.37
3979	O2L22F1	O2L22J1	O2L34J3	Ductile Iron		348.7	8	0.012	619.27	619.27	3.95	10	40%	2.62

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3830	O2L6F1	O2L6J1	M1A9	PVC		631.6	4	0.01	153.95	153.95	3.93	10	39%	10.55
464	O1L17FB2	W-17	PMP-17B	Steel	21.1	9.5	6	0.013	333.17	333.17	3.78	10	38%	0.33
3728	O2L1F1	O2L1J1	O2L18J2	Cast iron		255.1	8	0.012	591.6	591.6	3.78	10	38%	2.47
427	O2L25FA2	PMP-25A	O2L25J1	Ductile Iron	84	10.6	3	0.012	82.961	82.961	3.77	10	38%	1.81
3827	O2L25F1	O2L25J1	M7C3	PVC		626.2	3	0.01	82.961	82.961	3.77	10	38%	13.52
511	O2F32FB1	W-32	PMP-32B	Ductile Iron	16.1	9.7	4	0.012	142.69	142.69	3.64	10	36%	0.23
3913	O2L32FB2	PMP-32B	O2L32J2	Ductile Iron	101	6.8	4	0.012	142.69	142.69	3.64	10	36%	1.47
3998	O2L32F2	O2L32J2	O2L32J1	PVC		521.1	4	0.01	142.69	142.69	3.64	10	36%	7.56
2443	O1L14F2	O1L14J2	O1L14J1	PVC		1384.7	10	0.01	880.32	880.32	3.6	10	36%	6.74
3482	O1L40FA1	PMP-40a	O1L40J1	Ductile Iron	70	13.3	4	0.012	139.62	139.62	3.56	10	36%	0.98
3955	O1L40F1	O1L14J1	O1L40J1	Cast iron		1155.4	4	0.012	-139.62	-139.62	3.56	10	36%	22.6
409	O2L1FA2	PMP-1A	O2L1J2	Ductile Iron	10	6.4	4	0.012	137.79	137.79	3.52	10	35%	20.12
3873	O2L1F2	O2L1J2	O2L1J1	PVC		347.6	4	0.012	137.79	137.79	3.52	10	35%	4.73
3586	O2L38F1	O2L38J1	M35A1	PVC		1300	6	0.01	309.12	309.12	3.51	10	35%	10.96
3882	O2L38FA2	PMP-38a	O2L38J1	Steel	100	6.2	6	0.013	309.12	309.12	3.51	10	35%	1.37
3753	O1L14F3	O1L14J3	O1L14J2	Ductile Iron		14.8	8	0.012	547.15	547.15	3.49	10	35%	0.09
1669	O2L45F1	O2L45J1	O2L12J1	PVC		161.3	6	0.01	302.14	302.14	3.43	10	34%	1.3
434	O2L18A-FB2	PMP-18A-b	O2L18AJ1	Steel	66	8.2	3	0.013	75.334	75.334	3.42	10	34%	1.94
3835	O2L5F2	O2L5J2	O2L5J1	Asbestos Cement		693.6	4	0.011	132.9	132.9	3.39	10	34%	10.76
3841	O2L5F1	O2L5J1	M3F3	Asbestos Cement		90.1	4	0.011	132.9	132.9	3.39	10	34%	1.37
3747	O2L15F2	O2L15J2	O2L15J1	PVC		27.2	3	0.01	74.29	74.29	3.37	10	34%	0.48
3749	O2L15FA2	PMP-15A	O2L15J2	Ductile Iron	78	6	3	0.012	74.29	74.29	3.37	10	34%	1.37
1813	O2L34F4	O2L34J4	O2L34J3	PVC		2328.2	12	0.01	1185.3	1185.3	3.36	10	34%	8.08
3968	O2L36F3	O2L36J2	O2L36J3	Ductile Iron		1431.2	8	0.012	-505.32	-505.32	3.23	10	32%	7.39
3809	O2L9FA1	W-9	PMP-9A	Cast iron	27	8	4	0.012	126.02	126.02	3.22	10	32%	0.44
3810	O2L9FA2	PMP-9A	O2L9J1	Cast iron	76	6.1	4	0.012	126.02	126.02	3.22	10	32%	1.23
3815	O2L9F1	O2L9J1	O2L32J1	Ductile Iron		555	4	0.012	126.02	126.02	3.22	10	32%	6.4
489	O2L4F5	O2L4J5	O2L4J4	Ductile Iron		30.3	4	0.012	124.51	124.51	3.18	10	32%	0.34
3085	O2L4FA2	PMP-4A	O2L4J5	Ductile Iron	105	7.3	4	0.012	124.51	124.51	3.18	10	32%	1.18

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3851	O2L4F4	O2L4J4	O2L4J3	Asbestos Cement		752.6	4	0.011	124.51	124.51	3.18	10	32%	10.12
3854	O2L4F3	O2L4J3	O2L4J2	Asbestos Cement		1169.3	4	0.011	124.51	124.51	3.18	10	32%	15.73
3856	O2L4F2	O2L4J2	O2L4J1	Asbestos Cement		374.9	4	0.011	124.51	124.51	3.18	10	32%	5.04
3858	O2L4F1	O2L4J1	O2L5J2	Asbestos Cement		42	4	0.011	124.51	124.51	3.18	10	32%	0.57
1490	O2L39F1	O2L39J1	M35A1	PVC		751.7	2	0.01	29.869	29.869	3.05	10	31%	17.64
3890	O2L39FA2	PMP-39a	O2L39J1	Ductile Iron	25	9	2	0.012	29.869	29.869	3.05	10	31%	0.59
199	O2L7F1	O2L1J1	O2L7J1	Cast iron		671.6	8	0.012	-453.81	-453.81	2.9	10	29%	2.84
1140	O1L42F1	O1L42J1	M14C1	Ductile Iron		1075.3	4	0.012	111.61	111.61	2.85	10	29%	9.9
3603	O2L16F1	O2L16J1	O2L41J1	Ductile Iron		496.3	8	0.013	435.92	435.92	2.78	10	28%	1.95
3604	O2L41F1	O2L41J1	O2L22J1	Ductile Iron		785.4	8	0.013	435.92	435.92	2.78	10	28%	3.08
3775	O2L12FB2	PMP-12B	O2L12J2	PVC	90	7.2	4	0.01	107.08	107.08	2.73	10	27%	0.77
3778	O2L12F2	O2L12J2	O2L12J1	PVC		30.5	4	0.01	107.08	107.08	2.73	10	27%	0.26
3864	O2L24F1	O2L24J1	O2L7J1	Asbestos Cement		561.1	6	0.011	240.39	240.39	2.73	10	27%	3.54
3672	O2L29F1	O2L29J1	M34A11	Ductile Iron		604.4	4	0.012	104.88	104.88	2.68	10	27%	4.96
395	O2L3FA2	PMP-3A	O2L3J2	Ductile Iron	98	6.9	4	0.012	104.48	104.48	2.67	10	27%	1.9
4048	O2L3F2	O2L3J1	O2L3J2	Cast iron		1248	4	0.012	-104.48	-104.48	2.67	10	27%	14.27
1668	O2L33F1	O2L33J1	O2L45J1	PVC		820.9	6	0.01	215.9	215.9	2.45	10	25%	3.56
143	O2L18AFB2	PMP-18B	O2L18J3	Ductile Iron	66	10.5	3	0.01	51.242	51.242	2.33	10	23%	0.58
3711	O2L23F1	O2L23F1	O2L24J1	PVC		474	4	0.01	89.097	89.097	2.27	10	23%	2.88
3451	O1L37F1	M14D4	O1L37J1	PVC		61.8	4	0.01	-88.302	-88.302	2.25	10	23%	0.37
3452	O1L37FA1	PMP-37a	O1L37J1	Steel	78	8.8	4	0.013	88.302	88.302	2.25	10	23%	0.76
466	O1L17FB1	PMP-17B	O1L17J4		155	8.3	8	0.012	333.17	333.17	2.13	10	21%	0.37
468	O1L17F3	O1L17J4	O1L17J3	Steel		7.9	8	0.013	333.17	333.17	2.13	10	21%	0.03
2441	O1L17F1	O1L17J1	O1L14J2	Ductile Iron		255.7	8	0.012	333.17	333.17	2.13	10	21%	0.61
2460	O1L17F2	O1L17J1	O1L17J2	Ductile Iron		1095.9	8	0.012	-333.17	-333.17	2.13	10	21%	2.61
2462	O1L17F2	O1L17J2	O1L17J3	PVC		1271	8	0.01	-333.17	-333.17	2.13	10	21%	3.03
393	O2L24FA2	PMP-24A	O2L24J2	Steel	84	8.3	3	0.013	46.812	46.812	2.12	10	21%	1.02
3708	O2L24F2	O2L24J2	O2L24J1	PVC		542.3	3	0.01	46.812	46.812	2.12	10	21%	4.06
407	O2L18A-FA2	PMP-18A	O2L18J3	Steel	66	10.8	3	0.013	46.617	46.617	2.12	10	21%	0.8

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3785	O2L11FA2	PMP-11A	O2L11J1	Ductile Iron	77	5.9	3	0.012	46.023	46.023	2.09	10	21%	0.56
3788	O2L11F2	O2L11J1	O2L11J1	Ductile Iron		41.5	3	0.012	46.023	46.023	2.09	10	21%	0.3
1783	O2L30FA2	PMP-30A	O2L30J1	PVC	77	8.8	3	0.01	43.798	43.798	1.99	10	20%	1.12
3659	O2L30F1	O2L30J1	O2L47J1	PVC		413.1	3	0.01	43.798	43.798	1.99	10	20%	2.73
4472	O2L48FA2	PMP-48A	O2L48J1	PVC	70	6.2	3	0.01	41.077	41.077	1.86	10	19%	0.41
214	O2L15F1	O2L15J1	O2L33J1	PVC		1180.6	6	0.01	159.37	159.37	1.81	10	18%	2.92
3486	O2L19FB1	W-19	PMP-19B	Steel	0.1	7.7	20	0.013	1747.5	1747.5	1.78	10	18%	0
3762	O2L13FA1	W-13	PMP-13A	Ductile Iron	16	7.3	3	0.012	32.293	32.293	1.47	10	15%	0.06
517	O2L36FA2	PMP-36A	O2L36J4	Steel	90	7.2	4	0.013	50.074	50.074	1.28	10	13%	0.31
3614	O2L36F4	O2L36J4	O2L36J3	Ductile Iron		1394.3	4	0.012	50.074	50.074	1.28	10	13%	2.91
3862	O2L3F1	O2L3J1	O2L24J1	Cast iron		2688.9	6	0.012	104.48	104.48	1.19	10	12%	4.27
506	O2L34FA1	W-34	PMP-34A	Ductile Iron	0.1	10.6	20	0.012	1150.9	1150.9	1.18	10	12%	0
3663	O2L31F1	O2L31J1	O2L16J1	Ductile Iron		653.2	8	0.012	166.88	166.88	1.07	10	11%	0.43
213	O2L13F1	O2L13J1	O2L15J1			584.2	6	0.013	85.077	85.077	0.97	10	10%	0.54
3764	O2L13FA2	PMP-13A	O2L13J2	Ductile Iron	69	8.5	4	0.012	32.293	32.293	0.82	10	8%	0.06
3767	O2L13F2	O2L13J2	O2L13J1	Ductile Iron		24.7	4	0.012	32.293	32.293	0.82	10	8%	0.02
212	O2L44F1	O1L44J1	O2L13J1	PVC		1303.2	6	0.01	52.785	52.785	0.6	10	6%	0.42
3881	O2L38FA1	W-38	PMP-38a	Steel	0.1	7.5	20	0.013	309.12	309.12	0.32	10	3%	0
3081	O2L16FA1	W-16	PMP-16A	Steel	1	8	20	0.013	269.04	269.04	0.27	10	3%	0
3662	O2L19F1	O2L34J4	O2L31J1	Cast iron		48.8	8	0.013	-34.375	-34.375	0.22	10	2%	0
3819	O2L7FA1	W-7	PMP-7A	Ductile Iron	1.1	7.1	20	0.012	213.42	213.42	0.22	10	2%	0
3925	O2L46FA1	W-46	PMP-46a	PVC	0.1	7.6	10	0.01	53.324	53.324	0.22	10	2%	0
3694	O2L44FA1	W-44	PMP-44a	PVC	0.1	8.1	10	0.01	52.785	52.785	0.22	10	2%	0
3832	O2L5FA2	PMP-5A	O2L5J3	Ductile Iron	93	6.7	4	0.012	8.3964	8.3964	0.21	10	2%	0.01
3834	O2L5F3	O2L5J3	O2L5J2	Ductile Iron		16.9	4	0.012	8.3964	8.3964	0.21	10	2%	0
1743	O2L31FA1	W-31	PMP-31A	Ductile Iron	0.1	8.6	20	0.012	201.26	201.26	0.21	10	2%	0
1690	02L23FA1	W-23	PMP-22A	Ductile Iron	1	8.7	20	0.012	183.34	183.34	0.19	10	2%	0
3525	O2L35FA1	W-35	PMP-35A	Steel	0.1	7.2	20	0.013	171.8	171.8	0.18	10	2%	0
417	O2L2FA1	W-2	PMP-2A	Steel	0.1	8.7	20	0.013	161.96	161.96	0.17	10	2%	0

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
1791	O2L26FB1	W-26	PMP-26B	PVC	0.1	7.7	20	0.01	159.28	159.28	0.16	10	2%	0
445	O2L6FA1	W-6	PMP-6A	Ductile Iron	0.1	7.5	20	0.012	153.95	153.95	0.16	10	2%	0
3481	O1L40FA2	W-40	PMP-40a	PVC	0.1	9.8	20	0.01	139.62	139.62	0.14	10	1%	0
3870	O2L1FA1	W-1	PMP-1A	Steel	0.1	7.5	20	0.013	137.79	137.79	0.14	10	1%	0
3849	O2L4FA1	W-4	PMP-4A	Ductile Iron	0.1	8.2	20	0.012	124.51	124.51	0.13	10	1%	0
3879	O1L42FB1	W-42	PMP-42a		1	7	20	0.013	111.61	111.61	0.11	10	1%	0
3773	O2L12FB1	W-12	PMP-12B	Ductile Iron	0.1	9	20	0.012	107.08	107.08	0.11	10	1%	0
3090	O2L29FA1	W-29	PMP-29A	PVC	0.1	11.1	20	0.01	104.88	104.88	0.11	10	1%	0
373	O2L3FA1	W-3	PMP-3A	Ductile Iron	0.1	7.8	20	0.012	104.48	104.48	0.11	10	1%	0
389	O2L23FB1	W-23	PMP-23B	Steel	1	8.2	20	0.013	89.097	89.097	0.09	10	1%	0
3453	O1L37FA2	W-37	PMP-37a	PVC	0.1	9.7	20	0.01	88.302	88.302	0.09	10	1%	0
3918	O2L45FA1	W-45	PMP-45a	PVC	0.1	7.1	20	0.01	86.238	86.238	0.09	10	1%	0
426	O2L25FA1	W-25	PMP-25A	Ductile Iron	0.1	7.7	20	0.012	82.961	82.961	0.08	10	1%	0
432	O2L18A-FA1	W-18A	PMP-18A-b	Steel	0.1	13.2	20	0.013	75.334	75.334	0.08	10	1%	0
3961	O2L15FA1	W-15	PMP-15A	Ductile Iron		7.2	20	0.012	74.29	74.29	0.08	10	1%	0
4405	O2L47FB1	W-47	PMP-47B	PVC	0.1	9.5	20	0.01	56.842	56.842	0.06	10	1%	0
3943	O2L11FA1	W-33	PMP-33A	Ductile Iron	0.1	6.7	20	0.012	56.531	56.531	0.06	10	1%	0
149	O2L18FB1	W-18	PMP-18B	Ductile Iron	0.1	8.9	20	0.01	51.242	51.242	0.05	10	1%	0
516	O2L36FA1	W-36	PMP-36A	Steel	0.1	8.2	20	0.013	50.074	50.074	0.05	10	1%	0
392	O2L24FA1	W-24	PMP-24A	PVC	0.1	9.1	20	0.01	46.812	46.812	0.05	10	1%	0
406	O2L18FA1	W-18	PMP-18A	Steel	0.1	8.8	20	0.013	46.617	46.617	0.05	10	1%	0
3783	O2L11FA1	W-11	PMP-11A	Ductile Iron	0.1	8.4	20	0.012	46.023	46.023	0.05	10	1%	0
1782	O2L30FA1	W-30	PMP-30A	Cast iron	0.1	8	20	0.012	43.798	43.798	0.04	10	0%	0
3974	O1L43FA2	W-35	PMP-43a	PVC	0.1	7.6	20	0.01	42.611	42.611	0.04	10	0%	0
4471	O2L48FA1	W-48	PMP-48A	PVC	0.1	8.1	20	0.01	41.077	41.077	0.04	10	0%	0
3889	O2L39FA1	W-39	PMP-39a	PVC	0.1	8.2	20	0.01	29.869	29.869	0.03	10	0%	0
3831	O2L5FA1	W-5	PMP-5A	Ductile Iron	0.1	7.6	20	0.012	8.3964	8.3964	0.01	10	0%	0
3605	O2L41F2	O2L41J2	O2L41J1			192.7	1.3	0.013	-0.00012	-0.00012	0	10	0%	0
3899	O2L41FA2	PMP-41a	O2L41J2	PVC	25	7	2	0.01	-0.00012	-0.00012	0	10	0%	0

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3797	O2L10F3	O2L10J3	O2L10J2	Ductile Iron		37.5	3	0.012	-1.95E-05	-1.95E-05	0	10	0%	0
2437	NA	O2L4J4	na			163.1	4	0.011	3.19E-05	3.19E-05	0	10	0%	0
3898	O2L41FA1	W-41	PMP-41a	PVC	0.1	7.2	20	0.01	-0.00012	-0.00012	0	10	0%	0
2433	NA	M3F3	na			97.3	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
2435	NA	na	na			126.6	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
3793	O2L10FA1	W-10	PMP-10A	Ductile Iron	0.1	8.3	20	0.012	-1.61E-05	-1.61E-05	0	10	0%	0
3795	O2L10FA2	PMP-10A	O2L10J3	Ductile Iron	99	6.6	3	0.012	0	0	0	10	0%	0
142	O2L24FB1	W-24	PMP-24B	Ductile Iron	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
150	O2L25FB2	PMP-25B	O2L25J1	Ductile Iron	84	9.2	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
151	O2L24FB2	PMP-24B	O2L24J2	Steel	84	7.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
152	O2L22FB1	W-23	PMP-22B	Ductile Iron	1	7.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
165	O1L17FA2	W-17	PMP-17A	Steel	21.1	6.7	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
166	O2L22FB2	PMP-22B	O2L22J2	Ductile Iron	112	7.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
168	O1L14FB2	W-14	PMP-14B	Ductile Iron	44	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
170	O2L34FC1	W-34	PMP-34C	Ductile Iron	0.1	6.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
177	O2L36FB1	W-36	PMP-36B	Ductile Iron	0.1	9.2	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
184	O2L36FB2	PMP-36B	O2L36J4	Ductile Iron	90	7.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
374	O2L3FB1	W-3	PMP-3B	Ductile Iron	0.1	8.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
386	O2L23FA1	W-23	PMP-23A	Steel	1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
387	O2L23FA2	PMP-23A	O2L23F1	Steel	84	9	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
394	O2L3FB2	PMP-3B	O2L3J2	Ductile Iron	98	8.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
401	O2L1FB2	PMP-1B	O2L1J2	Ductile Iron	10	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
413	O2L2FB1	W-2	PMP-2B	Steel	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
415	O2L2FB2	PMP-2B	O2L2J1	Ductile Iron	112	9.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
435	O2L18A-FA2	PMP-18A-a	O2L18AJ1	Steel	66	8.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
436	O2L18A-FA1	PMP-18A-a	W-18A	Steel	0.1	8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
443	O2L6FB2	PMP-6B	O2L6J1	PVC	74	6.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
444	O2L6FB1	W-6	PMP-6B	Ductile Iron	0.1	7	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
467	O1L17FA1	PMP-17A	O1L17J4	Steel	155	8.3	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
473	O1L14FB1	PMP-14B	O1L14J3	Steel	134	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
486	O2L4FB2	PMP4B	O2L4J5	Ductile Iron	105	6.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
487	O2L4FB1	W-4	PMP4B	Ductile Iron	0.1	8.5	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
492	O2L5FB1	W-5	PMP-5B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
494	O2L5FB2	PMP-5B	O2L5J3	Ductile Iron	93	5.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
513	O2F32FA1	W-32	PMP-32A	Ductile Iron	16.1	9.8	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
514	O2L32FA2	PMP-32A	O2L32J2	Ductile Iron	101	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
526	O2L34FC2	PMP-34C	O2L34J6	Ductile Iron	154	7.8	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1693	O2L34FB1	W-34	PMP-34B	Ductile Iron	0.1	8.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1694	O2L34FB2	PMP-34B	O2L34J6	Ductile Iron	154	9.4	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1745	O2L31FB2	PMP-31B	O2L31J2	Steel	77	9.6	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1746	O2L31FB1	W-31	PMP-31B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1784	O2L30FB2	PMP-30B	O2L30J1	PVC	77	8.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1785	O2L30FB1	W-30	PMP-30B	Cast iron	0.1	7.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1793	O2L26FA2	PMP-26A	O2L26J1	Steel	79	6.1	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1794	O2L26FA1	W-26	PMP-26A	PVC	1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2454	NA	J-97	na			612.3	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2466	NA	na	J-97			2074.5	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3078	O2L16FB2	PMP-16B	O2L16J2	Ductile Iron	77	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3082	O2L16FB1	W-16	PMP-16B	Steel	1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3086	O2L29FB1	W-29	PMP-29B	PVC	0.1	10	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3088	O2L29FB2	PMP-29B	O2L29J2	PVC	78	11.7	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3454	O1L37FB1	PMP-37b	O1L37J1	Ductile Iron	78	6.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3455	O1L37FB2	W-37	PMP-37b		0.1	8.8	10	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3483	O1L40FB2	W-40	PMP-40b	PVC	0.1	12.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3484	O1L40FB1	PMP-40b	O1L40J1	Ductile Iron	70	10	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3487	O2L19FA1	W-19	PMP-19A	Steel	0.1	7.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3493	O2L19FA2	PMP-19A	O1L34J2	Steel	341	8.5	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3566	O2L38FB1	W-38	PMP-38b	Steel	0.1	8.3	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3568	O2L38FB2	PMP-38b	O2L38J1	Steel	100	7.3	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3651	O2L34BYEPA	O2L36J1	O2L34J5	Ductile Iron		15.2	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3696	O2L44FB1	W-44	PMP-44b	PVC	0.1	8.3	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3697	O2L44FB2	PMP-44b	O1L44J2		25	6.8	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3744	O2L15FB2	PMP-15B	O2L15J2	Ductile Iron	78	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3768	O2L13FB1	W-13	PMP-13B	Ductile Iron	16	9.1	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3769	O2L13FB2	PMP-13B	O2L13J2	Ductile Iron	69	9.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3779	O2L12FA1	W-12	PMP-12A	Ductile Iron	0.1	8.2	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3780	O2L12FA2	PMP-12A	O2L12J2	Ductile Iron	90	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3789	O2L11FB1	W-11	PMP-11B	Ductile Iron	0.1	8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3790	O2L11FB2	PMP-11B	O2L11J1	Ductile Iron	77	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3799	O2L10FB1	W-10	PMP-10B	Ductile Iron	0.1	5.6	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3800	O2L10FB2	PMP-10B	O2L10J3	Ductile Iron	99	7.5	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3803	O2L9FB2	PMP-9B	O2L9J1	Ductile Iron	76	5.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3808	O2L9FB1	W-9	PMP-9B	Cast iron	27	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3817	O2L7FB1	W-7	PMP-7B	Ductile Iron	0.1	7.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3823	O2L7FB2	PMP-7B	O2L7J2	Ductile Iron	104	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3869	O2L1FB1	W-1	PMP-1B	Steel	0.1	7.2	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3877	O1L42FA1	W-42	PMP-42b		0.1	8.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3878	O1L42FA2	PMP-42b	O1L42J1		25	7.7	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3887	O2L39FB1	W-39	PMP-39b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3888	O2L39FB2	PMP-39b	O2L39J1	Ductile Iron	25	8.3	2	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3891	O2L35FB2	W-35	PMP-35B	Steel	0.1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3892	O2L35FB2	PMP-35B	O2L35J2	Steel	90	6.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3896	O2L41FB1	W-41	PMP-41b	PVC	0.1	6.9	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3897	O2L41FB2	PMP-41b	O2L41J2	PVC	25	7	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3916	O2L45FB1	W-45	PMP-45b		0.1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3917	O2L45FB2	PMP-45b	O2L45J2	PVC	25	7.4	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3933	O2L46FB1	W-46	PMP-46b	PVC	0.1	8.1	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3934	O2L46FB2	PMP-46b	O2L46J1		25	6.2	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3937	O2L33FB1	W-33	PMP-33B	Ductile Iron	0.1	6.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3939	O2L33FB2	PMP-33B	O2L33J2	Steel	70	5.8	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3960	O2L15FB1	W-15	PMP-15B	Ductile Iron		7.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3972	O1L14FB2	W-35	PMP-43b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3973	O1L14FB1	PMP-43b	O1L43J1	PVC	25	7.3	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4408	O2L47FA1	W-47	PMP-47A	PVC	0.1	9.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4409	O2L47FA2	PMP-47A	O2L47J2	PVC	40	6.2	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4462	O2L48FB1	W-48	PMP-48B	PVC	0.1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4464	O2L48FB2	PMP-48B	O2L48J1	PVC	70	7.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

EXHIBIT D.4
PRESSURE NODE DATA TABLE REPORT

Model Pressure Node Data Table 2025 Existing Conditions
Exhibit D4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
1341	O1L14J1	6.7	3.5	58.1	24	54.6		921853.18	600253.72	TRUE
2432	O1L14J2	6.4	0	64.8	28	64.8		920948.59	600723.96	TRUE
472	O1L14J3	6.4	8	64.9	25	56.9		920955.16	600715.27	TRUE
127	O1L17J1	6	5.3	65.4	26	60.2		920692.99	600715.98	TRUE
2461	O1L17J2	6.8	4	68	28	64		920723	599620.53	TRUE
87	O1L17J3	7.9	5	71.1	29	66.1		920698	598426.1	TRUE
465	O1L17J4	7	5	71.1	29	66.1		920705.89	598426.09	TRUE
2428	O1L34J1	8	5	23.5	8	18.5		927366.12	604992.24	TRUE
3492	O1L34J2	6.8	4.8	29.3	11	24.5		927390.3	604966.61	TRUE
3445	O1L37J1	6	3	3.5	0	0.5		919806.96	599800.73	TRUE
1337	O1L40J1	7.7	4	80.7	33	76.7		921532.85	599443.59	TRUE
1132	O1L42J1	5.8	3	7.6	2	4.6		919732.18	600929.27	TRUE
3588	O1L43J1	7.1	5	23.9	8	18.9		919610.41	600547.6	TRUE
116	O1L44J1	6.8	5.3	55.9	22	50.7		921909.68	600337.73	TRUE
1678	O1L44J2	6.2	0	64.3	28	64.3		921913.59	600458.39	TRUE
88	O2L10J1	8	4	23.6	8	19.6		927114.51	600739.53	TRUE
136	O2L10J2	7.8	5	34.2	13	29.2		926523.21	600750.87	TRUE
3794	O2L10J3	8.7	6.5	34.2	12	27.7		926513.68	600783.24	TRUE
135	O2L11J1	7.9	5.5	42.4	16	36.9		926045.89	600735.78	TRUE
3784	O2L11J1	10.5	8.5	42.7	15	34.2		926041.8	600777.04	TRUE
134	O2L12J1	8.1	6	47.2	18	41.2		925712.64	600726.09	TRUE
3774	O2L12J2	8.2	6.2	47.4	18	41.2		925711.36	600756.56	TRUE
131	O2L13J1	6.1	3	55.5	23	52.5		922967.26	600629.79	TRUE
3763	O2L13J2	6.2	4.2	55.5	22	51.3		922961.39	600653.77	TRUE
132	O2L15J1	6.8	4	55	22	51		923551.18	600648.88	TRUE
3743	O2L15J2	7	5	55.4	22	50.4		923546.24	600675.67	TRUE
107	O2L16J1	4.7	2.5	32	13	29.5		928422.75	604385.66	TRUE
2407	O2L16J2	6.7	4	49	19	45		928763.58	604418.47	TRUE
433	O2L18AJ1	4.7	2.5	12.9	4	10.4		928854.97	600361.74	TRUE
93	O2L18J1	7.7	4	12.5	4	8.5		928569.18	600970.36	TRUE

Model Pressure Node Data Table 2025 Existing Conditions
Exhibit D4

3726	O2L18J2	4.9	2.9	25.5	10	22.6		928608.77	599957.47	TRUE
126	O2L18J3	5.7	3	30.5	12	27.5		928767.45	599971.15	TRUE
3504	O2L19J1	8.3	7.8	25.2	8	17.4		927390.21	604973.37	TRUE
104	O2L1J1	6	4	28	10	24		928617.92	599702.49	TRUE
398	O2L1J2	6.6	4	32.7	12	28.7		928285.14	599671.66	TRUE
105	O2L22J1	6.9	4	26.9	10	22.9		927748.42	604998.77	TRUE
106	O2L22J2	5.5	3	49.4	20	46.4		927483.96	604307.21	TRUE
118	O2L23F1	4.3	1.2	37.2	16	36		929940.07	600105.19	TRUE
97	O2L24J1	6.9	4	34.4	13	30.4		929844.61	599734.74	TRUE
102	O2L24J2	5.4	3	38.4	15	35.4		929700.1	600158.28	TRUE
101	O2L25J1	4.5	2.7	14.5	5	11.8		929283.22	600655.84	TRUE
1790	O2L26J1	5.6	3.6	12.1	4	8.5		927480.33	603912.05	TRUE
2416	O2L29J1	4.5	2	6.8	2	4.8		929271.35	603049.66	TRUE
3087	O2L29J2	4.5	2	7.2	2	5.2		929284.01	603049.29	TRUE
414	O2L2J1	5.8	3.3	15.8	5	12.5		928996	598338.88	TRUE
1781	O2L30J1	3.1	1	21.8	9	20.8		929239.57	603452.81	TRUE
3661	O2L31J1	4.8	2.5	32.4	13	29.9		928446.71	603732.88	TRUE
1742	O2L31J2	6.6	4	62.3	25	58.3		929288.83	604013.67	TRUE
100	O2L32J1	5.7	4	27.9	10	23.9		928486.55	602372.06	TRUE
125	O2L32J2	5.3	4	35.5	14	31.5		927974.57	602351.14	TRUE
133	O2L33J1	8.3	6	52	20	46		924731.1	600689.88	TRUE
3938	O2L33J2	9.2	6	54.5	21	48.5		924723.91	600721.68	TRUE
3505	O2L34J2	8.1	4.6	24.1	8	19.6		927389.97	604994.04	TRUE
3498	O2L34J3	8.4	3.8	24.3	9	20.5		927411.01	604994.99	TRUE
1810	O2L34J4	4.8	4	32.4	12	28.4		928447.42	603684.11	TRUE
120	O2L34J5	5.9	2	79.9	34	77.9		928527.32	601678.68	TRUE
525	O2L34J6	5.9	10.1	81.1	31	70.9		928480.51	601676.24	TRUE
3528	O2L35J1	5.9	3	76.4	32	73.4		925402.48	604500.5	TRUE
3526	O2L35J2	0	0	76.6	33	76.6		925402.8	604509.91	TRUE
3649	O2L36J1	6	4	-3.6	-3	-7.6		928527.66	601663.48	TRUE
91	O2L36J2	7.4	5	11.3	3	6.3		928541.4	601077.86	TRUE
90	O2L36J3	8.9	4	18.6	6	14.6		927111.29	601021.17	TRUE
89	O2L36J4	6.1	4	21.6	8	17.6		926952.73	602311.3	TRUE
3567	O2L38J1	6.5	3.5	10.2	3	6.7		925476.79	603270.8	TRUE

Model Pressure Node Data Table 2025 Existing Conditions
Exhibit D4

1482	O2L39J1	6.5	4	16.5	5	12.5		925456.86	603835.44	TRUE
4047	O2L3J1	6.9	5	38.6	15	33.6		929945.67	597047.95	TRUE
124	O2L3J2	6.4	5	52.9	21	47.9		928698.06	597016.74	TRUE
3602	O2L41J1	5.5	4	30	11	26		928396.68	604881.25	TRUE
1639	O2L41J2	6.4	4	30	11	26		928579.21	604893.45	TRUE
1667	O2L45J1	8.1	6	48.5	18	42.5		925551.4	600721.93	TRUE
1670	O2L45J2	9.4	7.4	55.1	21	47.7		925547.33	600761.31	TRUE
3926	O2L46J1	6.6	3	16.9	6	13.9		928915.95	600879.36	TRUE
4400	O2L47J1	2.2	1.4	19.1	8	17.7		928837.69	603432.35	TRUE
4396	O2L47J2	5	3	20.1	7	17.1		928830.59	603426.03	TRUE
4463	O2L48J1	0	0	25.8	11	25.8		926212.08	601305.88	TRUE
3855	O2L4J1	6.3	4.3	16.2	5	11.9		927327.5	597718.21	TRUE
3853	O2L4J2	6.2	4.2	21.3	7	17.1		927318.45	598092.97	TRUE
3850	O2L4J3	5.8	3.8	37	14	33.2		927280.07	599261.59	TRUE
488	O2L4J4	7	5	47.1	18	42.1		927253.84	600013.72	TRUE
484	O2L4J5	7.6	6	47.5	18	41.5		927276.73	600022.08	TRUE
3838	O2L5J1	6	4	4.9	0	0.9		927367.89	597001.13	TRUE
3857	O2L5J2	6.3	4	15.7	5	11.7		927330.85	597676.29	TRUE
493	O2L5J3	6.3	4.8	15.7	5	10.8		927336.66	597692.12	TRUE
442	O2L6J1	6.3	4	13.9	4	9.9		928475.95	600682.36	TRUE
95	O2L7J1	6.6	4	30.8	12	26.8		929283.52	599729.39	TRUE
3820	O2L7J2	6.9	4.9	31.8	12	26.9		929290.49	599699.06	TRUE
3802	O2L9J1	6.5	3.5	34.3	13	30.8		928210.32	602646.01	TRUE
2434	na	0	0	3.5	2	3.5		927359.5	596967.77	TRUE
2436	na	0	0	3.5	2	3.5		927353.71	597094.23	TRUE
2438	na	0	0	47.1	20	47.1		927262.9	599779.52	TRUE

EXHIBIT D.5.
PUMP DATA TABLE REPORT

Model Pump Data Table 2025 Existing Conditions
Exhibit D5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
63	PMP-1A	TRUE	6.7	-3.8	Pump Definition - LS1	137.79	54.6	-1.8	52.8
396	PMP-1B	FALSE	6.7	-3.8	Pump Definition - LS1	(N/A)	(N/A)	(N/A)	(N/A)
412	PMP-2A	TRUE	6.3	-4.7	Pump Definition - LS2	161.96	21.5	-3.7	17.9
411	PMP-2B	FALSE	6.4	-4.7	Pump Definition - LS2	(N/A)	(N/A)	(N/A)	(N/A)
365	PMP-3A	TRUE	6.4	-2.9	Pump Definition - LS3	104.48	56.7	-1.9	54.8
62	PMP-3B	FALSE	6.4	-2.9	Pump Definition - LS3	(N/A)	(N/A)	(N/A)	(N/A)
481	PMP-4A	TRUE	7.6	-3.6	Pump Definition - LS4	124.51	50.2	-1.6	48.6
491	PMP-5A	TRUE	6	-6.2	Pump Definition - LS5	8.3964	19.8	-4.2	15.7
490	PMP-5B	FALSE	6	-6.2	Pump Definition - LS5	(N/A)	(N/A)	(N/A)	(N/A)
440	PMP-6A	TRUE	6.5	-2.9	Pump Definition - LS6	153.95	20.3	-1.4	18.9
441	PMP-6B	FALSE	6.5	-2.9	Pump Definition - LS6	(N/A)	(N/A)	(N/A)	(N/A)
453	PMP-7A	TRUE	6.8	-5.4	Pump Definition - LS7	213.42	38.3	-3.4	34.9
60	PMP-7B	FALSE	6.8	-5.4	Pump Definition - LS7	(N/A)	(N/A)	(N/A)	(N/A)
3801	PMP-9A	TRUE	6	3.5	Pump Definition - LS9	126.02	37	-1.4	35.6
51	PMP-9B	FALSE	6	3.5	Pump Definition - LS9	(N/A)	(N/A)	(N/A)	(N/A)
3791	PMP-10A	TRUE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	-1.93E-05	26	3.9	29.9
3792	PMP-10B	FALSE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3781	PMP-11A	TRUE	10.5	3	Pump Definition - LS11	46.023	33.8	9.5	43.3
3782	PMP-11B	FALSE	10.5	3	Pump Definition - LS11	(N/A)	(N/A)	(N/A)	(N/A)
3772	PMP-12A	FALSE	8.7	2.5	Pump Definition - LS12	(N/A)	(N/A)	(N/A)	(N/A)
3771	PMP-12B	TRUE	8.7	2.5	Pump Definition - LS12	107.08	40.2	8	48.2
3760	PMP-13A	TRUE	6.7	4.7	Pump Definition - LS13	32.293	53.4	2.1	55.6
3761	PMP-13B	FALSE	6.7	4.7	Pump Definition - LS13	(N/A)	(N/A)	(N/A)	(N/A)
469	PMP-14A	TRUE	6.4	8	Pump Definition - LS14	547.15	74.8	-4.7	70.2
48	PMP-14B	FALSE	6.4	8	Pump Definition - LS14	(N/A)	(N/A)	(N/A)	(N/A)
3741	PMP-15A	TRUE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	74.29	54.3	2.5	56.8
3740	PMP-15B	FALSE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
2476	PMP-16A	TRUE	5.9	-6.3	Pump Definition - LS16	269.04	64.3	-4.3	60
2481	PMP-16B	FALSE	5.9	-6.3	Pump Definition - LS16	(N/A)	(N/A)	(N/A)	(N/A)

Model Pump Data Table 2025 Existing Conditions
Exhibit D5

49	PMP-17A	FALSE	7	9	Pump Definition - LS17	(N/A)	(N/A)	(N/A)	(N/A)
463	PMP-17B	TRUE	7.5	9	Pump Definition - LS17	333.17	82.8	-11.3	71.5
405	PMP-18A	TRUE	5.7	-5	Pump Definition - LS18	46.617	30.3	1	31.3
431	PMP-18A-a	FALSE	6.1	-3.5	Pump Definition - LS18a	(N/A)	(N/A)	(N/A)	(N/A)
430	PMP-18A-b	TRUE	6.1	-3.5	Pump Definition - LS18a	75.334	15.8	-1	14.8
61	PMP-18B	TRUE	5.7	-5	Pump Definition - LS18	51.242	30.1	1	31.1
539	PMP-19A	FALSE	6.8	-4.1	Pump Definition - LS19	(N/A)	(N/A)	(N/A)	(N/A)
53	PMP-19B	TRUE	6.8	-2.5	Pump Definition - LS19	1747.5	59.9	-2.1	57.8
1689	PMP-22A	TRUE	5.4	-9.7	Pump Definition - LS22	183.34	60.8	-7.2	53.6
52	PMP-22B	FALSE	5.9	-9.7	Pump Definition - LS22	(N/A)	(N/A)	(N/A)	(N/A)
59	PMP-23A	FALSE	4.5	-5.9	Pump Definition - LS23	(N/A)	(N/A)	(N/A)	(N/A)
388	PMP-23B	TRUE	-5.9	-5.9	Pump Definition - LS23	89.097	44	-3.4	40.6
391	PMP-24A	TRUE	5.6	-3.4	Pump Definition - LS24	46.812	40.3	-0.9	39.4
58	PMP-24B	FALSE	5.6	-3.4	Pump Definition - LS24	(N/A)	(N/A)	(N/A)	(N/A)
425	PMP-25A	TRUE	5.1	-5.4	Pump Definition - LS24-LS25	82.961	19.2	-2.9	16.3
57	PMP-25B	FALSE	5.1	-5.4	Pump Definition - LS24-LS25	(N/A)	(N/A)	(N/A)	(N/A)
1788	PMP-26A	FALSE	5.6	-4.2	Pump Definition - LS26	(N/A)	(N/A)	(N/A)	(N/A)
1789	PMP-26B	TRUE	5.6	-4.2	Pump Definition - LS26	159.28	25.2	-3.8	21.4
2479	PMP-29A	TRUE	4.4	-4.9	Pump Definition - LS29	104.88	18.9	-3.9	15
2480	PMP-29B	FALSE	3.5	-4.9	Pump Definition - LS29	(N/A)	(N/A)	(N/A)	(N/A)
1779	PMP-30A	TRUE	4.1	-5	Pump Definition - LS30	43.798	25.4	-2.5	22.9
1780	PMP-30B	FALSE	4.1	-5	Pump Definition - LS30	(N/A)	(N/A)	(N/A)	(N/A)
1740	PMP-31A	TRUE	6.2	-8	Pump Definition - LS31	201.26	95.7	-6.6	89.2
1741	PMP-31B	FALSE	6.2	-8	Pump Definition - LS31	(N/A)	(N/A)	(N/A)	(N/A)
508	PMP-32A	FALSE	8	10	Pump Definition - LS32	(N/A)	(N/A)	(N/A)	(N/A)
50	PMP-32B	TRUE	8	10	Pump Definition - LS32	142.69	42.3	-5.3	37
3935	PMP-33A	TRUE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	56.531	60.2	3	63.2
3936	PMP-33B	FALSE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
505	PMP-34A	TRUE	6.9	-10.5	Pump Definition - LS34	1150.9	90.7	-6	84.7
1692	PMP-34B	FALSE	6.9	-10.5	Pump Definition - LS34	(N/A)	(N/A)	(N/A)	(N/A)
56	PMP-34C	FALSE	6.9	-10.5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
3522	PMP-35A	TRUE	6	-5	Pump Definition - LS35	171.8	81	-1.4	79.6
3521	PMP-35B	FALSE	6	-5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
515	PMP-36A	TRUE	6.7	-8.5	Pump Definition - LS36	50.074	27.4	-5.5	21.9

Model Pump Data Table 2025 Existing Conditions
Exhibit D5

64	PMP-36B	FALSE	7.5	-8.5	Pump Definition - LS36	(N/A)	(N/A)	(N/A)	(N/A)
3443	PMP-37a	TRUE	6.3	-7	Pump Definition - LS37	88.302	8.9	-4.7	4.3
3444	PMP-37b	FALSE	6.5	-7	Pump Definition - LS37	(N/A)	(N/A)	(N/A)	(N/A)
3565	PMP-38a	TRUE	6.5	-15.4	Pump Definition - LS38	309.12	21.7	-10.2	11.5
3564	PMP-38b	FALSE	6.5	-15.4	Pump Definition - LS38	(N/A)	(N/A)	(N/A)	(N/A)
3886	PMP-39a	TRUE	6	-5	Pump Definition - LS39	29.869	15.1	2	17.1
3885	PMP-39b	FALSE	6	-5	Pump Definition - LS39	(N/A)	(N/A)	(N/A)	(N/A)
3479	PMP-40a	TRUE	8	5	Pump Definition - LS40	139.62	86.6	-5	81.6
3480	PMP-40b	FALSE	8	5	Pump Definition - LS40	(N/A)	(N/A)	(N/A)	(N/A)
3895	PMP-41a	TRUE	6.5	0	Pump Definition - LS10-LS42-LS43 Privite	0	0	4	30
3894	PMP-41b	FALSE	0	6.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3875	PMP-42a	TRUE	5	0	Pump Definition - LS10-LS42-LS43 Privite	111.61	11.8	2.5	14.3
3876	PMP-42b	FALSE	5	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3970	PMP-43a	TRUE	9.4	1	Pump Definition - LS10-LS42-LS43 Privite	42.611	21	4	25
3971	PMP-43b	FALSE	7.4	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3693	PMP-44a	TRUE	6.8	0.5	Pump Definition - LS15-LS33-LS44-LS45	52.785	61.5	4.5	66
3692	PMP-44b	FALSE	6.7	0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
3915	PMP-45a	TRUE	9.3	3.5	Pump Definition - LS15-LS33-LS44-LS45	86.238	50.3	9	59.3
3914	PMP-45b	FALSE	9.3	3.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3923	PMP-46a	TRUE	6.5	-3	Pump Definition - LS10-LS42-LS43 Privite	53.324	19.7	-1	18.7
3924	PMP-46b	FALSE	6.3	-3	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4407	PMP-47A	FALSE	5	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4404	PMP-47B	TRUE	5	1	Pump Definition - LS10-LS42-LS43 Privite	56.842	19.2	4	23.2
4460	PMP-48A	TRUE	0	0	Pump Definition - LS10-LS42-LS43 Privite	41.077	21.2	5	26.2
4461	PMP-48B	FALSE	0	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
482	PMP4B	FALSE	7.6	-3.6	Pump Definition - LS4	(N/A)	(N/A)	(N/A)	(N/A)

EXHIBIT D.6
OUTFALL DATA TABLE REPORT

Model Outfall Data Table 2025 Existing Conditions
Exhibt D6

ID	Label	Elev (Grd) (ft)	Elev (Invt) (ft)	Boundary Condition Type	Elev (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Flow (Total Out) (gpm)	Notes
1797	O-1	6.8	3.5	User Defined Tailwater	58	58	1019.9	Measured 58 ft of Head or 25 psi at 12:00 PM Tuesday in August 2023
3488	O-2	6.5	3.5	User Defined Tailwater	23	23	3723.9	Measured 10 psi or 23 feet of Head on Monday 6/12/2023

EXHIBIT E.1
Gravity Sewer Date Table Report

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
536	O1L14SA2	M14A2	-3.6	M14A1	-4	102.8	0.004	8	0.013	4.22	660.86	346.58	190.7	93.6	Vitrified Clay
1120	O1L14SC1	M14C1	-2.7	M14A2	-3.6	279.4	0.003	8	0.013	3.59	562.74	302.61	186	100	Vitrified Clay
1466	O2L34SA9	M34A9	0.1	M34A8	0	92.2	0.001	8	0.013	1.39	217.91	138.37	157.5	92.2	Vitrified Clay
1517	O2L34SA3	M34A3	-4.4	M34A2	-4.5	34	0.004	8	0.01	4.12	645.2	418.76	154.1	92.2	PVC
1115	O1L14SC2	M14C2	-2.4	M14C1	-2.7	92.4	0.003	8	0.013	2.88	451.14	298.52	151.1	100	Vitrified Clay
1113	O1L14SC3	M14C3	-2.3	M14C2	-2.4	22.4	0.003	8	0.013	2.88	451.14	303.48	148.7	100	Vitrified Clay
998	O2L34SA6	M34A6	-1.9	M34A5	-2.1	77	0.002	8	0.013	2.33	365.33	247.26	147.8	82	Vitrified Clay
1110	O1L14SC4	M14C4	-1.4	M14C3	-2.3	315.6	0.003	8	0.013	2.75	430.62	297.54	144.7	100	Vitrified Clay
1322	O1L17SA10	M17A10	0.6	M17A9	0	160.9	0.004	8	0.013	2.77	434.53	325.59	133.5	100	Vitrified Clay
1323	O1L17SA9	M17A9	0	M17A8	-0.4	88.8	0.005	8	0.013	2.94	460.89	364.07	126.6	86.1	Vitrified Clay
1089	O1L17SA11	M17A11	1.6	M17A10	0.6	245.1	0.004	8	0.013	2.48	388.21	342.94	113.2	100	Vitrified Clay
1353	O2L34SA8	M34A8	0	M34A7	-0.5	319.7	0.002	8	0.013	1.62	239.64	224.95	106.5	75	Vitrified Clay
1108	O1L14SC5	M14C5	-0.4	M14C4	-1.4	315.1	0.003	8	0.013	1.93	302.05	297.81	101.4	100	Vitrified Clay
360	O2L3SA1	M3A1	-1.8	W-3	-1.7	17.9	-0.004	8	0.013	2.32	363.07	362.33	100.2	81.9	
1275	O2L22SA2	M22A2	-0.8	M22A1	-1.4	133.8	0.005	8	0.013	2.71	362.49	372.16	97.4	71.8	Vitrified Clay
1057	O1L17SA2	M17A2	-6.6	M17A1	-7	144.5	0.002	12	0.013	2.5	718.72	775.54	92.7	72.9	Vitrified Clay
3510	O2L35SA1	W-35	-1.4	M35A1	-1.3	20.3	0.005	8	0.01	3.58	452.83	494.45	91.6	73.4	PVC
4001	O1L17SA1	M17A1	-7	W-17	-7.1	39.9	0.003	12	0.013	2.93	824.17	912.44	90.3	64.2	Vitrified Clay
1032	O1L17SA3	M17A3	-6.4	M17A2	-6.6	112	0.002	12	0.013	2.21	593.32	692.29	85.7	73.9	Vitrified Clay
1518	O2L34SA3	M34A4	-3	M34A3	-4.3	313	0.004	8	0.01	3.22	365.33	454.36	80.4	84	PVC
3683	O2L22SA4	M22A3	0.9	M22A4	1.6	180.6	0.004	8	0.013	2.29	244.36	327.87	74.5	59.8	Vitrified Clay
988	O2L34SI1	M34A7	-0.5	M34A6	-1.9	332.4	0.004	8	0.013	2.43	255.24	349.46	73	81.7	Vitrified Clay
1465	O2L34SA10	M34A10	0.8	M34A9	0.1	233.6	0.003	8	0.013	2.06	213.65	296.91	72	80.4	Vitrified Clay
1459	O2L34SA11	M34A11	1.5	M34A10	0.8	233.9	0.003	8	0.013	2.12	213.13	307.09	69.4	62.1	Vitrified Clay
4285	O1L17SA4	M17A5	-5.7	M17A4	-6.3	285.4	0.002	12	0.013	2.29	505.93	751.26	67.3	64	Vitrified Clay
4282	O1L17SA4	M17A4	-6.3	M17A3	-6.4	27.9	0.003	12	0.013	2.53	505.93	856.88	59	70.4	Vitrified Clay
1283	O2L22SA3	M22A3	0.9	M22A2	-0.8	259.4	0.007	8	0.013	2.94	261.37	442.87	59	67.5	
3993	O2L36SB1	M36A1	-5.2	M36B1	-4	279.6	0.004	8	0.01	3	263.87	452.17	58.4	59.8	PVC
4142	O2L1SA5	M1A4	1	M1A5	1.1	43.1	0.004	8	0.013	2.25	193.2	342.52	56.4	53.2	Vitrified Clay
4143	O2L1SA6	M1A5	1.1	M1A6	1.4	72.8	0.004	8	0.013	2.25	192.3	343.57	56	53.6	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
376	O2L3SA2	M3A2	-1.3	M3A1	-1.8	107.4	0.005	8	0.013	2.42	204.57	370.12	55.3	77	Vitrified Clay
4081	O2L1SA4	M1A3	-0.1	M1A4	1	240.7	0.004	8	0.013	2.35	196.2	359.94	54.5	52	Vitrified Clay
733	O2L3SH1	M3H1	-0.1	M3A2	-1.3	318.9	0.004	8	0.013	2.15	178.63	329.9	54.1	53.2	Vitrified Clay
1100	O1L14SD1	M14D1	0.4	M14C5	-0.4	279.3	0.003	8	0.013	1.02	159.55	299.18	53.3	100	Vitrified Clay
646	O2L36SA4	M36A4	-2.2	M36A3	-2.4	220.4	0.001	8	0.01	1.38	112.69	212.41	53.1	45.9	PVC
737	O2L3SH2	M3H2	1.3	M3H1	-0.1	388.5	0.004	8	0.013	2.08	168.66	322.05	52.4	51.9	Vitrified Clay
4136	O2L1SA7	M1A6	1.4	M1A7	1.7	46.6	0.006	8	0.013	2.65	191.4	426.48	44.9	50.2	Vitrified Clay
3863	O2L3SF1	M3A1	-1.8	M3F1	-0.4	341.2	0.004	8	0.013	2.09	139.17	344.92	40.3	72.1	Vitrified Clay
870	O2L1SA2	M1A2	-0.8	M1A1	-1	82.6	0.003	10	0.013	2.16	225.15	558.68	40.3	42.5	Vitrified Clay
3957	O2L3SF3	M3F2	1.5	M3F3	3.2	459.3	0.004	8	0.013	1.99	132.9	329.96	40.3	43.4	Vitrified Clay
1168	O1L14SB2	M14B2	-1.4	M14B1	-1.7	285.5	0.001	8	0.013	1.16	76.633	192.58	39.8	36.6	Vitrified Clay
1124	O1L14SC6	M14C6	0.5	M14C5	-0.4	305.7	0.003	8	0.013	0.75	116.85	299.16	39.1	100	Vitrified Clay
1396	O1L17SB2	M17B1	2.2	M17B2	2.6	99.6	0.004	8	0.01	2.67	173.14	446.82	38.7	92	PVC
1126	O1L14SC7	M14C7	1	M14C6	0.5	170	0.003	8	0.013	0.71	111.15	288.2	38.6	100	Vitrified Clay
1617	O2L3SF2	M3F2	1.5	M3F1	-0.4	437.2	0.004	8	0.013	2.13	136.04	357.52	38.1	43.5	Vitrified Clay
653	O2L36SA2	M36A2	-4.1	M36A1	-5.2	310.1	0.003	8	0.01	2.46	156.76	414.13	37.9	53.7	PVC
1402	O1L17SB4	M17B3	3.6	M17B4	4.2	217.7	0.003	8	0.01	2.19	138.94	370.1	37.5	40.6	PVC
1104	O1L14SD3	M14D3	2.1	M14D2	1.3	284.2	0.003	8	0.013	0.69	108.25	296.6	36.5	100	Vitrified Clay
1106	O1L14SD4	M14D4	2.8	M14D3	2.1	226.8	0.003	8	0.013	0.67	105.4	296.94	35.5	100	Vitrified Clay
4080	O2L2SR2	M1A2	-0.8	M1A3	-0.1	208.8	0.003	10	0.013	2.1	199.5	562.18	35.5	42.6	Vitrified Clay
1324	O1L17SA8	M17A8	-2.1	M17A6	-3.4	159.5	0.008	12	0.013	3.73	505.93	1443.4	35.1	42.8	Vitrified Clay
707	O2L3SJ1	M3J1	3	M3H2	1.3	234.4	0.007	8	0.013	2.71	162.53	465.9	34.9	46.7	Vitrified Clay
1000	O2L34SA5	M34A5	-2.1	M34A4	-3	23.2	0.039	8	0.013	6.17	365.33	1067.6	34.2	66	Vitrified Clay
902	O2L23SB1	M23B1	1.9	M17A1	0.3	399.2	0.004	8	0.035	0.74	43.167	128.33	33.6	31.1	
1398	O1L17SB3	M17B3	3.4	M17B2	2.6	147.7	0.006	8	0.01	3.06	173.14	538.07	32.2	63.7	PVC
419	O2L2SA1	M2A1	-2.1	W-2	-2.2	15.7	0.006	6	0.013	2.03	64.5	200.89	32.1	38.3	Vitrified Clay
651	O2L36SA3	M36A3	-2.4	M36A2	-4.1	354.7	0.005	8	0.01	2.7	148.91	479.4	31.1	41.4	PVC
1404	O1L17SB5	M17B5	4.7	M17B4	4	146.5	0.004	8	0.01	2.55	138.94	454.91	30.5	55.6	PVC
1710	O2L38SA2	M38A2	-7.2	M38A1	-8.8	395.9	0.004	8	0.01	2.47	127.39	449.63	28.3	36.7	PVC
3884	O2L38SA1	M38A1	-8.9	W-38	-9.1	23.9	0.008	8	0.01	3.53	182.2	644.52	28.3	40.5	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1551	O1L17SF1	M17F1	2.8	M17A11	1.6	282.2	0.004	8	0.013	1.96	101.08	358.04	28.2	78.9	Vitrified Clay
683	O2L36SB2	M36B2	-3	M36B1	-4	327.4	0.003	8	0.01	2.16	108.22	397.39	27.2	45.3	PVC
3372	O2L7SC2	M7C2	-0.1	M7C1	-0.9	162.5	0.005	8	0.013	2.06	102.99	380.57	27.1	34.9	Vitrified Clay
1102	O1L14SD2	M14D2	3.2	M14D1	0.4	281.8	0.01	8	0.013	0.91	142.45	533.77	26.7	100	Vitrified Clay
1408	O1L17SB6	M17B6	5.6	M17B5	4.7	229.2	0.004	8	0.01	2.38	116.14	444.28	26.1	36.9	PVC
1156	O1L14SA5	M14A5	-2.4	M14A4	-3.1	172.3	0.004	8	0.013	1.84	88.999	343.16	25.9	97.8	Vitrified Clay
645	O2L36SA5	M36A5	-2	M36A4	-2.2	84.2	0.003	8	0.01	2.2	104.84	413.76	25.3	43	PVC
404	O2L1SA1	M1A1	-1	W-1	-1.2	11	0.012	10	0.013	3.65	270.45	1071.6	25.2	37.8	Vitrified Clay
1088	O1L17A12	M17A12	4	M17A11	3.1	217.3	0.004	8	0.013	1.92	91.2	362.32	25.2	32.7	Vitrified Clay
4010	O2L19SA1	W-9	-0.4	M9A1	-0.3	20.8	0.005	8	0.01	2.56	116.55	488.56	23.9	34.3	PVC
1553	O1L17SF2	M17F2	3.9	M17F1	2.8	296.1	0.004	8	0.013	1.74	78.277	335.02	23.4	45.4	Vitrified Clay
4284	O1L17SA6	M17A6	-3.4	M17A5	-5.7	118.8	0.019	12	0.013	5.12	505.93	2230.1	22.7	52.4	Vitrified Clay
589	O2L7SA2	M7A2	-2	M7A1	-5.5	246.6	0.014	6	0.013	2.76	68.033	300.43	22.6	69.4	Vitrified Clay
3378	O2L7SC3	M7C3	0.7	M7C2	-0.1	139.7	0.006	8	0.013	2.1	91.361	410.39	22.3	33.8	Vitrified Clay
644	O2L36SA6	M36A6	-1.7	M36A5	-2	90.5	0.003	8	0.01	2.05	88.673	399.19	22.2	33.2	PVC
3684	O2L22SA4	M22A4	1.6	M22A5	2.2	112.5	0.005	8	0.013	1.97	85.088	386.07	22	48.1	
569	O2L7SD2	M7D2	1.8	M7D1	1	157	0.005	6	0.013	1.66	39.533	184.22	21.5	33.3	Vitrified Clay
457	O2L7SA1	M7A1	-5.5	W-7	-6.4	7.7	0.116	6	0.013	2.08	183.32	857.64	21.4	100	
524	O2L34SA2	M34A2	-4.6	M34A1	-5.5	25.8	0.036	12	0.012	7.36	694	3269.3	21.2	69.1	Ductile Iron
570	O2L7SD1	M7D1	1	M7A3	-0.6	136.4	0.012	6	0.013	2.43	56.333	272.74	20.7	36.3	Vitrified Clay
3512	O2L35SA2	M35A1	-1.2	M35A2	-0.1	286.5	0.004	8	0.01	2.19	89.89	436.87	20.6	45.6	PVC
4023	O2L5SA1	M5A1	-2.9	W-5	-3	10.6	0.005	6	0.01	2.01	46.17	225.16	20.5	31.2	PVC
1333	O1L40SA5	M40A4	2.7	M40A5	3.7	263.3	0.004	8	0.01	2.17	88.078	434.47	20.3	30.5	PVC
1329	O1L40SA3	M40A2	0.3	M40A3	1.4	286.8	0.004	8	0.01	2.18	88.078	436.66	20.2	30.5	PVC
3103	O2L34SG1	M34G1	3.8	M34F2	0.3	401.3	0.009	6	0.013	2.09	47.493	236.19	20.1	66.1	Vitrified Clay
3514	O2L35SA3	M35A2	0	M35A3	1.5	393.5	0.004	8	0.01	2.13	83.012	433.85	19.1	29.6	PVC
1016	O1L17SM1	M17M1	-0.8	M17A3	-1.3	132	0.004	8	0.01	2.21	85.5	450.98	19	29.8	PVC
1331	O1L40SA4	M40A3	1.5	M40A4	2.7	275	0.004	8	0.01	2.28	88.078	465.75	18.9	30	PVC
1327	O1L40SA2	M40A1	-0.6	M40A2	0.2	190.5	0.004	8	0.01	2.29	88.078	468.18	18.8	33.8	PVC
4128	O2L1SA8	M1A7	1.7	M1A8	1.9	44.8	0.004	12	0.013	2.19	187.8	1007.9	18.6	30.3	

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1555	O1L17SF3	M17F3	4	M17F2	3.9	16.5	0.006	8	0.013	2.06	78.277	421.82	18.6	31.1	Vitrified Clay
912	O2L5SA2	M5A2	-2.7	M5A1	-2.9	53.7	0.005	6	0.01	1.94	41.445	223.47	18.5	30.8	PVC
643	O2L36SA7	M36A7	-0.7	M36A6	-1.7	299.2	0.003	8	0.01	1.92	72.508	395.17	18.3	30.6	PVC
4129	O2L1SA9	M1A8	1.9	M1A9	3	256.4	0.004	12	0.013	2.26	186.3	1056.8	17.6	28.8	
1304	O1L14SC8	M14C8	1.3	M14C7	1	89.7	0.003	8	0.01	0.45	71.25	407.81	17.5	100	PVC
588	O2L7SA3	M7A3	-0.6	M7A2	-2	283.5	0.005	8	0.013	1.82	65.633	379.78	17.3	28.6	Vitrified Clay
3247	O2L18SC9	M18C9	3.4	M18C2	3	99.5	0.004	8	0.01	2.11	75.649	441.38	17.1	28.6	PVC
1502	O2L18ASA5	M18A-A5	0.7	M18A-A	0.2	162.3	0.003	8	0.01	1.88	67.499	395.19	17.1	55.5	PVC
1496	O2L18ASA3	M18A-A3	-0.3	M18A-A	-0.7	102.4	0.004	8	0.01	0.49	76.004	446.05	17	100	PVC
1704	O2L38SA3	M38A3	-5.5	M38A2	-7.2	382.4	0.004	8	0.013	1.69	59.324	358.4	16.6	32.2	
1306	O1L14SC9	M14C9	1.7	M14C8	1.3	115.8	0.004	8	0.01	0.45	71.25	444.4	16	100	PVC
538	O1L14SA4	M14A4	-3.1	M14A3	-2.6	57	-0.008	8	0.01	0.63	98.119	619.43	15.8	100	PVC
1412	O1L17SB7	M17B6	5.3	M17B7	5.7	143.6	0.003	8	0.01	1.69	57	362.66	15.7	50.5	PVC
537	O1L14SA3	M14A3	-2.6	M14A2	-3.6	68.4	0.013	8	0.013	0.63	98.119	628.94	15.6	100	
1500	O2L18ASA4	M18A-A4	0.2	M18A-A	-0.3	112.6	0.004	8	0.01	2.07	69.074	445.71	15.5	91.5	PVC
1172	O1L14SA7	M14A7	-1.6	M14A6	-0.5	131	-0.008	8	0.013	0.49	76.174	492.39	15.5	64.2	Vitrified Clay
3995	O2L36SC2	M36C1	-2	M36C2	-0.5	271.5	0.005	8	0.01	2.41	80.072	522.31	15.3	30.1	PVC
1014	O1L17SM2	M17M2	-0.3	M17M1	-0.8	94.7	0.005	8	0.01	2.26	74.1	491.29	15.1	29	PVC
1012	O1L17SM3	M17M3	0.6	M17M2	-0.3	244	0.004	8	0.01	1.98	62.7	437.59	14.3	26.8	PVC
642	O2L36SA8	M36A8	0.2	M36A7	-0.7	292.1	0.003	8	0.01	1.8	56.344	399.96	14.1	27.2	PVC
1425	O2L32SA1	W-32	-1.6	M32A1	-1.2	120.4	0.004	8	0.01	1.95	59.743	435.71	13.7	25	PVC
1506	O2L18ASA6	M18A-A6	1.2	M18A-A	0.7	121.8	0.004	8	0.01	2.04	61.199	460.67	13.3	26.6	PVC
3643	O2L18ASA2	M18A-A2	-0.7	M18A-A	0.4	95.8	-0.011	8	0.013	0.49	76.004	575.97	13.2	64.1	
3846	O2L4SA3	M4A2	0.3	M4A3	0.7	92.3	0.005	6	0.013	1.34	22.365	171.88	13	23.1	Vitrified Clay
3365	O2L7SC1	M7C1	-0.9	M7A1	-5.5	181.5	0.025	8	0.013	3.77	109.59	864.45	12.7	67.1	Vitrified Clay
3994	O2L36SC1	M36B1	-4	M36C1	-2	190.4	0.011	8	0.01	3.16	90.812	724.35	12.5	43	PVC
3426	O2L36SA1	M36A1	-5.2	W-36	-9	68	0.057	12	0.013	7	473.73	3804.2	12.5	71.6	
568	O2L7SD3	M7D3	2.7	M7D2	1.8	157.5	0.005	6	0.013	1.42	22.733	182.79	12.4	27.6	Vitrified Clay
1512	O2L18ASA8	M18A-A8	2.1	M18A-A	1.7	100.8	0.004	8	0.01	1.95	54.899	449.6	12.2	24	PVC
1377	O1L37SC1	M37A2	-2.8	M37A1	-3.2	98.7	0.004	8	0.01	2.01	56.185	465.32	12.1	23.8	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1510	O2L18ASA7	M18A-A7	1.7	M18A-A	1.2	120	0.004	8	0.01	2	55.844	464.08	12	24.7	PVC
1008	O1L17SM5	M17M5	1.9	M17M4	1	215.3	0.004	8	0.01	1.88	51.3	440.44	11.6	23.1	PVC
1010	O1L17SM4	M17M4	1	M17M3	0.6	105.8	0.004	8	0.01	1.89	51.3	444.2	11.5	24.4	PVC
1448	O2L31SA2	M31A2	-2.3	M31A1	-4	387.1	0.004	8	0.01	1.98	53.693	465.86	11.5	30.1	PVC
1606	O1L17SO1	M17O1	1.7	M17N1	0.1	315.6	0.005	8	0.01	2.11	57	498.88	11.4	28.5	PVC
3713	O2L22SA1	M22A1	-1.4	W-23	-2.2	16.1	0.048	12	0.013	6.58	389.91	3518.3	11.1	31.1	
682	O2L36SB3	M36B3	-0.1	M36B2	-3	325.9	0.009	8	0.01	2.78	73.19	660.47	11.1	31.7	PVC
865	O2L1SE3	M1E3	1.5	M1E2	0.7	171.5	0.005	6	0.013	1.28	18.75	172.65	10.9	22.1	Vitrified Clay
1166	O1L14SB1	M14B1	-1.7	M14A1	-4	304.2	0.007	10	0.013	2.27	91.913	847.57	10.8	46.6	Vitrified Clay
689	O2L36SD2	M36D2	1.9	M36D1	1	353.5	0.003	8	0.013	1.15	29.802	276.67	10.8	19.8	
1072	O1L17SQ1	M17Q2	-3.4	M17Q1	-4	143.7	0.004	8	0.013	0.24	37.05	344.55	10.8	100	Vitrified Clay
924	O2L5SA4	M5A4	-0.7	M5A3	-2.4	308.2	0.005	6	0.013	1.38	19.71	186.47	10.6	22.2	Vitrified Clay
794	O2L2SA2	M2A2	-1.3	M2A1	-2.1	174.8	0.005	8	0.013	1.52	38.7	366.74	10.6	25.6	Vitrified Clay
4012	O2L9SB1	M9A1	-0.3	M9B1	0.5	194.7	0.004	8	0.01	1.87	47.25	452	10.5	28.7	PVC
1128	O1L14SF1	M14F1	1.8	M14C7	1	250.4	0.003	8	0.013	0.2	31.35	302.71	10.4	100	Vitrified Clay
1414	O1L17SB9	M17B9	6.5	M17B7	6.1	98.6	0.004	8	0.01	1.83	45.6	443.5	10.3	21.7	PVC
1702	O2L38SA4	M38A4	-3.8	M38A3	-5.4	393.5	0.004	8	0.01	1.86	46.198	452.36	10.2	21.8	PVC
926	O2L5SA6	M5A6	0.5	M5A4	-0.7	280.1	0.005	6	0.013	1.24	17.19	169.58	10.1	21.7	Vitrified Clay
699	O1L17SL3	M17L3	1.8	M17L2	1.2	152.2	0.004	8	0.01	1.83	45.041	446.39	10.1	21.5	PVC
697	O1L17SL2	M17L2	1.2	M17L1	0.9	75.7	0.004	8	0.01	1.84	45.041	451.18	10	21.5	PVC
1373	O1L37SA3	M37A3	-1.6	M37A2	-2.8	245.7	0.005	8	0.01	1.96	47.831	482.4	9.9	23.3	PVC
532	O1L14SA1	M14A1	-4	W-14	-8.2	6.8	0.617	10	0.013	19.16	752.77	7726.2	9.7	84.9	
1557	O1L17SF4	M17F4	5.2	M17F3	4	350.6	0.003	8	0.013	1.27	29.542	317.28	9.3	24.9	Vitrified Clay
1592	O2L16SA5	M16A5	0.6	M16A4	-0.3	203.9	0.004	8	0.013	1.38	31.711	348.09	9.1	21.7	Vitrified Clay
986	O2L34SF1	M34F1	0.8	M34A6	-0.3	324.1	0.004	12	0.013	1.68	86.002	952.5	9	19.1	
1006	O1L17SM6	M17M6	2.5	M17M5	1.9	150.5	0.004	8	0.01	1.76	39.9	445.1	9	21.7	PVC
1371	O1L37SA4	M37A4	-0.4	M37A3	-1.6	236.2	0.005	8	0.01	1.98	44.699	500.45	8.9	21.9	PVC
4321	O2L18SC1	M18A1	-3.1	M18C1	2.5	150.6	0.037	8	0.013	4.1	92.029	1041.2	8.8	65.6	Vitrified Clay
1712	O2L38SB1	M38A1	-2.9	M38B1	-1.6	300.5	0.004	8	0.01	1.83	40.853	465.5	8.8	20.3	PVC
1196	O1L14SA8	M14A8	-0.6	M14A7	-1.6	247.4	0.004	8	0.013	1.34	29.64	342.71	8.6	82.2	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
928	O2L5SA7	M5A7	1.8	M5A6	0.5	282.1	0.005	6	0.013	1.18	14.67	169.64	8.6	20.7	Vitrified Clay
4475	O2L4SA2	M4A2	0.3	M4A1	0.1	16.8	0.011	6	0.013	1.81	22.365	260.6	8.6	26.5	Vitrified Clay
701	O1L17SL4	M17L4	2.3	M17L3	1.8	130.1	0.004	8	0.01	1.73	37.916	445.75	8.5	20.7	PVC
856	O2L1SJJ1	M1JJ1	1.7	M1D2	0.9	131.3	0.006	6	0.013	1.31	15.9	191.56	8.3	20.3	Vitrified Clay
1586	O2L16SA3	M16A3	-1.4	M16A2	-2.6	24.9	0.045	8	0.013	4.44	95.475	1150.3	8.3	25.7	Vitrified Clay
680	O2L36SI1	M36I1	1.5	M36B3	-0.1	300.2	0.005	8	0.01	1.99	42.6	514.71	8.3	24.4	PVC
1170	O1L14SA6	M14A6	-0.5	M14A5	-2.4	64.2	0.029	8	0.013	3.56	76.174	923.17	8.3	62	Vitrified Clay
659	O2L36SC3	M36C3	3.9	M36C2	-0.5	309.8	0.014	8	0.01	3.24	69.331	843.1	8.2	28	PVC
3278	O2L18SC2	M18C2	3	M18C1	2.5	140.1	0.004	12	0.013	1.75	83.839	1019.8	8.2	20.1	
3429	O2L25SA2	M25A2	-0.4	M25A1	-1	132.9	0.004	8	0.013	1.37	29.097	355.25	8.2	19.7	Vitrified Clay
1198	O1L14SA9	M14A9	0.4	M14A8	-0.6	249.5	0.004	8	0.013	1.31	27.93	342.65	8.2	41.9	Vitrified Clay
4014	O2L9SB2	M9B1	0.5	M9B2	1.5	123	0.008	6	0.01	2.01	23.625	295.15	8	26	PVC
953	O2L4SA4	M4A4	1.2	M4A3	0.7	103.7	0.005	6	0.013	1.15	13.545	169.51	8	21.7	Vitrified Clay
1394	O1L17SB1	M17B1	2.2	M17A11	1.6	20.6	0.03	10	0.01	0.71	173.14	2218.4	7.8	100	PVC
528	O2L34SA1	M34A1	-5.5	W-34	-11.1	5.9	0.953	14	0.012	29.8	1913.6	24545	7.8	87.2	Ductile Iron
1228	O1L14SA10	M14A10	1.2	M14A9	0.4	205.2	0.004	8	0.013	1.3	26.22	342.81	7.6	19	
1031	O1L17SN1	M17N1	0.1	M17A2	-1.9	188.1	0.011	12	0.013	2.77	125.4	1652.8	7.6	20.2	
1319	O1L17SQ4	M17Q4	4.1	M17Q3	3.3	199.6	0.004	8	0.013	1.29	25.65	343.31	7.5	19	Vitrified Clay
1277	O2L22SB1	M22B1	1.2	M22A2	-0.8	70.3	0.028	8	0.01	4.39	86.94	1177.4	7.4	55	PVC
1582	O2L16SB2	M16B2	-1.7	M16B1	-2	109.3	0.003	8	0.013	1.16	22.896	311.19	7.4	17.7	Vitrified Clay
1698	O2L38SA5	M38A4	-3.7	M38A5	-2.1	397.1	0.004	8	0.01	1.68	33.072	450.33	7.3	18.4	PVC
1431	O2L32SB2	M32A2	0.8	M32A1	-1.2	242.9	0.008	8	0.01	2.34	45.938	630.08	7.3	23.4	PVC
3083	O2L16SA1	M16A1	-2.8	W-16	-7.3	31.2	0.145	8	0.013	7	149	2064.8	7.2	70.1	Vitrified Clay
930	O2L5SA8	M5A8	3.1	M5A7	1.8	281.1	0.005	6	0.013	1.11	12.15	169.28	7.2	19	Vitrified Clay
1605	O1L17SO2	M17O2	2.9	M17O1	1.7	258.3	0.005	8	0.01	1.76	34.2	476.53	7.2	21.6	PVC
3516	O2L35SD1	M35A3	1.5	M35D1	2	109.8	0.005	8	0.01	1.78	34.432	480.46	7.2	24.3	PVC
4096	O2L1SA10	M1A9	3	M1A10	4.3	221.4	0.006	8	0.013	1.51	28.75	410.73	7	30.3	Vitrified Clay
1718	O2L16SA2	M16A2	-2.6	M16A1	-2.8	25.6	0.007	12	0.013	2.24	95.475	1378.3	6.9	22.8	
692	O2L36SB4	M36B4	0.5	M36B3	-0.1	188.5	0.003	8	0.01	1.5	28.201	410.79	6.9	22.7	PVC
863	O2L1SK2	M1E4	3	M1E3	1.5	125.9	0.012	6	0.013	1.78	18.75	274.92	6.8	21.1	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
4273	O2L32SC2	M32C1	0	M32C2	1	151.6	0.007	6	0.013	1.32	13.805	204.55	6.7	17.3	Vitrified Clay
1130	O1L14SF2	M14F2	2.5	M14F1	1.8	250.2	0.003	8	0.013	0.13	19.95	296.94	6.7	100	Vitrified Clay
3990	O2L35SA4	M35A3	1.5	M35A4	2.7	270.8	0.004	8	0.01	1.7	31.4	469.34	6.7	23.1	PVC
667	O2L36SG1	M36G1	5	M36C3	3.9	232.8	0.005	8	0.013	1.34	24.739	371.09	6.7	22.2	
1588	O2L16SD1	M16D1	-0.1	M16A3	-1.4	285.7	0.005	8	0.013	1.34	24.462	371.41	6.6	24.6	Vitrified Clay
1433	O2L32SA3	M32A2	0.8	M32A3	1.1	73.4	0.005	8	0.01	1.78	31.068	500.5	6.2	19.9	PVC
793	O2L2SD1	M2D1	-1.7	M2A1	-2.1	55.3	0.007	6	0.013	1.31	12.9	207.87	6.2	27.9	Vitrified Clay
796	O2L2SC1	M2C1	-1.8	M2A1	-2.1	40	0.007	6	0.013	1.28	12.6	203.11	6.2	27.9	Vitrified Clay
1356	O2L16SA6	M16A6	1.1	M16A5	0.6	98.2	0.005	8	0.01	1.82	31.711	512.97	6.2	19.2	PVC
1477	O2L39SA1	W-39	-2	M39A1	-1.6	76	0.005	8	0.01	0.2	31.501	511.59	6.2	100	PVC
1418	O1L17SB10	M17B10	7	M17B9	6.5	112.2	0.004	8	0.012	1.32	22.8	372.14	6.1	19.3	Ductile Iron
869	O2L1SE1	M1E1	-0.3	M1A2	-0.8	104.8	0.005	8	0.013	1.35	23.25	382.92	6.1	35.9	Vitrified Clay
867	O2L1SE2	M1E2	0.7	M1E1	-0.3	210.7	0.004	8	0.013	1.27	21.45	363.06	5.9	16.6	Vitrified Clay
4182	O2L7SB2	M1D1	-0.2	M1A1	-1	175.9	0.005	8	0.013	1.28	21.6	366.44	5.9	33.8	Vitrified Clay
1444	O2L31SA3	M31A3	-0.1	M31A2	-2.3	325.9	0.007	8	0.01	2.03	34.205	581.9	5.9	21.2	PVC
1442	O2L31SA4	M31A4	0.4	M31A3	-0.1	326.6	0.001	8	0.01	0.92	15.54	264.6	5.9	17.6	PVC
703	O1L17SL5	M17L5	3.6	M17L4	2.3	301.8	0.004	8	0.01	1.59	26.516	455.56	5.8	18.2	PVC
911	O2L5SA3	M5A3	-2.4	M5A2	-2.7	54.7	0.005	8	0.01	1.66	27.585	476.76	5.8	19.7	PVC
3198	O2L18SA1	W-18	-5.2	M18A1	-3.1	11.3	0.186	8	0.013	0.86	134.55	2339.4	5.8	100	Vitrified Clay
1522	O2L34SC2	M34C2	-0.3	M34C1	-1	152.4	0.005	8	0.01	1.64	26.396	480.62	5.5	16.7	PVC
4181	O2L7SB2	M1D2	0.9	M1D1	-0.2	268.1	0.004	8	0.013	1.22	19.5	358.58	5.4	16.2	Vitrified Clay
3187	O2L30SE1	M30B2	0	M30B1	-0.5	58.1	0.009	6	0.013	1.41	12.6	233.56	5.4	16.6	Vitrified Clay
976	O2L34SF2	M34F2	1.9	M34F1	-0.8	304.3	0.009	12	0.013	2.23	78.915	1480.9	5.3	58.6	
3193	O2L30SB4	M30B4	1.7	M30B3	1	143.5	0.005	4	0.01	1.05	4.095	77.556	5.3	18.3	PVC
1351	O2L34SL	M34L1	1.6	M34A8	0	389.1	0.004	8	0.013	1.16	18.058	343.39	5.3	51	Vitrified Clay
1714	O2L38SB3	M38B1	-1.6	M38B2	0.1	298.2	0.006	8	0.01	1.77	27.236	527.58	5.2	18.7	PVC
4002	O1L17SQ0	M17Q0	0.6	W-17	-0.1	26.7	0.027	8	0.01	3.86	59.217	1150	5.1	20.2	PVC
1083	O1L17SG1	M17G1	4.8	M17A10	4.1	172.1	0.004	8	0.01	1.49	22.8	446.44	5.1	15.3	PVC
1174	O1L14SM1	M14M1	-0.4	M14A7	-1.6	293.9	0.004	8	0.013	1.15	17.385	343.06	5.1	67.9	Vitrified Clay
1593	O2L16SA4	M16A4	-0.3	M16A3	-1.4	188.8	0.006	12	0.013	1.85	62.92	1253.3	5	18.3	

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
848	O2L1SJJ2	M1JJ2	2.1	M1JJ1	1.7	66.2	0.007	6	0.013	1.21	10.2	203.87	5	17.4	Vitrified Clay
1563	O1L14SH2	M14H2	3.4	M14H1	3	117.6	0.004	8	0.013	0.11	17.1	342.84	5	100	Vitrified Clay
859	O2L1SB1	M1A1	-1	M1B1	-0.4	124.3	0.005	8	0.013	1.24	18.6	375.29	5	33.1	Vitrified Clay
1321	O1L17SQ3	M17Q3	3.3	M17Q2	-3.4	341	0.02	8	0.013	2.51	37.05	759.03	4.9	59.8	Vitrified Clay
4020	O2L5SD2	M5D1	-1	M5D2	-0.8	43.7	0.005	6	0.01	1.3	10.71	221.39	4.8	15	PVC
1055	O1L17ST2	M17T2	-3.3	M17T1	-3.5	39.8	0.004	12	0.013	1.48	48.45	1013.6	4.8	14.1	
1021	O1L17SO3	M17O3	4.1	M17O2	2.9	270.1	0.005	8	0.01	1.57	22.8	477.74	4.8	17.1	PVC
1450	O2L31SB3	M31B2	0.8	M31B1	-0.4	235.1	0.005	8	0.01	1.61	23.338	493.11	4.7	17	PVC
4021	O2L5SD3	M5D2	-0.8	M5D3	0.7	341.9	0.005	6	0.013	0.98	7.875	169	4.7	14.9	Vitrified Clay
3657	O2L31SB1	M31A1	-4	W-31	-9.6	36.6	0.153	8	0.01	8.32	125.43	2756.8	4.5	68.3	PVC
1208	O1L14SS2	M14S2	2.1	M14S1	1	288.3	0.004	8	0.013	1.05	14.82	325.73	4.5	15.2	Vitrified Clay
3992	O2L35SA5	M35A4	2.8	M35A4	3.6	218.5	0.004	8	0.01	1.36	19.14	423.99	4.5	14.2	PVC
1312	O1L14SG1	M14G1	2.4	M14C9	1.7	177.5	0.004	8	0.01	0.13	19.95	442.78	4.5	100	PVC
1696	O2L38SA5	M38A6	-1.1	M38A5	-2	224.6	0.004	8	0.01	1.45	19.946	451.2	4.4	14.3	PVC
1613	O2L3SD1	M3D1	-0.2	M3A1	-1.8	527	0.003	8	0.013	0.96	13.11	296.95	4.4	57.1	Vitrified Clay
1776	O2L30SA4	M30A4	1.4	M30A3	0.6	183.3	0.005	6	0.013	0.98	7.56	171.47	4.4	13.8	Vitrified Clay
3476	O1L40SA1	M40A1	-0.6	W-40	-1.5	10.6	0.085	8	0.01	6.6	90.528	2054.1	4.4	22.9	PVC
1202	O1L14SS1	M14S1	1	M14A7	-1.6	247.7	0.011	8	0.013	1.78	24.368	556.67	4.4	57.9	Vitrified Clay
732	O2L3SL1	M3L1	0.4	M3H1	-0.1	113.6	0.005	6	0.013	0.97	7.41	170.35	4.3	42	Vitrified Clay
661	O2L36SC4	M36C4	5.1	M36C3	3.9	227.5	0.005	8	0.01	1.58	21.482	494.65	4.3	20.9	PVC
4064	O2L2SP1	M2P1	0	M2A2	-1.3	292.9	0.004	8	0.013	1.14	15.3	357.43	4.3	18	Vitrified Clay
1053	O1L17ST3	M17T3	-2.8	M17T2	-3.3	99.7	0.005	12	0.013	1.6	48.45	1132.6	4.3	14.5	
576	O2L7SE1	M7E1	4.9	M7D3	2.7	432.8	0.005	6	0.013	1.02	7.7333	181.57	4.3	18.9	Vitrified Clay
4218	O2L25SA3	M25A2	-0.4	M25A3	0.2	107.7	0.006	8	0.013	1.29	17.127	404.83	4.2	16.7	Vitrified Clay
963	O2L4SA5	M4A5	1.8	M4A4	1.2	122.9	0.005	6	0.013	0.97	7.245	171.5	4.2	16.5	Vitrified Clay
3192	O2L30SF1	M30B3	1	M30B2	0	167.7	0.006	6	0.013	1.1	8.19	194.44	4.2	15.1	Vitrified Clay
137	O1L17SJ1	M17J1	3.7	M17A9	2.6	254	0.004	8	0.013	1.13	14.962	356.87	4.2	13.2	
1567	O1L14SH4	M14H4	4.2	M14H3	3.8	105.9	0.004	8	0.013	0.09	14.25	341.52	4.2	100	Vitrified Clay
3175	O2L30SA2	M30B1	-0.5	M30A1	-0.9	23.9	0.018	6	0.013	1.85	13.545	333.55	4.1	20.1	Vitrified Clay
1706	O2L38SC1	M38A2	-2	M38C1	-0.7	296.3	0.004	12	0.013	1.42	41.003	1030.2	4	13	

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
860	O2L1SB2	M1B1	-0.4	M1B2	1.2	373.3	0.004	8	0.013	1.09	13.8	354.63	3.9	14.3	Vitrified Clay
1612	O2L3SD2	M3D2	0.6	M3D1	-0.2	284.2	0.003	8	0.013	0.89	11.115	287.73	3.9	13.9	Vitrified Clay
735	O2L3SA3	M3A3	0.4	M3A2	-1.3	474.8	0.004	8	0.013	0.99	12.255	321.66	3.8	33.7	Vitrified Clay
1565	O1L14SH3	M14H3	3.8	M14H2	3.4	53.6	0.007	8	0.013	0.11	17.1	450.68	3.8	100	Vitrified Clay
1447	O2L31SB1	M31B1	-0.4	M31A1	-4	231.3	0.015	8	0.01	2.67	32.788	875.9	3.7	27.5	PVC
1025	O1L17SN2	M17N2	3.7	M17N1	0.1	202.6	0.018	8	0.01	2.84	34.2	935.91	3.7	25.7	PVC
1481	O2L39SA2	M39A1	-1.6	M39A2	-0.3	346.5	0.004	8	0.01	0.1	15.75	440.09	3.6	100	PVC
1435	O2L32SA4	M32A4	1.9	M32A3	1.1	179	0.004	8	0.01	1.4	16.517	465.42	3.5	15.4	PVC
3121	O2L29SB1	M29B1	-1	M29A1	-1.6	116	0.005	6	0.01	1.24	8.19	231.48	3.5	16	PVC
1749	O2L31SB3	M31B3	1.7	M31B2	0.8	175	0.005	8	0.01	1.52	17.767	505.55	3.5	14.5	PVC
4451	O2L18SB1	M18A1	-3.1	M18B1	-2.4	108	0.007	8	0.013	0.1	15.435	439.69	3.5	100	Vitrified Clay
1081	O1L17SH1	M17H1	2.6	M17A10	2.3	40.6	0.006	8	0.01	1.65	19.237	553.53	3.5	13.4	PVC
676	O2L36SB6	M36B6	3	M36B5	2.1	238.2	0.004	8	0.01	1.31	14.901	442.9	3.4	12.4	PVC
1210	O1L14SS3	M14S3	2.9	M14S2	2.1	210.9	0.004	8	0.013	0.99	11.115	334.02	3.3	13.5	Vitrified Clay
742	O2L3SA4	M3A4	1.4	M3A3	0.4	285.6	0.004	8	0.013	0.94	10.545	320.92	3.3	12.9	Vitrified Clay
1070	O1L17SQ1	M17Q1	-4	M17Q0	0.6	105.3	-0.043	8	0.013	0.24	37.05	1128.7	3.3	62.5	Vitrified Clay
1716	O2L38SB3	M38B2	0.1	M38B3	1.5	395.4	0.003	8	0.01	1.22	13.618	416.54	3.3	14.6	PVC
786	O2L2SD3	M2D3	1.5	M2D2	0	255.5	0.006	6	0.013	1.01	6.3	192.96	3.3	12.7	Vitrified Clay
3384	O2L25SB2	M25B2	0.9	M25B1	0.3	267.7	0.002	8	0.013	0.79	8.76	269.31	3.3	12.2	Vitrified Clay
1079	O1L17SH2	M17H2	3	M17H1	2.6	95.1	0.005	8	0.01	1.48	16.388	506.06	3.2	13.5	PVC
1308	O1L14SG1	M14C10	2.6	M14C9	1.7	204.6	0.004	8	0.01	0.09	14.25	446.3	3.2	100	PVC
691	O2L36SB5	M36B5	2.1	M36B4	0.5	346.3	0.004	8	0.01	1.36	14.901	467.13	3.2	15	PVC
1796	O2L26SA1	M26A1	-0.1	W-26	-0.3	30.7	0.007	6	0.019	0.72	4.41	139.01	3.2	10.9	
610	O2L2SA4	M2A4	1.5	M2A3	0.3	385.4	0.003	8	0.013	0.88	9.6	302.61	3.2	12.4	Vitrified Clay
1379	O1L37SC1	M37C1	-2.6	M37A1	-3.2	151.6	0.004	8	0.01	1.25	13.574	428.51	3.2	18.2	PVC
1349	O2L34SU1	M34U1	2.6	M34L1	1.6	241.1	0.004	8	0.013	1.02	10.978	351.02	3.1	13.8	Vitrified Clay
705	O1L17SL6	M17L6	4	M17L5	3.6	88.8	0.005	8	0.01	1.4	15.116	484.91	3.1	14.5	PVC
990	O2L34SI1	M34J1	0.1	M34A7	-0.5	104.2	0.006	6	0.013	1	6.0375	194.22	3.1	48.3	Vitrified Clay
3349	O2L25SA4	M25A4	1	M25A3	0.2	124.4	0.006	8	0.01	1.6	17.127	554.7	3.1	13.6	PVC
3390	O2L25SA5	M25A4	1	M25A5	1.5	128.6	0.004	8	0.01	1.28	13.662	443.97	3.1	12.6	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
3392	O2L25SA6	M25A6	1.9	M25A5	1.5	110	0.004	8	0.01	1.26	13.347	435.75	3.1	12	PVC
767	O2L2SA3	M2A3	0.3	M2A2	-1.3	170.1	0.009	8	0.013	1.48	15.6	517.85	3	17.3	Vitrified Clay
1610	O2L3SD3	M3D3	1.5	M3D2	0.6	298.5	0.003	8	0.013	0.85	8.835	299.44	3	12.6	Vitrified Clay
4478	O2L4SG1	M4G1	3	M4A1	0.1	347.6	0.008	6	0.013	1.16	6.7725	230.02	2.9	21.5	Vitrified Clay
567	O2L7SD4	M7D4	4.4	M7D3	2.7	329.2	0.005	6	0.013	0.93	5.4	183.62	2.9	17.8	
932	O2L5SD4	M5D4	2.2	M5D3	0.7	315.1	0.005	6	0.013	0.87	5.04	173.17	2.9	13.2	Vitrified Clay
3518	O2L35SB1	M35A1	-1.3	M35B1	2	326.2	0.01	8	0.01	2.01	20.636	709.15	2.9	44.9	PVC
3358	O2L25SB1	M25B1	0.3	M25A1	-1	149.3	0.008	8	0.013	1.39	14.115	494.2	2.9	16	Vitrified Clay
3195	O2L30SF1	M30F1	1.8	M30B3	1	205.5	0.004	4	0.01	0.77	1.89	69.272	2.7	16.2	PVC
804	O2L2SC2	M2C2	-1.3	M2C1	-1.8	83.4	0.006	6	0.013	0.98	5.4	198.28	2.7	14.1	Vitrified Clay
666	O2L36SG2	M36G2	6	M36G1	5	235.8	0.004	8	0.01	1.26	12.37	454.49	2.7	14.4	PVC
1719	O2L16SB1	M16B1	-2	M16A1	-2.8	114.9	0.006	12	0.013	1.58	34.912	1283.3	2.7	19.1	
3113	O2L29SA2	M29A2	-0.7	M29A1	-1.6	160.7	0.006	8	0.01	1.46	14.175	527.71	2.7	13.1	PVC
595	O2L7SF1	M7F1	4.1	M7D2	1.8	335.2	0.007	6	0.013	1.01	5.4	207.68	2.6	21.3	
3996	O2L36SD1	M36B1	-4	M36D1	1	188.9	0.026	8	0.01	3.13	29.802	1147.1	2.6	36.2	PVC
1406	O1L17SI1	M17I1	4.9	M17B5	4.7	64.3	0.004	8	0.01	1.2	11.4	439.57	2.6	24.9	PVC
4269	O1L14SF3	M14F2	2.5	M14F3	3	132.3	0.004	8	0.013	0.05	8.55	330.07	2.6	100	Vitrified Clay
4418	O2L30SA2	M30A2	-0.2	M30A1	-0.9	85.8	0.009	8	0.013	1.37	12.915	501.36	2.6	14.5	
1416	O1L17SE1	M17E1	7	M17B9	6.5	115	0.004	8	0.01	1.21	11.4	445.98	2.6	16.4	PVC
1004	O1L17SM7	M17M7	3.8	M17M6	2.5	319.4	0.004	8	0.01	1.21	11.4	446.35	2.6	15.7	PVC
1410	O1L17SD1	M17D1	6.2	M17B6	5.6	164.6	0.004	8	0.01	1.21	11.4	446.41	2.6	23.1	PVC
1420	O1L17SB11	M17B11	7.8	M17B10	7	190.4	0.004	8	0.01	1.23	11.4	457.07	2.5	13.8	PVC
842	O2L1SJJ3	M1JJ3	2.7	M1JJ2	2.1	81.2	0.007	6	0.013	0.98	5.1	205.35	2.5	13	Vitrified Clay
637	O2L36SA9	M36A9	1	M36A8	0.2	86.2	0.009	8	0.01	1.81	16.625	670.63	2.5	19.2	PVC
3414	O2L18SA2	M18A2	-2.5	M18A1	-3.1	163.8	0.004	12	0.013	0.07	24.57	991.79	2.5	100	
784	O2L2SD4	M2D4	3	M2D3	1.5	383.8	0.004	6	0.013	0.75	3.9	157.44	2.5	11.6	Vitrified Clay
3419	O2L18SA3	M18A3	-1.6	M18A2	-2.5	255	0.003	8	0.013	0.05	7.875	320.4	2.5	100	Vitrified Clay
709	O2L3SH3	M3H3	1.8	M3H2	1.3	115.2	0.005	6	0.013	0.81	4.135	169.18	2.4	39.7	Vitrified Clay
3179	O2L30SB5	M30B5	2.2	M30B4	1.7	110.8	0.005	6	0.013	0.8	4.095	169.15	2.4	10.6	Vitrified Clay
3331	O2L25SC1	M25C1	0.6	M25A2	-0.4	133.3	0.008	6	0.013	1.05	5.355	221.35	2.4	18.3	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
673	O2L36SF1	M36F1	3	M36D2	1.9	139.7	0.008	8	0.01	1.66	14.901	619.99	2.4	17.2	PVC
1427	O2L32SC1	M32A1	-0.6	M32C1	-0.4	27.1	0.007	8	0.01	1.53	13.805	574.73	2.4	11.3	PVC
1186	O1L14SM3	M14M3	3	M14M2	2.2	209.2	0.004	8	0.013	0.93	8.265	347.74	2.4	10.9	Vitrified Clay
3305	O2L24SA1	M24D1	-0.9	M24A1	-1.6	169.2	0.004	6	0.013	0.75	3.78	159.65	2.4	55.5	Vitrified Clay
1027	O1L17SN3	M17N3	4.7	M17N2	3.7	210.4	0.005	8	0.01	1.28	11.4	483.64	2.4	14.8	PVC
639	O2L36SH2	M36H2	5.1	M36H1	3	229.5	0.009	8	0.01	1.77	15.703	669.54	2.3	14.1	PVC
1230	O1L14SA11	M14A11	2	M14A10	1.2	138.9	0.006	8	0.013	1.1	9.69	415.7	2.3	14.6	Vitrified Clay
3411	O2L18SE1	M18E1	-1.8	M18A2	-2.5	142.4	0.005	8	0.013	0.06	8.82	380.31	2.3	100	Vitrified Clay
663	O2L36SC5	M36C5	6	M36C4	5.1	220.1	0.004	8	0.01	1.22	10.741	463.16	2.3	12.7	PVC
4063	O2L2SR1	M2R1	1.8	M2P1	0	423.6	0.004	8	0.013	0.93	8.1	352.99	2.3	12.3	Vitrified Clay
1029	O1L17SN4	M17N4	5.3	M17N3	4.7	122.5	0.005	8	0.01	1.31	11.4	497.52	2.3	10.6	PVC
1603	O2L38SD1	M38D1	0.1	M38A6	-1	190.5	0.006	8	0.01	1.4	12.154	530.84	2.3	10.8	PVC
4479	O2L4SA1	M4A1	0.1	W-4	-4.6	7.7	0.602	6	0.013	8.39	44.529	1953.9	2.3	65.6	Vitrified Clay
592	O2L7SG1	M7G1	3.9	M7D1	1	328.7	0.009	6	0.013	1.11	5.4	237.34	2.3	22.9	
4018	O2L5SD1	M5A2	-2.7	M5D1	-1	360.5	0.005	8	0.01	1.25	10.71	475.56	2.3	16.5	PVC
1526	O2L34SC4	M34C4	2.9	M34C3	1.7	308.5	0.004	12	0.013	1.17	22.604	1009.7	2.2	10.7	Vitrified Clay
1561	O1L14SH1	M14H1	3	M14D2	1.3	47	0.036	8	0.013	0.15	22.8	1025.4	2.2	100	Vitrified Clay
1537	O2L34SB3	M34B3	2.9	M34B2	2.3	139.3	0.004	8	0.01	1.23	10.427	470.36	2.2	10.3	PVC
1535	O2L34SB2	M34B2	2.3	M34B1	1.7	122.7	0.004	8	0.01	1.23	10.427	471.99	2.2	13.1	PVC
647	O2L36SE1	M36E1	2.2	M36A3	-2.4	311.1	0.015	8	0.01	2.24	18.913	864.78	2.2	27	PVC
4028	O2L3SB1	M3A4	1.4	M3B1	1.9	100.8	0.005	6	0.013	0.78	3.705	170.08	2.2	13.4	Vitrified Clay
4066	O2L2SP2	M2P1	0	M2P2	0.5	91.8	0.006	6	0.013	0.9	4.2	196.19	2.1	14.4	
1463	O2L34SA12	M34A12	1.7	M34A11	1.5	31.8	0.004	8	0.013	0.92	7.6125	359.79	2.1	50.8	Vitrified Clay
1462	O2L34SA13	M34A13	2.1	M34A12	1.7	127.9	0.003	8	0.013	0.8	6.5625	314.43	2.1	25.2	Vitrified Clay
1528	O2L34SC5	M34C5	4.1	M34C4	2.9	308.2	0.004	12	0.013	1.15	21	1010.1	2.1	10.2	Vitrified Clay
1182	O1L14SM2	M14M2	2.2	M14M1	-0.4	216.3	0.012	8	0.013	1.51	12.255	591.62	2.1	23.5	Vitrified Clay
1068	O1L17SQ0	M17T1	-3.5	M17A1	-7	161.1	0.022	12	0.013	2.67	48.45	2353.3	2.1	42	
728	O2L3SL2	M3L2	0.9	M3L1	0.4	83.1	0.005	6	0.013	0.82	3.705	181.11	2	12.1	Vitrified Clay
4387	O2L32SB2	M32B1	2	M32B2	3	272.8	0.004	8	0.01	1.08	8.699	426.9	2	11	PVC
3181	O2L30SB6	M30B6	2.7	M30B5	2.2	91.7	0.005	6	0.013	0.84	3.78	186	2	10.3	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
788	O2L2SD2	M2D2	0	M2D1	-1.7	68.4	0.025	6	0.013	1.8	8.1	398.66	2	14.9	Vitrified Clay
974	O2L34SF2	M34F3	2.7	M34F2	1.9	281.3	0.003	8	0.013	0.77	6.1235	303.34	2	17.8	Vitrified Clay
947	O2L4SB1	M4B1	2.5	M4A3	0.7	377.4	0.005	6	0.013	0.78	3.465	172.94	2	17.1	Vitrified Clay
1214	O1L14SS4	M14S4	3.7	M14S3	2.9	209.4	0.004	8	0.013	0.87	6.84	343.46	2	11.1	Vitrified Clay
3190	O2L30SE1	M30E1	1.5	M30B2	0	205.1	0.007	4	0.01	0.95	1.89	94.953	2	17.5	PVC
798	O2L2SF1	M2F1	0.4	M2C1	-1.8	420.7	0.005	6	0.013	0.81	3.6	182.25	2	13.3	Vitrified Clay
638	O2L36SH1	M36H1	3	M36A8	0.2	96.2	0.029	8	0.01	3.01	23.555	1198.8	2	20.5	PVC
3900	O2L34SA14	M34A13	2.1	M34A14	2.3	50.2	0.003	8	0.013	0.74	5.775	296.44	1.9	9.8	
4417	O2L30SA3	M30A3	0.6	M30A2	-0.2	86.2	0.009	8	0.013	1.25	9.765	501.36	1.9	10.7	
1533	O2L34SD1	M34D1	2.9	M34B1	1.7	285.9	0.004	8	0.01	1.13	8.778	451.03	1.9	12.8	PVC
3136	O2L34SL2	M34L2	2.3	M34L1	1.6	126.4	0.006	6	0.01	1.1	4.8225	248.74	1.9	15.4	PVC
1358	O2L16SA7	M16A7	2.8	M16A6	1.1	397.2	0.004	8	0.01	1.14	8.8737	458.56	1.9	13.9	PVC
3988	O1L37SC1	M14D5	3.5	M14D4	2.8	225.2	0.003	8	0.013	0.04	5.7	298.04	1.9	100	Vitrified Clay
1314	O1L14SG2	M14G2	3.3	M14G1	2.4	203	0.004	8	0.01	0.05	8.55	448.05	1.9	100	PVC
1539	O2L34SB4	M34B4	3.5	M34B3	2.9	146.2	0.004	8	0.01	1.13	8.6771	455.49	1.9	10	PVC
3126	O2L29SB2	M29B2	0	M29B1	-1	152.4	0.007	6	0.01	1.18	5.04	265.2	1.9	11.7	PVC
3225	O2L18SB2	M18B2	-1.6	M18B1	-2.4	137	0.006	8	0.013	0.05	7.875	422.13	1.9	100	Vitrified Clay
821	O2L1SB3	M1B2	1.2	M1B3	2.4	277.1	0.004	8	0.013	0.88	6.6	357.79	1.8	11.5	Vitrified Clay
1531	O2L34SD2	M34D2	3.6	M34D1	2.9	139.4	0.005	8	0.01	1.18	8.778	481.37	1.8	9.6	PVC
378	O2L3SG1	M3G1	0.2	M3A2	-1.3	398.5	0.004	8	0.013	0.81	5.985	330.52	1.8	31.7	Vitrified Clay
3902	O2L13SA1	W-13	2.7	M13A1	3.2	115.4	0.004	8	0.01	1.14	8.33	464.05	1.8	9.2	PVC
1601	O2L38SD2	M38D2	0.7	M38D1	0.2	191.8	0.002	8	0.01	0.83	6.0769	341.53	1.8	8.6	PVC
671	O2L36SD3	M36D3	3	M36D2	1.9	76.5	0.014	8	0.01	2.03	14.901	837.85	1.8	17.2	PVC
967	O2L4SG2	M4G2	5.4	M4G1	3	360.7	0.007	6	0.013	0.88	3.6225	205.41	1.8	10.6	Vitrified Clay
769	O2L2SJ1	M2A3	0.3	M2J1	0.1	127.5	-0.001	8	0.013	0.02	3.3	192.16	1.7	25.2	Vitrified Clay
695	O1L17SL1	M17L1	0.9	M17A8	-2.1	21.4	0.139	8	0.01	6.35	45.041	2631.4	1.7	44.3	PVC
636	O2L36SA10	M36A10	1.4	M36A9	1	88	0.005	8	0.01	1.17	8.3125	487.09	1.7	11.1	PVC
1520	O2L34SC1	M34C1	-1	M34A2	-4.6	374	0.01	12	0.01	2.17	34.417	2030.2	1.7	32	PVC
640	O2L36SH3	M36H3	6	M36H2	5.1	213.5	0.004	8	0.01	1.12	7.8517	465.33	1.7	10.8	PVC
585	O2L7SA4	M7A4	1.3	M7A3	-0.6	364.9	0.005	8	0.013	0.94	6.6	391.35	1.7	18.6	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
757	O2L3SA6	M3A6	2.9	M3A5	1.7	259.6	0.005	6	0.013	0.72	2.85	169.07	1.7	10.2	Vitrified Clay
992	O2L34SJ2	M34K1	1.1	M34J1	0.1	182.5	0.006	6	0.013	0.8	3.15	187.35	1.7	10.5	Vitrified Clay
934	O2L5SD5	M5D5	3.4	M5D4	2.2	254	0.005	6	0.013	0.72	2.835	169.45	1.7	10.4	Vitrified Clay
1569	O1L14SH5	M14H5	5.2	M14H4	4.2	246.4	0.004	8	0.013	0.82	5.7	343.76	1.7	54.5	Vitrified Clay
3418	O2L18ASA4	M18A4	-0.9	M18A3	-1.6	164.1	0.004	8	0.013	0.04	5.67	343.92	1.6	100	Vitrified Clay
4104	O2L1SBB1	M1A7	1.7	M1BB1	2.4	89.8	0.008	6	0.013	0.93	3.6	218.9	1.6	35.8	Vitrified Clay
823	O2L1SB4	M1B3	2.4	M1B4	3.5	154.1	0.007	4	0.013	0.7	1.2	73.532	1.6	13.9	Vitrified Clay
4477	O2L4SH1	M4H1	2.5	M4A1	0.1	404.3	0.006	6	0.013	0.82	3.15	194.02	1.6	20	Vitrified Clay
1037	O1L17ST4	M17T4	1.1	M17T3	-2.8	190.2	0.021	12	0.013	2.41	37.05	2289.8	1.6	12.9	
1590	O2L16SD2	M16D2	2	M16D1	-0.1	279	0.008	8	0.013	1.11	7.5542	470.5	1.6	13.1	Vitrified Clay
1310	O1L14SC11	M14C11	3.1	M14C10	2.6	135.7	0.004	8	0.01	0.05	7.125	444.74	1.6	100	PVC
4009	O2L9SA2	M9A1	-0.3	M9A2	1.1	236.1	0.006	12	0.013	1.29	19.688	1231.2	1.6	16.2	
3981	O2L15SA1	W-15	3.5	M15A1	4.5	266.7	0.004	8	0.01	1.01	6.7375	431.72	1.6	8.5	PVC
894	O2L1SA11	M1A10	5.9	M1A11	6.4	146.8	0.003	8	0.01	0.96	6.25	411.46	1.5	8.3	PVC
1437	O2L32SD1	M32D1	1.4	M32A3	1.1	78.3	0.003	8	0.01	0.93	6.02	398.51	1.5	13.2	PVC
758	O2L3SA5	M3A5	1.7	M3A4	1.4	87.5	0.004	8	0.013	0.75	4.845	322.82	1.5	10.5	Vitrified Clay
3950	O2L29SA3	M29A2	-0.7	M29A3	0.2	149.9	0.006	8	0.01	1.23	7.875	529.4	1.5	10.5	PVC
1524	O2L34SC3	M34C3	1.7	M34C2	-0.3	30.9	0.064	8	0.01	4.12	26.396	1782.6	1.5	12.5	PVC
4153	O2L1SV1	M1U1	2.6	M1V1	3	43.4	0.009	4	0.013	0.76	1.2	81.985	1.5	8.8	Vitrified Clay
711	O2L3SH4	M3H4	2.5	M3H3	1.8	81.3	0.009	4	0.013	0.73	1.14	79.253	1.4	12.3	Vitrified Clay
4159	O2L1SS1	M1A4	1	M1S1	1.8	120.9	0.007	6	0.013	0.85	3	208.66	1.4	39.3	Vitrified Clay
613	O2L2SA5	M2A5	1.9	M2A4	1.5	124.8	0.004	8	0.013	0.77	4.8	336.41	1.4	10.3	Vitrified Clay
3435	O1L37SA1	M37A1	-3.2	W-37	-3.7	8.4	0.056	12	0.01	4.99	69.759	4904.3	1.4	12.4	PVC
1739	O2L16SB3	M16B3	-1.5	M16B2	-1.7	50.3	0.004	12	0.013	1.03	14.321	1008.4	1.4	10.3	
618	O2L3SD4	M3D4	2	M3D3	1.5	115	0.004	8	0.013	0.8	4.845	350.41	1.4	10	Vitrified Clay
4428	O2L16SC1	M16A1	-2.8	M16C1	2.2	437.7	0.011	8	0.013	1.3	7.875	576.76	1.4	24.5	
4057	O2L2ST1	M2R1	1.8	M2T1	2.3	85.8	0.006	6	0.013	0.8	2.7	198.53	1.4	11	Vitrified Clay
4030	O2L3SB2	M3B1	1.9	M3B2	2.8	214	0.005	6	0.013	0.68	2.28	169.53	1.3	9.1	Vitrified Clay
4271	O2L4SG3	M4G2	5.4	M4G3	6.2	100.2	0.008	6	0.013	0.9	2.9925	224.99	1.3	8.7	Vitrified Clay
1542	O2L34SB1	M34B1	1.7	M34A1	-5.5	102.4	0.071	8	0.01	4.2	24.795	1873.1	1.3	58	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1039	O1L17SV1	M17V1	1.8	M17T4	1.1	162.6	0.005	12	0.013	1.07	14.25	1086	1.3	9.9	
4162	O2L1SS2	M1S1	1.8	M1S2	2.5	60.4	0.012	4	0.013	0.82	1.2	91.915	1.3	10.4	Vitrified Clay
1095	O1L17SP2	M17P2	4.1	M17P1	2.9	316.4	0.004	8	0.01	0.98	5.7	441.35	1.3	12.5	PVC
1097	O1L17SP3	M17P3	4.5	M17P2	4.1	90	0.004	8	0.01	0.99	5.7	445.84	1.3	7.9	PVC
3644	O2L18ASA1	M18A-A1	-1	W-18A	-4	21.7	0.139	12	0.013	5.51	76.004	5961.7	1.3	58.4	
980	O2L34SH2	M34H1	-0.2	M34H2	0.9	195.1	0.006	6	0.013	0.74	2.3625	186.95	1.3	67.3	Vitrified Clay
835	O2L1SH3	M1H2	3.3	M1H3	3.6	46.6	0.007	4	0.013	0.64	0.9	71.885	1.3	9.5	Vitrified Clay
1773	O2L30SA5	M30A5	2.2	M30A4	1.4	174.9	0.004	8	0.013	0.77	4.41	355.13	1.2	9.3	Vitrified Clay
1093	O1L17SP1	M17P1	2.9	M17A1	-7	91.4	0.108	8	0.01	5.02	28.5	2316.4	1.2	58.6	PVC
3144	O2L34SL3	M34L3	2.9	M34L2	2.3	91.7	0.006	6	0.01	0.99	3.09	254.72	1.2	9	PVC
4098	O2L1SHH1	M1A9	3	M1HH1	3.5	77.2	0.006	6	0.013	0.77	2.4	198.6	1.2	32.2	Vitrified Clay
4050	O2L2SR3	M2R2	3.2	M2R3	3.7	81.2	0.006	6	0.013	0.77	2.4	198.81	1.2	8	Vitrified Clay
3320	O2L24SA2	M24A2	-1	M24A1	-1.6	142.9	0.004	6	0.013	0.62	1.89	159.05	1.2	61	Vitrified Clay
755	O2L3SA7	M3A7	3.5	M3A6	2.9	148.7	0.005	6	0.013	0.65	1.995	169.06	1.2	8.3	Vitrified Clay
819	O2L1SF1	M1F1	2.5	M1B2	1.2	315.9	0.004	8	0.013	0.76	4.2	356.39	1.2	10.6	Vitrified Clay
806	O2L2SC3	M2C3	0.9	M2C2	-1.3	422.1	0.005	6	0.013	0.7	2.1	182.37	1.2	9.4	Vitrified Clay
800	O2L2SF2	M2F2	2.1	M2F1	0.4	318	0.005	6	0.013	0.69	2.1	183.59	1.1	8.7	Vitrified Clay
649	O2L36SE2	M36E2	6	M36E1	2.2	273.3	0.014	8	0.01	1.76	9.4567	827	1.1	11.9	PVC
1786	O2L30SA1	M30A1	-0.9	W-30	-5.5	19.7	0.23	8	0.013	5.12	29.61	2601.4	1.1	58.7	
581	O2L7SA6	M7A6	4.9	M7A5	3.3	302.5	0.005	6	0.013	0.69	2.1	184.85	1.1	8.7	Vitrified Clay
1046	O1L17ST7	M17T7	2.4	M17T6	2.1	93.7	0.004	12	0.013	0.95	11.4	1004.7	1.1	7.5	
1048	O1L17ST6	M17T6	2.1	M17T5	1.8	68.2	0.004	12	0.013	0.95	11.4	1006.3	1.1	7.3	
3948	O2L10SA1	W-10	4.4	M10A1	5.5	238.1	0.005	6	0.01	0.83	2.4792	222.53	1.1	7.3	PVC
1708	O2L38SC2	M38C1	-0.6	M38C2	1	264.1	0.006	12	0.013	1.18	13.938	1252.3	1.1	7.3	
1400	O1L17SC1	M17C1	3.7	M17B3	3.4	65.6	0.004	12	0.013	0.97	11.4	1025.7	1.1	18.1	
901	O2L23SB2	M23B2	3.5	M23B1	1.9	401.3	0.004	8	0.013	0.72	3.7917	342.43	1.1	23.7	Vitrified Clay
3410	O2L18SE2	M18E2	-0.6	M18E1	-1.8	282.2	0.004	8	0.013	0.02	3.78	343.2	1.1	100	Vitrified Clay
827	O2L1SH1	M1B3	2.4	M1H1	2.9	94.6	0.006	8	0.013	0.86	4.5	409.82	1.1	8.4	Vitrified Clay
584	O2L7SA5	M7A5	3.3	M7A4	1.3	399.6	0.005	8	0.013	0.8	4.2	383.71	1.1	8.2	Vitrified Clay
978	O2L34SH1	M34F1	0.8	M34H1	-0.2	109.3	-0.01	8	0.013	0.04	5.775	530.12	1.1	65.2	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
3984	O1L37SC2	M37C1	-2.6	M37C2	-1.4	255.1	0.005	8	0.01	1.03	5.2208	497.45	1	9.7	PVC
4122	O2L1SEE1	M1BB1	2.4	M1EE1	2.9	49.2	0.01	4	0.013	0.71	0.9	86.119	1	10.3	Vitrified Clay
1049	O1L17ST5	M17T5	1.8	M17T4	1.1	145.9	0.005	12	0.013	1.02	11.4	1107.6	1	9.4	
1232	O1L14SBB1	M14BB1	3.3	M14A11	2	308.7	0.004	8	0.013	0.7	3.42	342.62	1	8.8	Vitrified Clay
1190	O1L14SM4	M14M4	4.3	M14M3	3	319.5	0.004	8	0.013	0.7	3.42	343.3	1	8.9	Vitrified Clay
1246	O1L14SZ1	M14Z1	4.2	M14A10	1.2	321.9	0.009	8	0.013	1.05	5.13	519.69	1	12.9	Vitrified Clay
1508	O2L18ASD1	M18A-D1	2.5	M18A-A	1.2	315.6	0.004	8	0.01	0.91	4.41	447.27	1	16.2	PVC
4072	O2L2SJ2	M2J1	0.1	M2J2	1	78.1	0.012	4	0.013	0.74	0.9	91.672	1	41.5	Vitrified Clay
3428	O2L25SA1	M25A1	-1	W-25	-5.9	50.8	0.097	12	0.013	4.35	48.252	4982.7	1	56.7	
722	O2L3SL3	M3L3	1.7	M3L2	0.9	125.3	0.007	6	0.013	0.74	1.995	207.43	1	8.4	Vitrified Clay
764	O2L2SB2	M2B2	2	M2B1	1	179.7	0.006	6	0.013	0.67	1.8	187.85	1	7.3	Vitrified Clay
1360	O2L16SA8	M16A8	3.5	M16A7	2.8	165.8	0.005	8	0.01	0.96	4.5675	477.36	1	8.3	PVC
4004	O2L13SA2	M13A1	3.2	M13A2	4.5	310.7	0.004	8	0.013	0.7	3.3337	350.8	1	8.1	
4107	O2L1SKK1	M1BB1	2.4	M1KK1	3.5	48.2	0.023	4	0.013	1.03	1.2	129.03	0.9	10.9	Vitrified Clay
611	O2L2SO1	M2O1	2.4	M2A4	1.5	315.3	0.003	8	0.013	0.59	2.7	297.71	0.9	9.5	Vitrified Clay
782	O2L2SI1	M2I1	4	M2D4	3	162	0.006	4	0.013	0.53	0.6	67.101	0.9	11.5	Vitrified Clay
1148	O1L14SJ1	M14J1	-1.9	M14A4	-2.9	254.3	0.004	8	0.01	0.88	3.99	446.55	0.9	59.1	PVC
1362	O2L16SA9	M16A9	3.9	M16A8	3.5	76.3	0.005	8	0.01	1.01	4.5675	516.97	0.9	6.8	PVC
1218	O1L14SS5	M14S5	4.7	M14S4	3.7	280	0.004	8	0.013	0.63	2.85	324.1	0.9	8.2	Vitrified Clay
380	O2L3SG2	M3G2	1.7	M3G1	0.2	419.3	0.004	8	0.013	0.63	2.85	324.4	0.9	8	Vitrified Clay
4105	O2L1SBB2	M1BB1	2.4	M1BB2	3	127.3	0.005	6	0.013	0.6	1.5	172.91	0.9	7.8	Vitrified Clay
619	O2L3SE1	M3E1	2.4	M3D3	1.5	300.9	0.003	8	0.013	0.58	2.565	296.6	0.9	9.2	Vitrified Clay
4032	O2L3SB3	M3B2	2.8	M3B3	3.3	104.3	0.005	6	0.013	0.58	1.425	169.07	0.8	7.3	Vitrified Clay
1317	O1L17SQ5	M17Q5	5.3	M17Q4	4.1	301.2	0.004	8	0.013	0.66	2.85	340.88	0.8	12.5	Vitrified Clay
4112	O2L1SBB3	M1BB2	3	M1BB3	3.9	118.3	0.008	4	0.013	0.57	0.6	74.498	0.8	8.2	Vitrified Clay
614	O2L2SA6	M2A6	2.8	M2A5	1.9	296.5	0.003	8	0.013	0.57	2.4	298.8	0.8	7.4	Vitrified Clay
1774	O2L30SI1	M30I1	2	M30A4	1.4	69.2	0.009	4	0.013	0.6	0.63	79.509	0.8	13.9	Vitrified Clay
1754	O2L31SB4	M31B4	3.4	M31B3	1.7	470.5	0.004	12	0.013	0.83	7.7198	975.16	0.8	7.6	
355	O1L17SJ2	M17J2	4.8	M17J1	3.7	259	0.004	8	0.01	0.86	3.5625	451.05	0.8	10.1	PVC
812	O2L2SR2	M2R2	3.2	M2R1	1.8	334.5	0.004	8	0.013	0.67	2.7	355.61	0.8	8.3	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1035	O1L17SU1	M17U1	-2.3	M17T3	-2.8	61.2	0.009	12	0.013	1.25	11.4	1501.6	0.8	10.3	
4160	O2L1SU1	M1S1	1.8	M1U1	2.6	83.5	0.01	6	0.013	0.81	1.8	246.46	0.7	7.2	Vitrified Clay
909	O2L5SB1	M5B1	3	M5A3	-2.4	287.8	0.019	6	0.013	1.14	2.52	345.61	0.7	14.9	Vitrified Clay
1770	O2L30SA6	M30A6	2.7	M30A5	2.2	104.2	0.005	6	0.013	0.57	1.26	174.43	0.7	8.3	Vitrified Clay
3903	O2L5SC1	M5A1	-2.9	M5C1	2	250.8	0.02	6	0.013	1.15	2.52	352.74	0.7	19.4	Vitrified Clay
1158	O1L14SL1	M14L1	0.1	M14A5	-2.4	327.2	0.007	8	0.01	1.11	4.275	607.64	0.7	51.1	PVC
1142	O1L14SI1	M14I1	-0.8	M14A4	-2	306.5	0.004	8	0.01	0.82	3.135	446.62	0.7	20.4	PVC
4208	O2L30SA6	M30A7	2.8	M30A6	2.7	29.1	0.005	6	0.013	0.59	1.26	180.73	0.7	6	Vitrified Clay
4234	O2L7SC4	M7C3	0.7	M7C4	3	468.5	0.005	6	0.013	0.57	1.2	176.44	0.7	24.4	Vitrified Clay
1366	O2L16SG1	M16G1	2.5	M16A6	1.1	320.9	0.004	12	0.013	0.84	7.0875	1048.7	0.7	9	
4034	O2L3SB4	M3B3	3.3	M3B4	3.6	62.9	0.005	6	0.013	0.55	1.14	171.05	0.7	6.2	Vitrified Clay
4229	O2L25SJ1	M25B2	0.9	M25J1	3	400.1	0.005	6	0.013	0.58	1.2	181.15	0.7	11.1	Vitrified Clay
766	O2L2SB1	M2B1	1	M2A2	-1.3	308.4	0.007	8	0.013	0.83	3	467.41	0.6	13.8	Vitrified Clay
1077	O1L17SG1	M17H3	4.5	M17H2	3	366.1	0.004	8	0.01	0.79	2.85	445.26	0.6	9.3	PVC
1771	O2L30SK1	M30K1	3.1	M30A5	2.2	70.4	0.014	4	0.013	0.71	0.63	99.254	0.6	10.9	Vitrified Clay
1772	O2L30SJ1	M30J1	3.5	M30A5	2.2	99	0.014	4	0.013	0.71	0.63	99.722	0.6	10.9	Vitrified Clay
3172	O2L30SC1	M30C1	-0.5	M30A1	-0.9	29.6	0.014	6	0.013	0.95	1.89	300.19	0.6	14.8	Vitrified Clay
1204	O1L14SX1	M14X1	2	M14S1	1	246.8	0.004	8	0.013	0.61	2.1375	341.77	0.6	10.7	Vitrified Clay
1737	O2L16SH1	M16H1	-1.9	M16B1	-2	32.1	0.004	12	0.013	0.8	6.3	1017.5	0.6	8.5	
4214	O2L25SD1	M25C1	0.6	M25D1	2.3	116.5	0.014	4	0.013	0.72	0.63	102.26	0.6	11.1	Vitrified Clay
831	O2L1SI1	M1H1	2.9	M1H2	3.3	61.4	0.007	8	0.013	0.78	2.7	444.36	0.6	6.5	Vitrified Clay
771	O2L2SL1	M2L1	0.6	M2J1	0.1	86	0.006	6	0.013	0.62	1.2	197.66	0.6	28	Vitrified Clay
1236	O1L14SAA2	M14AA1	3.9	M14A1(	1.2	248.8	0.011	8	0.013	1	3.42	568.69	0.6	12.3	Vitrified Clay
617	O2L3SD4	M3D5	4	M3D4	2	318.4	0.006	8	0.013	0.75	2.565	426.62	0.6	6.9	Vitrified Clay
955	O2L4SD1	M4D1	3.5	M4A4	1.2	332.6	0.007	6	0.013	0.65	1.26	210.31	0.6	12.3	Vitrified Clay
4198	O2L34SA15	M34A15	3.3	M34A14	2.3	255.6	0.004	8	0.01	0.77	2.625	445.41	0.6	7.6	PVC
1423	O2L34SE2	M34E2	1.5	M34E1	-0.9	213.2	0.011	6	0.01	1.08	2.0417	349.5	0.6	6.6	PVC
4238	O2L7SM1	M7C2	-0.1	M7M1	3	463.4	0.007	6	0.013	0.63	1.2	205.96	0.6	26.5	Vitrified Clay
904	O2L23SA2	M17A2	2.1	M17A1	0.3	327.5	0.006	8	0.013	0.7	2.3333	404.28	0.6	13.8	
1150	O1L14SJ2	M14J2	-0.7	M14J1	-1.9	303.7	0.004	8	0.01	0.77	2.565	445.06	0.6	11.9	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1368	O2L16SG2	M16G2	3.4	M16G1	2.5	220.8	0.004	8	0.013	0.62	2.0475	361.35	0.6	7.1	
4287	O1L14SC7	M14C6	0.5	M14E1	4.8	106.4	0.041	6	0.013	1.55	2.85	508.53	0.6	75	
972	O2L34SF2	M34F4	3.4	M34F3	2.7	291.5	0.002	12	0.013	0.59	4.286	772.29	0.6	6	
4388	O2L32SB1	M32B1	2	W-32	0	46.8	0.043	12	0.013	2.5	17.974	3305.6	0.5	6.7	
1335	O1L40SB2	M40A1	1.2	M40B2	1.9	188.5	0.004	8	0.01	0.77	2.45	453.49	0.5	5.1	PVC
1775	O2L30SH1	M30H1	3.1	M30A4	1.4	86.1	0.02	4	0.013	0.81	0.63	120.01	0.5	13.7	Vitrified Clay
3166	O2L30SA11	M30A11	4.4	M30A10	4	70.5	0.005	4	0.013	0.4	0.315	60.183	0.5	5.7	Vitrified Clay
1220	O1L14ST1	M14T1	3.1	M14S2	2.1	276.9	0.004	8	0.013	0.56	1.71	332.36	0.5	9.9	Vitrified Clay
4149	O2L1SU2	M1U1	2.6	M1U2	3.6	52.8	0.019	4	0.013	0.78	0.6	117.52	0.5	7.5	Vitrified Clay
1734	O2L16SF1	M16F1	3	M16B2	-1.7	436	0.011	8	0.013	0.93	2.8583	560.08	0.5	11.9	
4175	O2L1SK1	M1E2	0.7	M1K1	2	66.3	0.02	6	0.013	1.05	1.8	353.44	0.5	14.1	Vitrified Clay
790	O2L2SE1	M2E1	2	M2D1	-1.7	414.5	0.009	6	0.013	0.7	1.2	238.36	0.5	11	Vitrified Clay
753	O2L3SA8	M3A8	4.3	M3A7	3.5	166.7	0.005	6	0.013	0.5	0.855	170.04	0.5	6.3	Vitrified Clay
1234	O1L14SBB2	M14BB2	4.2	M14BB1	3.3	246.9	0.004	8	0.013	0.57	1.71	342.35	0.5	6.1	Vitrified Clay
1176	O1L14SN1	M14N1	0.9	M14M1	-0.4	327.3	0.004	8	0.013	0.57	1.71	342.87	0.5	20.4	Vitrified Clay
4207	O2L30SA8	M30A8	3.1	M30A7	2.8	52.5	0.006	6	0.013	0.56	0.945	190.42	0.5	5.5	Vitrified Clay
1733	O2L16SE1	M16E1	3	M16B1	-2	435.3	0.012	8	0.013	0.96	2.8583	581.84	0.5	11.2	
762	O2L2SB2	M2B3	3	M2B2	2	176.5	0.006	6	0.013	0.55	0.9	189.57	0.5	6	Vitrified Clay
228	O1L17SJ3	M17J3	5.2	M17J2	4.8	51.5	0.009	6	0.01	0.87	1.425	302.67	0.5	7	PVC
385	O2L23SA1	M17A1	0.3	W-23	-6.4	11	0.608	12	0.013	8.78	58.625	12469	0.5	57.4	
4044	O2L2SG1	M2F2	2.1	M2G1	2.8	135	0.006	4	0.013	0.41	0.3	64.717	0.5	8.2	Vitrified Clay
4220	O2L25SF1	M25A1	-1	M25F1	2	115.2	0.026	4	0.013	0.9	0.63	137.14	0.5	23	Vitrified Clay
4091	O2L1SQ1	M1A3	-0.1	M1Q1	2	86.1	0.024	6	0.013	1.12	1.8	392.33	0.5	37.3	Vitrified Clay
4224	O2L25SI1	M25B1	0.3	M25I1	3	105.6	0.026	4	0.013	0.9	0.63	137.33	0.5	15	Vitrified Clay
3106	O2L34SO1	M34O1	2.9	M34A9	0.1	177.4	0.016	6	0.01	1.17	1.89	412.04	0.5	53.1	PVC
802	O2L2SF3	M2F3	2.6	M2F2	2.1	89.5	0.006	4	0.013	0.43	0.3	66.799	0.4	8.1	Vitrified Clay
3599	O1L37SE1	M37C1	-2.6	M37E1	-1.6	235	0.004	8	0.01	0.75	2.0883	471.24	0.4	8.5	PVC
3598	O1L37SB1	M37A2	-2.8	M37B1	-1.7	233.9	0.005	8	0.01	0.77	2.0883	476.91	0.4	14.5	PVC
4118	O2L1SCC2	M1CC1	3.5	M1CC2	4	77.5	0.006	4	0.013	0.43	0.3	68.59	0.4	5.1	Vitrified Clay
825	O2L1SB5	M1B4	3.5	M1B5	4.5	152.8	0.007	4	0.013	0.43	0.3	69.091	0.4	6.9	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
850	O2L1SOO1	M1JJ1	1.7	M1OO1	4.5	402.4	0.007	6	0.013	0.6	0.9	210.2	0.4	12.1	Vitrified Clay
1498	O2L18ASB1	M18A-B1	0.9	M18A-A	-0.3	279.5	0.004	8	0.01	0.71	1.89	446.28	0.4	52.3	PVC
1768	O2L30SA9	M30A9	3.8	M30A8	3.1	198.2	0.004	6	0.013	0.42	0.63	149.65	0.4	4.9	Vitrified Clay
1240	O1L14SA12	M14A12	3.5	M14A11	2	375.3	0.004	8	0.013	0.54	1.425	342.87	0.4	7.6	Vitrified Clay
1162	O1L14SK1	M14K1	0.6	M14A5	-2.4	260.8	0.012	8	0.01	1.18	3.135	757.49	0.4	50.7	PVC
4169	O2L1SM1	M1E1	-0.3	M1M1	2	75.2	0.03	4	0.013	0.9	0.6	147.72	0.4	19.6	Vitrified Clay
3520	O2L35SC1	M35A1	-1.3	M35C1	0	95.3	0.014	8	0.01	1.28	3.3168	823.44	0.4	40.5	PVC
3156	O2L30SL1	M30A7	2.8	M30L1	3.8	118.5	0.008	4	0.013	0.47	0.315	78.474	0.4	6.8	Vitrified Clay
4109	O2L1SKK2	M1KK1	3.5	M1KK2	4.5	130.6	0.008	4	0.013	0.45	0.3	74.737	0.4	6.5	Vitrified Clay
1192	O1L14SR1	M14R1	4.4	M14M4	4.3	130.4	0.001	6	0.013	0.2	0.285	73.133	0.4	7	Vitrified Clay
4100	O2L1SII1	M1HH1	3.5	M1II1	5	181.6	0.008	4	0.013	0.48	0.3	77.63	0.4	8	Vitrified Clay
1144	O1L14SI2	M14I2	0.5	M14I1	-0.8	310.4	0.004	8	0.01	0.69	1.71	447.43	0.4	5.2	PVC
4114	O2L1SBB4	M1BB3	3.9	M1BB4	5.1	138.4	0.009	4	0.013	0.49	0.3	79.521	0.4	5.4	Vitrified Clay
4185	O2L7SB2	M1D3	3	M1D4	4	114.4	0.009	4	0.013	0.49	0.3	79.857	0.4	5.2	Vitrified Clay
4197	O2L34SA16	M34A16	4.9	M34A15	3.3	402.3	0.004	4	0.01	0.43	0.2625	70.459	0.4	7.7	PVC
4247	O2L7SJ1	M7C1	-0.9	M7J1	4	296.3	0.017	6	0.013	0.87	1.2	323.84	0.4	25.3	Vitrified Clay
4068	O2L2SP3	M2P2	0.5	M2P3	3	262.3	0.009	4	0.013	0.5	0.3	82.722	0.4	9.8	Vitrified Clay
4102	O2L1SHH2	M1HH1	3.5	M1HH2	5.2	180.7	0.009	4	0.013	0.5	0.3	82.851	0.4	7.9	Vitrified Clay
4059	O2L2ST2	M2T1	2.3	M2T2	4.2	196	0.01	4	0.013	0.5	0.3	83.315	0.4	8.3	Vitrified Clay
3153	O2L34ST1	M34T1	3.5	M34A14	2.3	287.1	0.004	4	0.01	0.44	0.2625	73.273	0.4	11.9	PVC
4200	O2L29SA4	M29A3	0.2	M29A4	1.1	166	0.006	8	0.01	0.8	1.89	527.72	0.4	6.6	PVC
4078	O2L2SB2	M2B3	3	M2B4	4	102.3	0.01	4	0.013	0.51	0.3	84.454	0.4	5.9	Vitrified Clay
4061	O2L2SU1	M2T1	2.3	M2U1	3.5	125.5	0.01	4	0.013	0.51	0.3	84.562	0.4	8.3	Vitrified Clay
4054	O2L2SS1	M2R3	3.7	M2S1	4.7	101.9	0.01	4	0.013	0.51	0.3	85.33	0.4	7.9	Vitrified Clay
4036	O2L3SB5	M3B4	3.6	M3B5	4.4	85.4	0.009	4	0.013	0.49	0.285	81.087	0.4	6.5	Vitrified Clay
751	O2L3SA9	M3A9	5.2	M3A8	4.3	99.2	0.009	4	0.013	0.49	0.285	81.353	0.4	6	Vitrified Clay
4157	O2L1SW1	M1V1	3	M1W1	4	98.6	0.01	4	0.013	0.52	0.3	86.013	0.3	6.4	Vitrified Clay
3108	O2L34SO2	M34O2	3.3	M34O1	2.9	118.2	0.003	6	0.01	0.49	0.63	183.2	0.3	5.3	PVC
591	O2L7SG2	M7G2	5.6	M7G1	3.9	342.6	0.005	6	0.013	0.47	0.6	177.4	0.3	7.4	
223	O1L17SK1	M17K1	5.6	M17J2	4.8	50.6	0.017	6	0.01	1.12	1.425	421.99	0.3	7	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
566	O2L7SD5	M7D5	6.1	M7D4	4.4	340.5	0.005	6	0.013	0.47	0.6	177.93	0.3	8	
594	O2L7SF2	M7F2	5.8	M7F1	4.1	338.4	0.005	6	0.013	0.47	0.6	178.48	0.3	7.7	
4420	O2L30SD1	M30A2	-0.2	M30D1	2	201.5	0.011	8	0.013	0.84	1.89	565.04	0.3	7.9	Vitrified Clay
1541	O2L34SB5	M34B5	4.3	M34B4	3.5	176.1	0.005	8	0.01	0.7	1.5799	475.18	0.3	6.9	PVC
713	O2L3SH5	M3H4	2.5	M3H5	4	149.7	0.01	4	0.013	0.51	0.285	85.772	0.3	6.3	Vitrified Clay
3164	O2L30SA10	M30A10	4	M30A9	3.8	35.3	0.006	6	0.013	0.5	0.63	189.65	0.3	4.4	Vitrified Clay
815	O2L1SG1	M1G1	4	M1F1	2.5	130.2	0.011	4	0.013	0.54	0.3	91.187	0.3	9.7	Vitrified Clay
3427	O2L24SA1	M24A1	-1.6	W-24	-3.9	70.8	0.033	12	0.013	1.55	9.45	2895	0.3	84	
4120	O2L1SDD1	M1CC1	3.5	M1DD1	4	42.2	0.012	4	0.013	0.55	0.3	93.003	0.3	4.8	Vitrified Clay
1152	O1L14SJ3	M14J3	0.3	M14J2	-0.7	247	0.004	8	0.01	0.64	1.425	446.35	0.3	4.8	PVC
1188	O1L14SQ1	M14Q1	4.3	M14M3	3	115	0.011	6	0.013	0.7	0.855	268.8	0.3	9.2	Vitrified Clay
4093	O2L1SQ2	M1Q1	2	M1Q2	3.5	122	0.012	4	0.013	0.56	0.3	94.728	0.3	6.6	Vitrified Clay
4205	O2L29SB3	M29B3	2	M29B2	0	401.7	0.005	8	0.01	0.71	1.575	497.47	0.3	5.9	PVC
3138	O2L34SM1	M34M1	2.8	M34L2	2.3	85.6	0.006	6	0.01	0.64	0.7875	256.41	0.3	7.1	PVC
1422	O2L34SE1	M34A6	-1.9	M34E1	-0.9	335.6	0.003	10	0.01	0.62	2.0417	687.31	0.3	44.8	PVC
1279	O2L22SB2	M22B2	2.5	M22B1	1.2	179.2	0.007	6	0.013	0.53	0.63	213.64	0.3	22.2	
3094	O2L29SA1	M29A1	-1.6	W-29	-5.9	16.2	0.267	12	0.013	4.7	24.255	8266.1	0.3	54.7	
575	O2L7SH1	M7H1	4.7	M7D2	1.8	426.1	0.007	6	0.013	0.51	0.6	207.04	0.3	17.7	Vitrified Clay
4453	O2L38SA7	M38A6	-1.1	M38A7	-0.5	81.2	0.007	8	0.01	0.84	1.715	596	0.3	9.3	PVC
4151	O2L1SU3	M1U2	3.6	M1U3	4.5	58.4	0.015	4	0.013	0.58	0.3	105.99	0.3	5	Vitrified Clay
4212	O2L25SC2	M25C1	0.6	M25C2	2.3	212.1	0.008	6	0.013	0.55	0.63	223.47	0.3	7.3	Vitrified Clay
1041	O1L17SV2	M17V2	2.8	M17V1	1.8	228.9	0.004	12	0.013	0.63	2.85	1013.8	0.3	6	
1738	O2L16SB4	M16B4	5	M16B3	-1.5	334.2	0.019	12	0.013	1.37	6.2417	2221.4	0.3	6.5	
4095	O2L1SR1	M1Q1	2	M1R1	4	122.7	0.016	4	0.013	0.59	0.3	109.04	0.3	6.6	Vitrified Clay
715	O2L3SI1	M3I1	4	M3H3	1.8	143.3	0.015	4	0.013	0.57	0.285	106.05	0.3	10.1	Vitrified Clay
4006	O2L10SA2	M10A1	5.5	M10A2	6	103.8	0.005	6	0.013	0.43	0.4667	174.81	0.3	5.6	
4124	O2L1SEE2	M1EE1	2.9	M1EE2	4	62.7	0.018	4	0.013	0.61	0.3	113.11	0.3	5.7	Vitrified Clay
982	O2L34SH3	M34H2	0.9	M34H3	2.5	261.6	0.006	6	0.013	0.48	0.525	199.95	0.3	19.2	Vitrified Clay
4179	O2L1SK2	M1K1	2	M1K2	4.5	137.6	0.018	4	0.013	0.62	0.3	115.13	0.3	6.6	Vitrified Clay
574	O2L7SI2	M7I2	4.6	M7D1	1	430	0.008	6	0.013	0.56	0.6	231.06	0.3	19.4	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
4177	O2L1SL1	M1K1	2	M1L1	4.5	131	0.019	4	0.013	0.63	0.3	118.02	0.3	6.6	Vitrified Clay
4267	O1L37SA4	M37A4	-0.4	M37A5	3	204.8	0.017	6	0.01	1.01	1.0442	423.66	0.2	16.7	PVC
4216	O2L25SE1	M25A2	-0.4	M25E1	3	293.9	0.012	6	0.013	0.63	0.63	270.86	0.2	14.7	Vitrified Clay
3986	O1L37SC3	M37C2	-1.4	M37C3	-0.4	241.4	0.004	8	0.01	0.59	1.0442	451.48	0.2	5.4	PVC
1289	O2L26SA2	M26A1	0.8	M26A2	2.7	261.3	0.007	6	0.01	0.64	0.63	278.43	0.2	3.6	PVC
1242	O1L14SA13	M14A13	5	M14A12	3.5	145.1	0.01	6	0.013	0.59	0.57	256.01	0.2	4.9	Vitrified Clay
4195	O2L34SS1	M34A13	2.1	M34S1	3.8	85.5	0.02	4	0.013	0.62	0.2625	120.45	0.2	11.9	
3146	O2L34SL4	M34L4	3.9	M34L3	2.9	193.5	0.006	6	0.01	0.55	0.525	242.9	0.2	5.7	PVC
744	O2L3S132	M3C2	2	M3A4	1.4	213.7	0.003	6	0.013	0.3	0.285	134.54	0.2	10	Vitrified Clay
984	O2L34SI1	M34I1	1.5	M34H1	-0.2	169.9	0.01	6	0.013	0.58	0.525	253.69	0.2	51.7	Vitrified Clay
777	O2L2SL2	M2L2	3	M2L1	0.6	78.1	0.03	4	0.013	0.76	0.3	148.79	0.2	6.2	
4415	O2L30SG1	M30A3	0.6	M30G1	2	193.9	0.007	8	0.013	0.6	0.945	468.97	0.2	6.6	Vitrified Clay
773	O2L2SM1	M2M1	3	M2L1	0.6	77	0.031	4	0.013	0.76	0.3	149.83	0.2	6.2	Vitrified Clay
717	O2L3SK1	M3H3	1.8	M3K1	-5.1	102.4	-0.067	6	0.013	0.01	1.285	652.28	0.2	55.4	Vitrified Clay
907	O2L5SB2	M5B2	4	M5B1	3	247.1	0.004	6	0.013	0.36	0.315	160.2	0.2	5.2	Vitrified Clay
936	O2L5SA9	M5A9	4.5	M5A8	3.1	319	0.005	6	0.013	0.38	0.315	169.18	0.2	10.7	Vitrified Clay
938	O2L5SD6	M5D6	4.6	M5D5	3.4	274.1	0.005	6	0.013	0.38	0.315	169.39	0.2	6.1	Vitrified Clay
969	O2L4SA6	M4A6	4	M4A5	1.8	491.3	0.005	6	0.013	0.38	0.315	169.66	0.2	8.6	Vitrified Clay
949	O2L4SB2	M4B2	4.3	M4B1	2.5	390	0.005	6	0.013	0.38	0.315	171.56	0.2	6.5	Vitrified Clay
3403	O2L18ASA5	M18A5	0.3	M18A4	-0.9	301.5	0.004	8	0.013	0	0.63	343.58	0.2	100	Vitrified Clay
941	O2L4SH2	M4H2	4	M4H1	2.5	316.8	0.005	6	0.013	0.38	0.315	173.3	0.2	6	Vitrified Clay
3171	O2L30SC2	M30C2	1.3	M30C1	-0.5	360.4	0.005	6	0.013	0.39	0.315	177.98	0.2	4.7	Vitrified Clay
4138	O2L1SAA1	M1A6	1.4	M1AA1	4	65	0.04	4	0.013	0.84	0.3	169.78	0.2	52	Vitrified Clay
4126	O2L1SEE3	M1EE1	2.9	M1EE3	4	27.8	0.04	4	0.013	0.84	0.3	169.96	0.2	5.7	Vitrified Clay
3185	O2L30SM1	M30M1	4	M30B6	2.7	258.1	0.005	6	0.013	0.39	0.315	178.71	0.2	6.5	Vitrified Clay
1216	O1L14SW1	M14W1	4.2	M14S4	3.7	118.6	0.004	6	0.013	0.36	0.285	161.86	0.2	8.1	Vitrified Clay
4040	O2L2SD5	M2D4	3	M2D5	4.5	322.1	0.005	6	0.013	0.36	0.3	171.84	0.2	7	Vitrified Clay
3912	O2L7SA7	M7A6	4.9	M7A7	6.1	243.7	0.005	6	0.013	0.37	0.3	176.7	0.2	5.3	
1224	O1L14ST2	M14T2	3.4	M14T1	3.1	76.5	0.004	6	0.013	0.35	0.285	167.92	0.2	5	Vitrified Clay
1364	O2L30SA10	M16A10	5.1	M16A9	3.9	259.9	0.004	8	0.01	0.55	0.7875	466.92	0.2	4.9	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
573	O2L7SB2	M7B2	4.9	M7B1	3.6	269.8	0.005	6	0.013	0.37	0.3	178.14	0.2	4.3	Vitrified Clay
1222	O1L14SU1	M14U1	3.5	M14T1	3.1	85	0.005	6	0.013	0.35	0.285	170.58	0.2	5	Vitrified Clay
838	O2L1SJJ4	M1JJ4	4.5	M1JJ3	2.7	353.7	0.005	6	0.013	0.37	0.3	181.13	0.2	7	Vitrified Clay
1206	O1L14SX2	M14X2	3.3	M14X1	2	203.2	0.006	8	0.013	0.51	0.7125	432.09	0.2	4.4	Vitrified Clay
1248	O1L14SZ2	M14Z2	5.5	M14Z1	4.2	324.6	0.004	8	0.013	0.41	0.57	345.84	0.2	5.1	Vitrified Clay
1212	O1L14SV1	M14V1	3.9	M14S3	2.9	244	0.004	8	0.013	0.41	0.57	350.68	0.2	7.8	Vitrified Clay
808	O2L2SC4	M2C4	2.3	M2C3	0.9	265.7	0.005	6	0.013	0.38	0.3	184.63	0.2	5.3	Vitrified Clay
4070	O2L2SQ1	M2P2	0.5	M2Q1	1.9	253.9	0.005	6	0.013	0.38	0.3	185.02	0.2	6.6	Vitrified Clay
1238	O1L14SAA2	M14AA2	4.8	M14AA1	3.9	190	0.004	8	0.013	0.42	0.57	356.31	0.2	4.4	Vitrified Clay
4052	O2L2SR4	M2R3	3.7	M2R4	4.7	172.7	0.006	6	0.013	0.39	0.3	188.12	0.2	5.3	Vitrified Clay
4232	O2L25SB3	M25B2	0.9	M25B3	5	164.1	0.025	6	0.013	0.81	0.63	396.55	0.2	10	Vitrified Clay
1244	O1L14SBB3	M14BB3	5.2	M14BB2	4.2	191.8	0.005	6	0.013	0.37	0.285	180.39	0.2	4.9	Vitrified Clay
833	O2L1SI1	M1H2	3.3	M1I1	4.5	208.8	0.006	6	0.013	0.39	0.3	190.11	0.2	5.2	Vitrified Clay
779	O2L2SN1	M2N1	0.9	M2J1	0.1	139.6	0.006	6	0.013	0.39	0.3	190.42	0.2	26.7	Vitrified Clay
4145	O2L1SX1	M1A5	1.1	M1X1	4	57.3	0.05	4	0.013	0.92	0.3	190.78	0.2	52	Vitrified Clay
4184	O2L7SB2	M1D2	0.9	M1D3	3	413.4	0.005	8	0.013	0.45	0.6	383.21	0.2	9.4	Vitrified Clay
4455	O2L38SA8	M38A7	-0.5	M38A8	7	308.6	0.024	8	0.01	1.28	1.715	1099.1	0.2	3.6	PVC
994	O2L34SK2	M34K2	3	M34K1	1.1	410	0.005	6	0.013	0.35	0.2625	171.43	0.2	6	Vitrified Clay
844	O2L1SNN1	M1JJ2	2.1	M1NN1	4.5	391.2	0.006	6	0.013	0.4	0.3	196.01	0.2	9.1	Vitrified Clay
3183	O2L30SB7	M30B7	3.6	M30B6	2.7	220.4	0.004	6	0.01	0.42	0.315	209.19	0.2	6.4	PVC
916	O2L5SC2	M5C2	4	M5C1	2	273	0.007	6	0.013	0.43	0.315	215.53	0.1	5.1	Vitrified Clay
1504	O2L18ASC1	M18A-C1	2.3	M18A-A	0.7	412.6	0.004	8	0.01	0.5	0.63	437.67	0.1	15.4	PVC
3123	O2L29SF1	M29F1	2.5	M29B1	-1	194.8	0.018	6	0.01	0.88	0.63	438.83	0.1	8.4	PVC
3425	O2L1SC1	M1C1	2	M1A1	-1	105.1	0.029	12	0.013	1.37	3.9	2718.9	0.1	18.9	
3408	O2L18SE3	M18E3	1.3	M18E2	-0.6	488.8	0.004	8	0.01	0.51	0.63	446.46	0.1	51.4	PVC
840	O2L1SKK1	M1JJ3	2.7	M1KK1	4.5	252.5	0.007	6	0.013	0.43	0.3	214.39	0.1	6.8	Vitrified Clay
957	O2L4SE1	M4E1	4	M4D1	3.5	61	0.008	6	0.013	0.45	0.315	227.98	0.1	4.2	Vitrified Clay
4155	O2L1SV2	M1V1	3	M1V2	4	15.4	0.065	4	0.013	0.95	0.3	217.54	0.1	6.3	Vitrified Clay
4038	O2L3SC1	M3B1	1.9	M3C1	4	35.5	0.061	4	0.013	0.91	0.285	210.32	0.1	9.7	Vitrified Clay
4255	O2L24SH1	M24A1	-1.6	M24H1	3	134.3	0.034	6	0.013	0.92	0.63	465.08	0.1	51.8	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
4076	O2L2SK1	M2J2	1	M2K1	3	29.5	0.068	4	0.013	0.97	0.3	222.58	0.1	5.7	Vitrified Clay
792	O2L2SE2	M2E2	3	M2E1	2	126.6	0.008	6	0.013	0.44	0.3	223.85	0.1	3.9	Vitrified Clay
4083	O2L1SO1	M1A2	-0.8	M1O1	2	87.4	0.032	6	0.013	0.89	0.6	448.54	0.1	38.6	Vitrified Clay
4249	O2L24SD2	M24D1	-0.9	M24D2	3.7	130.1	0.035	6	0.013	0.94	0.63	473.45	0.1	7.3	Vitrified Clay
4074	O2L2SJ3	M2J2	1	M2J3	4	41.9	0.072	4	0.013	0.99	0.3	228.61	0.1	5.7	Vitrified Clay
1736	O2L16SH2	M16H2	4.2	M16H1	-1.9	332.4	0.018	12	0.013	1.06	2.8292	2162.4	0.1	4.4	
4085	O2L1SP1	M1O1	2	M1P1	4	27.7	0.072	4	0.013	0.99	0.3	229.54	0.1	4.7	Vitrified Clay
829	O2L1SI1	M1H1	2.9	M1J1	4.5	192.6	0.008	6	0.013	0.45	0.3	229.64	0.1	6.3	Vitrified Clay
962	O2L4SA6	M4F1	4	M4A5	1.8	243	0.009	6	0.013	0.48	0.315	242.34	0.1	8.3	Vitrified Clay
4189	O2L34SR1	M34A13	2.1	M34R1	3	16	0.056	4	0.013	0.87	0.2625	202.47	0.1	11.9	Vitrified Clay
4222	O2L25SG1	M25A1	-1	M25G1	8	237.8	0.038	6	0.013	0.96	0.63	489.09	0.1	15.1	Vitrified Clay
1160	O1L14SL2	M14L2	1.5	M14L1	0.1	355.4	0.004	8	0.01	0.49	0.57	445.64	0.1	4.6	PVC
1164	O1L14SK2	M14K2	1.6	M14K1	0.6	234.1	0.004	8	0.01	0.49	0.57	446.74	0.1	4.2	PVC
4147	O2L1SY1	M1A5	1.1	M1Y1	0	14.6	-0.078	4	0.013	0.01	0.3	238.72	0.1	100	Vitrified Clay
852	O2L1SOO2	M1OO1	4.5	M1OO2	5	55	0.009	6	0.013	0.47	0.3	240.13	0.1	3.7	Vitrified Clay
4171	O2L1SN3	M1M1	2	M1N3	4	24.9	0.08	4	0.013	1.04	0.3	241.96	0.1	5	Vitrified Clay
846	O2L1SLL1	M1JJ2	2.1	M1LL1	4.5	256.3	0.009	6	0.013	0.47	0.3	242.15	0.1	8.9	Vitrified Clay
4131	O2L1SFF1	M1A8	1.9	M1FF1	4	25.8	0.082	4	0.013	1.04	0.3	243.89	0.1	45.9	Vitrified Clay
4227	O2L25SH1	M25B1	0.3	M25H1	7	157.1	0.043	6	0.013	1	0.63	521.19	0.1	9.8	Vitrified Clay
4089	O2L1SO2	M1O1	2	M1O2	4	23.4	0.085	4	0.013	1.06	0.3	249.44	0.1	4.7	Vitrified Clay
4026	O2L4SC1	M4A3	0.7	M4C1	4	283.9	0.012	6	0.013	0.52	0.315	271.11	0.1	13.5	Vitrified Clay
1184	O1L14SP1	M14P1	3.8	M14M2	2.2	199.4	0.008	8	0.013	0.53	0.57	493.37	0.1	6.9	Vitrified Clay
1281	O2L22SE1	M22E1	2.6	M22B1	1.2	208.3	0.007	6	0.01	0.52	0.315	274.09	0.1	21.5	PVC
4173	O2L1SM2	M1M1	2	M1M2	4	21.1	0.095	4	0.013	1.11	0.3	262.71	0.1	5	Vitrified Clay
720	O2L3SL4	M3L4	4	M3L3	1.7	232.3	0.01	6	0.013	0.47	0.285	250.57	0.1	4.8	Vitrified Clay
4187	O2L1SH4	M1H3	3.6	M1H4	4.5	71.6	0.012	6	0.013	0.52	0.3	276.09	0.1	3.8	Vitrified Clay
959	O2L4SD2	M4D2	4	M4D1	3.5	37	0.014	6	0.013	0.55	0.315	292.76	0.1	4.1	Vitrified Clay
1180	O1L14SO1	M14O1	2.5	M14N1	0.9	135	0.012	6	0.013	0.51	0.285	275.52	0.1	4.6	Vitrified Clay
3134	O2L29SC2	M29C2	3	M29C1	2	129.4	0.008	8	0.01	0.64	0.63	619.81	0.1	2.5	PVC
615	O2L2SA7	M2A7	3.7	M2A6	2.8	300.7	0.003	8	0.013	0.31	0.3	296.71	0.1	4.4	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
612	O2L2SO2	M2O2	3.4	M2O1	2.4	316.4	0.003	8	0.013	0.31	0.3	297.16	0.1	4.6	Vitrified Clay
4245	O2L7SK1	M7C1	-0.9	M7K1	3	264.7	0.015	6	0.013	0.56	0.3	305.68	0.1	24	Vitrified Clay
620	O2L3SE2	M3E2	3.3	M3E1	2.4	300.9	0.003	8	0.013	0.3	0.285	296.62	0.1	4.5	Vitrified Clay
616	O2L3SD6	M3D6	3.9	M3D5	2.9	314.4	0.003	8	0.013	0.3	0.285	298.11	0.1	58	Vitrified Clay
996	O2L34SJ2	M34J2	2.5	M34J1	0.1	194.9	0.012	6	0.013	0.5	0.2625	280.02	0.1	7.2	Vitrified Clay
3952	O2L29SD1	M29A3	0.2	M29D1	4	421.4	0.009	8	0.01	0.68	0.63	672.56	0.1	5.7	PVC
4133	O2L1SGG1	M1A8	1.9	M1GG1	4	14.5	0.144	4	0.013	1.31	0.3	324.64	0.1	45.9	Vitrified Clay
724	O2L3SM1	M3L2	0.9	M3M1	4.5	238.9	0.015	6	0.013	0.56	0.285	311.28	0.1	6.2	Vitrified Clay
3421	O2L18SG1	M18G1	-0.6	M18A3	-1.6	235.8	0.004	8	0.013	0	0.315	344.22	0.1	100	Vitrified Clay
3416	O2L18SF1	M18F1	-1.5	M18A2	-2.5	237.8	0.004	8	0.013	0	0.315	344.59	0.1	100	Vitrified Clay
4315	O2L18A	M18C2	3	M18D1	3.2	41.8	0.004	12	0.013	0.45	0.945	1048.7	0.1	11	
382	O2L3SG3	M3G3	3.1	M3G2	1.7	393.5	0.004	8	0.013	0.32	0.285	323.48	0.1	4.5	Vitrified Clay
817	O2L1SF2	M1F1	2.5	M1F2	4	371.7	0.004	8	0.013	0.34	0.3	342.68	0.1	4.9	Vitrified Clay
4257	O2L24SA3	M24A2	-1	M24A3	2	142.3	0.021	6	0.013	0.64	0.315	366.3	0.1	12.3	Vitrified Clay
730	O2L3SO1	M3O1	5	M3L1	0.4	255.7	0.018	6	0.013	0.59	0.285	337.04	0.1	8.3	Vitrified Clay
1194	O1L14SM5	M14M5	5.7	M14M4	4.3	345	0.004	8	0.013	0.34	0.285	343.01	0.1	4.6	Vitrified Clay
3119	O2L29SE1	M29E1	4	M29A2	-0.7	403.4	0.012	8	0.01	0.75	0.63	759.38	0.1	7.3	PVC
4253	O2L24SG1	M24A1	-1.6	M24G1	4	59.2	0.094	6	0.013	1.34	0.63	772.83	0.1	51.8	Vitrified Clay
4140	O2L1SZ1	M1A6	1.4	M1Z1	4	13.6	0.188	4	0.013	1.45	0.3	370.46	0.1	52	Vitrified Clay
1178	O1L14SN2	M14N2	2.5	M14N1	0.9	79	0.02	6	0.013	0.62	0.285	360.12	0.1	4.6	Vitrified Clay
4191	O2L34SP1	M34A12	1.7	M34P1	4	14.4	0.162	4	0.013	1.32	0.2625	343.6	0.1	42.2	Vitrified Clay
4251	O2L24SA1	M24D1	-0.9	M24E1	5.4	58.1	0.108	6	0.013	1.42	0.63	829.33	0.1	7.3	Vitrified Clay
3142	O2L34SM2	M34N1	3.5	M34M1	2.8	55.5	0.012	6	0.01	0.61	0.2625	358.36	0.1	3.2	PVC
4204	O2L29SB4	M29B4	2.5	M29B3	2	127.8	0.004	8	0.01	0.4	0.315	440.96	0.1	3.1	PVC
4210	O2L25SA7	M25A6	1.9	M25A7	3.5	403.5	0.004	8	0.01	0.4	0.315	443.97	0.1	7	PVC
3398	O2L25SK1	M25K1	2.4	M25A4	1	345.5	0.004	8	0.01	0.41	0.315	445.62	0.1	7.6	PVC
727	O2L3SN1	M3N1	-6.1	M3L1	0.4	241.6	-0.027	6	0.013	0	0.285	413.39	0.1	57.1	Vitrified Clay
4236	O2L7SC4	M7C3	0.7	M7N1	4	105.9	0.031	6	0.013	0.73	0.3	444.49	0.1	22.6	Vitrified Clay
4263	O2L7SB1	M7A1	-5.5	M7B1	3.6	238.5	0.038	12	0.013	1.25	2.1	3118.3	0.1	51.4	
3140	O2L34SM2	M34M2	3.8	M34M1	2.8	56.2	0.017	6	0.01	0.68	0.2625	429.13	0.1	3.2	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1154	O1L14SJ	M14J4	1.4	M14J3	0.3	245	0.004	8	0.01	0.41	0.285	468.11	0.1	3	PVC
1146	O1L14SI3	M14I3	1.5	M14I2	0.5	226.4	0.004	8	0.01	0.41	0.285	470.9	0.1	3.2	PVC
4116	O2L1SCC1	M1BB2	3	M1CC1	3.5	46.8	0.011	12	0.013	0.63	0.9	1652.3	0.1	2.6	
4243	O2L7SL1	M7C2	-0.1	M7L1	6	104.9	0.058	6	0.013	0.9	0.3	607.2	0	24.9	Vitrified Clay
4259	O2L24SB1	M24A2	-1	M24B1	3	60.7	0.066	6	0.013	0.95	0.315	647.42	0	12.3	
3985	O1L37SD1	M37C2	-1.4	M37D1	5	56.1	0.114	8	0.01	1.92	1.0442	2376.2	0	5.3	PVC
4202	O2L29SA5	M29A4	1.1	M29A5	4.6	254.7	0.014	8	0.01	0.65	0.315	827.15	0	3.1	PVC
1200	O1L14SY1	M14Y1	4.8	M14A9	0.4	202.7	0.022	8	0.013	0.57	0.285	800.48	0	10.5	Vitrified Clay
1226	O1L14SS6	M14S6	5.8	M14S5	4.7	286.6	0.004	12	0.013	0.31	0.285	1004.1	0	2.9	
3424	O2L1SC2	M1C2	4	M1C1	2	292.2	0.007	12	0.013	0.37	0.3	1322.9	0	2.5	
3132	O2L29SC1	M29C1	2	M29A1	-1.6	16.4	0.218	8	0.01	1.96	0.63	3292.1	0	8.4	PVC
4042	O2L2SH1	M2D4	3	M2H1	3.5	25.7	0.019	12	0.013	0.56	0.3	2230.3	0	3.2	
4164	O2L1ST1	M1S2	2.5	M1T1	4	60.1	0.025	12	0.013	0.6	0.3	2526.9	0	1.9	
4167	O2L1SS3	M1S2	2.5	M1S3	4	57.6	0.026	12	0.013	0.61	0.3	2580.6	0	1.9	
4193	O2L34SQ1	M34A12	1.7	M34Q1	3.8	89	0.024	12	0.013	0.57	0.2625	2474.3	0	13.9	
354	O1L17SM8	M17M8	4.2	M17M7	3.8	110	0.004	8	0.01	0	0	450.94	0	5.5	PVC
635	O2L36SA11	M36A11	2.8	M36A10	1.4	339.1	0.004	8	0.01	0	0	454.65	0	4.6	PVC
854	O2L1SMM1	M1MM1	4.5	M1JJ1	1.7	270.1	0.01	6	0.013	0	0	256.58	0	9.8	Vitrified Clay
1044	O1L17ST8	M17T8	2.8	M17T7	2.4	88.7	0.004	12	0.013	0	0	1004.2	0	3.7	
1051	O1L17SU2	M17U2	-1	M17U1	-2.3	275.1	0.005	12	0.013	0	0	1082.2	0	3.2	
1063	O1L17SR1	M17R1	1.8	M17Q0	0.6	400	0.003	8	0.013	0	0	299.51	0	12.5	Vitrified Clay
1065	O1L17SR2	M17R2	2.9	M17R1	1.8	268.2	0.004	8	0.013	0	0	342.55	0	0	Vitrified Clay
1067	O1L17SR3	M17R3	3.6	M17R2	2.9	161.2	0.005	8	0.013	0	0	367.43	0	0	Vitrified Clay
1074	O1L17SS1	M17S1	-1.4	M17Q2	-3.4	391.3	0.005	8	0.013	0	0	381.87	0	100	Vitrified Clay
1085	O1L17SG2	M17G2	7	M17G1	4.8	398.5	0.006	8	0.01	0	0	527.42	0	7.7	PVC
1271	O2L22SF1	M22F1	-1.8	M22A1	-0.5	112.4	-0.011	6	0.013	0	0	266.59	0	50	Vitrified Clay
1683	O2L19SA2	M19A2	1.5	M19A1	1	72.8	0.007	12	0.013	0	0	1324.9	0	0	Vitrified Clay
1684	O2L19SA1	M19A1	1	W-19	-4.4	16.7	0.321	12	0.013	0	0	9058.2	0	50	Vitrified Clay
3130	O2L29SG1	M29G1	2.5	M29B2	0	130.4	0.019	6	0.01	0	0	453.23	0	5.1	PVC
3983	O2L38SD3	M38D2	0.8	M38D3	1.1	72	0.004	8	0.01	0	0	462.79	0	0	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1515	O2L46SA1	W-46	2	M46A1	2.4	72.7	-0.006	8	0.01	(N/A)	(N/A)	529.48	(N/A)	(N/A)	PVC

EXHIBIT E.2
SEWER MANHOLE DATA TABLE REPORT

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
67	M17A9	8.5	8.5	16416	0	449.5	11.4	460.89	0.79	0.8	FALSE	TRUE
359	M3A1	6.4	6.4	8964	-1.8	356.9	6.225	363.07	0.69	-1.1	FALSE	TRUE
456	M7A1	6.6	8.3	5184	-5.5	179.7	3.6	183.32	2.15	-3.4	FALSE	TRUE
522	M34A1	6.7	6.7	0	-5.5	1914	0	1913.6	0.85	-4.6	FALSE	TRUE
533	M14A2	5.6	7.5	0	-3.6	660.9	0	660.86	1.73	-1.8	FALSE	TRUE
534	M14A3	5.9	5.9	0	-2.6	98.12	0	98.119	0.83	-1.8	FALSE	TRUE
535	M14A4	5.6	5.6	2872.8	-3.1	96.12	1.995	98.119	1.28	-1.8	FALSE	TRUE
598	M3D5	6.8	6.8	3283.2	2.9	0.285	2.28	2.565	1.06	4	FALSE	TRUE
712	M3H5	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
723	M3M1	5.5	5.5	410.4	4.5	0	0.285	0.285	0.01	4.5	FALSE	TRUE
725	M3N1	5.6	5.6	410.4	-6.1	0	0.285	0.285	6.58	0.5	FALSE	TRUE
816	M1F2	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
824	M1B5	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
828	M1J1	6	6	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
832	M1I1	5.8	5.8	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
839	M1KK1	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
843	M1NN1	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
845	M1LL1	6.3	6.3	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
851	M1OO2	6.4	6.4	432	5	0	0.3	0.3	0.01	5	FALSE	TRUE
897	M1D4	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
950	M4C1	5.5	5.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	TRUE
973	M34F2	4.8	4.8	36429.05	0.3	53.62	25.298	78.915	1.75	2	FALSE	TRUE
975	M34F1	4.8	4.8	1890	-0.8	84.69	1.3125	86.002	1.78	1	FALSE	TRUE
977	M34H1	3.4	3.4	4158	-0.2	2.888	2.8875	5.775	1.25	1	FALSE	TRUE
981	M34H3	4.1	4.1	756	2.5	0	0.525	0.525	0.02	2.5	FALSE	TRUE
985	M34A6	4.3	4.3	31753.4	-1.9	343.3	22.051	365.33	0.71	-1.2	FALSE	TRUE
1056	M17A1	8.6	8.6	41040	-7	795.7	28.5	824.17	0.71	-6.3	FALSE	TRUE
1069	M17Q1	6.7	6.7	0	-4	37.05	0	37.05	4.78	0.8	FALSE	TRUE
1071	M17Q2	7.3	7.3	0	-3.4	37.05	0	37.05	4.2	0.8	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1073	M17S1	7	7	0	-1.4	0	0	0	2.26	0.8	FALSE	TRUE
1080	M17A10	8.7	8.7	6156	0.6	430.3	4.275	434.53	1.25	1.8	FALSE	TRUE
1087	M17A11	8.9	8.9	32832	1.6	365.4	22.8	388.21	1.52	3.1	FALSE	TRUE
1098	M14C5	7.4	7.4	36936	-0.4	276.4	25.65	302.05	5.38	4.9	FALSE	TRUE
1099	M14D1	5.1	5.1	24624	0.4	142.5	17.1	159.55	4.66	5.1	TRUE	TRUE
1101	M14D2	4.9	4.9	16416	1.3	131.1	11.4	142.45	3.67	4.9	TRUE	TRUE
1103	M14D3	5.7	5.7	4104	2.1	105.4	2.85	108.25	2.93	5.1	FALSE	TRUE
1105	M14D4	6.1	6.1	16416	2.8	94	11.4	105.4	2.34	5.1	FALSE	TRUE
1107	M14C4	6.2	6.2	185132.02	-1.4	302.1	128.56	430.62	5.35	4	FALSE	TRUE
1109	M14C3	6.4	6.4	29548.8	-2.3	430.6	20.52	451.14	4.31	2	FALSE	TRUE
1112	M14C2	6.4	6.4	0	-2.4	451.1	0	451.14	4.23	1.8	FALSE	TRUE
1114	M14C1	6.4	6.4	0	-2.7	562.7	0	562.74	3.87	1.2	FALSE	TRUE
1121	M14D5	6.3	6.3	8208	3.5	0	5.7	5.7	1.66	5.1	FALSE	TRUE
1123	M14C6	7.1	7.1	4104	0.5	114	2.85	116.85	4.59	5.1	FALSE	TRUE
1125	M14C7	7.4	7.4	12312	1	102.6	8.55	111.15	4.18	5.2	FALSE	TRUE
1127	M14F1	9.2	9.2	16416	1.8	19.95	11.4	31.35	3.41	5.2	FALSE	TRUE
1129	M14F2	0	7.9	16416	2.5	8.55	11.4	19.95	2.66	5.2	FALSE	TRUE
1171	M14A7	6.4	6.4	6885.6	-1.6	71.39	4.7817	76.174	1.41	-0.2	FALSE	TRUE
1284	M22A5	5.4	5.4	122526	2.2	0	85.088	85.088	0.21	2.4	FALSE	TRUE
1288	M26A2	5	5	907.2	2.7	0	0.63	0.63	-0.03	2.7	FALSE	TRUE
1303	M14C8	8.1	8.1	0	1.3	71.25	0	71.25	3.89	5.2	FALSE	TRUE
1305	M14C9	7.3	7.3	53352	1.7	34.2	37.05	71.25	3.44	5.2	FALSE	TRUE
1307	M14C10	7.6	7.6	10260	2.6	7.125	7.125	14.25	2.62	5.2	FALSE	TRUE
1309	M14C11	8.2	8.2	10260	3.1	0	7.125	7.125	2.08	5.2	FALSE	TRUE
1311	M14G1	8	8	16416	2.4	8.55	11.4	19.95	2.74	5.2	FALSE	TRUE
1313	M14G2	8.2	8.2	12312	3.3	0	8.55	8.55	1.92	5.2	FALSE	TRUE
1332	M40A5	9.2	9.2	126831.6	3.7	0	88.078	88.078	0.2	3.9	FALSE	TRUE
1334	M40B2	8	8	3528	4	0	2.45	2.45	-2.03	2	FALSE	TRUE
1386	M37D1	8.1	8.1	1503.6	5	0	1.0442	1.0442	0.02	5	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1393	M17B1	8.8	8.8	0	2.2	173.1	0	173.14	0.91	3.1	FALSE	TRUE
1464	M34A9	4.4	4.4	3402	0.1	215.5	2.3625	217.91	0.65	0.7	FALSE	TRUE
1476	M39A1	5.9	5.9	22680.42	-1.6	15.75	15.75	31.501	3.6	2	FALSE	TRUE
1480	M39A2	5.9	5.9	22680.42	-0.3	0	15.75	15.75	2.25	2	FALSE	TRUE
1493	M18A-A2	5.1	5.1	0	-0.7	76	0	76.004	1.39	0.7	FALSE	TRUE
1495	M18A-A3	5.6	5.6	7257.6	-0.3	70.96	5.04	76.004	0.99	0.7	FALSE	TRUE
1516	M34A3	5.1	5.1	16068.5	-4.4	634	11.159	645.2	0.78	-3.6	FALSE	TRUE
1560	M14H1	5.6	5.6	8208	3	17.1	5.7	22.8	1.99	4.9	FALSE	TRUE
1562	M14H2	5.6	5.6	0	3.4	17.1	0	17.1	1.52	4.9	FALSE	TRUE
1564	M14H3	5.6	5.6	4104	3.8	14.25	2.85	17.1	1.15	4.9	FALSE	TRUE
1566	M14H4	5.9	5.9	12312	4.2	5.7	8.55	14.25	0.73	4.9	FALSE	TRUE
1618	M3F3	5.9	5.9	0	3.2	132.9	0	132.9	0.29	3.5	FALSE	TRUE
1707	M38C2	7	7	20071.38	1	0	13.938	13.938	0.07	1.1	FALSE	TRUE
1715	M38B3	7.1	7.1	19609.59	1.5	0	13.618	13.618	0.08	1.6	FALSE	TRUE
3154	M30L1	4.2	4.2	453.6	3.8	0	0.315	0.315	0.02	3.8	FALSE	TRUE
3197	M18A1	5.6	5.6	3628.8	-3.1	132	2.52	134.55	4.11	1	FALSE	TRUE
3199	M18B2	5	5	11340	-1.6	0	7.875	7.875	2.57	1	FALSE	TRUE
3223	M18B1	5.1	5.1	10886.4	-2.4	7.875	7.56	15.435	3.4	1	FALSE	TRUE
3303	M24A1	6	6	3628.8	-1.6	6.93	2.52	9.45	0.68	-0.9	FALSE	TRUE
3401	M18A5	6.9	6.9	907.2	0.3	0	0.63	0.63	0.72	1	FALSE	TRUE
3402	M18A4	6.3	6.3	7257.6	-0.9	0.63	5.04	5.67	1.93	1	FALSE	TRUE
3404	M18A2	5.4	5.4	10886.4	-2.5	17.01	7.56	24.57	3.48	1	FALSE	TRUE
3407	M18E2	7.1	7.1	4536	-0.6	0.63	3.15	3.78	1.65	1	FALSE	TRUE
3409	M18E1	6.2	6.2	7257.6	-1.8	3.78	5.04	8.82	2.78	1	FALSE	TRUE
3415	M18F1	6.9	6.9	453.6	-1.5	0	0.315	0.315	2.52	1	FALSE	TRUE
3417	M18A3	5.9	5.9	2721.6	-1.6	5.985	1.89	7.875	2.59	1	FALSE	TRUE
3420	M18G1	6.5	6.5	453.6	-0.6	0	0.315	0.315	1.64	1	FALSE	TRUE
3517	M35B1	6.5	6.5	29716.26	2	0	20.636	20.636	0.1	2.1	FALSE	TRUE
3519	M35C1	6	6	4776.24	0	0	3.3168	3.3168	0.04	0	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3911	M7A7	7.9	7.9	432	6.1	0	0.3	0.3	0.02	6.1	FALSE	TRUE
3951	M29D1	5.1	5.1	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
3980	M15A1	7	7	9702	4.5	0	6.7375	6.7375	0.06	4.6	FALSE	TRUE
3991	M35A4	6.6	6.6	27561.66	3.6	0	19.14	19.14	0.1	3.7	FALSE	TRUE
4003	M13A2	6.2	6.2	4800.6	4.5	0	3.3337	3.3337	0.05	4.5	FALSE	TRUE
4005	M10A2	9.3	9.3	672	6	0	0.46667	0.46667	0.02	6	FALSE	TRUE
4008	M9A2	5.1	5.1	28350	1.1	0	19.688	19.688	0.09	1.2	FALSE	TRUE
4013	M9B2	5.3	5.3	34020	1.5	0	23.625	23.625	0.11	1.6	FALSE	TRUE
4035	M3B5	5	5	410.4	4.4	0	0.285	0.285	0.01	4.4	FALSE	TRUE
4037	M3C1	5.7	5.7	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
4039	M2D5	5.3	5.3	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4043	M2G1	5.6	5.6	432	2.8	0	0.3	0.3	0.02	2.9	FALSE	TRUE
4051	M2R4	6.2	6.2	432	4.7	0	0.3	0.3	0.02	4.7	FALSE	TRUE
4053	M2S1	6.1	6.1	432	4.7	0	0.3	0.3	0.01	4.8	FALSE	TRUE
4058	M2T2	6.1	6.1	432	4.2	0	0.3	0.3	0.01	4.2	FALSE	TRUE
4060	M2U1	6.2	6.2	432	3.5	0	0.3	0.3	0.01	3.6	FALSE	TRUE
4067	M2P3	6.1	6.1	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4069	M2Q1	6.9	6.9	432	1.9	0	0.3	0.3	0.02	1.9	FALSE	TRUE
4073	M2J3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4075	M2K1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4077	M2B4	5.5	5.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4084	M1P1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4088	M1O2	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4092	M1Q2	5.3	5.3	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	TRUE
4094	M1R1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4099	M1II1	5.8	5.8	432	5	0	0.3	0.3	0.02	5	FALSE	TRUE
4101	M1HH2	5.7	5.7	432	5.2	0	0.3	0.3	0.01	5.2	FALSE	TRUE
4108	M1KK2	6.5	6.5	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4113	M1BB4	5.6	5.6	432	5.1	0	0.3	0.3	0.01	5.1	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4117	M1CC2	6	6	432	4	0	0.3	0.3	0.02	4	FALSE	TRUE
4119	M1DD1	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4123	M1EE2	6.1	6.1	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4125	M1EE3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4130	M1FF1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4132	M1GG1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4134	M1A6	6.5	6.5	432	1.4	192	0.29999	192.3	0.36	1.8	FALSE	TRUE
4137	M1AA1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4139	M1Z1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4141	M1A5	6.5	6.5	432	1.1	192.9	0.3	193.2	0.36	1.5	FALSE	TRUE
4144	M1X1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4146	M1Y1	6.8	6.8	432	0	0	0.3	0.3	1.5	1.5	FALSE	TRUE
4150	M1U3	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4154	M1V2	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4156	M1W1	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4163	M1T1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4166	M1S3	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4170	M1N3	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4172	M1M2	5	5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4176	M1L1	5.1	5.1	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4178	M1K2	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4186	M1H4	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4188	M34R1	4.4	4.4	378	3	0	0.2625	0.2625	0.01	3	FALSE	TRUE
4190	M34P1	4.8	4.8	378	4	0	0.2625	0.2625	0.01	4	FALSE	TRUE
4192	M34Q1	4.3	4.3	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4194	M34S1	4.7	4.7	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4201	M29A5	5.6	5.6	453.6	4.6	0	0.315	0.315	0.01	4.6	FALSE	TRUE
4209	M25A7	4.1	4.1	453.6	3.5	0	0.315	0.315	0.01	3.5	FALSE	TRUE
4211	M25C2	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4213	M25D1	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4215	M25E1	5.3	5.3	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4219	M25F1	4.7	4.7	907.2	2	0	0.63	0.63	0.02	2	FALSE	TRUE
4221	M25G1	10	10	907.2	8	0	0.63	0.63	0.02	8	FALSE	TRUE
4223	M25I1	5.2	5.2	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4226	M25H1	10	10	907.2	7	0	0.63	0.63	0.02	7	FALSE	TRUE
4228	M25J1	5.2	5.2	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4231	M25B3	7.3	7.3	907.2	5	0	0.63	0.63	0.02	5	FALSE	TRUE
4233	M7C4	4.5	4.5	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4235	M7N1	8.2	8.2	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4237	M7M1	4.8	4.8	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4240	M7L1	9.9	9.9	432	6	0	0.3	0.3	0.01	6	FALSE	TRUE
4244	M7K1	5.3	5.3	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4246	M7J1	8.4	8.4	1728	4	0	1.2	1.2	0.03	4	FALSE	TRUE
4248	M24D2	5.7	5.7	907.2	3.7	0	0.63	0.63	0.02	3.7	FALSE	TRUE
4250	M24E1	8.4	8.4	907.2	5.4	0	0.63	0.63	0.02	5.4	FALSE	TRUE
4252	M24G1	6.8	6.8	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
4254	M24H1	5	5	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4256	M24A3	4.9	4.9	453.6	2	0	0.315	0.315	0.01	2	FALSE	TRUE
4258	M24B1	5.6	5.6	453.6	3	0	0.315	0.315	0.01	3	FALSE	TRUE
4266	M37A5	5	5	1503.6	3	0	1.0442	1.0442	0.02	3	FALSE	TRUE
4268	M14F3	8.3	8.3	12312	3	0	8.55	8.55	2.17	5.2	FALSE	TRUE
4270	M4G3	9	9	4309.2	6.2	0	2.9925	2.9925	0.04	6.2	FALSE	TRUE
4272	M32C2	5.2	5.2	19879.02	1	0	13.805	13.805	0.09	1.1	FALSE	TRUE
4286	M14E1	8	8	4104	4.8	0	2.85	2.85	0.25	5.1	FALSE	TRUE
4386	M32B2	6	6	12526.5	3	0	8.699	8.699	0.07	3.1	FALSE	TRUE
4414	M30G1	3.4	3.4	1360.8	2	0	0.945	0.945	0.02	2	FALSE	TRUE
4419	M30D1	3.5	3.5	2721.6	2	0	1.89	1.89	0.03	2	FALSE	TRUE
4427	M16C1	4.7	4.7	11340	2.2	0	7.875	7.875	0.06	2.3	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4454	M38A8	10.3	10.3	2469.6	7	0	1.715	1.715	0.03	7	FALSE	TRUE
68	M17J1	8.8	8.8	16416	3.7	3.563	11.4	14.962	0.09	3.8	FALSE	FALSE
222	M17K1	9.3	9.3	2052	5.6	0	1.425	1.425	0.03	5.6	FALSE	FALSE
226	M17J2	8.8	8.8	1026	4.8	2.85	0.7125	3.5625	0.04	4.8	FALSE	FALSE
227	M17J3	9.2	9.2	2052	5.2	0	1.425	1.425	0.03	5.2	FALSE	FALSE
352	M17M8	7.2	7.2	0	4.2	0	0	0	0	4.2	FALSE	FALSE
353	M17M7	7	7	16416	3.8	0	11.4	11.4	0.07	3.8	FALSE	FALSE
375	M3A2	6.2	6.2	11080.8	-1.3	196.9	7.695	204.57	0.36	-0.9	FALSE	FALSE
377	M3G1	6.1	6.1	4514.4	0.2	2.85	3.135	5.985	0.06	0.3	FALSE	FALSE
379	M3G2	6.2	6.2	3693.6	1.7	0.285	2.565	2.85	0.04	1.7	FALSE	FALSE
381	M3G3	6.4	6.4	410.4	3.1	0	0.285	0.285	0.01	3.1	FALSE	FALSE
384	M17A1	4.4	4.4	18900	0.3	45.5	13.125	58.625	0.15	0.5	FALSE	FALSE
403	M1A1	7.2	7.2	1728	-1	269.3	1.2	270.45	0.34	-0.7	FALSE	FALSE
418	M2A1	5.8	5.8	432	-2.1	64.2	0.3	64.5	0.19	-1.9	FALSE	FALSE
424	M3J1	5.4	5.4	820.8	3	162	0.57	162.53	0.28	3.3	FALSE	FALSE
451	M1A9	6.3	6.3	1728	3	185.1	1.2	186.3	0.28	3.3	FALSE	FALSE
523	M34A2	5.7	5.7	20709.15	-4.6	679.6	14.381	694	0.53	-4.1	FALSE	FALSE
530	M14A1	6.3	6.3	0	-4	752.8	0	752.77	0.58	-3.4	FALSE	FALSE
545	M7B1	8.4	8.4	2592	3.6	0.3	1.8	2.1	0.03	3.6	FALSE	FALSE
546	M7B2	7.7	7.7	432	4.9	0	0.3	0.3	0.02	4.9	FALSE	FALSE
549	M7A3	6.1	6.1	3888	-0.6	62.93	2.7	65.633	0.19	-0.4	FALSE	FALSE
550	M7D1	6	6	15552	1	45.53	10.8	56.333	0.18	1.2	FALSE	FALSE
551	M7D2	6	6	15552	1.8	28.73	10.8	39.533	0.16	2	FALSE	FALSE
552	M7D3	6.7	6.7	13824	2.7	13.13	9.6	22.733	0.12	2.8	FALSE	FALSE
553	M7E1	7.7	7.7	11136	4.9	0	7.7333	7.7333	0.07	5	FALSE	FALSE
554	M7H1	6.7	6.7	864	4.7	0	0.6	0.6	0.02	4.7	FALSE	FALSE
555	M7I2	6.1	6.1	864	4.6	0	0.6	0.6	0.02	4.6	FALSE	FALSE
559	M7D4	7.4	7.4	6912	4.4	0.6	4.8	5.4	0.06	4.5	FALSE	FALSE
560	M7G2	7.1	7.1	864	5.6	0	0.6	0.6	0.02	5.6	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
561	M7F2	7.7	7.7	864	5.8	0	0.6	0.6	0.02	5.8	FALSE	FALSE
564	M7A6	8	8	2592	4.9	0.3	1.8	2.1	0.04	5	FALSE	FALSE
565	M7D5	7.7	7.7	864	6.1	0	0.6	0.6	0.02	6.1	FALSE	FALSE
580	M7A5	7.7	7.7	3024	3.3	2.1	2.1	4.2	0.05	3.3	FALSE	FALSE
583	M7A4	6.6	6.6	3456	1.3	4.2	2.4	6.6	0.06	1.4	FALSE	FALSE
587	M7A2	6.1	6.1	3456	-2	65.63	2.4	68.033	0.19	-1.8	FALSE	FALSE
590	M7G1	6.3	6.3	6912	3.9	0.6	4.8	5.4	0.05	4	FALSE	FALSE
593	M7F1	6.5	6.5	6912	4.1	0.6	4.8	5.4	0.06	4.2	FALSE	FALSE
596	M3D4	6.7	7.5	3283.2	2	2.565	2.28	4.845	0.05	2	FALSE	FALSE
597	M3D3	6.6	6.6	2052	1.5	7.41	1.425	8.835	0.08	1.6	FALSE	FALSE
599	M3D6	6.3	6.3	410.4	3.9	0	0.285	0.285	0.11	4	FALSE	FALSE
600	M2A7	6.4	6.4	432	3.7	0	0.3	0.3	0.02	3.8	FALSE	FALSE
601	M3E1	5.4	5.4	3283.2	2.4	0.285	2.28	2.565	0.04	2.5	FALSE	FALSE
602	M3E2	5.3	5.3	410.4	3.3	0	0.285	0.285	0.02	3.3	FALSE	FALSE
603	M2O2	6.1	6.1	432	3.4	0	0.3	0.3	0.02	3.4	FALSE	FALSE
604	M2A6	6.3	6.3	3024	2.8	0.3	2.1	2.4	0.04	2.9	FALSE	FALSE
605	M2O1	6.1	6.1	3456	2.4	0.3	2.4	2.7	0.05	2.5	FALSE	FALSE
606	M2A4	7.3	7.3	3024	1.5	7.5	2.1	9.6	0.08	1.5	FALSE	FALSE
607	M2A5	7.3	7.3	3456	1.9	2.4	2.4	4.8	0.06	2	FALSE	FALSE
608	M2A3	7.1	7.1	3888	0.3	12.9	2.7	15.6	0.08	0.3	FALSE	FALSE
622	M36A11	5.8	5.8	0	2.8	0	0	0	0	2.8	FALSE	FALSE
623	M36A10	5.9	5.9	11970	1.4	0	8.3125	8.3125	0.06	1.5	FALSE	FALSE
624	M36A9	5.7	5.7	11970	1	8.313	8.3125	16.625	0.09	1.1	FALSE	FALSE
625	M36A8	5.9	5.9	23276.4	0.2	40.18	16.164	56.344	0.17	0.4	FALSE	FALSE
627	M36A6	5.8	5.8	23276.4	-1.7	72.51	16.164	88.673	0.21	-1.4	FALSE	FALSE
628	M36A5	6.4	6.4	23276.4	-2	88.67	16.164	104.84	0.23	-1.7	FALSE	FALSE
629	M36A4	5.9	5.9	11306.4	-2.2	104.8	7.8517	112.69	0.34	-1.9	FALSE	FALSE
630	M36A3	6.1	6.1	24924.06	-2.4	131.6	17.308	148.91	0.27	-2.2	FALSE	FALSE
631	M36E1	7.1	7.1	13617.66	2.2	9.457	9.4567	18.913	0.09	2.3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
632	M36H1	8.8	8.8	11306.4	3	15.7	7.8517	23.555	0.1	3.1	FALSE	FALSE
633	M36H2	9.3	9.3	11306.4	5.1	7.852	7.8517	15.703	0.08	5.2	FALSE	FALSE
634	M36H3	9.4	9.4	11306.4	6	0	7.8517	7.8517	0.06	6.1	FALSE	FALSE
641	M36A7	5.6	5.6	23276.4	-0.7	56.34	16.164	72.508	0.19	-0.5	FALSE	FALSE
648	M36E2	7.1	7.1	13617.66	6	0	9.4567	9.4567	0.07	6.1	FALSE	FALSE
650	M36A2	6.2	6.2	11306.4	-4.1	148.9	7.8517	156.76	0.28	-3.8	FALSE	FALSE
652	M36A1	5.8	5.8	76461.84	-5.2	420.6	53.098	473.73	0.43	-4.7	FALSE	FALSE
654	M36B1	6.5	6.5	50449.56	-4	228.8	35.034	263.87	0.37	-3.6	FALSE	FALSE
656	M36C2	5.3	7.9	15466.92	-0.5	69.33	10.741	80.072	0.19	-0.3	FALSE	FALSE
658	M36C3	8.2	8.2	33278.7	3.9	46.22	23.11	69.331	0.18	4.1	FALSE	FALSE
660	M36C4	8.6	8.6	15466.92	5.1	10.74	10.741	21.482	0.1	5.1	FALSE	FALSE
662	M36C5	8.5	10.4	15466.92	6	0	10.741	10.741	0.07	6.1	FALSE	FALSE
664	M36G2	8.9	8.9	17812.2	6	0	12.37	12.37	0.08	6.1	FALSE	FALSE
665	M36G1	8.8	8.8	17811.78	5	12.37	12.369	24.739	0.12	5.1	FALSE	FALSE
668	M36D2	6	6	0	1.9	29.8	0	29.802	0.15	2.1	FALSE	FALSE
670	M36D3	5.9	5.9	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
672	M36F1	5.5	5.5	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
674	M36B6	5.7	5.7	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
675	M36B5	6.5	6.5	0	2.1	14.9	0	14.901	0.08	2.1	FALSE	FALSE
677	M36B3	6.4	8.3	3439.8	-0.1	70.8	2.3888	73.19	0.18	0.1	FALSE	FALSE
679	M36I1	7.1	8.2	2192.4	1.5	41.08	1.5225	42.6	0.14	1.6	FALSE	FALSE
681	M36B2	6.3	6.3	50449.56	-3	73.19	35.034	108.22	0.24	-2.7	FALSE	FALSE
684	M36C1	8.3	8.3	15466.5	-2	80.07	10.741	90.812	0.21	-1.8	FALSE	FALSE
687	M36D1	8.3	8.3	0	1	29.8	0	29.802	0.12	1.1	FALSE	FALSE
690	M36B4	8	8	19152	0.5	14.9	13.3	28.201	0.12	0.7	FALSE	FALSE
693	M17A8	8.4	8.4	0	-2.1	505.9	0	505.93	0.45	-1.7	FALSE	FALSE
694	M17L1	7.7	10.5	0	0.9	45.04	0	45.041	0.14	1	FALSE	FALSE
696	M17L2	8.3	8.3	0	1.2	45.04	0	45.041	0.14	1.3	FALSE	FALSE
698	M17L3	6.7	6.7	10260	1.8	37.92	7.125	45.041	0.14	1.9	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
700	M17L4	7.6	7.6	16416	2.3	26.52	11.4	37.916	0.13	2.5	FALSE	FALSE
702	M17L5	7	7	16416	3.6	15.12	11.4	26.516	0.11	3.7	FALSE	FALSE
704	M17L6	7.2	7.2	21766.4	4	0	15.116	15.116	0.08	4.1	FALSE	FALSE
706	M3H2	5.4	5.4	2872.8	1.3	166.7	1.995	168.66	0.34	1.6	FALSE	FALSE
708	M3H3	5.5	5.5	2052	1.8	2.71	1.425	4.135	0.05	1.8	FALSE	FALSE
710	M3H4	4.9	4.9	1231.2	2.5	0.285	0.855	1.14	0.03	2.5	FALSE	FALSE
714	M3I1	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
716	M3K1	5.8	5.8	410.4	-5.1	0	1.285	1.285	6.93	1.8	FALSE	FALSE
718	M3L4	5.2	5.2	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
719	M3L3	3.9	3.9	2462.4	1.7	0.285	1.71	1.995	0.03	1.7	FALSE	FALSE
721	M3L2	5.7	5.7	2052	0.9	2.28	1.425	3.705	0.05	0.9	FALSE	FALSE
726	M3L1	5.9	5.9	4514.4	0.4	4.275	3.135	7.41	0.07	0.5	FALSE	FALSE
729	M3O1	6.3	6.3	410.4	5	0	0.285	0.285	0.01	5	FALSE	FALSE
731	M3H1	5.1	5.1	3693.6	-0.1	176.1	2.565	178.63	0.35	0.2	FALSE	FALSE
734	M3A3	6.1	6.1	2462.4	0.4	10.55	1.71	12.255	0.09	0.5	FALSE	FALSE
741	M3A4	5.8	5.8	2462.4	1.4	8.835	1.71	10.545	0.08	1.5	FALSE	FALSE
743	M3C2	5.6	5.6	410.4	2	0	0.285	0.285	0.02	2	FALSE	FALSE
749	M3A9	5.3	5.3	410.4	5	0	0.285	0.285	0.21	5.2	FALSE	FALSE
750	M3A8	5.4	5.4	820.8	4.3	0.285	0.57	0.855	0.03	4.3	FALSE	FALSE
752	M3A7	5.5	5.5	1641.6	3.5	0.855	1.14	1.995	0.04	3.6	FALSE	FALSE
754	M3A6	5.3	5.3	1231.2	2.9	1.995	0.855	2.85	0.05	2.9	FALSE	FALSE
756	M3A5	6.4	6.4	2872.8	1.7	2.85	1.995	4.845	0.06	1.8	FALSE	FALSE
760	M2B3	5.6	5.6	864	3	0.3	0.6	0.9	0.02	3	FALSE	FALSE
761	M2B2	5.9	5.9	1296	2	0.9	0.9	1.8	0.03	2	FALSE	FALSE
763	M2B1	5.9	5.9	1728	1	1.8	1.2	3	0.04	1	FALSE	FALSE
765	M2A2	6.2	6.2	6912	-1.3	33.9	4.8	38.7	0.15	-1.1	FALSE	FALSE
768	M2J1	6.1	6.1	1296	0.1	2.4	0.9	3.3	0.25	0.4	FALSE	FALSE
770	M2L1	5.7	5.7	864	0.6	0.6	0.6	1.2	0.03	0.7	FALSE	FALSE
772	M2M1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
776	M2L2	6	6	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
778	M2N1	6.1	6.1	432	0.9	0	0.3	0.3	0.02	0.9	FALSE	FALSE
780	M2I1	6	6	864	4	0	0.6	0.6	0.02	4	FALSE	FALSE
781	M2D4	5.5	5.5	3888	3	1.2	2.7	3.9	0.05	3.1	FALSE	FALSE
783	M2D3	5.4	5.4	3456	1.5	3.9	2.4	6.3	0.06	1.6	FALSE	FALSE
785	M2D2	5.4	5.4	2592	0	6.3	1.8	8.1	0.06	0.1	FALSE	FALSE
787	M2D1	5.8	5.8	5184	-1.7	9.3	3.6	12.9	0.08	-1.6	FALSE	FALSE
789	M2E1	5.9	5.9	1296	2	0.3	0.9	1.2	0.03	2	FALSE	FALSE
791	M2E2	5.8	5.8	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
795	M2C1	5.8	5.8	5184	-1.8	9	3.6	12.6	0.08	-1.7	FALSE	FALSE
797	M2F1	5.7	5.7	2160	0.4	2.1	1.5	3.6	0.05	0.4	FALSE	FALSE
799	M2F2	5.8	5.8	2160	2.1	0.6	1.5	2.1	0.04	2.1	FALSE	FALSE
801	M2F3	6.1	6.1	432	2.6	0	0.3	0.3	0.02	2.6	FALSE	FALSE
803	M2C2	5.6	5.6	4752	-1.3	2.1	3.3	5.4	0.06	-1.3	FALSE	FALSE
805	M2C3	5.7	5.7	2592	0.9	0.3	1.8	2.1	0.04	0.9	FALSE	FALSE
807	M2C4	5.3	5.3	432	2.3	0	0.3	0.3	0.02	2.3	FALSE	FALSE
809	M2R1	5.7	5.7	3888	1.8	5.4	2.7	8.1	0.07	1.8	FALSE	FALSE
811	M2R2	5.8	5.8	432	3.2	2.4	0.3	2.7	0.04	3.3	FALSE	FALSE
813	M1G1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
814	M1F1	6.1	6.1	5184	2.5	0.6	3.6	4.2	0.05	2.6	FALSE	FALSE
818	M1B2	6	6	4320	1.2	10.8	3	13.8	0.09	1.2	FALSE	FALSE
820	M1B3	5.9	5.9	1296	2.4	5.7	0.9	6.6	0.06	2.4	FALSE	FALSE
822	M1B4	5.6	5.6	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
826	M1H1	5.8	5.8	2160	2.9	3	1.5	4.5	0.05	2.9	FALSE	FALSE
830	M1H2	5.9	5.9	2160	3.3	1.2	1.5	2.7	0.04	3.3	FALSE	FALSE
834	M1H3	6.1	6.1	864	3.6	0.3	0.6	0.9	0.03	3.7	FALSE	FALSE
836	M1JJ4	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	FALSE
837	M1JJ3	6.1	6.1	6480	2.7	0.6	4.5	5.1	0.05	2.7	FALSE	FALSE
841	M1JJ2	6.3	6.3	6480	2.1	5.7	4.5	10.2	0.08	2.2	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
847	M1JJ1	6.6	6.6	6912	1.7	11.1	4.8	15.9	0.1	1.8	FALSE	FALSE
849	M1OO1	6.3	6.3	864	4.5	0.3	0.6	0.9	0.02	4.5	FALSE	FALSE
853	M1MM1	6.2	6.2	0	4.5	0	0	0	0	4.5	FALSE	FALSE
855	M1D2	6.7	6.7	4320	0.9	16.5	3	19.5	0.11	1	FALSE	FALSE
858	M1B1	6.5	6.5	6912	-0.4	13.8	4.8	18.6	0.1	-0.3	FALSE	FALSE
861	M1E4	6.6	6.6	27000	3	0	18.75	18.75	0.1	3.1	FALSE	FALSE
862	M1E3	5.7	5.7	0	1.5	18.75	0	18.75	0.11	1.6	FALSE	FALSE
864	M1E2	5.4	5.4	1296	0.7	20.55	0.9	21.45	0.11	0.8	FALSE	FALSE
866	M1E1	6.3	6.3	1728	-0.3	22.05	1.2	23.25	0.11	-0.1	FALSE	FALSE
868	M1A2	6.4	6.4	2592	-0.8	223.4	1.8	225.15	0.37	-0.4	FALSE	FALSE
871	M1A4	6.5	6.5	0	1	196.2	0	196.2	0.35	1.3	FALSE	FALSE
882	M1U1	6.1	6.1	0	2.6	1.8	0	1.8	0.03	2.6	FALSE	FALSE
884	M1A7	6.5	6.5	0	1.7	191.4	0	191.4	0.31	2	FALSE	FALSE
886	M1BB2	5.9	5.9	0	3	1.5	0	1.5	0.03	3	FALSE	FALSE
891	M1A10	6.7	6.7	32400	4.3	6.25	22.5	28.75	0.12	4.4	FALSE	FALSE
893	M1A11	8.2	8.2	9000	4.8	0	6.25	6.25	1.64	6.4	FALSE	FALSE
899	M23B2	6.9	6.9	5460	3.5	0	3.7917	3.7917	0.05	3.6	FALSE	FALSE
900	M23B1	5.4	5.4	56700	1.9	3.792	39.375	43.167	0.27	2.2	FALSE	FALSE
903	M17A2	6.1	7.8	3360	2.1	0	2.3333	2.3333	0.04	2.2	FALSE	FALSE
905	M5B2	6	6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
906	M5B1	6.4	6.4	3175.2	3	0.315	2.205	2.52	0.04	3	FALSE	FALSE
908	M5A3	6.2	6.2	7711.2	-2.4	22.23	5.355	27.585	0.11	-2.3	FALSE	FALSE
910	M5A2	6	6	4536	-2.7	38.3	3.15	41.445	0.15	-2.5	FALSE	FALSE
913	M5C1	6.4	6.4	3175.2	2	0.315	2.205	2.52	0.04	2	FALSE	FALSE
915	M5C2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
921	M5D3	6.3	6.3	4082.4	0.7	5.04	2.835	7.875	0.07	0.8	FALSE	FALSE
923	M5A4	6	6	3628.8	-0.7	17.19	2.52	19.71	0.11	-0.6	FALSE	FALSE
925	M5A6	5.8	5.8	3628.8	0.5	14.67	2.52	17.19	0.11	0.6	FALSE	FALSE
927	M5A7	6.5	6.5	3628.8	1.8	12.15	2.52	14.67	0.1	1.9	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
929	M5A8	6.3	6.3	4082.4	3.1	0.315	11.835	12.15	0.09	3.2	FALSE	FALSE
931	M5D4	6	6	3175.2	2.2	2.835	2.205	5.04	0.06	2.3	FALSE	FALSE
933	M5D5	6.3	6.3	3628.8	3.4	0.315	2.52	2.835	0.04	3.4	FALSE	FALSE
935	M5A9	5.8	5.8	453.6	4.5	0	0.315	0.315	0.02	4.5	FALSE	FALSE
937	M5D6	5.8	5.8	453.6	4.6	0	0.315	0.315	0.02	4.6	FALSE	FALSE
939	M4H2	5.9	5.9	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
940	M4H1	6.4	6.4	4082.4	2.5	0.315	2.835	3.15	0.04	2.5	FALSE	FALSE
944	M4A3	6.7	6.7	7257.6	0.7	17.33	5.04	22.365	0.12	0.8	FALSE	FALSE
946	M4B1	6.1	6.1	4536	2.5	0.315	3.15	3.465	0.05	2.5	FALSE	FALSE
948	M4B2	6.3	6.3	453.6	4.3	0	0.315	0.315	0.02	4.3	FALSE	FALSE
952	M4A4	6.7	6.7	7257.6	1.2	8.505	5.04	13.545	0.1	1.3	FALSE	FALSE
954	M4D1	6.5	6.5	907.2	3.5	0.63	0.63	1.26	0.03	3.5	FALSE	FALSE
956	M4E1	6.4	6.4	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
958	M4D2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
960	M4F1	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
961	M4A5	6.7	6.7	9525.6	1.8	0.63	6.615	7.245	0.07	1.8	FALSE	FALSE
964	M4G1	7.6	7.6	4536	3	3.623	3.15	6.7725	0.06	3.1	FALSE	FALSE
966	M4G2	7.4	7.4	907.2	5.4	2.993	0.63	3.6225	0.05	5.4	FALSE	FALSE
968	M4A6	7.2	7.2	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
970	M34F4	4.4	4.4	6171.9	1.8	0	4.286	4.286	1.63	3.5	FALSE	FALSE
971	M34F3	4.8	4.8	2646	1.2	4.286	1.8375	6.1235	1.65	2.8	FALSE	FALSE
979	M34H2	5.1	5.1	2646	0.9	0.525	1.8375	2.3625	0.17	1	FALSE	FALSE
983	M34I1	3.4	3.4	756	1.5	0	0.525	0.525	0.02	1.5	FALSE	FALSE
987	M34A7	4.3	4.3	13769	-0.5	245.7	9.5618	255.24	0.42	-0.1	FALSE	FALSE
989	M34J1	3.2	3.2	3780	0.1	3.413	2.625	6.0375	0.06	0.2	FALSE	FALSE
991	M34K1	4.5	4.5	4158	1.1	0.263	2.8875	3.15	0.05	1.1	FALSE	FALSE
993	M34K2	4.7	4.7	378	3	0	0.2625	0.2625	0.01	3	FALSE	FALSE
995	M34J2	5	5	378	2.5	0	0.2625	0.2625	0.01	2.5	FALSE	FALSE
997	M34A5	4.2	4.2	0	-2.1	365.3	0	365.33	0.43	-1.6	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
999	M34A4	4.1	4.1	0	-3	365.3	0	365.33	0.45	-2.5	FALSE	FALSE
1001	M34E2	7.1	7.1	2940	1.5	0	2.0417	2.0417	0.03	1.5	FALSE	FALSE
1003	M17M6	7.1	7.1	41040	2.5	11.4	28.5	39.9	0.14	2.6	FALSE	FALSE
1005	M17M5	6.8	6.8	16416	1.9	39.9	11.4	51.3	0.15	2	FALSE	FALSE
1007	M17M4	6.8	6.8	0	1	51.3	0	51.3	0.15	1.2	FALSE	FALSE
1009	M17M3	6.8	6.8	16416	0.6	51.3	11.4	62.7	0.17	0.8	FALSE	FALSE
1011	M17M2	6.9	6.9	16416	-0.3	62.7	11.4	74.1	0.19	-0.1	FALSE	FALSE
1013	M17M1	7	7	16416	-0.8	74.1	11.4	85.5	0.2	-0.6	FALSE	FALSE
1015	M17A3	9.6	9.6	2720.8	-6.4	591.4	1.8895	593.32	0.73	-5.7	FALSE	FALSE
1017	M17A6	8	8	0	-3.4	505.9	0	505.93	0.45	-3	FALSE	FALSE
1019	M17O3	8.4	8.4	32832	4.1	0	22.8	22.8	0.1	4.2	FALSE	FALSE
1020	M17O2	6.9	6.9	16416	2.9	22.8	11.4	34.2	0.13	3	FALSE	FALSE
1022	M17N1	6.7	6.7	49248	0.1	91.2	34.2	125.4	0.22	0.3	FALSE	FALSE
1024	M17N2	6.9	6.9	32832	3.7	11.4	22.8	34.2	0.13	3.8	FALSE	FALSE
1026	M17N3	6.8	6.8	0	4.7	11.4	0	11.4	0.07	4.7	FALSE	FALSE
1028	M17N4	7.6	7.6	16416	5.3	0	11.4	11.4	0.07	5.3	FALSE	FALSE
1030	M17A2	8	8	0	-6.6	718.7	0	718.72	0.75	-5.9	FALSE	FALSE
1033	M17U1	6.9	6.9	16416	-2.3	0	11.4	11.4	0.06	-2.2	FALSE	FALSE
1034	M17T3	8.1	8.1	0	-2.8	48.45	0	48.45	0.14	-2.7	FALSE	FALSE
1036	M17T4	8.2	8.2	16416	1.1	25.65	11.4	37.05	0.12	1.2	FALSE	FALSE
1038	M17V1	7.1	7.1	16416	1.8	2.85	11.4	14.25	0.08	1.9	FALSE	FALSE
1040	M17V2	6.8	6.8	4104	2.8	0	2.85	2.85	0.04	2.8	FALSE	FALSE
1042	M17T8	8.5	8.5	0	2.8	0	0	0	0	2.8	FALSE	FALSE
1043	M17T7	8	8	16416	2.4	0	11.4	11.4	0.07	2.5	FALSE	FALSE
1045	M17T6	7.2	7.2	0	2.1	11.4	0	11.4	0.07	2.1	FALSE	FALSE
1047	M17T5	7.7	7.7	0	1.8	11.4	0	11.4	0.07	1.9	FALSE	FALSE
1050	M17U2	7.6	7.6	0	-1	0	0	0	0	-1	FALSE	FALSE
1052	M17T2	7	7	0	-3.3	48.45	0	48.45	0.15	-3.2	FALSE	FALSE
1054	M17T1	7.4	7.4	0	-3.5	48.45	0	48.45	0.13	-3.3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1060	M17Q0	7.2	7.2	31920	0.6	37.05	22.167	59.217	0.17	0.8	FALSE	FALSE
1062	M17R1	6.9	6.9	0	1.8	0	0	0	0	1.8	FALSE	FALSE
1064	M17R2	7.1	7.1	0	2.9	0	0	0	0	2.9	FALSE	FALSE
1066	M17R3	7.6	7.6	0	3.6	0	0	0	0	3.6	FALSE	FALSE
1075	M17H3	8.4	8.4	4104	4.5	0	2.85	2.85	0.04	4.5	FALSE	FALSE
1076	M17H2	8.6	8.6	19494	3	2.85	13.538	16.388	0.09	3.1	FALSE	FALSE
1078	M17H1	8.7	8.7	4104	2.6	16.39	2.85	19.237	0.09	2.6	FALSE	FALSE
1082	M17G1	9.6	9.6	32832	4.8	0	22.8	22.8	0.1	4.9	FALSE	FALSE
1084	M17G2	9.4	9.4	0	7	0	0	0	0	7	FALSE	FALSE
1086	M17A12	9.4	9.4	131328	4	0	91.2	91.2	0.23	4.2	FALSE	FALSE
1092	M17P1	7	8.6	32832	2.9	5.7	22.8	28.5	0.11	3	FALSE	FALSE
1094	M17P2	7.4	7.4	0	4.1	5.7	0	5.7	0.05	4.2	FALSE	FALSE
1096	M17P3	8	9.5	8208	4.5	0	5.7	5.7	0.05	4.6	FALSE	FALSE
1141	M14I1	5.4	5.4	2052	-0.8	1.71	1.425	3.135	0.04	-0.8	FALSE	FALSE
1143	M14I2	5.3	5.3	2052	0.5	0.285	1.425	1.71	0.03	0.5	FALSE	FALSE
1145	M14I3	5.8	5.8	410.4	1.5	0	0.285	0.285	0.01	1.5	FALSE	FALSE
1147	M14J1	5.4	5.4	2052	-1.9	2.565	1.425	3.99	0.12	-1.8	FALSE	FALSE
1149	M14J2	5.7	5.7	1641.6	-0.7	1.425	1.14	2.565	0.04	-0.7	FALSE	FALSE
1151	M14J3	5.7	5.7	1641.6	0.3	0.285	1.14	1.425	0.03	0.3	FALSE	FALSE
1153	M14J4	5.9	5.9	410.4	1.4	0	0.285	0.285	0.01	1.4	FALSE	FALSE
1155	M14A5	5.2	5.2	7797.6	-2.4	83.58	5.415	88.999	0.64	-1.7	FALSE	FALSE
1157	M14L1	5.5	5.5	5335.2	0.1	0.57	3.705	4.275	0.04	0.1	FALSE	FALSE
1159	M14L2	5.2	5.2	820.8	1.5	0	0.57	0.57	0.02	1.5	FALSE	FALSE
1161	M14K1	5.2	5.2	3693.6	0.6	0.57	2.565	3.135	0.04	0.7	FALSE	FALSE
1163	M14K2	5.6	5.6	820.8	1.6	0	0.57	0.57	0.02	1.6	FALSE	FALSE
1165	M14B1	6.5	6.5	22002	-1.7	76.63	15.279	91.913	0.2	-1.5	FALSE	FALSE
1167	M14B2	5.3	5.3	110352	-1.4	0	76.633	76.633	0.29	-1.1	FALSE	FALSE
1169	M14A6	5.1	5.1	0	-0.5	76.17	0	76.174	0.19	-0.3	FALSE	FALSE
1173	M14M1	5.3	5.3	4924.8	-0.4	13.97	3.42	17.385	0.24	-0.2	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1175	M14N1	5.6	5.6	1641.6	0.9	0.57	1.14	1.71	0.03	0.9	FALSE	FALSE
1177	M14N2	5.5	5.5	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1179	M14O1	5.6	5.6	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1181	M14M2	6.6	6.6	4924.8	2.2	8.835	3.42	12.255	0.07	2.2	FALSE	FALSE
1183	M14P1	6.8	6.8	820.8	3.8	0	0.57	0.57	0.02	3.8	FALSE	FALSE
1185	M14M3	7.4	7.4	5745.6	3	4.275	3.99	8.265	0.07	3.1	FALSE	FALSE
1187	M14Q1	7.3	7.3	1231.2	4.3	0	0.855	0.855	0.02	4.3	FALSE	FALSE
1189	M14M4	8	8	4104	4.3	0.57	2.85	3.42	0.05	4.3	FALSE	FALSE
1191	M14R1	7.5	7.5	410.4	4.4	0	0.285	0.285	0.02	4.4	FALSE	FALSE
1193	M14M5	9.1	9.1	410.4	5.7	0	0.285	0.285	0.01	5.7	FALSE	FALSE
1195	M14A8	6.7	6.7	2462.4	-0.6	27.93	1.71	29.64	0.43	-0.2	FALSE	FALSE
1197	M14A9	8	8	2052	0.4	26.51	1.425	27.93	0.13	0.5	FALSE	FALSE
1199	M14Y1	7.8	7.8	410.4	4.8	0	0.285	0.285	0.01	4.8	FALSE	FALSE
1201	M14S1	5.3	5.3	10670.4	1	16.96	7.41	24.368	0.11	1.1	FALSE	FALSE
1203	M14X1	6.4	6.4	2052	2	0.713	1.425	2.1375	0.04	2	FALSE	FALSE
1205	M14X2	7.3	7.3	1026	3.3	0	0.7125	0.7125	0.02	3.3	FALSE	FALSE
1207	M14S2	5.7	5.7	2872.8	2.1	12.83	1.995	14.82	0.1	2.1	FALSE	FALSE
1209	M14S3	6	6	5335.2	2.9	7.41	3.705	11.115	0.08	2.9	FALSE	FALSE
1211	M14V1	7.6	7.6	820.8	3.9	0	0.57	0.57	0.02	3.9	FALSE	FALSE
1213	M14S4	7.7	7.7	5335.2	3.7	3.135	3.705	6.84	0.07	3.8	FALSE	FALSE
1215	M14W1	7.2	7.2	410.4	4.2	0	0.285	0.285	0.02	4.2	FALSE	FALSE
1217	M14S5	8	8	3693.6	4.7	0.285	2.565	2.85	0.04	4.7	FALSE	FALSE
1219	M14T1	6.3	6.3	1641.6	3.1	0.57	1.14	1.71	0.03	3.1	FALSE	FALSE
1221	M14U1	5.9	5.9	410.4	3.5	0	0.285	0.285	0.02	3.5	FALSE	FALSE
1223	M14T2	6.6	6.6	410.4	3.4	0	0.285	0.285	0.02	3.4	FALSE	FALSE
1225	M14S6	8.8	8.8	410.4	5.8	0	0.285	0.285	0.01	5.8	FALSE	FALSE
1227	M14A10	8.2	8.2	11491.2	1.2	18.24	7.98	26.22	0.12	1.3	FALSE	FALSE
1229	M14A11	8.3	8.3	6976.8	2	4.845	4.845	9.69	0.07	2.1	FALSE	FALSE
1231	M14BB1	8.4	8.4	2462.4	3.3	1.71	1.71	3.42	0.05	3.3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1233	M14BB2	8.4	8.4	2052	4.2	0.285	1.425	1.71	0.03	4.3	FALSE	FALSE
1235	M14AA1	8.6	8.6	4104	3.9	0.57	2.85	3.42	0.04	4	FALSE	FALSE
1237	M14AA2	8.4	8.4	820.8	4.8	0	0.57	0.57	0.02	4.8	FALSE	FALSE
1239	M14A12	8.9	8.9	1231.2	3.5	0.57	0.855	1.425	0.03	3.6	FALSE	FALSE
1241	M14A13	9	9	820.8	5	0	0.57	0.57	0.02	5	FALSE	FALSE
1243	M14BB3	8.4	8.4	410.4	5.2	0	0.285	0.285	0.02	5.2	FALSE	FALSE
1245	M14Z1	8.4	8.4	6566.4	4.2	0.57	4.56	5.13	0.05	4.2	FALSE	FALSE
1247	M14Z2	8.4	8.4	820.8	5.5	0	0.57	0.57	0.02	5.5	FALSE	FALSE
1269	M22A1	5	5	39480	-1.4	362.5	27.417	389.91	0.39	-1	FALSE	FALSE
1270	M22F1	4.7	4.7	0	-1.8	0	0	0	1.26	-0.5	FALSE	FALSE
1274	M22A2	4.8	4.8	20412	-0.8	348.3	14.175	362.49	0.53	-0.3	FALSE	FALSE
1276	M22B1	6.2	6.2	123832.8	1.2	0.945	85.995	86.94	0.2	1.4	FALSE	FALSE
1278	M22B2	5.6	5.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
1280	M22E1	5.3	5.3	453.6	2.6	0	0.315	0.315	0.01	2.6	FALSE	FALSE
1282	M22A3	5.2	5.2	24494.4	0.9	244.4	17.01	261.37	0.37	1.3	FALSE	FALSE
1287	M26A1	5.4	5.4	5443.2	0	0.63	3.78	4.41	-0.03	0	FALSE	FALSE
1315	M17Q5	7.6	7.6	4104	5.3	0	2.85	2.85	0.04	5.3	FALSE	FALSE
1316	M17Q4	7.2	7.2	32832	4.1	2.85	22.8	25.65	0.12	4.2	FALSE	FALSE
1318	M17Q3	7.2	7.2	16416	3.3	25.65	11.4	37.05	0.13	3.4	FALSE	FALSE
1325	M40A1	8	8	0	-0.6	90.53	0	90.528	0.21	-0.4	FALSE	FALSE
1326	M40A2	7.9	7.9	0	0.3	88.08	0	88.078	0.1	0.4	FALSE	FALSE
1328	M40A3	8.4	8.4	0	1.5	88.08	0	88.078	0.1	1.6	FALSE	FALSE
1330	M40A4	7.5	7.5	0	2.7	88.08	0	88.078	0.2	2.9	FALSE	FALSE
1347	M34U1	5.1	5.1	15807.75	2.6	0	10.978	10.978	0.08	2.7	FALSE	FALSE
1348	M34L1	4.7	4.7	3250.8	1.6	15.8	2.2575	18.058	0.1	1.7	FALSE	FALSE
1350	M34A8	4.6	4.6	5292	0	236	3.675	239.64	0.58	0.6	FALSE	FALSE
1354	M16A5	5.8	5.8	0	0.6	31.71	0	31.711	0.14	0.7	FALSE	FALSE
1355	M16A6	5.4	5.4	22680	1.1	15.96	15.75	31.711	0.12	1.2	FALSE	FALSE
1357	M16A7	6.2	6.2	6200.88	2.8	4.568	4.3062	8.8737	0.06	2.8	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1359	M16A8	6.1	6.1	0	3.5	4.568	0	4.5675	0.05	3.6	FALSE	FALSE
1361	M16A9	7	7	5443.2	3.9	0.788	3.78	4.5675	0.04	4	FALSE	FALSE
1363	M16A10	6.9	6.9	1134	5.1	0	0.7875	0.7875	0.02	5.1	FALSE	FALSE
1365	M16G1	4.2	4.2	7257.6	2.5	2.048	5.04	7.0875	0.06	2.5	FALSE	FALSE
1367	M16G2	5.5	5.5	2948.4	3.4	0	2.0475	2.0475	0.04	3.5	FALSE	FALSE
1369	M37A4	5.5	5.5	1503.6	-0.4	43.66	1.0442	44.699	0.14	-0.3	FALSE	FALSE
1370	M37A3	5.4	5.4	4510.8	-1.6	44.7	3.1325	47.831	0.15	-1.5	FALSE	FALSE
1372	M37A2	5.3	5.3	9021.6	-2.8	49.92	6.265	56.185	0.16	-2.6	FALSE	FALSE
1374	M37B1	4.8	4.8	3007.2	-1.7	0	2.0883	2.0883	0.03	-1.7	FALSE	FALSE
1376	M37A1	5.7	5.7	0	-3.2	69.76	0	69.759	0.16	-3	FALSE	FALSE
1378	M37C1	6	6	9021.6	-2.6	7.309	6.265	13.574	0.08	-2.6	FALSE	FALSE
1380	M37E1	5.3	5.3	3007.2	-1.6	0	2.0883	2.0883	0.03	-1.6	FALSE	FALSE
1382	M37C2	6.3	6.3	4510.8	-1.4	2.088	3.1325	5.2208	0.05	-1.3	FALSE	FALSE
1384	M37C3	5.1	5.1	1503.6	-0.4	0	1.0442	1.0442	0.02	-0.4	FALSE	FALSE
1395	M17B2	9	9	0	2.6	173.1	0	173.14	0.56	3.1	FALSE	FALSE
1397	M17B3	8	8	32832	3.4	150.3	22.8	173.14	0.29	3.7	FALSE	FALSE
1399	M17C1	7.7	7.7	16416	3.7	0	11.4	11.4	0.07	3.8	FALSE	FALSE
1401	M17B4	8.1	8.1	0	4	138.9	0	138.94	0.48	4.5	FALSE	FALSE
1403	M17B5	9.7	9.7	16416	4.7	127.5	11.4	138.94	0.26	4.9	FALSE	FALSE
1405	M17I1	8.1	8.1	16416	4.9	0	11.4	11.4	0.07	5	FALSE	FALSE
1407	M17B6	7.7	7.7	68742	5.6	68.4	47.737	116.14	0.23	5.8	FALSE	FALSE
1409	M17D1	8.1	8.1	16416	6.2	0	11.4	11.4	0.07	6.3	FALSE	FALSE
1411	M17B7	8.1	8.1	16416	6.1	45.6	11.4	57	-0.27	5.9	FALSE	FALSE
1413	M17B9	7.6	7.6	16416	6.5	34.2	11.4	45.6	0.15	6.7	FALSE	FALSE
1415	M17E1	8.6	8.6	16416	7	0	11.4	11.4	0.07	7.1	FALSE	FALSE
1417	M17B10	10.2	10.2	16416	7	11.4	11.4	22.8	0.11	7.1	FALSE	FALSE
1419	M17B11	10.3	10.3	16416	7.8	0	11.4	11.4	0.07	7.8	FALSE	FALSE
1421	M34E1	5.1	5.1	0	-0.9	2.042	0	2.0417	0.03	-0.9	FALSE	FALSE
1424	M32A1	5.8	5.8	0	-1.2	59.74	0	59.743	0.17	-1	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1426	M32C1	5.7	5.7	0	0	13.81	0	13.805	-0.31	-0.3	FALSE	FALSE
1430	M32A2	7.2	7.2	21413.28	0.8	31.07	14.87	45.938	0.15	0.9	FALSE	FALSE
1432	M32A3	5.6	5.6	12285	1.1	22.54	8.5313	31.068	0.12	1.3	FALSE	FALSE
1434	M32A4	5.3	5.3	23784.18	1.9	0	16.517	16.517	0.09	2	FALSE	FALSE
1436	M32D1	4.8	4.8	8668.8	1.4	0	6.02	6.02	0.06	1.4	FALSE	FALSE
1440	M31A4	5.5	5.5	22378.02	0.4	0	15.54	15.54	0.11	0.5	FALSE	FALSE
1441	M31A3	7.4	7.4	26877.48	-0.1	15.54	18.665	34.205	0.13	0.1	FALSE	FALSE
1443	M31A2	7.7	7.7	28061.88	-2.3	34.21	19.487	53.693	0.16	-2.1	FALSE	FALSE
1445	M31A1	6.2	6.2	56089.32	-4	86.48	38.951	125.43	0.24	-3.7	FALSE	FALSE
1446	M31B1	5.8	5.8	13608	-0.4	23.34	9.45	32.788	0.12	-0.3	FALSE	FALSE
1449	M31B2	6.3	6.3	8022	0.8	17.77	5.5708	23.338	0.1	0.9	FALSE	FALSE
1451	M31B4	4.3	4.3	11116.56	3.4	0	7.7198	7.7198	0.06	3.5	FALSE	FALSE
1455	M34A13	4.7	4.7	378	2.1	6.3	0.2625	6.5625	0.07	2.2	FALSE	FALSE
1456	M34A11	4.4	4.4	0	1.5	213.1	0	213.13	0.41	1.9	FALSE	FALSE
1458	M34A10	4.4	4.4	756	0.8	213.1	0.525	213.65	0.42	1.2	FALSE	FALSE
1461	M34A12	4.5	4.5	756	1.7	7.088	0.525	7.6125	0.27	1.9	FALSE	FALSE
1497	M18A-B1	5.3	5.3	2721.6	0.9	0	1.89	1.89	0.03	0.9	FALSE	FALSE
1499	M18A-A4	5.5	5.5	2268	0.2	67.5	1.575	69.074	0.55	0.7	FALSE	FALSE
1501	M18A-A5	5.3	5.3	8164.8	0.7	61.83	5.67	67.499	0.19	0.9	FALSE	FALSE
1503	M18A-C1	8.2	8.2	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	FALSE
1505	M18A-A6	5.4	5.4	1360.8	1.2	60.25	0.945	61.199	0.17	1.4	FALSE	FALSE
1507	M18A-D1	9.2	9.2	6350.4	2.5	0	4.41	4.41	0.05	2.5	FALSE	FALSE
1509	M18A-A7	7.7	7.7	1360.8	1.7	54.9	0.945	55.844	0.16	1.9	FALSE	FALSE
1511	M18A-A8	8.3	8.3	2268	2.1	53.32	1.575	54.899	0.16	2.3	FALSE	FALSE
1513	M46A1	4.9	4.9	(N/A)	0.8	(N/A)	(N/A)	(N/A)	(N/A)	(N/A)	FALSE	FALSE
1519	M34C1	6.5	6.5	11550	-1	26.4	8.0208	34.417	0.11	-0.9	FALSE	FALSE
1521	M34C2	7.1	7.1	0	-0.3	26.4	0	26.396	0.11	-0.2	FALSE	FALSE
1523	M34C3	7.2	7.2	5460	1.7	22.6	3.7917	26.396	0.11	1.8	FALSE	FALSE
1525	M34C4	7.6	7.6	2310	2.9	21	1.6042	22.604	0.1	3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1527	M34C5	8.5	8.5	30240	4.1	0	21	21	0.1	4.2	FALSE	FALSE
1529	M34D2	5.5	5.5	12640.25	3.6	0	8.778	8.778	0.06	3.6	FALSE	FALSE
1530	M34D1	5.7	5.7	0	2.9	8.778	0	8.778	0.06	3	FALSE	FALSE
1532	M34B1	5.8	5.8	8050	1.7	19.21	5.5903	24.795	0.11	1.8	FALSE	FALSE
1534	M34B2	6.7	6.7	0	2.3	10.43	0	10.427	0.07	2.3	FALSE	FALSE
1536	M34B3	5.7	5.7	2520	2.9	8.677	1.75	10.427	0.07	3	FALSE	FALSE
1538	M34B4	5.3	5.3	10220	3.5	1.58	7.0972	8.6771	0.06	3.6	FALSE	FALSE
1540	M34B5	6	6	2275	4.3	0	1.5799	1.5799	0.03	4.3	FALSE	FALSE
1550	M17F1	9.1	9.1	32832	2.8	78.28	22.8	101.08	0.39	3.2	FALSE	FALSE
1552	M17F2	8.9	8.9	0	3.9	78.28	0	78.277	0.22	4.1	FALSE	FALSE
1554	M17F3	10.9	10.9	70178.4	4	29.54	48.735	78.277	0.19	4.2	FALSE	FALSE
1556	M17F4	10	10	42540	5.2	0	29.542	29.542	0.14	5.4	FALSE	FALSE
1568	M14H5	5.7	5.7	8208	5.2	0	5.7	5.7	0.06	5.3	FALSE	FALSE
1579	M16B1	6.4	6.4	4116	-2	32.05	2.8583	34.912	0.11	-1.9	FALSE	FALSE
1581	M16B2	6	6	8232	-1.7	17.18	5.7167	22.896	0.12	-1.5	FALSE	FALSE
1583	M16A2	6	6	0	-2.6	95.48	0	95.475	0.19	-2.4	FALSE	FALSE
1585	M16A3	5.4	5.4	11655	-1.4	87.38	8.0938	95.475	0.21	-1.2	FALSE	FALSE
1587	M16D1	6.1	6.1	24347.4	-0.1	7.554	16.908	24.462	0.12	0	FALSE	FALSE
1589	M16D2	4.8	4.8	10878	2	0	7.5542	7.5542	0.06	2.1	FALSE	FALSE
1591	M16A4	4.1	4.1	44940	-0.3	31.71	31.208	62.92	0.15	-0.1	FALSE	FALSE
1599	M38D2	8	8	8750.7	0.7	0	6.0769	6.0769	0.06	0.7	FALSE	FALSE
1600	M38D1	5.7	5.7	8750.7	0.1	6.077	6.0769	12.154	0.07	0.2	FALSE	FALSE
1602	M38A6	6	6	8750.7	-1.1	13.87	6.0769	19.946	0.1	-1	FALSE	FALSE
1604	M17O1	6.9	6.9	32832	1.7	34.2	22.8	57	0.16	1.8	FALSE	FALSE
1609	M3D2	6.3	6.3	3283.2	0.6	8.835	2.28	11.115	0.09	0.7	FALSE	FALSE
1611	M3D1	6.4	6.4	2872.8	-0.2	11.12	1.995	13.11	0.1	-0.1	FALSE	FALSE
1614	M3F1	6.6	6.6	4514.4	-0.4	136	3.135	139.17	0.29	-0.1	FALSE	FALSE
1616	M3F2	6	6	4514.4	1.5	132.9	3.135	136.04	0.29	1.8	FALSE	FALSE
1680	M19A2	5.2	5.2	0	1.5	0	0	0	0	1.5	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1681	M19A1	5.4	5.4	0	1	0	0	0	0	1	FALSE	FALSE
1695	M38A5	4.9	4.9	18901.68	-2.1	19.95	13.126	33.072	0.12	-2	FALSE	FALSE
1697	M38A4	5	5	18901.68	-3.8	33.07	13.126	46.198	0.15	-3.7	FALSE	FALSE
1701	M38A3	5.1	5.1	18901.68	-5.5	46.2	13.126	59.324	0.18	-5.4	FALSE	FALSE
1703	M38A2	6.6	6.6	38973.06	-7.2	100.3	27.065	127.39	0.25	-7	FALSE	FALSE
1705	M38C1	7	7	38973.06	-0.7	13.94	27.065	41.003	0.14	-0.6	FALSE	FALSE
1709	M38A1	6.1	6.1	20090.99	-8.9	168.3	13.952	182.2	0.3	-8.6	FALSE	FALSE
1711	M38B1	6.5	6.5	19609.59	-1.6	27.24	13.618	40.853	0.14	-1.4	FALSE	FALSE
1713	M38B2	7.1	7.1	19609.59	0.1	13.62	13.618	27.236	0.11	0.2	FALSE	FALSE
1717	M16A1	5.9	5.9	15456	-2.8	138.3	10.733	149	0.27	-2.5	FALSE	FALSE
1726	M16H1	6.4	6.4	4998	-1.9	2.829	3.4708	6.3	0.06	-1.8	FALSE	FALSE
1727	M16F1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1729	M16B4	7.2	7.2	8988	5	0	6.2417	6.2417	0.05	5	FALSE	FALSE
1731	M16B3	7.2	7.2	11634	-1.5	6.242	8.0792	14.321	0.08	-1.4	FALSE	FALSE
1732	M16E1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1735	M16H2	6.7	6.7	4074	4.2	0	2.8292	2.8292	0.03	4.2	FALSE	FALSE
1751	M31B3	5.4	5.4	14468.16	1.7	7.72	10.047	17.767	0.09	1.7	FALSE	FALSE
1755	M30A9	4.1	4.1	0	3.8	0.63	0	0.63	0.02	3.8	FALSE	FALSE
1756	M30A8	4.4	4.4	453.6	3.1	0.63	0.315	0.945	0.03	3.1	FALSE	FALSE
1757	M30A6	3.3	3.3	0	2.7	1.26	0	1.26	0.03	2.7	FALSE	FALSE
1758	M30K1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1759	M30A5	3.8	3.8	2721.6	2.2	2.52	1.89	4.41	0.05	2.2	FALSE	FALSE
1760	M30J1	4	4	907.2	3.5	0	0.63	0.63	0.02	3.5	FALSE	FALSE
1761	M30A4	3.6	3.6	2721.6	1.4	5.67	1.89	7.56	0.07	1.5	FALSE	FALSE
1762	M30I1	3.4	3.4	907.2	2	0	0.63	0.63	0.02	2	FALSE	FALSE
1763	M30H1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1764	M30A3	3.7	3.7	1814.4	0.6	8.505	1.26	9.765	0.07	0.6	FALSE	FALSE
1767	M30A1	3.5	3.5	1814.4	-0.9	28.35	1.26	29.61	0.12	-0.8	FALSE	FALSE
1836	M29A1	4.5	4.5	1814.4	-1.6	23	1.26	24.255	0.09	-1.5	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3102	M34G1	5.2	5.2	68390	3.8	0	47.493	47.493	0.16	4	FALSE	FALSE
3105	M34O1	5.3	5.3	1814.4	2.9	0.63	1.26	1.89	0.03	2.9	FALSE	FALSE
3107	M34O2	5	5	907.2	3.3	0	0.63	0.63	0.02	3.3	FALSE	FALSE
3112	M29A2	4.5	4.5	8164.8	-0.7	8.505	5.67	14.175	0.08	-0.6	FALSE	FALSE
3118	M29E1	5.4	5.4	907.2	4	0	0.63	0.63	0.02	4	FALSE	FALSE
3120	M29B1	4.2	4.2	3628.8	-1	5.67	2.52	8.19	0.07	-0.9	FALSE	FALSE
3122	M29F1	4.6	4.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
3125	M29B2	4.5	4.5	4989.6	0	1.575	3.465	5.04	0.05	0.1	FALSE	FALSE
3127	M29B4	4.6	4.6	453.6	2.5	0	0.315	0.315	0.01	2.5	FALSE	FALSE
3129	M29G1	4.5	4.5	0	2.5	0	0	0	0	2.5	FALSE	FALSE
3131	M29C1	5	5	0	2	0.63	0	0.63	0.02	2	FALSE	FALSE
3133	M29C2	5.1	5.1	907.2	3	0	0.63	0.63	0.02	3	FALSE	FALSE
3135	M34L2	4.3	4.3	1360.8	2.3	3.878	0.945	4.8225	0.05	2.4	FALSE	FALSE
3137	M34M1	4.4	4.4	378	2.8	0.525	0.2625	0.7875	0.02	2.9	FALSE	FALSE
3139	M34M2	4.8	4.8	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	FALSE
3141	M34N1	4.5	4.5	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3143	M34L3	4.2	4.2	3693.6	2.9	0.525	2.565	3.09	0.04	2.9	FALSE	FALSE
3145	M34L4	4.4	4.4	756	3.9	0	0.525	0.525	0.02	3.9	FALSE	FALSE
3147	M34A16	5	5	378	4.9	0	0.2625	0.2625	0.01	4.9	FALSE	FALSE
3148	M34A14	4.3	4.3	4158	2.3	2.888	2.8875	5.775	0.06	2.3	FALSE	FALSE
3152	M34T1	4	4	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3155	M30A10	4.6	4.6	453.6	4	0.315	0.315	0.63	0.02	4	FALSE	FALSE
3165	M30A11	4.6	4.6	453.6	4.4	0	0.315	0.315	0.02	4.4	FALSE	FALSE
3168	M30C2	4	4	453.6	1.3	0	0.315	0.315	0.02	1.3	FALSE	FALSE
3170	M30C1	4	4	2268	-0.5	0.315	1.575	1.89	0.03	-0.5	FALSE	FALSE
3174	M30B1	3.2	3.2	1360.8	-0.5	12.6	0.945	13.545	0.08	-0.4	FALSE	FALSE
3176	M30B4	4	4	0	1.7	4.095	0	4.095	0.05	1.8	FALSE	FALSE
3178	M30B5	4.8	4.8	453.6	2.2	3.78	0.315	4.095	0.05	2.3	FALSE	FALSE
3180	M30B6	4.9	4.9	4536	2.7	0.63	3.15	3.78	0.05	2.7	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3182	M30B7	4.1	4.1	453.6	3.6	0	0.315	0.315	0.01	3.6	FALSE	FALSE
3184	M30M1	4.6	4.6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
3186	M30B2	2.8	2.8	3628.8	0	10.08	2.52	12.6	0.08	0.1	FALSE	FALSE
3189	M30E1	3	3	2721.6	1.5	0	1.89	1.89	0.03	1.5	FALSE	FALSE
3191	M30B3	2.8	2.8	3175.2	1	5.985	2.205	8.19	0.07	1.1	FALSE	FALSE
3194	M30F1	2.6	2.6	2721.6	1.8	0	1.89	1.89	0.04	1.8	FALSE	FALSE
3243	M18C9	5.3	5.3	453.6	3.4	75.33	0.315	75.649	0.19	3.6	FALSE	FALSE
3246	M18C2	5.5	5.5	10432.8	3	76.59	7.245	83.839	0.19	3.2	FALSE	FALSE
3276	M18C1	5.4	5.4	11793.6	2.5	83.84	8.19	92.029	0.21	2.7	FALSE	FALSE
3304	M24D1	7.9	7.9	3628.8	-0.9	1.26	2.52	3.78	0.06	-0.8	FALSE	FALSE
3319	M24A2	5.4	5.4	1814.4	-1	0.63	1.26	1.89	0.11	-0.9	FALSE	FALSE
3328	M25A1	4.6	4.6	5443.2	-1	44.47	3.78	48.252	0.13	-0.8	FALSE	FALSE
3330	M25C1	5.6	5.6	5896.8	0.6	1.26	4.095	5.355	0.05	0.7	FALSE	FALSE
3346	M25A4	4.6	4.6	4536	1	13.98	3.15	17.127	0.09	1.1	FALSE	FALSE
3348	M25A2	5.6	5.6	8618.4	-0.4	23.11	5.985	29.097	0.13	-0.3	FALSE	FALSE
3357	M25B1	5.3	5.3	5896.8	0.3	10.02	4.095	14.115	0.08	0.3	FALSE	FALSE
3364	M7C1	8	8	7344	-0.9	104.5	5.1	109.59	0.23	-0.7	FALSE	FALSE
3377	M7C3	8.3	8.3	9936	0.7	84.46	6.9	91.361	0.21	0.9	FALSE	FALSE
3383	M25B2	5.4	5.4	9979.2	0.9	1.83	6.93	8.76	0.08	1	FALSE	FALSE
3389	M25A5	4	4	453.6	1.5	13.35	0.315	13.662	0.08	1.6	FALSE	FALSE
3391	M25A6	4.6	4.6	18765.6	1.9	0.315	13.032	13.347	0.08	2	FALSE	FALSE
3397	M25K1	4.2	4.2	453.6	2.4	0	0.315	0.315	0.01	2.4	FALSE	FALSE
3406	M18E3	7	7	907.2	1.3	0	0.63	0.63	0.02	1.3	FALSE	FALSE
3422	M1C2	6.7	6.7	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
3423	M1C1	6.4	6.4	5184	2	0.3	3.6	3.9	0.04	2	FALSE	FALSE
3509	M35A1	6	6	0	-1.3	452.8	0	452.83	0.5	-0.8	FALSE	FALSE
3511	M35A2	6.7	6.7	9904.23	-0.1	83.01	6.8779	89.89	0.21	0.1	FALSE	FALSE
3513	M35A3	6.7	6.7	24740.52	1.5	65.83	17.181	83.012	0.2	1.7	FALSE	FALSE
3515	M35D1	6	6	49581.63	2	0	34.432	34.432	0.13	2.1	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3642	M18A-A1	5.1	5.1	0	-1	76	0	76.004	0.17	-0.8	FALSE	FALSE
3682	M22A4	5.5	5.5	0	1.6	244.4	0	244.36	0.43	2	FALSE	FALSE
3901	M13A1	5.5	5.5	7194.6	3.2	3.334	4.9963	8.33	0.06	3.3	FALSE	FALSE
3947	M10A1	9.3	9.3	2898	5.5	0.467	2.0125	2.4792	0.04	5.5	FALSE	FALSE
3949	M29A3	4.6	4.6	7711.2	0.2	2.52	5.355	7.875	0.06	0.2	FALSE	FALSE
3982	M38D3	6.5	6.5	0	1.1	0	0	0	0	1.1	FALSE	FALSE
3989	M35A4	6.8	6.8	17653.86	2.7	19.14	12.26	31.4	0.12	2.8	FALSE	FALSE
4007	M9A1	6.9	6.9	71442	-0.3	66.94	49.613	116.55	0.24	-0.1	FALSE	FALSE
4011	M9B1	5.8	5.8	34020	0.5	23.63	23.625	47.25	0.15	0.6	FALSE	FALSE
4017	M5D1	6	6	0	-1	10.71	0	10.71	0.07	-1	FALSE	FALSE
4019	M5D2	6.2	6.2	4082.4	-0.8	7.875	2.835	10.71	0.08	-0.8	FALSE	FALSE
4022	M5A1	6.4	6.4	3175.2	-2.9	43.97	2.205	46.17	0.16	-2.8	FALSE	FALSE
4024	M4A2	7.5	7.5	0	0.3	22.37	0	22.365	0.11	0.4	FALSE	FALSE
4027	M3B1	5.7	5.7	1641.6	1.9	2.565	1.14	3.705	0.05	1.9	FALSE	FALSE
4029	M3B2	5.8	5.8	1231.2	2.8	1.425	0.855	2.28	0.04	2.9	FALSE	FALSE
4031	M3B3	5.5	5.5	410.4	3.3	1.14	0.285	1.425	0.03	3.3	FALSE	FALSE
4033	M3B4	5.4	5.4	1231.2	3.6	0.285	0.855	1.14	0.03	3.6	FALSE	FALSE
4041	M2H1	5.5	5.5	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	FALSE
4049	M2R3	5.9	5.9	2592	3.7	0.6	1.8	2.4	0.04	3.8	FALSE	FALSE
4056	M2T1	5.9	5.9	3024	2.3	0.6	2.1	2.7	0.04	2.3	FALSE	FALSE
4062	M2P1	6	6	4320	0	12.3	3	15.3	0.09	0.1	FALSE	FALSE
4065	M2P2	6.1	6.1	5184	0.5	0.6	3.6	4.2	0.05	0.6	FALSE	FALSE
4071	M2J2	6.4	6.4	432	1	0.6	0.3	0.9	0.02	1	FALSE	FALSE
4079	M1A3	6.4	6.4	2160	-0.1	198	1.5	199.5	0.34	0.3	FALSE	FALSE
4082	M1O1	5.5	5.5	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4090	M1Q1	5.4	5.4	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4097	M1HH1	5.6	5.6	2592	3.5	0.6	1.8	2.4	0.04	3.5	FALSE	FALSE
4103	M1BB1	6.3	6.3	0	2.4	3.6	0	3.6	0.04	2.4	FALSE	FALSE
4106	M1KK1	6.8	6.8	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4111	M1BB3	5.9	5.9	432	3.9	0.3	0.3	0.6	0.02	3.9	FALSE	FALSE
4115	M1CC1	6.3	6.3	432	3.5	0.6	0.3	0.9	0.02	3.5	FALSE	FALSE
4121	M1EE1	6.2	6.2	432	2.9	0.6	0.3	0.9	0.02	2.9	FALSE	FALSE
4127	M1A8	6.4	6.4	1296	1.9	186.9	0.89999	187.8	0.29	2.2	FALSE	FALSE
4148	M1U2	5.8	5.8	432	3.6	0.3	0.3	0.6	0.02	3.6	FALSE	FALSE
4152	M1V1	6.4	6.4	864	3	0.6	0.6	1.2	0.03	3	FALSE	FALSE
4158	M1S1	6.2	6.2	0	1.8	3	0	3	0.04	1.8	FALSE	FALSE
4161	M1S2	5.7	5.7	864	2.5	0.6	0.6	1.2	0.03	2.5	FALSE	FALSE
4168	M1M1	5.3	5.3	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4174	M1K1	5.1	5.1	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4180	M1D1	7	7	3024	-0.2	19.5	2.1	21.6	0.11	-0.1	FALSE	FALSE
4183	M1D3	6.4	6.4	432	3	0.3	0.3	0.6	0.02	3	FALSE	FALSE
4196	M34A15	4	4	3402	3.3	0.263	2.3625	2.625	0.04	3.3	FALSE	FALSE
4199	M29A4	4.7	4.7	2268	1.1	0.315	1.575	1.89	0.03	1.1	FALSE	FALSE
4203	M29B3	4.6	4.6	1814.4	2	0.315	1.26	1.575	0.03	2	FALSE	FALSE
4206	M30A7	3.7	3.7	0	2.8	1.26	0	1.26	0.03	2.8	FALSE	FALSE
4217	M25A3	4.2	4.2	0	0.2	17.13	0	17.127	0.09	0.3	FALSE	FALSE
4239	M7C2	8.6	8.6	14580	-0.1	92.86	10.125	102.99	0.24	0.1	FALSE	FALSE
4280	M17A4	9.5	9.5	0	-6.3	505.9	0	505.93	0.68	-5.7	FALSE	FALSE
4283	M17A5	8.4	8.4	0	-5.7	505.9	0	505.93	0.6	-5.1	FALSE	FALSE
4314	M18D1	5.2	5.2	1360.8	3.2	0	0.945	0.945	0.03	3.2	FALSE	FALSE
4384	M32B1	6.3	6.3	13356	2	8.699	9.275	17.974	0.08	2.1	FALSE	FALSE
4416	M30A2	3.6	3.6	1814.4	-0.2	11.66	1.26	12.915	0.08	-0.1	FALSE	FALSE
4452	M38A7	6.3	6.3	0	-0.5	1.715	0	1.715	0.03	-0.5	FALSE	FALSE
4476	M4A1	7.5	7.5	17628	0.1	32.29	12.242	44.529	0.16	0.3	FALSE	FALSE

EXHIBIT E.3
FORCEMAIN DATA TABLE REPORT

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3880	O1L42FB2	PMP-42a	O1L42J1		25	6.4	2	0.013	111.61	111.61	11.4	10	114%	6.74
3494	O2L19FB2	PMP-19B	O1L34J2	Steel	342	8.2	8	0.013	1747.5	1747.5	11.15	10	112%	28.55
3495	O2L19F2	O1L34J2	O2L19J1	Steel	49	6.8	8	0.013	1747.5	1747.5	11.15	10	112%	4.09
3508	O2L19F1	O2L19J1	O2L34J2	Ductile Iron		20.7	8	0.012	1747.5	1747.5	11.15	10	112%	1.06
3489	O2L34F1	O1L34J1	O-2	Ductile Iron		17.4	12	0.012	3723.9	3723.9	10.56	10	106%	0.5
3507	O2L34F2	O2L34J2	O1L34J1	Ductile Iron		23.9	12	0.012	3552.1	3552.1	10.08	10	101%	0.63
1744	O2L31FA2	PMP-31A	O2L31J2	Steel	77	8	3	0.013	201.26	201.26	9.13	10	91%	26.91
3919	O2L45FA2	PMP-45a	O2L45J2	PVC	25	7.6	2	0.01	86.238	86.238	8.81	10	88%	4.18
3921	O2L45F2	O2L45J1	O2L45J2	PVC		39.6	2	0.01	-86.238	-86.238	8.81	10	88%	6.62
3720	O2L18A-F1	O2L18AJ1	M18C9	PVC		71.5	2	0.01	75.334	75.334	7.69	10	77%	9.31
3650	O2L36F2	O2L36J2	O2L36J1	Ductile Iron		585.8	8	0.013	1194.8	1194.8	7.63	10	76%	14.88
3652	O2L36F1	M34A1	O2L36J1	Ductile Iron		48	8	0.012	-1194.8	-1194.8	7.63	10	76%	1.22
527	O2L34FA2	PMP-34A	O2L34J6	Ductile Iron	154	11.3	8	0.012	1150.9	1150.9	7.35	10	74%	3.65
2455	O2L34F5	O2L34J5	O2L34J4	Ductile Iron		2007	8	0.012	1150.9	1150.9	7.35	10	74%	47.56
3624	O2L34F6	O2L34J6	O2L34J5	Ductile Iron		46.9	8	0.012	1150.9	1150.9	7.35	10	74%	1.11
1296	O2L26F1	O2L26J1	M22A4	PVC		142.1	3	0.01	159.28	159.28	7.23	10	72%	10.27
1792	O2L26FB2	PMP-26B	O2L26J1	Steel	79	10.1	3	0.013	159.28	159.28	7.23	10	72%	9.28
446	O2L6FA2	PMP-6A	O2L6J1		74	6.9	3	0.013	153.95	153.95	6.99	10	70%	5.02
3077	O2L16FA2	PMP-16A	O2L16J2	Ductile Iron	77	7.6	4	0.012	269.04	269.04	6.87	10	69%	10.94
3739	O2L16F2	O2L16J2	O2L16J1	PVC		363.9	4	0.01	269.04	269.04	6.87	10	69%	17.1
3811	O2L32F1	O2L32J1	M34A3	PVC		681.8	4	0.01	268.71	268.71	6.86	10	69%	31.97
474	O1L14FA1	PMP-14A	O1L14J3	Steel	134	7.5	6	0.013	547.15	547.15	6.21	10	62%	5.29
3606	O1L14FA2	W-14	PMP-14A	Ductile Iron	44	7.8	6	0.012	547.15	547.15	6.21	10	62%	1.07
4399	O2L47F2	O2L47J2	O2L47J1	PVC		13.6	2	0.01	56.842	56.842	5.8	10	58%	1.05
4410	O2L47FB1	PMP-47B	O2L47J2	PVC	40	7.3	2	0.01	56.842	56.842	5.8	10	58%	3.09
3942	O2L33F2	O2L33J2	O2L33J1	PVC		32.6	2	0.01	56.531	56.531	5.77	10	58%	2.49
3944	O2L33FA2	PMP-33A	O2L33J2	Steel	70	5.9	2	0.013	56.531	56.531	5.77	10	58%	8.7
3821	O2L7FA2	PMP-7A	O2L7J2	Ductile Iron	104	7.6	4	0.012	213.42	213.42	5.45	10	55%	3.18
3825	O2L7F2	O2L7J2	O2L7J1	PVC		31.1	4	0.01	213.42	213.42	5.45	10	55%	0.95

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3927	O2L46FA2	PMP-46a	O2L46J1	PVC	25	6.3	2	0.01	53.324	53.324	5.45	10	55%	1.72
3932	O2L46F1	O2L46J1	M18A-A8	PVC		213.3	2	0.01	53.324	53.324	5.45	10	55%	14.64
3587	O2L44F2	O1L44J2	O1L44J1	PVC		124.3	2	0.01	52.785	52.785	5.39	10	54%	8.37
3695	O2L44FA2	PMP-44a	O1L44J2	PVC	25	7.1	2	0.01	52.785	52.785	5.39	10	54%	1.68
217	O2L11F1	O2L11J1	O2L10J2	PVC		477.6	6	0.01	455.24	455.24	5.17	10	52%	8.25
477	O2L10F2	O2L10J2	O2L10J1	PVC		613.4	6	0.01	455.24	455.24	5.17	10	52%	10.59
3964	O2L10F1	O2L10J1	O2L36J3	Ductile Iron		287.1	6	0.012	455.24	455.24	5.17	10	52%	4.96
3664	O2L31F2	O2L31J2	O2L31J1	PVC		1088.2	4	0.01	201.26	201.26	5.14	10	51%	29.87
3506	O2L34F3	O2L34J3	O2L34J2	Ductile Iron		21.1	12	0.012	1804.6	1804.6	5.12	10	51%	0.16
3089	O2L29FA2	PMP-29A	O2L29J2	Steel	78	11.7	3	0.013	104.88	104.88	4.76	10	48%	7.74
3095	O2L29F2	O2L29J2	O2L29J1	PVC		12.7	3	0.01	104.88	104.88	4.76	10	48%	0.42
1691	O2L22A2	PMP-22A	O2L22J2	Steel	113	7.5	4	0.013	183.34	183.34	4.68	10	47%	4.24
3716	O2L22F1	O2L22J2	O2L22J1	PVC		973.6	4	0.013	183.34	183.34	4.68	10	47%	22.48
216	O2L12F1	O2L12J1	O2L11J1	PVC		333.4	6	0.01	409.22	409.22	4.64	10	46%	4.73
4402	O2L47F1	O2L47J1	M34A11	PVC		559.7	3	0.01	100.64	100.64	4.57	10	46%	17.28
3725	O2L18F4	O2L18J3	O2L18J2	Ductile Iron		170.7	3	0.012	97.859	97.859	4.44	10	44%	5.01
163	O2L18F1	O2L18J1	O2L36J2	Ductile Iron		130.4	8	0.012	689.45	689.45	4.4	10	44%	1.2
3730	O2L18F3	O2L18J2	O2L18J1	Cast iron		1013.7	8	0.012	689.45	689.45	4.4	10	44%	13.04
3527	O2L35FA2	PMP-35A	O2L35J2	Steel	90	6.9	4	0.013	171.8	171.8	4.39	10	44%	3
3529	O2L35F2	O2L35J2	O2L35J1	PVC		9.4	4	0.01	171.8	171.8	4.39	10	44%	0.19
3536	O2L35F1	O2L35J1	O1L34J1	PVC		2583.6	4	0.01	171.8	171.8	4.39	10	44%	52.9
3975	O1L43FA1	PMP-43a	O1L43J1	PVC	25	7.5	2	0.01	42.611	42.611	4.35	10	44%	1.13
3978	O1L43F1	O1L43J1	M37A4	PVC		533.5	2	0.01	42.611	42.611	4.35	10	44%	24.17
4470	O2L48F1	O2L48J1	M36I1	PVC		570.6	2	0.01	41.077	41.077	4.19	10	42%	24.15
1798	O1LS14F1	O1L14J1	O-1	PVC		10.5	10	0.01	1019.9	1019.9	4.17	10	42%	0.07
423	O2L2F1	O2L2J1	M3J1	Asbestos Cement		569.4	4	0.011	161.96	161.96	4.13	10	41%	12.47
3865	O2L2FA2	PMP-2A	O2L2J1	Ductile Iron	112	10.6	4	0.012	161.96	161.96	4.13	10	41%	2.06
390	O2L23FB2	PMP-23B	O2L23F1	Steel	84	8.2	3	0.013	89.097	89.097	4.04	10	40%	3.37
3979	O2L22F1	O2L22J1	O2L34J3	Ductile Iron		348.7	8	0.012	619.27	619.27	3.95	10	40%	2.62

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3830	O2L6F1	O2L6J1	M1A9	PVC		631.6	4	0.01	153.95	153.95	3.93	10	39%	10.55
464	O1L17FB2	W-17	PMP-17B	Steel	21.1	9.5	6	0.013	333.17	333.17	3.78	10	38%	0.33
3728	O2L1F1	O2L1J1	O2L18J2	Cast iron		255.1	8	0.012	591.6	591.6	3.78	10	38%	2.47
427	O2L25FA2	PMP-25A	O2L25J1	Ductile Iron	84	10.6	3	0.012	82.961	82.961	3.77	10	38%	1.81
3827	O2L25F1	O2L25J1	M7C3	PVC		626.2	3	0.01	82.961	82.961	3.77	10	38%	13.52
511	O2F32FB1	W-32	PMP-32B	Ductile Iron	16.1	9.7	4	0.012	142.69	142.69	3.64	10	36%	0.23
3913	O2L32FB2	PMP-32B	O2L32J2	Ductile Iron	101	6.8	4	0.012	142.69	142.69	3.64	10	36%	1.47
3998	O2L32F2	O2L32J2	O2L32J1	PVC		521.1	4	0.01	142.69	142.69	3.64	10	36%	7.56
2443	O1L14F2	O1L14J2	O1L14J1	PVC		1384.7	10	0.01	880.32	880.32	3.6	10	36%	6.74
3482	O1L40FA1	PMP-40a	O1L40J1	Ductile Iron	70	13.3	4	0.012	139.62	139.62	3.56	10	36%	0.98
3955	O1L40F1	O1L14J1	O1L40J1	Cast iron		1155.4	4	0.012	-139.62	-139.62	3.56	10	36%	22.6
409	O2L1FA2	PMP-1A	O2L1J2	Ductile Iron	10	6.4	4	0.012	137.79	137.79	3.52	10	35%	20.12
3873	O2L1F2	O2L1J2	O2L1J1	PVC		347.6	4	0.012	137.79	137.79	3.52	10	35%	4.73
3586	O2L38F1	O2L38J1	M35A1	PVC		1300	6	0.01	309.12	309.12	3.51	10	35%	10.96
3882	O2L38FA2	PMP-38a	O2L38J1	Steel	100	6.2	6	0.013	309.12	309.12	3.51	10	35%	1.37
3753	O1L14F3	O1L14J3	O1L14J2	Ductile Iron		14.8	8	0.012	547.15	547.15	3.49	10	35%	0.09
1669	O2L45F1	O2L45J1	O2L12J1	PVC		161.3	6	0.01	302.14	302.14	3.43	10	34%	1.3
434	O2L18A-FB	PMP-18A-B	O2L18AJ1	Steel	66	8.2	3	0.013	75.334	75.334	3.42	10	34%	1.94
3835	O2L5F2	O2L5J2	O2L5J1	Asbestos Cement		693.6	4	0.011	132.9	132.9	3.39	10	34%	10.76
3841	O2L5F1	O2L5J1	M3F3	Asbestos Cement		90.1	4	0.011	132.9	132.9	3.39	10	34%	1.37
3747	O2L15F2	O2L15J2	O2L15J1	PVC		27.2	3	0.01	74.29	74.29	3.37	10	34%	0.48
3749	O2L15FA2	PMP-15A	O2L15J2	Ductile Iron	78	6	3	0.012	74.29	74.29	3.37	10	34%	1.37
1813	O2L34F4	O2L34J4	O2L34J3	PVC		2328.2	12	0.01	1185.3	1185.3	3.36	10	34%	8.08
3968	O2L36F3	O2L36J2	O2L36J3	Ductile Iron		1431.2	8	0.012	-505.32	-505.32	3.23	10	32%	7.39
3809	O2L9FA1	W-9	PMP-9A	Cast iron	27	8	4	0.012	126.02	126.02	3.22	10	32%	0.44
3810	O2L9FA2	PMP-9A	O2L9J1	Cast iron	76	6.1	4	0.012	126.02	126.02	3.22	10	32%	1.23
3815	O2L9F1	O2L9J1	O2L32J1	Ductile Iron		555	4	0.012	126.02	126.02	3.22	10	32%	6.4
489	O2L4F5	O2L4J5	O2L4J4	Ductile Iron		30.3	4	0.012	124.51	124.51	3.18	10	32%	0.34
3085	O2L4FA2	PMP-4A	O2L4J5	Ductile Iron	105	7.3	4	0.012	124.51	124.51	3.18	10	32%	1.18

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3851	O2L4F4	O2L4J4	O2L4J3	Asbestos Cement		752.6	4	0.011	124.51	124.51	3.18	10	32%	10.12
3854	O2L4F3	O2L4J3	O2L4J2	Asbestos Cement		1169.3	4	0.011	124.51	124.51	3.18	10	32%	15.73
3856	O2L4F2	O2L4J2	O2L4J1	Asbestos Cement		374.9	4	0.011	124.51	124.51	3.18	10	32%	5.04
3858	O2L4F1	O2L4J1	O2L5J2	Asbestos Cement		42	4	0.011	124.51	124.51	3.18	10	32%	0.57
1490	O2L39F1	O2L39J1	M35A1	PVC		751.7	2	0.01	29.869	29.869	3.05	10	31%	17.64
3890	O2L39FA2	PMP-39a	O2L39J1	Ductile Iron	25	9	2	0.012	29.869	29.869	3.05	10	31%	0.59
199	O2L7F1	O2L1J1	O2L7J1	Cast iron		671.6	8	0.012	-453.81	-453.81	2.9	10	29%	2.84
1140	O1L42F1	O1L42J1	M14C1	Ductile Iron		1075.3	4	0.012	111.61	111.61	2.85	10	29%	9.9
3603	O2L16F1	O2L16J1	O2L41J1	Ductile Iron		496.3	8	0.013	435.92	435.92	2.78	10	28%	1.95
3604	O2L41F1	O2L41J1	O2L22J1	Ductile Iron		785.4	8	0.013	435.92	435.92	2.78	10	28%	3.08
3775	O2L12FB2	PMP-12B	O2L12J2	PVC	90	7.2	4	0.01	107.08	107.08	2.73	10	27%	0.77
3778	O2L12F2	O2L12J2	O2L12J1	PVC		30.5	4	0.01	107.08	107.08	2.73	10	27%	0.26
3864	O2L24F1	O2L24J1	O2L7J1	Asbestos Cement		561.1	6	0.011	240.39	240.39	2.73	10	27%	3.54
3672	O2L29F1	O2L29J1	M34A11	Ductile Iron		604.4	4	0.012	104.88	104.88	2.68	10	27%	4.96
395	O2L3FA2	PMP-3A	O2L3J2	Ductile Iron	98	6.9	4	0.012	104.48	104.48	2.67	10	27%	1.9
4048	O2L3F2	O2L3J1	O2L3J2	Cast iron		1248	4	0.012	-104.48	-104.48	2.67	10	27%	14.27
1668	O2L33F1	O2L33J1	O2L45J1	PVC		820.9	6	0.01	215.9	215.9	2.45	10	25%	3.56
143	O2L18AFB2	PMP-18B	O2L18J3	Ductile Iron	66	10.5	3	0.01	51.242	51.242	2.33	10	23%	0.58
3711	O2L23F1	O2L23F1	O2L24J1	PVC		474	4	0.01	89.097	89.097	2.27	10	23%	2.88
3451	O1L37F1	M14D4	O1L37J1	PVC		61.8	4	0.01	-88.302	-88.302	2.25	10	23%	0.37
3452	O1L37FA1	PMP-37a	O1L37J1	Steel	78	8.8	4	0.013	88.302	88.302	2.25	10	23%	0.76
466	O1L17FB1	PMP-17B	O1L17J4		155	8.3	8	0.012	333.17	333.17	2.13	10	21%	0.37
468	O1L17F3	O1L17J4	O1L17J3	Steel		7.9	8	0.013	333.17	333.17	2.13	10	21%	0.03
2441	O1L17F1	O1L17J1	O1L14J2	Ductile Iron		255.7	8	0.012	333.17	333.17	2.13	10	21%	0.61
2460	O1L17F2	O1L17J1	O1L17J2	Ductile Iron		1095.9	8	0.012	-333.17	-333.17	2.13	10	21%	2.61
2462	O1L17F2	O1L17J2	O1L17J3	PVC		1271	8	0.01	-333.17	-333.17	2.13	10	21%	3.03
393	O2L24FA2	PMP-24A	O2L24J2	Steel	84	8.3	3	0.013	46.812	46.812	2.12	10	21%	1.02
3708	O2L24F2	O2L24J2	O2L24J1	PVC		542.3	3	0.01	46.812	46.812	2.12	10	21%	4.06
407	O2L18A-FA	PMP-18A	O2L18J3	Steel	66	10.8	3	0.013	46.617	46.617	2.12	10	21%	0.8

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3785	O2L11FA2	PMP-11A	O2L11J1	Ductile Iron	77	5.9	3	0.012	46.023	46.023	2.09	10	21%	0.56
3788	O2L11F2	O2L11J1	O2L11J1	Ductile Iron		41.5	3	0.012	46.023	46.023	2.09	10	21%	0.3
1783	O2L30FA2	PMP-30A	O2L30J1	PVC	77	8.8	3	0.01	43.798	43.798	1.99	10	20%	1.12
3659	O2L30F1	O2L30J1	O2L47J1	PVC		413.1	3	0.01	43.798	43.798	1.99	10	20%	2.73
4472	O2L48FA2	PMP-48A	O2L48J1	PVC	70	6.2	3	0.01	41.077	41.077	1.86	10	19%	0.41
214	O2L15F1	O2L15J1	O2L33J1	PVC		1180.6	6	0.01	159.37	159.37	1.81	10	18%	2.92
3486	O2L19FB1	W-19	PMP-19B	Steel	0.1	7.7	20	0.013	1747.5	1747.5	1.78	10	18%	0
3762	O2L13FA1	W-13	PMP-13A	Ductile Iron	16	7.3	3	0.012	32.293	32.293	1.47	10	15%	0.06
517	O2L36FA2	PMP-36A	O2L36J4	Steel	90	7.2	4	0.013	50.074	50.074	1.28	10	13%	0.31
3614	O2L36F4	O2L36J4	O2L36J3	Ductile Iron		1394.3	4	0.012	50.074	50.074	1.28	10	13%	2.91
3862	O2L3F1	O2L3J1	O2L24J1	Cast iron		2688.9	6	0.012	104.48	104.48	1.19	10	12%	4.27
506	O2L34FA1	W-34	PMP-34A	Ductile Iron	0.1	10.6	20	0.012	1150.9	1150.9	1.18	10	12%	0
3663	O2L31F1	O2L31J1	O2L16J1	Ductile Iron		653.2	8	0.012	166.88	166.88	1.07	10	11%	0.43
213	O2L13F1	O2L13J1	O2L15J1			584.2	6	0.013	85.077	85.077	0.97	10	10%	0.54
3764	O2L13FA2	PMP-13A	O2L13J2	Ductile Iron	69	8.5	4	0.012	32.293	32.293	0.82	10	8%	0.06
3767	O2L13F2	O2L13J2	O2L13J1	Ductile Iron		24.7	4	0.012	32.293	32.293	0.82	10	8%	0.02
212	O2L44F1	O1L44J1	O2L13J1	PVC		1303.2	6	0.01	52.785	52.785	0.6	10	6%	0.42
3881	O2L38FA1	W-38	PMP-38a	Steel	0.1	7.5	20	0.013	309.12	309.12	0.32	10	3%	0
3081	O2L16FA1	W-16	PMP-16A	Steel	1	8	20	0.013	269.04	269.04	0.27	10	3%	0
3662	O2L19F1	O2L34J4	O2L31J1	Cast iron		48.8	8	0.013	-34.375	-34.375	0.22	10	2%	0
3819	O2L7FA1	W-7	PMP-7A	Ductile Iron	1.1	7.1	20	0.012	213.42	213.42	0.22	10	2%	0
3925	O2L46FA1	W-46	PMP-46a	PVC	0.1	7.6	10	0.01	53.324	53.324	0.22	10	2%	0
3694	O2L44FA1	W-44	PMP-44a	PVC	0.1	8.1	10	0.01	52.785	52.785	0.22	10	2%	0
3832	O2L5FA2	PMP-5A	O2L5J3	Ductile Iron	93	6.7	4	0.012	8.3964	8.3964	0.21	10	2%	0.01
3834	O2L5F3	O2L5J3	O2L5J2	Ductile Iron		16.9	4	0.012	8.3964	8.3964	0.21	10	2%	0
1743	O2L31FA1	W-31	PMP-31A	Ductile Iron	0.1	8.6	20	0.012	201.26	201.26	0.21	10	2%	0
1690	02L23FA1	W-23	PMP-22A	Ductile Iron	1	8.7	20	0.012	183.34	183.34	0.19	10	2%	0
3525	O2L35FA1	W-35	PMP-35A	Steel	0.1	7.2	20	0.013	171.8	171.8	0.18	10	2%	0
417	O2L2FA1	W-2	PMP-2A	Steel	0.1	8.7	20	0.013	161.96	161.96	0.17	10	2%	0

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
1791	O2L26FB1	W-26	PMP-26B	Natural stream we	0.1	7.7	20	0.045	159.28	159.28	0.16	10	2%	0
445	O2L6FA1	W-6	PMP-6A	Ductile Iron	0.1	7.5	20	0.012	153.95	153.95	0.16	10	2%	0
3481	O1L40FA2	W-40	PMP-40a	PVC	0.1	9.8	20	0.01	139.62	139.62	0.14	10	1%	0
3870	O2L1FA1	W-1	PMP-1A	Steel	0.1	7.5	20	0.013	137.79	137.79	0.14	10	1%	0
3849	O2L4FA1	W-4	PMP-4A	Ductile Iron	0.1	8.2	20	0.012	124.51	124.51	0.13	10	1%	0
3879	O1L42FB1	W-42	PMP-42a		1	7	20	0.013	111.61	111.61	0.11	10	1%	0
3773	O2L12FB1	W-12	PMP-12B	Ductile Iron	0.1	9	20	0.012	107.08	107.08	0.11	10	1%	0
3090	O2L29FA1	W-29	PMP-29A	PVC	0.1	11.1	20	0.01	104.88	104.88	0.11	10	1%	0
373	O2L3FA1	W-3	PMP-3A	Ductile Iron	0.1	7.8	20	0.012	104.48	104.48	0.11	10	1%	0
389	O2L23FB1	W-23	PMP-23B	Steel	1	8.2	20	0.013	89.097	89.097	0.09	10	1%	0
3453	O1L37FA2	W-37	PMP-37a	PVC	0.1	9.7	20	0.01	88.302	88.302	0.09	10	1%	0
3918	O2L45FA1	W-45	PMP-45a	PVC	0.1	7.1	20	0.01	86.238	86.238	0.09	10	1%	0
426	O2L25FA1	W-25	PMP-25A	Ductile Iron	0.1	7.7	20	0.012	82.961	82.961	0.08	10	1%	0
432	O2L18A-FA	W-18A	PMP-18A-b	Steel	0.1	13.2	20	0.013	75.334	75.334	0.08	10	1%	0
3961	O2L15FA1	W-15	PMP-15A	Ductile Iron		7.2	20	0.012	74.29	74.29	0.08	10	1%	0
4405	O2L47FB1	W-47	PMP-47B	PVC	0.1	9.5	20	0.01	56.842	56.842	0.06	10	1%	0
3943	O2L11FA1	W-33	PMP-33A	Ductile Iron	0.1	6.7	20	0.012	56.531	56.531	0.06	10	1%	0
149	O2L18FB1	W-18	PMP-18B	Ductile Iron	0.1	8.9	20	0.01	51.242	51.242	0.05	10	1%	0
516	O2L36FA1	W-36	PMP-36A	Steel	0.1	8.2	20	0.013	50.074	50.074	0.05	10	1%	0
392	O2L24FA1	W-24	PMP-24A	PVC	0.1	9.1	20	0.01	46.812	46.812	0.05	10	1%	0
406	O2L18FA1	W-18	PMP-18A	Steel	0.1	8.8	20	0.013	46.617	46.617	0.05	10	1%	0
3783	O2L11FA1	W-11	PMP-11A	Ductile Iron	0.1	8.4	20	0.012	46.023	46.023	0.05	10	1%	0
1782	O2L30FA1	W-30	PMP-30A	Cast iron	0.1	8	20	0.012	43.798	43.798	0.04	10	0%	0
3974	O1L43FA2	W-35	PMP-43a	PVC	0.1	7.6	20	0.01	42.611	42.611	0.04	10	0%	0
4471	O2L48FA1	W-48	PMP-48A	PVC	0.1	8.1	20	0.01	41.077	41.077	0.04	10	0%	0
3889	O2L39FA1	W-39	PMP-39a	PVC	0.1	8.2	20	0.01	29.869	29.869	0.03	10	0%	0
3831	O2L5FA1	W-5	PMP-5A	Ductile Iron	0.1	7.6	20	0.012	8.3964	8.3964	0.01	10	0%	0
3605	O2L41F2	O2L41J2	O2L41J1			192.7	1.3	0.013	-0.00012	-0.00012	0	10	0%	0
3899	O2L41FA2	PMP-41a	O2L41J2	PVC	25	7	2	0.01	-0.00012	-0.00012	0	10	0%	0

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3797	O2L10F3	O2L10J3	O2L10J2	Ductile Iron		37.5	3	0.012	-1.95E-05	-1.95E-05	0	10	0%	0
2437	NA	O2L4J4	na			163.1	4	0.011	3.19E-05	3.19E-05	0	10	0%	0
3898	O2L41FA1	W-41	PMP-41a	PVC	0.1	7.2	20	0.01	-0.00012	-0.00012	0	10	0%	0
2433	NA	M3F3	na			97.3	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
2435	NA	na	na			126.6	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
3793	O2L10FA1	W-10	PMP-10A	Ductile Iron	0.1	8.3	20	0.012	-1.61E-05	-1.61E-05	0	10	0%	0
3795	O2L10FA2	PMP-10A	O2L10J3	Ductile Iron	99	6.6	3	0.012	0	0	0	10	0%	0
142	O2L24FB1	W-24	PMP-24B	Ductile Iron	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
150	O2L25FB2	PMP-25B	O2L25J1	Ductile Iron	84	9.2	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
151	O2L24FB2	PMP-24B	O2L24J2	Steel	84	7.3	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
152	O2L22FB1	W-23	PMP-22B	Ductile Iron	1	7.4	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
165	O1L17FA2	W-17	PMP-17A	Steel	21.1	6.7	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
166	O2L22FB2	PMP-22B	O2L22J2	Ductile Iron	112	7.3	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
168	O1L14FB2	W-14	PMP-14B	Ductile Iron	44	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
170	O2L34FC1	W-34	PMP-34C	Ductile Iron	0.1	6.9	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
177	O2L36FB1	W-36	PMP-36B	Ductile Iron	0.1	9.2	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
184	O2L36FB2	PMP-36B	O2L36J4	Ductile Iron	90	7.9	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
374	O2L3FB1	W-3	PMP-3B	Ductile Iron	0.1	8.3	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
386	O2L23FA1	W-23	PMP-23A	Steel	1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
387	O2L23FA2	PMP-23A	O2L23F1	Steel	84	9	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
394	O2L3FB2	PMP-3B	O2L3J2	Ductile Iron	98	8.4	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
401	O2L1FB2	PMP-1B	O2L1J2	Ductile Iron	10	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
413	O2L2FB1	W-2	PMP-2B	Steel	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
415	O2L2FB2	PMP-2B	O2L2J1	Ductile Iron	112	9.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
435	O2L18A-FA	PMP-18A-a	O2L18AJ1	Steel	66	8.3	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
436	O2L18A-FA	PMP-18A-a	W-18A	Steel	0.1	8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
443	O2L6FB2	PMP-6B	O2L6J1	PVC	74	6.1	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
444	O2L6FB1	W-6	PMP-6B	Ductile Iron	0.1	7	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
467	O1L17FA1	PMP-17A	O1L17J4	Steel	155	8.3	8	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
473	O1L14FB1	PMP-14B	O1L14J3	Steel	134	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
486	O2L4FB2	PMP4B	O2L4J5	Ductile Iron	105	6.6	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
487	O2L4FB1	W-4	PMP4B	Ductile Iron	0.1	8.5	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
492	O2L5FB1	W-5	PMP-5B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
494	O2L5FB2	PMP-5B	O2L5J3	Ductile Iron	93	5.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
513	O2F32FA1	W-32	PMP-32A	Ductile Iron	16.1	9.8	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
514	O2L32FA2	PMP-32A	O2L32J2	Ductile Iron	101	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
526	O2L34FC2	PMP-34C	O2L34J6	Ductile Iron	154	7.8	8	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1693	O2L34FB1	W-34	PMP-34B	Ductile Iron	0.1	8.4	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1694	O2L34FB2	PMP-34B	O2L34J6	Ductile Iron	154	9.4	8	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1745	O2L31FB2	PMP-31B	O2L31J2	Steel	77	9.6	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1746	O2L31FB1	W-31	PMP-31B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1784	O2L30FB2	PMP-30B	O2L30J1	PVC	77	8.1	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1785	O2L30FB1	W-30	PMP-30B	Cast iron	0.1	7.4	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1793	O2L26FA2	PMP-26A	O2L26J1	Steel	79	6.1	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1794	O2L26FA1	W-26	PMP-26A	PVC	1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
2454	NA	J-97	na			612.3	4	0.011	(N/A)	(N/A)	(N/A)	10	######	(N/A)
2466	NA	na	J-97			2074.5	4	0.011	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3078	O2L16FB2	PMP-16B	O2L16J2	Ductile Iron	77	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3082	O2L16FB1	W-16	PMP-16B	Steel	1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3086	O2L29FB1	W-29	PMP-29B	PVC	0.1	10	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3088	O2L29FB2	PMP-29B	O2L29J2	PVC	78	11.7	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3454	O1L37FB1	PMP-37b	O1L37J1	Ductile Iron	78	6.4	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3455	O1L37FB2	W-37	PMP-37b		0.1	8.8	10	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3483	O1L40FB2	W-40	PMP-40b	PVC	0.1	12.3	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3484	O1L40FB1	PMP-40b	O1L40J1	Ductile Iron	70	10	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3487	O2L19FA1	W-19	PMP-19A	Steel	0.1	7.9	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3493	O2L19FA2	PMP-19A	O1L34J2	Steel	341	8.5	8	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3566	O2L38FB1	W-38	PMP-38b	Steel	0.1	8.3	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3568	O2L38FB2	PMP-38b	O2L38J1	Steel	100	7.3	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3651	O2L34BYEF	O2L36J1	O2L34J5	Ductile Iron		15.2	8	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3696	O2L44FB1	W-44	PMP-44b	PVC	0.1	8.3	10	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3697	O2L44FB2	PMP-44b	O1L44J2		25	6.8	0	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3744	O2L15FB2	PMP-15B	O2L15J2	Ductile Iron	78	6	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3768	O2L13FB1	W-13	PMP-13B	Ductile Iron	16	9.1	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3769	O2L13FB2	PMP-13B	O2L13J2	Ductile Iron	69	9.6	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3779	O2L12FA1	W-12	PMP-12A	Ductile Iron	0.1	8.2	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3780	O2L12FA2	PMP-12A	O2L12J2	Ductile Iron	90	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3789	O2L11FB1	W-11	PMP-11B	Ductile Iron	0.1	8	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3790	O2L11FB2	PMP-11B	O2L11J1	Ductile Iron	77	6	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3799	O2L10FB1	W-10	PMP-10B	Ductile Iron	0.1	5.6	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3800	O2L10FB2	PMP-10B	O2L10J3	Ductile Iron	99	7.5	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3803	O2L9FB2	PMP-9B	O2L9J1	Ductile Iron	76	5.9	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3808	O2L9FB1	W-9	PMP-9B	Cast iron	27	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3817	O2L7FB1	W-7	PMP-7B	Ductile Iron	0.1	7.3	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3823	O2L7FB2	PMP-7B	O2L7J2	Ductile Iron	104	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3869	O2L1FB1	W-1	PMP-1B	Steel	0.1	7.2	0	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3877	O1L42FA1	W-42	PMP-42b		0.1	8.8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3878	O1L42FA2	PMP-42b	O1L42J1		25	7.7	2	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3887	O2L39FB1	W-39	PMP-39b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3888	O2L39FB2	PMP-39b	O2L39J1	Ductile Iron	25	8.3	2	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3891	O2L35FB2	W-35	PMP-35B	Steel	0.1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3892	O2L35FB2	PMP-35B	O2L35J2	Steel	90	6.3	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3896	O2L41FB1	W-41	PMP-41b	PVC	0.1	6.9	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3897	O2L41FB2	PMP-41b	O2L41J2	PVC	25	7	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3916	O2L45FB1	W-45	PMP-45b		0.1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3917	O2L45FB2	PMP-45b	O2L45J2	PVC	25	7.4	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3933	O2L46FB1	W-46	PMP-46b	PVC	0.1	8.1	10	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3934	O2L46FB2	PMP-46b	O2L46J1		25	6.2	2	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3937	O2L33FB1	W-33	PMP-33B	Ductile Iron	0.1	6.8	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3939	O2L33FB2	PMP-33B	O2L33J2	Steel	70	5.8	2	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3960	O2L15FB1	W-15	PMP-15B	Ductile Iron		7.8	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3972	O1L14FB2	W-35	PMP-43b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3973	O1L14FB1	PMP-43b	O1L43J1	PVC	25	7.3	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4408	O2L47FA1	W-47	PMP-47A	PVC	0.1	9.3	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4409	O2L47FA2	PMP-47A	O2L47J2	PVC	40	6.2	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4462	O2L48FB1	W-48	PMP-48B	PVC	0.1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4464	O2L48FB2	PMP-48B	O2L48J1	PVC	70	7.1	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)

EXHIBIT E.4
PRESSURE NODE DATE TABLE REPORT

Model Pressure Node Data Table 25 Units Per Acre
Exhibit E4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
1341	O1L14J1	6.7	3.5	58.1	24	54.6		921853.18	600253.72	TRUE
2432	O1L14J2	6.4	0	64.8	28	64.8		920948.59	600723.96	TRUE
472	O1L14J3	6.4	8	64.9	25	56.9		920955.16	600715.27	TRUE
127	O1L17J1	6	5.3	65.4	26	60.2		920692.99	600715.98	TRUE
2461	O1L17J2	6.8	4	68	28	64		920723	599620.53	TRUE
87	O1L17J3	7.9	5	71.1	29	66.1		920698	598426.1	TRUE
465	O1L17J4	7	5	71.1	29	66.1		920705.89	598426.09	TRUE
2428	O1L34J1	8	5	23.5	8	18.5		927366.12	604992.24	TRUE
3492	O1L34J2	6.8	4.8	29.3	11	24.5		927390.3	604966.61	TRUE
3445	O1L37J1	6	3	3.5	0	0.5		919806.96	599800.73	TRUE
1337	O1L40J1	7.7	4	80.7	33	76.7		921532.85	599443.59	TRUE
1132	O1L42J1	5.8	3	7.6	2	4.6		919732.18	600929.27	TRUE
3588	O1L43J1	7.1	5	23.9	8	18.9		919610.41	600547.6	TRUE
116	O1L44J1	6.8	5.3	55.9	22	50.7		921909.68	600337.73	TRUE
1678	O1L44J2	6.2	0	64.3	28	64.3		921913.59	600458.39	TRUE
88	O2L10J1	8	4	23.6	8	19.6		927114.51	600739.53	TRUE
136	O2L10J2	7.8	5	34.2	13	29.2		926523.21	600750.87	TRUE
3794	O2L10J3	8.7	6.5	34.2	12	27.7		926513.68	600783.24	TRUE
135	O2L11J1	7.9	5.5	42.4	16	36.9		926045.89	600735.78	TRUE
3784	O2L11J1	10.5	8.5	42.7	15	34.2		926041.8	600777.04	TRUE
134	O2L12J1	8.1	6	47.2	18	41.2		925712.64	600726.09	TRUE
3774	O2L12J2	8.2	6.2	47.4	18	41.2		925711.36	600756.56	TRUE
131	O2L13J1	6.1	3	55.5	23	52.5		922967.26	600629.79	TRUE
3763	O2L13J2	6.2	4.2	55.5	22	51.3		922961.39	600653.77	TRUE
132	O2L15J1	6.8	4	55	22	51		923551.18	600648.88	TRUE
3743	O2L15J2	7	5	55.4	22	50.4		923546.24	600675.67	TRUE
107	O2L16J1	4.7	2.5	32	13	29.5		928422.75	604385.66	TRUE
2407	O2L16J2	6.7	4	49	19	45		928763.58	604418.47	TRUE
433	O2L18AJ1	4.7	2.5	12.9	4	10.4		928854.97	600361.74	TRUE
93	O2L18J1	7.7	4	12.5	4	8.5		928569.18	600970.36	TRUE

Model Pressure Node Data Table 25 Units Per Acre
Exhibit E4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
3726	O2L18J2	4.9	2.9	25.5	10	22.6		928608.77	599957.47	TRUE
126	O2L18J3	5.7	3	30.5	12	27.5		928767.45	599971.15	TRUE
3504	O2L19J1	8.3	7.8	25.2	8	17.4		927390.21	604973.37	TRUE
104	O2L1J1	6	4	28	10	24		928617.92	599702.49	TRUE
398	O2L1J2	6.6	4	32.7	12	28.7		928285.14	599671.66	TRUE
105	O2L22J1	6.9	4	26.9	10	22.9		927748.42	604998.77	TRUE
106	O2L22J2	5.5	3	49.4	20	46.4		927483.96	604307.21	TRUE
118	O2L23F1	4.3	1.2	37.2	16	36		929940.07	600105.19	TRUE
97	O2L24J1	6.9	4	34.4	13	30.4		929844.61	599734.74	TRUE
102	O2L24J2	5.4	3	38.4	15	35.4		929700.1	600158.28	TRUE
101	O2L25J1	4.5	2.7	14.5	5	11.8		929283.22	600655.84	TRUE
1790	O2L26J1	5.6	3.6	12.1	4	8.5		927480.33	603912.05	TRUE
2416	O2L29J1	4.5	2	6.8	2	4.8		929271.35	603049.66	TRUE
3087	O2L29J2	4.5	2	7.2	2	5.2		929284.01	603049.29	TRUE
414	O2L2J1	5.8	3.3	15.8	5	12.5		928996	598338.88	TRUE
1781	O2L30J1	3.1	1	21.8	9	20.8		929239.57	603452.81	TRUE
3661	O2L31J1	4.8	2.5	32.4	13	29.9		928446.71	603732.88	TRUE
1742	O2L31J2	6.6	4	62.3	25	58.3		929288.83	604013.67	TRUE
100	O2L32J1	5.7	4	27.9	10	23.9		928486.55	602372.06	TRUE
125	O2L32J2	5.3	4	35.5	14	31.5		927974.57	602351.14	TRUE
133	O2L33J1	8.3	6	52	20	46		924731.1	600689.88	TRUE
3938	O2L33J2	9.2	6	54.5	21	48.5		924723.91	600721.68	TRUE
3505	O2L34J2	8.1	4.6	24.1	8	19.6		927389.97	604994.04	TRUE
3498	O2L34J3	8.4	3.8	24.3	9	20.5		927411.01	604994.99	TRUE
1810	O2L34J4	4.8	4	32.4	12	28.4		928447.42	603684.11	TRUE
120	O2L34J5	5.9	2	79.9	34	77.9		928527.32	601678.68	TRUE
525	O2L34J6	5.9	10.1	81.1	31	70.9		928480.51	601676.24	TRUE
3528	O2L35J1	5.9	3	76.4	32	73.4		925402.48	604500.5	TRUE
3526	O2L35J2	0	0	76.6	33	76.6		925402.8	604509.91	TRUE
3649	O2L36J1	6	4	-3.6	-3	-7.6		928527.66	601663.48	TRUE

Model Pressure Node Data Table 25 Units Per Acre
Exhibit E4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
91	O2L36J2	7.4	5	11.3	3	6.3		928541.4	601077.86	TRUE
90	O2L36J3	8.9	4	18.6	6	14.6		927111.29	601021.17	TRUE
89	O2L36J4	6.1	4	21.6	8	17.6		926952.73	602311.3	TRUE
3567	O2L38J1	6.5	3.5	10.2	3	6.7		925476.79	603270.8	TRUE
1482	O2L39J1	6.5	4	16.5	5	12.5		925456.86	603835.44	TRUE
4047	O2L3J1	6.9	5	38.6	15	33.6		929945.67	597047.95	TRUE
124	O2L3J2	6.4	5	52.9	21	47.9		928698.06	597016.74	TRUE
3602	O2L41J1	5.5	4	30	11	26		928396.68	604881.25	TRUE
1639	O2L41J2	6.4	4	30	11	26		928579.21	604893.45	TRUE
1667	O2L45J1	8.1	6	48.5	18	42.5		925551.4	600721.93	TRUE
1670	O2L45J2	9.4	7.4	55.1	21	47.7		925547.33	600761.31	TRUE
3926	O2L46J1	6.6	3	16.9	6	13.9		928915.95	600879.36	TRUE
4400	O2L47J1	2.2	1.4	19.1	8	17.7		928837.69	603432.35	TRUE
4396	O2L47J2	5	3	20.1	7	17.1		928830.59	603426.03	TRUE
4463	O2L48J1	0	0	25.8	11	25.8		926212.08	601305.88	TRUE
3855	O2L4J1	6.3	4.3	16.2	5	11.9		927327.5	597718.21	TRUE
3853	O2L4J2	6.2	4.2	21.3	7	17.1		927318.45	598092.97	TRUE
3850	O2L4J3	5.8	3.8	37	14	33.2		927280.07	599261.59	TRUE
488	O2L4J4	7	5	47.1	18	42.1		927253.84	600013.72	TRUE
484	O2L4J5	7.6	6	47.5	18	41.5		927276.73	600022.08	TRUE
3838	O2L5J1	6	4	4.9	0	0.9		927367.89	597001.13	TRUE
3857	O2L5J2	6.3	4	15.7	5	11.7		927330.85	597676.29	TRUE
493	O2L5J3	6.3	4.8	15.7	5	10.8		927336.66	597692.12	TRUE
442	O2L6J1	6.3	4	13.9	4	9.9		928475.95	600682.36	TRUE
95	O2L7J1	6.6	4	30.8	12	26.8		929283.52	599729.39	TRUE
3820	O2L7J2	6.9	4.9	31.8	12	26.9		929290.49	599699.06	TRUE
3802	O2L9J1	6.5	3.5	34.3	13	30.8		928210.32	602646.01	TRUE
2434	na	0	0	3.5	2	3.5		927359.5	596967.77	TRUE
2436	na	0	0	3.5	2	3.5		927353.71	597094.23	TRUE
2438	na	0	0	47.1	20	47.1		927262.9	599779.52	TRUE

EXHIBIT E.5
PUMP DATA TABLE REPORT

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
63	PMP-1A	TRUE	6.7	-3.8	Pump Definition - LS1	137.79	54.6	-1.8	52.8
396	PMP-1B	FALSE	6.7	-3.8	Pump Definition - LS1	(N/A)	(N/A)	(N/A)	(N/A)
412	PMP-2A	TRUE	6.3	-4.7	Pump Definition - LS2	161.96	21.5	-3.7	17.9
411	PMP-2B	FALSE	6.4	-4.7	Pump Definition - LS2	(N/A)	(N/A)	(N/A)	(N/A)
365	PMP-3A	TRUE	6.4	-2.9	Pump Definition - LS3	104.48	56.7	-1.9	54.8
62	PMP-3B	FALSE	6.4	-2.9	Pump Definition - LS3	(N/A)	(N/A)	(N/A)	(N/A)
481	PMP-4A	TRUE	7.6	-3.6	Pump Definition - LS4	124.51	50.2	-1.6	48.6
491	PMP-5A	TRUE	6	-6.2	Pump Definition - LS5	8.3964	19.8	-4.2	15.7
490	PMP-5B	FALSE	6	-6.2	Pump Definition - LS5	(N/A)	(N/A)	(N/A)	(N/A)
440	PMP-6A	TRUE	6.5	-2.9	Pump Definition - LS6	153.95	20.3	-1.4	18.9
441	PMP-6B	FALSE	6.5	-2.9	Pump Definition - LS6	(N/A)	(N/A)	(N/A)	(N/A)
453	PMP-7A	TRUE	6.8	-5.4	Pump Definition - LS7	213.42	38.3	-3.4	34.9
60	PMP-7B	FALSE	6.8	-5.4	Pump Definition - LS7	(N/A)	(N/A)	(N/A)	(N/A)
3801	PMP-9A	TRUE	6	3.5	Pump Definition - LS9	126.02	37	-1.4	35.6
51	PMP-9B	FALSE	6	3.5	Pump Definition - LS9	(N/A)	(N/A)	(N/A)	(N/A)
3791	PMP-10A	TRUE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	-1.93E-05	26	3.9	29.9
3792	PMP-10B	FALSE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3781	PMP-11A	TRUE	10.5	3	Pump Definition - LS11	46.023	33.8	9.5	43.3
3782	PMP-11B	FALSE	10.5	3	Pump Definition - LS11	(N/A)	(N/A)	(N/A)	(N/A)
3772	PMP-12A	FALSE	8.7	2.5	Pump Definition - LS12	(N/A)	(N/A)	(N/A)	(N/A)
3771	PMP-12B	TRUE	8.7	2.5	Pump Definition - LS12	107.08	40.2	8	48.2
3760	PMP-13A	TRUE	6.7	4.7	Pump Definition - LS13	32.293	53.4	2.1	55.6
3761	PMP-13B	FALSE	6.7	4.7	Pump Definition - LS13	(N/A)	(N/A)	(N/A)	(N/A)
469	PMP-14A	TRUE	6.4	8	Pump Definition - LS14	547.15	74.8	-4.7	70.2
48	PMP-14B	FALSE	6.4	8	Pump Definition - LS14	(N/A)	(N/A)	(N/A)	(N/A)
3741	PMP-15A	TRUE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	74.29	54.3	2.5	56.8
3740	PMP-15B	FALSE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
2476	PMP-16A	TRUE	5.9	-6.3	Pump Definition - LS16	269.04	64.3	-4.3	60
2481	PMP-16B	FALSE	5.9	-6.3	Pump Definition - LS16	(N/A)	(N/A)	(N/A)	(N/A)

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
49	PMP-17A	FALSE	7	9	Pump Definition - LS17	(N/A)	(N/A)	(N/A)	(N/A)
463	PMP-17B	TRUE	7.5	9	Pump Definition - LS17	333.17	82.8	-11.3	71.5
405	PMP-18A	TRUE	5.7	-5	Pump Definition - LS18	46.617	30.3	1	31.3
431	PMP-18A-a	FALSE	6.1	-3.5	Pump Definition - LS18a	(N/A)	(N/A)	(N/A)	(N/A)
430	PMP-18A-b	TRUE	6.1	-3.5	Pump Definition - LS18a	75.334	15.8	-1	14.8
61	PMP-18B	TRUE	5.7	-5	Pump Definition - LS18	51.242	30.1	1	31.1
539	PMP-19A	FALSE	6.8	-4.1	Pump Definition - LS19	(N/A)	(N/A)	(N/A)	(N/A)
53	PMP-19B	TRUE	6.8	-2.5	Pump Definition - LS19	1747.5	59.9	-2.1	57.8
1689	PMP-22A	TRUE	5.4	-9.7	Pump Definition - LS22	183.34	60.8	-7.2	53.6
52	PMP-22B	FALSE	5.9	-9.7	Pump Definition - LS22	(N/A)	(N/A)	(N/A)	(N/A)
59	PMP-23A	FALSE	4.5	-5.9	Pump Definition - LS23	(N/A)	(N/A)	(N/A)	(N/A)
388	PMP-23B	TRUE	-5.9	-5.9	Pump Definition - LS23	89.097	44	-3.4	40.6
391	PMP-24A	TRUE	5.6	-3.4	Pump Definition - LS24	46.812	40.3	-0.9	39.4
58	PMP-24B	FALSE	5.6	-3.4	Pump Definition - LS24	(N/A)	(N/A)	(N/A)	(N/A)
425	PMP-25A	TRUE	5.1	-5.4	Pump Definition - LS24-LS25	82.961	19.2	-2.9	16.3
57	PMP-25B	FALSE	5.1	-5.4	Pump Definition - LS24-LS25	(N/A)	(N/A)	(N/A)	(N/A)
1788	PMP-26A	FALSE	5.6	-4.2	Pump Definition - LS26	(N/A)	(N/A)	(N/A)	(N/A)
1789	PMP-26B	TRUE	5.6	-4.2	Pump Definition - LS26	159.28	25.2	-3.8	21.4
2479	PMP-29A	TRUE	4.4	-4.9	Pump Definition - LS29	104.88	18.9	-3.9	15
2480	PMP-29B	FALSE	3.5	-4.9	Pump Definition - LS29	(N/A)	(N/A)	(N/A)	(N/A)
1779	PMP-30A	TRUE	4.1	-5	Pump Definition - LS30	43.798	25.4	-2.5	22.9
1780	PMP-30B	FALSE	4.1	-5	Pump Definition - LS30	(N/A)	(N/A)	(N/A)	(N/A)
1740	PMP-31A	TRUE	6.2	-8	Pump Definition - LS31	201.26	95.7	-6.6	89.2
1741	PMP-31B	FALSE	6.2	-8	Pump Definition - LS31	(N/A)	(N/A)	(N/A)	(N/A)
508	PMP-32A	FALSE	8	10	Pump Definition - LS32	(N/A)	(N/A)	(N/A)	(N/A)
50	PMP-32B	TRUE	8	10	Pump Definition - LS32	142.69	42.3	-5.3	37
3935	PMP-33A	TRUE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	56.531	60.2	3	63.2
3936	PMP-33B	FALSE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
505	PMP-34A	TRUE	6.9	-10.5	Pump Definition - LS34	1150.9	90.7	-6	84.7

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
1692	PMP-34B	FALSE	6.9	-10.5	Pump Definition - LS34	(N/A)	(N/A)	(N/A)	(N/A)
56	PMP-34C	FALSE	6.9	-10.5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
3522	PMP-35A	TRUE	6	-5	Pump Definition - LS35	171.8	81	-1.4	79.6
3521	PMP-35B	FALSE	6	-5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
515	PMP-36A	TRUE	6.7	-8.5	Pump Definition - LS36	50.074	27.4	-5.5	21.9
64	PMP-36B	FALSE	7.5	-8.5	Pump Definition - LS36	(N/A)	(N/A)	(N/A)	(N/A)
3443	PMP-37a	TRUE	6.3	-7	Pump Definition - LS37	88.302	8.9	-4.7	4.3
3444	PMP-37b	FALSE	6.5	-7	Pump Definition - LS37	(N/A)	(N/A)	(N/A)	(N/A)
3565	PMP-38a	TRUE	6.5	-15.4	Pump Definition - LS38	309.12	21.7	-10.2	11.5
3564	PMP-38b	FALSE	6.5	-15.4	Pump Definition - LS38	(N/A)	(N/A)	(N/A)	(N/A)
3886	PMP-39a	TRUE	6	-5	Pump Definition - LS39	29.869	15.1	2	17.1
3885	PMP-39b	FALSE	6	-5	Pump Definition - LS39	(N/A)	(N/A)	(N/A)	(N/A)
3479	PMP-40a	TRUE	8	5	Pump Definition - LS40	139.62	86.6	-5	81.6
3480	PMP-40b	FALSE	8	5	Pump Definition - LS40	(N/A)	(N/A)	(N/A)	(N/A)
3895	PMP-41a	TRUE	6.5	0	Pump Definition - LS10-LS42-LS43 Privite	0	0	4	30
3894	PMP-41b	FALSE	0	6.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3875	PMP-42a	TRUE	5	0	Pump Definition - LS10-LS42-LS43 Privite	111.61	11.8	2.5	14.3
3876	PMP-42b	FALSE	5	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3970	PMP-43a	TRUE	9.4	1	Pump Definition - LS10-LS42-LS43 Privite	42.611	21	4	25
3971	PMP-43b	FALSE	7.4	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3693	PMP-44a	TRUE	6.8	0.5	Pump Definition - LS15-LS33-LS44-LS45	52.785	61.5	4.5	66
3692	PMP-44b	FALSE	6.7	0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
3915	PMP-45a	TRUE	9.3	3.5	Pump Definition - LS15-LS33-LS44-LS45	86.238	50.3	9	59.3
3914	PMP-45b	FALSE	9.3	3.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3923	PMP-46a	TRUE	6.5	-3	Pump Definition - LS10-LS42-LS43 Privite	53.324	19.7	-1	18.7
3924	PMP-46b	FALSE	6.3	-3	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4407	PMP-47A	FALSE	5	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4404	PMP-47B	TRUE	5	1	Pump Definition - LS10-LS42-LS43 Privite	56.842	19.2	4	23.2
4460	PMP-48A	TRUE	0	0	Pump Definition - LS10-LS42-LS43 Privite	41.077	21.2	5	26.2

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
4461	PMP-48B	FALSE	0	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
482	PMP4B	FALSE	7.6	-3.6	Pump Definition - LS4	(N/A)	(N/A)	(N/A)	(N/A)

EXHIBIT E.6
OUTFALL DATA TABLE REPORT

Model Outfall Data Table 25 Units Per Acre
Exhibit E6

ID	Label	Elevation (Ground) (ft)	Elev (Invert) (ft)	Boundary Condition Type	Elevation (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Flow (Total Out) (gpm)	Notes
1797	O-1	6.8	3.5	User Defined Tailwater	58	58	1020	Measured 58 ft of Head or 25 psi at 12:00 PM Tuesday August 2023
3488	O-2	6.5	3.5	User Defined Tailwater	23	23	3724	Measured 10 psi or 23 feet of Head on Monday 6/12/2023

EXHIBIT F.1
GRAVITY SEWER DATA TABLE REPORT

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1120	O1L14SC1	M14C1	-2.7	M14A2	-3.6	279.4	0.003	8	0.013	4.39	687.4	302.61	227.2	Vitrified Clay
536	O1L14SA2	M14A2	-3.6	M14A1	-4	102.8	0.004	8	0.013	5.01	785.6	346.58	226.7	Vitrified Clay
1115	O1L14SC2	M14C2	-2.4	M14C1	-2.7	92.4	0.003	8	0.013	3.68	575.8	298.52	192.9	Vitrified Clay
1113	O1L14SC3	M14C3	-2.3	M14C2	-2.4	22.4	0.003	8	0.013	3.68	575.8	303.48	189.7	Vitrified Clay
1110	O1L14SC4	M14C4	-1.4	M14C3	-2.3	315.6	0.003	8	0.013	3.54	555.3	297.54	186.6	Vitrified Clay
1322	O1L17SA10	M17A10	0.6	M17A9	0	160.9	0.004	8	0.013	3.43	537.1	325.59	165	Vitrified Clay
1466	O2L34SA9	M34A9	0.1	M34A8	0	92.2	0.001	8	0.013	1.39	217.9	138.37	157.5	Vitrified Clay
1323	O1L17SA9	M17A9	0	M17A8	-0.4	88.8	0.005	8	0.013	3.6	563.5	364.07	154.8	Vitrified Clay
1517	O2L34SA3	M34A3	-4.4	M34A2	-4.5	34	0.004	8	0.01	4.12	645.2	418.76	154.1	PVC
998	O2L34SA6	M34A6	-1.9	M34A5	-2.1	77	0.002	8	0.013	2.33	365.3	247.26	147.8	Vitrified Clay
1089	O1L17SA11	M17A11	1.6	M17A10	0.6	245.1	0.004	8	0.013	3.13	490.8	342.94	143.1	Vitrified Clay
1275	O2L22SA2	M22A2	-0.8	M22A1	-1.4	133.8	0.005	8	0.013	2.94	460.5	372.16	123.7	Vitrified Clay
1353	O2L34SA8	M34A8	0	M34A7	-0.5	319.7	0.002	8	0.013	1.62	239.6	224.95	106.5	Vitrified Clay
1057	O1L17SA2	M17A2	-6.6	M17A1	-7	144.5	0.002	12	0.013	2.48	821.3	775.54	105.9	Vitrified Clay
4001	O1L17SA1	M17A1	-7	W-17	-7.1	39.9	0.003	12	0.013	2.95	926.8	912.44	101.6	Vitrified Clay
1108	O1L14SC5	M14C5	-0.4	M14C4	-1.4	315.1	0.003	8	0.013	1.93	302.1	297.81	101.4	Vitrified Clay
1032	O1L17SA3	M17A3	-6.4	M17A2	-6.6	112	0.002	12	0.013	2.24	695.9	692.29	100.5	Vitrified Clay
360	O2L3SA1	M3A1	-1.8	W-3	-1.7	17.9	-0.004	8	0.013	2.31	362.1	362.33	99.9	
3683	O2L22SA4	M22A3	0.9	M22A4	1.6	180.6	0.004	8	0.013	2.39	326.5	327.87	99.6	Vitrified Clay
3510	O2L35SA1	W-35	-1.4	M35A1	-1.3	20.3	0.005	8	0.01	3.58	452.8	494.45	91.6	PVC
4285	O1L17SA4	M17A5	-5.7	M17A4	-6.3	285.4	0.002	12	0.013	2.37	608.5	751.26	81	Vitrified Clay
1518	O2L34SA3	M34A4	-3	M34A3	-4.3	313	0.004	8	0.01	3.22	365.3	454.36	80.4	PVC
1283	O2L22SA3	M22A3	0.9	M22A2	-0.8	259.4	0.007	8	0.013	3.12	343.5	442.87	77.6	
988	O2L34SI1	M34A7	-0.5	M34A6	-1.9	332.4	0.004	8	0.013	2.43	255.2	349.46	73	Vitrified Clay
1465	O2L34SA10	M34A10	0.8	M34A9	0.1	233.6	0.003	8	0.013	2.06	213.7	296.91	72	Vitrified Clay
4282	O1L17SA4	M17A4	-6.3	M17A3	-6.4	27.9	0.003	12	0.013	2.64	608.5	856.88	71	Vitrified Clay
1459	O2L34SA11	M34A11	1.5	M34A10	0.8	233.9	0.003	8	0.013	2.12	213.1	307.09	69.4	Vitrified Clay
3993	O2L36SB1	M36A1	-5.2	M36B1	-4	279.6	0.004	8	0.01	3	263.9	452.17	58.4	PVC
4142	O2L1SA5	M1A4	1	M1A5	1.1	43.1	0.004	8	0.013	2.25	193.2	342.52	56.4	Vitrified Clay
4143	O2L1SA6	M1A5	1.1	M1A6	1.4	72.8	0.004	8	0.013	2.25	192.3	343.57	56	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
376	O2L3SA2	M3A2	-1.3	M3A1	-1.8	107.4	0.005	8	0.013	2.42	203.6	370.12	55	Vitrified Clay
4081	O2L1SA4	M1A3	-0.1	M1A4	1	240.7	0.004	8	0.013	2.35	196.2	359.94	54.5	Vitrified Clay
733	O2L3SH1	M3H1	-0.1	M3A2	-1.3	318.9	0.004	8	0.013	2.14	177.6	329.9	53.8	Vitrified Clay
1100	O1L14SD1	M14D1	0.4	M14C5	-0.4	279.3	0.003	8	0.013	1.02	159.6	299.18	53.3	Vitrified Clay
646	O2L36SA4	M36A4	-2.2	M36A3	-2.4	220.4	0.001	8	0.01	1.38	112.7	212.41	53.1	PVC
737	O2L3SH2	M3H2	1.3	M3H1	-0.1	388.5	0.004	8	0.013	2.08	167.7	322.05	52.1	Vitrified Clay
1402	O1L17SB4	M17B3	3.6	M17B4	4.2	217.7	0.003	8	0.01	1.12	176	370.1	47.6	PVC
1396	O1L17SB2	M17B1	2.2	M17B2	2.6	99.6	0.004	8	0.01	1.34	210.2	446.82	47	PVC
4136	O2L1SA7	M1A6	1.4	M1A7	1.7	46.6	0.006	8	0.013	2.65	191.4	426.48	44.9	Vitrified Clay
3684	O2L22SA4	M22A4	1.6	M22A5	2.2	112.5	0.005	8	0.013	2.38	167.2	386.07	43.3	
419	O2L2SA1	M2A1	-2.1	W-2	-2.2	15.7	0.004	6	0.013	1.64	64.5	150.5	42.9	Vitrified Clay
1324	O1L17SA8	M17A8	-2.1	M17A6	-3.4	159.5	0.008	12	0.013	3.92	608.5	1443.4	42.2	Vitrified Clay
3863	O2L3SF1	M3A1	-1.8	M3F1	-0.4	341.2	0.004	8	0.013	2.09	139.2	344.92	40.3	Vitrified Clay
870	O2L1SA2	M1A2	-0.8	M1A1	-1	82.6	0.003	10	0.013	2.16	225.2	558.68	40.3	Vitrified Clay
3957	O2L3SF3	M3F2	1.5	M3F3	3.2	459.3	0.004	8	0.013	1.99	132.9	329.96	40.3	Vitrified Clay
1168	O1L14SB2	M14B2	-1.4	M14B1	-1.7	285.5	0.001	8	0.013	1.16	76.63	192.58	39.8	Vitrified Clay
1398	O1L17SB3	M17B3	3.4	M17B2	2.6	147.7	0.006	8	0.01	1.34	210.2	538.07	39.1	PVC
1124	O1L14SC6	M14C6	0.5	M14C5	-0.4	305.7	0.003	8	0.013	0.75	116.9	299.16	39.1	Vitrified Clay
1404	O1L17SB5	M17B5	4.7	M17B4	4	146.5	0.004	8	0.01	2.72	176	454.91	38.7	PVC
1126	O1L14SC7	M14C7	1	M14C6	0.5	170	0.003	8	0.013	0.71	111.2	288.2	38.6	Vitrified Clay
1617	O2L3SF2	M3F2	1.5	M3F1	-0.4	437.2	0.004	8	0.013	2.13	136	357.52	38.1	Vitrified Clay
653	O2L36SA2	M36A2	-4.1	M36A1	-5.2	310.1	0.003	8	0.01	2.46	156.8	414.13	37.9	PVC
1271	O2L22SF1	M22F1	-1.8	M22A1	-0.5	112.4	-0.011	6	0.013	1.13	99.38	266.59	37.3	Vitrified Clay
1104	O1L14SD3	M14D3	2.1	M14D2	1.3	284.2	0.003	8	0.013	0.69	108.3	296.6	36.5	Vitrified Clay
1551	O1L17SF1	M17F1	2.8	M17A11	1.6	282.2	0.004	8	0.013	0.83	130.3	358.04	36.4	Vitrified Clay
1106	O1L14SD4	M14D4	2.8	M14D3	2.1	226.8	0.003	8	0.013	0.67	105.4	296.94	35.5	Vitrified Clay
4080	O2L2SR2	M1A2	-0.8	M1A3	-0.1	208.8	0.003	10	0.013	2.1	199.5	562.18	35.5	Vitrified Clay
1088	O1L17A12	M17A12	4	M17A11	3.1	217.3	0.004	8	0.013	0.81	127.5	362.32	35.2	Vitrified Clay
707	O2L3SJ1	M3J1	3	M3H2	1.3	234.4	0.007	8	0.013	2.71	162.5	465.9	34.9	Vitrified Clay
1408	O1L17SB6	M17B6	5.6	M17B5	4.7	229.2	0.004	8	0.01	2.58	153.2	444.28	34.5	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1000	O2L34SA5	M34A5	-2.1	M34A4	-3	23.2	0.039	8	0.013	6.17	365.3	1067.6	34.2	Vitrified Clay
902	O2L23SB1	M23B1	1.9	M17A1	0.3	399.2	0.004	8	0.035	0.74	43.17	128.33	33.6	
1553	O1L17SF2	M17F2	3.9	M17F1	2.8	296.1	0.004	8	0.013	0.69	107.5	335.02	32.1	Vitrified Clay
651	O2L36SA3	M36A3	-2.4	M36A2	-4.1	354.7	0.005	8	0.01	2.7	148.9	479.4	31.1	PVC
1710	O2L38SA2	M38A2	-7.2	M38A1	-8.8	395.9	0.004	8	0.01	2.47	127.4	449.63	28.3	PVC
3884	O2L38SA1	M38A1	-8.9	W-38	-9.1	23.9	0.008	8	0.01	3.53	182.2	644.52	28.3	PVC
4284	O1L17SA6	M17A6	-3.4	M17A5	-5.7	118.8	0.019	12	0.013	5.39	608.5	2230.1	27.3	Vitrified Clay
683	O2L36SB2	M36B2	-3	M36B1	-4	327.4	0.003	8	0.01	2.16	108.2	397.39	27.2	PVC
3372	O2L7SC2	M7C2	-0.1	M7C1	-0.9	162.5	0.005	8	0.013	2.06	103	380.57	27.1	Vitrified Clay
1102	O1L14SD2	M14D2	3.2	M14D1	0.4	281.8	0.01	8	0.013	0.91	142.5	533.77	26.7	Vitrified Clay
1156	O1L14SA5	M14A5	-2.4	M14A4	-3.1	172.3	0.004	8	0.013	0.57	89	343.16	25.9	Vitrified Clay
1555	O1L17SF3	M17F3	4	M17F2	3.9	16.5	0.006	8	0.013	0.69	107.5	421.82	25.5	Vitrified Clay
645	O2L36SA5	M36A5	-2	M36A4	-2.2	84.2	0.003	8	0.01	2.2	104.8	413.76	25.3	PVC
404	O2L1SA1	M1A1	-1	W-1	-1.2	11	0.012	10	0.013	3.65	270.5	1071.6	25.2	Vitrified Clay
4010	O2L19SA1	W-9	-0.4	M9A1	-0.3	20.8	0.005	8	0.01	2.56	116.6	488.56	23.9	PVC
524	O2L34SA2	M34A2	-4.6	M34A1	-5.5	25.8	0.031	12	0.012	6.98	694	3033.5	22.9	Ductile Iron
589	O2L7SA2	M7A2	-2	M7A1	-5.5	246.6	0.014	6	0.013	2.76	68.03	300.43	22.6	Vitrified Clay
3378	O2L7SC3	M7C3	0.7	M7C2	-0.1	139.7	0.006	8	0.013	2.1	91.36	410.39	22.3	Vitrified Clay
644	O2L36SA6	M36A6	-1.7	M36A5	-2	90.5	0.003	8	0.01	2.05	88.67	399.19	22.2	PVC
569	O2L7SD2	M7D2	1.8	M7D1	1	157	0.005	6	0.013	1.66	39.53	184.22	21.5	Vitrified Clay
457	O2L7SA1	M7A1	-5.5	W-7	-6.4	7.7	0.116	6	0.013	2.08	183.3	857.64	21.4	
570	O2L7SD1	M7D1	1	M7A3	-0.6	136.4	0.012	6	0.013	2.43	56.33	272.74	20.7	Vitrified Clay
3512	O2L35SA2	M35A1	-1.2	M35A2	-0.1	286.5	0.004	8	0.01	2.19	89.89	436.87	20.6	PVC
1333	O1L40SA5	M40A4	2.7	M40A5	3.7	263.3	0.004	8	0.01	2.17	88.08	434.47	20.3	PVC
1329	O1L40SA3	M40A2	0.3	M40A3	1.4	286.8	0.004	8	0.01	2.18	88.08	436.66	20.2	PVC
3103	O2L34SG1	M34G1	3.8	M34F2	0.3	401.3	0.009	6	0.013	2.09	47.49	236.19	20.1	Vitrified Clay
3514	O2L35SA3	M35A2	0	M35A3	1.5	393.5	0.004	8	0.01	2.13	83.01	433.85	19.1	PVC
1016	O1L17SM1	M17M1	-0.8	M17A3	-1.3	132	0.004	8	0.01	2.21	85.5	450.98	19	PVC
1331	O1L40SA4	M40A3	1.5	M40A4	2.7	275	0.004	8	0.01	2.28	88.08	465.75	18.9	PVC
1327	O1L40SA2	M40A1	-0.6	M40A2	0.2	190.5	0.004	8	0.01	2.29	88.08	468.18	18.8	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4128	O2L1SA8	M1A7	1.7	M1A8	1.9	44.8	0.004	12	0.013	2.19	187.8	1007.9	18.6	
1557	O1L17SF4	M17F4	5.2	M17F3	4	350.6	0.003	8	0.013	1.55	58.75	317.28	18.5	Vitrified Clay
643	O2L36SA7	M36A7	-0.7	M36A6	-1.7	299.2	0.003	8	0.01	1.92	72.51	395.17	18.3	PVC
4129	O2L1SA9	M1A8	1.9	M1A9	3	256.4	0.004	12	0.013	2.26	186.3	1056.8	17.6	
1304	O1L14SC8	M14C8	1.3	M14C7	1	89.7	0.003	8	0.01	0.45	71.25	407.81	17.5	PVC
588	O2L7SA3	M7A3	-0.6	M7A2	-2	283.5	0.005	8	0.013	1.82	65.63	379.78	17.3	Vitrified Clay
3247	O2L18SC9	M18C9	3.4	M18C2	3	99.5	0.004	8	0.01	2.11	75.65	441.38	17.1	PVC
1502	O2L18ASA5	M18A-A5	0.7	M18A-A4	0.2	162.3	0.003	8	0.01	1.88	67.5	395.19	17.1	PVC
1496	O2L18ASA3	M18A-A3	-0.3	M18A-A2	-0.7	102.4	0.004	8	0.01	0.49	76	446.05	17	PVC
3713	O2L22SA1	M22A1	-1.4	W-23	-2.2	16.1	0.048	12	0.013	7.4	587.3	3518.3	16.7	
1704	O2L38SA3	M38A3	-5.5	M38A2	-7.2	382.4	0.004	8	0.013	1.69	59.32	358.4	16.6	
4023	O2L5SA1	M5A1	-2.9	W-5	-3	10.6	0.005	6	0.01	1.89	37.17	225.16	16.5	PVC
1306	O1L14SC9	M14C9	1.7	M14C8	1.3	115.8	0.004	8	0.01	0.45	71.25	444.4	16	PVC
538	O1L14SA4	M14A4	-3.1	M14A3	-2.6	57	-0.008	8	0.01	0.63	98.12	619.43	15.8	PVC
1412	O1L17SB7	M17B6	5.3	M17B7	5.7	143.6	0.003	8	0.01	1.69	57	362.66	15.7	PVC
537	O1L14SA3	M14A3	-2.6	M14A2	-3.6	68.4	0.013	8	0.013	0.63	98.12	628.94	15.6	
1500	O2L18ASA4	M18A-A4	0.2	M18A-A3	-0.3	112.6	0.004	8	0.01	2.07	69.07	445.71	15.5	PVC
1172	O1L14SA7	M14A7	-1.6	M14A6	-0.5	131	-0.008	8	0.013	0.49	76.17	492.39	15.5	Vitrified Clay
3995	O2L36SC2	M36C1	-2	M36C2	-0.5	271.5	0.005	8	0.01	2.41	80.07	522.31	15.3	PVC
1014	O1L17SM2	M17M2	-0.3	M17M1	-0.8	94.7	0.005	8	0.01	2.26	74.1	491.29	15.1	PVC
912	O2L5SA2	M5A2	-2.7	M5A1	-2.9	53.7	0.005	6	0.01	1.81	32.45	223.47	14.5	PVC
1012	O1L17SM3	M17M3	0.6	M17M2	-0.3	244	0.004	8	0.01	1.98	62.7	437.59	14.3	PVC
642	O2L36SA8	M36A8	0.2	M36A7	-0.7	292.1	0.003	8	0.01	1.8	56.34	399.96	14.1	PVC
1425	O2L32SA1	W-32	-1.6	M32A1	-1.2	120.4	0.004	8	0.01	1.95	59.74	435.71	13.7	PVC
1506	O2L18ASA6	M18A-A6	1.2	M18A-A5	0.7	121.8	0.004	8	0.01	2.04	61.2	460.67	13.3	PVC
3643	O2L18ASA2	M18A-A2	-0.7	M18A-A1	0.4	95.8	-0.011	8	0.013	0.49	76	575.97	13.2	
3846	O2L4SA3	M4A2	0.3	M4A3	0.7	92.3	0.005	6	0.013	1.34	22.37	171.88	13	Vitrified Clay
3365	O2L7SC1	M7C1	-0.9	M7A1	-5.5	181.5	0.025	8	0.013	3.77	109.6	864.45	12.7	Vitrified Clay
3994	O2L36SC1	M36B1	-4	M36C1	-2	190.4	0.011	8	0.01	3.16	90.81	724.35	12.5	PVC
3426	O2L36SA1	M36A1	-5.2	W-36	-9	68	0.057	12	0.013	7	473.7	3804.2	12.5	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
568	O2L7SD3	M7D3	2.7	M7D2	1.8	157.5	0.005	6	0.013	1.42	22.73	182.79	12.4	Vitrified Clay
1512	O2L18ASA8	M18A-A8	2.1	M18A-A7	1.7	100.8	0.004	8	0.01	1.95	54.9	449.6	12.2	PVC
1377	O1L37SC1	M37A2	-2.8	M37A1	-3.2	98.7	0.004	8	0.01	2.01	56.19	465.32	12.1	PVC
1510	O2L18ASA7	M18A-A7	1.7	M18A-A6	1.2	120	0.004	8	0.01	2	55.84	464.08	12	PVC
1008	O1L17SM5	M17M5	1.9	M17M4	1	215.3	0.004	8	0.01	1.88	51.3	440.44	11.6	PVC
1010	O1L17SM4	M17M4	1	M17M3	0.6	105.8	0.004	8	0.01	1.89	51.3	444.2	11.5	PVC
1448	O2L31SA2	M31A2	-2.3	M31A1	-4	387.1	0.004	8	0.01	1.98	53.69	465.86	11.5	PVC
1606	O1L17SO1	M17O1	1.7	M17N1	0.1	315.6	0.005	8	0.01	2.11	57	498.88	11.4	PVC
682	O2L36SB3	M36B3	-0.1	M36B2	-3	325.9	0.009	8	0.01	2.78	73.19	660.47	11.1	PVC
865	O2L1SE3	M1E3	1.5	M1E2	0.7	171.5	0.005	6	0.013	1.28	18.75	172.65	10.9	Vitrified Clay
1166	O1L14SB1	M14B1	-1.7	M14A1	-4	304.2	0.007	10	0.013	2.27	91.91	847.57	10.8	Vitrified Clay
1072	O1L17SQ1	M17Q2	-3.4	M17Q1	-4	143.7	0.004	8	0.013	0.24	37.05	344.55	10.8	Vitrified Clay
794	O2L2SA2	M2A2	-1.3	M2A1	-2.1	174.8	0.005	8	0.013	1.52	38.7	366.74	10.6	Vitrified Clay
4012	O2L9SB1	M9A1	-0.3	M9B1	0.5	194.7	0.004	8	0.01	1.87	47.25	452	10.5	PVC
1128	O1L14SF1	M14F1	1.8	M14C7	1	250.4	0.003	8	0.013	0.2	31.35	302.71	10.4	Vitrified Clay
1414	O1L17SB9	M17B9	6.5	M17B7	6.1	98.6	0.004	8	0.01	1.83	45.6	443.5	10.3	PVC
1702	O2L38SA4	M38A4	-3.8	M38A3	-5.4	393.5	0.004	8	0.01	1.86	46.2	452.36	10.2	PVC
699	O1L17SL3	M17L3	1.8	M17L2	1.2	152.2	0.004	8	0.01	1.83	45.04	448.12	10.1	PVC
697	O1L17SL2	M17L2	1.2	M17L1	0.9	75.7	0.004	8	0.01	1.84	45.04	451.18	10	PVC
1373	O1L37SA3	M37A3	-1.6	M37A2	-2.8	245.7	0.005	8	0.01	1.96	47.83	482.4	9.9	PVC
1394	O1L17SB1	M17B1	2.2	M17A11	1.6	20.6	0.03	10	0.01	0.86	210.2	2218.4	9.5	PVC
1592	O2L16SA5	M16A5	0.6	M16A4	-0.3	203.9	0.004	8	0.013	1.38	31.71	348.09	9.1	Vitrified Clay
986	O2L34SF1	M34F1	0.8	M34A6	-0.3	324.1	0.004	12	0.013	1.68	86	952.5	9	
1006	O1L17SM6	M17M6	2.5	M17M5	1.9	150.5	0.004	8	0.01	1.76	39.9	445.1	9	PVC
1371	O1L37SA4	M37A4	-0.4	M37A3	-1.6	236.2	0.005	8	0.01	1.98	44.7	500.45	8.9	PVC
4321	O2L18SC1	M18A1	-3.1	M18C1	2.5	150.6	0.037	8	0.013	4.1	92.03	1041.2	8.8	Vitrified Clay
1712	O2L38SB1	M38A1	-2.9	M38B1	-1.6	300.5	0.004	8	0.01	1.83	40.85	465.5	8.8	PVC
1277	O2L22SB1	M22B1	1.2	M22A2	-0.8	70.3	0.028	8	0.01	4.62	102.8	1177.4	8.7	PVC
689	O2L36SD2	M36D2	1.9	M36D1	1	353.5	0.004	8	0.013	1.34	29.8	343.01	8.7	
1196	O1L14SA8	M14A8	-0.6	M14A7	-1.6	247.4	0.004	8	0.013	1.34	29.64	342.71	8.6	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4475	O2L4SA2	M4A2	0.3	M4A1	0.1	16.8	0.011	6	0.013	1.81	22.37	260.6	8.6	Vitrified Clay
701	O1L17SL4	M17L4	2.3	M17L3	1.8	130.1	0.004	8	0.01	1.73	37.92	445.75	8.5	PVC
856	O2L1SJJ1	M1JJ1	1.7	M1D2	0.9	131.3	0.006	6	0.013	1.31	15.9	191.56	8.3	Vitrified Clay
1586	O2L16SA3	M16A3	-1.4	M16A2	-2.6	24.9	0.045	8	0.013	4.44	95.48	1150.3	8.3	Vitrified Clay
680	O2L36SI1	M36I1	1.5	M36B3	-0.1	300.2	0.005	8	0.01	1.99	42.6	514.71	8.3	PVC
1170	O1L14SA6	M14A6	-0.5	M14A5	-2.4	64.2	0.029	8	0.013	3.56	76.17	923.17	8.3	Vitrified Clay
659	O2L36SC3	M36C3	3.9	M36C2	-0.5	309.8	0.014	8	0.01	3.24	69.33	843.1	8.2	PVC
3278	O2L18SC2	M18C2	3	M18C1	2.5	140.1	0.004	12	0.013	1.75	83.84	1019.8	8.2	
3429	O2L25SA2	M25A2	-0.4	M25A1	-1	132.9	0.004	8	0.013	1.37	29.1	355.25	8.2	Vitrified Clay
1198	O1L14SA9	M14A9	0.4	M14A8	-0.6	249.5	0.004	8	0.013	1.31	27.93	342.65	8.2	Vitrified Clay
4014	O2L9SB2	M9B1	0.5	M9B2	1.5	123	0.008	6	0.01	2.01	23.63	295.15	8	PVC
953	O2L4SA4	M4A4	1.2	M4A3	0.7	103.7	0.005	6	0.013	1.15	13.55	169.51	8	Vitrified Clay
1228	O1L14SA10	M14A10	1.2	M14A9	0.4	205.2	0.004	8	0.013	1.3	26.22	342.81	7.6	
1031	O1L17SN1	M17N1	0.1	M17A2	-1.9	188.1	0.011	12	0.013	2.77	125.4	1652.8	7.6	
532	O1L14SA1	M14A1	-4	W-14	-8.2	6.8	1.403	10	0.013	26.73	877.5	11649	7.5	
1319	O1L17SQ4	M17Q4	4.1	M17Q3	3.3	199.6	0.004	8	0.013	1.29	25.65	343.31	7.5	Vitrified Clay
1582	O2L16SB2	M16B2	-1.7	M16B1	-2	109.3	0.003	8	0.013	1.16	22.9	311.19	7.4	Vitrified Clay
1698	O2L38SA5	M38A4	-3.7	M38A5	-2.1	397.1	0.004	8	0.01	1.68	33.07	450.33	7.3	PVC
1431	O2L32SB2	M32A2	0.8	M32A1	-1.2	242.9	0.008	8	0.01	2.34	45.94	630.08	7.3	PVC
3083	O2L16SA1	M16A1	-2.8	W-16	-7.3	31.2	0.145	8	0.013	7	149	2064.8	7.2	Vitrified Clay
1605	O1L17SO2	M17O2	2.9	M17O1	1.7	258.3	0.005	8	0.01	1.76	34.2	476.53	7.2	PVC
3516	O2L35SD1	M35A3	1.5	M35D1	2	109.8	0.005	8	0.01	1.78	34.43	480.46	7.2	PVC
4096	O2L1SA10	M1A9	3	M1A10	4.3	221.4	0.006	8	0.013	1.51	28.75	410.73	7	Vitrified Clay
1718	O2L16SA2	M16A2	-2.6	M16A1	-2.8	25.6	0.007	12	0.013	2.24	95.48	1378.3	6.9	
692	O2L36SB4	M36B4	0.5	M36B3	-0.1	188.5	0.003	8	0.01	1.5	28.2	410.79	6.9	PVC
863	O2L1SK2	M1E4	3	M1E3	1.5	125.9	0.012	6	0.013	1.78	18.75	274.92	6.8	Vitrified Clay
4273	O2L32SC2	M32C1	0	M32C2	1	151.6	0.007	6	0.013	1.32	13.81	204.55	6.7	Vitrified Clay
1130	O1L14SF2	M14F2	2.5	M14F1	1.8	250.2	0.003	8	0.013	0.13	19.95	296.94	6.7	Vitrified Clay
3990	O2L35SA4	M35A3	1.5	M35A4	2.7	270.8	0.004	8	0.01	1.7	31.4	469.34	6.7	PVC
667	O2L36SG1	M36G1	5	M36C3	3.9	232.8	0.005	8	0.013	1.34	24.74	371.09	6.7	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1588	O2L16SD1	M16D1	-0.1	M16A3	-1.4	285.7	0.005	8	0.013	1.34	24.46	371.41	6.6	Vitrified Clay
1433	O2L32SA3	M32A2	0.8	M32A3	1.1	73.4	0.005	8	0.01	1.78	31.07	500.5	6.2	PVC
793	O2L2SD1	M2D1	-1.7	M2A1	-2.1	55.3	0.007	6	0.013	1.31	12.9	207.87	6.2	Vitrified Clay
796	O2L2SC1	M2C1	-1.8	M2A1	-2.1	40	0.007	6	0.013	1.28	12.6	203.11	6.2	Vitrified Clay
1356	O2L16SA6	M16A6	1.1	M16A5	0.6	98.2	0.005	8	0.01	1.82	31.71	512.97	6.2	PVC
1477	O2L39SA1	W-39	-2	M39A1	-1.6	76	0.005	8	0.01	0.2	31.5	511.59	6.2	PVC
1418	O1L17SB10	M17B10	7	M17B9	6.5	112.2	0.004	8	0.012	1.32	22.8	372.14	6.1	Ductile Iron
869	O2L1SE1	M1E1	-0.3	M1A2	-0.8	104.8	0.005	8	0.013	1.35	23.25	382.92	6.1	Vitrified Clay
867	O2L1SE2	M1E2	0.7	M1E1	-0.3	210.7	0.004	8	0.013	1.27	21.45	363.06	5.9	Vitrified Clay
4182	O2L7SB2	M1D1	-0.2	M1A1	-1	175.9	0.005	8	0.013	1.28	21.6	366.44	5.9	Vitrified Clay
1444	O2L31SA3	M31A3	-0.1	M31A2	-2.3	325.9	0.007	8	0.01	2.03	34.21	581.9	5.9	PVC
1442	O2L31SA4	M31A4	0.4	M31A3	-0.1	326.6	0.001	8	0.01	0.92	15.54	264.6	5.9	PVC
703	O1L17SL5	M17L5	3.6	M17L4	2.3	301.8	0.004	8	0.01	1.59	26.52	455.56	5.8	PVC
3198	O2L18SA1	W-18	-5.2	M18A1	-3.1	11.3	0.186	8	0.013	0.86	134.6	2339.4	5.8	Vitrified Clay
924	O2L5SA4	M5A4	-0.7	M5A3	-2.4	308.2	0.005	6	0.013	1.15	10.71	186.47	5.7	Vitrified Clay
528	O2L34SA1	M34A1	-5.5	W-34	-11.1	5.9	1.877	14	0.012	37.83	1914	34448	5.6	Ductile Iron
1522	O2L34SC2	M34C2	-0.3	M34C1	-1	152.4	0.005	8	0.01	1.64	26.4	480.62	5.5	PVC
4181	O2L7SB2	M1D2	0.9	M1D1	-0.2	268.1	0.004	8	0.013	1.22	19.5	358.58	5.4	Vitrified Clay
3187	O2L30SE1	M30B2	0	M30B1	-0.5	58.1	0.009	6	0.013	1.41	12.6	233.56	5.4	Vitrified Clay
976	O2L34SF2	M34F2	1.9	M34F1	-0.8	304.3	0.009	12	0.013	2.23	78.92	1480.9	5.3	
3193	O2L30SB4	M30B4	1.7	M30B3	1	143.5	0.005	4	0.01	1.05	4.095	77.556	5.3	PVC
1351	O2L34SL	M34L1	1.6	M34A8	0	389.1	0.004	8	0.013	1.16	18.06	343.39	5.3	Vitrified Clay
1714	O2L38SB3	M38B1	-1.6	M38B2	0.1	298.2	0.006	8	0.01	1.77	27.24	527.58	5.2	PVC
4002	O1L17SQ0	M17Q0	0.6	W-17	-0.1	26.7	0.027	8	0.01	3.86	59.22	1150	5.1	PVC
1083	O1L17SG1	M17G1	4.8	M17A10	4.1	172.1	0.004	8	0.01	1.49	22.8	446.44	5.1	PVC
1174	O1L14SM1	M14M1	-0.4	M14A7	-1.6	293.9	0.004	8	0.013	1.15	17.39	343.06	5.1	Vitrified Clay
1593	O2L16SA4	M16A4	-0.3	M16A3	-1.4	188.8	0.006	12	0.013	1.85	62.92	1253.3	5	
848	O2L1SJJ2	M1JJ2	2.1	M1JJ1	1.7	66.2	0.007	6	0.013	1.21	10.2	203.87	5	Vitrified Clay
1563	O1L14SH2	M14H2	3.4	M14H1	3	117.6	0.004	8	0.013	0.11	17.1	342.84	5	Vitrified Clay
859	O2L1SB1	M1A1	-1	M1B1	-0.4	124.3	0.005	8	0.013	1.24	18.6	375.29	5	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1321	O1L17SQ3	M17Q3	3.3	M17Q2	-3.4	341	0.02	8	0.013	2.51	37.05	759.03	4.9	Vitrified Clay
4020	O2L5SD2	M5D1	-1	M5D2	-0.8	43.7	0.005	6	0.01	1.3	10.71	221.39	4.8	PVC
926	O2L5SA6	M5A6	0.5	M5A4	-0.7	280.1	0.005	6	0.013	0.99	8.19	169.58	4.8	Vitrified Clay
1055	O1L17ST2	M17T2	-3.3	M17T1	-3.5	39.8	0.004	12	0.013	1.48	48.45	1013.6	4.8	
1021	O1L17SO3	M17O3	4.1	M17O2	2.9	270.1	0.005	8	0.01	1.57	22.8	477.74	4.8	PVC
1450	O2L31SB3	M31B2	0.8	M31B1	-0.4	235.1	0.005	8	0.01	1.61	23.34	493.11	4.7	PVC
4021	O2L5SD3	M5D2	-0.8	M5D3	0.7	341.9	0.005	6	0.013	0.98	7.875	169	4.7	Vitrified Clay
3657	O2L31SB1	M31A1	-4	W-31	-9.6	36.6	0.153	8	0.01	8.32	125.4	2756.8	4.5	PVC
1208	O1L14SS2	M14S2	2.1	M14S1	1	288.3	0.004	8	0.013	1.05	14.82	325.73	4.5	Vitrified Clay
3992	O2L35SA5	M35A4	2.8	M35A4	3.6	218.5	0.004	8	0.01	1.36	19.14	423.99	4.5	PVC
1312	O1L14SG1	M14G1	2.4	M14C9	1.7	177.5	0.004	8	0.01	0.13	19.95	442.78	4.5	PVC
1696	O2L38SA5	M38A6	-1.1	M38A5	-2	224.6	0.004	8	0.01	1.45	19.95	451.2	4.4	PVC
1613	O2L3SD1	M3D1	-0.2	M3A1	-1.8	527	0.003	8	0.013	0.96	13.11	296.95	4.4	Vitrified Clay
1776	O2L30SA4	M30A4	1.4	M30A3	0.6	183.3	0.005	6	0.013	0.98	7.56	171.47	4.4	Vitrified Clay
3476	O1L40SA1	M40A1	-0.6	W-40	-1.5	10.6	0.085	8	0.01	6.6	90.53	2054.1	4.4	PVC
1202	O1L14SS1	M14S1	1	M14A7	-1.6	247.7	0.011	8	0.013	1.78	24.37	556.67	4.4	Vitrified Clay
732	O2L3SL1	M3L1	0.4	M3H1	-0.1	113.6	0.005	6	0.013	0.97	7.41	170.35	4.3	Vitrified Clay
661	O2L36SC4	M36C4	5.1	M36C3	3.9	227.5	0.005	8	0.01	1.58	21.48	494.65	4.3	PVC
4064	O2L2SP1	M2P1	0	M2A2	-1.3	292.9	0.004	8	0.013	1.14	15.3	357.43	4.3	Vitrified Clay
1053	O1L17ST3	M17T3	-2.8	M17T2	-3.3	99.7	0.005	12	0.013	1.6	48.45	1132.6	4.3	
576	O2L7SE1	M7E1	4.9	M7D3	2.7	432.8	0.005	6	0.013	1.02	7.733	181.57	4.3	Vitrified Clay
4218	O2L25SA3	M25A2	-0.4	M25A3	0.2	107.7	0.006	8	0.013	1.29	17.13	404.83	4.2	Vitrified Clay
963	O2L4SA5	M4A5	1.8	M4A4	1.2	122.9	0.005	6	0.013	0.97	7.245	171.5	4.2	Vitrified Clay
3192	O2L30SF1	M30B3	1	M30B2	0	167.7	0.006	6	0.013	1.1	8.19	194.44	4.2	Vitrified Clay
137	O1L17SJ1	M17J1	3.7	M17A9	2.6	254	0.004	8	0.013	1.13	14.96	356.87	4.2	
1567	O1L14SH4	M14H4	4.2	M14H3	3.8	105.9	0.004	8	0.013	0.09	14.25	341.52	4.2	Vitrified Clay
3175	O2L30SA2	M30B1	-0.5	M30A1	-0.9	23.9	0.018	6	0.013	1.85	13.55	333.55	4.1	Vitrified Clay
1706	O2L38SC1	M38A2	-2	M38C1	-0.7	296.3	0.004	12	0.013	1.42	41	1030.2	4	
911	O2L5SA3	M5A3	-2.4	M5A2	-2.7	54.7	0.005	8	0.01	1.47	18.59	476.76	3.9	PVC
860	O2L1SB2	M1B1	-0.4	M1B2	1.2	373.3	0.004	8	0.013	1.09	13.8	354.63	3.9	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1612	O2L3SD2	M3D2	0.6	M3D1	-0.2	284.2	0.003	8	0.013	0.89	11.12	287.73	3.9	Vitrified Clay
735	O2L3SA3	M3A3	0.4	M3A2	-1.3	474.8	0.004	8	0.013	0.99	12.26	321.66	3.8	Vitrified Clay
1565	O1L14SH3	M14H3	3.8	M14H2	3.4	53.6	0.007	8	0.013	0.11	17.1	450.68	3.8	Vitrified Clay
1447	O2L31SB1	M31B1	-0.4	M31A1	-4	231.3	0.015	8	0.01	2.67	32.79	875.9	3.7	PVC
1025	O1L17SN2	M17N2	3.7	M17N1	0.1	202.6	0.018	8	0.01	2.84	34.2	935.91	3.7	PVC
1481	O2L39SA2	M39A1	-1.6	M39A2	-0.3	346.5	0.004	8	0.01	0.1	15.75	440.09	3.6	PVC
1435	O2L32SA4	M32A4	1.9	M32A3	1.1	179	0.004	8	0.01	1.4	16.52	465.42	3.5	PVC
3121	O2L29SB1	M29B1	-1	M29A1	-1.6	116	0.005	6	0.01	1.24	8.19	231.48	3.5	PVC
1749	O2L31SB3	M31B3	1.7	M31B2	0.8	175	0.005	8	0.01	1.52	17.77	505.55	3.5	PVC
4451	O2L18SB1	M18A1	-3.1	M18B1	-2.4	108	0.007	8	0.013	0.1	15.44	439.69	3.5	Vitrified Clay
1081	O1L17SH1	M17H1	2.6	M17A10	2.3	40.6	0.006	8	0.01	1.65	19.24	553.53	3.5	PVC
676	O2L36SB6	M36B6	3	M36B5	2.1	238.2	0.004	8	0.01	1.31	14.9	442.9	3.4	PVC
928	O2L5SA7	M5A7	1.8	M5A6	0.5	282.1	0.005	6	0.013	0.89	5.67	169.64	3.3	Vitrified Clay
1210	O1L14SS3	M14S3	2.9	M14S2	2.1	210.9	0.004	8	0.013	0.99	11.12	334.02	3.3	Vitrified Clay
705	O1L17SL6	M17L6	4	M17L5	3.6	88.8	0.004	8	0.01	1.35	15.12	456.92	3.3	PVC
742	O2L3SA4	M3A4	1.4	M3A3	0.4	285.6	0.004	8	0.013	0.94	10.55	320.92	3.3	Vitrified Clay
1070	O1L17SQ1	M17Q1	-4	M17Q0	0.6	105.3	-0.043	8	0.013	0.24	37.05	1128.7	3.3	Vitrified Clay
1716	O2L38SB3	M38B2	0.1	M38B3	1.5	395.4	0.003	8	0.01	1.22	13.62	416.54	3.3	PVC
786	O2L2SD3	M2D3	1.5	M2D2	0	255.5	0.006	6	0.013	1.01	6.3	192.96	3.3	Vitrified Clay
3384	O2L25SB2	M25B2	0.9	M25B1	0.3	267.7	0.002	8	0.013	0.79	8.76	269.31	3.3	Vitrified Clay
1079	O1L17SH2	M17H2	3	M17H1	2.6	95.1	0.005	8	0.01	1.48	16.39	506.06	3.2	PVC
1308	O1L14SG1	M14C10	2.6	M14C9	1.7	204.6	0.004	8	0.01	0.09	14.25	446.3	3.2	PVC
691	O2L36SB5	M36B5	2.1	M36B4	0.5	346.3	0.004	8	0.01	1.36	14.9	467.13	3.2	PVC
610	O2L2SA4	M2A4	1.5	M2A3	0.3	385.4	0.003	8	0.013	0.88	9.6	302.61	3.2	Vitrified Clay
1379	O1L37SC1	M37C1	-2.6	M37A1	-3.2	151.6	0.004	8	0.01	1.25	13.57	428.51	3.2	PVC
1349	O2L34SU1	M34U1	2.6	M34L1	1.6	241.1	0.004	8	0.013	1.02	10.98	351.02	3.1	Vitrified Clay
990	O2L34SI1	M34J1	0.1	M34A7	-0.5	104.2	0.006	6	0.013	1	6.038	194.22	3.1	Vitrified Clay
3349	O2L25SA4	M25A4	1	M25A3	0.2	124.4	0.006	8	0.01	1.6	17.13	554.7	3.1	PVC
3390	O2L25SA5	M25A4	1	M25A5	1.5	128.6	0.004	8	0.01	1.28	13.66	443.97	3.1	PVC
3392	O2L25SA6	M25A6	1.9	M25A5	1.5	110	0.004	8	0.01	1.26	13.35	435.75	3.1	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
767	O2L2SA3	M2A3	0.3	M2A2	-1.3	170.1	0.009	8	0.013	1.48	15.6	517.85	3	Vitrified Clay
1610	O2L3SD3	M3D3	1.5	M3D2	0.6	298.5	0.003	8	0.013	0.85	8.835	299.44	3	Vitrified Clay
4478	O2L4SG1	M4G1	3	M4A1	0.1	347.6	0.008	6	0.013	1.16	6.773	230.02	2.9	Vitrified Clay
567	O2L7SD4	M7D4	4.4	M7D3	2.7	329.2	0.005	6	0.013	0.93	5.4	183.62	2.9	
932	O2L5SD4	M5D4	2.2	M5D3	0.7	315.1	0.005	6	0.013	0.87	5.04	173.17	2.9	Vitrified Clay
3518	O2L35SB1	M35A1	-1.3	M35B1	2	326.2	0.01	8	0.01	2.01	20.64	709.15	2.9	PVC
3358	O2L25SB1	M25B1	0.3	M25A1	-1	149.3	0.008	8	0.013	1.39	14.12	494.2	2.9	Vitrified Clay
3195	O2L30SF1	M30F1	1.8	M30B3	1	205.5	0.004	4	0.01	0.77	1.89	69.272	2.7	PVC
804	O2L2SC2	M2C2	-1.3	M2C1	-1.8	83.4	0.006	6	0.013	0.98	5.4	198.28	2.7	Vitrified Clay
666	O2L36SG2	M36G2	6	M36G1	5	235.8	0.004	8	0.01	1.26	12.37	454.49	2.7	PVC
1719	O2L16SB1	M16B1	-2	M16A1	-2.8	114.9	0.006	12	0.013	1.58	34.91	1283.3	2.7	
3113	O2L29SA2	M29A2	-0.7	M29A1	-1.6	160.7	0.006	8	0.01	1.46	14.18	527.71	2.7	PVC
595	O2L7SF1	M7F1	4.1	M7D2	1.8	335.2	0.007	6	0.013	1.01	5.4	207.68	2.6	
3996	O2L36SD1	M36B1	-4	M36D1	1	188.9	0.026	8	0.01	3.13	29.8	1147.1	2.6	PVC
1406	O1L17SI1	M17I1	4.9	M17B5	4.7	64.3	0.004	8	0.01	1.2	11.4	439.57	2.6	PVC
4269	O1L14SF3	M14F2	2.5	M14F3	3	132.3	0.004	8	0.013	0.05	8.55	330.07	2.6	Vitrified Clay
4418	O2L30SA2	M30A2	-0.2	M30A1	-0.9	85.8	0.009	8	0.013	1.37	12.92	501.36	2.6	
1416	O1L17SE1	M17E1	7	M17B9	6.5	115	0.004	8	0.01	1.21	11.4	445.98	2.6	PVC
1004	O1L17SM7	M17M7	3.8	M17M6	2.5	319.4	0.004	8	0.01	1.21	11.4	446.35	2.6	PVC
1410	O1L17SD1	M17D1	6.2	M17B6	5.6	164.6	0.004	8	0.01	1.21	11.4	446.41	2.6	PVC
1420	O1L17SB11	M17B11	7.8	M17B10	7	190.4	0.004	8	0.01	1.23	11.4	457.07	2.5	PVC
842	O2L1SJJ3	M1JJ3	2.7	M1JJ2	2.1	81.2	0.007	6	0.013	0.98	5.1	205.35	2.5	Vitrified Clay
637	O2L36SA9	M36A9	1	M36A8	0.2	86.2	0.009	8	0.01	1.81	16.63	670.63	2.5	PVC
3414	O2L18SA2	M18A2	-2.5	M18A1	-3.1	163.8	0.004	12	0.013	0.07	24.57	991.79	2.5	
784	O2L2SD4	M2D4	3	M2D3	1.5	383.8	0.004	6	0.013	0.75	3.9	157.44	2.5	Vitrified Clay
3419	O2L18SA3	M18A3	-1.6	M18A2	-2.5	255	0.003	8	0.013	0.05	7.875	320.4	2.5	Vitrified Clay
3179	O2L30SB5	M30B5	2.2	M30B4	1.7	110.8	0.005	6	0.013	0.8	4.095	169.15	2.4	Vitrified Clay
3331	O2L25SC1	M25C1	0.6	M25A2	-0.4	133.3	0.008	6	0.013	1.05	5.355	221.35	2.4	Vitrified Clay
673	O2L36SF1	M36F1	3	M36D2	1.9	139.7	0.008	8	0.01	1.66	14.9	619.99	2.4	PVC
1427	O2L32SC1	M32A1	-0.6	M32C1	-0.4	27.1	0.007	8	0.01	1.53	13.81	574.73	2.4	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1186	O1L14SM3	M14M3	3	M14M2	2.2	209.2	0.004	8	0.013	0.93	8.265	347.74	2.4	Vitrified Clay
3305	O2L24SA1	M24D1	-0.9	M24A1	-1.6	169.2	0.004	6	0.013	0.75	3.78	159.65	2.4	Vitrified Clay
1027	O1L17SN3	M17N3	4.7	M17N2	3.7	210.4	0.005	8	0.01	1.28	11.4	483.64	2.4	PVC
639	O2L36SH2	M36H2	5.1	M36H1	3	229.5	0.009	8	0.01	1.77	15.7	669.54	2.3	PVC
1230	O1L14SA11	M14A11	2	M14A10	1.2	138.9	0.006	8	0.013	1.1	9.69	415.7	2.3	Vitrified Clay
3411	O2L18SE1	M18E1	-1.8	M18A2	-2.5	142.4	0.005	8	0.013	0.06	8.82	380.31	2.3	Vitrified Clay
663	O2L36SC5	M36C5	6	M36C4	5.1	220.1	0.004	8	0.01	1.22	10.74	463.16	2.3	PVC
4063	O2L2SR1	M2R1	1.8	M2P1	0	423.6	0.004	8	0.013	0.93	8.1	352.99	2.3	Vitrified Clay
1029	O1L17SN4	M17N4	5.3	M17N3	4.7	122.5	0.005	8	0.01	1.31	11.4	497.52	2.3	PVC
1603	O2L38SD1	M38D1	0.1	M38A6	-1	190.5	0.006	8	0.01	1.4	12.15	530.84	2.3	PVC
4479	O2L4SA1	M4A1	0.1	W-4	-4.6	7.7	0.602	6	0.013	8.39	44.53	1953.9	2.3	Vitrified Clay
592	O2L7SG1	M7G1	3.9	M7D1	1	328.7	0.009	6	0.013	1.11	5.4	237.34	2.3	
4018	O2L5SD1	M5A2	-2.7	M5D1	-1	360.5	0.005	8	0.01	1.25	10.71	475.56	2.3	PVC
1526	O2L34SC4	M34C4	2.9	M34C3	1.7	308.5	0.004	12	0.013	1.17	22.6	1009.7	2.2	Vitrified Clay
1561	O1L14SH1	M14H1	3	M14D2	1.3	47	0.036	8	0.013	0.15	22.8	1025.4	2.2	Vitrified Clay
1537	O2L34SB3	M34B3	2.9	M34B2	2.3	139.3	0.004	8	0.01	1.23	10.43	470.36	2.2	PVC
1535	O2L34SB2	M34B2	2.3	M34B1	1.7	122.7	0.004	8	0.01	1.23	10.43	471.99	2.2	PVC
647	O2L36SE1	M36E1	2.2	M36A3	-2.4	311.1	0.015	8	0.01	2.24	18.91	864.78	2.2	PVC
4028	O2L3SB1	M3A4	1.4	M3B1	1.9	100.8	0.005	6	0.013	0.78	3.705	170.08	2.2	Vitrified Clay
4066	O2L2SP2	M2P1	0	M2P2	0.5	91.8	0.006	6	0.013	0.9	4.2	196.19	2.1	
1463	O2L34SA12	M34A12	1.7	M34A11	1.5	31.8	0.004	8	0.013	0.92	7.613	359.79	2.1	Vitrified Clay
1462	O2L34SA13	M34A13	2.1	M34A12	1.7	127.9	0.003	8	0.013	0.8	6.563	314.43	2.1	Vitrified Clay
1528	O2L34SC5	M34C5	4.1	M34C4	2.9	308.2	0.004	12	0.013	1.15	21	1010.1	2.1	Vitrified Clay
1182	O1L14SM2	M14M2	2.2	M14M1	-0.4	216.3	0.012	8	0.013	1.51	12.26	591.62	2.1	Vitrified Clay
1068	O1L17SQ0	M17T1	-3.5	M17A1	-7	161.1	0.022	12	0.013	2.67	48.45	2353.3	2.1	
728	O2L3SL2	M3L2	0.9	M3L1	0.4	83.1	0.005	6	0.013	0.82	3.705	181.11	2	Vitrified Clay
4387	O2L32SB2	M32B1	2	M32B2	3	272.8	0.004	8	0.01	1.08	8.699	426.9	2	PVC
3181	O2L30SB6	M30B6	2.7	M30B5	2.2	91.7	0.005	6	0.013	0.84	3.78	186	2	Vitrified Clay
788	O2L2SD2	M2D2	0	M2D1	-1.7	68.4	0.025	6	0.013	1.8	8.1	398.66	2	Vitrified Clay
974	O2L34SF2	M34F3	2.7	M34F2	1.9	281.3	0.003	8	0.013	0.77	6.124	303.34	2	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
947	O2L4SB1	M4B1	2.5	M4A3	0.7	377.4	0.005	6	0.013	0.78	3.465	172.94	2	Vitrified Clay
1214	O1L14SS4	M14S4	3.7	M14S3	2.9	209.4	0.004	8	0.013	0.87	6.84	343.46	2	Vitrified Clay
3190	O2L30SE1	M30E1	1.5	M30B2	0	205.1	0.007	4	0.01	0.95	1.89	94.953	2	PVC
1796	O2L26SA1	M26A1	-0.1	W-26	-0.3	30.7	0.017	6	0.019	0.99	4.41	222.44	2	
798	O2L2SF1	M2F1	0.4	M2C1	-1.8	420.7	0.005	6	0.013	0.81	3.6	182.25	2	Vitrified Clay
638	O2L36SH1	M36H1	3	M36A8	0.2	96.2	0.029	8	0.01	3.01	23.56	1198.8	2	PVC
3900	O2L34SA14	M34A13	2.1	M34A14	2.3	50.2	0.003	8	0.013	0.74	5.775	296.44	1.9	
4417	O2L30SA3	M30A3	0.6	M30A2	-0.2	86.2	0.009	8	0.013	1.25	9.765	501.36	1.9	
1533	O2L34SD1	M34D1	2.9	M34B1	1.7	285.9	0.004	8	0.01	1.13	8.778	451.03	1.9	PVC
3136	O2L34SL2	M34L2	2.3	M34L1	1.6	126.4	0.006	6	0.01	1.1	4.823	248.74	1.9	PVC
1358	O2L16SA7	M16A7	2.8	M16A6	1.1	397.2	0.004	8	0.01	1.14	8.874	458.56	1.9	PVC
3988	O1L37SC1	M14D5	3.5	M14D4	2.8	225.2	0.003	8	0.013	0.04	5.7	298.04	1.9	Vitrified Clay
1314	O1L14SG2	M14G2	3.3	M14G1	2.4	203	0.004	8	0.01	0.05	8.55	448.05	1.9	PVC
1539	O2L34SB4	M34B4	3.5	M34B3	2.9	146.2	0.004	8	0.01	1.13	8.677	455.49	1.9	PVC
3126	O2L29SB2	M29B2	0	M29B1	-1	152.4	0.007	6	0.01	1.18	5.04	265.2	1.9	PVC
3225	O2L18SB2	M18B2	-1.6	M18B1	-2.4	137	0.006	8	0.013	0.05	7.875	422.13	1.9	Vitrified Clay
930	O2L5SA8	M5A8	3.1	M5A7	1.8	281.1	0.005	6	0.013	0.74	3.15	169.28	1.9	Vitrified Clay
709	O2L3SH3	M3H3	1.8	M3H2	1.3	115.2	0.005	6	0.013	0.74	3.135	169.18	1.9	Vitrified Clay
821	O2L1SB3	M1B2	1.2	M1B3	2.4	277.1	0.004	8	0.013	0.88	6.6	357.79	1.8	Vitrified Clay
1531	O2L34SD2	M34D2	3.6	M34D1	2.9	139.4	0.005	8	0.01	1.18	8.778	481.37	1.8	PVC
378	O2L3SG1	M3G1	0.2	M3A2	-1.3	398.5	0.004	8	0.013	0.81	5.985	330.52	1.8	Vitrified Clay
3902	O2L13SA1	W-13	2.7	M13A1	3.2	115.4	0.004	8	0.01	1.14	8.33	464.05	1.8	PVC
1601	O2L38SD2	M38D2	0.7	M38D1	0.2	191.8	0.002	8	0.01	0.83	6.077	341.53	1.8	PVC
671	O2L36SD3	M36D3	3	M36D2	1.9	76.5	0.014	8	0.01	2.03	14.9	837.85	1.8	PVC
967	O2L4SG2	M4G2	5.4	M4G1	3	360.7	0.007	6	0.013	0.88	3.623	205.41	1.8	Vitrified Clay
769	O2L2SJ1	M2A3	0.3	M2J1	0.1	127.5	-0.001	8	0.013	0.02	3.3	192.16	1.7	Vitrified Clay
695	O1L17SL1	M17L1	0.9	M17A8	-2.1	21.4	0.139	8	0.01	6.35	45.04	2631.4	1.7	PVC
636	O2L36SA10	M36A10	1.4	M36A9	1	88	0.005	8	0.01	1.17	8.313	487.09	1.7	PVC
1520	O2L34SC1	M34C1	-1	M34A2	-4.6	374	0.01	12	0.01	2.17	34.42	2030.2	1.7	PVC
640	O2L36SH3	M36H3	6	M36H2	5.1	213.5	0.004	8	0.01	1.12	7.852	465.33	1.7	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
585	O2L7SA4	M7A4	1.3	M7A3	-0.6	364.9	0.005	8	0.013	0.94	6.6	391.35	1.7	Vitrified Clay
757	O2L3SA6	M3A6	2.9	M3A5	1.7	259.6	0.005	6	0.013	0.72	2.85	169.07	1.7	Vitrified Clay
992	O2L34SJ2	M34K1	1.1	M34J1	0.1	182.5	0.006	6	0.013	0.8	3.15	187.35	1.7	Vitrified Clay
934	O2L5SD5	M5D5	3.4	M5D4	2.2	254	0.005	6	0.013	0.72	2.835	169.45	1.7	Vitrified Clay
1569	O1L14SH5	M14H5	5.2	M14H4	4.2	246.4	0.004	8	0.013	0.82	5.7	343.76	1.7	Vitrified Clay
3418	O2L18ASA4	M18A4	-0.9	M18A3	-1.6	164.1	0.004	8	0.013	0.04	5.67	343.92	1.6	Vitrified Clay
4104	O2L1SBB1	M1A7	1.7	M1BB1	2.4	89.8	0.008	6	0.013	0.93	3.6	218.9	1.6	Vitrified Clay
823	O2L1SB4	M1B3	2.4	M1B4	3.5	154.1	0.007	4	0.013	0.7	1.2	73.532	1.6	Vitrified Clay
4477	O2L4SH1	M4H1	2.5	M4A1	0.1	404.3	0.006	6	0.013	0.82	3.15	194.02	1.6	Vitrified Clay
1037	O1L17ST4	M17T4	1.1	M17T3	-2.8	190.2	0.021	12	0.013	2.41	37.05	2289.8	1.6	
1590	O2L16SD2	M16D2	2	M16D1	-0.1	279	0.008	8	0.013	1.11	7.554	470.5	1.6	Vitrified Clay
1310	O1L14SC11	M14C11	3.1	M14C10	2.6	135.7	0.004	8	0.01	0.05	7.125	444.74	1.6	PVC
4009	O2L9SA2	M9A1	-0.3	M9A2	1.1	236.1	0.006	12	0.013	1.29	19.69	1231.2	1.6	
3981	O2L15SA1	W-15	3.5	M15A1	4.5	266.7	0.004	8	0.01	1.01	6.738	431.72	1.6	PVC
894	O2L1SA11	M1A10	5.9	M1A11	6.4	146.8	0.003	8	0.01	0.96	6.25	411.46	1.5	PVC
1437	O2L32SD1	M32D1	1.4	M32A3	1.1	78.3	0.003	8	0.01	0.93	6.02	398.51	1.5	PVC
758	O2L3SA5	M3A5	1.7	M3A4	1.4	87.5	0.004	8	0.013	0.75	4.845	322.82	1.5	Vitrified Clay
3950	O2L29SA3	M29A2	-0.7	M29A3	0.2	149.9	0.006	8	0.01	1.23	7.875	529.4	1.5	PVC
1524	O2L34SC3	M34C3	1.7	M34C2	-0.3	30.9	0.064	8	0.01	4.12	26.4	1782.6	1.5	PVC
4153	O2L1SV1	M1U1	2.6	M1V1	3	43.4	0.009	4	0.013	0.76	1.2	81.985	1.5	Vitrified Clay
711	O2L3SH4	M3H4	2.5	M3H3	1.8	81.3	0.009	4	0.013	0.73	1.14	79.253	1.4	Vitrified Clay
4159	O2L1SS1	M1A4	1	M1S1	1.8	120.9	0.007	6	0.013	0.85	3	208.66	1.4	Vitrified Clay
613	O2L2SA5	M2A5	1.9	M2A4	1.5	124.8	0.004	8	0.013	0.77	4.8	336.41	1.4	Vitrified Clay
3435	O1L37SA1	M37A1	-3.2	W-37	-3.7	8.4	0.056	12	0.01	4.99	69.76	4904.3	1.4	PVC
1739	O2L16SB3	M16B3	-1.5	M16B2	-1.7	50.3	0.004	12	0.013	1.03	14.32	1008.4	1.4	
618	O2L3SD4	M3D4	2	M3D3	1.5	115	0.004	8	0.013	0.8	4.845	350.41	1.4	Vitrified Clay
4428	O2L16SC1	M16A1	-2.8	M16C1	2.2	437.7	0.011	8	0.013	1.3	7.875	576.76	1.4	
4057	O2L2ST1	M2R1	1.8	M2T1	2.3	85.8	0.006	6	0.013	0.8	2.7	198.53	1.4	Vitrified Clay
4030	O2L3SB2	M3B1	1.9	M3B2	2.8	214	0.005	6	0.013	0.68	2.28	169.53	1.3	Vitrified Clay
4271	O2L4SG3	M4G2	5.4	M4G3	6.2	100.2	0.008	6	0.013	0.9	2.993	224.99	1.3	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1542	O2L34SB1	M34B1	1.7	M34A1	-5.5	102.4	0.071	8	0.01	4.2	24.8	1873.1	1.3	PVC
1039	O1L17SV1	M17V1	1.8	M17T4	1.1	162.6	0.005	12	0.013	1.07	14.25	1086	1.3	
4162	O2L1SS2	M1S1	1.8	M1S2	2.5	60.4	0.012	4	0.013	0.82	1.2	91.915	1.3	Vitrified Clay
1095	O1L17SP2	M17P2	4.1	M17P1	2.9	316.4	0.004	8	0.01	0.98	5.7	441.35	1.3	PVC
1097	O1L17SP3	M17P3	4.5	M17P2	4.1	90	0.004	8	0.01	0.99	5.7	445.84	1.3	PVC
3644	O2L18ASA1	M18A-A1	-1	W-18A	-4	21.7	0.139	12	0.013	5.51	76	5961.7	1.3	
980	O2L34SH2	M34H1	-0.2	M34H2	0.9	195.1	0.006	6	0.013	0.74	2.363	186.95	1.3	Vitrified Clay
835	O2L1SH3	M1H2	3.3	M1H3	3.6	46.6	0.007	4	0.013	0.64	0.9	71.885	1.3	Vitrified Clay
1773	O2L30SA5	M30A5	2.2	M30A4	1.4	174.9	0.004	8	0.013	0.77	4.41	355.13	1.2	Vitrified Clay
1093	O1L17SP1	M17P1	2.9	M17A1	-7	91.4	0.108	8	0.01	5.02	28.5	2316.4	1.2	PVC
3144	O2L34SL3	M34L3	2.9	M34L2	2.3	91.7	0.006	6	0.01	0.99	3.09	254.72	1.2	PVC
4098	O2L1SHH1	M1A9	3	M1HH1	3.5	77.2	0.006	6	0.013	0.77	2.4	198.6	1.2	Vitrified Clay
4050	O2L2SR3	M2R2	3.2	M2R3	3.7	81.2	0.006	6	0.013	0.77	2.4	198.81	1.2	Vitrified Clay
3320	O2L24SA2	M24A2	-1	M24A1	-1.6	142.9	0.004	6	0.013	0.62	1.89	159.05	1.2	Vitrified Clay
755	O2L3SA7	M3A7	3.5	M3A6	2.9	148.7	0.005	6	0.013	0.65	1.995	169.06	1.2	Vitrified Clay
819	O2L1SF1	M1F1	2.5	M1B2	1.2	315.9	0.004	8	0.013	0.76	4.2	356.39	1.2	Vitrified Clay
806	O2L2SC3	M2C3	0.9	M2C2	-1.3	422.1	0.005	6	0.013	0.7	2.1	182.37	1.2	Vitrified Clay
800	O2L2SF2	M2F2	2.1	M2F1	0.4	318	0.005	6	0.013	0.69	2.1	183.59	1.1	Vitrified Clay
649	O2L36SE2	M36E2	6	M36E1	2.2	273.3	0.014	8	0.01	1.76	9.457	827	1.1	PVC
1786	O2L30SA1	M30A1	-0.9	W-30	-5.5	19.7	0.23	8	0.013	5.12	29.61	2601.4	1.1	
581	O2L7SA6	M7A6	4.9	M7A5	3.3	302.5	0.005	6	0.013	0.69	2.1	184.85	1.1	Vitrified Clay
1046	O1L17ST7	M17T7	2.4	M17T6	2.1	93.7	0.004	12	0.013	0.95	11.4	1004.7	1.1	
1048	O1L17ST6	M17T6	2.1	M17T5	1.8	68.2	0.004	12	0.013	0.95	11.4	1006.3	1.1	
3948	O2L10SA1	W-10	4.4	M10A1	5.5	238.1	0.005	6	0.01	0.83	2.479	222.53	1.1	PVC
1708	O2L38SC2	M38C1	-0.6	M38C2	1	264.1	0.006	12	0.013	1.18	13.94	1252.3	1.1	
1400	O1L17SC1	M17C1	3.7	M17B3	3.4	65.6	0.004	12	0.013	0.03	11.4	1025.7	1.1	
901	O2L23SB2	M23B2	3.5	M23B1	1.9	401.3	0.004	8	0.013	0.72	3.792	342.43	1.1	Vitrified Clay
3410	O2L18SE2	M18E2	-0.6	M18E1	-1.8	282.2	0.004	8	0.013	0.02	3.78	343.2	1.1	Vitrified Clay
827	O2L1SH1	M1B3	2.4	M1H1	2.9	94.6	0.006	8	0.013	0.86	4.5	409.82	1.1	Vitrified Clay
584	O2L7SA5	M7A5	3.3	M7A4	1.3	399.6	0.005	8	0.013	0.8	4.2	383.71	1.1	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
978	O2L34SH1	M34F1	0.8	M34H1	-0.2	109.3	-0.01	8	0.013	0.04	5.775	530.12	1.1	Vitrified Clay
3984	O1L37SC2	M37C1	-2.6	M37C2	-1.4	255.1	0.005	8	0.01	1.03	5.221	497.45	1	PVC
4122	O2L1SEE1	M1BB1	2.4	M1EE1	2.9	49.2	0.01	4	0.013	0.71	0.9	86.119	1	Vitrified Clay
1049	O1L17ST5	M17T5	1.8	M17T4	1.1	145.9	0.005	12	0.013	1.02	11.4	1107.6	1	
1232	O1L14SBB1	M14BB1	3.3	M14A11	2	308.7	0.004	8	0.013	0.7	3.42	342.62	1	Vitrified Clay
1190	O1L14SM4	M14M4	4.3	M14M3	3	319.5	0.004	8	0.013	0.7	3.42	343.3	1	Vitrified Clay
1246	O1L14SZ1	M14Z1	4.2	M14A10	1.2	321.9	0.009	8	0.013	1.05	5.13	519.69	1	Vitrified Clay
1508	O2L18ASD1	M18A-D1	2.5	M18A-A6	1.2	315.6	0.004	8	0.01	0.91	4.41	447.27	1	PVC
4072	O2L2SJ2	M2J1	0.1	M2J2	1	78.1	0.012	4	0.013	0.74	0.9	91.672	1	Vitrified Clay
3428	O2L25SA1	M25A1	-1	W-25	-5.9	50.8	0.097	12	0.013	4.35	48.25	4982.7	1	
722	O2L3SL3	M3L3	1.7	M3L2	0.9	125.3	0.007	6	0.013	0.74	1.995	207.43	1	Vitrified Clay
764	O2L2SB2	M2B2	2	M2B1	1	179.7	0.006	6	0.013	0.67	1.8	187.85	1	Vitrified Clay
1360	O2L16SA8	M16A8	3.5	M16A7	2.8	165.8	0.005	8	0.01	0.96	4.568	477.36	1	PVC
4004	O2L13SA2	M13A1	3.2	M13A2	4.5	310.7	0.004	8	0.013	0.7	3.334	350.8	1	
4107	O2L1SKK1	M1BB1	2.4	M1KK1	3.5	48.2	0.023	4	0.013	1.03	1.2	129.03	0.9	Vitrified Clay
611	O2L2SO1	M2O1	2.4	M2A4	1.5	315.3	0.003	8	0.013	0.59	2.7	297.71	0.9	Vitrified Clay
782	O2L2SI1	M2I1	4	M2D4	3	162	0.006	4	0.013	0.53	0.6	67.101	0.9	Vitrified Clay
1148	O1L14SJ1	M14J1	-1.9	M14A4	-2.9	254.3	0.004	8	0.01	0.03	3.99	446.55	0.9	PVC
1362	O2L16SA9	M16A9	3.9	M16A8	3.5	76.3	0.005	8	0.01	1.01	4.568	516.97	0.9	PVC
1218	O1L14SS5	M14S5	4.7	M14S4	3.7	280	0.004	8	0.013	0.63	2.85	324.1	0.9	Vitrified Clay
380	O2L3SG2	M3G2	1.7	M3G1	0.2	419.3	0.004	8	0.013	0.63	2.85	324.4	0.9	Vitrified Clay
4105	O2L1SBB2	M1BB1	2.4	M1BB2	3	127.3	0.005	6	0.013	0.6	1.5	172.91	0.9	Vitrified Clay
619	O2L3SE1	M3E1	2.4	M3D3	1.5	300.9	0.003	8	0.013	0.58	2.565	296.6	0.9	Vitrified Clay
4032	O2L3SB3	M3B2	2.8	M3B3	3.3	104.3	0.005	6	0.013	0.58	1.425	169.07	0.8	Vitrified Clay
1317	O1L17SQ5	M17Q5	5.3	M17Q4	4.1	301.2	0.004	8	0.013	0.66	2.85	340.88	0.8	Vitrified Clay
4112	O2L1SBB3	M1BB2	3	M1BB3	3.9	118.3	0.008	4	0.013	0.57	0.6	74.498	0.8	Vitrified Clay
614	O2L2SA6	M2A6	2.8	M2A5	1.9	296.5	0.003	8	0.013	0.57	2.4	298.8	0.8	Vitrified Clay
1774	O2L30SI1	M30I1	2	M30A4	1.4	69.2	0.009	4	0.013	0.6	0.63	79.509	0.8	Vitrified Clay
1754	O2L31SB4	M31B4	3.4	M31B3	1.7	470.5	0.004	12	0.013	0.83	7.72	975.16	0.8	
355	O1L17SJ2	M17J2	4.8	M17J1	3.7	259	0.004	8	0.01	0.86	3.563	451.05	0.8	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
812	O2L2SR2	M2R2	3.2	M2R1	1.8	334.5	0.004	8	0.013	0.67	2.7	355.61	0.8	Vitrified Clay
1035	O1L17SU1	M17U1	-2.3	M17T3	-2.8	61.2	0.009	12	0.013	1.25	11.4	1501.6	0.8	
4160	O2L1SU1	M1S1	1.8	M1U1	2.6	83.5	0.01	6	0.013	0.81	1.8	246.46	0.7	Vitrified Clay
909	O2L5SB1	M5B1	3	M5A3	-2.4	287.8	0.019	6	0.013	1.14	2.52	345.61	0.7	Vitrified Clay
1770	O2L30SA6	M30A6	2.7	M30A5	2.2	104.2	0.005	6	0.013	0.57	1.26	174.43	0.7	Vitrified Clay
3903	O2L5SC1	M5A1	-2.9	M5C1	2	250.8	0.02	6	0.013	1.15	2.52	352.74	0.7	Vitrified Clay
1158	O1L14SL1	M14L1	0.1	M14A5	-2.4	327.2	0.007	8	0.01	1.11	4.275	607.64	0.7	PVC
1142	O1L14SI1	M14I1	-0.8	M14A4	-2	306.5	0.004	8	0.01	0.82	3.135	446.62	0.7	PVC
4208	O2L30SA6	M30A7	2.8	M30A6	2.7	29.1	0.005	6	0.013	0.59	1.26	180.73	0.7	Vitrified Clay
4234	O2L7SC4	M7C3	0.7	M7C4	3	468.5	0.005	6	0.013	0.57	1.2	176.44	0.7	Vitrified Clay
1366	O2L16SG1	M16G1	2.5	M16A6	1.1	320.9	0.004	12	0.013	0.84	7.088	1048.7	0.7	
4034	O2L3SB4	M3B3	3.3	M3B4	3.6	62.9	0.005	6	0.013	0.55	1.14	171.05	0.7	Vitrified Clay
4229	O2L25SJ1	M25B2	0.9	M25J1	3	400.1	0.005	6	0.013	0.58	1.2	181.15	0.7	Vitrified Clay
766	O2L2SB1	M2B1	1	M2A2	-1.3	308.4	0.007	8	0.013	0.83	3	467.41	0.6	Vitrified Clay
1077	O1L17SG1	M17H3	4.5	M17H2	3	366.1	0.004	8	0.01	0.79	2.85	445.26	0.6	PVC
1771	O2L30SK1	M30K1	3.1	M30A5	2.2	70.4	0.014	4	0.013	0.71	0.63	99.254	0.6	Vitrified Clay
1772	O2L30SJ1	M30J1	3.5	M30A5	2.2	99	0.014	4	0.013	0.71	0.63	99.722	0.6	Vitrified Clay
3172	O2L30SC1	M30C1	-0.5	M30A1	-0.9	29.6	0.014	6	0.013	0.95	1.89	300.19	0.6	Vitrified Clay
1204	O1L14SX1	M14X1	2	M14S1	1	246.8	0.004	8	0.013	0.61	2.138	341.77	0.6	Vitrified Clay
1737	O2L16SH1	M16H1	-1.9	M16B1	-2	32.1	0.004	12	0.013	0.8	6.3	1017.5	0.6	
4214	O2L25SD1	M25C1	0.6	M25D1	2.3	116.5	0.014	4	0.013	0.72	0.63	102.26	0.6	Vitrified Clay
831	O2L1SI1	M1H1	2.9	M1H2	3.3	61.4	0.007	8	0.013	0.78	2.7	444.36	0.6	Vitrified Clay
771	O2L2SL1	M2L1	0.6	M2J1	0.1	86	0.006	6	0.013	0.62	1.2	197.66	0.6	Vitrified Clay
1236	O1L14SAA2	M14AA1	3.9	M14A10	1.2	248.8	0.011	8	0.013	1	3.42	568.69	0.6	Vitrified Clay
617	O2L3SD4	M3D5	4	M3D4	2	318.4	0.006	8	0.013	0.75	2.565	426.62	0.6	Vitrified Clay
955	O2L4SD1	M4D1	3.5	M4A4	1.2	332.6	0.007	6	0.013	0.65	1.26	210.31	0.6	Vitrified Clay
4198	O2L34SA15	M34A15	3.3	M34A14	2.3	255.6	0.004	8	0.01	0.77	2.625	445.41	0.6	PVC
1423	O2L34SE2	M34E2	1.5	M34E1	-0.9	213.2	0.011	6	0.01	1.08	2.042	349.5	0.6	PVC
4238	O2L7SM1	M7C2	-0.1	M7M1	3	463.4	0.007	6	0.013	0.63	1.2	205.96	0.6	Vitrified Clay
904	O2L23SA2	M17A2	2.1	M17A1	0.3	327.5	0.006	8	0.013	0.7	2.333	404.28	0.6	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1150	O1L14SJ2	M14J2	-0.7	M14J1	-1.9	303.7	0.004	8	0.01	0.77	2.565	445.06	0.6	PVC
1368	O2L16SG2	M16G2	3.4	M16G1	2.5	220.8	0.004	8	0.013	0.62	2.048	361.35	0.6	
4287	O1L14SC7	M14C6	0.5	M14E1	4.8	106.4	0.041	6	0.013	0.03	2.85	508.53	0.6	
972	O2L34SF2	M34F4	3.4	M34F3	2.7	291.5	0.002	12	0.013	0.59	4.286	772.29	0.6	
4388	O2L32SB1	M32B1	2	W-32	0	46.8	0.043	12	0.013	2.5	17.97	3305.6	0.5	
1335	O1L40SB2	M40A1	1.2	M40B2	1.9	188.5	0.004	8	0.01	0.77	2.45	453.49	0.5	PVC
1775	O2L30SH1	M30H1	3.1	M30A4	1.4	86.1	0.02	4	0.013	0.81	0.63	120.01	0.5	Vitrified Clay
3166	O2L30SA11	M30A11	4.4	M30A10	4	70.5	0.005	4	0.013	0.4	0.315	60.183	0.5	Vitrified Clay
1220	O1L14ST1	M14T1	3.1	M14S2	2.1	276.9	0.004	8	0.013	0.56	1.71	332.36	0.5	Vitrified Clay
4149	O2L1SU2	M1U1	2.6	M1U2	3.6	52.8	0.019	4	0.013	0.78	0.6	117.52	0.5	Vitrified Clay
1734	O2L16SF1	M16F1	3	M16B2	-1.7	436	0.011	8	0.013	0.93	2.858	560.08	0.5	
4175	O2L1SK1	M1E2	0.7	M1K1	2	66.3	0.02	6	0.013	1.05	1.8	353.44	0.5	Vitrified Clay
790	O2L2SE1	M2E1	2	M2D1	-1.7	414.5	0.009	6	0.013	0.7	1.2	238.36	0.5	Vitrified Clay
753	O2L3SA8	M3A8	4.3	M3A7	3.5	166.7	0.005	6	0.013	0.5	0.855	170.04	0.5	Vitrified Clay
1234	O1L14SBB2	M14BB2	4.2	M14BB1	3.3	246.9	0.004	8	0.013	0.57	1.71	342.35	0.5	Vitrified Clay
1176	O1L14SN1	M14N1	0.9	M14M1	-0.4	327.3	0.004	8	0.013	0.57	1.71	342.87	0.5	Vitrified Clay
4207	O2L30SA8	M30A8	3.1	M30A7	2.8	52.5	0.006	6	0.013	0.56	0.945	190.42	0.5	Vitrified Clay
1733	O2L16SE1	M16E1	3	M16B1	-2	435.3	0.012	8	0.013	0.96	2.858	581.84	0.5	
762	O2L2SB2	M2B3	3	M2B2	2	176.5	0.006	6	0.013	0.55	0.9	189.57	0.5	Vitrified Clay
228	O1L17SJ3	M17J3	5.2	M17J2	4.8	51.5	0.009	6	0.01	0.87	1.425	302.67	0.5	PVC
385	O2L23SA1	M17A1	0.3	W-23	-6.4	11	0.608	12	0.013	8.78	58.63	12469	0.5	
4044	O2L2SG1	M2F2	2.1	M2G1	2.8	135	0.006	4	0.013	0.41	0.3	64.717	0.5	Vitrified Clay
4220	O2L25SF1	M25A1	-1	M25F1	2	115.2	0.026	4	0.013	0.9	0.63	137.14	0.5	Vitrified Clay
4091	O2L1SQ1	M1A3	-0.1	M1Q1	2	86.1	0.024	6	0.013	1.12	1.8	392.33	0.5	Vitrified Clay
4224	O2L25SI1	M25B1	0.3	M25I1	3	105.6	0.026	4	0.013	0.9	0.63	137.33	0.5	Vitrified Clay
3106	O2L34SO1	M34O1	2.9	M34A9	0.1	177.4	0.016	6	0.01	1.17	1.89	412.04	0.5	PVC
802	O2L2SF3	M2F3	2.6	M2F2	2.1	89.5	0.006	4	0.013	0.43	0.3	66.799	0.4	Vitrified Clay
3599	O1L37SE1	M37C1	-2.6	M37E1	-1.6	235	0.004	8	0.01	0.75	2.088	471.24	0.4	PVC
3598	O1L37SB1	M37A2	-2.8	M37B1	-1.7	233.9	0.005	8	0.01	0.77	2.088	476.91	0.4	PVC
4118	O2L1SCC2	M1CC1	3.5	M1CC2	4	77.5	0.006	4	0.013	0.43	0.3	68.59	0.4	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
825	O2L1SB5	M1B4	3.5	M1B5	4.5	152.8	0.007	4	0.013	0.43	0.3	69.091	0.4	Vitrified Clay
850	O2L1SOO1	M1JJ1	1.7	M1OO1	4.5	402.4	0.007	6	0.013	0.6	0.9	210.2	0.4	Vitrified Clay
1498	O2L18ASB1	M18A-B1	0.9	M18A-A3	-0.3	279.5	0.004	8	0.01	0.71	1.89	446.28	0.4	PVC
1768	O2L30SA9	M30A9	3.8	M30A8	3.1	198.2	0.004	6	0.013	0.42	0.63	149.65	0.4	Vitrified Clay
1240	O1L14SA12	M14A12	3.5	M14A11	2	375.3	0.004	8	0.013	0.54	1.425	342.87	0.4	Vitrified Clay
1162	O1L14SK1	M14K1	0.6	M14A5	-2.4	260.8	0.012	8	0.01	1.18	3.135	757.49	0.4	PVC
4169	O2L1SM1	M1E1	-0.3	M1M1	2	75.2	0.03	4	0.013	0.9	0.6	147.72	0.4	Vitrified Clay
3520	O2L35SC1	M35A1	-1.3	M35C1	0	95.3	0.014	8	0.01	1.28	3.317	823.44	0.4	PVC
3156	O2L30SL1	M30A7	2.8	M30L1	3.8	118.5	0.008	4	0.013	0.47	0.315	78.474	0.4	Vitrified Clay
4109	O2L1SKK2	M1KK1	3.5	M1KK2	4.5	130.6	0.008	4	0.013	0.45	0.3	74.737	0.4	Vitrified Clay
1192	O1L14SR1	M14R1	4.4	M14M4	4.3	130.4	0.001	6	0.013	0.2	0.285	73.133	0.4	Vitrified Clay
4100	O2L1SII1	M1HH1	3.5	M1II1	5	181.6	0.008	4	0.013	0.48	0.3	77.63	0.4	Vitrified Clay
1144	O1L14SI2	M14I2	0.5	M14I1	-0.8	310.4	0.004	8	0.01	0.69	1.71	447.43	0.4	PVC
4114	O2L1SBB4	M1BB3	3.9	M1BB4	5.1	138.4	0.009	4	0.013	0.49	0.3	79.521	0.4	Vitrified Clay
4185	O2L7SB2	M1D3	3	M1D4	4	114.4	0.009	4	0.013	0.49	0.3	79.857	0.4	Vitrified Clay
4197	O2L34SA16	M34A16	4.9	M34A15	3.3	402.3	0.004	4	0.01	0.43	0.263	70.459	0.4	PVC
4247	O2L7SJ1	M7C1	-0.9	M7J1	4	296.3	0.017	6	0.013	0.87	1.2	323.84	0.4	Vitrified Clay
4068	O2L2SP3	M2P2	0.5	M2P3	3	262.3	0.009	4	0.013	0.5	0.3	82.722	0.4	Vitrified Clay
4102	O2L1SHH2	M1HH1	3.5	M1HH2	5.2	180.7	0.009	4	0.013	0.5	0.3	82.851	0.4	Vitrified Clay
4059	O2L2ST2	M2T1	2.3	M2T2	4.2	196	0.01	4	0.013	0.5	0.3	83.315	0.4	Vitrified Clay
3153	O2L34ST1	M34T1	3.5	M34A14	2.3	287.1	0.004	4	0.01	0.44	0.263	73.273	0.4	PVC
4200	O2L29SA4	M29A3	0.2	M29A4	1.1	166	0.006	8	0.01	0.8	1.89	527.72	0.4	PVC
4078	O2L2SB2	M2B3	3	M2B4	4	102.3	0.01	4	0.013	0.51	0.3	84.454	0.4	Vitrified Clay
4061	O2L2SU1	M2T1	2.3	M2U1	3.5	125.5	0.01	4	0.013	0.51	0.3	84.562	0.4	Vitrified Clay
4054	O2L2SS1	M2R3	3.7	M2S1	4.7	101.9	0.01	4	0.013	0.51	0.3	85.33	0.4	Vitrified Clay
4036	O2L3SB5	M3B4	3.6	M3B5	4.4	85.4	0.009	4	0.013	0.49	0.285	81.087	0.4	Vitrified Clay
751	O2L3SA9	M3A9	5.2	M3A8	4.3	99.2	0.009	4	0.013	0.49	0.285	81.353	0.4	Vitrified Clay
4157	O2L1SW1	M1V1	3	M1W1	4	98.6	0.01	4	0.013	0.52	0.3	86.013	0.3	Vitrified Clay
3108	O2L34SO2	M34O2	3.3	M34O1	2.9	118.2	0.003	6	0.01	0.49	0.63	183.2	0.3	PVC
591	O2L7SG2	M7G2	5.6	M7G1	3.9	342.6	0.005	6	0.013	0.47	0.6	177.4	0.3	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
223	O1L17SK1	M17K1	5.6	M17J2	4.8	50.6	0.017	6	0.01	1.12	1.425	421.99	0.3	PVC
566	O2L7SD5	M7D5	6.1	M7D4	4.4	340.5	0.005	6	0.013	0.47	0.6	177.93	0.3	
594	O2L7SF2	M7F2	5.8	M7F1	4.1	338.4	0.005	6	0.013	0.47	0.6	178.48	0.3	
4420	O2L30SD1	M30A2	-0.2	M30D1	2	201.5	0.011	8	0.013	0.84	1.89	565.04	0.3	Vitrified Clay
1541	O2L34SB5	M34B5	4.3	M34B4	3.5	176.1	0.005	8	0.01	0.7	1.58	475.18	0.3	PVC
713	O2L3SH5	M3H4	2.5	M3H5	4	149.7	0.01	4	0.013	0.51	0.285	85.772	0.3	Vitrified Clay
3164	O2L30SA10	M30A10	4	M30A9	3.8	35.3	0.006	6	0.013	0.5	0.63	189.65	0.3	Vitrified Clay
815	O2L1SG1	M1G1	4	M1F1	2.5	130.2	0.011	4	0.013	0.54	0.3	91.187	0.3	Vitrified Clay
3427	O2L24SA1	M24A1	-1.6	W-24	-3.9	70.8	0.033	12	0.013	1.55	9.45	2895	0.3	
4120	O2L1SDD1	M1CC1	3.5	M1DD1	4	42.2	0.012	4	0.013	0.55	0.3	93.003	0.3	Vitrified Clay
1152	O1L14SJ3	M14J3	0.3	M14J2	-0.7	247	0.004	8	0.01	0.64	1.425	446.35	0.3	PVC
1188	O1L14SQ1	M14Q1	4.3	M14M3	3	115	0.011	6	0.013	0.7	0.855	268.8	0.3	Vitrified Clay
4093	O2L1SQ2	M1Q1	2	M1Q2	3.5	122	0.012	4	0.013	0.56	0.3	94.728	0.3	Vitrified Clay
4205	O2L29SB3	M29B3	2	M29B2	0	401.7	0.005	8	0.01	0.71	1.575	497.47	0.3	PVC
3138	O2L34SM1	M34M1	2.8	M34L2	2.3	85.6	0.006	6	0.01	0.64	0.788	256.41	0.3	PVC
1422	O2L34SE1	M34A6	-1.9	M34E1	-0.9	335.6	0.003	10	0.01	0.62	2.042	687.31	0.3	PVC
1279	O2L22SB2	M22B2	2.5	M22B1	1.2	179.2	0.007	6	0.013	0.53	0.63	213.64	0.3	
3094	O2L29SA1	M29A1	-1.6	W-29	-5.9	16.2	0.267	12	0.013	4.7	24.26	8266.1	0.3	
575	O2L7SH1	M7H1	4.7	M7D2	1.8	426.1	0.007	6	0.013	0.51	0.6	207.04	0.3	Vitrified Clay
4453	O2L38SA7	M38A6	-1.1	M38A7	-0.5	81.2	0.007	8	0.01	0.84	1.715	596	0.3	PVC
4151	O2L1SU3	M1U2	3.6	M1U3	4.5	58.4	0.015	4	0.013	0.58	0.3	105.99	0.3	Vitrified Clay
4212	O2L25SC2	M25C1	0.6	M25C2	2.3	212.1	0.008	6	0.013	0.55	0.63	223.47	0.3	Vitrified Clay
1041	O1L17SV2	M17V2	2.8	M17V1	1.8	228.9	0.004	12	0.013	0.63	2.85	1013.8	0.3	
1738	O2L16SB4	M16B4	5	M16B3	-1.5	334.2	0.019	12	0.013	1.37	6.242	2221.4	0.3	
4095	O2L1SR1	M1Q1	2	M1R1	4	122.7	0.016	4	0.013	0.59	0.3	109.04	0.3	Vitrified Clay
715	O2L3SI1	M3I1	4	M3H3	1.8	143.3	0.015	4	0.013	0.57	0.285	106.05	0.3	Vitrified Clay
4006	O2L10SA2	M10A1	5.5	M10A2	6	103.8	0.005	6	0.013	0.43	0.467	174.81	0.3	
4124	O2L1SEE2	M1EE1	2.9	M1EE2	4	62.7	0.018	4	0.013	0.61	0.3	113.11	0.3	Vitrified Clay
982	O2L34SH3	M34H2	0.9	M34H3	2.5	261.6	0.006	6	0.013	0.48	0.525	199.95	0.3	Vitrified Clay
4179	O2L1SK2	M1K1	2	M1K2	4.5	137.6	0.018	4	0.013	0.62	0.3	115.13	0.3	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
574	O2L7SI2	M7I2	4.6	M7D1	1	430	0.008	6	0.013	0.56	0.6	231.06	0.3	Vitrified Clay
4177	O2L1SL1	M1K1	2	M1L1	4.5	131	0.019	4	0.013	0.63	0.3	118.02	0.3	Vitrified Clay
4267	O1L37SA4	M37A4	-0.4	M37A5	3	204.8	0.017	6	0.01	1.01	1.044	423.66	0.2	PVC
4216	O2L25SE1	M25A2	-0.4	M25E1	3	293.9	0.012	6	0.013	0.63	0.63	270.86	0.2	Vitrified Clay
3986	O1L37SC3	M37C2	-1.4	M37C3	-0.4	241.4	0.004	8	0.01	0.59	1.044	451.48	0.2	PVC
1289	O2L26SA2	M26A1	0.8	M26A2	2.7	261.3	0.007	6	0.01	0.64	0.63	278.43	0.2	PVC
1242	O1L14SA13	M14A13	5	M14A12	3.5	145.1	0.01	6	0.013	0.59	0.57	256.01	0.2	Vitrified Clay
4195	O2L34SS1	M34A13	2.1	M34S1	3.8	85.5	0.02	4	0.013	0.62	0.263	120.45	0.2	
3146	O2L34SL4	M34L4	3.9	M34L3	2.9	193.5	0.006	6	0.01	0.55	0.525	242.9	0.2	PVC
744	O2L3S132	M3C2	2	M3A4	1.4	213.7	0.003	6	0.013	0.3	0.285	134.54	0.2	Vitrified Clay
984	O2L34SI1	M34I1	1.5	M34H1	-0.2	169.9	0.01	6	0.013	0.58	0.525	253.69	0.2	Vitrified Clay
777	O2L2SL2	M2L2	3	M2L1	0.6	78.1	0.03	4	0.013	0.76	0.3	148.79	0.2	
4415	O2L30SG1	M30A3	0.6	M30G1	2	193.9	0.007	8	0.013	0.6	0.945	468.97	0.2	Vitrified Clay
773	O2L2SM1	M2M1	3	M2L1	0.6	77	0.031	4	0.013	0.76	0.3	149.83	0.2	Vitrified Clay
907	O2L5SB2	M5B2	4	M5B1	3	247.1	0.004	6	0.013	0.36	0.315	160.2	0.2	Vitrified Clay
936	O2L5SA9	M5A9	4.5	M5A8	3.1	319	0.005	6	0.013	0.38	0.315	169.18	0.2	Vitrified Clay
938	O2L5SD6	M5D6	4.6	M5D5	3.4	274.1	0.005	6	0.013	0.38	0.315	169.39	0.2	Vitrified Clay
969	O2L4SA6	M4A6	4	M4A5	1.8	491.3	0.005	6	0.013	0.38	0.315	169.66	0.2	Vitrified Clay
949	O2L4SB2	M4B2	4.3	M4B1	2.5	390	0.005	6	0.013	0.38	0.315	171.56	0.2	Vitrified Clay
3403	O2L18ASA5	M18A5	0.3	M18A4	-0.9	301.5	0.004	8	0.013	0	0.63	343.58	0.2	Vitrified Clay
941	O2L4SH2	M4H2	4	M4H1	2.5	316.8	0.005	6	0.013	0.38	0.315	173.3	0.2	Vitrified Clay
3171	O2L30SC2	M30C2	1.3	M30C1	-0.5	360.4	0.005	6	0.013	0.39	0.315	177.98	0.2	Vitrified Clay
4138	O2L1SAA1	M1A6	1.4	M1AA1	4	65	0.04	4	0.013	0.84	0.3	169.78	0.2	Vitrified Clay
4126	O2L1SEE3	M1EE1	2.9	M1EE3	4	27.8	0.04	4	0.013	0.84	0.3	169.96	0.2	Vitrified Clay
3185	O2L30SM1	M30M1	4	M30B6	2.7	258.1	0.005	6	0.013	0.39	0.315	178.71	0.2	Vitrified Clay
1216	O1L14SW1	M14W1	4.2	M14S4	3.7	118.6	0.004	6	0.013	0.36	0.285	161.86	0.2	Vitrified Clay
4040	O2L2SD5	M2D4	3	M2D5	4.5	322.1	0.005	6	0.013	0.36	0.3	171.84	0.2	Vitrified Clay
3912	O2L7SA7	M7A6	4.9	M7A7	6.1	243.7	0.005	6	0.013	0.37	0.3	176.7	0.2	
1224	O1L14ST2	M14T2	3.4	M14T1	3.1	76.5	0.004	6	0.013	0.35	0.285	167.92	0.2	Vitrified Clay
1364	O2L30SA10	M16A10	5.1	M16A9	3.9	259.9	0.004	8	0.01	0.55	0.788	466.92	0.2	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
573	O2L7SB2	M7B2	4.9	M7B1	3.6	269.8	0.005	6	0.013	0.37	0.3	178.14	0.2	Vitrified Clay
1222	O1L14SU1	M14U1	3.5	M14T1	3.1	85	0.005	6	0.013	0.35	0.285	170.58	0.2	Vitrified Clay
838	O2L1SJJ4	M1JJ4	4.5	M1JJ3	2.7	353.7	0.005	6	0.013	0.37	0.3	181.13	0.2	Vitrified Clay
1206	O1L14SX2	M14X2	3.3	M14X1	2	203.2	0.006	8	0.013	0.51	0.713	432.09	0.2	Vitrified Clay
1248	O1L14SZ2	M14Z2	5.5	M14Z1	4.2	324.6	0.004	8	0.013	0.41	0.57	345.84	0.2	Vitrified Clay
1212	O1L14SV1	M14V1	3.9	M14S3	2.9	244	0.004	8	0.013	0.41	0.57	350.68	0.2	Vitrified Clay
808	O2L2SC4	M2C4	2.3	M2C3	0.9	265.7	0.005	6	0.013	0.38	0.3	184.63	0.2	Vitrified Clay
4070	O2L2SQ1	M2P2	0.5	M2Q1	1.9	253.9	0.005	6	0.013	0.38	0.3	185.02	0.2	Vitrified Clay
1238	O1L14SAA2	M14AA2	4.8	M14AA1	3.9	190	0.004	8	0.013	0.42	0.57	356.31	0.2	Vitrified Clay
4052	O2L2SR4	M2R3	3.7	M2R4	4.7	172.7	0.006	6	0.013	0.39	0.3	188.12	0.2	Vitrified Clay
4232	O2L25SB3	M25B2	0.9	M25B3	5	164.1	0.025	6	0.013	0.81	0.63	396.55	0.2	Vitrified Clay
1244	O1L14SBB3	M14BB3	5.2	M14BB2	4.2	191.8	0.005	6	0.013	0.37	0.285	180.39	0.2	Vitrified Clay
833	O2L1SI1	M1H2	3.3	M1I1	4.5	208.8	0.006	6	0.013	0.39	0.3	190.11	0.2	Vitrified Clay
779	O2L2SN1	M2N1	0.9	M2J1	0.1	139.6	0.006	6	0.013	0.39	0.3	190.42	0.2	Vitrified Clay
4145	O2L1SX1	M1A5	1.1	M1X1	4	57.3	0.05	4	0.013	0.92	0.3	190.78	0.2	Vitrified Clay
4184	O2L7SB2	M1D2	0.9	M1D3	3	413.4	0.005	8	0.013	0.45	0.6	383.21	0.2	Vitrified Clay
4455	O2L38SA8	M38A7	-0.5	M38A8	7	308.6	0.024	8	0.01	1.28	1.715	1099.1	0.2	PVC
994	O2L34SK2	M34K2	3	M34K1	1.1	410	0.005	6	0.013	0.35	0.263	171.43	0.2	Vitrified Clay
844	O2L1SNN1	M1JJ2	2.1	M1NN1	4.5	391.2	0.006	6	0.013	0.4	0.3	196.01	0.2	Vitrified Clay
3183	O2L30SB7	M30B7	3.6	M30B6	2.7	220.4	0.004	6	0.01	0.42	0.315	209.19	0.2	PVC
916	O2L5SC2	M5C2	4	M5C1	2	273	0.007	6	0.013	0.43	0.315	215.53	0.1	Vitrified Clay
1504	O2L18ASC1	M18A-C1	2.3	M18A-A5	0.7	412.6	0.004	8	0.01	0.5	0.63	437.67	0.1	PVC
3123	O2L29SF1	M29F1	2.5	M29B1	-1	194.8	0.018	6	0.01	0.88	0.63	438.83	0.1	PVC
3425	O2L1SC1	M1C1	2	M1A1	-1	105.1	0.029	12	0.013	1.37	3.9	2718.9	0.1	
3408	O2L18SE3	M18E3	1.3	M18E2	-0.6	488.8	0.004	8	0.01	0.51	0.63	446.46	0.1	PVC
840	O2L1SKK1	M1JJ3	2.7	M1KK1	4.5	252.5	0.007	6	0.013	0.43	0.3	214.39	0.1	Vitrified Clay
957	O2L4SE1	M4E1	4	M4D1	3.5	61	0.008	6	0.013	0.45	0.315	227.98	0.1	Vitrified Clay
4155	O2L1SV2	M1V1	3	M1V2	4	15.4	0.065	4	0.013	0.95	0.3	217.54	0.1	Vitrified Clay
4038	O2L3SC1	M3B1	1.9	M3C1	4	35.5	0.061	4	0.013	0.91	0.285	210.32	0.1	Vitrified Clay
4255	O2L24SH1	M24A1	-1.6	M24H1	3	134.3	0.034	6	0.013	0.92	0.63	465.08	0.1	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4076	O2L2SK1	M2J2	1	M2K1	3	29.5	0.068	4	0.013	0.97	0.3	222.58	0.1	Vitrified Clay
792	O2L2SE2	M2E2	3	M2E1	2	126.6	0.008	6	0.013	0.44	0.3	223.85	0.1	Vitrified Clay
4083	O2L1SO1	M1A2	-0.8	M1O1	2	87.4	0.032	6	0.013	0.89	0.6	448.54	0.1	Vitrified Clay
4249	O2L24SD2	M24D1	-0.9	M24D2	3.7	130.1	0.035	6	0.013	0.94	0.63	473.45	0.1	Vitrified Clay
4074	O2L2SJ3	M2J2	1	M2J3	4	41.9	0.072	4	0.013	0.99	0.3	228.61	0.1	Vitrified Clay
1736	O2L16SH2	M16H2	4.2	M16H1	-1.9	332.4	0.018	12	0.013	1.06	2.829	2162.4	0.1	
4085	O2L1SP1	M1O1	2	M1P1	4	27.7	0.072	4	0.013	0.99	0.3	229.54	0.1	Vitrified Clay
829	O2L1SI1	M1H1	2.9	M1J1	4.5	192.6	0.008	6	0.013	0.45	0.3	229.64	0.1	Vitrified Clay
962	O2L4SA6	M4F1	4	M4A5	1.8	243	0.009	6	0.013	0.48	0.315	242.34	0.1	Vitrified Clay
4189	O2L34SR1	M34A13	2.1	M34R1	3	16	0.056	4	0.013	0.87	0.263	202.47	0.1	Vitrified Clay
4222	O2L25SG1	M25A1	-1	M25G1	8	237.8	0.038	6	0.013	0.96	0.63	489.09	0.1	Vitrified Clay
1160	O1L14SL2	M14L2	1.5	M14L1	0.1	355.4	0.004	8	0.01	0.49	0.57	445.64	0.1	PVC
1164	O1L14SK2	M14K2	1.6	M14K1	0.6	234.1	0.004	8	0.01	0.49	0.57	446.74	0.1	PVC
4147	O2L1SY1	M1A5	1.1	M1Y1	0	14.6	-0.078	4	0.013	0.01	0.3	238.72	0.1	Vitrified Clay
852	O2L1SOO2	M1OO1	4.5	M1OO2	5	55	0.009	6	0.013	0.47	0.3	240.13	0.1	Vitrified Clay
4171	O2L1SN3	M1M1	2	M1N3	4	24.9	0.08	4	0.013	1.04	0.3	241.96	0.1	Vitrified Clay
846	O2L1SLL1	M1JJ2	2.1	M1LL1	4.5	256.3	0.009	6	0.013	0.47	0.3	242.15	0.1	Vitrified Clay
4131	O2L1SFF1	M1A8	1.9	M1FF1	4	25.8	0.082	4	0.013	1.04	0.3	243.89	0.1	Vitrified Clay
4227	O2L25SH1	M25B1	0.3	M25H1	7	157.1	0.043	6	0.013	1	0.63	521.19	0.1	Vitrified Clay
4089	O2L1SO2	M1O1	2	M1O2	4	23.4	0.085	4	0.013	1.06	0.3	249.44	0.1	Vitrified Clay
4026	O2L4SC1	M4A3	0.7	M4C1	4	283.9	0.012	6	0.013	0.52	0.315	271.11	0.1	Vitrified Clay
1184	O1L14SP1	M14P1	3.8	M14M2	2.2	199.4	0.008	8	0.013	0.53	0.57	493.37	0.1	Vitrified Clay
1281	O2L22SE1	M22E1	2.6	M22B1	1.2	208.3	0.007	6	0.01	0.52	0.315	274.09	0.1	PVC
4173	O2L1SM2	M1M1	2	M1M2	4	21.1	0.095	4	0.013	1.11	0.3	262.71	0.1	Vitrified Clay
720	O2L3SL4	M3L4	4	M3L3	1.7	232.3	0.01	6	0.013	0.47	0.285	250.57	0.1	Vitrified Clay
4187	O2L1SH4	M1H3	3.6	M1H4	4.5	71.6	0.012	6	0.013	0.52	0.3	276.09	0.1	Vitrified Clay
959	O2L4SD2	M4D2	4	M4D1	3.5	37	0.014	6	0.013	0.55	0.315	292.76	0.1	Vitrified Clay
1180	O1L14SO1	M14O1	2.5	M14N1	0.9	135	0.012	6	0.013	0.51	0.285	275.52	0.1	Vitrified Clay
3134	O2L29SC2	M29C2	3	M29C1	2	129.4	0.008	8	0.01	0.64	0.63	619.81	0.1	PVC
615	O2L2SA7	M2A7	3.7	M2A6	2.8	300.7	0.003	8	0.013	0.31	0.3	296.71	0.1	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
612	O2L2SO2	M2O2	3.4	M2O1	2.4	316.4	0.003	8	0.013	0.31	0.3	297.16	0.1	Vitrified Clay
4245	O2L7SK1	M7C1	-0.9	M7K1	3	264.7	0.015	6	0.013	0.56	0.3	305.68	0.1	Vitrified Clay
620	O2L3SE2	M3E2	3.3	M3E1	2.4	300.9	0.003	8	0.013	0.3	0.285	296.62	0.1	Vitrified Clay
616	O2L3SD6	M3D6	3.9	M3D5	2.9	314.4	0.003	8	0.013	0.3	0.285	298.11	0.1	Vitrified Clay
996	O2L34SJ2	M34J2	2.5	M34J1	0.1	194.9	0.012	6	0.013	0.5	0.263	280.02	0.1	Vitrified Clay
3952	O2L29SD1	M29A3	0.2	M29D1	4	421.4	0.009	8	0.01	0.68	0.63	672.56	0.1	PVC
4133	O2L1SGG1	M1A8	1.9	M1GG1	4	14.5	0.144	4	0.013	1.31	0.3	324.64	0.1	Vitrified Clay
724	O2L3SM1	M3L2	0.9	M3M1	4.5	238.9	0.015	6	0.013	0.56	0.285	311.28	0.1	Vitrified Clay
3421	O2L18SG1	M18G1	-0.6	M18A3	-1.6	235.8	0.004	8	0.013	0	0.315	344.22	0.1	Vitrified Clay
3416	O2L18SF1	M18F1	-1.5	M18A2	-2.5	237.8	0.004	8	0.013	0	0.315	344.59	0.1	Vitrified Clay
4315	O2L18A	M18C2	3	M18D1	3.2	41.8	0.004	12	0.013	0.45	0.945	1048.7	0.1	
382	O2L3SG3	M3G3	3.1	M3G2	1.7	393.5	0.004	8	0.013	0.32	0.285	323.48	0.1	Vitrified Clay
817	O2L1SF2	M1F1	2.5	M1F2	4	371.7	0.004	8	0.013	0.34	0.3	342.68	0.1	Vitrified Clay
4257	O2L24SA3	M24A2	-1	M24A3	2	142.3	0.021	6	0.013	0.64	0.315	366.3	0.1	Vitrified Clay
730	O2L3SO1	M3O1	5	M3L1	0.4	255.7	0.018	6	0.013	0.59	0.285	337.04	0.1	Vitrified Clay
1194	O1L14SM5	M14M5	5.7	M14M4	4.3	345	0.004	8	0.013	0.34	0.285	343.01	0.1	Vitrified Clay
3119	O2L29SE1	M29E1	4	M29A2	-0.7	403.4	0.012	8	0.01	0.75	0.63	759.38	0.1	PVC
4253	O2L24SG1	M24A1	-1.6	M24G1	4	59.2	0.094	6	0.013	1.34	0.63	772.83	0.1	Vitrified Clay
4140	O2L1SZ1	M1A6	1.4	M1Z1	4	13.6	0.188	4	0.013	1.45	0.3	370.46	0.1	Vitrified Clay
1178	O1L14SN2	M14N2	2.5	M14N1	0.9	79	0.02	6	0.013	0.62	0.285	360.12	0.1	Vitrified Clay
4191	O2L34SP1	M34A12	1.7	M34P1	4	14.4	0.162	4	0.013	1.32	0.263	343.6	0.1	Vitrified Clay
4251	O2L24SA1	M24D1	-0.9	M24E1	5.4	58.1	0.108	6	0.013	1.42	0.63	829.33	0.1	Vitrified Clay
3142	O2L34SM2	M34N1	3.5	M34M1	2.8	55.5	0.012	6	0.01	0.61	0.263	358.36	0.1	PVC
4204	O2L29SB4	M29B4	2.5	M29B3	2	127.8	0.004	8	0.01	0.4	0.315	440.96	0.1	PVC
4210	O2L25SA7	M25A6	1.9	M25A7	3.5	403.5	0.004	8	0.01	0.4	0.315	443.97	0.1	PVC
3398	O2L25SK1	M25K1	2.4	M25A4	1	345.5	0.004	8	0.01	0.41	0.315	445.62	0.1	PVC
727	O2L3SN1	M3N1	-6.1	M3L1	0.4	241.6	-0.027	6	0.013	0	0.285	413.39	0.1	Vitrified Clay
4236	O2L7SC4	M7C3	0.7	M7N1	4	105.9	0.031	6	0.013	0.73	0.3	444.49	0.1	Vitrified Clay
4263	O2L7SB1	M7A1	-5.5	M7B1	3.6	238.5	0.038	12	0.013	1.25	2.1	3118.3	0.1	
3140	O2L34SM2	M34M2	3.8	M34M1	2.8	56.2	0.017	6	0.01	0.68	0.263	429.13	0.1	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1154	O1L14SJ	M14J4	1.4	M14J3	0.3	245	0.004	8	0.01	0.41	0.285	468.11	0.1	PVC
1146	O1L14SI3	M14I3	1.5	M14I2	0.5	226.4	0.004	8	0.01	0.41	0.285	470.9	0.1	PVC
4116	O2L1SCC1	M1BB2	3	M1CC1	3.5	46.8	0.011	12	0.013	0.63	0.9	1652.3	0.1	
4243	O2L7SL1	M7C2	-0.1	M7L1	6	104.9	0.058	6	0.013	0.9	0.3	607.2	0	Vitrified Clay
4259	O2L24SB1	M24A2	-1	M24B1	3	60.7	0.066	6	0.013	0.95	0.315	647.42	0	
3985	O1L37SD1	M37C2	-1.4	M37D1	5	56.1	0.114	8	0.01	1.92	1.044	2376.2	0	PVC
717	O2L3SK1	M3H3	1.8	M3K1	-5.1	102.4	-0.067	6	0.013	0	0.285	652.28	0	Vitrified Clay
4202	O2L29SA5	M29A4	1.1	M29A5	4.6	254.7	0.014	8	0.01	0.65	0.315	827.15	0	PVC
1200	O1L14SY1	M14Y1	4.8	M14A9	0.4	202.7	0.022	8	0.013	0.57	0.285	800.48	0	Vitrified Clay
1226	O1L14SS6	M14S6	5.8	M14S5	4.7	286.6	0.004	12	0.013	0.31	0.285	1004.1	0	
3424	O2L1SC2	M1C2	4	M1C1	2	292.2	0.007	12	0.013	0.37	0.3	1322.9	0	
3132	O2L29SC1	M29C1	2	M29A1	-1.6	16.4	0.218	8	0.01	1.96	0.63	3292.1	0	PVC
4042	O2L2SH1	M2D4	3	M2H1	3.5	25.7	0.019	12	0.013	0.56	0.3	2230.3	0	
4164	O2L1ST1	M1S2	2.5	M1T1	4	60.1	0.025	12	0.013	0.6	0.3	2526.9	0	
4167	O2L1SS3	M1S2	2.5	M1S3	4	57.6	0.026	12	0.013	0.61	0.3	2580.6	0	
4193	O2L34SQ1	M34A12	1.7	M34Q1	3.8	89	0.024	12	0.013	0.57	0.263	2474.3	0	
354	O1L17SM8	M17M8	4.2	M17M7	3.8	110	0.004	8	0.01	0	0	450.94	0	PVC
635	O2L36SA11	M36A11	2.8	M36A10	1.4	339.1	0.004	8	0.01	0	0	454.65	0	PVC
854	O2L1SMM1	M1MM1	4.5	M1JJ1	1.7	270.1	0.01	6	0.013	0	0	256.58	0	Vitrified Clay
1044	O1L17ST8	M17T8	2.8	M17T7	2.4	88.7	0.004	12	0.013	0	0	1004.2	0	
1051	O1L17SU2	M17U2	-1	M17U1	-2.3	275.1	0.005	12	0.013	0	0	1082.2	0	
1063	O1L17SR1	M17R1	1.8	M17Q0	0.6	400	0.003	8	0.013	0	0	299.51	0	Vitrified Clay
1065	O1L17SR2	M17R2	2.9	M17R1	1.8	268.2	0.004	8	0.013	0	0	342.55	0	Vitrified Clay
1067	O1L17SR3	M17R3	3.6	M17R2	2.9	161.2	0.005	8	0.013	0	0	367.43	0	Vitrified Clay
1074	O1L17SS1	M17S1	-1.4	M17Q2	-3.4	391.3	0.005	8	0.013	0	0	381.87	0	Vitrified Clay
1085	O1L17SG2	M17G2	7	M17G1	4.8	398.5	0.006	8	0.01	0	0	527.42	0	PVC
1683	O2L19SA2	M19A2	1.5	M19A1	1	72.8	0.007	12	0.013	0	0	1324.9	0	Vitrified Clay
1684	O2L19SA1	M19A1	1	W-19	-4.4	16.7	0.321	12	0.013	0	0	9058.2	0	Vitrified Clay
3130	O2L29SG1	M29G1	2.5	M29B2	0	130.4	0.019	6	0.01	0	0	453.23	0	PVC
3983	O2L38SD3	M38D2	0.8	M38D3	1.1	72	0.004	8	0.01	0	0	462.79	0	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1515	O2L46SA1	W-46	2	M46A1	2.4	72.7	-0.006	8	0.01	(N/A)	(N/A)	529.48	(N/A)	PVC

EXHIBIT F.2
SEWER MANHOLE DATA TABLE REPORT

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
67	M17A9	8.5	8.5	16416	0	552.09	11.4	563.49	1.15	1.2	FALSE	TRUE
359	M3A1	6.4	6.4	8964	-1.8	355.85	6.225	362.07	0.69	-1.1	FALSE	TRUE
456	M7A1	6.6	8.3	5184	-5.5	179.72	3.6	183.32	2.15	-3.4	FALSE	TRUE
522	M34A1	6.7	6.7	0	-5.5	1913.6	0	1913.6	0.85	-4.6	FALSE	TRUE
533	M14A2	5.6	7.5	0	-3.6	785.55	0	785.55	2.38	-1.2	FALSE	TRUE
534	M14A3	5.9	5.9	0	-2.6	98.119	0	98.119	1.48	-1.1	FALSE	TRUE
535	M14A4	5.6	5.6	2872.8	-3.1	96.124	1.995	98.119	1.94	-1.1	FALSE	TRUE
598	M3D5	6.8	6.8	3283.2	2.9	0.285	2.28	2.565	1.06	4	FALSE	TRUE
712	M3H5	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
723	M3M1	5.5	5.5	410.4	4.5	0	0.285	0.285	0.01	4.5	FALSE	TRUE
725	M3N1	5.6	5.6	410.4	-6.1	0	0.285	0.285	6.58	0.5	FALSE	TRUE
816	M1F2	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
824	M1B5	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
828	M1J1	6	6	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
832	M1I1	5.8	5.8	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
839	M1KK1	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
843	M1NN1	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
845	M1LL1	6.3	6.3	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
851	M1OO2	6.4	6.4	432	5	0	0.3	0.3	0.01	5	FALSE	TRUE
897	M1D4	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
950	M4C1	5.5	5.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	TRUE
973	M34F2	4.8	4.8	36429.05	0.3	53.617	25.298	78.915	1.75	2	FALSE	TRUE
975	M34F1	4.8	4.8	1890	-0.8	84.69	1.3125	86.002	1.78	1	FALSE	TRUE
977	M34H1	3.4	3.4	4158	-0.2	2.8875	2.8875	5.775	1.25	1	FALSE	TRUE
981	M34H3	4.1	4.1	756	2.5	0	0.525	0.525	0.02	2.5	FALSE	TRUE
985	M34A6	4.3	4.3	31753.4	-1.9	343.28	22.051	365.33	0.71	-1.2	FALSE	TRUE
1056	M17A1	8.6	8.6	41040	-7	898.27	28.5	926.77	0.76	-6.2	FALSE	TRUE
1069	M17Q1	6.7	6.7	0	-4	37.05	0	37.05	4.78	0.8	FALSE	TRUE
1071	M17Q2	7.3	7.3	0	-3.4	37.05	0	37.05	4.2	0.8	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1073	M17S1	7	7	0	-1.4	0	0	0	2.26	0.8	FALSE	TRUE
1080	M17A10	8.7	8.7	6156	0.6	532.85	4.275	537.13	2.15	2.7	FALSE	TRUE
1086	M17A12	9.4	9.4	183654	4	0	127.54	127.54	0.84	4.9	FALSE	TRUE
1087	M17A11	8.9	8.9	32832	1.6	468.01	22.8	490.81	3.18	4.7	FALSE	TRUE
1098	M14C5	7.4	7.4	36936	-0.4	276.4	25.65	302.05	7.65	7.2	FALSE	TRUE
1099	M14D1	5.1	5.1	24624	0.4	142.45	17.1	159.55	4.66	5.1	TRUE	TRUE
1101	M14D2	4.9	4.9	16416	1.3	131.05	11.4	142.45	3.67	4.9	TRUE	TRUE
1103	M14D3	5.7	5.7	4104	2.1	105.4	2.85	108.25	2.93	5.1	FALSE	TRUE
1105	M14D4	6.1	6.1	16416	2.8	94.002	11.4	105.4	2.34	5.1	FALSE	TRUE
1107	M14C4	6.2	6.2	364682	-1.4	302.05	253.25	555.3	7.62	6.2	TRUE	TRUE
1109	M14C3	6.4	6.4	29548.8	-2.3	555.3	20.52	575.82	6.95	4.6	FALSE	TRUE
1112	M14C2	6.4	6.4	0	-2.4	575.82	0	575.82	6.76	4.4	FALSE	TRUE
1114	M14C1	6.4	6.4	0	-2.7	687.43	0	687.43	6	3.3	FALSE	TRUE
1121	M14D5	6.3	6.3	8208	3.5	0	5.7	5.7	1.66	5.1	FALSE	TRUE
1123	M14C6	7.1	7.1	4104	0.5	114	2.85	116.85	6.64	7.1	TRUE	TRUE
1125	M14C7	7.4	7.4	12312	1	102.6	8.55	111.15	6.23	7.2	FALSE	TRUE
1127	M14F1	9.2	9.2	16416	1.8	19.95	11.4	31.35	5.46	7.2	FALSE	TRUE
1129	M14F2	0	7.9	16416	2.5	8.55	11.4	19.95	4.71	7.2	FALSE	TRUE
1147	M14J1	5.4	5.4	2052	-1.9	2.565	1.425	3.99	0.78	-1.1	FALSE	TRUE
1155	M14A5	5.2	5.2	7797.6	-2.4	83.584	5.415	88.999	1.29	-1.1	FALSE	TRUE
1171	M14A7	6.4	6.4	6885.6	-1.6	71.393	4.7817	76.174	1.41	-0.2	FALSE	TRUE
1270	M22F1	4.7	4.7	143100	-1.8	0	99.375	99.375	1.79	0	FALSE	TRUE
1274	M22A2	4.8	4.8	20412	-0.8	446.34	14.175	460.51	0.88	0.1	FALSE	TRUE
1284	M22A5	5.4	5.4	240786	2.2	0	167.21	167.21	0.31	2.5	FALSE	TRUE
1288	M26A2	5	5	907.2	2.7	0	0.63	0.63	-0.03	2.7	FALSE	TRUE
1303	M14C8	8.1	8.1	0	1.3	71.25	0	71.25	5.94	7.2	FALSE	TRUE
1305	M14C9	7.3	7.3	53352	1.7	34.2	37.05	71.25	5.49	7.2	FALSE	TRUE
1307	M14C10	7.6	7.6	10260	2.6	7.125	7.125	14.25	4.67	7.2	FALSE	TRUE
1309	M14C11	8.2	8.2	10260	3.1	0	7.125	7.125	4.13	7.2	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1311	M14G1	8	8	16416	2.4	8.55	11.4	19.95	4.79	7.2	FALSE	TRUE
1313	M14G2	8.2	8.2	12312	3.3	0	8.55	8.55	3.97	7.2	FALSE	TRUE
1332	M40A5	9.2	9.2	126831.6	3.7	0	88.078	88.078	0.2	3.9	FALSE	TRUE
1334	M40B2	8	8	3528	4	0	2.45	2.45	-2.03	2	FALSE	TRUE
1386	M37D1	8.1	8.1	1503.6	5	0	1.0442	1.0442	0.02	5	FALSE	TRUE
1393	M17B1	8.8	8.8	0	2.2	210.19	0	210.19	2.56	4.7	FALSE	TRUE
1395	M17B2	9	9	0	2.6	210.19	0	210.19	2.25	4.8	FALSE	TRUE
1397	M17B3	8	8	32832	3.4	187.39	22.8	210.19	1.52	5	FALSE	TRUE
1399	M17C1	7.7	7.7	16416	3.7	0	11.4	11.4	1.25	5	FALSE	TRUE
1401	M17B4	8.1	8.1	0	4	175.99	0	175.99	1.06	5.1	FALSE	TRUE
1464	M34A9	4.4	4.4	3402	0.1	215.54	2.3625	217.91	0.65	0.7	FALSE	TRUE
1476	M39A1	5.9	5.9	22680.42	-1.6	15.75	15.75	31.501	3.6	2	FALSE	TRUE
1480	M39A2	5.9	5.9	22680.42	-0.3	0	15.75	15.75	2.25	2	FALSE	TRUE
1493	M18A-A2	5.1	5.1	0	-0.7	76.004	0	76.004	1.39	0.7	FALSE	TRUE
1495	M18A-A3	5.6	5.6	7257.6	-0.3	70.964	5.04	76.004	0.99	0.7	FALSE	TRUE
1516	M34A3	5.1	5.1	16068.5	-4.4	634.04	11.159	645.2	0.78	-3.6	FALSE	TRUE
1550	M17F1	9.1	9.1	32832	2.8	107.49	22.8	130.29	2.11	4.9	FALSE	TRUE
1552	M17F2	8.9	8.9	0	3.9	107.49	0	107.49	1.1	5	FALSE	TRUE
1554	M17F3	10.9	10.9	70178.4	4	58.754	48.735	107.49	1	5	FALSE	TRUE
1560	M14H1	5.6	5.6	8208	3	17.1	5.7	22.8	1.99	4.9	FALSE	TRUE
1562	M14H2	5.6	5.6	0	3.4	17.1	0	17.1	1.52	4.9	FALSE	TRUE
1564	M14H3	5.6	5.6	4104	3.8	14.25	2.85	17.1	1.15	4.9	FALSE	TRUE
1566	M14H4	5.9	5.9	12312	4.2	5.7	8.55	14.25	0.73	4.9	FALSE	TRUE
1618	M3F3	5.9	5.9	0	3.2	132.9	0	132.9	0.29	3.5	FALSE	TRUE
1707	M38C2	7	7	20071.38	1	0	13.938	13.938	0.07	1.1	FALSE	TRUE
1715	M38B3	7.1	7.1	19609.59	1.5	0	13.618	13.618	0.08	1.6	FALSE	TRUE
3154	M30L1	4.2	4.2	453.6	3.8	0	0.315	0.315	0.02	3.8	FALSE	TRUE
3197	M18A1	5.6	5.6	3628.8	-3.1	132.03	2.52	134.55	4.11	1	FALSE	TRUE
3199	M18B2	5	5	11340	-1.6	0	7.875	7.875	2.57	1	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3223	M18B1	5.1	5.1	10886.4	-2.4	7.875	7.56	15.435	3.4	1	FALSE	TRUE
3303	M24A1	6	6	3628.8	-1.6	6.93	2.52	9.45	0.68	-0.9	FALSE	TRUE
3401	M18A5	6.9	6.9	907.2	0.3	0	0.63	0.63	0.72	1	FALSE	TRUE
3402	M18A4	6.3	6.3	7257.6	-0.9	0.63	5.04	5.67	1.93	1	FALSE	TRUE
3404	M18A2	5.4	5.4	10886.4	-2.5	17.01	7.56	24.57	3.48	1	FALSE	TRUE
3407	M18E2	7.1	7.1	4536	-0.6	0.63	3.15	3.78	1.65	1	FALSE	TRUE
3409	M18E1	6.2	6.2	7257.6	-1.8	3.78	5.04	8.82	2.78	1	FALSE	TRUE
3415	M18F1	6.9	6.9	453.6	-1.5	0	0.315	0.315	2.52	1	FALSE	TRUE
3417	M18A3	5.9	5.9	2721.6	-1.6	5.985	1.89	7.875	2.59	1	FALSE	TRUE
3420	M18G1	6.5	6.5	453.6	-0.6	0	0.315	0.315	1.64	1	FALSE	TRUE
3517	M35B1	6.5	6.5	29716.26	2	0	20.636	20.636	0.1	2.1	FALSE	TRUE
3519	M35C1	6	6	4776.24	0	0	3.3168	3.3168	0.04	0	FALSE	TRUE
3911	M7A7	7.9	7.9	432	6.1	0	0.3	0.3	0.02	6.1	FALSE	TRUE
3951	M29D1	5.1	5.1	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
3980	M15A1	7	7	9702	4.5	0	6.7375	6.7375	0.06	4.6	FALSE	TRUE
3991	M35A4	6.6	6.6	27561.66	3.6	0	19.14	19.14	0.1	3.7	FALSE	TRUE
4003	M13A2	6.2	6.2	4800.6	4.5	0	3.3337	3.3337	0.05	4.5	FALSE	TRUE
4005	M10A2	9.3	9.3	672	6	0	0.46667	0.46667	0.02	6	FALSE	TRUE
4008	M9A2	5.1	5.1	28350	1.1	0	19.688	19.688	0.09	1.2	FALSE	TRUE
4013	M9B2	5.3	5.3	34020	1.5	0	23.625	23.625	0.11	1.6	FALSE	TRUE
4035	M3B5	5	5	410.4	4.4	0	0.285	0.285	0.01	4.4	FALSE	TRUE
4037	M3C1	5.7	5.7	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
4039	M2D5	5.3	5.3	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4043	M2G1	5.6	5.6	432	2.8	0	0.3	0.3	0.02	2.9	FALSE	TRUE
4051	M2R4	6.2	6.2	432	4.7	0	0.3	0.3	0.02	4.7	FALSE	TRUE
4053	M2S1	6.1	6.1	432	4.7	0	0.3	0.3	0.01	4.8	FALSE	TRUE
4058	M2T2	6.1	6.1	432	4.2	0	0.3	0.3	0.01	4.2	FALSE	TRUE
4060	M2U1	6.2	6.2	432	3.5	0	0.3	0.3	0.01	3.6	FALSE	TRUE
4067	M2P3	6.1	6.1	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4069	M2Q1	6.9	6.9	432	1.9	0	0.3	0.3	0.02	1.9	FALSE	TRUE
4073	M2J3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4075	M2K1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4077	M2B4	5.5	5.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4084	M1P1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4088	M1O2	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4092	M1Q2	5.3	5.3	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	TRUE
4094	M1R1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4099	M1II1	5.8	5.8	432	5	0	0.3	0.3	0.02	5	FALSE	TRUE
4101	M1HH2	5.7	5.7	432	5.2	0	0.3	0.3	0.01	5.2	FALSE	TRUE
4108	M1KK2	6.5	6.5	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4113	M1BB4	5.6	5.6	432	5.1	0	0.3	0.3	0.01	5.1	FALSE	TRUE
4117	M1CC2	6	6	432	4	0	0.3	0.3	0.02	4	FALSE	TRUE
4119	M1DD1	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4123	M1EE2	6.1	6.1	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4125	M1EE3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4130	M1FF1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4132	M1GG1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4134	M1A6	6.5	6.5	432	1.4	192	0.29999	192.3	0.36	1.8	FALSE	TRUE
4137	M1AA1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4139	M1Z1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4141	M1A5	6.5	6.5	432	1.1	192.9	0.3	193.2	0.36	1.5	FALSE	TRUE
4144	M1X1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4146	M1Y1	6.8	6.8	432	0	0	0.3	0.3	1.5	1.5	FALSE	TRUE
4150	M1U3	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4154	M1V2	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4156	M1W1	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4163	M1T1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4166	M1S3	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4170	M1N3	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4172	M1M2	5	5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4176	M1L1	5.1	5.1	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4178	M1K2	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4186	M1H4	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4188	M34R1	4.4	4.4	378	3	0	0.2625	0.2625	0.01	3	FALSE	TRUE
4190	M34P1	4.8	4.8	378	4	0	0.2625	0.2625	0.01	4	FALSE	TRUE
4192	M34Q1	4.3	4.3	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4194	M34S1	4.7	4.7	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4201	M29A5	5.6	5.6	453.6	4.6	0	0.315	0.315	0.01	4.6	FALSE	TRUE
4209	M25A7	4.1	4.1	453.6	3.5	0	0.315	0.315	0.01	3.5	FALSE	TRUE
4211	M25C2	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4213	M25D1	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4215	M25E1	5.3	5.3	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4219	M25F1	4.7	4.7	907.2	2	0	0.63	0.63	0.02	2	FALSE	TRUE
4221	M25G1	10	10	907.2	8	0	0.63	0.63	0.02	8	FALSE	TRUE
4223	M25I1	5.2	5.2	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4226	M25H1	10	10	907.2	7	0	0.63	0.63	0.02	7	FALSE	TRUE
4228	M25J1	5.2	5.2	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4231	M25B3	7.3	7.3	907.2	5	0	0.63	0.63	0.02	5	FALSE	TRUE
4233	M7C4	4.5	4.5	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4235	M7N1	8.2	8.2	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4237	M7M1	4.8	4.8	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4240	M7L1	9.9	9.9	432	6	0	0.3	0.3	0.01	6	FALSE	TRUE
4244	M7K1	5.3	5.3	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4246	M7J1	8.4	8.4	1728	4	0	1.2	1.2	0.03	4	FALSE	TRUE
4248	M24D2	5.7	5.7	907.2	3.7	0	0.63	0.63	0.02	3.7	FALSE	TRUE
4250	M24E1	8.4	8.4	907.2	5.4	0	0.63	0.63	0.02	5.4	FALSE	TRUE
4252	M24G1	6.8	6.8	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4254	M24H1	5	5	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4256	M24A3	4.9	4.9	453.6	2	0	0.315	0.315	0.01	2	FALSE	TRUE
4258	M24B1	5.6	5.6	453.6	3	0	0.315	0.315	0.01	3	FALSE	TRUE
4266	M37A5	5	5	1503.6	3	0	1.0442	1.0442	0.02	3	FALSE	TRUE
4268	M14F3	8.3	8.3	12312	3	0	8.55	8.55	4.22	7.2	FALSE	TRUE
4270	M4G3	9	9	4309.2	6.2	0	2.9925	2.9925	0.04	6.2	FALSE	TRUE
4272	M32C2	5.2	5.2	19879.02	1	0	13.805	13.805	0.09	1.1	FALSE	TRUE
4286	M14E1	8	8	4104	4.8	0	2.85	2.85	2.3	7.1	FALSE	TRUE
4386	M32B2	6	6	12526.5	3	0	8.699	8.699	0.07	3.1	FALSE	TRUE
4414	M30G1	3.4	3.4	1360.8	2	0	0.945	0.945	0.02	2	FALSE	TRUE
4419	M30D1	3.5	3.5	2721.6	2	0	1.89	1.89	0.03	2	FALSE	TRUE
4427	M16C1	4.7	4.7	11340	2.2	0	7.875	7.875	0.06	2.3	FALSE	TRUE
4454	M38A8	10.3	10.3	2469.6	7	0	1.715	1.715	0.03	7	FALSE	TRUE
68	M17J1	8.8	8.8	16416	3.7	3.5625	11.4	14.962	0.09	3.8	FALSE	FALSE
222	M17K1	9.3	9.3	2052	5.6	0	1.425	1.425	0.03	5.6	FALSE	FALSE
226	M17J2	8.8	8.8	1026	4.8	2.85	0.7125	3.5625	0.04	4.8	FALSE	FALSE
227	M17J3	9.2	9.2	2052	5.2	0	1.425	1.425	0.03	5.2	FALSE	FALSE
352	M17M8	7.2	7.2	0	4.2	0	0	0	0	4.2	FALSE	FALSE
353	M17M7	7	7	16416	3.8	0	11.4	11.4	0.07	3.8	FALSE	FALSE
375	M3A2	6.2	6.2	11080.8	-1.3	195.87	7.695	203.57	0.36	-0.9	FALSE	FALSE
377	M3G1	6.1	6.1	4514.4	0.2	2.85	3.135	5.985	0.06	0.3	FALSE	FALSE
379	M3G2	6.2	6.2	3693.6	1.7	0.285	2.565	2.85	0.04	1.7	FALSE	FALSE
381	M3G3	6.4	6.4	410.4	3.1	0	0.285	0.285	0.01	3.1	FALSE	FALSE
384	M17A1	4.4	4.4	18900	0.3	45.5	13.125	58.625	0.15	0.5	FALSE	FALSE
403	M1A1	7.2	7.2	1728	-1	269.25	1.2	270.45	0.34	-0.7	FALSE	FALSE
418	M2A1	5.8	5.8	432	-2.1	64.2	0.3	64.5	0.23	-1.9	FALSE	FALSE
424	M3J1	5.4	5.4	820.8	3	161.96	0.57	162.53	0.28	3.3	FALSE	FALSE
451	M1A9	6.3	6.3	1728	3	185.1	1.2	186.3	0.28	3.3	FALSE	FALSE
523	M34A2	5.7	5.7	20709.15	-4.6	679.62	14.381	694	0.53	-4.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
530	M14A1	6.3	6.3	0	-4	877.46	0	877.46	0.63	-3.3	FALSE	FALSE
545	M7B1	8.4	8.4	2592	3.6	0.3	1.8	2.1	0.03	3.6	FALSE	FALSE
546	M7B2	7.7	7.7	432	4.9	0	0.3	0.3	0.02	4.9	FALSE	FALSE
549	M7A3	6.1	6.1	3888	-0.6	62.933	2.7	65.633	0.19	-0.4	FALSE	FALSE
550	M7D1	6	6	15552	1	45.533	10.8	56.333	0.18	1.2	FALSE	FALSE
551	M7D2	6	6	15552	1.8	28.733	10.8	39.533	0.16	2	FALSE	FALSE
552	M7D3	6.7	6.7	13824	2.7	13.133	9.6	22.733	0.12	2.8	FALSE	FALSE
553	M7E1	7.7	7.7	11136	4.9	0	7.7333	7.7333	0.07	5	FALSE	FALSE
554	M7H1	6.7	6.7	864	4.7	0	0.6	0.6	0.02	4.7	FALSE	FALSE
555	M7I2	6.1	6.1	864	4.6	0	0.6	0.6	0.02	4.6	FALSE	FALSE
559	M7D4	7.4	7.4	6912	4.4	0.6	4.8	5.4	0.06	4.5	FALSE	FALSE
560	M7G2	7.1	7.1	864	5.6	0	0.6	0.6	0.02	5.6	FALSE	FALSE
561	M7F2	7.7	7.7	864	5.8	0	0.6	0.6	0.02	5.8	FALSE	FALSE
564	M7A6	8	8	2592	4.9	0.3	1.8	2.1	0.04	5	FALSE	FALSE
565	M7D5	7.7	7.7	864	6.1	0	0.6	0.6	0.02	6.1	FALSE	FALSE
580	M7A5	7.7	7.7	3024	3.3	2.1	2.1	4.2	0.05	3.3	FALSE	FALSE
583	M7A4	6.6	6.6	3456	1.3	4.2	2.4	6.6	0.06	1.4	FALSE	FALSE
587	M7A2	6.1	6.1	3456	-2	65.633	2.4	68.033	0.19	-1.8	FALSE	FALSE
590	M7G1	6.3	6.3	6912	3.9	0.6	4.8	5.4	0.05	4	FALSE	FALSE
593	M7F1	6.5	6.5	6912	4.1	0.6	4.8	5.4	0.06	4.2	FALSE	FALSE
596	M3D4	6.7	7.5	3283.2	2	2.565	2.28	4.845	0.05	2	FALSE	FALSE
597	M3D3	6.6	6.6	2052	1.5	7.41	1.425	8.835	0.08	1.6	FALSE	FALSE
599	M3D6	6.3	6.3	410.4	3.9	0	0.285	0.285	0.11	4	FALSE	FALSE
600	M2A7	6.4	6.4	432	3.7	0	0.3	0.3	0.02	3.8	FALSE	FALSE
601	M3E1	5.4	5.4	3283.2	2.4	0.285	2.28	2.565	0.04	2.5	FALSE	FALSE
602	M3E2	5.3	5.3	410.4	3.3	0	0.285	0.285	0.02	3.3	FALSE	FALSE
603	M2O2	6.1	6.1	432	3.4	0	0.3	0.3	0.02	3.4	FALSE	FALSE
604	M2A6	6.3	6.3	3024	2.8	0.3	2.1	2.4	0.04	2.9	FALSE	FALSE
605	M2O1	6.1	6.1	3456	2.4	0.3	2.4	2.7	0.05	2.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
606	M2A4	7.3	7.3	3024	1.5	7.5	2.1	9.6	0.08	1.5	FALSE	FALSE
607	M2A5	7.3	7.3	3456	1.9	2.4	2.4	4.8	0.06	2	FALSE	FALSE
608	M2A3	7.1	7.1	3888	0.3	12.9	2.7	15.6	0.08	0.3	FALSE	FALSE
622	M36A11	5.8	5.8	0	2.8	0	0	0	0	2.8	FALSE	FALSE
623	M36A10	5.9	5.9	11970	1.4	0	8.3125	8.3125	0.06	1.5	FALSE	FALSE
624	M36A9	5.7	5.7	11970	1	8.3125	8.3125	16.625	0.09	1.1	FALSE	FALSE
625	M36A8	5.9	5.9	23276.4	0.2	40.18	16.164	56.344	0.17	0.4	FALSE	FALSE
627	M36A6	5.8	5.8	23276.4	-1.7	72.508	16.164	88.673	0.21	-1.4	FALSE	FALSE
628	M36A5	6.4	6.4	23276.4	-2	88.673	16.164	104.84	0.23	-1.7	FALSE	FALSE
629	M36A4	5.9	5.9	11306.4	-2.2	104.84	7.8517	112.69	0.34	-1.9	FALSE	FALSE
630	M36A3	6.1	6.1	24924.06	-2.4	131.6	17.308	148.91	0.27	-2.2	FALSE	FALSE
631	M36E1	7.1	7.1	13617.66	2.2	9.4567	9.4567	18.913	0.09	2.3	FALSE	FALSE
632	M36H1	8.8	8.8	11306.4	3	15.703	7.8517	23.555	0.1	3.1	FALSE	FALSE
633	M36H2	9.3	9.3	11306.4	5.1	7.8517	7.8517	15.703	0.08	5.2	FALSE	FALSE
634	M36H3	9.4	9.4	11306.4	6	0	7.8517	7.8517	0.06	6.1	FALSE	FALSE
641	M36A7	5.6	5.6	23276.4	-0.7	56.344	16.164	72.508	0.19	-0.5	FALSE	FALSE
648	M36E2	7.1	7.1	13617.66	6	0	9.4567	9.4567	0.07	6.1	FALSE	FALSE
650	M36A2	6.2	6.2	11306.4	-4.1	148.91	7.8517	156.76	0.28	-3.8	FALSE	FALSE
652	M36A1	5.8	5.8	76461.84	-5.2	420.64	53.098	473.73	0.43	-4.7	FALSE	FALSE
654	M36B1	6.5	6.5	50449.56	-4	228.84	35.034	263.87	0.37	-3.6	FALSE	FALSE
656	M36C2	5.3	7.9	15466.92	-0.5	69.331	10.741	80.072	0.19	-0.3	FALSE	FALSE
658	M36C3	8.2	8.2	33278.7	3.9	46.221	23.11	69.331	0.18	4.1	FALSE	FALSE
660	M36C4	8.6	8.6	15466.92	5.1	10.741	10.741	21.482	0.1	5.1	FALSE	FALSE
662	M36C5	8.5	10.4	15466.92	6	0	10.741	10.741	0.07	6.1	FALSE	FALSE
664	M36G2	8.9	8.9	17812.2	6	0	12.37	12.37	0.08	6.1	FALSE	FALSE
665	M36G1	8.8	8.8	17811.78	5	12.37	12.369	24.739	0.12	5.1	FALSE	FALSE
668	M36D2	6	6	0	1.9	29.802	0	29.802	0.13	2.1	FALSE	FALSE
670	M36D3	5.9	5.9	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
672	M36F1	5.5	5.5	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
674	M36B6	5.7	5.7	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
675	M36B5	6.5	6.5	0	2.1	14.901	0	14.901	0.08	2.1	FALSE	FALSE
677	M36B3	6.4	8.3	3439.8	-0.1	70.801	2.3888	73.19	0.18	0.1	FALSE	FALSE
679	M36I1	7.1	8.2	2192.4	1.5	41.077	1.5225	42.6	0.14	1.6	FALSE	FALSE
681	M36B2	6.3	6.3	50449.56	-3	73.19	35.034	108.22	0.24	-2.7	FALSE	FALSE
684	M36C1	8.3	8.3	15466.5	-2	80.072	10.741	90.812	0.21	-1.8	FALSE	FALSE
687	M36D1	8.3	8.3	0	1	29.802	0	29.802	0.12	1.1	FALSE	FALSE
690	M36B4	8	8	19152	0.5	14.901	13.3	28.201	0.12	0.7	FALSE	FALSE
693	M17A8	8.4	8.4	0	-2.1	608.53	0	608.53	0.49	-1.6	FALSE	FALSE
694	M17L1	7.7	10.5	0	0.9	45.041	0	45.041	0.14	1	FALSE	FALSE
696	M17L2	8.3	8.3	0	1.2	45.041	0	45.041	0.14	1.3	FALSE	FALSE
698	M17L3	6.7	6.7	10260	1.8	37.916	7.125	45.041	0.14	1.9	FALSE	FALSE
700	M17L4	7.6	7.6	16416	2.3	26.516	11.4	37.916	0.13	2.5	FALSE	FALSE
702	M17L5	7	7	16416	3.6	15.116	11.4	26.516	0.11	3.7	FALSE	FALSE
704	M17L6	7.2	7.2	21766.4	4	0	15.116	15.116	0.08	4.1	FALSE	FALSE
706	M3H2	5.4	5.4	2872.8	1.3	165.66	1.995	167.66	0.34	1.6	FALSE	FALSE
708	M3H3	5.5	5.5	2052	1.8	1.71	1.425	3.135	0.05	1.8	FALSE	FALSE
710	M3H4	4.9	4.9	1231.2	2.5	0.285	0.855	1.14	0.03	2.5	FALSE	FALSE
714	M3I1	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
716	M3K1	5.8	5.8	410.4	-5.1	0	0.285	0.285	6.92	1.8	FALSE	FALSE
718	M3L4	5.2	5.2	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
719	M3L3	3.9	3.9	2462.4	1.7	0.285	1.71	1.995	0.03	1.7	FALSE	FALSE
721	M3L2	5.7	5.7	2052	0.9	2.28	1.425	3.705	0.05	0.9	FALSE	FALSE
726	M3L1	5.9	5.9	4514.4	0.4	4.275	3.135	7.41	0.07	0.5	FALSE	FALSE
729	M3O1	6.3	6.3	410.4	5	0	0.285	0.285	0.01	5	FALSE	FALSE
731	M3H1	5.1	5.1	3693.6	-0.1	175.07	2.565	177.63	0.35	0.2	FALSE	FALSE
734	M3A3	6.1	6.1	2462.4	0.4	10.545	1.71	12.255	0.09	0.5	FALSE	FALSE
741	M3A4	5.8	5.8	2462.4	1.4	8.835	1.71	10.545	0.08	1.5	FALSE	FALSE
743	M3C2	5.6	5.6	410.4	2	0	0.285	0.285	0.02	2	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
749	M3A9	5.3	5.3	410.4	5	0	0.285	0.285	0.21	5.2	FALSE	FALSE
750	M3A8	5.4	5.4	820.8	4.3	0.285	0.57	0.855	0.03	4.3	FALSE	FALSE
752	M3A7	5.5	5.5	1641.6	3.5	0.855	1.14	1.995	0.04	3.6	FALSE	FALSE
754	M3A6	5.3	5.3	1231.2	2.9	1.995	0.855	2.85	0.05	2.9	FALSE	FALSE
756	M3A5	6.4	6.4	2872.8	1.7	2.85	1.995	4.845	0.06	1.8	FALSE	FALSE
760	M2B3	5.6	5.6	864	3	0.3	0.6	0.9	0.02	3	FALSE	FALSE
761	M2B2	5.9	5.9	1296	2	0.9	0.9	1.8	0.03	2	FALSE	FALSE
763	M2B1	5.9	5.9	1728	1	1.8	1.2	3	0.04	1	FALSE	FALSE
765	M2A2	6.2	6.2	6912	-1.3	33.9	4.8	38.7	0.15	-1.1	FALSE	FALSE
768	M2J1	6.1	6.1	1296	0.1	2.4	0.9	3.3	0.25	0.4	FALSE	FALSE
770	M2L1	5.7	5.7	864	0.6	0.6	0.6	1.2	0.03	0.7	FALSE	FALSE
772	M2M1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
776	M2L2	6	6	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
778	M2N1	6.1	6.1	432	0.9	0	0.3	0.3	0.02	0.9	FALSE	FALSE
780	M2I1	6	6	864	4	0	0.6	0.6	0.02	4	FALSE	FALSE
781	M2D4	5.5	5.5	3888	3	1.2	2.7	3.9	0.05	3.1	FALSE	FALSE
783	M2D3	5.4	5.4	3456	1.5	3.9	2.4	6.3	0.06	1.6	FALSE	FALSE
785	M2D2	5.4	5.4	2592	0	6.3	1.8	8.1	0.06	0.1	FALSE	FALSE
787	M2D1	5.8	5.8	5184	-1.7	9.3	3.6	12.9	0.08	-1.6	FALSE	FALSE
789	M2E1	5.9	5.9	1296	2	0.3	0.9	1.2	0.03	2	FALSE	FALSE
791	M2E2	5.8	5.8	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
795	M2C1	5.8	5.8	5184	-1.8	9	3.6	12.6	0.08	-1.7	FALSE	FALSE
797	M2F1	5.7	5.7	2160	0.4	2.1	1.5	3.6	0.05	0.4	FALSE	FALSE
799	M2F2	5.8	5.8	2160	2.1	0.6	1.5	2.1	0.04	2.1	FALSE	FALSE
801	M2F3	6.1	6.1	432	2.6	0	0.3	0.3	0.02	2.6	FALSE	FALSE
803	M2C2	5.6	5.6	4752	-1.3	2.1	3.3	5.4	0.06	-1.3	FALSE	FALSE
805	M2C3	5.7	5.7	2592	0.9	0.3	1.8	2.1	0.04	0.9	FALSE	FALSE
807	M2C4	5.3	5.3	432	2.3	0	0.3	0.3	0.02	2.3	FALSE	FALSE
809	M2R1	5.7	5.7	3888	1.8	5.4	2.7	8.1	0.07	1.8	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
811	M2R2	5.8	5.8	432	3.2	2.4	0.3	2.7	0.04	3.3	FALSE	FALSE
813	M1G1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
814	M1F1	6.1	6.1	5184	2.5	0.6	3.6	4.2	0.05	2.6	FALSE	FALSE
818	M1B2	6	6	4320	1.2	10.8	3	13.8	0.09	1.2	FALSE	FALSE
820	M1B3	5.9	5.9	1296	2.4	5.7	0.9	6.6	0.06	2.4	FALSE	FALSE
822	M1B4	5.6	5.6	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
826	M1H1	5.8	5.8	2160	2.9	3	1.5	4.5	0.05	2.9	FALSE	FALSE
830	M1H2	5.9	5.9	2160	3.3	1.2	1.5	2.7	0.04	3.3	FALSE	FALSE
834	M1H3	6.1	6.1	864	3.6	0.3	0.6	0.9	0.03	3.7	FALSE	FALSE
836	M1JJ4	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	FALSE
837	M1JJ3	6.1	6.1	6480	2.7	0.6	4.5	5.1	0.05	2.7	FALSE	FALSE
841	M1JJ2	6.3	6.3	6480	2.1	5.7	4.5	10.2	0.08	2.2	FALSE	FALSE
847	M1JJ1	6.6	6.6	6912	1.7	11.1	4.8	15.9	0.1	1.8	FALSE	FALSE
849	M1OO1	6.3	6.3	864	4.5	0.3	0.6	0.9	0.02	4.5	FALSE	FALSE
853	M1MM1	6.2	6.2	0	4.5	0	0	0	0	4.5	FALSE	FALSE
855	M1D2	6.7	6.7	4320	0.9	16.5	3	19.5	0.11	1	FALSE	FALSE
858	M1B1	6.5	6.5	6912	-0.4	13.8	4.8	18.6	0.1	-0.3	FALSE	FALSE
861	M1E4	6.6	6.6	27000	3	0	18.75	18.75	0.1	3.1	FALSE	FALSE
862	M1E3	5.7	5.7	0	1.5	18.75	0	18.75	0.11	1.6	FALSE	FALSE
864	M1E2	5.4	5.4	1296	0.7	20.55	0.9	21.45	0.11	0.8	FALSE	FALSE
866	M1E1	6.3	6.3	1728	-0.3	22.05	1.2	23.25	0.11	-0.1	FALSE	FALSE
868	M1A2	6.4	6.4	2592	-0.8	223.35	1.8	225.15	0.37	-0.4	FALSE	FALSE
871	M1A4	6.5	6.5	0	1	196.2	0	196.2	0.35	1.3	FALSE	FALSE
882	M1U1	6.1	6.1	0	2.6	1.8	0	1.8	0.03	2.6	FALSE	FALSE
884	M1A7	6.5	6.5	0	1.7	191.4	0	191.4	0.31	2	FALSE	FALSE
886	M1BB2	5.9	5.9	0	3	1.5	0	1.5	0.03	3	FALSE	FALSE
891	M1A10	6.7	6.7	32400	4.3	6.25	22.5	28.75	0.12	4.4	FALSE	FALSE
893	M1A11	8.2	8.2	9000	4.8	0	6.25	6.25	1.64	6.4	FALSE	FALSE
899	M23B2	6.9	6.9	5460	3.5	0	3.7917	3.7917	0.05	3.6	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
900	M23B1	5.4	5.4	56700	1.9	3.7917	39.375	43.167	0.27	2.2	FALSE	FALSE
903	M17A2	6.1	7.8	3360	2.1	0	2.3333	2.3333	0.04	2.2	FALSE	FALSE
905	M5B2	6	6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
906	M5B1	6.4	6.4	3175.2	3	0.315	2.205	2.52	0.04	3	FALSE	FALSE
908	M5A3	6.2	6.2	7711.2	-2.4	13.23	5.355	18.585	0.09	-2.3	FALSE	FALSE
910	M5A2	6	6	4536	-2.7	29.295	3.15	32.445	0.13	-2.5	FALSE	FALSE
913	M5C1	6.4	6.4	3175.2	2	0.315	2.205	2.52	0.04	2	FALSE	FALSE
915	M5C2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
921	M5D3	6.3	6.3	4082.4	0.7	5.04	2.835	7.875	0.07	0.8	FALSE	FALSE
923	M5A4	6	6	3628.8	-0.7	8.19	2.52	10.71	0.08	-0.6	FALSE	FALSE
925	M5A6	5.8	5.8	3628.8	0.5	5.67	2.52	8.19	0.07	0.6	FALSE	FALSE
927	M5A7	6.5	6.5	3628.8	1.8	3.15	2.52	5.67	0.06	1.9	FALSE	FALSE
929	M5A8	6.3	6.3	4082.4	3.1	0.315	2.835	3.15	0.05	3.1	FALSE	FALSE
931	M5D4	6	6	3175.2	2.2	2.835	2.205	5.04	0.06	2.3	FALSE	FALSE
933	M5D5	6.3	6.3	3628.8	3.4	0.315	2.52	2.835	0.04	3.4	FALSE	FALSE
935	M5A9	5.8	5.8	453.6	4.5	0	0.315	0.315	0.02	4.5	FALSE	FALSE
937	M5D6	5.8	5.8	453.6	4.6	0	0.315	0.315	0.02	4.6	FALSE	FALSE
939	M4H2	5.9	5.9	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
940	M4H1	6.4	6.4	4082.4	2.5	0.315	2.835	3.15	0.04	2.5	FALSE	FALSE
944	M4A3	6.7	6.7	7257.6	0.7	17.325	5.04	22.365	0.12	0.8	FALSE	FALSE
946	M4B1	6.1	6.1	4536	2.5	0.315	3.15	3.465	0.05	2.5	FALSE	FALSE
948	M4B2	6.3	6.3	453.6	4.3	0	0.315	0.315	0.02	4.3	FALSE	FALSE
952	M4A4	6.7	6.7	7257.6	1.2	8.505	5.04	13.545	0.1	1.3	FALSE	FALSE
954	M4D1	6.5	6.5	907.2	3.5	0.63	0.63	1.26	0.03	3.5	FALSE	FALSE
956	M4E1	6.4	6.4	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
958	M4D2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
960	M4F1	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
961	M4A5	6.7	6.7	9525.6	1.8	0.63	6.615	7.245	0.07	1.8	FALSE	FALSE
964	M4G1	7.6	7.6	4536	3	3.6225	3.15	6.7725	0.06	3.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
966	M4G2	7.4	7.4	907.2	5.4	2.9925	0.63	3.6225	0.05	5.4	FALSE	FALSE
968	M4A6	7.2	7.2	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
970	M34F4	4.4	4.4	6171.9	1.8	0	4.286	4.286	1.63	3.5	FALSE	FALSE
971	M34F3	4.8	4.8	2646	1.2	4.286	1.8375	6.1235	1.65	2.8	FALSE	FALSE
979	M34H2	5.1	5.1	2646	0.9	0.525	1.8375	2.3625	0.17	1	FALSE	FALSE
983	M34I1	3.4	3.4	756	1.5	0	0.525	0.525	0.02	1.5	FALSE	FALSE
987	M34A7	4.3	4.3	13769	-0.5	245.68	9.5618	255.24	0.42	-0.1	FALSE	FALSE
989	M34J1	3.2	3.2	3780	0.1	3.4125	2.625	6.0375	0.06	0.2	FALSE	FALSE
991	M34K1	4.5	4.5	4158	1.1	0.2625	2.8875	3.15	0.05	1.1	FALSE	FALSE
993	M34K2	4.7	4.7	378	3	0	0.2625	0.2625	0.01	3	FALSE	FALSE
995	M34J2	5	5	378	2.5	0	0.2625	0.2625	0.01	2.5	FALSE	FALSE
997	M34A5	4.2	4.2	0	-2.1	365.33	0	365.33	0.43	-1.6	FALSE	FALSE
999	M34A4	4.1	4.1	0	-3	365.33	0	365.33	0.45	-2.5	FALSE	FALSE
1001	M34E2	7.1	7.1	2940	1.5	0	2.0417	2.0417	0.03	1.5	FALSE	FALSE
1003	M17M6	7.1	7.1	41040	2.5	11.4	28.5	39.9	0.14	2.6	FALSE	FALSE
1005	M17M5	6.8	6.8	16416	1.9	39.9	11.4	51.3	0.15	2	FALSE	FALSE
1007	M17M4	6.8	6.8	0	1	51.3	0	51.3	0.15	1.2	FALSE	FALSE
1009	M17M3	6.8	6.8	16416	0.6	51.3	11.4	62.7	0.17	0.8	FALSE	FALSE
1011	M17M2	6.9	6.9	16416	-0.3	62.7	11.4	74.1	0.19	-0.1	FALSE	FALSE
1013	M17M1	7	7	16416	-0.8	74.1	11.4	85.5	0.2	-0.6	FALSE	FALSE
1015	M17A3	9.6	9.6	2720.8	-6.4	694.03	1.8894	695.92	0.83	-5.6	FALSE	FALSE
1017	M17A6	8	8	0	-3.4	608.53	0	608.53	0.49	-2.9	FALSE	FALSE
1019	M17O3	8.4	8.4	32832	4.1	0	22.8	22.8	0.1	4.2	FALSE	FALSE
1020	M17O2	6.9	6.9	16416	2.9	22.8	11.4	34.2	0.13	3	FALSE	FALSE
1022	M17N1	6.7	6.7	49248	0.1	91.2	34.2	125.4	0.22	0.3	FALSE	FALSE
1024	M17N2	6.9	6.9	32832	3.7	11.4	22.8	34.2	0.13	3.8	FALSE	FALSE
1026	M17N3	6.8	6.8	0	4.7	11.4	0	11.4	0.07	4.7	FALSE	FALSE
1028	M17N4	7.6	7.6	16416	5.3	0	11.4	11.4	0.07	5.3	FALSE	FALSE
1030	M17A2	8	8	0	-6.6	821.32	0	821.32	0.84	-5.8	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1033	M17U1	6.9	6.9	16416	-2.3	0	11.4	11.4	0.06	-2.2	FALSE	FALSE
1034	M17T3	8.1	8.1	0	-2.8	48.45	0	48.45	0.14	-2.7	FALSE	FALSE
1036	M17T4	8.2	8.2	16416	1.1	25.65	11.4	37.05	0.12	1.2	FALSE	FALSE
1038	M17V1	7.1	7.1	16416	1.8	2.85	11.4	14.25	0.08	1.9	FALSE	FALSE
1040	M17V2	6.8	6.8	4104	2.8	0	2.85	2.85	0.04	2.8	FALSE	FALSE
1042	M17T8	8.5	8.5	0	2.8	0	0	0	0	2.8	FALSE	FALSE
1043	M17T7	8	8	16416	2.4	0	11.4	11.4	0.07	2.5	FALSE	FALSE
1045	M17T6	7.2	7.2	0	2.1	11.4	0	11.4	0.07	2.1	FALSE	FALSE
1047	M17T5	7.7	7.7	0	1.8	11.4	0	11.4	0.07	1.9	FALSE	FALSE
1050	M17U2	7.6	7.6	0	-1	0	0	0	0	-1	FALSE	FALSE
1052	M17T2	7	7	0	-3.3	48.45	0	48.45	0.15	-3.2	FALSE	FALSE
1054	M17T1	7.4	7.4	0	-3.5	48.45	0	48.45	0.13	-3.3	FALSE	FALSE
1060	M17Q0	7.2	7.2	31920	0.6	37.05	22.167	59.217	0.17	0.8	FALSE	FALSE
1062	M17R1	6.9	6.9	0	1.8	0	0	0	0	1.8	FALSE	FALSE
1064	M17R2	7.1	7.1	0	2.9	0	0	0	0	2.9	FALSE	FALSE
1066	M17R3	7.6	7.6	0	3.6	0	0	0	0	3.6	FALSE	FALSE
1075	M17H3	8.4	8.4	4104	4.5	0	2.85	2.85	0.04	4.5	FALSE	FALSE
1076	M17H2	8.6	8.6	19494	3	2.85	13.538	16.388	0.09	3.1	FALSE	FALSE
1078	M17H1	8.7	8.7	4104	2.6	16.388	2.85	19.237	0.18	2.7	FALSE	FALSE
1082	M17G1	9.6	9.6	32832	4.8	0	22.8	22.8	0.1	4.9	FALSE	FALSE
1084	M17G2	9.4	9.4	0	7	0	0	0	0	7	FALSE	FALSE
1092	M17P1	7	8.6	32832	2.9	5.7	22.8	28.5	0.11	3	FALSE	FALSE
1094	M17P2	7.4	7.4	0	4.1	5.7	0	5.7	0.05	4.2	FALSE	FALSE
1096	M17P3	8	9.5	8208	4.5	0	5.7	5.7	0.05	4.6	FALSE	FALSE
1141	M14I1	5.4	5.4	2052	-0.8	1.71	1.425	3.135	0.04	-0.8	FALSE	FALSE
1143	M14I2	5.3	5.3	2052	0.5	0.285	1.425	1.71	0.03	0.5	FALSE	FALSE
1145	M14I3	5.8	5.8	410.4	1.5	0	0.285	0.285	0.01	1.5	FALSE	FALSE
1149	M14J2	5.7	5.7	1641.6	-0.7	1.425	1.14	2.565	0.04	-0.7	FALSE	FALSE
1151	M14J3	5.7	5.7	1641.6	0.3	0.285	1.14	1.425	0.03	0.3	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1153	M14J4	5.9	5.9	410.4	1.4	0	0.285	0.285	0.01	1.4	FALSE	FALSE
1157	M14L1	5.5	5.5	5335.2	0.1	0.57	3.705	4.275	0.04	0.1	FALSE	FALSE
1159	M14L2	5.2	5.2	820.8	1.5	0	0.57	0.57	0.02	1.5	FALSE	FALSE
1161	M14K1	5.2	5.2	3693.6	0.6	0.57	2.565	3.135	0.04	0.7	FALSE	FALSE
1163	M14K2	5.6	5.6	820.8	1.6	0	0.57	0.57	0.02	1.6	FALSE	FALSE
1165	M14B1	6.5	6.5	22002	-1.7	76.633	15.279	91.913	0.2	-1.5	FALSE	FALSE
1167	M14B2	5.3	5.3	110352	-1.4	0	76.633	76.633	0.29	-1.1	FALSE	FALSE
1169	M14A6	5.1	5.1	0	-0.5	76.174	0	76.174	0.19	-0.3	FALSE	FALSE
1173	M14M1	5.3	5.3	4924.8	-0.4	13.965	3.42	17.385	0.24	-0.2	FALSE	FALSE
1175	M14N1	5.6	5.6	1641.6	0.9	0.57	1.14	1.71	0.03	0.9	FALSE	FALSE
1177	M14N2	5.5	5.5	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1179	M14O1	5.6	5.6	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1181	M14M2	6.6	6.6	4924.8	2.2	8.835	3.42	12.255	0.07	2.2	FALSE	FALSE
1183	M14P1	6.8	6.8	820.8	3.8	0	0.57	0.57	0.02	3.8	FALSE	FALSE
1185	M14M3	7.4	7.4	5745.6	3	4.275	3.99	8.265	0.07	3.1	FALSE	FALSE
1187	M14Q1	7.3	7.3	1231.2	4.3	0	0.855	0.855	0.02	4.3	FALSE	FALSE
1189	M14M4	8	8	4104	4.3	0.57	2.85	3.42	0.05	4.3	FALSE	FALSE
1191	M14R1	7.5	7.5	410.4	4.4	0	0.285	0.285	0.02	4.4	FALSE	FALSE
1193	M14M5	9.1	9.1	410.4	5.7	0	0.285	0.285	0.01	5.7	FALSE	FALSE
1195	M14A8	6.7	6.7	2462.4	-0.6	27.93	1.71	29.64	0.43	-0.2	FALSE	FALSE
1197	M14A9	8	8	2052	0.4	26.505	1.425	27.93	0.13	0.5	FALSE	FALSE
1199	M14Y1	7.8	7.8	410.4	4.8	0	0.285	0.285	0.01	4.8	FALSE	FALSE
1201	M14S1	5.3	5.3	10670.4	1	16.957	7.41	24.368	0.11	1.1	FALSE	FALSE
1203	M14X1	6.4	6.4	2052	2	0.7125	1.425	2.1375	0.04	2	FALSE	FALSE
1205	M14X2	7.3	7.3	1026	3.3	0	0.7125	0.7125	0.02	3.3	FALSE	FALSE
1207	M14S2	5.7	5.7	2872.8	2.1	12.825	1.995	14.82	0.1	2.1	FALSE	FALSE
1209	M14S3	6	6	5335.2	2.9	7.41	3.705	11.115	0.08	2.9	FALSE	FALSE
1211	M14V1	7.6	7.6	820.8	3.9	0	0.57	0.57	0.02	3.9	FALSE	FALSE
1213	M14S4	7.7	7.7	5335.2	3.7	3.135	3.705	6.84	0.07	3.8	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1215	M14W1	7.2	7.2	410.4	4.2	0	0.285	0.285	0.02	4.2	FALSE	FALSE
1217	M14S5	8	8	3693.6	4.7	0.285	2.565	2.85	0.04	4.7	FALSE	FALSE
1219	M14T1	6.3	6.3	1641.6	3.1	0.57	1.14	1.71	0.03	3.1	FALSE	FALSE
1221	M14U1	5.9	5.9	410.4	3.5	0	0.285	0.285	0.02	3.5	FALSE	FALSE
1223	M14T2	6.6	6.6	410.4	3.4	0	0.285	0.285	0.02	3.4	FALSE	FALSE
1225	M14S6	8.8	8.8	410.4	5.8	0	0.285	0.285	0.01	5.8	FALSE	FALSE
1227	M14A10	8.2	8.2	11491.2	1.2	18.24	7.98	26.22	0.12	1.3	FALSE	FALSE
1229	M14A11	8.3	8.3	6976.8	2	4.845	4.845	9.69	0.07	2.1	FALSE	FALSE
1231	M14BB1	8.4	8.4	2462.4	3.3	1.71	1.71	3.42	0.05	3.3	FALSE	FALSE
1233	M14BB2	8.4	8.4	2052	4.2	0.285	1.425	1.71	0.03	4.3	FALSE	FALSE
1235	M14AA1	8.6	8.6	4104	3.9	0.57	2.85	3.42	0.04	4	FALSE	FALSE
1237	M14AA2	8.4	8.4	820.8	4.8	0	0.57	0.57	0.02	4.8	FALSE	FALSE
1239	M14A12	8.9	8.9	1231.2	3.5	0.57	0.855	1.425	0.03	3.6	FALSE	FALSE
1241	M14A13	9	9	820.8	5	0	0.57	0.57	0.02	5	FALSE	FALSE
1243	M14BB3	8.4	8.4	410.4	5.2	0	0.285	0.285	0.02	5.2	FALSE	FALSE
1245	M14Z1	8.4	8.4	6566.4	4.2	0.57	4.56	5.13	0.05	4.2	FALSE	FALSE
1247	M14Z2	8.4	8.4	820.8	5.5	0	0.57	0.57	0.02	5.5	FALSE	FALSE
1269	M22A1	5	5	39480	-1.4	559.89	27.417	587.31	0.48	-0.9	FALSE	FALSE
1276	M22B1	6.2	6.2	146728.8	1.2	0.945	101.9	102.84	0.22	1.4	FALSE	FALSE
1278	M22B2	5.6	5.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
1280	M22E1	5.3	5.3	453.6	2.6	0	0.315	0.315	0.01	2.6	FALSE	FALSE
1282	M22A3	5.2	5.2	24494.4	0.9	326.49	17.01	343.5	0.44	1.4	FALSE	FALSE
1287	M26A1	5.4	5.4	5443.2	0	0.63	3.78	4.41	-0.04	0	FALSE	FALSE
1315	M17Q5	7.6	7.6	4104	5.3	0	2.85	2.85	0.04	5.3	FALSE	FALSE
1316	M17Q4	7.2	7.2	32832	4.1	2.85	22.8	25.65	0.12	4.2	FALSE	FALSE
1318	M17Q3	7.2	7.2	16416	3.3	25.65	11.4	37.05	0.13	3.4	FALSE	FALSE
1325	M40A1	8	8	0	-0.6	90.528	0	90.528	0.21	-0.4	FALSE	FALSE
1326	M40A2	7.9	7.9	0	0.3	88.078	0	88.078	0.1	0.4	FALSE	FALSE
1328	M40A3	8.4	8.4	0	1.5	88.078	0	88.078	0.1	1.6	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1330	M40A4	7.5	7.5	0	2.7	88.078	0	88.078	0.2	2.9	FALSE	FALSE
1347	M34U1	5.1	5.1	15807.75	2.6	0	10.978	10.978	0.08	2.7	FALSE	FALSE
1348	M34L1	4.7	4.7	3250.8	1.6	15.8	2.2575	18.058	0.1	1.7	FALSE	FALSE
1350	M34A8	4.6	4.6	5292	0	235.96	3.675	239.64	0.58	0.6	FALSE	FALSE
1354	M16A5	5.8	5.8	0	0.6	31.711	0	31.711	0.14	0.7	FALSE	FALSE
1355	M16A6	5.4	5.4	22680	1.1	15.961	15.75	31.711	0.12	1.2	FALSE	FALSE
1357	M16A7	6.2	6.2	6200.88	2.8	4.5675	4.3062	8.8737	0.06	2.8	FALSE	FALSE
1359	M16A8	6.1	6.1	0	3.5	4.5675	0	4.5675	0.05	3.6	FALSE	FALSE
1361	M16A9	7	7	5443.2	3.9	0.7875	3.78	4.5675	0.04	4	FALSE	FALSE
1363	M16A10	6.9	6.9	1134	5.1	0	0.7875	0.7875	0.02	5.1	FALSE	FALSE
1365	M16G1	4.2	4.2	7257.6	2.5	2.0475	5.04	7.0875	0.06	2.5	FALSE	FALSE
1367	M16G2	5.5	5.5	2948.4	3.4	0	2.0475	2.0475	0.04	3.5	FALSE	FALSE
1369	M37A4	5.5	5.5	1503.6	-0.4	43.655	1.0442	44.699	0.14	-0.3	FALSE	FALSE
1370	M37A3	5.4	5.4	4510.8	-1.6	44.699	3.1325	47.831	0.15	-1.5	FALSE	FALSE
1372	M37A2	5.3	5.3	9021.6	-2.8	49.92	6.265	56.185	0.16	-2.6	FALSE	FALSE
1374	M37B1	4.8	4.8	3007.2	-1.7	0	2.0883	2.0883	0.03	-1.7	FALSE	FALSE
1376	M37A1	5.7	5.7	0	-3.2	69.759	0	69.759	0.16	-3	FALSE	FALSE
1378	M37C1	6	6	9021.6	-2.6	7.3092	6.265	13.574	0.08	-2.6	FALSE	FALSE
1380	M37E1	5.3	5.3	3007.2	-1.6	0	2.0883	2.0883	0.03	-1.6	FALSE	FALSE
1382	M37C2	6.3	6.3	4510.8	-1.4	2.0883	3.1325	5.2208	0.05	-1.3	FALSE	FALSE
1384	M37C3	5.1	5.1	1503.6	-0.4	0	1.0442	1.0442	0.02	-0.4	FALSE	FALSE
1403	M17B5	9.7	9.7	16416	4.7	164.59	11.4	175.99	0.53	5.2	FALSE	FALSE
1405	M17I1	8.1	8.1	16416	4.9	0	11.4	11.4	0.28	5.2	FALSE	FALSE
1407	M17B6	7.7	7.7	122094	5.6	68.4	84.788	153.19	0.27	5.8	FALSE	FALSE
1409	M17D1	8.1	8.1	16416	6.2	0	11.4	11.4	0.07	6.3	FALSE	FALSE
1411	M17B7	8.1	8.1	16416	6.1	45.6	11.4	57	-0.26	5.9	FALSE	FALSE
1413	M17B9	7.6	7.6	16416	6.5	34.2	11.4	45.6	0.15	6.7	FALSE	FALSE
1415	M17E1	8.6	8.6	16416	7	0	11.4	11.4	0.07	7.1	FALSE	FALSE
1417	M17B10	10.2	10.2	16416	7	11.4	11.4	22.8	0.11	7.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1419	M17B11	10.3	10.3	16416	7.8	0	11.4	11.4	0.07	7.8	FALSE	FALSE
1421	M34E1	5.1	5.1	0	-0.9	2.0417	0	2.0417	0.03	-0.9	FALSE	FALSE
1424	M32A1	5.8	5.8	0	-1.2	59.743	0	59.743	0.17	-1	FALSE	FALSE
1426	M32C1	5.7	5.7	0	0	13.805	0	13.805	-0.31	-0.3	FALSE	FALSE
1430	M32A2	7.2	7.2	21413.28	0.8	31.068	14.87	45.938	0.15	0.9	FALSE	FALSE
1432	M32A3	5.6	5.6	12285	1.1	22.537	8.5313	31.068	0.12	1.3	FALSE	FALSE
1434	M32A4	5.3	5.3	23784.18	1.9	0	16.517	16.517	0.09	2	FALSE	FALSE
1436	M32D1	4.8	4.8	8668.8	1.4	0	6.02	6.02	0.06	1.4	FALSE	FALSE
1440	M31A4	5.5	5.5	22378.02	0.4	0	15.54	15.54	0.11	0.5	FALSE	FALSE
1441	M31A3	7.4	7.4	26877.48	-0.1	15.54	18.665	34.205	0.13	0.1	FALSE	FALSE
1443	M31A2	7.7	7.7	28061.88	-2.3	34.205	19.487	53.693	0.16	-2.1	FALSE	FALSE
1445	M31A1	6.2	6.2	56089.32	-4	86.481	38.951	125.43	0.24	-3.7	FALSE	FALSE
1446	M31B1	5.8	5.8	13608	-0.4	23.338	9.45	32.788	0.12	-0.3	FALSE	FALSE
1449	M31B2	6.3	6.3	8022	0.8	17.767	5.5708	23.338	0.1	0.9	FALSE	FALSE
1451	M31B4	4.3	4.3	11116.56	3.4	0	7.7198	7.7198	0.06	3.5	FALSE	FALSE
1455	M34A13	4.7	4.7	378	2.1	6.3	0.2625	6.5625	0.07	2.2	FALSE	FALSE
1456	M34A11	4.4	4.4	0	1.5	213.13	0	213.13	0.41	1.9	FALSE	FALSE
1458	M34A10	4.4	4.4	756	0.8	213.13	0.525	213.65	0.42	1.2	FALSE	FALSE
1461	M34A12	4.5	4.5	756	1.7	7.0875	0.525	7.6125	0.27	1.9	FALSE	FALSE
1497	M18A-B1	5.3	5.3	2721.6	0.9	0	1.89	1.89	0.03	0.9	FALSE	FALSE
1499	M18A-A4	5.5	5.5	2268	0.2	67.499	1.575	69.074	0.55	0.7	FALSE	FALSE
1501	M18A-A5	5.3	5.3	8164.8	0.7	61.829	5.67	67.499	0.19	0.9	FALSE	FALSE
1503	M18A-C1	8.2	8.2	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	FALSE
1505	M18A-A6	5.4	5.4	1360.8	1.2	60.254	0.945	61.199	0.17	1.4	FALSE	FALSE
1507	M18A-D1	9.2	9.2	6350.4	2.5	0	4.41	4.41	0.05	2.5	FALSE	FALSE
1509	M18A-A7	7.7	7.7	1360.8	1.7	54.899	0.945	55.844	0.16	1.9	FALSE	FALSE
1511	M18A-A8	8.3	8.3	2268	2.1	53.324	1.575	54.899	0.16	2.3	FALSE	FALSE
1513	M46A1	4.9	4.9	(N/A)	0.8	(N/A)	(N/A)	(N/A)	(N/A)	(N/A)	FALSE	FALSE
1519	M34C1	6.5	6.5	11550	-1	26.396	8.0208	34.417	0.11	-0.9	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1521	M34C2	7.1	7.1	0	-0.3	26.396	0	26.396	0.11	-0.2	FALSE	FALSE
1523	M34C3	7.2	7.2	5460	1.7	22.604	3.7917	26.396	0.11	1.8	FALSE	FALSE
1525	M34C4	7.6	7.6	2310	2.9	21	1.6042	22.604	0.1	3	FALSE	FALSE
1527	M34C5	8.5	8.5	30240	4.1	0	21	21	0.1	4.2	FALSE	FALSE
1529	M34D2	5.5	5.5	12640.25	3.6	0	8.778	8.778	0.06	3.6	FALSE	FALSE
1530	M34D1	5.7	5.7	0	2.9	8.778	0	8.778	0.06	3	FALSE	FALSE
1532	M34B1	5.8	5.8	8050	1.7	19.205	5.5903	24.795	0.11	1.8	FALSE	FALSE
1534	M34B2	6.7	6.7	0	2.3	10.427	0	10.427	0.07	2.3	FALSE	FALSE
1536	M34B3	5.7	5.7	2520	2.9	8.6771	1.75	10.427	0.07	3	FALSE	FALSE
1538	M34B4	5.3	5.3	10220	3.5	1.5799	7.0972	8.6771	0.06	3.6	FALSE	FALSE
1540	M34B5	6	6	2275	4.3	0	1.5799	1.5799	0.03	4.3	FALSE	FALSE
1556	M17F4	10	10	84606	5.2	0	58.754	58.754	0.19	5.4	FALSE	FALSE
1568	M14H5	5.7	5.7	8208	5.2	0	5.7	5.7	0.06	5.3	FALSE	FALSE
1579	M16B1	6.4	6.4	4116	-2	32.054	2.8583	34.912	0.11	-1.9	FALSE	FALSE
1581	M16B2	6	6	8232	-1.7	17.179	5.7167	22.896	0.12	-1.5	FALSE	FALSE
1583	M16A2	6	6	0	-2.6	95.475	0	95.475	0.19	-2.4	FALSE	FALSE
1585	M16A3	5.4	5.4	11655	-1.4	87.382	8.0938	95.475	0.21	-1.2	FALSE	FALSE
1587	M16D1	6.1	6.1	24347.4	-0.1	7.5542	16.908	24.462	0.12	0	FALSE	FALSE
1589	M16D2	4.8	4.8	10878	2	0	7.5542	7.5542	0.06	2.1	FALSE	FALSE
1591	M16A4	4.1	4.1	44940	-0.3	31.711	31.208	62.92	0.15	-0.1	FALSE	FALSE
1599	M38D2	8	8	8750.7	0.7	0	6.0769	6.0769	0.06	0.7	FALSE	FALSE
1600	M38D1	5.7	5.7	8750.7	0.1	6.0769	6.0769	12.154	0.07	0.2	FALSE	FALSE
1602	M38A6	6	6	8750.7	-1.1	13.869	6.0769	19.946	0.1	-1	FALSE	FALSE
1604	M17O1	6.9	6.9	32832	1.7	34.2	22.8	57	0.16	1.8	FALSE	FALSE
1609	M3D2	6.3	6.3	3283.2	0.6	8.835	2.28	11.115	0.09	0.7	FALSE	FALSE
1611	M3D1	6.4	6.4	2872.8	-0.2	11.115	1.995	13.11	0.1	-0.1	FALSE	FALSE
1614	M3F1	6.6	6.6	4514.4	-0.4	136.04	3.135	139.17	0.29	-0.1	FALSE	FALSE
1616	M3F2	6	6	4514.4	1.5	132.9	3.135	136.04	0.29	1.8	FALSE	FALSE
1680	M19A2	5.2	5.2	0	1.5	0	0	0	0	1.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1681	M19A1	5.4	5.4	0	1	0	0	0	0	1	FALSE	FALSE
1695	M38A5	4.9	4.9	18901.68	-2.1	19.946	13.126	33.072	0.12	-2	FALSE	FALSE
1697	M38A4	5	5	18901.68	-3.8	33.072	13.126	46.198	0.15	-3.7	FALSE	FALSE
1701	M38A3	5.1	5.1	18901.68	-5.5	46.198	13.126	59.324	0.18	-5.4	FALSE	FALSE
1703	M38A2	6.6	6.6	38973.06	-7.2	100.33	27.065	127.39	0.25	-7	FALSE	FALSE
1705	M38C1	7	7	38973.06	-0.7	13.938	27.065	41.003	0.14	-0.6	FALSE	FALSE
1709	M38A1	6.1	6.1	20090.99	-8.9	168.25	13.952	182.2	0.3	-8.6	FALSE	FALSE
1711	M38B1	6.5	6.5	19609.59	-1.6	27.236	13.618	40.853	0.14	-1.4	FALSE	FALSE
1713	M38B2	7.1	7.1	19609.59	0.1	13.618	13.618	27.236	0.11	0.2	FALSE	FALSE
1717	M16A1	5.9	5.9	15456	-2.8	138.26	10.733	149	0.27	-2.5	FALSE	FALSE
1726	M16H1	6.4	6.4	4998	-1.9	2.8292	3.4708	6.3	0.06	-1.8	FALSE	FALSE
1727	M16F1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1729	M16B4	7.2	7.2	8988	5	0	6.2417	6.2417	0.05	5	FALSE	FALSE
1731	M16B3	7.2	7.2	11634	-1.5	6.2417	8.0792	14.321	0.08	-1.4	FALSE	FALSE
1732	M16E1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1735	M16H2	6.7	6.7	4074	4.2	0	2.8292	2.8292	0.03	4.2	FALSE	FALSE
1751	M31B3	5.4	5.4	14468.16	1.7	7.7198	10.047	17.767	0.09	1.7	FALSE	FALSE
1755	M30A9	4.1	4.1	0	3.8	0.63	0	0.63	0.02	3.8	FALSE	FALSE
1756	M30A8	4.4	4.4	453.6	3.1	0.63	0.315	0.945	0.03	3.1	FALSE	FALSE
1757	M30A6	3.3	3.3	0	2.7	1.26	0	1.26	0.03	2.7	FALSE	FALSE
1758	M30K1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1759	M30A5	3.8	3.8	2721.6	2.2	2.52	1.89	4.41	0.05	2.2	FALSE	FALSE
1760	M30J1	4	4	907.2	3.5	0	0.63	0.63	0.02	3.5	FALSE	FALSE
1761	M30A4	3.6	3.6	2721.6	1.4	5.67	1.89	7.56	0.07	1.5	FALSE	FALSE
1762	M30I1	3.4	3.4	907.2	2	0	0.63	0.63	0.02	2	FALSE	FALSE
1763	M30H1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1764	M30A3	3.7	3.7	1814.4	0.6	8.505	1.26	9.765	0.07	0.6	FALSE	FALSE
1767	M30A1	3.5	3.5	1814.4	-0.9	28.35	1.26	29.61	0.12	-0.8	FALSE	FALSE
1836	M29A1	4.5	4.5	1814.4	-1.6	22.995	1.26	24.255	0.09	-1.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3102	M34G1	5.2	5.2	68390	3.8	0	47.493	47.493	0.16	4	FALSE	FALSE
3105	M34O1	5.3	5.3	1814.4	2.9	0.63	1.26	1.89	0.03	2.9	FALSE	FALSE
3107	M34O2	5	5	907.2	3.3	0	0.63	0.63	0.02	3.3	FALSE	FALSE
3112	M29A2	4.5	4.5	8164.8	-0.7	8.505	5.67	14.175	0.08	-0.6	FALSE	FALSE
3118	M29E1	5.4	5.4	907.2	4	0	0.63	0.63	0.02	4	FALSE	FALSE
3120	M29B1	4.2	4.2	3628.8	-1	5.67	2.52	8.19	0.07	-0.9	FALSE	FALSE
3122	M29F1	4.6	4.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
3125	M29B2	4.5	4.5	4989.6	0	1.575	3.465	5.04	0.05	0.1	FALSE	FALSE
3127	M29B4	4.6	4.6	453.6	2.5	0	0.315	0.315	0.01	2.5	FALSE	FALSE
3129	M29G1	4.5	4.5	0	2.5	0	0	0	0	2.5	FALSE	FALSE
3131	M29C1	5	5	0	2	0.63	0	0.63	0.02	2	FALSE	FALSE
3133	M29C2	5.1	5.1	907.2	3	0	0.63	0.63	0.02	3	FALSE	FALSE
3135	M34L2	4.3	4.3	1360.8	2.3	3.8775	0.945	4.8225	0.05	2.4	FALSE	FALSE
3137	M34M1	4.4	4.4	378	2.8	0.525	0.2625	0.7875	0.02	2.9	FALSE	FALSE
3139	M34M2	4.8	4.8	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	FALSE
3141	M34N1	4.5	4.5	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3143	M34L3	4.2	4.2	3693.6	2.9	0.525	2.565	3.09	0.04	2.9	FALSE	FALSE
3145	M34L4	4.4	4.4	756	3.9	0	0.525	0.525	0.02	3.9	FALSE	FALSE
3147	M34A16	5	5	378	4.9	0	0.2625	0.2625	0.01	4.9	FALSE	FALSE
3148	M34A14	4.3	4.3	4158	2.3	2.8875	2.8875	5.775	0.06	2.3	FALSE	FALSE
3152	M34T1	4	4	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3155	M30A10	4.6	4.6	453.6	4	0.315	0.315	0.63	0.02	4	FALSE	FALSE
3165	M30A11	4.6	4.6	453.6	4.4	0	0.315	0.315	0.02	4.4	FALSE	FALSE
3168	M30C2	4	4	453.6	1.3	0	0.315	0.315	0.02	1.3	FALSE	FALSE
3170	M30C1	4	4	2268	-0.5	0.315	1.575	1.89	0.03	-0.5	FALSE	FALSE
3174	M30B1	3.2	3.2	1360.8	-0.5	12.6	0.945	13.545	0.08	-0.4	FALSE	FALSE
3176	M30B4	4	4	0	1.7	4.095	0	4.095	0.05	1.8	FALSE	FALSE
3178	M30B5	4.8	4.8	453.6	2.2	3.78	0.315	4.095	0.05	2.3	FALSE	FALSE
3180	M30B6	4.9	4.9	4536	2.7	0.63	3.15	3.78	0.05	2.7	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3182	M30B7	4.1	4.1	453.6	3.6	0	0.315	0.315	0.01	3.6	FALSE	FALSE
3184	M30M1	4.6	4.6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
3186	M30B2	2.8	2.8	3628.8	0	10.08	2.52	12.6	0.08	0.1	FALSE	FALSE
3189	M30E1	3	3	2721.6	1.5	0	1.89	1.89	0.03	1.5	FALSE	FALSE
3191	M30B3	2.8	2.8	3175.2	1	5.985	2.205	8.19	0.07	1.1	FALSE	FALSE
3194	M30F1	2.6	2.6	2721.6	1.8	0	1.89	1.89	0.04	1.8	FALSE	FALSE
3243	M18C9	5.3	5.3	453.6	3.4	75.334	0.315	75.649	0.19	3.6	FALSE	FALSE
3246	M18C2	5.5	5.5	10432.8	3	76.594	7.245	83.839	0.19	3.2	FALSE	FALSE
3276	M18C1	5.4	5.4	11793.6	2.5	83.839	8.19	92.029	0.21	2.7	FALSE	FALSE
3304	M24D1	7.9	7.9	3628.8	-0.9	1.26	2.52	3.78	0.06	-0.8	FALSE	FALSE
3319	M24A2	5.4	5.4	1814.4	-1	0.63	1.26	1.89	0.11	-0.9	FALSE	FALSE
3328	M25A1	4.6	4.6	5443.2	-1	44.472	3.78	48.252	0.13	-0.8	FALSE	FALSE
3330	M25C1	5.6	5.6	5896.8	0.6	1.26	4.095	5.355	0.05	0.7	FALSE	FALSE
3346	M25A4	4.6	4.6	4536	1	13.977	3.15	17.127	0.09	1.1	FALSE	FALSE
3348	M25A2	5.6	5.6	8618.4	-0.4	23.112	5.985	29.097	0.13	-0.3	FALSE	FALSE
3357	M25B1	5.3	5.3	5896.8	0.3	10.02	4.095	14.115	0.08	0.3	FALSE	FALSE
3364	M7C1	8	8	7344	-0.9	104.49	5.1	109.59	0.23	-0.7	FALSE	FALSE
3377	M7C3	8.3	8.3	9936	0.7	84.461	6.9	91.361	0.21	0.9	FALSE	FALSE
3383	M25B2	5.4	5.4	9979.2	0.9	1.83	6.93	8.76	0.08	1	FALSE	FALSE
3389	M25A5	4	4	453.6	1.5	13.347	0.315	13.662	0.08	1.6	FALSE	FALSE
3391	M25A6	4.6	4.6	18765.6	1.9	0.315	13.032	13.347	0.08	2	FALSE	FALSE
3397	M25K1	4.2	4.2	453.6	2.4	0	0.315	0.315	0.01	2.4	FALSE	FALSE
3406	M18E3	7	7	907.2	1.3	0	0.63	0.63	0.02	1.3	FALSE	FALSE
3422	M1C2	6.7	6.7	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
3423	M1C1	6.4	6.4	5184	2	0.3	3.6	3.9	0.04	2	FALSE	FALSE
3509	M35A1	6	6	0	-1.3	452.83	0	452.83	0.5	-0.8	FALSE	FALSE
3511	M35A2	6.7	6.7	9904.23	-0.1	83.012	6.8779	89.89	0.21	0.1	FALSE	FALSE
3513	M35A3	6.7	6.7	24740.52	1.5	65.831	17.181	83.012	0.2	1.7	FALSE	FALSE
3515	M35D1	6	6	49581.63	2	0	34.432	34.432	0.13	2.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3642	M18A-A1	5.1	5.1	0	-1	76.004	0	76.004	0.17	-0.8	FALSE	FALSE
3682	M22A4	5.5	5.5	0	1.6	326.49	0	326.49	0.54	2.1	FALSE	FALSE
3901	M13A1	5.5	5.5	7194.6	3.2	3.3337	4.9963	8.33	0.06	3.3	FALSE	FALSE
3947	M10A1	9.3	9.3	2898	5.5	0.46667	2.0125	2.4792	0.04	5.5	FALSE	FALSE
3949	M29A3	4.6	4.6	7711.2	0.2	2.52	5.355	7.875	0.06	0.2	FALSE	FALSE
3982	M38D3	6.5	6.5	0	1.1	0	0	0	0	1.1	FALSE	FALSE
3989	M35A4	6.8	6.8	17653.86	2.7	19.14	12.26	31.4	0.12	2.8	FALSE	FALSE
4007	M9A1	6.9	6.9	71442	-0.3	66.938	49.613	116.55	0.24	-0.1	FALSE	FALSE
4011	M9B1	5.8	5.8	34020	0.5	23.625	23.625	47.25	0.15	0.6	FALSE	FALSE
4017	M5D1	6	6	0	-1	10.71	0	10.71	0.07	-1	FALSE	FALSE
4019	M5D2	6.2	6.2	4082.4	-0.8	7.875	2.835	10.71	0.08	-0.8	FALSE	FALSE
4022	M5A1	6.4	6.4	3175.2	-2.9	34.965	2.205	37.17	0.14	-2.8	FALSE	FALSE
4024	M4A2	7.5	7.5	0	0.3	22.365	0	22.365	0.11	0.4	FALSE	FALSE
4027	M3B1	5.7	5.7	1641.6	1.9	2.565	1.14	3.705	0.05	1.9	FALSE	FALSE
4029	M3B2	5.8	5.8	1231.2	2.8	1.425	0.855	2.28	0.04	2.9	FALSE	FALSE
4031	M3B3	5.5	5.5	410.4	3.3	1.14	0.285	1.425	0.03	3.3	FALSE	FALSE
4033	M3B4	5.4	5.4	1231.2	3.6	0.285	0.855	1.14	0.03	3.6	FALSE	FALSE
4041	M2H1	5.5	5.5	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	FALSE
4049	M2R3	5.9	5.9	2592	3.7	0.6	1.8	2.4	0.04	3.8	FALSE	FALSE
4056	M2T1	5.9	5.9	3024	2.3	0.6	2.1	2.7	0.04	2.3	FALSE	FALSE
4062	M2P1	6	6	4320	0	12.3	3	15.3	0.09	0.1	FALSE	FALSE
4065	M2P2	6.1	6.1	5184	0.5	0.6	3.6	4.2	0.05	0.6	FALSE	FALSE
4071	M2J2	6.4	6.4	432	1	0.6	0.3	0.9	0.02	1	FALSE	FALSE
4079	M1A3	6.4	6.4	2160	-0.1	198	1.5	199.5	0.34	0.3	FALSE	FALSE
4082	M1O1	5.5	5.5	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4090	M1Q1	5.4	5.4	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4097	M1HH1	5.6	5.6	2592	3.5	0.6	1.8	2.4	0.04	3.5	FALSE	FALSE
4103	M1BB1	6.3	6.3	0	2.4	3.6	0	3.6	0.04	2.4	FALSE	FALSE
4106	M1KK1	6.8	6.8	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4111	M1BB3	5.9	5.9	432	3.9	0.3	0.3	0.6	0.02	3.9	FALSE	FALSE
4115	M1CC1	6.3	6.3	432	3.5	0.6	0.3	0.9	0.02	3.5	FALSE	FALSE
4121	M1EE1	6.2	6.2	432	2.9	0.6	0.3	0.9	0.02	2.9	FALSE	FALSE
4127	M1A8	6.4	6.4	1296	1.9	186.9	0.89999	187.8	0.29	2.2	FALSE	FALSE
4148	M1U2	5.8	5.8	432	3.6	0.3	0.3	0.6	0.02	3.6	FALSE	FALSE
4152	M1V1	6.4	6.4	864	3	0.6	0.6	1.2	0.03	3	FALSE	FALSE
4158	M1S1	6.2	6.2	0	1.8	3	0	3	0.04	1.8	FALSE	FALSE
4161	M1S2	5.7	5.7	864	2.5	0.6	0.6	1.2	0.03	2.5	FALSE	FALSE
4168	M1M1	5.3	5.3	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4174	M1K1	5.1	5.1	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4180	M1D1	7	7	3024	-0.2	19.5	2.1	21.6	0.11	-0.1	FALSE	FALSE
4183	M1D3	6.4	6.4	432	3	0.3	0.3	0.6	0.02	3	FALSE	FALSE
4196	M34A15	4	4	3402	3.3	0.2625	2.3625	2.625	0.04	3.3	FALSE	FALSE
4199	M29A4	4.7	4.7	2268	1.1	0.315	1.575	1.89	0.03	1.1	FALSE	FALSE
4203	M29B3	4.6	4.6	1814.4	2	0.315	1.26	1.575	0.03	2	FALSE	FALSE
4206	M30A7	3.7	3.7	0	2.8	1.26	0	1.26	0.03	2.8	FALSE	FALSE
4217	M25A3	4.2	4.2	0	0.2	17.127	0	17.127	0.09	0.3	FALSE	FALSE
4239	M7C2	8.6	8.6	14580	-0.1	92.861	10.125	102.99	0.24	0.1	FALSE	FALSE
4280	M17A4	9.5	9.5	0	-6.3	608.53	0	608.53	0.79	-5.6	FALSE	FALSE
4283	M17A5	8.4	8.4	0	-5.7	608.53	0	608.53	0.69	-5	FALSE	FALSE
4314	M18D1	5.2	5.2	1360.8	3.2	0	0.945	0.945	0.03	3.2	FALSE	FALSE
4384	M32B1	6.3	6.3	13356	2	8.699	9.275	17.974	0.08	2.1	FALSE	FALSE
4416	M30A2	3.6	3.6	1814.4	-0.2	11.655	1.26	12.915	0.08	-0.1	FALSE	FALSE
4452	M38A7	6.3	6.3	0	-0.5	1.715	0	1.715	0.03	-0.5	FALSE	FALSE
4476	M4A1	7.5	7.5	17628	0.1	32.288	12.242	44.529	0.16	0.3	FALSE	FALSE

EXHIBIT F.3
FORCEMAIN DATA TABLE REPORT

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3880	O1L42FB2	PMP-42a	O1L42J1		25	6.4	2	0.013	111.61	111.61	11.4	10	114%	6.74
3494	O2L19FB2	PMP-19B	O1L34J2	Steel	342	8.2	8	0.013	1747.5	1747.5	11.15	10	112%	28.55
3495	O2L19F2	O1L34J2	O2L19J1	Steel	49	6.8	8	0.013	1747.5	1747.5	11.15	10	112%	4.09
3508	O2L19F1	O2L19J1	O2L34J2	Ductile Iron		20.7	8	0.012	1747.5	1747.5	11.15	10	112%	1.06
3489	O2L34F1	O1L34J1	O-2	Ductile Iron		17.4	12	0.012	3723.9	3723.9	10.56	10	106%	0.5
3507	O2L34F2	O2L34J2	O1L34J1	Ductile Iron		23.9	12	0.012	3552.1	3552.1	10.08	10	101%	0.63
1744	O2L31FA2	PMP-31A	O2L31J2	Steel	77	8	3	0.013	201.26	201.26	9.13	10	91%	26.91
3919	O2L45FA2	PMP-45a	O2L45J2	PVC	25	7.6	2	0.01	86.238	86.238	8.81	10	88%	4.18
3921	O2L45F2	O2L45J1	O2L45J2	PVC		39.6	2	0.01	-86.238	-86.238	8.81	10	88%	6.62
3720	O2L18A-F1	O2L18AJ1	M18C9	PVC		71.5	2	0.01	75.334	75.334	7.69	10	77%	9.31
3650	O2L36F2	O2L36J2	O2L36J1	Ductile Iron		585.8	8	0.013	1194.8	1194.8	7.63	10	76%	14.88
3652	O2L36F1	M34A1	O2L36J1	Ductile Iron		48	8	0.012	-1194.8	-1194.8	7.63	10	76%	1.22
527	O2L34FA2	PMP-34A	O2L34J6	Ductile Iron	154	11.3	8	0.012	1150.9	1150.9	7.35	10	74%	3.65
2455	O2L34F5	O2L34J5	O2L34J4	Ductile Iron		2007	8	0.012	1150.9	1150.9	7.35	10	74%	47.56
3624	O2L34F6	O2L34J6	O2L34J5	Ductile Iron		46.9	8	0.012	1150.9	1150.9	7.35	10	74%	1.11
1296	O2L26F1	O2L26J1	M22A4	PVC		142.1	3	0.01	159.28	159.28	7.23	10	72%	10.27
1792	O2L26FB2	PMP-26B	O2L26J1	Steel	79	10.1	3	0.013	159.28	159.28	7.23	10	72%	9.28
446	O2L6FA2	PMP-6A	O2L6J1		74	6.9	3	0.013	153.95	153.95	6.99	10	70%	5.02
3077	O2L16FA2	PMP-16A	O2L16J2	Ductile Iron	77	7.6	4	0.012	269.04	269.04	6.87	10	69%	10.94
3739	O2L16F2	O2L16J2	O2L16J1	PVC		363.9	4	0.01	269.04	269.04	6.87	10	69%	17.1
3811	O2L32F1	O2L32J1	M34A3	PVC		681.8	4	0.01	268.71	268.71	6.86	10	69%	31.97
474	O1L14FA1	PMP-14A	O1L14J3	Steel	134	7.5	6	0.013	547.15	547.15	6.21	10	62%	5.29
3606	O1L14FA2	W-14	PMP-14A	Ductile Iron	44	7.8	6	0.012	547.15	547.15	6.21	10	62%	1.07
4399	O2L47F2	O2L47J2	O2L47J1	PVC		13.6	2	0.01	56.842	56.842	5.8	10	58%	1.05
4410	O2L47FB1	PMP-47B	O2L47J2	PVC	40	7.3	2	0.01	56.842	56.842	5.8	10	58%	3.09
3942	O2L33F2	O2L33J2	O2L33J1	PVC		32.6	2	0.01	56.531	56.531	5.77	10	58%	2.49
3944	O2L33FA2	PMP-33A	O2L33J2	Steel	70	5.9	2	0.013	56.531	56.531	5.77	10	58%	8.7
3821	O2L7FA2	PMP-7A	O2L7J2	Ductile Iron	104	7.6	4	0.012	213.42	213.42	5.45	10	55%	3.18
3825	O2L7F2	O2L7J2	O2L7J1	PVC		31.1	4	0.01	213.42	213.42	5.45	10	55%	0.95

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3927	O2L46FA2	PMP-46a	O2L46J1	PVC	25	6.3	2	0.01	53.324	53.324	5.45	10	55%	1.72
3932	O2L46F1	O2L46J1	M18A-A8	PVC		213.3	2	0.01	53.324	53.324	5.45	10	55%	14.64
3587	O2L44F2	O1L44J2	O1L44J1	PVC		124.3	2	0.01	52.785	52.785	5.39	10	54%	8.37
3695	O2L44FA2	PMP-44a	O1L44J2	PVC	25	7.1	2	0.01	52.785	52.785	5.39	10	54%	1.68
217	O2L11F1	O2L11J1	O2L10J2	PVC		477.6	6	0.01	455.24	455.24	5.17	10	52%	8.25
477	O2L10F2	O2L10J2	O2L10J1	PVC		613.4	6	0.01	455.24	455.24	5.17	10	52%	10.59
3964	O2L10F1	O2L10J1	O2L36J3	Ductile Iron		287.1	6	0.012	455.24	455.24	5.17	10	52%	4.96
3664	O2L31F2	O2L31J2	O2L31J1	PVC		1088.2	4	0.01	201.26	201.26	5.14	10	51%	29.87
3506	O2L34F3	O2L34J3	O2L34J2	Ductile Iron		21.1	12	0.012	1804.6	1804.6	5.12	10	51%	0.16
3089	O2L29FA2	PMP-29A	O2L29J2	Steel	78	11.7	3	0.013	104.88	104.88	4.76	10	48%	7.74
3095	O2L29F2	O2L29J2	O2L29J1	PVC		12.7	3	0.01	104.88	104.88	4.76	10	48%	0.42
1691	O2L22A2	PMP-22A	O2L22J2	Steel	113	7.5	4	0.013	183.34	183.34	4.68	10	47%	4.24
3716	O2L22F1	O2L22J2	O2L22J1	PVC		973.6	4	0.013	183.34	183.34	4.68	10	47%	22.48
216	O2L12F1	O2L12J1	O2L11J1	PVC		333.4	6	0.01	409.22	409.22	4.64	10	46%	4.73
4402	O2L47F1	O2L47J1	M34A11	PVC		559.7	3	0.01	100.64	100.64	4.57	10	46%	17.28
3725	O2L18F4	O2L18J3	O2L18J2	Ductile Iron		170.7	3	0.012	97.859	97.859	4.44	10	44%	5.01
163	O2L18F1	O2L18J1	O2L36J2	Ductile Iron		130.4	8	0.012	689.45	689.45	4.4	10	44%	1.2
3730	O2L18F3	O2L18J2	O2L18J1	Cast iron		1013.7	8	0.012	689.45	689.45	4.4	10	44%	13.04
3527	O2L35FA2	PMP-35A	O2L35J2	Steel	90	6.9	4	0.013	171.8	171.8	4.39	10	44%	3
3529	O2L35F2	O2L35J2	O2L35J1	PVC		9.4	4	0.01	171.8	171.8	4.39	10	44%	0.19
3536	O2L35F1	O2L35J1	O1L34J1	PVC		2583.6	4	0.01	171.8	171.8	4.39	10	44%	52.9
3975	O1L43FA1	PMP-43a	O1L43J1	PVC	25	7.5	2	0.01	42.611	42.611	4.35	10	44%	1.13
3978	O1L43F1	O1L43J1	M37A4	PVC		533.5	2	0.01	42.611	42.611	4.35	10	44%	24.17
4470	O2L48F1	O2L48J1	M36I1	PVC		570.6	2	0.01	41.077	41.077	4.19	10	42%	24.15
1798	O1LS14F1	O1L14J1	O-1	PVC		10.5	10	0.01	1019.9	1019.9	4.17	10	42%	0.07
423	O2L2F1	O2L2J1	M3J1	Asbestos Cement		569.4	4	0.011	161.96	161.96	4.13	10	41%	12.47
3865	O2L2FA2	PMP-2A	O2L2J1	Ductile Iron	112	10.6	4	0.012	161.96	161.96	4.13	10	41%	2.06
390	O2L23FB2	PMP-23B	O2L23F1	Steel	84	8.2	3	0.013	89.097	89.097	4.04	10	40%	3.37
3979	O2L22F1	O2L22J1	O2L34J3	Ductile Iron		348.7	8	0.012	619.27	619.27	3.95	10	40%	2.62

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3830	O2L6F1	O2L6J1	M1A9	PVC		631.6	4	0.01	153.95	153.95	3.93	10	39%	10.55
464	O1L17FB2	W-17	PMP-17B	Steel	21.1	9.5	6	0.013	333.17	333.17	3.78	10	38%	0.33
3728	O2L1F1	O2L1J1	O2L18J2	Cast iron		255.1	8	0.012	591.6	591.6	3.78	10	38%	2.47
427	O2L25FA2	PMP-25A	O2L25J1	Ductile Iron	84	10.6	3	0.012	82.961	82.961	3.77	10	38%	1.81
3827	O2L25F1	O2L25J1	M7C3	PVC		626.2	3	0.01	82.961	82.961	3.77	10	38%	13.52
511	O2F32FB1	W-32	PMP-32B	Ductile Iron	16.1	9.7	4	0.012	142.69	142.69	3.64	10	36%	0.23
3913	O2L32FB2	PMP-32B	O2L32J2	Ductile Iron	101	6.8	4	0.012	142.69	142.69	3.64	10	36%	1.47
3998	O2L32F2	O2L32J2	O2L32J1	PVC		521.1	4	0.01	142.69	142.69	3.64	10	36%	7.56
2443	O1L14F2	O1L14J2	O1L14J1	PVC		1384.7	10	0.01	880.32	880.32	3.6	10	36%	6.74
3482	O1L40FA1	PMP-40a	O1L40J1	Ductile Iron	70	13.3	4	0.012	139.62	139.62	3.56	10	36%	0.98
3955	O1L40F1	O1L14J1	O1L40J1	Cast iron		1155.4	4	0.012	-139.62	-139.62	3.56	10	36%	22.6
409	O2L1FA2	PMP-1A	O2L1J2	Ductile Iron	10	6.4	4	0.012	137.79	137.79	3.52	10	35%	20.12
3873	O2L1F2	O2L1J2	O2L1J1	PVC		347.6	4	0.012	137.79	137.79	3.52	10	35%	4.73
3586	O2L38F1	O2L38J1	M35A1	PVC		1300	6	0.01	309.12	309.12	3.51	10	35%	10.96
3882	O2L38FA2	PMP-38a	O2L38J1	Steel	100	6.2	6	0.013	309.12	309.12	3.51	10	35%	1.37
3753	O1L14F3	O1L14J3	O1L14J2	Ductile Iron		14.8	8	0.012	547.15	547.15	3.49	10	35%	0.09
1669	O2L45F1	O2L45J1	O2L12J1	PVC		161.3	6	0.01	302.14	302.14	3.43	10	34%	1.3
434	O2L18A-FB2	PMP-18A-b	O2L18AJ1	Steel	66	8.2	3	0.013	75.334	75.334	3.42	10	34%	1.94
3835	O2L5F2	O2L5J2	O2L5J1	Asbestos Cement		693.6	4	0.011	132.9	132.9	3.39	10	34%	10.76
3841	O2L5F1	O2L5J1	M3F3	Asbestos Cement		90.1	4	0.011	132.9	132.9	3.39	10	34%	1.37
3747	O2L15F2	O2L15J2	O2L15J1	PVC		27.2	3	0.01	74.29	74.29	3.37	10	34%	0.48
3749	O2L15FA2	PMP-15A	O2L15J2	Ductile Iron	78	6	3	0.012	74.29	74.29	3.37	10	34%	1.37
1813	O2L34F4	O2L34J4	O2L34J3	PVC		2328.2	12	0.01	1185.3	1185.3	3.36	10	34%	8.08
3968	O2L36F3	O2L36J2	O2L36J3	Ductile Iron		1431.2	8	0.012	-505.32	-505.32	3.23	10	32%	7.39
3809	O2L9FA1	W-9	PMP-9A	Cast iron	27	8	4	0.012	126.02	126.02	3.22	10	32%	0.44
3810	O2L9FA2	PMP-9A	O2L9J1	Cast iron	76	6.1	4	0.012	126.02	126.02	3.22	10	32%	1.23
3815	O2L9F1	O2L9J1	O2L32J1	Ductile Iron		555	4	0.012	126.02	126.02	3.22	10	32%	6.4
489	O2L4F5	O2L4J5	O2L4J4	Ductile Iron		30.3	4	0.012	124.51	124.51	3.18	10	32%	0.34
3085	O2L4FA2	PMP-4A	O2L4J5	Ductile Iron	105	7.3	4	0.012	124.51	124.51	3.18	10	32%	1.18

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3851	O2L4F4	O2L4J4	O2L4J3	Asbestos Cement		752.6	4	0.011	124.51	124.51	3.18	10	32%	10.12
3854	O2L4F3	O2L4J3	O2L4J2	Asbestos Cement		1169.3	4	0.011	124.51	124.51	3.18	10	32%	15.73
3856	O2L4F2	O2L4J2	O2L4J1	Asbestos Cement		374.9	4	0.011	124.51	124.51	3.18	10	32%	5.04
3858	O2L4F1	O2L4J1	O2L5J2	Asbestos Cement		42	4	0.011	124.51	124.51	3.18	10	32%	0.57
1490	O2L39F1	O2L39J1	M35A1	PVC		751.7	2	0.01	29.869	29.869	3.05	10	31%	17.64
3890	O2L39FA2	PMP-39a	O2L39J1	Ductile Iron	25	9	2	0.012	29.869	29.869	3.05	10	31%	0.59
199	O2L7F1	O2L1J1	O2L7J1	Cast iron		671.6	8	0.012	-453.81	-453.81	2.9	10	29%	2.84
1140	O1L42F1	O1L42J1	M14C1	Ductile Iron		1075.3	4	0.012	111.61	111.61	2.85	10	29%	9.9
3603	O2L16F1	O2L16J1	O2L41J1	Ductile Iron		496.3	8	0.013	435.92	435.92	2.78	10	28%	1.95
3604	O2L41F1	O2L41J1	O2L22J1	Ductile Iron		785.4	8	0.013	435.92	435.92	2.78	10	28%	3.08
3775	O2L12FB2	PMP-12B	O2L12J2	PVC	90	7.2	4	0.01	107.08	107.08	2.73	10	27%	0.77
3778	O2L12F2	O2L12J2	O2L12J1	PVC		30.5	4	0.01	107.08	107.08	2.73	10	27%	0.26
3864	O2L24F1	O2L24J1	O2L7J1	Asbestos Cement		561.1	6	0.011	240.39	240.39	2.73	10	27%	3.54
3672	O2L29F1	O2L29J1	M34A11	Ductile Iron		604.4	4	0.012	104.88	104.88	2.68	10	27%	4.96
395	O2L3FA2	PMP-3A	O2L3J2	Ductile Iron	98	6.9	4	0.012	104.48	104.48	2.67	10	27%	1.9
4048	O2L3F2	O2L3J1	O2L3J2	Cast iron		1248	4	0.012	-104.48	-104.48	2.67	10	27%	14.27
1668	O2L33F1	O2L33J1	O2L45J1	PVC		820.9	6	0.01	215.9	215.9	2.45	10	25%	3.56
143	O2L18AFB2	PMP-18B	O2L18J3	Ductile Iron	66	10.5	3	0.01	51.242	51.242	2.33	10	23%	0.58
3711	O2L23F1	O2L23F1	O2L24J1	PVC		474	4	0.01	89.097	89.097	2.27	10	23%	2.88
3451	O1L37F1	M14D4	O1L37J1	PVC		61.8	4	0.01	-88.302	-88.302	2.25	10	23%	0.37
3452	O1L37FA1	PMP-37a	O1L37J1	Steel	78	8.8	4	0.013	88.302	88.302	2.25	10	23%	0.76
466	O1L17FB1	PMP-17B	O1L17J4		155	8.3	8	0.012	333.17	333.17	2.13	10	21%	0.37
468	O1L17F3	O1L17J4	O1L17J3	Steel		7.9	8	0.013	333.17	333.17	2.13	10	21%	0.03
2441	O1L17F1	O1L17J1	O1L14J2	Ductile Iron		255.7	8	0.012	333.17	333.17	2.13	10	21%	0.61
2460	O1L17F2	O1L17J1	O1L17J2	Ductile Iron		1095.9	8	0.012	-333.17	-333.17	2.13	10	21%	2.61
2462	O1L17F2	O1L17J2	O1L17J3	PVC		1271	8	0.01	-333.17	-333.17	2.13	10	21%	3.03
393	O2L24FA2	PMP-24A	O2L24J2	Steel	84	8.3	3	0.013	46.812	46.812	2.12	10	21%	1.02
3708	O2L24F2	O2L24J2	O2L24J1	PVC		542.3	3	0.01	46.812	46.812	2.12	10	21%	4.06
407	O2L18A-FA2	PMP-18A	O2L18J3	Steel	66	10.8	3	0.013	46.617	46.617	2.12	10	21%	0.8

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3785	O2L11FA2	PMP-11A	O2L11J1	Ductile Iron	77	5.9	3	0.012	46.023	46.023	2.09	10	21%	0.56
3788	O2L11F2	O2L11J1	O2L11J1	Ductile Iron		41.5	3	0.012	46.023	46.023	2.09	10	21%	0.3
1783	O2L30FA2	PMP-30A	O2L30J1	PVC	77	8.8	3	0.01	43.798	43.798	1.99	10	20%	1.12
3659	O2L30F1	O2L30J1	O2L47J1	PVC		413.1	3	0.01	43.798	43.798	1.99	10	20%	2.73
4472	O2L48FA2	PMP-48A	O2L48J1	PVC	70	6.2	3	0.01	41.077	41.077	1.86	10	19%	0.41
214	O2L15F1	O2L15J1	O2L33J1	PVC		1180.6	6	0.01	159.37	159.37	1.81	10	18%	2.92
3486	O2L19FB1	W-19	PMP-19B	Steel	0.1	7.7	20	0.013	1747.5	1747.5	1.78	10	18%	0
3762	O2L13FA1	W-13	PMP-13A	Ductile Iron	16	7.3	3	0.012	32.293	32.293	1.47	10	15%	0.06
517	O2L36FA2	PMP-36A	O2L36J4	Steel	90	7.2	4	0.013	50.074	50.074	1.28	10	13%	0.31
3614	O2L36F4	O2L36J4	O2L36J3	Ductile Iron		1394.3	4	0.012	50.074	50.074	1.28	10	13%	2.91
3862	O2L3F1	O2L3J1	O2L24J1	Cast iron		2688.9	6	0.012	104.48	104.48	1.19	10	12%	4.27
506	O2L34FA1	W-34	PMP-34A	Ductile Iron	0.1	10.6	20	0.012	1150.9	1150.9	1.18	10	12%	0
3663	O2L31F1	O2L31J1	O2L16J1	Ductile Iron		653.2	8	0.012	166.88	166.88	1.07	10	11%	0.43
213	O2L13F1	O2L13J1	O2L15J1			584.2	6	0.013	85.077	85.077	0.97	10	10%	0.54
3764	O2L13FA2	PMP-13A	O2L13J2	Ductile Iron	69	8.5	4	0.012	32.293	32.293	0.82	10	8%	0.06
3767	O2L13F2	O2L13J2	O2L13J1	Ductile Iron		24.7	4	0.012	32.293	32.293	0.82	10	8%	0.02
212	O2L44F1	O1L44J1	O2L13J1	PVC		1303.2	6	0.01	52.785	52.785	0.6	10	6%	0.42
3881	O2L38FA1	W-38	PMP-38a	Steel	0.1	7.5	20	0.013	309.12	309.12	0.32	10	3%	0
3081	O2L16FA1	W-16	PMP-16A	Steel	1	8	20	0.013	269.04	269.04	0.27	10	3%	0
3662	O2L19F1	O2L34J4	O2L31J1	Cast iron		48.8	8	0.013	-34.375	-34.375	0.22	10	2%	0
3819	O2L7FA1	W-7	PMP-7A	Ductile Iron	1.1	7.1	20	0.012	213.42	213.42	0.22	10	2%	0
3925	O2L46FA1	W-46	PMP-46a	PVC	0.1	7.6	10	0.01	53.324	53.324	0.22	10	2%	0
3694	O2L44FA1	W-44	PMP-44a	PVC	0.1	8.1	10	0.01	52.785	52.785	0.22	10	2%	0
3832	O2L5FA2	PMP-5A	O2L5J3	Ductile Iron	93	6.7	4	0.012	8.3964	8.3964	0.21	10	2%	0.01
3834	O2L5F3	O2L5J3	O2L5J2	Ductile Iron		16.9	4	0.012	8.3964	8.3964	0.21	10	2%	0
1743	O2L31FA1	W-31	PMP-31A	Ductile Iron	0.1	8.6	20	0.012	201.26	201.26	0.21	10	2%	0
1690	02L23FA1	W-23	PMP-22A	Ductile Iron	1	8.7	20	0.012	183.34	183.34	0.19	10	2%	0
3525	O2L35FA1	W-35	PMP-35A	Steel	0.1	7.2	20	0.013	171.8	171.8	0.18	10	2%	0
417	O2L2FA1	W-2	PMP-2A	Steel	0.1	8.7	20	0.013	161.96	161.96	0.17	10	2%	0

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
1791	O2L26FB1	W-26	PMP-26B	PVC	0.1	7.7	20	0.01	159.28	159.28	0.16	10	2%	0
445	O2L6FA1	W-6	PMP-6A	Ductile Iron	0.1	7.5	20	0.012	153.95	153.95	0.16	10	2%	0
3481	O1L40FA2	W-40	PMP-40a	PVC	0.1	9.8	20	0.01	139.62	139.62	0.14	10	1%	0
3870	O2L1FA1	W-1	PMP-1A	Steel	0.1	7.5	20	0.013	137.79	137.79	0.14	10	1%	0
3849	O2L4FA1	W-4	PMP-4A	Ductile Iron	0.1	8.2	20	0.012	124.51	124.51	0.13	10	1%	0
3879	O1L42FB1	W-42	PMP-42a		1	7	20	0.013	111.61	111.61	0.11	10	1%	0
3773	O2L12FB1	W-12	PMP-12B	Ductile Iron	0.1	9	20	0.012	107.08	107.08	0.11	10	1%	0
3090	O2L29FA1	W-29	PMP-29A	PVC	0.1	11.1	20	0.01	104.88	104.88	0.11	10	1%	0
373	O2L3FA1	W-3	PMP-3A	Ductile Iron	0.1	7.8	20	0.012	104.48	104.48	0.11	10	1%	0
389	O2L23FB1	W-23	PMP-23B	Steel	1	8.2	20	0.013	89.097	89.097	0.09	10	1%	0
3453	O1L37FA2	W-37	PMP-37a	PVC	0.1	9.7	20	0.01	88.302	88.302	0.09	10	1%	0
3918	O2L45FA1	W-45	PMP-45a	PVC	0.1	7.1	20	0.01	86.238	86.238	0.09	10	1%	0
426	O2L25FA1	W-25	PMP-25A	Ductile Iron	0.1	7.7	20	0.012	82.961	82.961	0.08	10	1%	0
432	O2L18A-FA1	W-18A	PMP-18A-b	Steel	0.1	13.2	20	0.013	75.334	75.334	0.08	10	1%	0
3961	O2L15FA1	W-15	PMP-15A	Ductile Iron		7.2	20	0.012	74.29	74.29	0.08	10	1%	0
4405	O2L47FB1	W-47	PMP-47B	PVC	0.1	9.5	20	0.01	56.842	56.842	0.06	10	1%	0
3943	O2L11FA1	W-33	PMP-33A	Ductile Iron	0.1	6.7	20	0.012	56.531	56.531	0.06	10	1%	0
149	O2L18FB1	W-18	PMP-18B	Ductile Iron	0.1	8.9	20	0.01	51.242	51.242	0.05	10	1%	0
516	O2L36FA1	W-36	PMP-36A	Steel	0.1	8.2	20	0.013	50.074	50.074	0.05	10	1%	0
392	O2L24FA1	W-24	PMP-24A	PVC	0.1	9.1	20	0.01	46.812	46.812	0.05	10	1%	0
406	O2L18FA1	W-18	PMP-18A	Steel	0.1	8.8	20	0.013	46.617	46.617	0.05	10	1%	0
3783	O2L11FA1	W-11	PMP-11A	Ductile Iron	0.1	8.4	20	0.012	46.023	46.023	0.05	10	1%	0
1782	O2L30FA1	W-30	PMP-30A	Cast iron	0.1	8	20	0.012	43.798	43.798	0.04	10	0%	0
3974	O1L43FA2	W-35	PMP-43a	PVC	0.1	7.6	20	0.01	42.611	42.611	0.04	10	0%	0
4471	O2L48FA1	W-48	PMP-48A	PVC	0.1	8.1	20	0.01	41.077	41.077	0.04	10	0%	0
3889	O2L39FA1	W-39	PMP-39a	PVC	0.1	8.2	20	0.01	29.869	29.869	0.03	10	0%	0
3831	O2L5FA1	W-5	PMP-5A	Ductile Iron	0.1	7.6	20	0.012	8.3964	8.3964	0.01	10	0%	0
3605	O2L41F2	O2L41J2	O2L41J1			192.7	1.3	0.013	-0.00012	-0.00012	0	10	0%	0
3899	O2L41FA2	PMP-41a	O2L41J2	PVC	25	7	2	0.01	-0.00012	-0.00012	0	10	0%	0

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3797	O2L10F3	O2L10J3	O2L10J2	Ductile Iron		37.5	3	0.012	-1.95E-05	-1.95E-05	0	10	0%	0
2437	NA	O2L4J4	na			163.1	4	0.011	3.19E-05	3.19E-05	0	10	0%	0
3898	O2L41FA1	W-41	PMP-41a	PVC	0.1	7.2	20	0.01	-0.00012	-0.00012	0	10	0%	0
2433	NA	M3F3	na			97.3	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
2435	NA	na	na			126.6	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
3793	O2L10FA1	W-10	PMP-10A	Ductile Iron	0.1	8.3	20	0.012	-1.61E-05	-1.61E-05	0	10	0%	0
3795	O2L10FA2	PMP-10A	O2L10J3	Ductile Iron	99	6.6	3	0.012	0	0	0	10	0%	0
142	O2L24FB1	W-24	PMP-24B	Ductile Iron	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
150	O2L25FB2	PMP-25B	O2L25J1	Ductile Iron	84	9.2	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
151	O2L24FB2	PMP-24B	O2L24J2	Steel	84	7.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
152	O2L22FB1	W-23	PMP-22B	Ductile Iron	1	7.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
165	O1L17FA2	W-17	PMP-17A	Steel	21.1	6.7	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
166	O2L22FB2	PMP-22B	O2L22J2	Ductile Iron	112	7.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
168	O1L14FB2	W-14	PMP-14B	Ductile Iron	44	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
170	O2L34FC1	W-34	PMP-34C	Ductile Iron	0.1	6.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
177	O2L36FB1	W-36	PMP-36B	Ductile Iron	0.1	9.2	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
184	O2L36FB2	PMP-36B	O2L36J4	Ductile Iron	90	7.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
374	O2L3FB1	W-3	PMP-3B	Ductile Iron	0.1	8.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
386	O2L23FA1	W-23	PMP-23A	Steel	1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
387	O2L23FA2	PMP-23A	O2L23F1	Steel	84	9	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
394	O2L3FB2	PMP-3B	O2L3J2	Ductile Iron	98	8.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
401	O2L1FB2	PMP-1B	O2L1J2	Ductile Iron	10	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
413	O2L2FB1	W-2	PMP-2B	Steel	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
415	O2L2FB2	PMP-2B	O2L2J1	Ductile Iron	112	9.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
435	O2L18A-FA2	PMP-18A-a	O2L18AJ1	Steel	66	8.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
436	O2L18A-FA1	PMP-18A-a	W-18A	Steel	0.1	8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
443	O2L6FB2	PMP-6B	O2L6J1	PVC	74	6.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
444	O2L6FB1	W-6	PMP-6B	Ductile Iron	0.1	7	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
467	O1L17FA1	PMP-17A	O1L17J4	Steel	155	8.3	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
473	O1L14FB1	PMP-14B	O1L14J3	Steel	134	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
486	O2L4FB2	PMP4B	O2L4J5	Ductile Iron	105	6.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
487	O2L4FB1	W-4	PMP4B	Ductile Iron	0.1	8.5	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
492	O2L5FB1	W-5	PMP-5B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
494	O2L5FB2	PMP-5B	O2L5J3	Ductile Iron	93	5.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
513	O2F32FA1	W-32	PMP-32A	Ductile Iron	16.1	9.8	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
514	O2L32FA2	PMP-32A	O2L32J2	Ductile Iron	101	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
526	O2L34FC2	PMP-34C	O2L34J6	Ductile Iron	154	7.8	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1693	O2L34FB1	W-34	PMP-34B	Ductile Iron	0.1	8.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1694	O2L34FB2	PMP-34B	O2L34J6	Ductile Iron	154	9.4	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1745	O2L31FB2	PMP-31B	O2L31J2	Steel	77	9.6	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1746	O2L31FB1	W-31	PMP-31B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1784	O2L30FB2	PMP-30B	O2L30J1	PVC	77	8.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1785	O2L30FB1	W-30	PMP-30B	Cast iron	0.1	7.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1793	O2L26FA2	PMP-26A	O2L26J1	Steel	79	6.1	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1794	O2L26FA1	W-26	PMP-26A	PVC	1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2454	NA	J-97	na			612.3	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2466	NA	na	J-97			2074.5	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3078	O2L16FB2	PMP-16B	O2L16J2	Ductile Iron	77	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3082	O2L16FB1	W-16	PMP-16B	Steel	1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3086	O2L29FB1	W-29	PMP-29B	PVC	0.1	10	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3088	O2L29FB2	PMP-29B	O2L29J2	PVC	78	11.7	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3454	O1L37FB1	PMP-37b	O1L37J1	Ductile Iron	78	6.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3455	O1L37FB2	W-37	PMP-37b		0.1	8.8	10	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3483	O1L40FB2	W-40	PMP-40b	PVC	0.1	12.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3484	O1L40FB1	PMP-40b	O1L40J1	Ductile Iron	70	10	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3487	O2L19FA1	W-19	PMP-19A	Steel	0.1	7.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3493	O2L19FA2	PMP-19A	O1L34J2	Steel	341	8.5	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3566	O2L38FB1	W-38	PMP-38b	Steel	0.1	8.3	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3568	O2L38FB2	PMP-38b	O2L38J1	Steel	100	7.3	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3651	O2L34BYEPAS	O2L36J1	O2L34J5	Ductile Iron		15.2	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3696	O2L44FB1	W-44	PMP-44b	PVC	0.1	8.3	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3697	O2L44FB2	PMP-44b	O1L44J2		25	6.8	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3744	O2L15FB2	PMP-15B	O2L15J2	Ductile Iron	78	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3768	O2L13FB1	W-13	PMP-13B	Ductile Iron	16	9.1	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3769	O2L13FB2	PMP-13B	O2L13J2	Ductile Iron	69	9.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3779	O2L12FA1	W-12	PMP-12A	Ductile Iron	0.1	8.2	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3780	O2L12FA2	PMP-12A	O2L12J2	Ductile Iron	90	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3789	O2L11FB1	W-11	PMP-11B	Ductile Iron	0.1	8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3790	O2L11FB2	PMP-11B	O2L11J1	Ductile Iron	77	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3799	O2L10FB1	W-10	PMP-10B	Ductile Iron	0.1	5.6	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3800	O2L10FB2	PMP-10B	O2L10J3	Ductile Iron	99	7.5	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3803	O2L9FB2	PMP-9B	O2L9J1	Ductile Iron	76	5.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3808	O2L9FB1	W-9	PMP-9B	Cast iron	27	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3817	O2L7FB1	W-7	PMP-7B	Ductile Iron	0.1	7.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3823	O2L7FB2	PMP-7B	O2L7J2	Ductile Iron	104	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3869	O2L1FB1	W-1	PMP-1B	Steel	0.1	7.2	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3877	O1L42FA1	W-42	PMP-42b		0.1	8.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3878	O1L42FA2	PMP-42b	O1L42J1		25	7.7	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3887	O2L39FB1	W-39	PMP-39b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3888	O2L39FB2	PMP-39b	O2L39J1	Ductile Iron	25	8.3	2	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3891	O2L35FB2	W-35	PMP-35B	Steel	0.1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3892	O2L35FB2	PMP-35B	O2L35J2	Steel	90	6.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3896	O2L41FB1	W-41	PMP-41b	PVC	0.1	6.9	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3897	O2L41FB2	PMP-41b	O2L41J2	PVC	25	7	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3916	O2L45FB1	W-45	PMP-45b		0.1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3917	O2L45FB2	PMP-45b	O2L45J2	PVC	25	7.4	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3933	O2L46FB1	W-46	PMP-46b	PVC	0.1	8.1	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3934	O2L46FB2	PMP-46b	O2L46J1		25	6.2	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3937	O2L33FB1	W-33	PMP-33B	Ductile Iron	0.1	6.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3939	O2L33FB2	PMP-33B	O2L33J2	Steel	70	5.8	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3960	O2L15FB1	W-15	PMP-15B	Ductile Iron		7.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3972	O1L14FB2	W-35	PMP-43b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3973	O1L14FB1	PMP-43b	O1L43J1	PVC	25	7.3	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4408	O2L47FA1	W-47	PMP-47A	PVC	0.1	9.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4409	O2L47FA2	PMP-47A	O2L47J2	PVC	40	6.2	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4462	O2L48FB1	W-48	PMP-48B	PVC	0.1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4464	O2L48FB2	PMP-48B	O2L48J1	PVC	70	7.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

EXHIBIT F.4
PRESSURE NODE DATA TABLE REPORT

Model Pressure Node Data Table 50 Units Per Acre Build Out
Exhibit F4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
1341	O1L14J1	6.7	3.5	58.1	24	54.6		921853.18	600253.72	TRUE
2432	O1L14J2	6.4	0	64.8	28	64.8		920948.59	600723.96	TRUE
472	O1L14J3	6.4	8	64.9	25	56.9		920955.16	600715.27	TRUE
127	O1L17J1	6	5.3	65.4	26	60.2		920692.99	600715.98	TRUE
2461	O1L17J2	6.8	4	68	28	64		920723	599620.53	TRUE
87	O1L17J3	7.9	5	71.1	29	66.1		920698	598426.1	TRUE
465	O1L17J4	7	5	71.1	29	66.1		920705.89	598426.09	TRUE
2428	O1L34J1	8	5	23.5	8	18.5		927366.12	604992.24	TRUE
3492	O1L34J2	6.8	4.8	29.3	11	24.5		927390.3	604966.61	TRUE
3445	O1L37J1	6	3	3.5	0	0.5		919806.96	599800.73	TRUE
1337	O1L40J1	7.7	4	80.7	33	76.7		921532.85	599443.59	TRUE
1132	O1L42J1	5.8	3	7.6	2	4.6		919732.18	600929.27	TRUE
3588	O1L43J1	7.1	5	23.9	8	18.9		919610.41	600547.6	TRUE
116	O1L44J1	6.8	5.3	55.9	22	50.7		921909.68	600337.73	TRUE
1678	O1L44J2	6.2	0	64.3	28	64.3		921913.59	600458.39	TRUE
88	O2L10J1	8	4	23.6	8	19.6		927114.51	600739.53	TRUE
136	O2L10J2	7.8	5	34.2	13	29.2		926523.21	600750.87	TRUE
3794	O2L10J3	8.7	6.5	34.2	12	27.7		926513.68	600783.24	TRUE
135	O2L11J1	7.9	5.5	42.4	16	36.9		926045.89	600735.78	TRUE
3784	O2L11J1	10.5	8.5	42.7	15	34.2		926041.8	600777.04	TRUE
134	O2L12J1	8.1	6	47.2	18	41.2		925712.64	600726.09	TRUE
3774	O2L12J2	8.2	6.2	47.4	18	41.2		925711.36	600756.56	TRUE
131	O2L13J1	6.1	3	55.5	23	52.5		922967.26	600629.79	TRUE
3763	O2L13J2	6.2	4.2	55.5	22	51.3		922961.39	600653.77	TRUE
132	O2L15J1	6.8	4	55	22	51		923551.18	600648.88	TRUE
3743	O2L15J2	7	5	55.4	22	50.4		923546.24	600675.67	TRUE
107	O2L16J1	4.7	2.5	32	13	29.5		928422.75	604385.66	TRUE
2407	O2L16J2	6.7	4	49	19	45		928763.58	604418.47	TRUE
433	O2L18AJ1	4.7	2.5	12.9	4	10.4		928854.97	600361.74	TRUE
93	O2L18J1	7.7	4	12.5	4	8.5		928569.18	600970.36	TRUE

Model Pressure Node Data Table 50 Units Per Acre Build Out
Exhibit F4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
3726	O2L18J2	4.9	2.9	25.5	10	22.6		928608.77	599957.47	TRUE
126	O2L18J3	5.7	3	30.5	12	27.5		928767.45	599971.15	TRUE
3504	O2L19J1	8.3	7.8	25.2	8	17.4		927390.21	604973.37	TRUE
104	O2L1J1	6	4	28	10	24		928617.92	599702.49	TRUE
398	O2L1J2	6.6	4	32.7	12	28.7		928285.14	599671.66	TRUE
105	O2L22J1	6.9	4	26.9	10	22.9		927748.42	604998.77	TRUE
106	O2L22J2	5.5	3	49.4	20	46.4		927483.96	604307.21	TRUE
118	O2L23F1	4.3	1.2	37.2	16	36		929940.07	600105.19	TRUE
97	O2L24J1	6.9	4	34.4	13	30.4		929844.61	599734.74	TRUE
102	O2L24J2	5.4	3	38.4	15	35.4		929700.1	600158.28	TRUE
101	O2L25J1	4.5	2.7	14.5	5	11.8		929283.22	600655.84	TRUE
1790	O2L26J1	5.6	3.6	12.1	4	8.5		927480.33	603912.05	TRUE
2416	O2L29J1	4.5	2	6.8	2	4.8		929271.35	603049.66	TRUE
3087	O2L29J2	4.5	2	7.2	2	5.2		929284.01	603049.29	TRUE
414	O2L2J1	5.8	3.3	15.8	5	12.5		928996	598338.88	TRUE
1781	O2L30J1	3.1	1	21.8	9	20.8		929239.57	603452.81	TRUE
3661	O2L31J1	4.8	2.5	32.4	13	29.9		928446.71	603732.88	TRUE
1742	O2L31J2	6.6	4	62.3	25	58.3		929288.83	604013.67	TRUE
100	O2L32J1	5.7	4	27.9	10	23.9		928486.55	602372.06	TRUE
125	O2L32J2	5.3	4	35.5	14	31.5		927974.57	602351.14	TRUE
133	O2L33J1	8.3	6	52	20	46		924731.1	600689.88	TRUE
3938	O2L33J2	9.2	6	54.5	21	48.5		924723.91	600721.68	TRUE
3505	O2L34J2	8.1	4.6	24.1	8	19.6		927389.97	604994.04	TRUE
3498	O2L34J3	8.4	3.8	24.3	9	20.5		927411.01	604994.99	TRUE
1810	O2L34J4	4.8	4	32.4	12	28.4		928447.42	603684.11	TRUE
120	O2L34J5	5.9	2	79.9	34	77.9		928527.32	601678.68	TRUE
525	O2L34J6	5.9	10.1	81.1	31	70.9		928480.51	601676.24	TRUE
3528	O2L35J1	5.9	3	76.4	32	73.4		925402.48	604500.5	TRUE
3526	O2L35J2	0	0	76.6	33	76.6		925402.8	604509.91	TRUE
3649	O2L36J1	6	4	-3.6	-3	-7.6		928527.66	601663.48	TRUE

Model Pressure Node Data Table 50 Units Per Acre Build Out
Exhibit F4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
91	O2L36J2	7.4	5	11.3	3	6.3		928541.4	601077.86	TRUE
90	O2L36J3	8.9	4	18.6	6	14.6		927111.29	601021.17	TRUE
89	O2L36J4	6.1	4	21.6	8	17.6		926952.73	602311.3	TRUE
3567	O2L38J1	6.5	3.5	10.2	3	6.7		925476.79	603270.8	TRUE
1482	O2L39J1	6.5	4	16.5	5	12.5		925456.86	603835.44	TRUE
4047	O2L3J1	6.9	5	38.6	15	33.6		929945.67	597047.95	TRUE
124	O2L3J2	6.4	5	52.9	21	47.9		928698.06	597016.74	TRUE
3602	O2L41J1	5.5	4	30	11	26		928396.68	604881.25	TRUE
1639	O2L41J2	6.4	4	30	11	26		928579.21	604893.45	TRUE
1667	O2L45J1	8.1	6	48.5	18	42.5		925551.4	600721.93	TRUE
1670	O2L45J2	9.4	7.4	55.1	21	47.7		925547.33	600761.31	TRUE
3926	O2L46J1	6.6	3	16.9	6	13.9		928915.95	600879.36	TRUE
4400	O2L47J1	2.2	1.4	19.1	8	17.7		928837.69	603432.35	TRUE
4396	O2L47J2	5	3	20.1	7	17.1		928830.59	603426.03	TRUE
4463	O2L48J1	0	0	25.8	11	25.8		926212.08	601305.88	TRUE
3855	O2L4J1	6.3	4.3	16.2	5	11.9		927327.5	597718.21	TRUE
3853	O2L4J2	6.2	4.2	21.3	7	17.1		927318.45	598092.97	TRUE
3850	O2L4J3	5.8	3.8	37	14	33.2		927280.07	599261.59	TRUE
488	O2L4J4	7	5	47.1	18	42.1		927253.84	600013.72	TRUE
484	O2L4J5	7.6	6	47.5	18	41.5		927276.73	600022.08	TRUE
3838	O2L5J1	6	4	4.9	0	0.9		927367.89	597001.13	TRUE
3857	O2L5J2	6.3	4	15.7	5	11.7		927330.85	597676.29	TRUE
493	O2L5J3	6.3	4.8	15.7	5	10.8		927336.66	597692.12	TRUE
442	O2L6J1	6.3	4	13.9	4	9.9		928475.95	600682.36	TRUE
95	O2L7J1	6.6	4	30.8	12	26.8		929283.52	599729.39	TRUE
3820	O2L7J2	6.9	4.9	31.8	12	26.9		929290.49	599699.06	TRUE
3802	O2L9J1	6.5	3.5	34.3	13	30.8		928210.32	602646.01	TRUE
2434	na	0	0	3.5	2	3.5		927359.5	596967.77	TRUE
2436	na	0	0	3.5	2	3.5		927353.71	597094.23	TRUE
2438	na	0	0	47.1	20	47.1		927262.9	599779.52	TRUE

EXHIBIT F.5
PUMP MODEL DATA TABLE REPORT

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
63	PMP-1A	TRUE	6.7	-3.8	Pump Definition - LS1	137.79	54.6	-1.8	52.8
396	PMP-1B	FALSE	6.7	-3.8	Pump Definition - LS1	(N/A)	(N/A)	(N/A)	(N/A)
412	PMP-2A	TRUE	6.3	-4.7	Pump Definition - LS2	161.96	21.5	-3.7	17.9
411	PMP-2B	FALSE	6.4	-4.7	Pump Definition - LS2	(N/A)	(N/A)	(N/A)	(N/A)
365	PMP-3A	TRUE	6.4	-2.9	Pump Definition - LS3	104.48	56.7	-1.9	54.8
62	PMP-3B	FALSE	6.4	-2.9	Pump Definition - LS3	(N/A)	(N/A)	(N/A)	(N/A)
481	PMP-4A	TRUE	7.6	-3.6	Pump Definition - LS4	124.51	50.2	-1.6	48.6
482	PMP-4B	FALSE	7.6	-3.6	Pump Definition - LS4	(N/A)	(N/A)	(N/A)	(N/A)
491	PMP-5A	TRUE	6	-6.2	Pump Definition - LS5	8.3964	19.8	-4.2	15.7
490	PMP-5B	FALSE	6	-6.2	Pump Definition - LS5	(N/A)	(N/A)	(N/A)	(N/A)
440	PMP-6A	TRUE	6.5	-2.9	Pump Definition - LS6	153.95	20.3	-1.4	18.9
441	PMP-6B	FALSE	6.5	-2.9	Pump Definition - LS6	(N/A)	(N/A)	(N/A)	(N/A)
453	PMP-7A	TRUE	6.8	-5.4	Pump Definition - LS7	213.42	38.3	-3.4	34.9
60	PMP-7B	FALSE	6.8	-5.4	Pump Definition - LS7	(N/A)	(N/A)	(N/A)	(N/A)
3801	PMP-9A	TRUE	6	3.5	Pump Definition - LS9	126.02	37	-1.4	35.6
51	PMP-9B	FALSE	6	3.5	Pump Definition - LS9	(N/A)	(N/A)	(N/A)	(N/A)
3791	PMP-10A	TRUE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	-1.93E-05	26	3.9	29.9
3792	PMP-10B	FALSE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3781	PMP-11A	TRUE	10.5	3	Pump Definition - LS11	46.023	33.8	9.5	43.3
3782	PMP-11B	FALSE	10.5	3	Pump Definition - LS11	(N/A)	(N/A)	(N/A)	(N/A)
3772	PMP-12A	FALSE	8.7	2.5	Pump Definition - LS12	(N/A)	(N/A)	(N/A)	(N/A)
3771	PMP-12B	TRUE	8.7	2.5	Pump Definition - LS12	107.08	40.2	8	48.2
3760	PMP-13A	TRUE	6.7	4.7	Pump Definition - LS13	32.293	53.4	2.1	55.6
3761	PMP-13B	FALSE	6.7	4.7	Pump Definition - LS13	(N/A)	(N/A)	(N/A)	(N/A)
469	PMP-14A	TRUE	6.4	8	Pump Definition - LS14	547.15	74.8	-4.7	70.2
48	PMP-14B	FALSE	6.4	8	Pump Definition - LS14	(N/A)	(N/A)	(N/A)	(N/A)
3741	PMP-15A	TRUE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	74.29	54.3	2.5	56.8
3740	PMP-15B	FALSE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
2476	PMP-16A	TRUE	5.9	-6.3	Pump Definition - LS16	269.04	64.3	-4.3	60

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
2481	PMP-16B	FALSE	5.9	-6.3	Pump Definition - LS16	(N/A)	(N/A)	(N/A)	(N/A)
49	PMP-17A	FALSE	7	9	Pump Definition - LS17	(N/A)	(N/A)	(N/A)	(N/A)
463	PMP-17B	TRUE	7.5	9	Pump Definition - LS17	333.17	82.8	-11.3	71.5
405	PMP-18A	TRUE	5.7	-5	Pump Definition - LS18	46.617	30.3	1	31.3
431	PMP-18A-a	FALSE	6.1	-3.5	Pump Definition - LS18a	(N/A)	(N/A)	(N/A)	(N/A)
430	PMP-18A-b	TRUE	6.1	-3.5	Pump Definition - LS18a	75.334	15.8	-1	14.8
61	PMP-18B	TRUE	5.7	-5	Pump Definition - LS18	51.242	30.1	1	31.1
539	PMP-19A	FALSE	6.8	-4.1	Pump Definition - LS19	(N/A)	(N/A)	(N/A)	(N/A)
53	PMP-19B	TRUE	6.8	-2.5	Pump Definition - LS19	1747.5	59.9	-2.1	57.8
1689	PMP-22A	TRUE	5.4	-9.7	Pump Definition - LS22	183.34	60.8	-7.2	53.6
52	PMP-22B	FALSE	5.9	-9.7	Pump Definition - LS22	(N/A)	(N/A)	(N/A)	(N/A)
59	PMP-23A	FALSE	4.5	-5.9	Pump Definition - LS23	(N/A)	(N/A)	(N/A)	(N/A)
388	PMP-23B	TRUE	-5.9	-5.9	Pump Definition - LS23	89.097	44	-3.4	40.6
391	PMP-24A	TRUE	5.6	-3.4	Pump Definition - LS24	46.812	40.3	-0.9	39.4
58	PMP-24B	FALSE	5.6	-3.4	Pump Definition - LS24	(N/A)	(N/A)	(N/A)	(N/A)
425	PMP-25A	TRUE	5.1	-5.4	Pump Definition - LS24-LS25	82.961	19.2	-2.9	16.3
57	PMP-25B	FALSE	5.1	-5.4	Pump Definition - LS24-LS25	(N/A)	(N/A)	(N/A)	(N/A)
1788	PMP-26A	FALSE	5.6	-4.2	Pump Definition - LS26	(N/A)	(N/A)	(N/A)	(N/A)
1789	PMP-26B	TRUE	5.6	-4.2	Pump Definition - LS26	159.28	25.2	-3.8	21.4
2479	PMP-29A	TRUE	4.4	-4.9	Pump Definition - LS29	104.88	18.9	-3.9	15
2480	PMP-29B	FALSE	3.5	-4.9	Pump Definition - LS29	(N/A)	(N/A)	(N/A)	(N/A)
1779	PMP-30A	TRUE	4.1	-5	Pump Definition - LS30	43.798	25.4	-2.5	22.9
1780	PMP-30B	FALSE	4.1	-5	Pump Definition - LS30	(N/A)	(N/A)	(N/A)	(N/A)
1740	PMP-31A	TRUE	6.2	-8	Pump Definition - LS31	201.26	95.7	-6.6	89.2
1741	PMP-31B	FALSE	6.2	-8	Pump Definition - LS31	(N/A)	(N/A)	(N/A)	(N/A)
508	PMP-32A	FALSE	8	10	Pump Definition - LS32	(N/A)	(N/A)	(N/A)	(N/A)
50	PMP-32B	TRUE	8	10	Pump Definition - LS32	142.69	42.3	-5.3	37
3935	PMP-33A	TRUE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	56.531	60.2	3	63.2
3936	PMP-33B	FALSE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
505	PMP-34A	TRUE	6.9	-10.5	Pump Definition - LS34	1150.9	90.7	-6	84.7
1692	PMP-34B	FALSE	6.9	-10.5	Pump Definition - LS34	(N/A)	(N/A)	(N/A)	(N/A)
56	PMP-34C	FALSE	6.9	-10.5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
3522	PMP-35A	TRUE	6	-5	Pump Definition - LS35	171.8	81	-1.4	79.6
3521	PMP-35B	FALSE	6	-5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
515	PMP-36A	TRUE	6.7	-8.5	Pump Definition - LS36	50.074	27.4	-5.5	21.9
64	PMP-36B	FALSE	7.5	-8.5	Pump Definition - LS36	(N/A)	(N/A)	(N/A)	(N/A)
3443	PMP-37a	TRUE	6.3	-7	Pump Definition - LS37	88.302	8.9	-4.7	4.3
3444	PMP-37b	FALSE	6.5	-7	Pump Definition - LS37	(N/A)	(N/A)	(N/A)	(N/A)
3565	PMP-38a	TRUE	6.5	-15.4	Pump Definition - LS38	309.12	21.7	-10.2	11.5
3564	PMP-38b	FALSE	6.5	-15.4	Pump Definition - LS38	(N/A)	(N/A)	(N/A)	(N/A)
3886	PMP-39a	TRUE	6	-5	Pump Definition - LS39	29.869	15.1	2	17.1
3885	PMP-39b	FALSE	6	-5	Pump Definition - LS39	(N/A)	(N/A)	(N/A)	(N/A)
3479	PMP-40a	TRUE	8	5	Pump Definition - LS40	139.62	86.6	-5	81.6
3480	PMP-40b	FALSE	8	5	Pump Definition - LS40	(N/A)	(N/A)	(N/A)	(N/A)
3895	PMP-41a	TRUE	6.5	0	Pump Definition - LS10-LS42-LS43 Privite	0	0	4	30
3894	PMP-41b	FALSE	0	6.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3875	PMP-42a	TRUE	5	0	Pump Definition - LS10-LS42-LS43 Privite	111.61	11.8	2.5	14.3
3876	PMP-42b	FALSE	5	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3970	PMP-43a	TRUE	9.4	1	Pump Definition - LS10-LS42-LS43 Privite	42.611	21	4	25
3971	PMP-43b	FALSE	7.4	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3693	PMP-44a	TRUE	6.8	0.5	Pump Definition - LS15-LS33-LS44-LS45	52.785	61.5	4.5	66
3692	PMP-44b	FALSE	6.7	0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
3915	PMP-45a	TRUE	9.3	3.5	Pump Definition - LS15-LS33-LS44-LS45	86.238	50.3	9	59.3
3914	PMP-45b	FALSE	9.3	3.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3923	PMP-46a	TRUE	6.5	-3	Pump Definition - LS10-LS42-LS43 Privite	53.324	19.7	-1	18.7
3924	PMP-46b	FALSE	6.3	-3	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4407	PMP-47A	FALSE	5	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4404	PMP-47B	TRUE	5	1	Pump Definition - LS10-LS42-LS43 Privite	56.842	19.2	4	23.2

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
4460	PMP-48A	TRUE	0	0	Pump Definition - LS10-LS42-LS43 Privite	41.077	21.2	5	26.2
4461	PMP-48B	FALSE	0	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)

EXHIBIT F.6
OUTFALL DATA TABLE REPORT

Model Outfall Data Table 50 Units Per Acre
Exhibit F6

ID	Label	Elev (Grd) (ft)	Elev (Invt) (ft)	Boundary Condition Type	Elev (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Flow (Total Out) (gpm)	Notes
1797	O-1	6.8	3.5	User Defined Tailwater	58	58	1019.9	Measured 58 ft of Head or 25 psi at 12:00 PM Tuesday August 2023
3488	O-2	6.5	3.5	User Defined Tailwater	23	23	3723.9	Measured 10 psi or 23 feet of Head on monday 6/12/2023

EXHIBIT G
PUMP INVENTORY TABLE

Pump Inventory Table

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Park Lake Estates	Lake Shore Drive	Pub	**LS #1**	1	Sulzer	xfp100E-CB1.5-PE56/4-E-60FM	0016055 42/2012	3	230	7.5	19.8	1757	713	65.6	2022	7.68	262	42	BPI Unitron Controls	Pump Definition - 32 (PMP-45)LS1
Park Lake Estates	Lake Shore Drive	Pub	**LS #1**	2	Sulzer	xfp100E-CB1.5-PE56/4-E-60FM	0016055 42/2012	3	230	7.5	19.8	1757	713	65.6	2022	7.68	262	42	BPI Unitron Controls	Pump Definition - 32 (PMP-45)LS1
Park Lake Estates	Marine Circle	Pub	**LS#2**	1	Sulzer	XFP80C-CB1.2-PE20/6-C-60FM	0023652 40/2013	3	230	2.7	8.4	1150	500	9	2013	7.68	140	18	Champion	Pump Definition - 6 (PMP-32)LS2
Park Lake Estates	Marine Circle	Pub	**LS#2**	2	Sulzer	XFP80C-CB1.2-PE20/6-C-60FM	0021027 40/2013	3	230	2.7	8.4	1150	500	9	2013	7.68	140	18	Champion	Pump Definition - 6 (PMP-32)LS2
Park Lake Estates	West Lake Shore Dr	Pub	**LS#3**	1	Sulzer	ABSXFP-PE2	300698673	3	230	7.5		1757 MAX	713	66	2022	0.195	275	40	UNITRON	Pump Definition - 6 (PMP-32)LS2
Park Lake Estates	West Lake Shore Dr	Pub	**LS#3**	2	ABS	XFP-PE2-100E-CB1.5-PE56_4EFM	300688962	3	230	7.5			713	66	2021	0.195	275	40	UNITRON	Pump Definition - 6 (PMP-32)LS2
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#4**	1	ABS	AFPK1041M46/4EX	6980	3	230	6.2	17.1	1750	780	59		0.2	132	46	Champion	Pump Definition - 16 (PMP-46)LS4
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#4**	2	ABS	AFPK1041 M46/4EX	69803	3	230	6.2	17.1		780	59			132	46	Champion	Pump Definition - 16 (PMP-46)LS5
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#5**	1	ABS	AFPK0841.4-M18/4FW	0091195	1	230	2.7	12	1146	305	20	2007	152mm	95	12	Champion	Pump Definition - 18 (PMP-38)LS5
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#5**	2	Liberty	XFP80CB1.4PE 20/6 LSG202M-C	124QWC	1	230	2.4	12.1	1750	305	20	2019	152mm	95	12	Champion	Pump Definition - 18 (PMP-38)LS6

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
La Siesta	Lake Shore Drive	Pub	**LS#6**	1	ABS	20-35 MOBILE HOME / AFPK0841.3M18/4EX		3			1		410	28			92	20	Champion	Pump Definition-4-LS6
La Siesta	Lake Shore Drive	Pub	**LS#6**	2	ABS	20-35 MOBILE HOME / AFPK0841.3M18/4EX		3		2.4			410	28			92	20	Champion	Pump Definition-4-LS6
Lone Pine	10th St.	Pub	**LS#7**	1	Sulzer	XFP100C-CB1_4-pe35/4-60HZ		3	230		13.7		635	49			210	28	Champion	Definition - 26 (PMP-42)LS7
Lone Pine	10th St.	Pub	**LS#7**	2	Sulzer	XFP100C-CB1_4-pe35/4-60HZ		3	230	4.7			635	49			210	28	Champion	Definition - 26 (PMP-42)LS7
removed	removed	Pub	**LS#8**	1																
removed	removed	Pub	**LS#8**	2																
ParkRD	Park Rd	Private	**LS#9**	1	Gorman-Rupp	T3A-B		3	240	5		1250	418	45			150	37	Gorman-Rupp	Pump Definition-5-LS-9
Park RD	Park Rd	Private	**LS#9**	2	Gorman-Rupp	T3A-B		3	240	5		1250	418	25			150	37	Gorman-Rupp	Pump Definition-5-LS-9
SW 30th Street	SW 30th St	Private	**LS#10**	1	Goulds	WS0512BF	WS0512BF	1	230	0.5	7.3	1750	160	25		5	25	23		Pump Definition - 10 (PMP-34)
SW 30th Street	SW 30th St	Private	**LS#10**	2	Goulds	WS0512BF	WS0512BF	1	230	0.5	7.3	1750	160	25		5	25	23		Pump Definition - 10 (PMP-34)
SW 30th Street	SW 30th St	Private	**LS#11**	1	HYDromatic	30 MP	2248-569	NA	NA	NA	NA	1800	NA	NA	NA	NA	NA	NA	NA	PMP11A
SW 30th Street	SW 30th St	Private	**LS#11**	2	HYDromatic	31 MP	2248-570	NA	NA	NA	NA	1800	NA	NA	NA	NA	NA	NA	NA	PMP11B
SW 30th Street	SW 30th St	Private	**LS#12**	1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP12A
SW 30th Street	SW 30th St	Private	**LS#12**	2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP12B
SW 30th Street	SW 30th St	Pub	**LS#13**	1	Gorman-Rupp	T4A3-B	1561914	3	230	10	24.4	1760	NA	60	NA	NA	NA	NA	Fair	PMP13A
SW 30th Street	SW 30th St	Pub	**LS#13**	2	Gorman-Rupp	T4A3-B	1561914	3	230	10	24.4	1760	NA	60	NA	NA	NA	NA	Fair	PMP13B
Peninsula	Hallandale Beach Blvd	Pub	**LS#14**	1	Gorman-Rupp	T6A60SB	1753320	3	240	30	125	1350	540	75	NA	NA	NA	NA	NA	PMP14A

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Peninsula	Hallandale Beach Blvd	Pub	**LS#14**	2	Gorman-Rupp	T6A60SB	1753320	3	240	30	125	1350	540	75	NA	NA	NA	NA	NA	PMP14B
SW 30th Street	SW 30th St	Pub	**LS#15**	1	Goulds	WS0712BHF	520150	3	230	0.75	12.6	Na	200	80	NA	NA	74	54	NA	PMP15A
No Second pump			**LS#15**																	
Alabama Street	Alabama St	Pub	**LS#16**	1	ABS	AFPK1049 M75/4	M75/4	3	230	10.1	26.1	1750	850	90	NA	NA	NA	NA	NA	PMP16A
Alabama Street	Alabama St	Pub	**LS#16**	2	Sulzer	AFPK1049 M75/4	M75/5	3	230	10	26.1	1750	850	90	NA	NA	NA	NA	NA	PMP16B
SW 52nd Ave.	52nd Ave	Pub	**LS#17**	1	Gorman-Rupp	T6A3S-B/F	1760411	3	230	30	125	1350	1400	90	NA	NA	NA	NA	NA	PMP17A
SW 52nd Ave.	52rd Ave	Pub	**LS#17**	2	Gorman-Rupp	T6A3S-B/F	1760411	3	230	30	125	1350	1400	90	NA	NA	NA	NA	NA	PMP17B
Holiday RV Park	Holliday Park Ave	Pub	**LS#18**	1	ABS	S10/4W.02 06087144	00318852	1	230	1.3	6.5	1700	36	32	NA	NA	NA	NA	NA	PMP18A
Holiday RV Park	Holliday Park Ave	Pub	**LS#18**	2	ABS	S10/4W.02 06087144	00318852	1	230	1.3	6.5	1700	36	32	NA	NA	NA	NA	NA	PMP18B
Holiday RV Park	SW 6th St	Pub	**LS#18 A**	1	Hydromatic	S3HRC300M2-2	S00742073	1	230	3	17.9	3450	200	24	NA	4	85	9	UNITRON	PMP18A-A
Holiday RV Park	SW 6th St	Pub	**LS#18 A**	2	Hydromatic	S3HRC300M2-2	S00742074	1	230	3	17.9	3450	200	24	NA	4	85	9	UNITRON	PMP18A-A
Coca Cola	Pembroke Rd	Pub	**LS#19**	1	Sulzer	XFP15OG-CB1.7-PE185/4	2773859	3	460	24.8	32.7	1750	1500	95	NA	NA	880	58	SULZER	PMP-19A
Coca Cola	Pembroke Rd	Pub	**LS#19**	2	ABS	AFPK1547 ME185/4	22166	3	460	24.8	32.7	1750	1500	95	NA	NA	880	58	SULZER	PMP-19B
removed	removed		**LS#20**	1		Does not exist														
removed	removed		**LS#20**	2		Does not exist														
removed	removed		**LS#21**	1		Old Master LS DOES NOT EXIST														
removed	removed		**LS#21**	2		Old Master LS DOES NOT EXIST														
Lakeview Park	1st St.	Pub	**LS#22**	1	Sulzer	XFP-PE2-100E-CB1.4-PE75_4E-FM	300357575	3	230	10	20	1762	450	85	NA	0.217	175	60	SULZER	PMP-22A
Lakeview Park	1st St.	Pub	**LS#22**	2	Sulzer	XFP-P2-100E-CB1.4-PE75_4E-FM	300698704	3	230	10	20	1762	450	85	NA	0.217	175	60	SULZER	PMP-22B
SW 30th Ave	SW 30th AVE	Pub	**LS#23**	1	ABS	AFPK1041.3M35/4e	92942	3	230	4.7	13.8	1780	700	44	NA	0.3	78	41	CHAMPION	PMP-23A
SW 30th Ave	SW 30th AVE	Pub	**LS#23**	2	ABS	AFPK1041.8M 35/4E	92942	3	230	4.7	13.8	1780	700	44	NA	0.3	78	41	CHAMPION	PMP-23B
Green Acres	7th St	Pub	**LS#24**	1	ABS	AFPK0841 M1.5/6EX	91275	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-24A
Green Acres	7th St	Pub	**LS#24**	2	ABS	AFPK0841M1.5/6EX	91276	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-24B

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Green Acres	4th St	Pub	**LS#25**	1	ABS	AFPK0841 M1.5/6	0891283	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-25A
Green Acres	4th St	Pub	**LS#25**	2	ABS	AFPK0841 M1.5/6	0891282	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-25B
Lakeview Park	5th St	Pub	**LS#26**	1	ABS	AFPK0841 M1.8/4EX	300466132	1	230	2.4	12.1	1750	560	28	8/17/2022	NA	63	12	CHAMPION	PMP-26A
Lakeview Park	6th St	Pub	**LS#26**	2	Sulzer	XFP-PE1-100C-C1.4-PE20-6C-FM	3055801	1	230	2.4	12.1	1750	560	23	8/18/2022	NA	63	12	CHAMPION	PMP-26B
removed	removed	NA	**LS#27**	1	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-27A
removed	removed	NA	**LS#27**	2	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-27B
removed	removed	NA	**LS#28**	1	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-28A
removed	removed	NA	**LS#28**	2	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-28B
Bamboo Park	24th St	Pub	**LS#29**	1	Sulzer	XFP-PE1-100C-CB1.4-PE20_6WC-FM	3135037	1	230	2.4	12	1146	471	23	2/27/2023	7.09	137	17	CHAMPION	PMP-29A
Bamboo Park	25th St	Pub	**LS#29**	2	Sulzer	XFP100C-1-CB1.4-PE20/6W.C.60FM	0030673	1	230	2.68	12	1146	471	23	NA	7.09	137	17	CHAMPION	PMP-29A
Bamboo Park	SW 30th CT	Pub	**LS#30**	1	ABS	AFP0831 M28/4W 60HZ	NA	3	240	2	9	NA	240	28	NA	NA	52	25	CHAMPION	PMP-30A
Bamboo Park	SW 30th Ct	Pub	**LS#30**	2	ABS	AFP0831 M28/4W 60HZ	NA	3	240	2	9	NA	240	28	NA	NA	52	25	CHAMPION	PMP-30B
SW 31st Ave	SW 31 St.	Pub	**LS#31**	1	ABS	AFPK1049.4-M75/IMP 228 mm	069195	3	480	10	26.1	NA	850	90	NA	NA	220	87	CHAMPION	PMP-30
SW 31st Ave	SW 31 St.	Pub	**LS#31**	2	SULZER	XFP100E-CB1-4a-PE75	NA	3	480	10	26.1	NA	700	120	NA	NA	325	87	CHAMPION	PMP-40B
John P Curcie	Irwin Lehmann Dr	Pub	**LS#32**	1	ABS	M35/4-12.60.03214991	0091247	3	208	4.7	15.1	1750	501	42.8	NA	NA	145	32	CHAMPION	PMP-26B
John P Curcie	Irwin Lehmann Dr	Pub	**LS#32**	2	ABS	M35/4-12.60.03214992	0091248	3	208	4.7	15.1	1750	501	42.8	NA	NA	145	32	CHAMPION	PMP-26B
SW 30th St.	SW 30th St.	Private	**LS#33**	1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-26B
SW 30th St.	SW 30th St.	Private	**LS#33**	2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-26B
Master Station 2800 Park Rd	Park Rd	Pub	**LS#34**	1	ABS	AFP1002ME350/4D	03574	3	480	41.5	55	1760	1500	190			975	106	CHAMPION	PMP-33A
Master Station 2800 Park Rd	Park Rd	Pub	**LS$34**	2	Sulzer	XFP-PE4-100J-CH1-PE350_4J-FM	300661886	3	460	46.9	55	1783	850	110			975	106	CHAMPION	PMP-34B

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Master Station 2800 Park Rd	Park Rd	Pub	**LS#34**	3	ABS	AFP1002ME350/4D	037575	3	480	41.5	55	1760	1500	190			975	106	CHAMPION	PMP-35C
PEMBROKE COMMERCE CENTER	PRIVATE	PUB	**LS#35**	3	EMU	FA10.33 238T 172-4/16	491894	3	230	10	28	1740	460	100			171	81	CC CONTROL	PMP-35A
PEMBROKE COMMERCE CENTER	PRIVATE	PUB	**LS#35**	3	EMU	FA10.33 238T 172-4/17	NA	3	230	10	28	1740	460	100			171	81	CC CONTROL	PMP-35B
Seneca	Senic Phase 3	Private	**LS#36**	1	WILO	FA10.51E	NA	3	230	8.5	18.7	1740	725	30			50	27	NA	PMP-36A
Seneca	Senic Phase 4	Private	**LS#36**	2	WILO	FA10.51E	NA	3	230	8.5	18.7	1740	725	30			50	27	NA	PMP-36B
SW 55th Ave	SW 55th St	Pub	**LS#37**	1	Sulzer	ABS PIRANHA S20/2	0400497	1	240	2	11.5	3400	43	109			50	27	CHAMPION	PMP-37A
SW 55th Ave	SW 55th St	Pub	**LS#37**	2	HOMA	GRP16/1	NA	1	230	1.6	8	3450	85	83			50	27	CHAMPION	PMP-37B
Senica Commerce Park	Senica Commerce Park	Pub	**LS#38**	1	FLYGT	FP 3085.183	NA	3	480	3	NA	1710	225	24			200	21	NA	PMP-38A
Senica Commerce Park	Senica Commerce Park	Pub	**LS#38**	2	FLYGT	FP 3085.184	NA	3	480	3	NA	1710	225	24			200	21	NA	PMP-38B
West Wind	SW 20th St	Private	**LS#39**	1	MYERS	WGX20-03	NA	1	220	2	NA	3450	70	130			28	26	NA	PMP-39A
West Wind	SW 20th St	Private	**LS#39**	2	MYERS	WGX20-03	NA	1	220	2	NA	3450	70	130			28	26	NA	PMP-39B
School	48th Street	Private	**LS#40**	1	EMU	FA-104	NA	3	230	7.5	NA	1740	600	100		238	139	86	NA	
School	49th Street	Private	**LS#40**	2	EMU	FA-105	NA	3	230	7.5	NA	1740	600	100		238	139	86	NA	
Service Station	SW 33 AVE	Private	**LS#41**	1	HYDromatic	SPGA GRINDER	NA	1	230	2		3500	105	135			50	105	NA	
Service Station	SW 33 AVE	Private	**LS#41**	2	HYDromatic	SPGA GRINDER	NA	1	230	2		3500	105	135			50	105	NA	
Marathon	55th AVE	Private	**LS#42**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Marathon	56th AVE	Private	**LS#42**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Bar-Club	SE56th/Hallendale Bch BLVD	Private	**LS#43**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Bar-Club	SE56th/Hallendale Bch BLVD	Private	**LS#43**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Dollar General	SW48th St Int Hallandale	Private	**LS#44**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Dollar General	SW48th St Int Hallandale	Private	**LS#44**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
APARTMENTS	3740 HALLANDALE BLVD	Private	**LS#45**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
APARTMENTS	3741 HALLANDALE BLVD	Private	**LS#46**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
TOWN REC CENTER	31ST PLACE	Private	**LS#47**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
TOWN REC CENTER	32nd PLACE	Private	**LS#48**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Dollar General	SW48th St Int Hallandale	Private	**LS#48**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	

EXHIBIT H
LETTER REQUEST FOR ADDITIONAL SEWER ALLOCATION

CRAIG A. SMITH & ASSOCIATES
A SMART-INFRASTRUCTURE COMPANY

December 11, 2023

The Town of Pembroke Park

Future Sewage Use Treatment Capacity Allocation

The Town of Pembroke Park has experienced significant growth in the last decade. Due to this growth, and projected future growth, it is in the best interest of the Town to seek additional sewage allocation above the existing allocation of 1.11 Million gallons per day as per the Large Users Agreement with the City of Hollywood. The current and projected flows are computed utilizing an analysis of the town code 13.5-52 wastewater treatment loads and the current Official Zoning Map in conjunction with the Southern Regional Wastewater Treatment Plant Large User Capacity Report.

Current Flow Projections as per Zoning:

- T-1 Trailer Park (16 units/acre) (313acres) (90 Gal/Acre) : 450,720 GPD
- RM-25 Medium High Density Multiple-Family Residential (5 Acres) (25 units/acre) (225 Gal/unit) : 28,125 GPD
- RM-16 Medium Density Multiple-Family Residential (107 Acres) (16 units/acre) (225 Gal/unit): 385,200 GPD
- Industrial (40% lot occupation) (0.1 Gal/SF) (6,324,910 SF): 632,491 GPD
- Restaurants (500 seats)(33 Gal/seat): 16,500 GPD
- Clubs (300 seats)(18 Gal/seat): 5,400 GPD
- Service Stations (94 Pumps) (90 Gal/pump): 8,460 GPD
- Laundry Mats (48 washing machines) (360 Gal per Machine): 17,280 GPD
- Churches (300 seats) (3 Gal/seat): 3,000 GPD
- Schools (2000 Students) (18/student): 36,000 GPD
- Senior Facility (300 Beds) (90 Gal/bed): 27,000 GPD
- Retail (140 acres of which 100 acres General Retail is utilized not including prior listed Retail i.e. clubs, restaurants..) (0.1 Gal/SF): 175,000 Gal/Day

The current total wastewater usage based on said analysis: 1,785,176 GPD

Future Projections:

- If half the T-1 units were to rezone from T-1 to RM-25 and additional 550,000 Gal/Day will need to be allocated to the town to service this growth.

Future Wastewater Usage based on said analysis: 2335176 GPD.

Based on this analysis the Town of Pembroke Park should seek additional Sewage Treatment Capacity Allocations.

Sincerely,

Daniel E. Shonk

Daniel Eugene Shonk P.E.




954. 782.8222
1425 E. Newport Center Drive
Deerfield Beach. FL: 33442

EXHIBIT I
2025 TOWN ATLAS

UPDATED WASTEWATER
MASTER PLAN ATLAS

LOCATION MAP

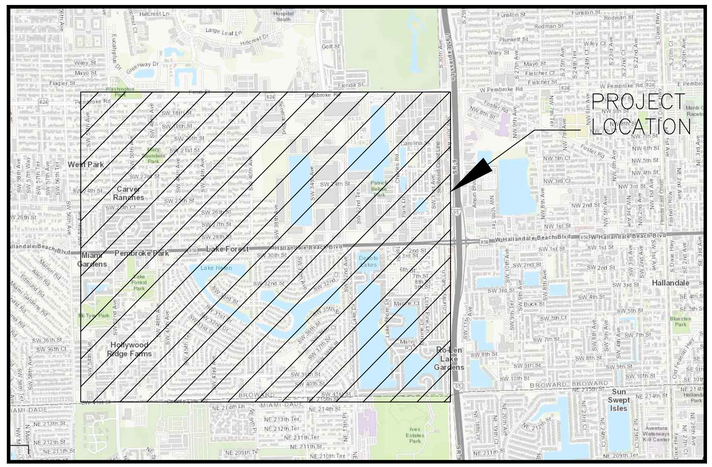

TOWN OF PEMBROKE PARK
FLORIDA
The Small Town that Means Big Business

BOARD OF COMMISSIONERS	
MAYOR	MAYOR ASHIRA MOHAMMED, DISTRICT 5
VICE MAYOR	ERIK MORRISSETTE, DISTRICT 1
CLERK COMMISSIONER	WILLIAM R. HODGKINS, DISTRICT 2
ACTING CLERK COMMISSIONER	MUSFIKA KASHEM, DISTRICT 4
COMMISSIONER	GEOFFREY JACOBS, DISTRICT 3

SHEET INDEX

NUMBER / SHEET		DESCRIPTION
01	C-01	COVER SHEET
02	C-02	KEY SHEET & SITE PLAN
03 - 14	C-03 - C-14	MASTER PLAN ATLAS

PREPARED FOR:


TOWN OF PEMBROKE PARK

PROJECT No. 08-22-025

CRAIG A. SMITH & ASSOCIATES
CONSULTING ENGINEERS-PLANNERS-SURVEYORS
21045 COMMERCIAL TRAIL - BOCA RATON, FLORIDA 33486
(561) 314-4445 WWW.CRAIGASMITH.COM
CERTIFICATE OF AUTHORIZATION NUMBER: LB0003110

FILE NAME: 08-22-025-C-01-COVER.dwg

F:\Jobs_X\Town_Town\Patricia_Fun\08-22-025\Wastewater\Plan\PLAN\01-08-22-025-C-01-COVER.dwg, 12/10/2024 8:52:45 AM, steve_li

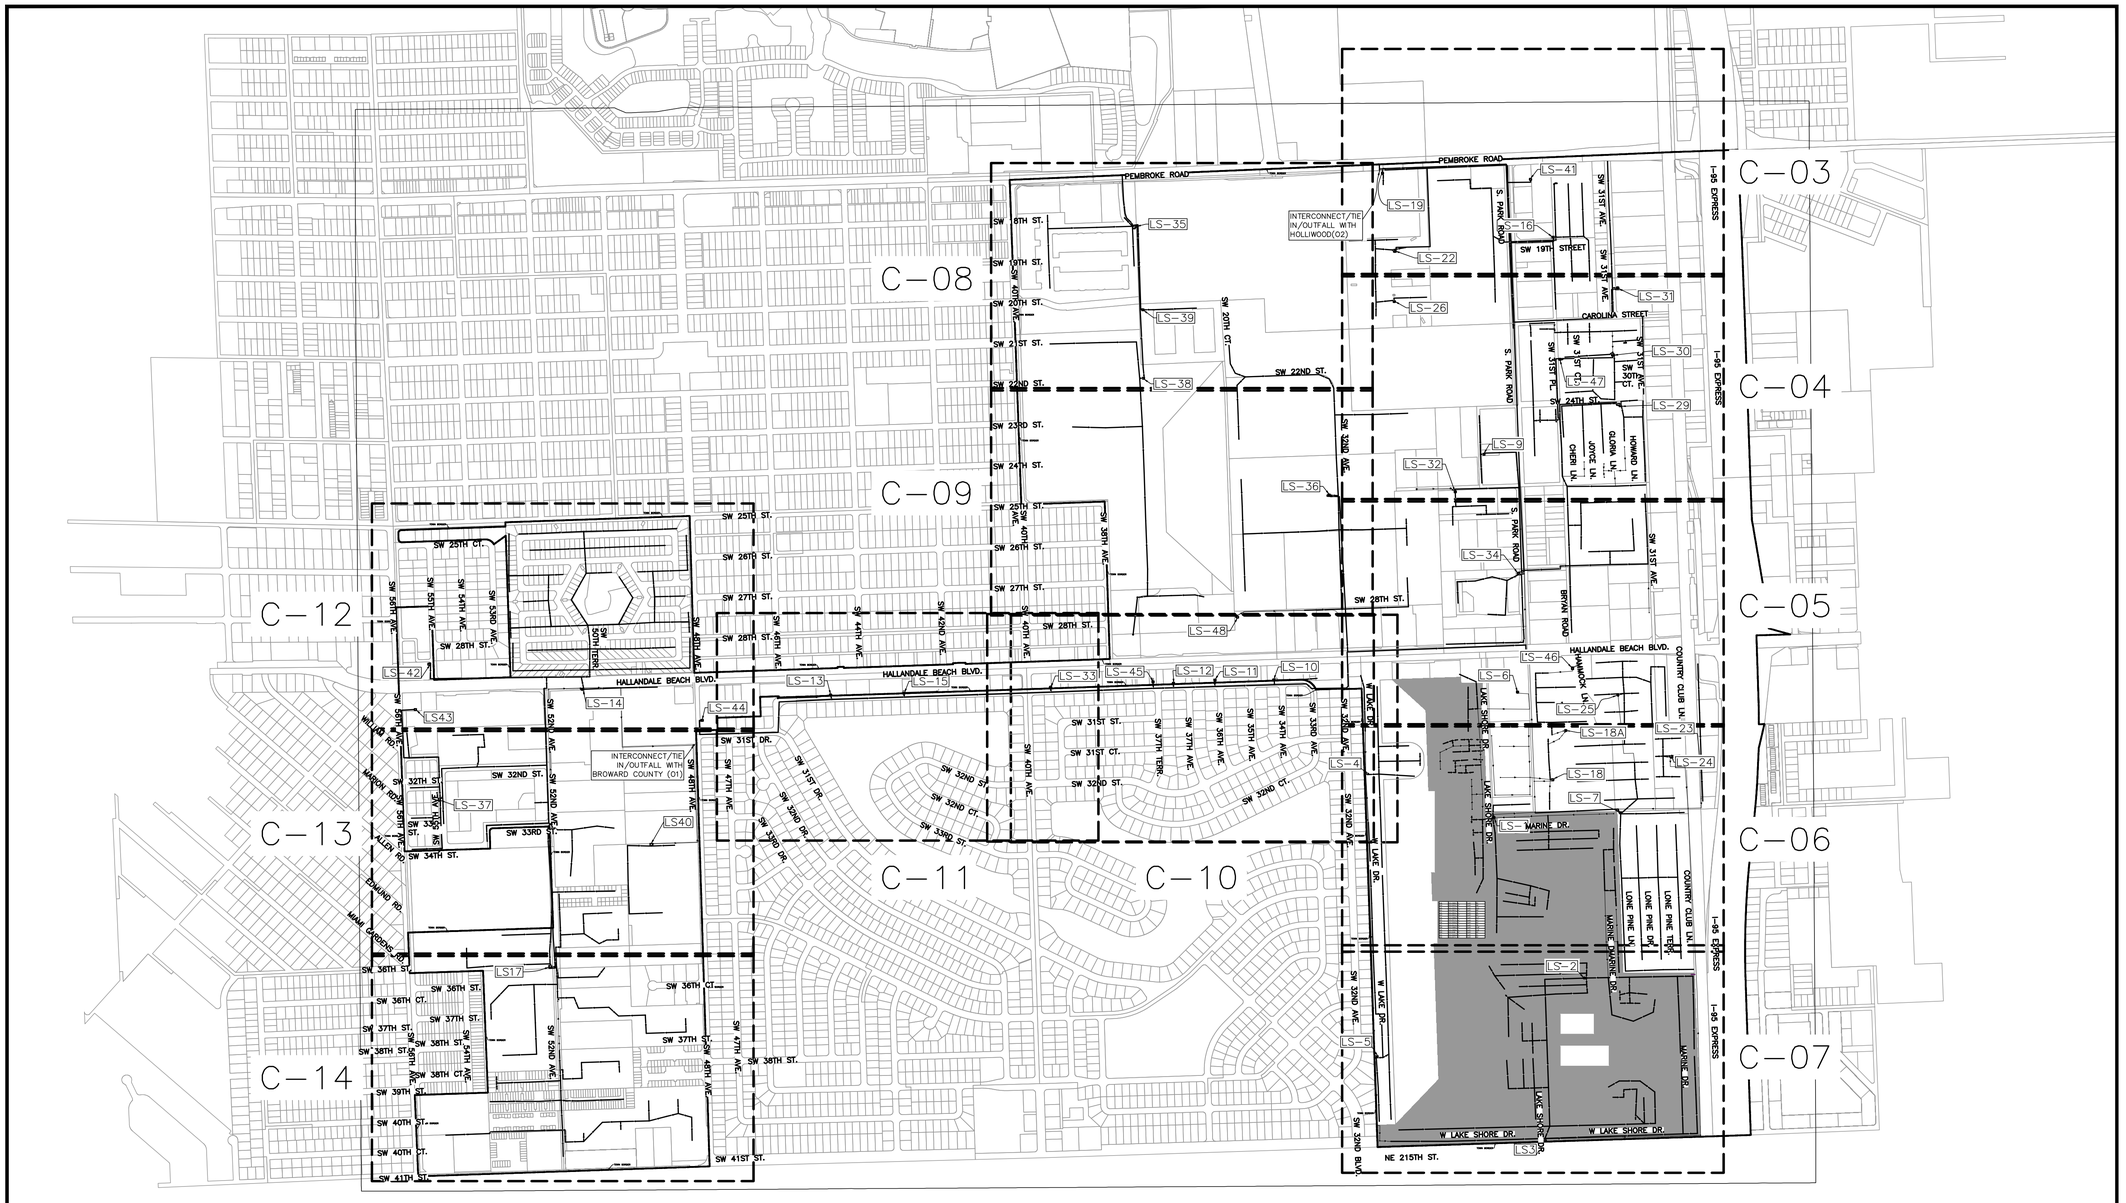

PROJECT NUMBER
08-22-025
02 OF 14

NOTE: OBJECTS IN THIS ATLAS WERE POSITIONED HORIZONTAL AND VERTICALLY REFERENCING: LABINS AERIAL, ASBUILT PLANS, CONSTRUCTION PLANS, COPIES OF PROPOSED PLANS, NOAA & LABINS LIDAR, PRIOR TOWN ATLAS, LINEAR INTERPOLATION, AND COUNTY PROPERTY APPRAISER SHAPE FILES.

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

KEY SHEET

P:\Jobs_Share_Open\Patrick_Carl\08-22-025-PEMBwwMasterPlan\PLANS\08-22-025-C02-KEYsheet.dwg, 12/5/2024 9:33:59 AM, steve.li



BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88

ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
03 OF 14

LEGEND:

-1.7 ———	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1


UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE



SEE SHEET C-03 FOR CONTINUATION

SEE SHEET C-08 FOR CONTINUATION

SEE SHEET C-09 FOR CONTINUATION

SEE SHEET C-05 FOR CONTINUATION

LS-26

LS-31

LS-30

LS-47

LS-29

LS-9

LS-32

CAROLINA STREET

S. PARK ROAD

I-95 EXPRESS

SW 31ST CT.

SW 31ST PL.

SW 31ST AVE.

SW 30TH CT.

SW 24TH ST.

SW 25TH ST.

SW 32ND AVE.

CHERI LN.

JOYCE LN.

GLORIA LN.

HOWARD LN.

SEE TABLE FOR INFO

OWNER REPLACED ALL 4"&6" VCP WITH 8" PVC IN BAMBOO PARADISE

GRAVITY PIPE TABLE

NUMBER	NAME	PIPE SIZE	MATERIAL	PIPE LENGTH
S1	02L34SA12	8"	CLAY	39'
S2	02L34SQ1	4"	CLAY	89'
S3	02L34SP1	4"	CLAY	14'
S4	02L34SA13	8"	CLAY	126'
S5	02L34SS1	4"	CLAY	86'
S6	02L34SR1	4"	CLAY	16'
S7	02L34SA14	8"	CLAY	50'

SEWER MANHOLE TABLE

NUMBER	NAME	INVERT ELEVATION
M1	M34A11	1.5'
M2	M34A12	1.7'
M3	M34Q1	3.8'
M4	M34P1	4.0'
M5	M34A13	2.1'
M6	M34S1	3.8'
M7	M34R1	3.0'
M8	M34A14	2.3'

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88

ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
04 OF 14

LEGEND:

-1.7 —— INVERT ELEVATION NAVD88

M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH

01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2

01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2

02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

FORCE MAIN PIPE

GRAVITY SEWER PIPE

GRAVITY SEWER MANHOLE

LIFT STATION WETWELL

PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP: C-03, C-04, C-05, C-06, C-07, C-08, C-09, C-10, C-11, C-12, C-13, C-14

SEE SHEET C-04 FOR CONTINUATION

SEE SHEET C-09 FOR CONTINUATION

SEE SHEET C-10 FOR CONTINUATION

SEE SHEET C-05 FOR CONTINUATION

SW 32ND AVE.

SW 28TH ST.

SW 27TH ST.

SW 31ST AVE.

S. PARK ROAD

BRYAN ROAD

HAMMOCK LN.

COUNTRY CLUB LN.

LAKE SHORE DR.

W LAKE DR.

HALLANDALE BEACH BLVD.

TOWN BORDER

LS-34

LS-46

LS-6

LS-25

188 LF 8" PVC 02L36SD1 M36D1 230 LF 8" N/A 02L36SD2 M36D2 76 LF 8" PVC 02L36SD3 M36D3 139 LF 8" PVC 02L36SF1 M36F1

1394 LF 4" DIP 02L36F4

188 LF 8" PVC 02L36SB4 M36B4 346 LF 8" PVC 02L36SB5 M36B5 M36B3 236 LF 8" PVC 02L36SB6 M36B6

295 LF 8" DIP 02L10F1

100 LF 6" CLAY 02L45SC3 M4G3 M4G2 359 LF 6" CLAY 02L45S2 491 LF 6" CLAY 02L45A6 M4A6

243 LF 8" PVC 02L32SB2 M32A1 M32C1 M32C2 73 LF 8" PVC 02L32SA3 M32A2 179 LF 8" PVC 02L32SA4 M32A4 M32A3 M32D1 27 LF 8" PVC 02L32SC1 78 LF 8" PVC 02L32SD1 151 LF 6" PVC 02L32SC2 681 LF 4" DIP 02L32F1 2007 LF 8" PVC 02L34F5

02L34F6 46 LF 8" DIP

02L34J6

29 LF 12" N/A 02L34SA1 114 LF 8" PVC 02L34SB1 M34A3 307 LF 8" PVC 02L34SA4 M34A4 26 LF 8" PVC 02L34SA3 02L34J5 02L34BYPASS 15 LF INACTIVE BYE-PASS 8" DIP 02L36J1

139 LF 8" PVC 02L34SB3 123 LF 8" PVC 02L34SB2 146 LF 8" PVC 02L34SB4 M34B4 M34B3 M34B2 M34B1 02L36F1 48 LF 8" DIP 16 LF 12" DIP 02L34SA2 M34A2 M34A1 M32A5 M32A6 M32A7 M32A8 M32A9 M32A10 M32A11 M32A12 M32A13 M32A14 M32A15 M32A16 M32A17 M32A18 M32A19 M32A20 M32A21 M32A22 M32A23 M32A24 M32A25 M32A26 M32A27 M32A28 M32A29 M32A30 M32A31 M32A32 M32A33 M32A34 M32A35 M32A36 M32A37 M32A38 M32A39 M32A40 M32A41 M32A42 M32A43 M32A44 M32A45 M32A46 M32A47 M32A48 M32A49 M32A50 M32A51 M32A52 M32A53 M32A54 M32A55 M32A56 M32A57 M32A58 M32A59 M32A60 M32A61 M32A62 M32A63 M32A64 M32A65 M32A66 M32A67 M32A68 M32A69 M32A70 M32A71 M32A72 M32A73 M32A74 M32A75 M32A76 M32A77 M32A78 M32A79 M32A80 M32A81 M32A82 M32A83 M32A84 M32A85 M32A86 M32A87 M32A88 M32A89 M32A90 M32A91 M32A92 M32A93 M32A94 M32A95 M32A96 M32A97 M32A98 M32A99 M32A100 M32A101 M32A102 M32A103 M32A104 M32A105 M32A106 M32A107 M32A108 M32A109 M32A110 M32A111 M32A112 M32A113 M32A114 M32A115 M32A116 M32A117 M32A118 M32A119 M32A120 M32A121 M32A122 M32A123 M32A124 M32A125 M32A126 M32A127 M32A128 M32A129 M32A130 M32A131 M32A132 M32A133 M32A134 M32A135 M32A136 M32A137 M32A138 M32A139 M32A140 M32A141 M32A142 M32A143 M32A144 M32A145 M32A146 M32A147 M32A148 M32A149 M32A150 M32A151 M32A152 M32A153 M32A154 M32A155 M32A156 M32A157 M32A158 M32A159 M32A160 M32A161 M32A162 M32A163 M32A164 M32A165 M32A166 M32A167 M32A168 M32A169 M32A170 M32A171 M32A172 M32A173 M32A174 M32A175 M32A176 M32A177 M32A178 M32A179 M32A180 M32A181 M32A182 M32A183 M32A184 M32A185 M32A186 M32A187 M32A188 M32A189 M32A190 M32A191 M32A192 M32A193 M32A194 M32A195 M32A196 M32A197 M32A198 M32A199 M32A200 M32A201 M32A202 M32A203 M32A204 M32A205 M32A206 M32A207 M32A208 M32A209 M32A210 M32A211 M32A212 M32A213 M32A214 M32A215 M32A216 M32A217 M32A218 M32A219 M32A220 M32A221 M32A222 M32A223 M32A224 M32A225 M32A226 M32A227 M32A228 M32A229 M32A230 M32A231 M32A232 M32A233 M32A234 M32A235 M32A236 M32A237 M32A238 M32A239 M32A240 M32A241 M32A242 M32A243 M32A244 M32A245 M32A246 M32A247 M32A248 M32A249 M32A250 M32A251 M32A252 M32A253 M32A254 M32A255 M32A256 M32A257 M32A258 M32A259 M32A260 M32A261 M32A262 M32A263 M32A264 M32A265 M32A266 M32A267 M32A268 M32A269 M32A270 M32A271 M32A272 M32A273 M32A274 M32A275 M32A276 M32A277 M32A278 M32A279 M32A280 M32A281 M32A282 M32A283 M32A284 M32A285 M32A286 M32A287 M32A288 M32A289 M32A290 M32A291 M32A292 M32A293 M32A294 M32A295 M32A296 M32A297 M32A298 M32A299 M32A300 M32A301 M32A302 M32A303 M32A304 M32A305 M32A306 M32A307 M32A308 M32A309 M32A310 M32A311 M32A312 M32A313 M32A314 M32A315 M32A316 M32A317 M32A318 M32A319 M32A320 M32A321 M32A322 M32A323 M32A324 M32A325 M32A326 M32A327 M32A328 M32A329 M32A330 M32A331 M32A332 M32A333 M32A334 M32A335 M32A336 M32A337 M32A338 M32A339 M32A340 M32A341 M32A342 M32A343 M32A344 M32A345 M32A346 M32A347 M32A348 M32A349 M32A350 M32A351 M32A352 M32A353 M32A354 M32A355 M32A356 M32A357 M32A358 M32A359 M32A360 M32A361 M32A362 M32A363 M32A364 M32A365 M32A366 M32A367 M32A368 M32A369 M32A370 M32A371 M32A372 M32A373 M32A374 M32A375 M32A376 M32A377 M32A378 M32A379 M32A380 M32A381 M32A382 M32A383 M32A384 M32A385 M32A386 M32A387 M32A388 M32A389 M32A390 M32A391 M32A392 M32A393 M32A394 M32A395 M32A396 M32A397 M32A398 M32A399 M32A400 M32A401 M32A402 M32A403 M32A404 M32A405 M32A406 M32A407 M32A408 M32A409 M32A410 M32A411 M32A412 M32A413 M32A414 M32A415 M32A416 M32A417 M32A418 M32A419 M32A420 M32A421 M32A422 M32A423 M32A424 M32A425 M32A426 M32A427 M32A428 M32A429 M32A430 M32A431 M32A432 M32A433 M32A434 M32A435 M32A436 M32A437 M32A438 M32A439 M32A440 M32A441 M32A442 M32A443 M32A444 M32A445 M32A446 M32A447 M32A448 M32A449 M32A450 M32A451 M32A452 M32A453 M32A454 M32A455 M32A456 M32A457 M32A458 M32A459 M32A460 M32A461 M32A462 M32A463 M32A464 M32A465 M32A466 M32A467 M32A468 M32A469 M32A470 M32A471 M32A472 M32A473 M32A474 M32A475 M32A476 M32A477 M32A478 M32A479 M32A480 M32A481 M32A482 M32A483 M32A484 M32A485 M32A486 M32A487 M32A488 M32A489 M32A490 M32A491 M32A492 M32A493 M32A494 M32A495 M32A496 M32A497 M32A498 M32A499 M32A500 M32A501 M32A502 M32A503 M32A504 M32A505 M32A506 M32A507 M32A508 M32A509 M32A510 M32A511 M32A512 M32A513 M32A514 M32A515 M32A516 M32A517 M32A518 M32A519 M32A520 M32A521 M32A522 M32A523 M32A524 M32A525 M32A526 M32A527 M32A528 M32A529 M32A530 M32A531 M32A532 M32A533 M32A534 M32A535 M32A536 M32A537 M32A538 M32A539 M32A540 M32A541 M32A542 M32A543 M32A544 M32A545 M32A546 M32A547 M32A548 M32A549 M32A550 M32A551 M32A552 M32A553 M32A554 M32A555 M32A556 M32A557 M32A558 M32A559 M32A560 M32A561 M32A562 M32A563 M32A564 M32A565 M32A566 M32A567 M32A568 M32A569 M32A570 M32A571 M32A572 M32A573 M32A574 M32A575 M32A576 M32A577 M32A578 M32A579 M32A580 M32A581 M32A582 M32A583 M32A584 M32A585 M32A586 M32A587 M32A588 M32A589 M32A590 M32A591 M32A592 M32A593 M32A594 M32A595 M32A596 M32A597 M32A598 M32A599 M32A600 M32A601 M32A602 M32A603 M32A604 M32A605 M32A606 M32A607 M32A608 M32A609 M32A610 M32A611 M32A612 M32A613 M32A614 M32A615 M32A616 M32A617 M32A618 M32A619 M32A620 M32A621 M32A622 M32A623 M32A624 M32A625 M32A626 M32A627 M32A628 M32A629 M32A630 M32A631 M32A632 M32A633 M32A634 M32A635 M32A636 M32A637 M32A638 M32A639 M32A640 M32A641 M32A642 M32A643 M32A644 M32A645 M32A646 M32A647 M32A648 M32A649 M32A650 M32A651 M32A652 M32A653 M32A654 M32A655 M32A656 M32A657 M32A658 M32A659 M32A660 M32A661 M32A662 M32A663 M32A664 M32A665 M32A666 M32A667 M32A668 M32A669 M32A670 M32A671 M32A672 M32A673 M32A674 M32A675 M32A676 M32A677 M32A678 M32A679 M32A680 M32A681 M32A682 M32A683 M32A684 M32A685 M32A686 M32A687 M32A688 M32A689 M32A690 M32A691 M32A692 M32A693 M32A694 M32A695 M32A696 M32A697 M32A698 M32A699 M32A700 M32A701 M32A702 M32A703 M32A704 M32A705 M32A706 M32A707 M32A708 M32A709 M32A710 M32A711 M32A712 M32A713 M32A714 M32A715 M32A716 M32A717 M32A718 M32A719 M32A720 M32A721 M32A722 M32A723 M32A724 M32A725 M32A726 M32A727 M32A728 M32A729 M32A730 M32A731 M32A732 M32A733 M32A734 M32A735 M32A736 M32A737 M32A738 M32A739 M32A740 M32A741 M32A742 M32A743 M32A744 M32A745 M32A746 M32A747 M32A748 M32A749 M32A750 M32A751 M32A752 M32A753 M32A754 M32A755 M32A756 M32A757 M32A758 M32A759 M32A760 M32A761 M32A762 M32A763 M32A764 M32A765 M32A766 M32A767 M32A768 M32A769 M32A770 M32A771 M32A772 M32A773 M32A774 M32A775 M32A776 M32A777 M32A778 M32A779 M32A780 M32A781 M32A782 M32A783 M32A784 M32A785 M32A786 M32A787 M32A788 M32A789 M32A790 M32A791 M32A792 M32A793 M32A794 M32A795 M32A796 M32A797 M32A798 M32A799 M32A800 M32A801 M32A802 M32A803 M32A804 M32A805 M32A806 M32A807 M32A808 M32A809 M32A810 M32A811 M32A812 M32A813 M32A814 M32A815 M32A816 M32A817 M32A818 M32A819 M32A820 M32A821 M32A822 M32A823 M32A824 M32A825 M32A826 M32A827 M32A828 M32A829 M32A830 M32A831 M32A832 M32A833 M32A834 M32A835 M32A836 M32A837 M32A838 M32A839 M32A840 M32A841 M32A842 M32A843 M32A844 M32A845 M32A846 M32A847 M32A848 M32A849 M32A850 M32A851 M32A852 M32A853 M32A854 M32A855 M32A856 M32A857 M32A858 M32A859 M32A860 M32A861 M32A862 M32A863 M32A864 M32A865 M32A866 M32A867 M32A868 M32A869 M32A870 M32A871 M32A872 M32A873 M32A874 M32A875 M32A876 M32A877 M32A878 M32A879 M32A880 M32A881 M32A882 M32A883 M32A884 M32A885 M32A886 M32A887 M32A888 M32A889 M32A890 M32A891 M32A892 M32A893 M32A894 M32A895 M32A896 M32A897 M32A898 M32A899 M32A900 M32A901 M32A902 M32A903 M32A904 M32A905 M32A906 M32A907 M32A908 M32A909 M32A910 M32A911 M32A912 M32A913 M32A914 M32A915 M32A916 M32A917 M32A918 M32A919 M32A920 M32A921 M32A922 M32A923 M32A924 M32A925 M32A926 M32A927 M32A928 M32A929 M32A930 M32A931 M32A932 M32A933 M32A934 M32A935 M32A936 M32A937 M32A938 M32A939 M32A940 M32A941 M32A942 M32A943 M32A944 M32A945 M32A946 M32A947 M32A948 M32A949 M32A950 M32A951 M32A952 M32A953 M32A954 M32A955 M32A956 M32A957 M32A958 M32A959 M32A960 M32A961 M32A962 M32A963 M32A964 M32A965 M32A966 M32A967 M32A968 M32A969 M32A970 M32A971 M32A972 M32A973 M32A974 M32A975 M32A976 M32A977 M32A978 M32A979 M32A980 M32A981 M32A982 M32A983 M32A984 M32A985 M32A986 M32A987 M32A988 M32A989 M32A990 M32A991 M32A992 M32A993 M32A994 M32A995 M32A996 M32A997 M32A998 M32A999 M32A1000 M32A1001 M32A1002 M32A1003 M32A1004 M32A1005 M32A1006 M32A1007 M32A1008 M32A1009 M32A1010 M32A1011 M32A1012 M32A1013 M32A1014 M32A1015 M32A1016 M32A1017 M32A1018 M32A1019 M32A1020 M32A1021 M32A1022 M32A1023 M32A1024 M32A1025 M32A1026 M32A1027 M32A1028 M32A1029 M32A1030 M32A1031 M32A1032 M32A1033 M32A1034 M32A1035 M32A1036 M32A1037 M32A1038 M32A1039 M32A1040 M32A1041 M32A1042 M32A1043 M32A1044 M32A1045 M32A1046 M32A1047 M32A1048 M32A1049 M32A1050 M32A1051 M32A1052 M32A1053 M32A1054 M32A1055 M32A1056 M32A1057 M32A1058 M32A1059 M32A1060 M32A1061 M32A1062 M32A1063 M32A1064 M32A1065 M32A1066 M32A1067 M32A1068 M32A1069 M32A1070 M32A1071 M32A1072 M32A1073 M32A1074 M32A1075 M32A1076 M32A1077 M32A1078 M32A1079 M32A1080 M32A1081 M32A1082 M32A1083 M32A1084 M32A1085 M32A1086 M32A1087 M32A1088 M32A1089 M32A1090 M32A1091 M32A1092 M32A1093 M32A1094 M32A1095 M32A1096 M32A1097 M32A1098 M32A1099 M32A1100 M32A1101 M32A1102 M32A1103 M32A1104 M32A1105 M32A1106 M32A1107 M32A1108 M32A1109 M32A1110 M32A1111 M32A1112 M32A1113 M32A1114 M32A1115 M32A1116 M32A1117 M32A1118 M32A1119 M32A1120 M32A1121 M32A1122 M32A1123 M32A1124 M32A1125 M32A1126 M32A1127 M32A1128 M32A1129 M32A1130 M32A1131 M32A1132 M32A1133 M32A1134 M32A1135 M32A1136 M32A1137 M32A1138 M32A1139 M32A1140 M32A1141 M32A1142 M32A1143 M32A1144 M32A1145 M32A1146 M32A1147 M32A1148 M32A1149 M32A1150 M32A1151 M32A1152 M32A1153 M32A1154 M32A1155 M32A1156 M32A1157 M32A1158 M32A1159 M32A1160 M32A1161 M32A1162 M32A1163 M32A1164 M32A1165 M32A1166 M32A1167 M32A1168 M32A1169 M32A1170 M32A1171 M32A1172 M32A1173 M32A1174 M32A1175 M32A1176 M32A1177 M32A1178 M32A1179 M32A1180 M32A1181 M32A1182 M32A1183 M32A1184 M32A1185 M32A1186 M32A1187 M32A1188 M32A1189 M32A1190 M32A1191 M32A1192 M32A1193 M32A1194 M32A1195 M32A1196 M32A1197 M32A1198 M32A1199 M32A1200 M32A1201 M32A1202 M32A1203 M32A1204 M32A1205 M32A1206 M32A1207 M32A1208 M32A1209 M32A1210 M32A1211 M32A1212 M32A1213 M32A1214 M32A1215 M32A1216 M32A1217 M32A1218 M32A1219 M32A1220 M32A1221 M32A1222 M32A1223 M32A1224 M32A1225 M32A1226 M32A1227 M32A1228 M32A1229 M32A1230 M32A1231 M32A1232 M32A1233 M32A1234 M32A1235 M32A1236 M32A1237 M32A1238 M32A1239 M32A1240 M32A1241 M32A1242 M32A1243 M32A1244 M32A1245 M32A1246 M32A1247 M32A1248 M32A1249 M32A1250 M32A1251 M32A1252 M32A1253 M32A1254 M32A1255 M32A1256 M32A1257 M32A1258 M32A1259 M32A1260 M32A1261 M32A1262 M32A1263 M32A1264 M32A1265 M32A1266 M32A1267 M32A1268 M32A1269 M32A1270 M32A1271 M32A1272 M32A1273 M32A1274 M32A1275 M32A1276 M32A1277 M32A1278 M32A1279 M32A1280 M32A1281 M32A1282 M32A1283 M32A1284 M32A1285 M32A1286 M32A1287 M32A1288 M32A1289 M32A1290 M32A1291 M32A1292 M32A1293 M32A1294 M32A1295 M32A1296 M32A1297 M32A1298 M32A1299 M32A1300 M32A1301 M32A1302 M32A1303 M32A1304 M32A1305 M32A1306 M32A1307 M32A1308 M32A1309 M32A1310 M32A1311 M32A1312 M32A1313 M32A1314 M32A1315 M32A1316 M32A1317 M32A1318 M32A1319 M32A1320 M32A1321 M32A1322 M32A1323 M32A1324 M32A1325 M32A1326 M32A1327 M32A1328 M32A1329 M32A1330 M32A1331 M32A1332 M32A1333 M32A1334 M32A1335 M32A1336 M32A1337 M32A1338 M32A1339 M32A1340 M32A1341 M32A1342 M32A1343 M32A1344 M32A1345 M32A1346 M32A1347 M32A1348 M32A1349 M32A1350 M32A1351 M32A1352 M32A1353 M32A1354 M32A1355 M32A1356 M32A1357 M32A1358 M32A1359 M32A1360 M32A1361 M32A1362 M32A1363 M32A1364 M32A1365 M32A1366 M32A1367 M32A1368 M32A1369 M32A1370 M32A1371 M32A1372 M32A1373 M32A1374 M32A1375 M32A1376 M32A1377 M32A1378 M32A1379 M32A1380 M32A1381 M32A1382 M32A1383 M32A1384 M32A1385 M32A1386 M32A1387 M32A1388 M32A1389 M32A1390 M32A1391 M32A1392 M32A1393 M32A1394 M32A1395 M32A1396 M32A1397 M32A1398 M32A1399 M32A1400 M32A1401 M32A1402 M32A1403 M32A1404 M32A1405 M32A1406 M32A1407 M32A1408 M32A1409 M32A1410 M32A1411 M32A1412 M32A1413 M32A1414 M32A1415 M32A1416 M32A1417 M32A1418 M32A1419 M32A1420 M32A1421 M32A1422 M32A1423 M32A1424 M32A1425 M32A1426 M32A1427 M32A1428 M32A1429 M32A1430 M32A1431 M32A1432 M32A1433 M32A1434 M32A1435 M32A1436 M32A1437 M32A1438 M32A1439 M32A1440 M32A1441 M32A1442 M32A1443 M32A1444 M32A1445 M32A1446 M32A1447 M32A1448 M32A1449 M32A1450 M32A1451 M32A1452 M32A1453 M32A1454 M32A1455 M32A1456 M32A1457 M32A1458 M32A1459 M32A1460 M32A1461 M32A1462 M32A1463 M32A1464 M32A1465 M32A1466 M32A1467 M32A1468 M32A1469 M32A1470 M32A1471 M32A1472 M32A1473 M32A1474 M32A1475 M32A1476 M32A1477 M32A1478 M32A1479 M32A1480 M32A1481 M32A1482 M32A1483 M32A1484 M32A1485 M32A1486 M32A1487 M32A1488 M32A1489 M32A1490 M32A1491 M32A1492 M32A1493 M32A1494 M32A1495 M32A1496 M32A1497 M32A1498 M32A1499 M32A1500 M32A1501 M32A1502 M32A1503 M32A1504 M32A1505 M32A1506 M32A1507 M32A1508 M32A1509 M32A1510 M32A1511 M32A1512 M32A1513 M32A1514 M32A1515 M32A1516 M32A1517 M32A1518 M32A1519 M32A1520 M32A1521 M32A1522 M32A1523 M32A1524 M32A1525 M32A1526 M32A1527 M32A1528 M32A1529 M32A1530 M32A1531 M32A1532 M32A1533 M32A1534 M32A1535 M32A1536 M32A1537 M32A1538 M32A1539 M32A1540 M32A1541 M32A1542 M32A1543 M32A1544 M32A1545 M32A1546 M32A1547 M32A1548 M32A1549 M32A1550 M32A1551 M32A1552 M32A1553 M32A1554 M32A1555 M32A1556 M32A1557 M32A1558 M32A1559 M32A1560 M32A1561 M32A1562 M32A1563 M32A1564 M32A1565 M32A1566 M32A1567 M32A1568 M32A1569 M32A1570 M32A1571 M32A1572 M32A1573 M32A1574 M32A1575 M32A1576 M32A1577 M32A1578 M32A1579 M32A1580 M32A1581 M32A1582 M32A1583 M32A1584 M32A1585 M32A1586 M32A1587 M32A1588 M32A1589 M32A1590 M32A1591 M32A1592 M32A1593 M32A1594 M32A1595 M32A1596 M32A1597 M32A1598 M32A1599 M32A1600 M32A1601 M32A1602 M32A1603 M32A1604 M32A1605 M32A1606 M32A1607 M32A1608 M32A1609 M32A1610 M32A1611 M32A1612 M32A1613 M32A1614 M32A1615 M32A1616 M32A1617 M32A1618 M32A1619 M32A1620 M32A1621 M32A1622 M32A1623 M32A1624 M32A1625 M32A1626 M32A1627 M32A1628 M32A1629 M32A1630 M32A1631 M32A1632 M32A1633 M32A1634 M32A1635 M32A1636 M32A1637 M32A1638 M32A1639 M32A1640 M32A1641 M32A1642 M32A1643 M32A1644 M32A1645 M32A1646 M32A1647 M32A1648 M32A1649 M32A1650 M32A1651 M32A1652 M32A1653 M32A1654 M32A1655 M32A1656 M32A1657 M32A1658 M32A1659 M32A1660 M32A1661 M32A1662 M32A1663 M32A1664 M32A1665 M32A1666 M32A1667 M32A1668 M32A1669 M32A1670 M32A1671 M32A1672 M32A1673 M32A1674 M32A1675 M32A1676 M32A1677 M32A1678 M32A1679 M32A1680 M32A1681 M32A1682 M32A1683 M32A1684 M32A1685 M32A1686 M32A1687 M32A1688 M32A1689 M32A1690 M32A1691 M32A1692 M32A1693 M32A1694 M32A1695 M32A1696 M32A1697 M32A1698 M32A1699 M32A1700 M32A1701 M32A1702 M32A1703 M32A1704 M32A1705 M32A1706 M32A1707 M32A1708 M32A1709 M32A1710 M32A1711 M32A1712 M32A1713 M32A1714 M32A1715 M32A1716 M32A1717 M32A1718 M32A1719 M32A1720 M32A1721 M32A1722 M32A1723 M32A1724 M32A1725 M32A1726 M32A1727 M32A1728 M32A1729 M32A1730 M32A1731 M32A1732 M32A1733 M32A1734 M32A1735 M32A1736 M32A1737 M32A1738 M32A1739 M32A1740 M32A1741 M32A1742 M32A1743 M32A1744 M32A1745 M32A1746 M32A1747 M32A1748 M32A1749 M32A1750 M32A1751 M32A1752 M32A1753 M32A1754 M32A1755 M32A1756 M32A1757 M32A1758 M32A1759 M32A1760 M32A1761 M32A1762 M32A1763 M32A1764 M32A1765 M32A1766 M32A1767 M32A1768 M32A1769 M32A1770 M32A1771 M32A1772 M32A1773 M32A1774 M32A1775 M32A1776 M32A1777 M32A1778 M32A1779 M32A1780 M32A1781 M32A1782 M32A1783 M32A1784 M32A1785 M32A1786 M32A1787 M32A1788 M32A1789 M32A1790 M32A1791 M32A1792 M32A1793 M32A1794 M32A1795 M32A1796 M32A1797 M32A1798 M32A1799 M32A1800 M32A1801 M32A1802 M32A1803 M32A1804 M32A1805 M32A1806 M32A1807 M32A1808 M32A1809 M32A1810 M32A1811 M32A1812 M32A1813 M32A1814 M32A1815 M32A1816 M32A1817 M32A1818 M32A1819 M32A1820 M32A1821 M32A1822 M32A1823 M32A1824 M32A1825 M32A1826 M32A1827 M32A1828 M32A1829 M32A1830 M32A1831 M32A1832 M32A1833 M32A1834 M32A1835 M32A1836 M32A1837 M32A1838 M32A1839 M32A1840 M32A1841 M32A1842 M32A1843 M32A1844 M32A1845 M32A1846 M32A1847 M32A1848 M32A1849 M32A1850 M32A1851 M32A1852 M32A1853 M32A1854 M32A1855 M32A1856 M32A1857 M32A1858 M32A1859 M32A1860 M32A1861 M32A1862 M32A1863 M32A1864 M32A1865 M32A1866 M32A1867 M32A1868 M32A1869 M32A1870 M32A1871 M32A1872 M32A1873 M32A1874 M32A1875 M32A1876 M32A1877 M32A1878 M32A1879 M32A1880 M32A1881 M32A1882 M32A1883 M32A1884 M32A1885 M32A1886 M32A1887 M32A1888 M32A1889 M32A1890 M32A1891 M32A1892 M32A1893 M32A1894 M32A1895 M32A1896 M32A1897 M32A1898 M32A1899 M32A1900 M32A1901 M32A1902 M32A1903 M32A1904 M32A1905 M32A1906 M32A1907 M32A1908 M32A1909 M32A1910 M32A1911 M32A1912 M32A1913 M32A1914 M32A1915 M32A1916 M32A1917 M32A1918 M32A1919 M32A1920 M32A1921 M32A1922 M32A1923 M32A1924 M32A1925 M32A1926 M32A1927 M32A1928 M32A1929 M32A1930 M32A1931 M32A1932 M32A1933 M32A1934 M32A1935 M32A1936 M32A1937 M32A1938 M32A1939 M32A1940 M32A1941 M32A1942 M32A1943 M32A1944 M32A1945 M32A1946 M32A1947 M32A1948 M32A1949 M32A1950 M32A1951 M32A1952 M32A1953 M32A1954 M32A1955 M32A1956 M32A1957 M32A1958 M32A1959 M32A1960 M32A1961 M32A1962 M32A1963 M32A1964 M32A1965 M32A1966 M32A1967 M32A1968 M32A1969 M32A1970 M32A1971 M32A1972 M32A1973 M32A1974 M32A1975 M32A1976 M32A1977 M32A1978 M32A1979 M32A1980 M32A1981 M32A1982 M32A1983 M32A1984 M32A1985 M32A1986 M32A1987 M32A1988 M32A1989 M32A1990 M32A1991 M32A1992 M32A1993 M32A1994 M32A1995 M32A1996 M32A1997 M32A1998 M32A1999 M32A2000 M32A2001 M32A2002 M32A2003 M32A2004 M32A2005 M32A2006 M32A2007 M32A2008 M32A2009 M32A2010 M32A2011 M32A2012 M32A2013 M32A2014 M32A2015 M32A2016 M32A2017 M32A2018 M32A2019 M32A2020 M32A2021 M32A2022 M32A2023 M32A2024 M32A2025 M32A2026 M32A2027 M32A2028 M32A2029 M32A2030 M32A2031 M32A2032 M32A2033 M32A2034 M32A2035 M32A2036 M32A2037 M32A2038 M32A2039 M32A2040 M32A2041 M32A2042 M32A2043 M32A2044 M32A2045 M32A2046 M32A2047 M32A2048 M32A2049 M32A2050 M32A2051 M32A2052 M32A2053 M32A2054 M32A2055 M32A2056 M32A2057 M32A2058 M32A2059 M32A2060 M32A2061 M32A2062 M32A2063 M32A2064 M32A2065 M32A2066 M32A2067 M32A2068 M32A2069 M32A2070 M32A2071 M32A2072 M32A2073 M32A2074 M32A2075 M32A2076 M32A2077 M32A2078 M32A2079 M32A2080 M32A2081 M32A2082 M32A2083 M32A2084 M32A2085 M32A2086 M32A2087 M32A2088 M32A2089 M32A2090 M32A2091 M32A2092 M32A2093 M32A2094 M32A2095 M32A2096 M32A2097 M32A2098 M32A2099 M32A2100 M32A2101 M32A2102 M32A2103 M32A2104 M32A2105 M32A2106 M32A2107 M32A2108 M32A2109 M32A2110 M32A2111 M32A2112 M32A2113 M32A2114 M32A2115 M32A2116 M32A2117 M32A2118 M32A2119 M32A2120 M32A2121 M32A2122 M32A2123 M32A2124 M32A2125 M32A2126 M32A2127 M32A2128 M32A2129 M32A2130 M32A2131 M32A2132 M32A2133 M32A2134 M32A2135 M32A2136 M32A2137 M32A2138 M32A2139 M32A2140 M32A2141 M32A2142 M32A2143 M32A2144 M32A2145 M32A2146 M32A2147 M32A2148 M32A2149 M32A2150 M32A2151 M32A2152 M32A2153 M32A2154 M32A2155 M32A2156 M32A2157 M32A2158 M32A2159 M32A2160 M32A2161 M32A2162 M32A2163 M32A2164 M32A2165 M32A2166 M32A2167 M32A2168 M32A2169 M32A2170 M32A2171 M32A2172 M32A2173 M32A2174 M32A2175 M32A2176 M32A2177 M32A2178 M32A2179 M32A2180 M32A2181 M32A2182 M32A2183 M32A2184 M32A2185 M32A2186 M32A2187 M32A2188 M32A2189 M32A2190 M32A2191 M32A2192 M32A2193 M32A2194 M32A2195 M32A2196 M32A2197 M32A2198 M32A2199 M32A2200 M32A2201 M32A2202 M32A2203 M32A2204 M32A2205 M32A2206 M32A2207 M32A2208 M32A2209 M32A2210 M32A2211 M32A2212 M32A2213 M32A2214 M32A2215 M32A2216 M32A2217 M32A2218 M32A2219 M32A2220 M32A2221 M32A2222 M32A2223 M32A2224 M32A2225 M32A2226 M32A2227 M32A2228 M32A2229 M32A2230 M32A2231 M32A2232 M32A2233 M32A2234 M32A2235 M32A2236 M32A2237 M32A2238 M32A2239 M32A2240 M32A2241 M32A2242 M32A2243 M32A2244 M32A2245 M32A2246 M32A2247 M32A2248 M32A2249 M32A2250 M32A2251 M32A2252 M32A2253 M32A2254 M32A2255 M32A2256 M32A2257 M32A2258 M32A2259 M32A2260 M32A2261 M32A2262 M32A2263 M32A2264 M32A2265 M32A2266 M32A2267 M32A2268 M32A2269 M32A2270 M32A2271 M32A2272 M32A2273 M32A2274 M32A2275 M32A2276 M32A2277 M32A2278 M32A2279 M32A2280 M32A2281 M32A2282 M32A2283 M32A2284 M32A2285 M32A2286 M32A2287 M32A2288 M32A2289 M32A2290 M32A2291 M32A2292 M32A2293 M32A2294 M32A2295 M32A2296 M32A2297 M32A2298 M32A2299 M32A2300 M32A2301 M32A2302 M32A2303 M32A2304 M32A2305 M32A2306 M32A2307 M32A2308 M32A2309 M32A2310 M32A2311 M32A2312 M32A2313 M32A2314 M32A2315 M32A2316 M32A2317 M32A2318 M32A2319 M32A2320 M32A2321 M32A2322 M32A2323 M32A2324 M32A2325 M32A2326 M32A2327 M32A2328 M32A2329 M32A2330 M32A2331 M32A2332 M32A2333 M32A2334 M32A2335 M32A2336 M32A2337 M32A2338 M32A2339 M32A2340 M32A2341 M32A2342 M32A2343 M32A2344 M32A2345 M32A2346 M32A2347 M32A2348 M32A2349 M32A2350 M32A2351 M32A2352 M32A2353 M32A2354 M32A2355 M32A2356 M32A2357 M32A2358 M32A2359 M32A2360 M32A2361 M32A2362 M32A2363 M32A2364 M32A2365 M32A2366 M32A2367 M32A2368 M32A2369 M32A2370 M32A2371 M32A2372 M32A2373 M32A2374 M32A2375 M32A2376 M32A2377 M32A2378 M32A2379 M32A2380 M32A2381 M32A2382 M32A2383 M32A2384 M32A2385 M32A2386 M32A2387 M32A2388 M32A2389 M32A2390 M32A2391 M32A2392 M32A2393 M32A2394 M32A2395 M32A2396 M32A2397 M32A2398 M32A2399 M32A2400 M32A2401 M32A2402 M32A2403 M32A2404 M32A2405 M32A2406 M32A2407 M32A2408 M32A2409 M32A2410 M32A2411 M32A2412 M32A2413 M32A2414 M32A2415 M32A2416 M32A2417 M32A2418 M32A2419 M32A2420 M32A2421 M32A2422 M32A2423 M32A2424 M32A2425 M32A2426 M32A2427 M32A2428 M32A2429 M32A2430 M32A2431 M32A2432 M32A2433 M32A2434 M32A2435 M32A2436 M32A2437 M32A2438 M32A2439 M32A2440 M32A2441 M32A2442 M32A2443 M32A2444 M32A2445 M32A2446 M32A2447 M32A2448 M32A2449 M32A2450 M32A2451 M32A2452 M32A2453 M32A2454 M32A2455 M32A2456 M32A2457 M32A2458 M32A2459 M32A2460 M32A2461 M32A2462 M32A2463 M32A2464 M32A2465 M32A2466 M32A2467 M32A2468 M32A2469 M32A2470 M32A2471 M32A2472 M32A2473 M32A2474 M32A2475 M32A2476 M32A2477 M32A2478 M32A2479 M32A2480 M32A2481 M32A2482 M32A2483 M32A2484 M32A2485 M32A2486 M32A2487 M32A2488 M32A2489 M32A2490 M32A2491 M32A2492 M32A2493 M32A2494 M32A2495 M32A2496 M32A2497 M32A2498 M32A2499 M32A2500 M32A2501 M32A2502 M32A2503 M32A2504 M32A2505 M32A2506 M32A2507 M32A2508 M32A2509 M32A2510 M32A2511 M32A2512 M32A2513 M32A2514 M32A2515 M32A2516 M32A2517 M32A2518 M32A2519 M32A2520 M32A2521 M32A2522 M32A2523 M32A2524 M32A2525 M32A2526 M32A2527 M32A2528 M32A2529 M32A2530 M32A2531 M32A2532 M32A2533 M32A2534 M32A2535 M32A2536 M32A2537 M32A2538 M32A2539 M32A2540 M32A2541 M32A2542 M32A2543 M32A2544 M32A2545 M32A2546 M32A2547 M32A2548 M32A2549 M32A2550 M32A2551 M32A2552 M32A2553 M32A2554 M32A2555 M32A2556 M32A2557 M32A2558 M32A2559 M32A2560 M32A2561 M32A2562 M32A2563 M32A2564 M32A2565 M32A2566 M32A2567 M32A2568 M32A2569 M32A2570 M32A2571 M32A2572 M32A2573 M32A2574 M32A2575 M32A2576 M32A2577 M32A2578 M32A2579 M32A2580 M32A2581 M32A2582 M32A2583 M32A2584 M32A2585 M32A2586 M32A2587 M32A2588 M32A2589 M32A2590 M32A2591 M32A2592 M32A2593 M32A2594 M32A2595 M32A2596 M32A2597 M32A2598 M32A2599 M32A2600 M32A2601 M32A2602 M32A2603 M32A2604 M32A2605 M32A2606 M32A2607 M32A2608 M32A2609 M32A2610 M32A2611 M32A2612 M32A2613 M32A2614 M32A2615 M32A2616 M32A2617 M32A2618 M32A2619 M32A2620 M32A2621 M32A2622 M32A2623 M32A2624 M32A2625 M32A2626 M32A2627 M32A2628 M32A2629 M32A2630 M32A2631 M32A2632 M32A2633 M32A2634 M32A2635 M32A2636 M32A2637 M32A2638 M32A2639 M32A2640 M32A2641 M32A2642 M32A2643 M32A2644 M32A2645 M32A2646 M32A2647 M32A2648 M32A2649 M32A2650 M32A2651 M32A2652 M32A2653 M32A2654 M32A2655 M32A2656 M32A2657 M32A2658 M32A2659 M32A2660 M32A2661 M32A2662 M32A2663 M32A2664 M32A2665 M32A2666 M32A2667 M32A2668 M32A2669 M32A2670 M32A2671 M

SEE SHEET C-05 FOR CONTINUATION

SEE SHEET C-10 FOR CONTINUATION



GRAVITY PIPE TABLE

NUMBER	NAME	INVERT EL.
M1	M1A4	1.0'
M2	M1S1	1.8'
M3	M1S2	2.5'
M4	M1S3	4.0'
M5	M1T1	4.0'
M6	M1U1	2.6'
M7	M1U2	3.6'
M8	M1U3	4.5'
M9	M1VI	3.0'
M10	M1V2	4.0'
M11	M1X1	4.0'
M12	M1A5	1.1'
M13	M1Y1	0.0'
M14	M1W1	4.0'
M15	M1A6	1.4'
M16	M1Z1	4.0'
M17	M1AA1	4.0'
M18	M1A7	1.7'
M19	M1BB1	2.4'
M20	M1KK1	3.5'
M21	M1KK2	4.5'
M22	M1EE1	2.9'
M23	M1EE3	4.0'
M24	M1EE2	4.0'
M25	M1BB2	3.0'
M26	M1CC1	3.5'
M27	M1DD1	4.0'
M28	M1CC2	4.0'
M29	M1BB3	3.9'
M30	M1BB4	5.1'
M31	M1A8	1.9'
M32	M1GG1	4.0'
M33	M1FF1	4.0'

GRAVITY PIPE TABLE

NUMBER	NAME	PIPE SIZE	MATERIAL	PIPE LENGTH
S1	02L1SS1	6"	CLAY	121'
S2	02L1SS2	4"	CLAY	60'
S3	02L1SS3	4"	CLAY	58'
S4	02L1ST1	4"	CLAY	60'
S5	02L1SU1	6"	CLAY	84'
S6	02L1SU2	4"	CLAY	53'
S7	02L1SU3	4"	CLAY	58'
S8	02L1SV1	4"	CLAY	43'
S9	02L1SV2	4"	CLAY	15'
S10	02L1SW1	4"	CLAY	99'
S11	02L1SA5	8"	CLAY	43'
S12	02L1SY1	4"	CLAY	15'
S13	02L1SX1	4"	CLAY	57'
S14	02L1SA6	8"	CLAY	73'
S15	02L1SZ1	4"	CLAY	14'
S16	02L1SAA1	4"	CLAY	65'
S17	02L1SA7	8"	CLAY	47'

GRAVITY PIPE TABLE

NUMBER	NAME	PIPE SIZE	MATERIAL	PIPE LENGTH
S18	02L1SBB1	6"	CLAY	90'
S19	02L1SKK1	4"	CLAY	48'
S20	02L1SKK2	4"	CLAY	131'
S21	02L1SEE1	4"	CLAY	49'
S22	02L1SEE3	4"	CLAY	28'
S23	02L1SEE2	4"	CLAY	63'
S24	02L1SBB2	6"	CLAY	127'
S25	02L1SCC1	4"	CLAY	47'
S26	02L1SDD1	4"	CLAY	42'
S27	02L1SCC2	4"	CLAY	78'
S28	02L1SBB3	4"	CLAY	118'
S29	02L1SBB4	4"	CLAY	138'
S30	02L1SA8	8"	CLAY	45'
S31	02L1SGG1	4"	CLAY	15'
S32	02L1SFF1	4"	CLAY	26'

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88

ALL ELEVATIONS ARE IN NAVD 88

LEGEND:

-1.7 —— INVERT ELEVATION NAVD88

M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH

01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2

01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2

02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

SEE SHEET C-07 FOR CONTINUATION

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE


KEYMAP

C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

PROJECT NUMBER
08-22-025
06 OF 14

SEE SHEET C-06 FOR CONTINUATION


SW 32ND AVE.
W LAKE DR.
SW 32ND BLVD.
W LAKE SHORE DR.
LAKE SHORE DR.
MARINE DR.
I-95 EXPRESS
NE 215TH ST.
TOWN BORDER
LS-2
LS-3
LS-5
LS3
SEE TABLE FOR INFO
2688 LF 6" C.I.P.
02L3P230
02L3J1
02L5J1
02L4J2
02L4J1
02L5J2
02L5F3
02L3SA1
02L3F2
02L3SD4
02L3SD3
02L3SD2
02L3SD1
02L3SC4
02L3SC3
02L3SC2
02L3SC1
02L3SB4
02L3SB3
02L3SB2
02L3SB1
02L3SA5
02L3SA4
02L3SA3
02L3SA2
02L3SA1
02L3SN1
02L3SM1
02L3SL3
02L3SL2
02L3SL1
02L3SK4
02L3SK3
02L3SK2
02L3SK1
02L3SJ3
02L3SJ2
02L3SJ1
02L3SH2
02L3SH1
02L3SG4
02L3SG3
02L3SG2
02L3SG1
02L3SF4
02L3SF3
02L3SF2
02L3SF1
02L3SE1
02L3SD5
02L5SD4
02L5SD3
02L5SD2
02L5SD1
02L5SC4
02L5SC3
02L5SC2
02L5SC1
02L5SB4
02L5SB3
02L5SB2
02L5SB1
02L5SA7
02L5SA6
02L5SA5
02L5SA4
02L5SA3
02L5SA2
02L5SA1
02L5SN1
02L5SM1
02L5SL3
02L5SL2
02L5SL1
02L5SK4
02L5SK3
02L5SK2
02L5SK1
02L5SJ3
02L5SJ2
02L5SJ1
02L5SH2
02L5SH1
02L5SG4
02L5SG3
02L5SG2
02L5SG1
02L5SF4
02L5SF3
02L5SF2
02L5SF1
02L5SE1
02L5SD5
02L5SD4
02L5SD3
02L5SD2
02L5SD1
02L5SC4
02L5SC3
02L5SC2
02L5SC1
02L5SB4
02L5SB3
02L5SB2
02L5SB1
02L5SA7
02L5SA6
02L5SA5
02L5SA4
02L5SA3
02L5SA2
02L5SA1
02L2SN1
02L2SM1
02L2SL3
02L2SL2
02L2SL1
02L2SK4
02L2SK3
02L2SK2
02L2SK1
02L2SJ3
02L2SJ2
02L2SJ1
02L2SH2
02L2SH1
02L2SG4
02L2SG3
02L2SG2
02L2SG1
02L2SF4
02L2SF3
02L2SF2
02L2SF1
02L2SE1
02L2SD5
02L2SD4
02L2SD3
02L2SD2
02L2SD1
02L2SC4
02L2SC3
02L2SC2
02L2SC1
02L2SB4
02L2SB3
02L2SB2
02L2SB1
02L2SA7
02L2SA6
02L2SA5
02L2SA4
02L2SA3
02L2SA2
02L2SA1
02L2F2
02L2F1
02L2J1
02L7SA7
02L7SA6
02L7SA5
02L7SA4
02L7SA3
02L7SA2
02L7SA1
M5 A7
M5 D3
M5 A6
M5 D2
M5 D1
M5A4
M5 A1
M5 A2
M5A3
M5C1
M5B1
M5C2
M5B2
M5J1
M5H5
M5H4
M5H3
M5H2
M5K1
M5M1
M5N1
M5L4
M5L3
M5L2
M5L1
M5H1
M5J1
M5K4
M5K3
M5K2
M5K5
M5M2
M5N2
M5L5
M3J1
M3H5
M3H4
M3H3
M3H2
M3K1
M3M1
M3N1
M3L4
M3L3
M3L2
M3L1
M3H1
M3J1
M3K4
M3K3
M3K2
M3K5
M3M2
M3N2
M3L5
M3A6
M3A7
M3A8
M3A9
M3B5
M3B4
M3B3
M3B2
M3B1
M3A1
M3A2
M3A3
M3A4
M3A5
M3C3
M3C2
M3C1
M3F3
M3F2
M3F1
M3E1
M3D5
M3D4
M3D3
M3D2
M3D1
M3C4
M3C5
M3E2
M3F4
M3F5
M3G1
M3G2
M3G3
M3G4
M3G5
M3H6
M3H7
M3H8
M3J2
M2J1
M2K1
M2L1
M2M1
M2N1
M2J2
M2J3
M2K2
M2L2
M2M2
M2N2
M2J4
M2K3
M2L3
M2M3
M2N3
M2J5
M2K4
M2L4
M2M4
M2N4
M2J6
M2K5
M2L5
M2M5
M2N5
M2J7
M2K6
M2L6
M2M6
M2N6
M2J8
M2K7
M2L7
M2M7
M2N7
M2J9
M2K8
M2L8
M2M8
M2N8
M2J10
M2K9
M2L9
M2M9
M2N9
M2J11
M2K10
M2L10
M2M10
M2N10
M2J12
M2K11
M2L11
M2M11
M2N11
M2J13
M2K12
M2L12
M2M12
M2N12
M2J14
M2K13
M2L13
M2M13
M2N13
M2J15
M2K14
M2L14
M2M14
M2N14
M2J16
M2K15
M2L15
M2M15
M2N15
M2J17
M2K16
M2L16
M2M16
M2N16
M2J18
M2K17
M2L17
M2M17
M2N17
M2J19
M2K18
M2L18
M2M18
M2N18
M2J20
M2K19
M2L19
M2M19
M2N19
M2J21
M2K20
M2L20
M2M20
M2N20
M2J22
M2K21
M2L21
M2M21
M2N21
M2J23
M2K22
M2L22
M2M22
M2N22
M2J24
M2K23
M2L23
M2M23
M2N23
M2J25
M2K24
M2L24
M2M24
M2N24
M2J26
M2K25
M2L25
M2M25
M2N25
M2J27
M2K26
M2L26
M2M26
M2N26
M2J28
M2K27
M2L27
M2M27
M2N27
M2J29
M2K28
M2L28
M2M28
M2N28
M2J30
M2K29
M2L29
M2M29
M2N29
M2J31
M2K30
M2L30
M2M30
M2N30
M2J32
M2K31
M2L31
M2M31
M2N31
M2J33
M2K32
M2L32
M2M32
M2N32
M2J34
M2K33
M2L33
M2M33
M2N33
M2J35
M2K34
M2L34
M2M34
M2N34
M2J36
M2K35
M2L35
M2M35
M2N35
M2J37
M2K36
M2L36
M2M36
M2N36
M2J38
M2K37
M2L37
M2M37
M2N37
M2J39
M2K38
M2L38
M2M38
M2N38
M2J40
M2K39
M2L39
M2M39
M2N39
M2J41
M2K40
M2L40
M2M40
M2N40
M2J42
M2K41
M2L41
M2M41
M2N41
M2J43
M2K42
M2L42
M2M42
M2N42
M2J44
M2K43
M2L43
M2M43
M2N43
M2J45
M2K44
M2L44
M2M44
M2N44
M2J46
M2K45
M2L45
M2M45
M2N45
M2J47
M2K46
M2L46
M2M46
M2N46
M2J48
M2K47
M2L47
M2M47
M2N47
M2J49
M2K48
M2L48
M2M48
M2N48
M2J50
M2K49
M2L49
M2M49
M2N49
M2J51
M2K50
M2L50
M2M50
M2N50
M2J52
M2K51
M2L51
M2M51
M2N51
M2J53
M2K52
M2L52
M2M52
M2N52
M2J54
M2K53
M2L53
M2M53
M2N53
M2J55
M2K54
M2L54
M2M54
M2N54
M2J56
M2K55
M2L55
M2M55
M2N55
M2J57
M2K56
M2L56
M2M56
M2N56
M2J58
M2K57
M2L57
M2M57
M2N57
M2J59
M2K58
M2L58
M2M58
M2N58
M2J60
M2K59
M2L59
M2M59
M2N59
M2J61
M2K60
M2L60
M2M60
M2N60
M2J62
M2K61
M2L61
M2M61
M2N61
M2J63
M2K62
M2L62
M2M62
M2N62
M2J64
M2K63
M2L63
M2M63
M2N63
M2J65
M2K64
M2L64
M2M64
M2N64
M2J66
M2K65
M2L65
M2M65
M2N65
M2J67
M2K66
M2L66
M2M66
M2N66
M2J68
M2K67
M2L67
M2M67
M2N67
M2J69
M2K68
M2L68
M2M68
M2N68
M2J70
M2K69
M2L69
M2M69
M2N69
M2J71
M2K70
M2L70
M2M70
M2N70
M2J72
M2K71
M2L71
M2M71
M2N71
M2J73
M2K72
M2L72
M2M72
M2N72
M2J74
M2K73
M2L73
M2M73
M2N73
M2J75
M2K74
M2L74
M2M74
M2N74
M2J76
M2K75
M2L75
M2M75
M2N75
M2J77
M2K76
M2L76
M2M76
M2N76
M2J78
M2K77
M2L77
M2M77
M2N77
M2J79
M2K78
M2L78
M2M78
M2N78
M2J80
M2K79
M2L79
M2M79
M2N79
M2J81
M2K80
M2L80
M2M80
M2N80
M2J82
M2K81
M2L81
M2M81
M2N81
M2J83
M2K82
M2L82
M2M82
M2N82
M2J84
M2K83
M2L83
M2M83
M2N83
M2J85
M2K84
M2L84
M2M84
M2N84
M2J86
M2K85
M2L85
M2M85
M2N85
M2J87
M2K86
M2L86
M2M86
M2N86
M2J88
M2K87
M2L87
M2M87
M2N87
M2J89
M2K88
M2L88
M2M88
M2N88
M2J90
M2K89
M2L89
M2M89
M2N89
M2J91
M2K90
M2L90
M2M90
M2N90
M2J92
M2K91
M2L91
M2M91
M2N91
M2J93
M2K92
M2L92
M2M92
M2N92
M2J94
M2K93
M2L93
M2M93
M2N93
M2J95
M2K94
M2L94
M2M94
M2N94
M2J96
M2K95
M2L95
M2M95
M2N95
M2J97
M2K96
M2L96
M2M96
M2N96
M2J98
M2K97
M2L97
M2M97
M2N97
M2J99
M2K98
M2L98
M2M98
M2N98
M2J100
M2K99
M2L99
M2M99
M2N99
M2J101
M2K100
M2L100
M2M100
M2N100
M2J102
M2K101
M2L101
M2M101
M2N101
M2J103
M2K102
M2L102
M2M102
M2N102
M2J104
M2K103
M2L103
M2M103
M2N103
M2J105
M2K104
M2L104
M2M104
M2N104
M2J106
M2K105
M2L105
M2M105
M2N105
M2J107
M2K106
M2L106
M2M106
M2N106
M2J108
M2K107
M2L107
M2M107
M2N107
M2J109
M2K108
M2L108
M2M108
M2N108
M2J110
M2K109
M2L109
M2M109
M2N109
M2J111
M2K110
M2L110
M2M110
M2N110
M2J112
M2K111
M2L111
M2M111
M2N111
M2J113
M2K112
M2L112
M2M112
M2N112
M2J114
M2K113
M2L113
M2M113
M2N113
M2J115
M2K114
M2L114
M2M114
M2N114
M2J116
M2K115
M2L115
M2M115
M2N115
M2J117
M2K116
M2L116
M2M116
M2N116
M2J118
M2K117
M2L117
M2M117
M2N117
M2J119
M2K118
M2L118
M2M118
M2N118
M2J120
M2K119
M2L119
M2M119
M2N119
M2J121
M2K120
M2L120
M2M120
M2N120
M2J122
M2K121
M2L121
M2M121
M2N121
M2J123
M2K122
M2L122
M2M122
M2N122
M2J124
M2K123
M2L123
M2M123
M2N123
M2J125
M2K124
M2L124
M2M124
M2N124
M2J126
M2K125
M2L125
M2M125
M2N125
M2J127
M2K126
M2L126
M2M126
M2N126
M2J128
M2K127
M2L127
M2M127
M2N127
M2J129
M2K128
M2L128
M2M128
M2N128
M2J130
M2K129
M2L129
M2M129
M2N129
M2J131
M2K130
M2L130
M2M130
M2N130
M2J132
M2K131
M2L131
M2M131
M2N131
M2J133
M2K132
M2L132
M2M132
M2N132
M2J134
M2K133
M2L133
M2M133
M2N133
M2J135
M2K134
M2L134
M2M134
M2N134
M2J136
M2K135
M2L135
M2M135
M2N135
M2J137
M2K136
M2L136
M2M136
M2N136
M2J138
M2K137
M2L137
M2M137
M2N137
M2J139
M2K138
M2L138
M2M138
M2N138
M2J140
M2K139
M2L139
M2M139
M2N139
M2J141
M2K140
M2L140
M2M140
M2N140
M2J142
M2K141
M2L141
M2M141
M2N141
M2J143
M2K142
M2L142
M2M142
M2N142
M2J144
M2K143
M2L143
M2M143
M2N143
M2J145
M2K144
M2L144
M2M144
M2N144
M2J146
M2K145
M2L145
M2M145
M2N145
M2J147
M2K146
M2L146
M2M146
M2N146
M2J148
M2K147
M2L147
M2M147
M2N147
M2J149
M2K148
M2L148
M2M148
M2N148
M2J150
M2K149
M2L149
M2M149
M2N149
M2J151
M2K150
M2L150
M2M150
M2N150
M2J152
M2K151
M2L151
M2M151
M2N151
M2J153
M2K152
M2L152
M2M152
M2N152
M2J154
M2K153
M2L153
M2M153
M2N153
M2J155
M2K154
M2L154
M2M154
M2N154
M2J156
M2K155
M2L155
M2M155
M2N155
M2J157
M2K156
M2L156
M2M156
M2N156
M2J158
M2K157
M2L157
M2M157
M2N157
M2J159
M2K158
M2L158
M2M158
M2N158
M2J160
M2K159
M2L159
M2M159
M2N159
M2J161
M2K160
M2L160
M2M160
M2N160
M2J162
M2K161
M2L161
M2M161
M2N161
M2J163
M2K162
M2L162
M2M162
M2N162
M2J164
M2K163
M2L163
M2M163
M2N163
M2J165
M2K164
M2L164
M2M164
M2N164
M2J166
M2K165
M2L165
M2M165
M2N165
M2J167
M2K166
M2L166
M2M166
M2N166
M2J168
M2K167
M2L167
M2M167
M2N167
M2J169
M2K168
M2L168
M2M168
M2N168
M2J170
M2K169
M2L169
M2M169
M2N169
M2J171
M2K170
M2L170
M2M170
M2N170
M2J172
M2K171
M2L171
M2M171
M2N171
M2J173
M2K172
M2L172
M2M172
M2N172
M2J174
M2K173
M2L173
M2M173
M2N173
M2J175
M2K174
M2L174
M2M174
M2N174
M2J176
M2K175
M2L175
M2M175
M2N175
M2J177
M2K176
M2L176
M2M176
M2N176
M2J178
M2K177
M2L177
M2M177
M2N177
M2J179
M2K178
M2L178
M2M178
M2N178
M2J180
M2K179
M2L179
M2M179
M2N179
M2J181
M2K180
M2L180
M2M180
M2N180
M2J182
M2K181
M2L181
M2M181
M2N181
M2J183
M2K182
M2L182
M2M182
M2N182
M2J184
M2K183
M2L183
M2M183
M2N183
M2J185
M2K184
M2L184
M2M184
M2N184
M2J186
M2K185
M2L185
M2M185
M2N185
M2J187
M2K186
M2L186
M2M186
M2N186
M2J188
M2K187
M2L187
M2M187
M2N187
M2J189
M2K188
M2L188
M2M188
M2N188
M2J190
M2K189
M2L189
M2M189
M2N189
M2J191
M2K190
M2L190
M2M190
M2N190
M2J192
M2K191
M2L191
M2M191
M2N191
M2J193
M2K192
M2L192
M2M192
M2N192
M2J194
M2K193
M2L193
M2M193
M2N193
M2J195
M2K194
M2L194
M2M194
M2N194
M2J196
M2K195
M2L195
M2M195
M2N195
M2J197
M2K196
M2L196
M2M196
M2N196
M2J198
M2K197
M2L197
M2M197
M2N197
M2J199
M2K198
M2L198
M2M198
M2N198
M2J200
M2K199
M2L199
M2M199
M2N199
M2J201
M2K200
M2L200
M2M200
M2N200
M2J202
M2K201
M2L201
M2M201
M2N201
M2J203
M2K202
M2L202
M2M202
M2N202
M2J204
M2K203
M2L203
M2M203
M2N203
M2J205
M2K204
M2L204
M2M204
M2N204
M2J206
M2K205
M2L205
M2M205
M2N205
M2J207
M2K206
M2L206
M2M206
M2N206
M2J208
M2K207
M2L207
M2M207
M2N207
M2J209
M2K208
M2L208
M2M208
M2N208
M2J210
M2K209
M2L209
M2M209
M2N209
M2J211
M2K210
M2L210
M2M210
M2N210
M2J212
M2K211
M2L211
M2M211
M2N211
M2J213
M2K212
M2L212
M2M212
M2N212
M2J214
M2K213
M2L213
M2M213
M2N213
M2J215
M2K214
M2L214
M2M214
M2N214
M2J216
M2K215
M2L215
M2M215
M2N215
M2J217
M2K216
M2L216
M2M216
M2N216
M2J218
M2K217
M2L217
M2M217
M2N217
M2J219
M2K218
M2L218
M2M218
M2N218
M2J220
M2K219
M2L219
M2M219
M2N219
M2J221
M2K220
M2L220
M2M220
M2N220
M2J222
M2K221
M2L221
M2M221
M2N221
M2J223
M2K222
M2L222
M2M222
M2N222
M2J224
M2K223
M2L223
M2M223
M2N223
M2J225
M2K224
M2L224
M2M224
M2N224
M2J226
M2K225
M2L225
M2M225
M2N225
M2J227
M2K226
M2L226
M2M226
M2N226
M2J228
M2K227
M2L227
M2M227
M2N227
M2J229
M2K228
M2L228
M2M228
M2N228
M2J230
M2K229
M2L229
M2M229
M2N229
M2J231
M2K230
M2L230
M2M230
M2N230
M2J232
M2K231
M2L231
M2M231
M2N231
M2J233
M2K232
M2L232
M2M232
M2N232
M2J234
M2K233
M2L233
M2M233
M2N233
M2J235
M2K234
M2L234
M2M234
M2N234
M2J236
M2K235
M2L235
M2M235
M2N235
M2J237
M2K236
M2L236
M2M236
M2N236
M2J238
M2K237
M2L237
M2M237
M2N237
M2J239
M2K238
M2L238
M2M238
M2N238
M2J240
M2K239
M2L239
M2M239
M2N239
M2J241
M2K240
M2L240
M2M240
M2N240
M2J242
M2K241
M2L241
M2M241
M2N241
M2J243
M2K242
M2L242
M2M242
M2N242
M2J244
M2K243
M2L243
M2M243
M2N243
M2J245
M2K244
M2L244
M2M244
M2N244
M2J246
M2K245
M2L245
M2M245
M2N245
M2J247
M2K246
M2L246
M2M246
M2N246
M2J248
M2K247
M2L247
M2M247
M2N247
M2J249
M2K248
M2L248
M2M248
M2N248
M2J250
M2K249
M2L249
M2M249
M2N249
M2J251
M2K250
M2L250
M2M250
M2N250
M2J252
M2K251
M2L251
M2M251
M2N251
M2J253
M2K252
M2L252
M2M252
M2N252
M2J254
M2K253
M2L253
M2M253
M2N253
M2J255
M2K254
M2L254
M2M254
M2N254
M2J256
M2K255
M2L255
M2M255
M2N255
M2J257
M2K256
M2L256
M2M256
M2N256
M2J258
M2K257
M2L257
M2M257
M2N257
M2J259
M2K258
M2L258
M2M258
M2N258
M2J260
M2K259
M2L259
M2M259
M2N259
M2J261
M2K260
M2L260
M2M260
M2N260
M2J262
M2K261
M2L261
M2M261
M2N261
M2J263
M2K262
M2L262
M2M262
M2N262
M2J264
M2K263
M2L263
M2M263
M2N263
M2J265
M2K264
M2L264
M2M264
M2N264
M2J266
M2K265
M2L265
M2M265
M2N265
M2J267
M2K266
M2L266
M2M266
M2N266
M2J268
M2K267
M2L267
M2M267
M2N267
M2J269
M2K268
M2L268
M2M268
M2N268
M2J270
M2K269
M2L269
M2M269
M2N269
M2J271
M2K270
M2L270
M2M270
M2N270
M2J272
M2K271
M2L271
M2M271
M2N271
M2J273
M2K272
M2L272
M2M272
M2N272
M2J274
M2K273
M2L273
M2M273
M2N273
M2J275
M2K274
M2L274
M2M274
M2N274
M2J276
M2K275
M2L275
M2M275
M2N275
M2J277
M2K276
M2L276
M2M276
M2N276
M2J278
M2K277
M2L277
M2M277
M2N277
M2J279
M2K278
M2L278
M2M278
M2N278
M2J280
M2K279
M2L279
M2M279
M2N279
M2J281
M2K280
M2L280
M2M280
M2N280
M2J282
M2K281
M2L281
M2M281
M2N281
M2J283
M2K282
M2L282
M2M282
M2N282
M2J284
M2K283
M2L283
M2M283
M2N283
M2J285
M2K284
M2L284
M2M284
M2N284
M2J286
M2K285
M2L285
M2M285
M2N285
M2J287
M2K286
M2L286
M2M286
M2N286
M2J288
M2K287
M2L287
M2M287
M2N287
M2J289
M2K288
M2L288
M2M288
M2N288
M2J290
M2K289
M2L289
M2M289
M2N289
M2J291
M2K290
M2L290
M2M290
M2N290
M2J292
M2K291
M2L291
M2M291
M2N291
M2J293
M2K292
M2L292
M2M292
M2N292
M2J294
M2K293
M2L293
M2M293
M2N293
M2J295
M2K294
M2L294
M2M294
M2N294
M2J296
M2K295
M2L295
M2M295
M2N295
M2J297
M2K296
M2L296
M2M296
M2N296
M2J298
M2K297
M2L297
M2M297
M2N297
M2J299
M2K298
M2L298
M2M298
M2N298
M2J300
M2K299
M2L299
M2M299
M2N299
M2J301
M2K300
M2L300
M2M300
M2N300
M2J302
M2K301
M2L301
M2M301
M2N301
M2J303
M2K302
M2L302
M2M302
M2N302
M2J304
M2K303
M2L303
M2M303
M2N303
M2J305
M2K304
M2L304
M2M304
M2N304
M2J306
M2K305
M2L305
M2M305
M2N305
M2J307
M2K306
M2L306
M2M306
M2N306
M2J308
M2K307
M2L307
M2M307
M2N307
M2J309
M2K308
M2L308
M2M308
M2N308
M2J310
M2K309
M2L309
M2M309
M2N309
M2J311
M2K310
M2L310
M2M310
M2N310
M2J312
M2K311
M2L311
M2M311
M2N311
M2J313
M2K312
M2L312
M2M312
M2N312
M2J314
M2K313
M2L313
M2M313
M2N313
M2J315
M2K314
M2L314
M2M314
M2N314
M2J316
M2K315
M2L315
M2M315
M2N315
M2J317
M2K316
M2L316
M2M316
M2N316
M2J318
M2K317
M2L317
M2M317
M2N317
M2J319
M2K318
M2L318
M2M318
M2N318
M2J320
M2K319
M2L319
M2M319
M2N319
M2J321
M2K320
M2L320
M2M320
M2N320
M2J322
M2K321
M2L321
M2M321
M2N321
M2J323
M2K322
M2L322
M2M322
M2N322
M2J324
M2K323
M2L323
M2M323
M2N323
M2J325
M2K324
M2L324
M2M324
M2N324
M2J326
M2K325
M2L325
M2M325
M2N325
M2J327
M2K326
M2L326
M2M326
M2N326
M2J328
M2K327
M2L327
M2M327
M2N327
M2J329
M2K328
M2L328
M2M328
M2N328
M2J330
M2K329
M2L329
M2M329
M2N329
M2J331
M2K330
M2L330
M2M330
M2N330
M2J332
M2K331
M2L331
M2M331
M2N331
M2J333
M2K332
M2L332
M2M332
M2N332
M2J334
M2K333
M2L333
M2M333
M2N333
M2J335
M2K334
M2L334
M2M334
M2N334
M2J336
M2K335
M2L335
M2M335
M2N335
M2J337
M2K336
M2L336
M2M336
M2N336
M2J338
M2K337
M2L337
M2M337
M2N337
M2J339
M2K338
M2L338
M2M338
M2N338
M2J340
M2K339
M2L339
M2M339
M2N339
M2J341
M2K340
M2L340
M2M340
M2N340
M2J342
M2K341
M2L341
M2M341
M2N341
M2J343
M2K342
M2L342
M2M342
M2N342
M2J344
M2K343
M2L343
M2M343
M2N343
M2J345
M2K344
M2L344
M2M344
M2N344
M2J346
M2K345
M2L345
M2M345
M2N345
M2J347
M2K346
M2L346
M2M346
M2N346
M2J348
M2K347
M2L347
M2M347
M2N347
M2J349
M2K348
M2L348
M2M348
M2N348
M2J350
M2K349
M2L349
M2M349
M2N349
M2J351
M2K350
M2L350
M2M350
M2N350
M2J352
M2K351
M2L351
M2M351
M2N351
M2J353
M2K352
M2L352
M2M352
M2N352
M2J354
M2K353
M2L353
M2M353
M2N353
M2J355
M2K354
M2L354
M2M354
M2N354
M2J356
M2K355
M2L355
M2M355
M2N355
M2J357
M2K356
M2L356
M2M356
M2N356
M2J358
M2K357
M2L357
M2M357
M2N357
M2J359
M2K358
M2L358
M2M358
M2N358
M2J360
M2K359
M2L359
M2M359
M2N359
M2J361
M2K360
M2L360
M2M360
M2N360
M2J362
M2K361
M2L361
M2M361
M2N361
M2J363
M2K362
M2L362
M2M362
M2N362
M2J364
M2K363
M2L363
M2M363
M2N363
M2J365
M2K364
M2L364
M2M364
M2N364
M2J366
M2K365
M2L365
M2M365
M2N365
M2J367
M2K366
M2L366
M2M366
M2N366
M2J368
M2K367
M2L367
M2M367
M2N367
M2J369
M2K368
M2L368
M2M368
M2N368
M2J370
M2K369
M2L369
M2M369
M2N369
M2J371
M2K370
M2L370
M2M370
M2N370
M2J372
M2K371
M2L371
M2M371
M2N371
M2J373
M2K372
M2L372
M2M372
M2N372
M2J374
M2K373
M2L373
M2M373
M2N373
M2J375
M2K374
M2L374
M2M374
M2N374
M2J376
M2K375
M2L375
M2M375
M2N375
M2J377
M2K376
M2L376
M2M376
M2N376
M2J378
M2K377
M2L377
M2M377
M2N377
M2J379
M2K378
M2L378
M2M378
M2N378
M2J380
M2K379
M2L379
M2M379
M2N379
M2J381
M2K380
M2L380
M2M380
M2N380
M2J382
M2K381
M2L381
M2M381
M2N381
M2J383
M2K382
M2L382
M2M382
M2N382
M2J384
M2K383
M2L383
M2M383
M2N383
M2J385
M2K384
M2L384
M2M384
M2N384
M2J386
M2K385
M2L385
M2M385
M2N385
M2J387
M2K386
M2L386
M2M386
M2N386
M2J388
M2K387
M2L387
M2M387
M2N387
M2J389
M2K388
M2L388
M2M388
M2N388
M2J390
M2K389
M2L389
M2M389
M2N389
M2J391
M2K390
M2L390
M2M390
M2N390
M2J392
M2K391
M2L391
M2M391
M2N391
M2J393
M2K392
M2L392
M2M392
M2N392
M2J394
M2K393
M2L393
M2M393
M2N393
M2J395
M2K394
M2L394
M2M394
M2N394
M2J396
M2K395
M2L395
M2M395
M2N395
M2J397
M2K396
M2L396
M2M396
M2N396
M2J398
M2K397
M2L397
M2M397
M2N397
M2J399
M2K398
M2L398
M2M398
M2N398
M2J400
M2K399
M2L399
M2M399
M2N399
M2J401
M2K400
M2L400
M2M400
M2N400
M2J402
M2K401
M2L401
M2M401
M2N401
M2J403
M2K402
M2L402
M2M402
M2N402
M2J404
M2K403
M2L403
M2M403
M2N403
M2J405
M2K404
M2L404
M2M404
M2N404
M2J406
M2K405
M2L405
M2M405
M2N405
M2J407
M2K406
M2L406
M2M406
M2N406
M2J408
M2K407
M2L407
M2M407
M2N407
M2J409
M2K408
M2L408
M2M408
M2N408
M2J410
M2K409
M2L409
M2M409
M2N409
M2J411
M2K410
M2L410
M2M410
M2N410
M2J412
M2K411
M2L411
M2M411
M2N411
M2J413
M2K412
M2L412
M2M412
M2N412
M2J414
M2K413
M2L413
M2M413
M2N413
M2J415
M2K414
M2L414
M2M414
M2N414
M2J416
M2K415
M2L415
M2M415
M2N415
M2J417
M2K416
M2L416
M2M416
M2N416
M2J418
M2K417
M2L417
M2M417
M2N417
M2J419
M2K418
M2L418
M2M418
M2N418
M2J420
M2K419
M2L419
M2M419
M2N419
M2J421
M2K420
M2L420
M2M420
M2N420
M2J422
M2K421
M2L421
M2M421
M2N421
M2J423
M2K422
M2L422
M2M422
M2N422
M2J424
M2K423
M2L423
M2M423
M2N423
M2J425
M2K424
M2L424
M2M424
M2N424
M2J426
M2K425
M2L425
M2M425
M2N425
M2J427
M2K426
M2L426
M2M426
M2N426
M2J428
M2K427
M2L427
M2M427
M2N427
M2J429
M2K428
M2L428
M2M428
M2N428
M2J430
M2K429
M2L429
M2M429
M2N429
M2J431
M2K430
M2L430
M2M430
M2N430
M2J432
M2K431
M2L431
M2M431
M2N431
M2J433
M2K432
M2L432
M2M432
M2N432
M2J434
M2K433
M2L433
M2M433
M2N433
M2J435
M2K434
M2L434
M2M434
M2N434
M2J436
M2K435
M2L435
M2M435
M2N435
M2J437
M2K436
M2L436
M2M436
M2N436
M2J438
M2K437
M2L437
M2M437
M2N437
M2J439
M2K438
M2L438
M2M438
M2N438
M2J440
M2K439
M2L439
M2M439
M2N439
M2J441
M2K440
M2L440
M2M440
M2N440
M2J442
M2K441
M2L441
M2M441
M2N441
M2J443
M2K442
M2L442
M2M442
M2N442
M2J444
M2K443
M2L443
M2M443
M2N443
M2J445
M2K444
M2L444
M2M444
M2N444
M2J446
M2K445
M2L445
M2M445
M2N445
M2J447
M2K446
M2L446
M2M446
M2N446
M2J448
M2K447
M2L447
M2M447
M2N447
M2J449
M2K448
M2L448
M2M448
M2N448
M2J450
M2K449
M2L449
M2M449
M2N449
M2J451
M2K450
M2L450
M2M450
M2N450
M2J452
M2K451
M2L451
M2M451
M2N451
M2J453
M2K452
M2L452
M2M452
M2N452
M2J454
M2K453
M2L453
M2M453
M2N453
M2J455
M2K454
M2L454
M2M454
M2N454
M2J456
M2K455
M2L455
M2M455
M2N455
M2J457
M2K456
M2L456
M2M456
M2N456
M2J458
M2K457
M2L457
M2M457
M2N457
M2J459
M2K458
M2L458
M2M458
M2N458
M2J460
M2K459
M2L459
M2M459
M2N459
M2J461
M2K460
M2L460
M2M460
M2N460
M2J462
M2K461
M2L461
M2M461
M2N461
M2J463
M2K462
M2L462
M2M462
M2N462
M2J464
M2K463
M2L463
M2M463
M2N463
M2J465
M2K464
M2L464
M2M464
M2N464
M2J466
M2K465
M2L465
M2M465
M2N465
M2J467
M2K466
M2L466
M2M466
M2N466
M2J468
M2K467
M2L467
M2M467
M2N467
M2J469
M2K468
M2L468
M2M468
M2N468
M2J470
M2K469
M2L469
M2M469
M2N469
M2J471
M2K470
M2L470
M2M470
M2N470
M2J472
M2K471
M2L471
M2M471
M2N471
M2J473
M2K472
M2L472
M2M472
M2N472
M2J474
M2K473
M2L473
M2M473
M2N473
M2J475
M2K474
M2L474
M2M474
M2N474
M2J476
M2K475
M2L475
M2M475
M2N475
M2J477
M2K476
M2L476
M2M476
M2N476
M2J478
M2K477
M2L477
M2M477
M2N477
M2J479
M2K478
M2L478
M2M478
M2N478
M2J480
M2K479
M2L479
M2M479
M2N479
M2J481
M2K480
M2L480
M2M480
M2N480
M2J482
M2K481
M2L481
M2M481
M2N481
M2J483
M2K482
M2L482
M2M482
M2N482
M2J484
M2K483
M2L483
M2M483
M2N483
M2J485
M2K484
M2L484
M2M484
M2N484
M2J486
M2K485
M2L485
M2M485
M2N485
M2J487
M2K486
M2L486
M2M486
M2N486
M2J488
M2K487
M2L487
M2M487
M2N487
M2J489
M2K488
M2L488
M2M488
M2N488
M2J490
M2K489
M2L489
M2M489
M2N489
M2J491
M2K490
M2L490
M2M490
M2N490
M2J492
M2K491
M2L491
M2M491
M2N491
M2J493
M2K492
M2L492
M2M492
M2N492
M2J494
M2K493
M2L493
M2M493
M2N493
M2J495
M2K494
M2L494
M2M494
M2N494
M2J496
M2K495
M2L495
M2M495
M2N495
M2J497
M2K496
M2L496
M2M496
M2N496
M2J498
M2K497
M2L497
M2M497
M2N497
M2J499
M2K498
M2L498
M2M498
M2N498
M2J500
M2K499
M2L499
M2M499
M2N499
M2J501
M2K500
M2L500
M2M500
M2N500
M2J502
M2K501
M2L501
M2M501
M2N501
M2J503
M2K502
M2L502
M2M502
M2N502
M2J504
M2K503
M2L503
M2M503
M2N503
M2J505
M2K504
M2L504
M2M504
M2N504
M2J506
M2K505
M2L505
M2M505
M2N505
M2J507
M2K506
M2L506
M2M506
M2N506
M2J508
M2K507
M2L507
M2M507
M2N507
M2J509
M2K508
M2L508
M2M508
M2N508
M2J510
M2K509
M2L509
M2M509
M2N509
M2J511
M2K510
M2L510
M2M510
M2N510
M2J512
M2K511
M2L511
M2M511
M2N511
M2J513
M2K512
M2L512
M2M512
M2N512
M2J514
M2K513
M2L513
M2M513
M2N513
M2J515
M2K514
M2L514
M2M514
M2N514
M2J516
M2K515
M2L515
M2M515
M2N515
M2J517
M2K516
M2L516
M2M516
M2N516
M2J518
M2K517
M2L517
M2M517
M2N517
M2J519
M2K518
M2L518
M2M518
M2N518
M2J520
M2K519
M2L519
M2M519
M2N519
M2J521
M2K520
M2L520
M2M520
M2N520
M2J522
M2K521
M2L521
M2M521
M2N521
M2J523
M2K522
M2L522
M2M522
M2N522
M2J524
M2K523
M2L523
M2M523
M2N523
M2J525
M2K524
M2L524
M2M524
M2N524
M2J526
M2K525
M2L525
M2M525
M2N525
M2J527
M2K526
M2L526
M2M526
M2N526
M2J528
M2K527
M2L527
M2M527
M2N527
M2J529
M2K528
M2L528
M2M528
M2N528
M2J530
M2K529
M2L529
M2M529
M2N529
M2J531
M2K530
M2L530
M2M530
M2N530
M2J532
M2K531
M2L531
M2M531
M2N531
M2J533
M2K532
M2L532
M2M532
M2N532
M2J534
M2K533
M2L533
M2M533
M2N533
M2J535
M2K534
M2L534
M2M534
M2N534
M2J536
M2K535
M2L535
M2M535
M2N535
M2J537
M2K536
M2L536
M2M536
M2N536
M2J538
M2K537
M2L537
M2M537
M2N537
M2J539
M2K538
M2L538
M2M538
M2N538
M2J540
M2K539
M2L539
M2M539
M2N539
M2J541
M2K540
M2L540
M2M540
M2N540
M2J542
M2K541
M2L541
M2M541
M2N541
M2J543
M2K542
M2L542
M2M542
M2N542
M2J544
M2K543
M2L543
M2M543
M2N543
M2J545
M2K544
M2L544
M2M544
M2N544
M2J546
M2K545
M2L545
M2M545
M2N545
M2J547
M2K546
M2L546
M2M546
M2N546
M2J548
M2K547
M2L547
M2M547
M2N547
M2J549
M2K548
M2L548
M2M548
M2N548
M2J550
M2K549
M2L549
M2M549
M2N549
M2J551
M2K550
M2L550
M2M550
M2N550
M2J552
M2K551
M2L551
M2M551
M2N551
M2J553
M2K552
M2L552
M2M552
M2N552
M2J554
M2K553
M2L553
M2M553
M2N553
M2J555
M2K554
M2L554
M2M554
M2N554
M2J556
M2K555
M2L555
M2M555
M2N555
M2J557
M2K556
M2L556
M2M556
M2N556
M2J558
M2K557
M2L557
M2M557
M2N557
M2J559
M2K558
M2L558
M2M558
M2N558
M2J560
M2K559
M2L559
M2M559
M2N559
M2J561
M2K560
M2L560
M2M560
M2N560
M2J562
M2K561
M2L561
M2M561
M2N561
M2J563
M2K562
M2L562
M2M562
M2N562
M2J564
M2K563
M2L563
M2M563
M2N563
M2J565

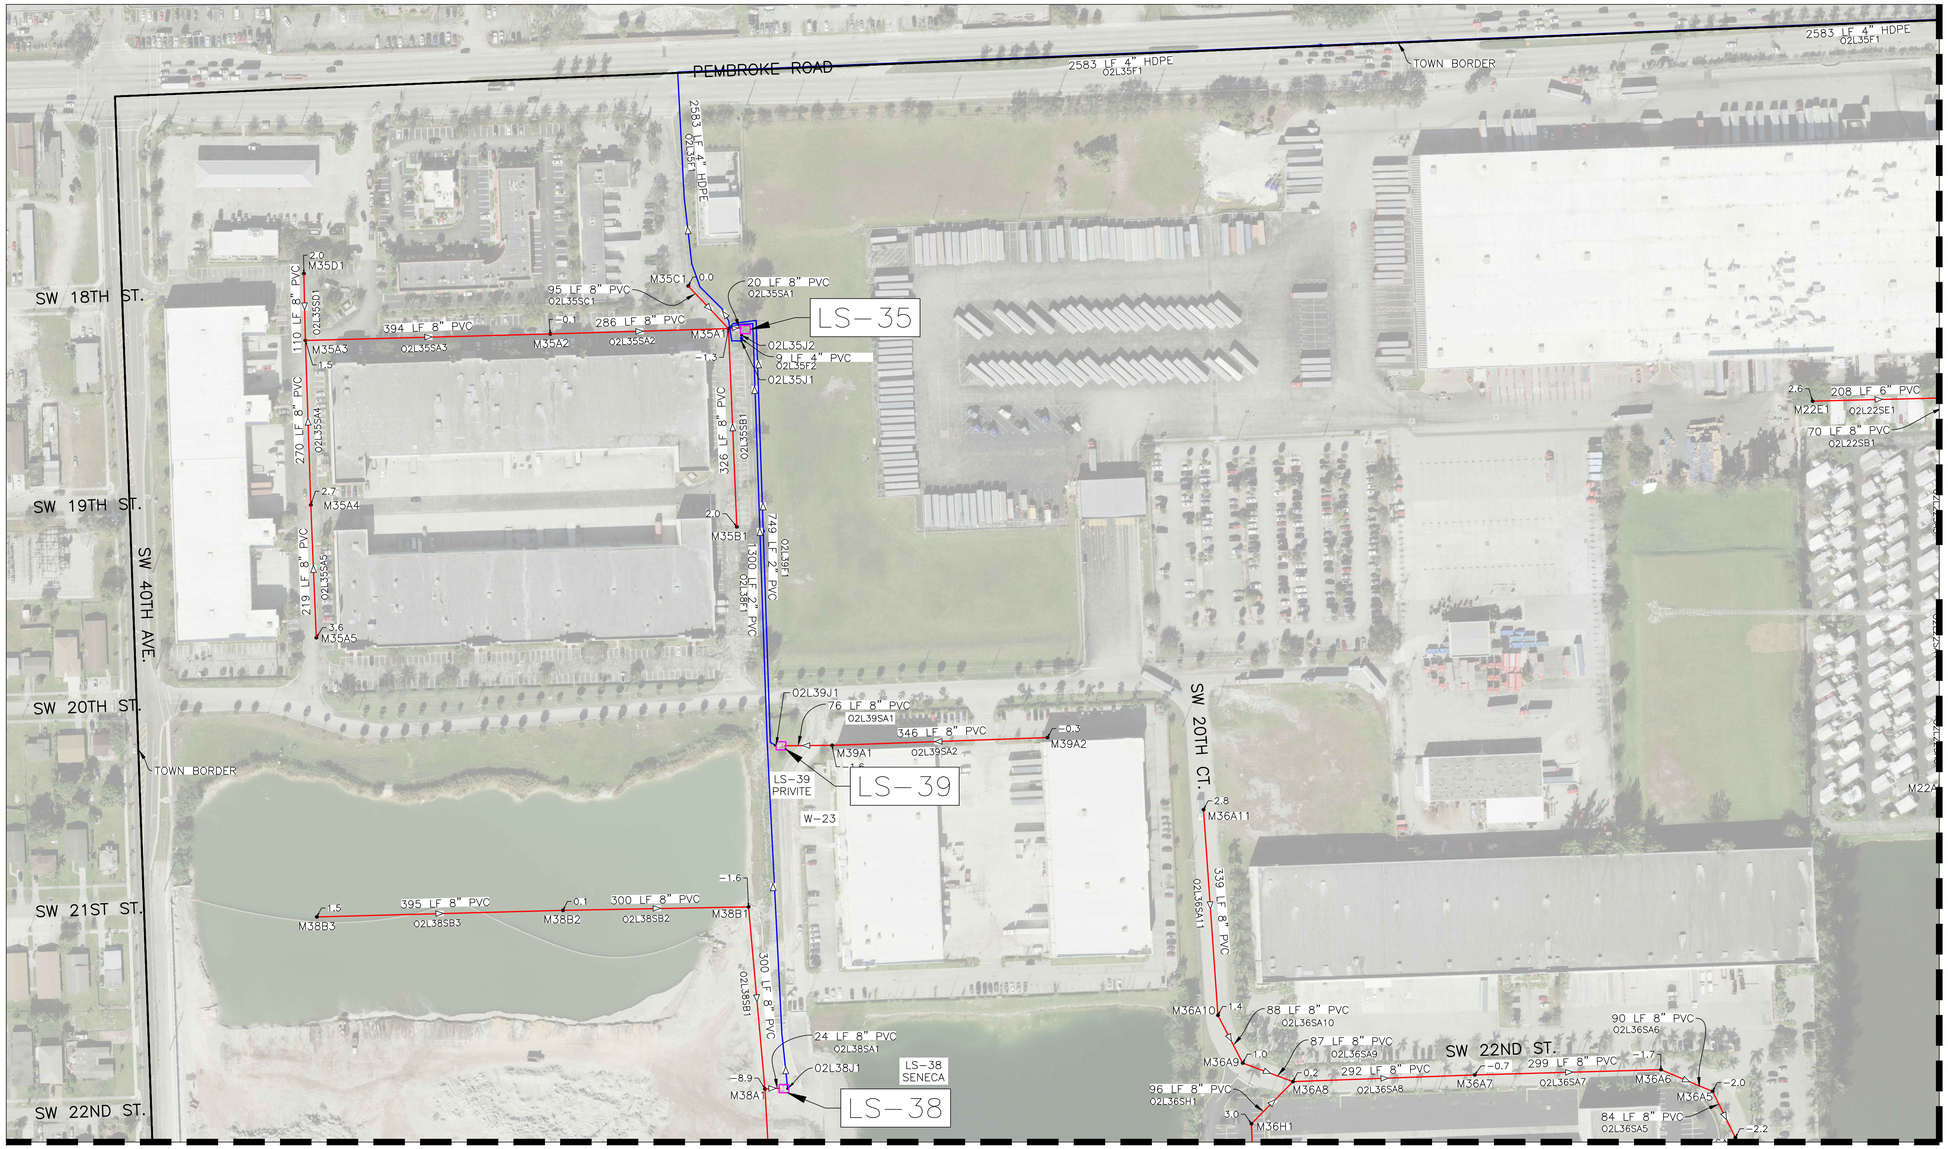

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
08 OF 14

LEGEND:

-1.7	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP: C-03, C-04, C-05, C-06, C-07, C-08, C-09, C-10, C-11, C-12, C-13, C-14

P:\Civil_Projects\Pembroke_Park\08-22-025-1\Wastewater\Plans\SHEETS\08-22-025-C-05-MLS5.dwg, 12/10/2024 1:55:57 PM, Josh.Ti

SEE SHEET C-08 FOR CONTINUATION



SEE SHEET C-10 FOR CONTINUATION

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88

ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
09 OF 14

LEGEND:

-1.7	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1


UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE



SEE SHEET C-09 FOR CONTINUATION

SEE SHEET C-05 FOR CONTINUATION

SEE SHEET C-06 FOR CONTINUATION

SW 28TH ST.

SW 40TH AVE.

TOWN BORDER

HALLANDALE BEACH BLVD.

308 LF 8" PVC
02L38J48
7.0
M38A8

02L48J1

LS-48

LS-33

LS-45

LS-12

LS-11

LS-10

LS-4

32 LF
2" PVC
02L33F2
02L33J2
02L33J1

821 LF1 8" ACP
02L33F1

02L45F2
39 LF
2" PVC
LS-45
02L12J2
02L45J2
02L45F1
118 LF 8" ACP
02L45J1
30 LF
4" PVC
02L12J1

02L12F2

02L11J1
02L11F2
41 LF
3" DIP
02L12F1

3764 LF 8" ACP

02L11F1
494 LF4 8" ACP
02L11J1

02L10J3
02L10F3
238 LF 6" PVC
5.5
104 LF
6" N/A
6.0
M10A2
M10A1
02L10SA1
02L10SA2
02L10J2
37 LF
3" DIP
TOWN BORDER
598 LF 8" ACP
02L10F2
02L10J1

SW 30TH ST.

1394 LF 4" DIP
02L36F41
02L36J3

1401 LF 8" DIP
02L36F1

M4G3
6.2
100 LF
6" CLAY
02L45G3
W LAKE DR.
M4G2
5.4
359 LF 6" CLAY
02L45G2
TOWN BORDER
M4G1
3.0
345 LF 6" CLAY
02L45G1
02L4J5
M4A
0.1
M4A2
0.3
18 LF 6" CLAY
02L45A2
02L4J4
02L4F5
30 LF
4" DIP
400 LF 6" CLAY
02L45H1
753 LF 4" ACP
02L4F4
2.5
M4H1
TOWN BORDER

SW 31ST ST.

SW 37TH TERR.

SW 37TH AVE.

SW 36TH AVE.

SW 35TH AVE.

SW 34TH AVE.

SW 33RD AVE.

SW 32ND AVE.

SW 31ST CT.

SW 32ND ST.

SW 32ND CT.

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
10 OF 14

LEGEND:

-1.7	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

N

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP

C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

SEE SHEET C-09 FOR CONTINUATION

SEE SHEET C-12 FOR CONTINUATION

SEE SHEET C-13 FOR CONTINUATION

SEE SHEET C-10 FOR CONTINUATION

SW 28TH ST.

SW 46TH AVE.

SW 44TH AVE.

SW 42ND AVE.

SW 40TH AVE.

TOWN BORDER

HALLANDALE BEACH BLVD.

LS-13

LS-15

LS-33

115 LF 8" PVC
02L13SA1

02L13J2
02L13F2
27 LF
3" PVC

02L13J1

311 LF 8" N/A M13A1
02L13SA2

M13A2

4.5

3.2

1330 LF 8" ACP
02L44F1

584 LF 8" ACP
02L13F1

02L15J2
02L15F2
27 LF
3" PVC

02L15J1

267 LF 8" PVC
02L15SA1

M15A1

1181 LF 8" ACP
02L15F1

SW 30TH ST.

32 LF
2" PVC
02L33F2

02L33J2

02L33J1

SW 31ST ST.

SW 31ST CT.

SW 32ND ST.

SW 31ST DR.

SW 47TH AVE.

SW 32ND DR.

SW 32ND CT.

SW 33RD DR.

SW 33RD ST.

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
11 OF 14

LEGEND:

-1.7-	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:


- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP

C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

P:\Civil_Projects\2022\08-22-025 - PEMBROKE PARK\Plans\Plan Set\08-22-025-C-11 - MASTER PLAN ATLAS.dwg, 12/15/2022 9:29:03 AM, jack.li

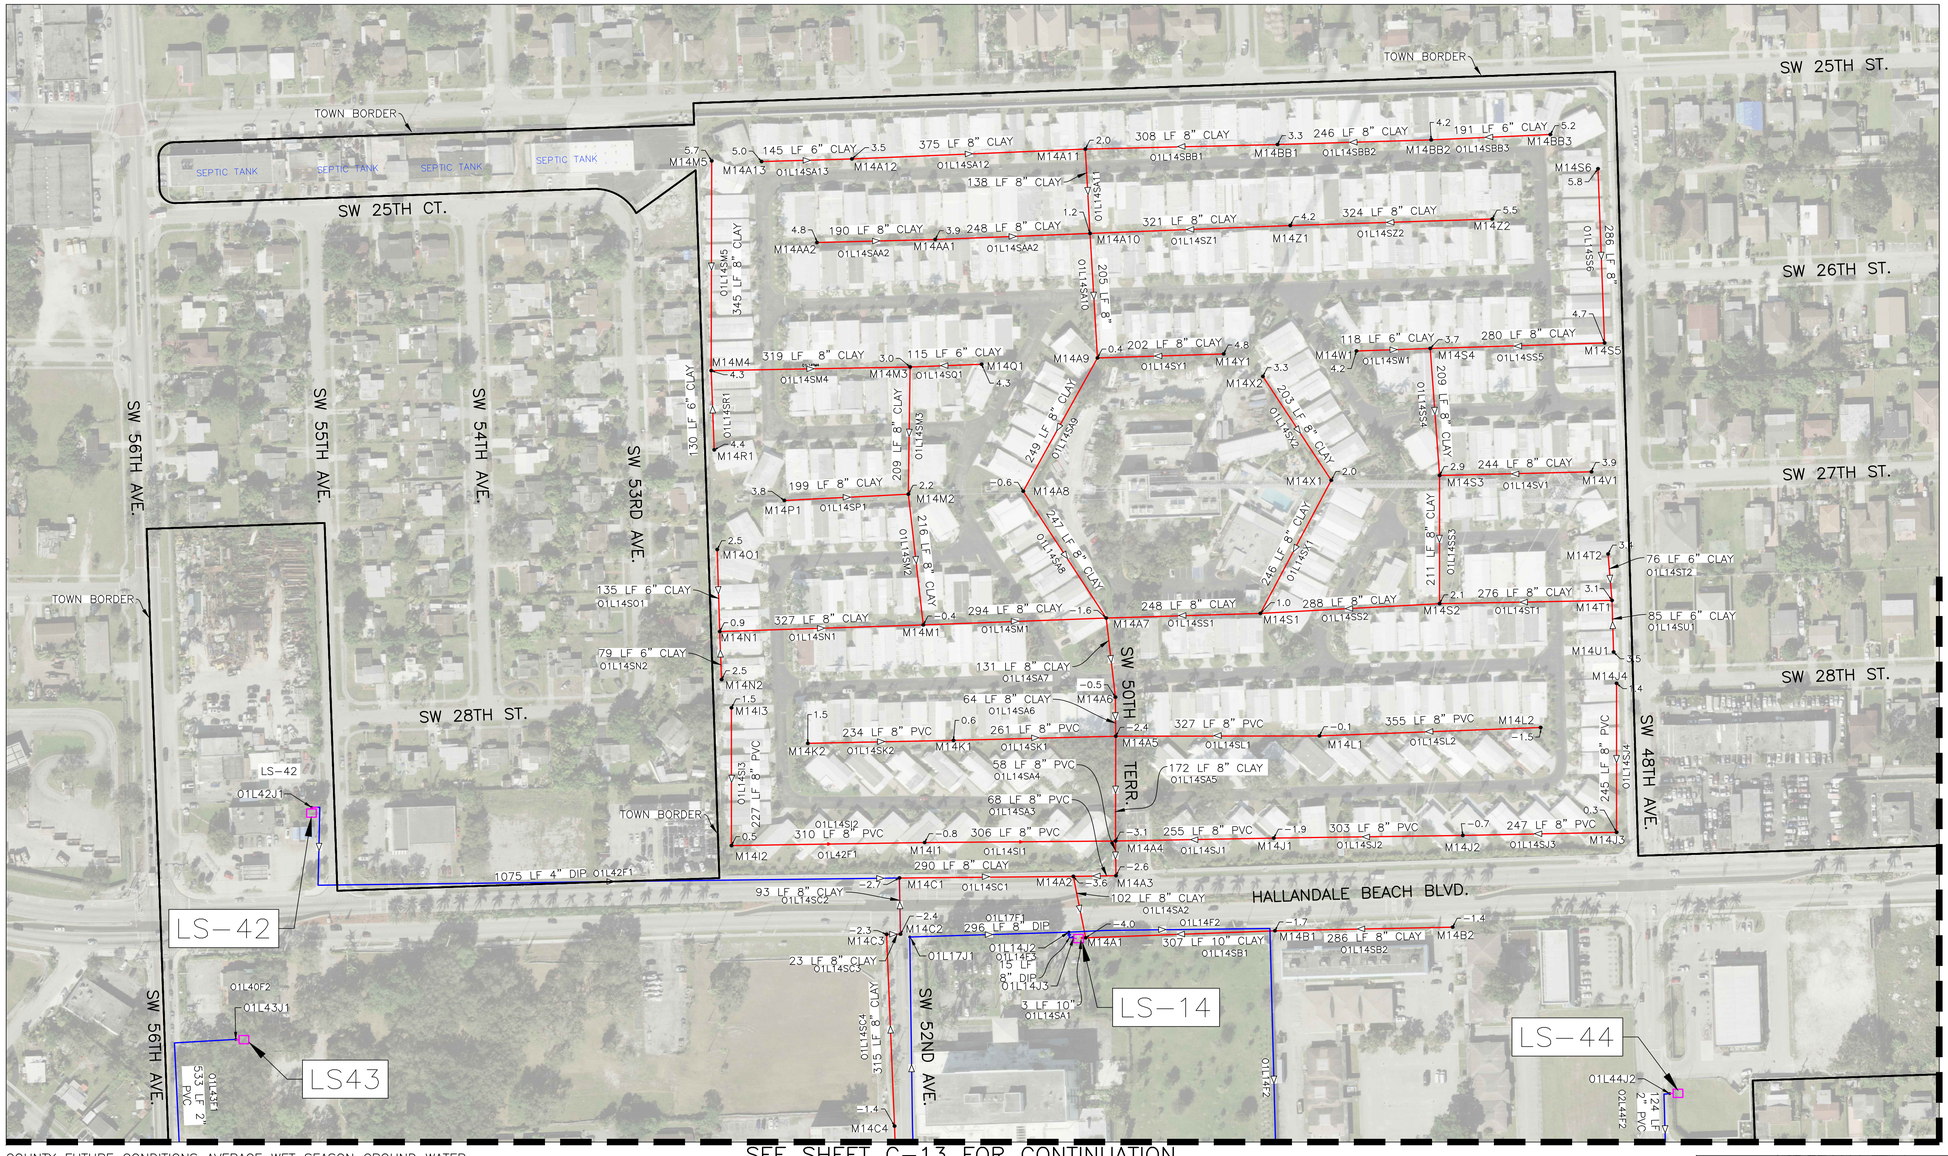

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

LEGEND:

-1.7	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

LEGEND:


- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

HORIZONTAL GRAPHIC SCALE
0 50 100 200

PROJECT NUMBER
08-22-025
12 OF 14

UPDATED WASTEWATER MASTER PLAN ATLAS


TOWN OF PEMBROKE PARK

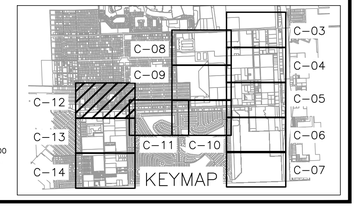

P:\Civil_Team_Town Projects_Part_2\25-22-025 - PBPBeachBasePlan\PLANS\25-22-025-C12-PLAN.dwg, 12/13/2024 9:01:25 AM, jack.li

SEE SHEET C-12 FOR CONTINUATION

SEE SHEET C-11 FOR CONTINUATION

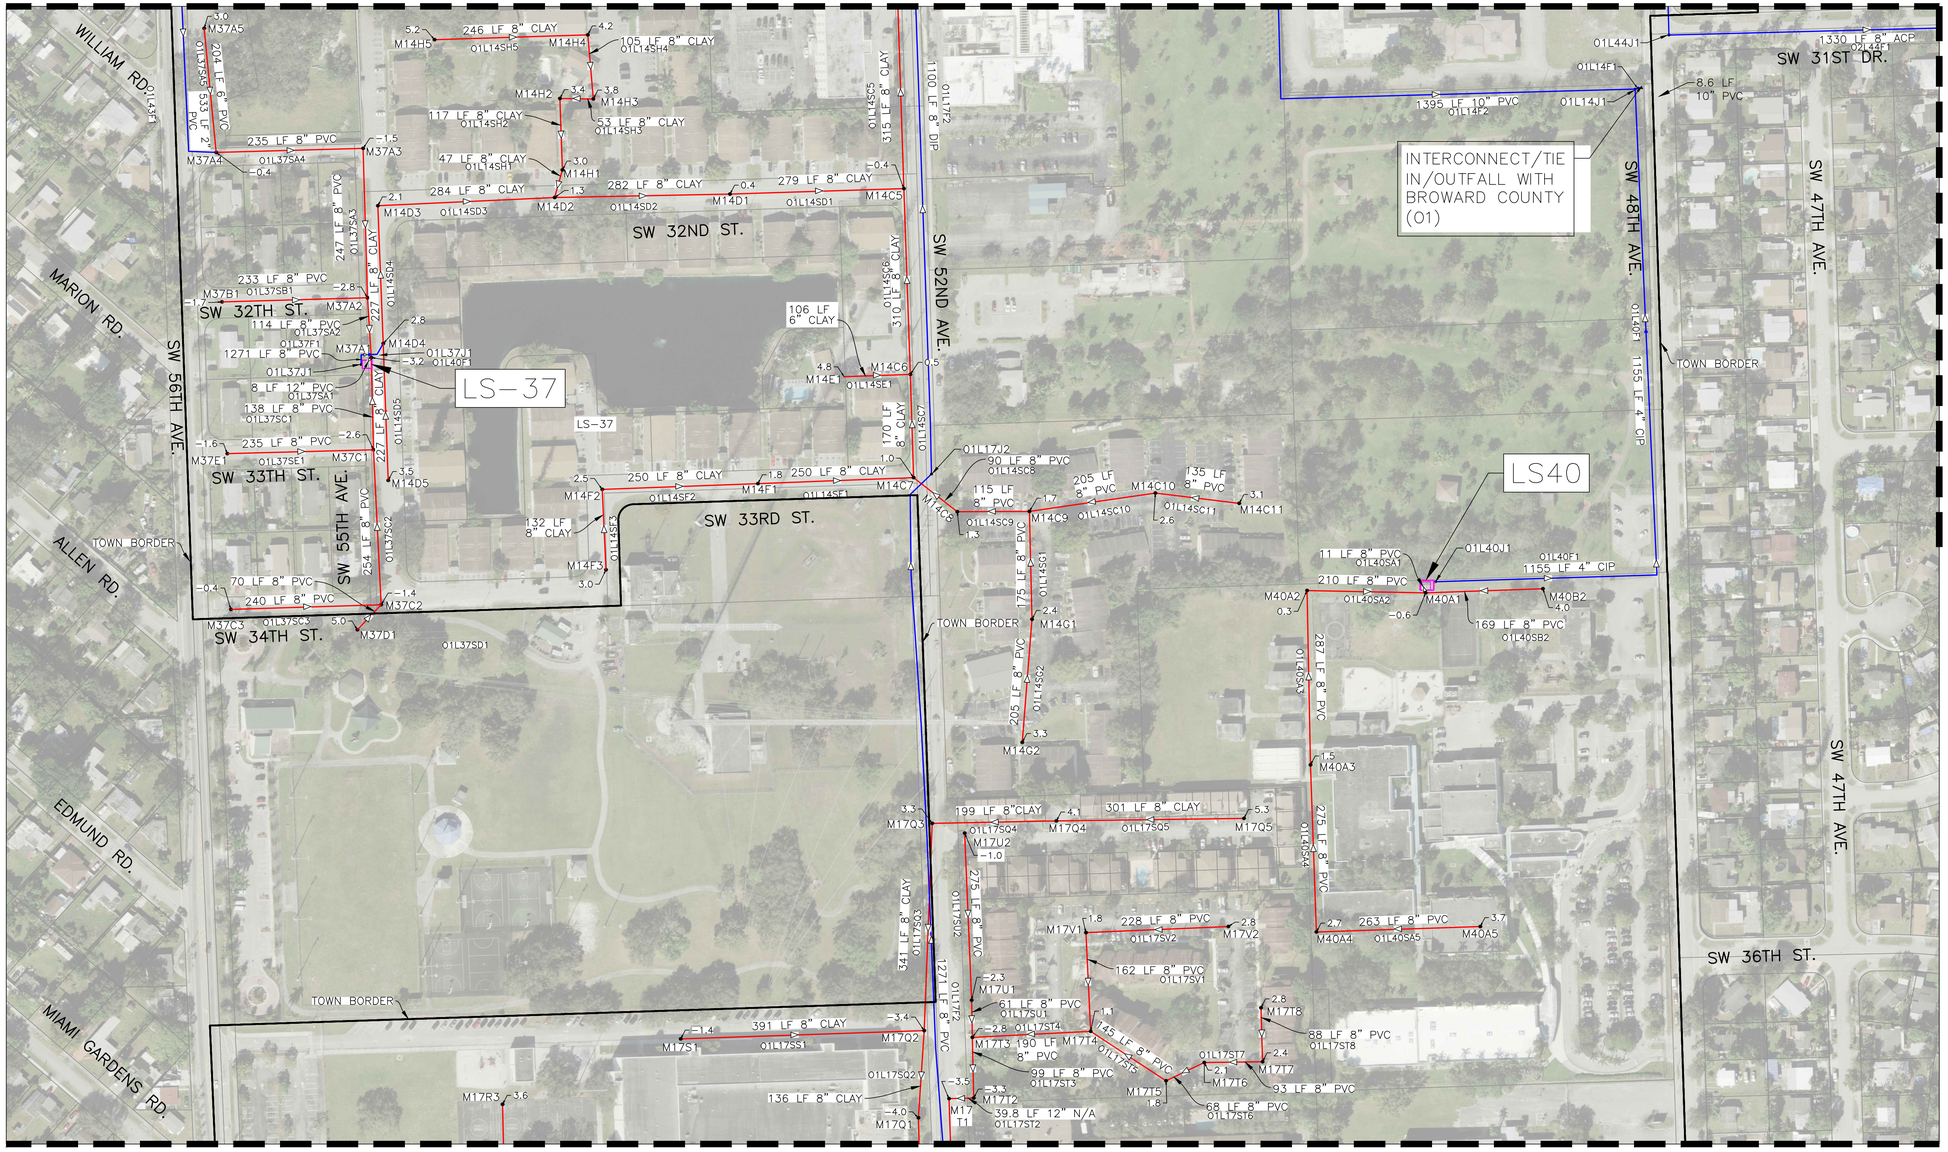

SEE SHEET C-14 FOR CONTINUATION

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

LEGEND:

-1.7	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1–LS14–SEWER BRANCH A–PIPE 2
01L14F2	FORCE MAIN: OUTFALL1–LS14–FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1–LS15–JUNCTION1

PROJECT NUMBER
08-22-025
13 OF 14


UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK


LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

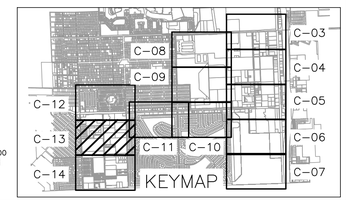

SEE SHEET C-13 FOR CONTINUATION

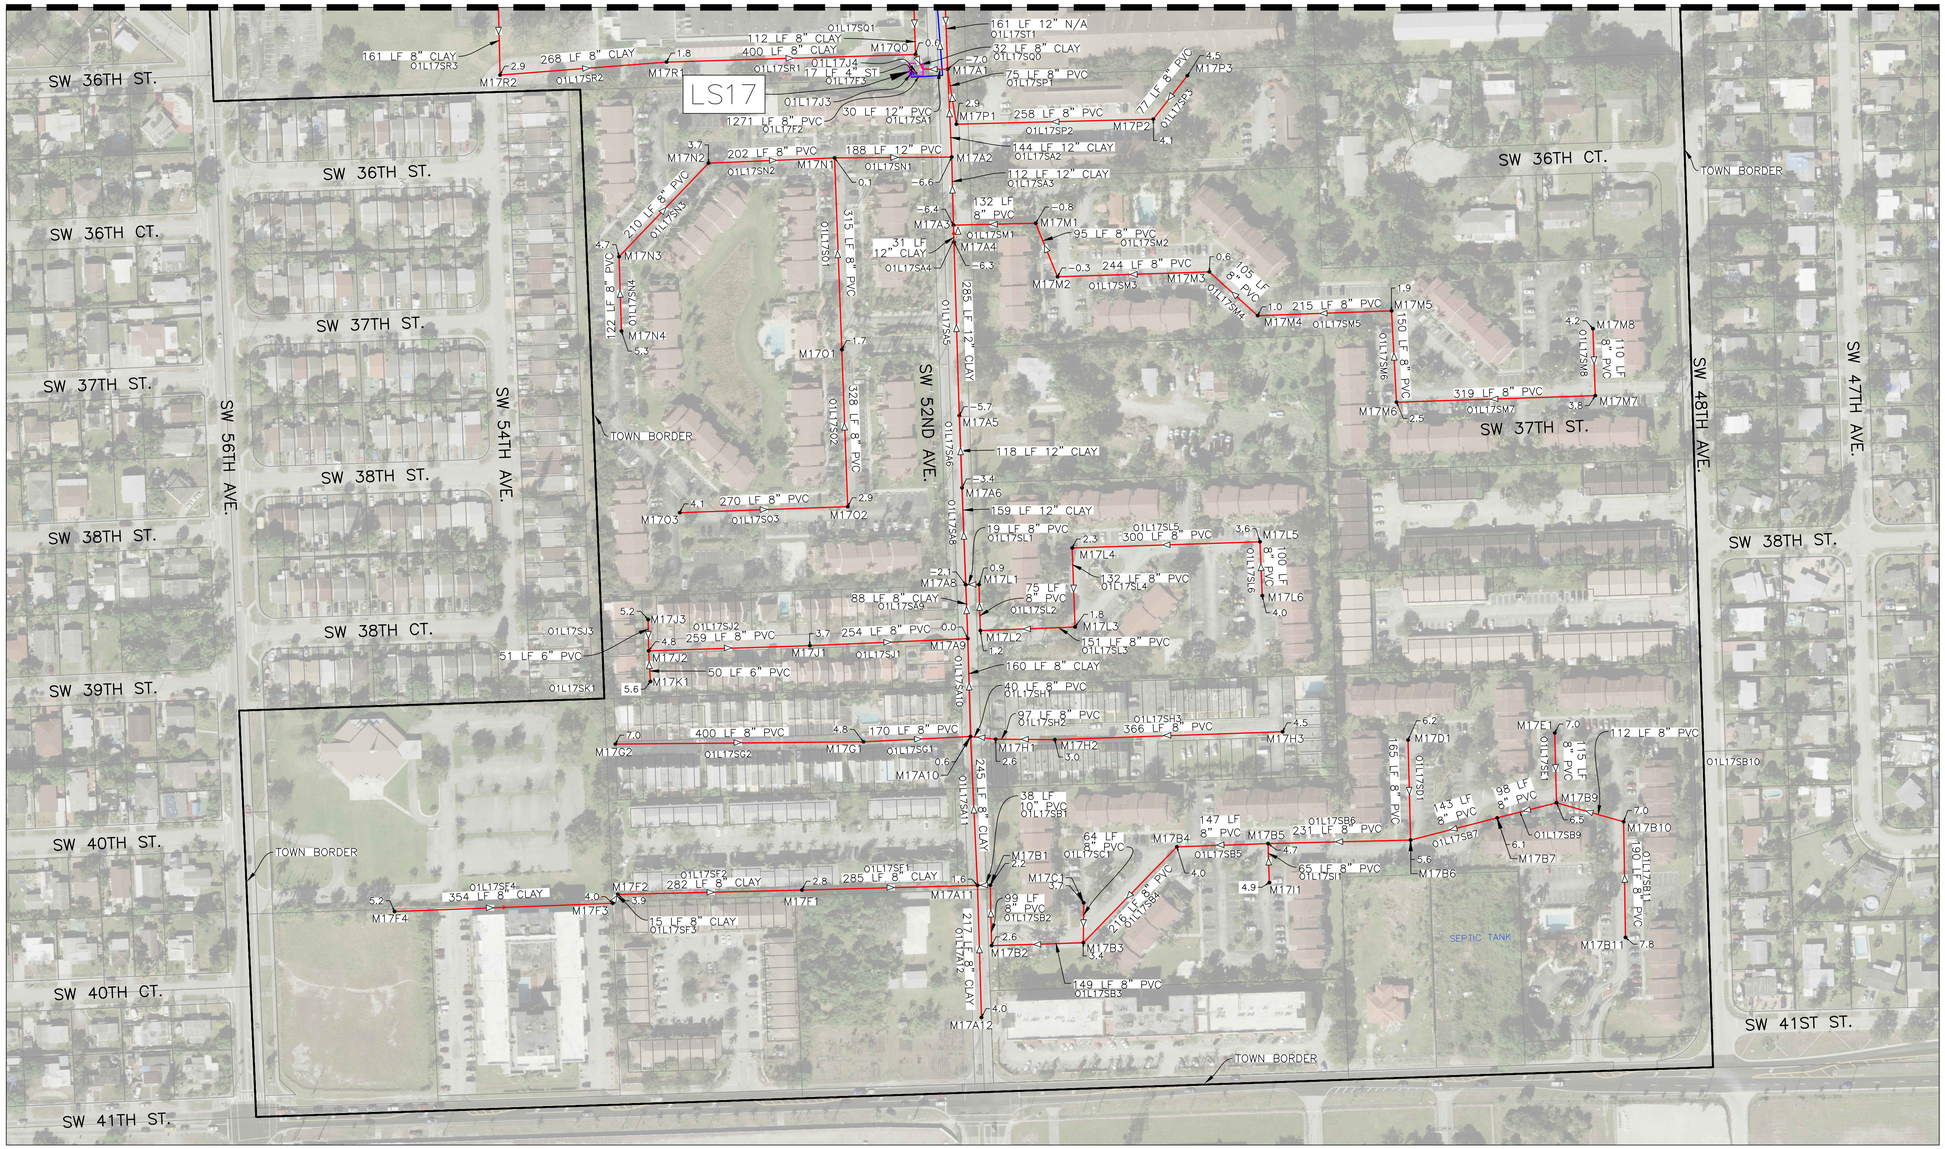

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
14 OF 14


LEGEND:
- −1.7 —— INVERT ELEVATION NAVD88
- M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
- 01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
- 01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
- 02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:
- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

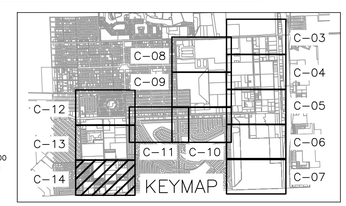

P:\Civil_Projects\Town of Pembroke Park\08-22-025 - PWS Master Plan\Plan\Plan\PEMPK 08-22-025-C-04 MXD Rev. 12-15-2023 8:46:29 AM, jpw, II

EXHIBIT A
CITY OF HOLLYWOOD LARGE USER'S AGREEMENT

R-90-121
9/5/90

LARGE USER WASTEWATER AGREEMENT

Between

THE CITY OF HOLLYWOOD, FLORIDA

and

PEMBROKE PARK, FLORIDA

LARGE USER WASTEWATER AGREEMENT
TABLE OF CONTENTS

ARTICLES		PAGE
ARTICLE I.	DEFINITIONS	2
ARTICLE II.	CONNECTION TO THE HOLLYWOOD SYSTEM . . .	8
	1. Points of Connection	8
	2. Easement Points of Connection . . .	8
	3. Maintenance of Pembroke Park's Facilities	8
	4. Service Area	9
	5. Future Flow Projections	10
	6. a. Hollywood's Obligation to. . . . Provide Wastewater Treatment Services	10 10
	b. Projected Flows (ADF).	11
	7. Meters	13
	8. Meter Maintenance	13
	9. Meter Accuracy	13
	10. Meter Failure	14
	11. Registration of Meter	14
	12. Meter Reading	14
ARTICLE III.	LIMITATIONS ON DISCHARGE OF CERTAIN WASTES	15
	1. Type of Waste to be Discharged . . .	15
	2. Compliance	19
	3. Sampling	21
	4. Regulatory Action	22
	5. Additional Charge for Wastes of Unusual Strength	23
	6. Emergency Action	24
ARTICLE IV.	CHARGES AND BILLING	25
	1. Annual Estimate	25
	2. Billings Procedure	25
	3. Additional Capacity	31
	4. Payment and Penalties for Nonpayment	32
	5. Dispute Over Amounts Billed	32
	6. Access to Records	33
ARTICLE V.	ADDITIONAL OBLIGATIONS OF THE PARTIES . .	34
	1. Expansion of the Hollywood Regional Wastewater Treatment Facilities . .	34
	2. Cost of Expansion of the Hollywood Regional Wastewater Treatment Facilities	34

	3. Pembroke Park's Obligation to Deliver Wastewater	35
	4. Pembroke Park's Cooperation	36
	5. Changes Required by Outside Agencies	36
	6. Adequate Rate Schedule	37
ARTICLE VI.	PROVISIONS RELATING TO TERMINATION OF AGREEMENT AND ASSIGNMENT OF HOLLYWOOD'S RIGHTS AND OBLIGATIONS . . .	38
	1. Termination Clause	38
	2. Sale, Lease or Transfer of the Hollywood System	41
ARTICLE VII.	PROVISIONS RELATING TO DEFAULT	44
	1. Default	44
	2. Dispute Over Monthly Billings . . .	45
	3. Non-Monetary Default	46
	4. Arbitration	46
	5. Litigation and Arbitration Costs . .	47
	6. Fines	47
	7. Force Majeure	47
ARTICLE VIII.	ADMINISTRATION	49
	1. Execution and Agreement	49
	2. LUAC	49
	3. Invalidity of Provision	50
	4. Legal Requirements	50
	5. Notice	50
	6. Prior Agreements	51
	7. Modification, Amendment or Alteration	51
	8. Findings	51
	9. Counterpart Execution	52

EXHIBITS:

A MAP OF HOLLYWOOD SYSTEM SERVICE AREA

B MAP OF PEMBROKE PARK'S SERVICE AREA

C MAP SHOWING POINTS OF CONNECTION AND METER LOCATIONS

D REPORT RELATING TO OPERATING, MAINTENANCE AND ADMINISTRATIVE COST DATA AND COMPUTATIONS AND ILLUSTRATIONS RELATING TO SAME

LARGE USER WASTEWATER AGREEMENT

THIS AGREEMENT made and entered into in Broward County, Florida, as of this 1st day of October, 1990, by and between the CITY OF HOLLYWOOD, a municipal corporation of the State of Florida (hereinafter referred to as "HOLLYWOOD"), and the PEMBROKE PARK, a municipal corporation of the State of Florida (hereinafter referred to as "PEMBROKE PARK")

W I T N E S S E T H:

WHEREAS, HOLLYWOOD and PEMBROKE PARK entered into that certain Large User Wastewater Agreement dated the 7th day of March, 1973, as amended, to provide for utilization of a common area wide wastewater collection, treatment and disposal facility (collectively the "Prior Agreement"); and

WHEREAS, the parties deem it mutually beneficial to continue to utilize the Hollywood Regional Wastewater Treatment and Disposal Facilities and the HOLLYWOOD Transmission Facilities, as such terms are defined herein; and

WHEREAS, the parties hereto have therefore determined to replace the Prior Agreement with this Agreement in order to provide for the technological advances, more stringent environmental regulations and governmental requirements which have occurred and which have caused the Prior Agreement to be inadequate to address current issues.

NOW, THEREFORE, for and in consideration of the mutual terms and conditions, promises, and covenants hereinafter set forth, HOLLYWOOD and PEMBROKE PARK agree as follows:

ARTICLE I. DEFINITIONS

Unless otherwise specifically set forth elsewhere herein, the following words and phrases used in this Agreement shall have the following meanings:

Any word or term related to "water" or "wastewater" shall have the definitions listed in the "Glossary - Water and Wastewater Control Engineering" 1981, Third Edition, published by the American Public Health Association, American Society of Civil Engineers, American Water Works Association and Water Pollution Control Federation.

1. "Annual Average Daily Flow" or "ADF" shall mean the flow determined by the total flow in gallons for a one year period divided by 365 days (or 366 days in the event of a leap year). The one year period shall be a Fiscal Year as defined herein.

2. "Consulting Engineer" shall mean that professional engineer or engineering firm selected and retained from time to time by HOLLYWOOD to perform engineering services pursuant to this Agreement.

3. "Debt Service Charges" (Treatment, Disposal and/or Transmission) shall include PEMBROKE PARK's applicable share of principal, interest, and coverage requirements on presently outstanding or new issues of revenue bonds, refunding bonds, bank financings or other obligations and including, but not limited to, bond agent fees, credit enhancement fees or service charges, heretofore or hereafter issued by HOLLYWOOD for the benefit of the Large Users and the HOLLYWOOD System. Each Large User's

applicable share of Debt Service Charges for upgrading and expansion shall be based on the formulae set forth in Article IV 2(b) hereof.

4. "Depreciation Charges" A proportionate share of the three (3%) percent per year depreciation on those portions of the HOLLYWOOD System constructed from revenues of HOLLYWOOD other than HOLLYWOOD sewer system bond proceeds and federal grants, as more particularly set forth in Article IV 2(c) below.

5. "Domestic Wastewater" shall mean such wastewater as is derived from residential dwellings, business buildings, institutions and the like.

6. "Financial Consultant" shall mean a firm of certified public accountants, engineers, economists, financial advisors, or any other qualified entity, selected by HOLLYWOOD from time to time to provide financial consultation services pertaining to this Agreement.

7. "Fiscal Year" shall mean a twelve (12) month period which commences on October 1st of each year and ends on September 30th of the following year.

8. "Hollywood Transmission Facilities" shall mean those facilities within the municipal jurisdiction of HOLLYWOOD, owned or operated, or both, by HOLLYWOOD, and shall include present facilities as well as any future facilities that are used now or will be used in the future for the purpose of transmitting wastewater to the Hollywood Treatment Facilities.

9. "Hollywood Regional Wastewater Treatment and Disposal Facilities" or "Hollywood Treatment Facilities" shall

mean those facilities owned or operated, or both, by HOLLYWOOD for the purpose of wastewater treatment and disposal, including any future additions, improvements or modifications to or extensions of these facilities that may occur from time to time, whether said facilities are within the municipal jurisdiction of HOLLYWOOD or not.

10. "Hollywood System" shall mean collectively the HOLLYWOOD Regional Wastewater Treatment and Disposal Facilities and the HOLLYWOOD Transmission Facilities, which System is hereby deemed to be a Publicly Owned Treatment Works (POTW) under 40 CFR 403. This term shall not include any physical facility that relates solely to the retail collection system of HOLLYWOOD. A map depicting the HOLLYWOOD System Service Area is attached hereto as Exhibit "A".

11. "PEMBROKE PARK System" shall mean the entire wastewater system including manholes, laterals, gravity sewers, lift stations, pumping stations, force mains, and the appurtenances thereto, and belonging to PEMBROKE PARK, whether within the corporate limits of PEMBROKE PARK or not.

12. "PEMBROKE PARK Service Area" shall mean the geographic boundaries in which: (i) PEMBROKE PARK is responsible for providing wastewater collection and transmission services to the HOLLYWOOD System, and (ii) HOLLYWOOD is responsible for providing treatment services to PEMBROKE PARK, both as more particularly described in Exhibit "B" attached hereto and made a part hereof. The parties agree that PEMBROKE PARK Service Area, as defined herein, shall also include any modifications to such

Service Area as a result of annexations, deannexations, or by mutual written agreement of the parties. Any change in PEMBROKE PARK's Service Area shall be deemed to automatically amend Exhibit B hereto, as necessary to correct the PEMBROKE PARK Service Area map.

13. "Industrial User" shall mean a user as defined in 40 CFR, as amended.

14. "Industrial Wastes" shall mean liquid wastes from any industrial process, cooling water discharge, or wastes exclusive of those which are Domestic Wastewater as defined in paragraph 5 of this Article.

15. "Infiltration and Inflow" shall mean water entering the sewer system and service connections from the ground (Infiltration) or water discharged into a sewer system or service connections from a roof, yard or street drains, cooling water discharges, manhole covers removed for storm drainage (Inflow). Infiltration and Inflow are mutually exclusive terms.

16. "Large User" shall mean any county, municipality, special district and any other entity which operates wastewater collection or transmission facilities which connect into the Hollywood System. The term "Large User" shall refer only to those counties, municipalities, special districts and other entities which have executed this form of agreement containing substantially the same terms and conditions. HOLLYWOOD shall be included within the defined term "Large User" when said term is used in conjunction with the obligations of the Large User for Debt Service Charges; Renewal, Replacement and Improvement

Account Charges; Depreciation Charges; and Operation, Maintenance and Administrative Costs; the flow projections contained in Article II hereof; the pretreatment requirements contained in Article III hereof; any penalty or compensatory charges set forth herein; and the non-monetary default provisions contained in Article VII hereof. When Hollywood is included as a Large User as set forth above, then Hollywood shall be bound by all terms, conditions, liabilities and obligations of all Large Users as set forth herein.

17. "Large Users' Advisory Committee" shall mean an advisory committee comprised of the appropriate and technically qualified representative of each of the Large Users, including HOLLYWOOD, and which shall have the rights and responsibilities set forth in Article VIII hereof.

18. "MGD" as used herein is an abbreviation for the term "million gallons per day."

19. "Operation, Maintenance and Administrative Costs" shall mean any reasonable and necessary expenses of operation, maintenance and administration of the HOLLYWOOD System, including but not limited to all HOLLYWOOD Treatment Facilities expenses, (including all costs attributable to the General Pretreatment Regulations, 40 CFR 403), allocable transmission expenses, allocable utility administration expenses, allocable utility accounting expenses, allocable general fund administration expenses, all as set forth more completely in composite Exhibit "D" attached hereto and made a part hereof.

20. "Points of Connection" shall mean those points where PEMBROKE PARK's system connects to the HOLLYWOOD System for the purpose of delivering PEMBROKE PARK's wastewater into the HOLLYWOOD System from PEMBROKE PARK's System, which points of connection are more particularly described as set forth in Article II below.

21. "Renewal, Replacement and Improvement Account Contribution" shall mean a monthly contribution, as more particularly described in Article IV 2(d) below, which contribution shall be in addition to all other charges due to HOLLYWOOD from PEMBROKE PARK, and shall be deposited into an account ("Renewal, Replacement and Improvement Account") to be established and utilized by HOLLYWOOD for renewal, replacement and improvement of the HOLLYWOOD System, as more particularly described in Article IV 2(d) below. The account established for PEMBROKE PARK shall be, through standard accounting techniques, segregated from any Renewal, Replacement and Improvement Account established by HOLLYWOOD for any other Large User.

ARTICLE II. CONNECTION TO THE HOLLYWOOD SYSTEM

1. Points of Connection.

The parties hereto agree that the points of connection of PEMBROKE PARK's System to the HOLLYWOOD System and meter locations shall be as set forth in Exhibit "C", attached hereto and made a part hereof.

2. Easement Points of Connection. HOLLYWOOD may locate the points of connection as per Exhibit "C" and provide for meter locations, and may locate meters on property currently being used by PEMBROKE PARK for wastewater transmission facilities. PEMBROKE PARK shall convey at no cost to HOLLYWOOD, an appropriate easement to the property as needed by HOLLYWOOD for the point of connection, meter locations, as necessary to provide ingress and egress to said facilities.

3. Maintenance of PEMBROKE PARK's Facilities.

a. PEMBROKE PARK agrees to keep facilities located within its Service Area or under control of PEMBROKE PARK through any agreement with the State, a county, or municipal government or authority or private party, in such condition so as to reasonably prevent any Infiltration or Inflow which would result in extraordinary levels of groundwater or storm water into PEMBROKE PARK's System, and thereby into the HOLLYWOOD System.

b. PEMBROKE PARK agrees to adopt, enact and enforce such rules, regulations or ordinances as may be required from time to time to ensure that PEMBROKE PARK, or users of PEMBROKE PARK's system are not discharging or causing to be discharged waters or waste which would cause PEMBROKE PARK's wastewater to

be unacceptable under the provisions of Article III of this Agreement.

c. PEMBROKE PARK agrees to be responsible for prompt implementation in its system of all actions required by any federal, state or local regulations imposed on HOLLYWOOD or the HOLLYWOOD System, or PEMBROKE PARK, either now or in the future with regard to the collection, treatment, transportation and disposal of wastewater, including, but not limited to, EPA general pretreatment requirements as contained in 40 CFR 403, and as same may be amended from time to time.

4. Service Area. PEMBROKE PARK agrees that it shall not accept wastewater from outside its Service Area for transmission to the HOLLYWOOD System unless PEMBROKE PARK receives approval from HOLLYWOOD and any regulatory agencies that have jurisdiction over the matter for said connection prior to its being made, with such approval being the subject of a written supplement or agreement which shall be attached hereto and made a part hereof. The parties hereto acknowledge that all contractual obligations regarding connection to and transmission to the HOLLYWOOD System existing as of the date of this Agreement, have been disclosed by each party to the other. Any agreement(s) between Large Users to exchange, trade, sell, assign or otherwise agree with respect to the use of each others flows within their respective Service Areas must be approved, in writing, by HOLLYWOOD. Unless otherwise expressly agreed to in writing, HOLLYWOOD has no obligation to accept or provide service for any wastewater which originates outside of PEMBROKE PARK's Service

Area. Subject to Article II, Section 6.B. hereof, PEMBROKE PARK agrees that it shall cause all wastewater flow generated within its present Service Area as defined in Exhibit "B", to be transmitted to the HOLLYWOOD System.

5. Future Flow Projections. PEMBROKE PARK agrees that it shall annually review its needs for wastewater transmission, treatment and disposal service, and shall, with advice and counsel of a professional engineer project its future ADF needs to the best of its knowledge and ability, for both the next ensuing Fiscal Year and the tenth year projection to HOLLYWOOD, by written notice, on or before March 1st of each year. Said projections shall be in such a format as may be requested by HOLLYWOOD from time to time and shall provide the following information:

(1) Average Daily Flow (MGD) for the next ensuing Fiscal Year; and

(2) Average Daily Flow (MGD) anticipated during the three months of greatest flow.

6.A. HOLLYWOOD's Obligation to Provide Wastewater Treatment Services. HOLLYWOOD acknowledges and agrees that in accordance with the terms and conditions of this Agreement and the other Large User Agreements, it has an affirmative, continuing obligation to provide wastewater treatment services to PEMBROKE PARK and the other Large Users with respect to wastewater flows within the Hollywood Service Area as shown on Exhibit A. HOLLYWOOD's obligation to provide wastewater services to PEMBROKE PARK shall continue until such time as this Agreement

is terminated in accordance with Article VI hereof, or until such time, if any, as HOLLYWOOD is ordered to stop treating PEMBROKE PARK's flows by injunction or final order of a court of competent jurisdiction or by a regulatory agency with the jurisdiction to issue such an order or injunction.

6.B. Projected Flows (ADF). PEMBROKE PARK acknowledges that HOLLYWOOD will rely on PEMBROKE PARK's future flow projections for ADF for the Fiscal Year 1999-2000, as set forth herein, in calculating and planning for the initial HOLLYWOOD System capacity expansion and the financing for same, and that any material increase or decrease in the amount of actual ADF from that disclosed or projected could seriously impact on HOLLYWOOD and the other Large Users with regard to their obligations concerning plant expansion and financing of same. Accordingly, except for those "Excess Flows" as defined herein, which PEMBROKE PARK elects to flow to an alternate system, PEMBROKE PARK agrees that it shall cause all wastewater collected within its Service Area as defined in Exhibit "B" hereto to be transmitted to the HOLLYWOOD System throughout the term of this Agreement. In addition, PEMBROKE PARK agrees that it shall not cause any wastewater collected within its Service Area, as defined in Exhibit "B" hereto, to be transmitted to the HOLLYWOOD System in excess of its projected flows set forth herein for the Fiscal Year 1999-2000 throughout the term of this Agreement, unless PEMBROKE PARK acquires or leases additional flow capacity from another Large User as set forth in Article II, Section 4, herein or unless HOLLYWOOD makes a further plant

capacity expansion to accommodate PEMBROKE PARK's additional flow needs. Debt Service Charges relating to any additional plant capacity expansions shall be borne by those Large Users who require said expansions in proportion to their respective needs.

PEMBROKE PARK hereby makes the following ADF Flow projections for the Fiscal Years indicated.

FISCAL YEAR 10/1-9/30	ADF (RESERVE CAPACITY MGD)
1988-1989	0.69
1999-2000*	1.00

* Fiscal Year 1999-2000 projections to be used by HOLLYWOOD for purposes of planning HOLLYWOOD System capacity expansion to the year 2000.

HOLLYWOOD shall have the right and power to enforce the limitation of its obligations hereunder either by suit or other proceedings at law or in equity and to take such action as necessary to prohibit PEMBROKE PARK from transmitting wastewater into HOLLYWOOD's Transmission and Treatment Facilities which exceeds 110% of the amount of PEMBROKE PARK's Annual Average Daily Flow as projected for a given Fiscal Year. Subject to obtaining HOLLYWOOD's and any regulatory agency's prior written consents, which consent from HOLLYWOOD shall not be unreasonably withheld, PEMBROKE PARK may transmit only those flows from within its Service Area which exceeds the ADF projected for Fiscal Year 1999-2000 (the "Excess Flows") as set forth above to available alternate systems for wastewater treatment. HOLLYWOOD shall have

no obligations or liabilities with respect to any Excess Flows which PEMBROKE PARK elects to transmit to any alternate system.

7. Meters. To the extent that HOLLYWOOD has not already done so, HOLLYWOOD shall furnish and install wastewater metering, recording and transmitting devices to be located at the sites as set forth in Exhibit "C". HOLLYWOOD shall retain ownership of the metering, recording and transmitting devices, together with any appurtenances thereto. PEMBROKE PARK shall reimburse HOLLYWOOD for the design, construction, calibration, and financing costs of such devices, to the extent that PEMBROKE PARK has not already done so, within thirty (30) days of receiving the invoice for said costs. The type of equipment selected shall be at the discretion of HOLLYWOOD; however, HOLLYWOOD shall require the manufacturer of the equipment to submit certified calibration tests to PEMBROKE PARK and HOLLYWOOD.

8. Meter Maintenance. HOLLYWOOD shall have a semi-annual inspection report prepared regarding the condition and accuracy of the metering device by a representative of the meter manufacturer. The expense for the annual inspection shall be an operating charge of the HOLLYWOOD facilities. A copy of this semi-annual report shall be furnished to PEMBROKE PARK.

9. Meter Accuracy. The parties hereto agree that should the metering equipment installed by HOLLYWOOD be found to be inaccurate beyond the manufacturer's range of accuracy, the meter will be assumed to be inaccurate since the last meter check or for a period of three (3) months, which ever time is less, and

the following month's billing will be adjusted to show a credit or additional charge to PEMBROKE PARK for metered flow for that period. If PEMBROKE PARK, for whatever reason, requests a meter report in addition to the semiannual reports, HOLLYWOOD will comply. If the meter was malfunctioning or required calibration, the expense associated with PEMBROKE PARK's request will be an operating expense to the HOLLYWOOD System. If the meter report indicates the meter was operating properly within the manufacturer's guaranteed range of accuracy, PEMBROKE PARK will be charged in the subsequent monthly bill for the expenses associated with the inspection.

10. Meter Failure. The parties agree that if at any time during this Agreement a metering device shall in any way fail to tabulate the flow into the HOLLYWOOD collection and treatment facilities, each successive monthly charge shall be based on the last available meter reading and adjusted to equal the same percent of total plant flow each month until the meter is once again fully operational.

11. Registration of Meter. Registration of a meter, when maintained as above, shall be binding on both parties for all wastewater flow charges. Access to the meters shall be available to PEMBROKE PARK upon request and in the presence of a representative of HOLLYWOOD.

12. Meter Reading. Meter reading for billing purposes shall occur as nearly as possible on the 25th day of each month.

ARTICLE III. LIMITATION ON DISCHARGE OF CERTAIN WASTES

1. Type of Waste to be Discharged.

a. Except as hereinafter provided, PEMBROKE PARK shall not discharge nor cause to be discharged any of the waters or wastes described in paragraph b. below, into the HOLLYWOOD System. All of the quality limitations enumerated below apply to concentrations or other physical characteristics obtained from analysis by HOLLYWOOD of representative samples of the waste collected, which samples upon request of PEMBROKE PARK in writing will be divided between HOLLYWOOD and PEMBROKE PARK. Such analysis as set forth herein shall be made in accordance with the latest edition of "Standard Methods for the Examination of Water and Wastewater" prepared and published jointly by the American Public Health Association, the American Waterworks Association and the Water Pollution Control Federation for so long as same is continued to be published. In the event these standards are no longer published, the parties shall agree on the standard for such analysis.

b. No person shall discharge or cause to be discharged any of the following described waters or wastes into the HOLLYWOOD System.

(1) Any inflow and that infiltration which can be deemed cost effective to correct.

(2) Any wastewater or vapor having a temperature higher than one hundred fifty (150^{o}) degrees Fahrenheit ($65^{o}C$).

(3) Any gasoline, benzene, naphtha, fuel oil or other flammable or explosive liquid, solid or gas.

(4) Any waters or wastes having a pH lower than 5.5 or higher than 9.5, or having any other corrosive property capable of causing damage or hazard to structures, equipment, or personnel of HOLLYWOOD.

(5) Any wastewater containing constituents in concentrations which are in excess of the concentrations set forth for normal wastewater:

BOD5	400 ppm
TSS	400 ppm
TKN	30 ppm
Phosphorus (P)	15 ppm
COD	800 ppm
TDS	2000 ppm

(6) Any waters containing toxic or poisonous solids, liquids or gases in sufficient quantities, which either singly or by interaction with other wastes, may injure or interfere with any waste treatment process, constitute a hazard to humans or animals, create a public nuisance, or create any hazard in the wastewater treatment plant, as sampled at or in the immediate vicinity of the point of discharge to the HOLLYWOOD System. The maximum limits for the below listed substances are:

Antimony	0.200 ppm
Arsenic	0.100 ppm
Barium	5.000 ppm
Beryllium	0.010 ppm
Bismuth	0.045 ppm
Boron	1.000 ppm
Cadmium	0.500 ppm
Chlorides	600.000 ppm
Chromium, Hexavalent	0.500 ppm
Chromium, Total	1.000 ppm
Cobalt	1.000 ppm
Copper, (Total)	2.000 ppm
Cyanides	0.250 ppm
Hydrogen Sulfide	3.000 ppm
Iron	10.000 ppm
Lead	0.400 ppm
Manganese	1.000 ppm

Mercury	0.100 ppm
Molybdenum	0.500 ppm
Nickel	1.800 ppm
Phenols	0.005 ppm
Selenium	0.100 ppm
Silver	0.240 ppm
Strontium	0.200 ppm
Tellurium	0.001 ppm
Tin	0.800 ppm
Toxic Radioactive Isotopes without a special permit	0.000 ppm
Zinc, (Total)	1.000 ppm
Pesticides	0.010 ppm
Herbicides	0.010 ppm
Fungicides	0.010 ppm

The maximum allowable values of the substances listed above may from time to time be revised by federal, state, local regulatory agencies, or HOLLYWOOD, if determined by the Consulting Engineer to be in the best interest of the Hollywood System, in which case PEMBROKE PARK agrees not to exceed such revised maximum limits. HOLLYWOOD shall provide PEMBROKE PARK, written notice, of any amendment or change to said schedule.

(7) Any solid or viscous substance in quantities or of such size capable of causing obstruction to the flow in the sewers or an interference with the proper operation of the wastewater facilities, such as, but not limited to, ashes, cans, sand, straw, shavings, metal, glass, tar, wax, lime slurry, lime residues, chemical residues and paint residues.

(8) Any wastewater containing more than twenty-five (25) milligrams per liter of petroleum oil, non-biodegradable cutting oils, or products of mineral oil origin.

(9) Any water or waste containing more than one hundred (100) milligrams per liter of biodegradable oils, fat,

grease or any oily substances, whether singularly or in a combination.

(10) Any water or wastes containing suspended solids or color or other such characteristics in quantity that unusual attention or expense is required to handle such material at the HOLLYWOOD facility, without a special permit.

(11) Any noxious or malodorous gas or substance which either singularly or by interaction with other wastes, is capable of creating a public nuisance or hazard to life, or which prevents or makes unduly hazardous the entry into sewers for maintenance and repair.

(12) Any water or wastes containing substances which are not amenable to treatment or reduction by the wastewater treatment processes employed, or are amenable to treatment only to such degree that the wastewater treatment plant effluent cannot meet the requirements of other agencies having jurisdiction over discharge to the receiving waters.

(13) Any waters or wastes which constitute a hazard to any structure or appurtenances of the HOLLYWOOD System.

(14) Any water or waste which singularly or in combination with other waters or wastes that inhibit or interfere with the treatment process or may render the treatment plant effluent toxic as determined by regulatory permit requirements.

(15) Any waters or wastes that render the sludge produced by the treatment plant to be other than a Class-I sludge as defined by Florida's Department of Environmental Regulation.

(16) Any substance or constituent in violation of "Federal (National) Categorical Pretreatment Standards" as issued by the United States Environmental Protection Agency, including any amendments or successor enactments thereto, or which exceeds, or would exceed, federal, state or local quality requirement, unless the discharge is allowable by a duly issued operating permit from the Broward County Environmental Quality Control Board.

2. Compliance.

(a) If at any time PEMBROKE PARK shall not comply with the restrictions imposed upon it in the preceding portion of this Article, or if PEMBROKE PARK shall create any condition which HOLLYWOOD should determine destructive to any part of HOLLYWOOD's System, HOLLYWOOD shall give thirty (30) days written notice to PEMBROKE PARK to discontinue such operation or practice, within which period PEMBROKE PARK agrees to comply. If PEMBROKE PARK does not initiate and/or establish a compliance program within ninety (90) days of notification, and/or if any damages result from the discharge of improper wastes by PEMBROKE PARK, HOLLYWOOD reserves the right to provide such preliminary treatment facilities or establish such programs as required to bring PEMBROKE PARK's discharge into compliance. PEMBROKE PARK will be responsible to HOLLYWOOD for all charges, both capital and operational for the establishment of these programs or facilities as described herein. Additionally, failure to comply with the conditions stipulated in Section 1 hereof, shall place PEMBROKE PARK in default of this Agreement.

(b) PEMBROKE PARK recognizes and agrees that HOLLYWOOD has the obligation and authority to perform the below as well as any future activities required by Environmental Protection Agency General Pretreatment Regulations, 40 CFR 403, Section 403.8, as set forth below: HOLLYWOOD agrees to notify PEMBROKE PARK, in writing, and will give PEMBROKE PARK the opportunity to take the appropriate action, prior to HOLLYWOOD taking any of the following actions.

(1) deny or condition new or increased contributions or pollutants, or changes in the nature of pollutants, to the HOLLYWOOD System by industrial user;

(2) require compliance with applicable pretreatment standards and requirements by industrial users;

(3) control, through permit, contract, order, or similar means, the contribution to the HOLLYWOOD System by each industrial user to ensure compliance with applicable pretreatment standards and requirements;

(4) require (a) the development of a compliance schedule by each industrial user for the installation of technology required to meet applicable pretreatment standards and requirements and (b) the submission of all notices and self-monitoring reports from industrial users as are necessary to assess and assure compliance by industrial users with pretreatment standards and requirements, including, but not limited to, the reports required in Paragraph 403.12;

(5) carry out all inspection, surveillance and monitoring procedures necessary to determine, independent of

information supplied by industrial users, compliance or non-compliance with applicable pretreatment standards and requirements by industrial users;

(6) obtain remedies for non-compliance by an industrial user with any pretreatment standard and requirement.

(c) The parties mutually agree that no statement contained herein shall be construed as preventing any special agreement or arrangement between HOLLYWOOD and PEMBROKE PARK or any user within PEMBROKE PARK's Service Area, whereby an industrial waste of unusual strength or charter may be accepted by HOLLYWOOD for treatment, subject to additional payment by PEMBROKE PARK, or said user.

(d) HOLLYWOOD agrees to provide PEMBROKE PARK with written notification of changes to the Regulations and a copy of the EPA required Pretreatment Annual Report.

(e) Nothing contained herein shall obligate PEMBROKE PARK to pay any costs incurred by HOLLYWOOD for pretreatment facilities required as a direct result of discharge of improper wastes into the HOLLYWOOD System by other Large Users.

3. Sampling.

a. PEMBROKE PARK agrees to include in the design of its wastewater delivery system a sampling station so that HOLLYWOOD can take representative samples of the wastewater as a means of monitoring the characteristics of the wastewater received from PEMBROKE PARK, and PEMBROKE PARK shall further provide to HOLLYWOOD such right-of-way or easements as may be

necessary to assure HOLLYWOOD of access to the sampling station site. HOLLYWOOD shall, upon notification to PEMBROKE PARK, have the right at any time to collect samples of sewage and industrial wastes at selected locations within PEMBROKE PARK's facilities for the purpose of making laboratory analysis of these wastes. The cost of collecting and then testing such samples shall be considered a HOLLYWOOD facility treatment and effluent disposal operating expense.

b. PEMBROKE PARK shall, upon written request, submit annually to HOLLYWOOD, no later than April 1 of each year, a laboratory analysis conducted by a State certified laboratory of composite samples of the combined Industrial and Domestic Wastes leaving PEMBROKE PARK's facilities at each point of connection. The costs for said submission shall be borne by PEMBROKE PARK. PEMBROKE PARK shall give HOLLYWOOD five (5) days written notice exclusive of Saturday, Sunday and holidays, of its intent to take the required samples, in order that HOLLYWOOD may be present at the time the sample is taken. The analysis made pursuant to this paragraph shall be made on twenty-four (24) hour representative samples and may include temperature, pH, and those substances listed in paragraph 1b(3), (5), (6), (8) and (9) above. HOLLYWOOD shall direct PEMBROKE PARK as to the particular samples, including pesticides, herbicides and/or fungicides for which analysis is required.

4. Regulatory Action.

a. PEMBROKE PARK agrees to adopt, enact and enforce such necessary rules, regulations and/or ordinances as

may be required so as to ensure that the users of PEMBROKE PARK's system do not discharge or cause to be discharged waters or wastes which would cause PEMBROKE PARK's wastewater to be unacceptable under the provisions of this Article, and to furnish to HOLLYWOOD certified copies of said regulations, rules and/or ordinances within one hundred eighty (180) days from the date of enactment of same or one hundred eighty (180) days from the date of this Agreement, whichever shall first occur.

b. PEMBROKE PARK shall be responsible for implementation in its system of federal, state or local regulations imposed on HOLLYWOOD or PEMBROKE PARK, either now or in the future.

5. Additional Charge for Wastes of Unusual Strength. In lieu of the remedies set forth in paragraph 2 of the Article above, in the event of a violation or default by PEMBROKE PARK pursuant to this Article, PEMBROKE PARK shall be subject to an additional charge which shall, upon imposition, be included in PEMBROKE PARK's monthly billing(s) subsequent to said determination by HOLLYWOOD. Designation of waste as being of unusual strength or character shall occur when the contributed wastewater parameters exceed those set forth in paragraph 1 of this Article. The additional charge shall be based upon HOLLYWOOD's total cost incurred in providing treatment, additional treatment programs, or additional facilities for the treatment of such wastes of unusual strengths. Any monies received from this Section shall be applied by HOLLYWOOD first to pay for the cost of correcting the problem caused by PEMBROKE

PARK and then to reduce the relevant operating expense of the HOLLYWOOD System.

6. Emergency Action. Notwithstanding anything to the contrary contained above, if at any time during the term of this Agreement, HOLLYWOOD determines, in its sole and absolute discretion, that PEMBROKE PARK's failure to comply with the restrictions imposed upon it by this Agreement constitutes such an immediate threat to the HOLLYWOOD System and/or the public health or safety so as to constitute an emergency situation requiring immediate remedial action, then, in that event, HOLLYWOOD may declare an emergency situation to exist and upon written notice to PEMBROKE PARK, may proceed to take whatever corrective action it deems necessary as to said emergency to prevent further nuisance or damage to HOLLYWOOD's System without the necessity of giving notice (other than notice of the emergency situation) to PEMBROKE PARK or affording PEMBROKE PARK an opportunity to remedy the situation. Any costs incurred by HOLLYWOOD in response to an emergency situation shall be charged to PEMBROKE PARK, and shall be the sole responsibility of PEMBROKE PARK to pay.

ARTICLE IV. CHARGES AND BILLING

1. Annual Estimate. HOLLYWOOD shall estimate all costs (on a Fiscal Year basis) of providing wastewater transmission, treatment, and disposal services to PEMBROKE PARK beginning with Fiscal Year 88-89. This annual estimate shall be the basis for PEMBROKE PARK's monthly billings during the next succeeding Fiscal Year. Adjustments will be made annually as described below based upon actual flows and actual costs when known.

2. Billings Procedure. The parties hereto agree that HOLLYWOOD shall provide wastewater transmission, treatment and disposal services to PEMBROKE PARK, at rates and charges constituting the full and actual costs of such service, including but not limited to Operation, Maintenance and Administrative costs, Renewal, Replacement and Improvement Account Contributions, Debt Service Charges, Depreciation Charges, and compensatory charges, and HOLLYWOOD shall set the same proportionate rates and charges for all Large Users of the HOLLYWOOD System. PEMBROKE PARK shall pay a monthly charge to HOLLYWOOD, as calculated pursuant to Section IV-1. above, for wastewater transmission, treatment and disposal services provided by HOLLYWOOD, commencing on the date of execution of this Agreement. Such charges shall be paid to HOLLYWOOD by PEMBROKE PARK monthly, and shall include the following components:

a. Operation, Maintenance and Administrative Costs. Operation, Maintenance and Administrative Costs are defined in Article I, paragraph 19 hereof, and will be estimated

for each Fiscal Year. The portion of the monthly charge to PEMBROKE PARK for Operation, Maintenance and Administrative Costs shall be based on the estimated rate per thousand gallons and shall be applied on actual flow used by PEMBROKE PARK during the billing period.

(1) Adjustment to Operation, Maintenance and Administrative Costs. At the end of each Fiscal Year, an annual adjustment shall be computed to determine PEMBROKE PARK's share of the actual Operation, Maintenance and Administrative Costs. This computation will be based upon the actual operation, maintenance and administrative expenses recorded for the HOLLYWOOD System for that Fiscal Year, multiplied by PEMBROKE PARK's percentage of the actual number of gallons of wastewater treated and disposed of through the HOLLYWOOD System for that Fiscal Year. Each adjustment in the operation, maintenance and administrative monthly charges shall be made subsequent to, and subject to final verification of the operation, maintenance and administrative expenses incurred which verification shall be included in the annual review of said charges. The above-referenced annual review shall be performed by an independent Financial Consultant selected by HOLLYWOOD and shall be distributed to PEMBROKE PARK on or before March 31 of the year following the end of each Fiscal Year. In the event the annual adjustment reflects that an underpayment has been made by PEMBROKE PARK with regard to Operation, Maintenance and Administrative Costs, then the amount due and owing for said underpayment shall be shown as a separate line item on the next

monthly bill sent to PEMBROKE PARK after the adjustment has been made. In the event the annual adjustment reflects that an overpayment has been made by PEMBROKE PARK, with regard to Operation, Maintenance and Administrative Costs, then in that event the amount of said overpayment shall be credited to PEMBROKE PARK as a separate line item on the next monthly bill after the adjustment has been made.

b. Debt Service Charges. Debt Service Charges, as defined in Article I, paragraph 3, for the HOLLYWOOD System shall be computed annually as follows: (i) with respect to projects relating to improvement and upgrading of the HOLLYWOOD System, PEMBROKE PARK's Debt Service Charges shall be computed annually by taking the ratio of the amount of PEMBROKE PARK's actual flow to the total flow of the HOLLYWOOD System for each Fiscal Year, multiplied annually by the total debt service due in that Fiscal Year for such upgrading project(s); (ii) with respect to projects relating to the initial plant capacity expansion of the HOLLYWOOD System, PEMBROKE PARK's Debt Service Charges shall be computed annually by taking the difference between PEMBROKE PARK's actual ADF Flows for Fiscal Year 1988-89 and PEMBROKE PARK's projected ADF Flow for the Fiscal Year 1999-2000 and then dividing that difference by the projected increase in capacity in the HOLLYWOOD System over and above the total System capacity for the Fiscal Year 1988-1989 as a result of such planned capacity expansion; and then multiplying that fraction by the total debt service due in that Fiscal Year for such expansion project(s); provided however, PEMBROKE PARK's Debt Service Charges with

respect to this initial capacity expansion financing will be adjusted pursuant to Article II, Section 6.B. in the event that PEMBROKE PARK's actual flows exceed its projected flows for Fiscal Year 1999-2000; and (iii) with respect to projects relating to transmission pipes and related transmission facilities within the HOLLYWOOD System, PEMBROKE PARK's Debt Service Charges shall be computed annually by multiplying the proportional cost, based on design, of the new transmission facilities which are required by PEMBROKE PARK by the total debt service due in that Fiscal Year for such transmission project. In addition, except as otherwise set forth in Exhibit "D" hereto, any Debt Service Charges which may be due HOLLYWOOD from PEMBROKE PARK by reason of any financings relating to the HOLLYWOOD System under the Prior Agreement (other than financings for transmission) shall be recalculated in accordance with the applicable formulae set forth above. The above described formulae are illustrated in Exhibit "D" attached hereto. In determining which projects are related to upgrading or expansion of the Hollywood System, prudent engineering judgment shall be used. The Debt Service Charges relating to any additional plant capacity expansions of the HOLLYWOOD System shall be borne by the Large Users who require said expansion in proportion to their respective needs.

c. Depreciation Charges. Depreciation Charges as defined in Article I, paragraph 4 above, shall be computed based on PEMBROKE PARK's proportionate share (as established in the Prior Agreement) of the three (3%) percent per year depreciation

on the existing facilities constructed from revenues of HOLLYWOOD other than the HOLLYWOOD Sewer System Bond proceeds and federal grants; the cost of said facilities being One Million Ninety-Six Thousand Eight Hundred Sixty and 74/100 ($1,096,860.74) Dollars.

d. Renewal, Replacement and Improvement Account Contribution.

(1) Funds from the Renewal, Replacement and Improvement Account, shall be used for the improvement, repair and replacement of the HOLLYWOOD System. Said Account shall be funded through contributions made monthly by PEMBROKE PARK to said account. As of October 1, 1988, the balance in PEMBROKE PARK's Account is deemed to be zero, and all other amounts on deposit in said account shall be carried forward. HOLLYWOOD shall maintain a separate Renewal, Replacement and Improvement Account for each Large User. Any amounts collected by HOLLYWOOD for PEMBROKE PARK's Account shall be utilized by HOLLYWOOD only for renewals, replacements and improvements to the HOLLYWOOD System. HOLLYWOOD shall use prudent engineering judgment in determining the need for renewal, replacement and improvement projects. Expenditure of funds on deposit in each Large User's RR&I Account shall be made based on their respective percentage of the total System flows. The contributions made by PEMBROKE PARK to the Account shall be in addition to all other charges collected by HOLLYWOOD set forth herein. Except as otherwise provided herein, PEMBROKE PARK's monthly contribution to this Account shall be ten percent (10%) of PEMBROKE PARK's monthly total bill for wastewater transmission and treatment, including,

but not limited to, Debt Service Charges, Depreciation Charges, and Operation, Maintenance and Administrative Costs. Payments to said Account shall continue to be made monthly at the aforestated rate until such time as PEMBROKE PARK's Account contains funds equal to PEMBROKE PARK's share of a maximum amount of five (5%) percent of the actual cost of the HOLLYWOOD System, and as said System may be expanded from time to time. During any period in which PEMBROKE PARK's Account is maintained at a level equaling its pro rata share of five percent (5%) of the actual cost of the HOLLYWOOD System, as expanded, no monthly payments shall be due from PEMBROKE PARK to this Account; provided, however, that pursuant to this Article, the maximum level may be modified from time to time, in which event PEMBROKE PARK shall resume making monthly payments to this Account until its required contribution level is reached. In the event the balance in PEMBROKE PARK's Account shall at any time fall below the maximum prescribed level set forth herein, then at that time PEMBROKE PARK shall resume making monthly payments in accordance with this paragraph so as to bring the balance in said Account to the maximum prescribed level. Said Account shall include any unexpended monies deposited since October 1, 1988, remaining on deposit in the special renewal or replacement and improvement fund established under the Prior Agreement between the parties. Contributions to the Renewal, Replacement and Improvement Account shall earn interest at HOLLYWOOD's pooled fund interest rate, which interest shall be credited annually based on the average monthly balance in PEMBROKE PARK's Account.

(2) In the event it is necessary to renew, replace or improve an element of the HOLLYWOOD System for which sufficient funds are not available in the Renewal, Replacement and Improvement Account established for PEMBROKE PARK, HOLLYWOOD shall notify PEMBROKE PARK of the deficiency in said Account. PEMBROKE PARK shall have a period of sixty (60) days from the date of said notification to contribute any said deficiency to the Renewal, Replacement and Improvement Account. In the event PEMBROKE PARK has not made said deficiency contribution within sixty (60) days of the date of notification of the deficiency by HOLLYWOOD, HOLLYWOOD, at its option may: (i) obtain financing necessary to fund the deficiency, in which event PEMBROKE PARK shall pay the cost of said financing as additional Debt Service Charges; or (ii) HOLLYWOOD may fund the deficiency internally, in which event PEMBROKE PARK shall repay HOLLYWOOD the amount of the deficiency, plus interest at HOLLYWOOD's earned interest rate as an additional monthly charge to PEMBROKE PARK, over a period of not less than sixty (60) months and not greater than one hundred twenty (120) months.

3. Additional Capacity. At such time as financing is secured for construction of additional facilities as contemplated in Article V below, so as to service the various Large Users, or it becomes necessary for PEMBROKE PARK to secure additional transmission or treatment capacity, PEMBROKE PARK shall pay all additional Debt Service Charges based on the formulae set forth in Article IV, 2(b) hereof.

4. Payment and Penalties for Nonpayment. The parties agree that HOLLYWOOD shall bill PEMBROKE PARK for providing the services necessary for wastewater treatment, transmission and disposal, on a monthly basis in accordance with HOLLYWOOD's standard billing procedures. PEMBROKE PARK shall pay such billings within forty-five (45) days of the receipt of the monthly bill. Should a billing or a portion of the billing be outstanding for a period of more than forty-five (45) days from the date of receipt of the original billing, then PEMBROKE PARK shall be considered in default of this Agreement. Should PEMBROKE PARK not pay within the forty-five (45) day period set forth herein, PEMBROKE PARK shall pay interest on the unpaid balance at the rate of twelve percent (12%) per annum.

5. Dispute Over Amounts Billed. PEMBROKE PARK agrees that in the event of a dispute as to a billing invoice or the amount PEMBROKE PARK owes on a monthly bill, and which dispute the parties cannot resolve within forty-five (45) days from the date of receipt of the original invoice, then PEMBROKE PARK shall automatically deliver to HOLLYWOOD the total amount billed and an adjustment of the billing invoice amount, if any, shall be made subject to subsequent agreement or adjudication. The amount of such charge that is in dispute shall be held in escrow by HOLLYWOOD until the dispute is resolved, provided however, that in the event the disputed amount relates to Debt Service Charges, then HOLLYWOOD shall be entitled to apply such disputed amount to make debt service payments when due.

6. Access to Records. HOLLYWOOD agrees that it shall maintain accurate accounting records for the wastewater collection, treatment and disposal facilities, and that HOLLYWOOD will make available to PEMBROKE PARK for inspection or review said records upon reasonable advance notice (at least fifteen 15 days) and specific written request as to the records requested. Any questions or explanations necessary as to the information contained in such records shall be addressed at the Large Users' Advisory Committee meetings.

ARTICLE V. ADDITIONAL OBLIGATIONS OF THE PARTIES

1. Expansion of the Hollywood Regional Wastewater Treatment Facilities. HOLLYWOOD and PEMBROKE PARK acknowledge that the present rated capacity of the HOLLYWOOD Regional Wastewater Treatment Facilities is 38 MGD, and that subsequent to the execution of this Agreement and similar agreements between HOLLYWOOD and the other Large Users, that the HOLLYWOOD System is planned to be initially expanded to treat the total projected flow requirements for the year 1999-2000 of all Large Users, including HOLLYWOOD. In the event that any further plant expansion(s) become necessary, then the costs, including the Debt Service Charges, relating to such additional expansion(s) shall be borne by those Large Users who require said expansion(s) in proportion to their respective needs. In the event that the HOLLYWOOD System is rerated without any capital expenditure to an MGD in excess of its then current capacity by an agency with regulatory authority to rerate the capacity of the plant, then each of the Large Users, including HOLLYWOOD, shall be given credit for such increased capacity on a pro rata basis in proportion to their maximum projected reserved flows set forth in Article II, Section 6.B. hereof as adjusted or amended, as a percentage of total projected reserved flows for all Large Users into the HOLLYWOOD System at the time of rerating.

2. Cost of Expansion of the Hollywood Regional Wastewater Treatment Facilities. At such time as HOLLYWOOD, determines it is necessary, in order to respond to the needs of the Large Users utilizing the HOLLYWOOD System, to expand the

HOLLYWOOD System, HOLLYWOOD shall charge PEMBROKE PARK monthly one-twelfth (1/12) of PEMBROKE PARK's annual Debt Service Charges then due attributable to said expansion which shall be computed in accordance with the formulae set forth in Article IV, 2(b) hereof. Said Debt Service Charges will be imposed at the time that HOLLYWOOD incurs the debt.

Nothing contained herein shall obligate HOLLYWOOD to undertake financing, either by issuing wastewater system revenue bonds, or any other financial mechanism, without the cooperation of PEMBROKE PARK, and the other Large Users and PEMBROKE PARK agrees to cooperate and execute any reasonably necessary document that may be required by the credit enhancement provider, bond insurer or rating agencies in order for HOLLYWOOD to obtain the financing for the expansion contemplated herein, including, documents, representations and consents, if any, required by bond rating agencies and municipal bond insurers or credit enhancement providers in connection with obtaining a credit rating or bond insurance on the bonded obligations; provided however, that PEMBROKE PARK shall not be required to execute any document or note that creates a bonded indebtedness directly to PEMBROKE PARK.

3. PEMBROKE PARK's Obligation to Deliver Wastewater. Except as otherwise provided in Article II hereof, PEMBROKE PARK agrees that during the term of this Agreement, it shall deliver all existing, and future wastewater flows collected by it, from within its Service Area as set forth in Exhibit "B", to the HOLLYWOOD System, and HOLLYWOOD agrees to accept such wastewater

flows from PEMBROKE PARK's Service Area on the terms and conditions set forth herein.

4. PEMBROKE PARK's Cooperation. PEMBROKE PARK agrees to cooperate and execute any necessary documents to effect the agreements contained herein, and to cooperate with HOLLYWOOD under the terms of the Florida Intergovernmental Cooperation Act as may be required from time to time in furtherance of this Agreement, and PEMBROKE PARK further agrees that it shall take no action which would jeopardize the tax exempt status, pursuant to the Internal Revenue Code, as amended from time to time, of the interest on any debt now or hereafter issued to finance the HOLLYWOOD System.

5. Changes Required by Outside Agencies. Notwithstanding HOLLYWOOD's obligations with respect to treating and disposing PEMBROKE PARK's flows as provided herein, HOLLYWOOD may revise the schedule of flows set forth herein in the event any federal, state or local agency having jurisdiction promulgates rules and regulations that would affect the amount or quality of flow HOLLYWOOD can treat or dispose. In that event, the parties agree to comply with any such rule or regulation and make such amendments to this Agreement as may be necessary, provided, however, that should there be a determination by either party that the rules or regulations so promulgated are unreasonable or not binding, the parties hereto reserve the right to challenge said regulations. HOLLYWOOD and PEMBROKE PARK acknowledge that certain federal, state and local agencies have jurisdiction or control over pollution matters and, should such

agency issue legal and enforceable orders or rules that may alter any of the terms and conditions of this Agreement, there shall be no liability on either party by reason of such action, provided that HOLLYWOOD shall not be precluded from making any necessary adjustments to the sewage collection and treatment rates; provided further, that any increased costs incurred by HOLLYWOOD from any such action shall be assessed pro rata to PEMBROKE PARK based on PEMBROKE PARK's actual flows; unless said adjustments are occasioned solely by the acts of Large Users other than PEMBROKE PARK, in which case PEMBROKE PARK shall not be liable for said adjustments.

6. Adequate Rate Schedule. PEMBROKE PARK agrees that it shall establish and maintain rates and service charges or other means of obtaining funds within its Service Area which shall be sufficient to provide the monthly payments to HOLLYWOOD for the wastewater collection and treatment service contemplated herein, and such rates and charges shall be revised as may be required from time to time to provide sufficient funds to pay any sums due HOLLYWOOD under the terms of this Agreement.

ARTICLE VI. PROVISIONS RELATING TO TERMINATION OF AGREEMENT AND ASSIGNMENT OF HOLLYWOOD'S RIGHTS AND OBLIGATIONS

1. Termination Clause. Except as otherwise provided in Section 2 of this Article VI, this Contract may be terminated at any time by either participating party on one (1) years notice (or such shorter time as the parties shall mutually agree) to the other in writing by certified mail, only under the following conditions:

a. Termination by PEMBROKE PARK.

(1) Subject to subsection (3) below, PEMBROKE PARK shall pay to HOLLYWOOD in advance of termination all Debt Service Charges which would otherwise have been chargeable to PEMBROKE PARK under the terms of this Agreement (based upon a weighted average for future years using projected flows). If such Debt Service Charges can be reduced by calling bonds for redemption or otherwise providing for their payment prior to maturity under the terms of their issuance and if PEMBROKE PARK provides HOLLYWOOD with sufficient money to cover its Debt Service Charges and all expenses in connection with such call for redemption, including premiums, legal fees and costs, publication costs, and trustees and paying agents fees and mailing costs, then HOLLYWOOD shall call for redemption as many of such bonds as may be called under their terms with the money paid by PEMBROKE PARK to HOLLYWOOD. HOLLYWOOD reserves the right to determine which bonds to call.

(2) Subject to subsection (3) below, PEMBROKE PARK shall, in addition to Debt Service Charges, pay to HOLLYWOOD a sum equal to the then present value of all other

payments which, in the absence of such termination, would be made by PEMBROKE PARK to HOLLYWOOD hereunder during the period when HOLLYWOOD would receive and treat wastewater from PEMBROKE PARK, through and including five (5) years from the date of termination using PEMBROKE PARK's annual payment in the year of termination. The "then present value" as used above means the value on the termination date of the various sums payable thereafter, discounted at the then prevailing Prime interest rate plus all payments due and past due with interest at the then prevailing Prime interest rate from the date due to the termination date. In making such determination, PEMBROKE PARK shall be given full credit for all actual reductions, if any, in HOLLYWOOD's expenses of operation and maintenance, and administration which reductions are attributable to the termination of this Agreement. Hollywood shall also have an affirmative obligation to take such actions as are available in order to mitigate its expenses.

(3) There shall be deducted from the sums of the amounts payable by PEMBROKE PARK under subparagraphs (1) and (2) above any amount of liability (not in excess of said sum) assumed in writing by any other municipality, political subdivision or other entity, simultaneous with or prior to such termination if (a) capability of municipality, the political subdivision or other entity assuming such liability to satisfy the same shall be found satisfactory by HOLLYWOOD, (b) such municipality, political subdivision or other entity shall execute an agreement with HOLLYWOOD substantially the same as this Agreement, (c) whenever any revenue bonds of the CITY OF HOLLYWOOD payable in whole or in

part from sewer revenues are then outstanding which are secured by ordinance, resolution or indenture empowering a trustee or other agent on behalf of the holders of such bonds to consent to said assumption of liability, if such trustee or other agent's consent shall have been obtained in writing, and (d) PEMBROKE PARK shall execute and deliver to HOLLYWOOD, in a form acceptable to HOLLYWOOD, an agreement releasing and holding HOLLYWOOD harmless and indemnifying HOLLYWOOD from any responsibility, liability or claim for or relating to collecting and/or treating PEMBROKE PARK's wastewater from and after the date of termination of this Agreement.

b. Termination by HOLLYWOOD.

(1) There shall be a readily available alternative means of treating and disposing of the wastewater of PEMBROKE PARK which HOLLYWOOD would otherwise be required to treat and dispose of under this Agreement and such alternative means must meet all state, federal and local requirements pertaining to the public health, the pollution of public water and the protection of the environment generally.

(2) Any revenue bonds of the CITY OF HOLLYWOOD payable in whole or in part from wastewater revenues are secured by ordinance, resolution or indenture which requires a trustee or other agent for the holders of such bonds to consent to such termination on their behalf, such trustee or agent shall so consent in writing.

(3) HOLLYWOOD shall pay to PEMBROKE PARK an amount equal to the sum of (a) the actual expenses incurred by

ARTICLE VII. PROVISIONS RELATING TO DEFAULT

1. Default.

a. The parties agree that in the event either party commits an act of default under any of the terms or provisions of this Agreement, the party so defaulting shall be liable to the other party for any expenses, loss or damage occasioned by reason of such default.

b. The parties acknowledge that in order to construct the planned expansion of the HOLLYWOOD System, it is necessary for revenue bonds to be issued from time to time to provide the funding source for said expansion program and, by reason of such obligations incurred by HOLLYWOOD with regard to said bond financing, it is imperative that HOLLYWOOD be paid in a timely fashion the sums due from PEMBROKE PARK pursuant to this Agreement. In light of the obligations to the bondholders, and the acknowledgments that HOLLYWOOD has relied on PEMBROKE PARK's representation that payment of all sums due HOLLYWOOD under the terms of this Agreement shall be prompt in their remittal, the parties hereby agree to resolve disputes over monthly billings in accordance with Section 2 hereof. In the event that PEMBROKE PARK shall have committed an act of monetary default by failing to pay a monthly service bill within forty-five (45) days of receipt of said bill, then PEMBROKE PARK shall pay an interest penalty on the unpaid balance at the rate of 12% per annum and HOLLYWOOD shall have, in addition to any other rights and remedies provided for herein, the right and power, by suit, action, mandamus or other such proceedings at law or in equity,

3. Non-Monetary Default. Except as otherwise expressly provided herein, with respect to non-monetary defaults only, committed by PEMBROKE PARK, the default, if not otherwise resolved after due and diligent effort by both parties, shall be submitted to binding arbitration as set forth in paragraph 4 below.

4. Arbitration. Any non-monetary dispute between HOLLYWOOD and PEMBROKE PARK arising from this Agreement which cannot otherwise be resolved after due and diligent effort by both parties, shall be the subject of binding arbitration. Said arbitration shall be conducted by a board of three arbitrators, each of whom shall be qualified as a licensed engineer or a certified public accountant, or otherwise qualified person, and who shall not be employed by either party on a regular salaried basis. Each party to this Agreement shall choose one arbitrator, and the two so chosen shall choose a third who shall act as chairperson. The fees, charges and expenses of such arbitrators shall be borne equally by the parties hereto. PEMBROKE PARK agrees that during any such period of arbitration, it will continue to promptly make all payments due HOLLYWOOD, pursuant to the terms of this Agreement and Hollywood shall continue to provide wastewater treatment services to PEMBROKE PARK in accordance with the terms hereof.

5. Litigation and Arbitration Costs.

a. PEMBROKE PARK agrees that, to the extent legally permitted, it shall indemnify and hold HOLLYWOOD harmless from and against any and all costs or expenses incurred by HOLLYWOOD in the event of any litigation in which PEMBROKE PARK or HOLLYWOOD is or may become a party as either Plaintiff or Defendant, which results from and is determined to be caused in whole or in part from the effects of the improper introduction of materials by PEMBROKE PARK or any users of PEMBROKE PARK's System into the HOLLYWOOD System, or any portion thereof which may cause damage within or without the HOLLYWOOD System.

b. In the event of litigation between the parties to enforce the terms of this Agreement, then in that event the prevailing party shall be entitled to recover all costs and fees incurred, including but not limited to reasonable attorneys' fees.

6. Fines. In the event any fines, penalties or damages are incurred or imposed by or on HOLLYWOOD by reason of PEMBROKE PARK's violation or default of its obligations under this Agreement, then, in that event, PEMBROKE PARK shall be solely responsible for the payment of same.

7. Force Majeure. The parties agree that in the event of a temporary cessation of wastewater transmission which results from an act of God, hurricane, lightning, fire, strike, casualty, necessary maintenance work, breakdown of machinery, insurrection or riot, that said temporary cessation shall not constitute a default in this Agreement on the part of either of

the parties, and neither party shall be liable to the other for any damage resulting from such cessation, and unless written notice to the contrary is received from any federal, state or local agency, or any court having jurisdiction over the subject matter, HOLLYWOOD shall continue to accept and dispose the wastewater transmitted to it by PEMBROKE PARK if possible, regardless of the degree of treatment available and PEMBROKE PARK, during any such period of interruption or reduced treatment shall continue to pay its share of Debt Service Charges due and the actual costs incurred by HOLLYWOOD. In the event the amount of the Debt Service Charges and actual costs incurred during any period of temporary cessation cannot be determined by reason of no flow, or insufficient flow of wastewater, then the Debt Service Charges and actual costs incurred paid by PEMBROKE PARK shall be based on the twelve (12) month period prior to said interruption of service or reduced treatment.

ARTICLE VIII. ADMINISTRATION

1. Execution and Agreement. The parties hereto agree that upon execution of this Agreement by the appropriate officials of HOLLYWOOD and PEMBROKE PARK, that said Agreement shall be in full force and effect as of the date of said execution, provided that the effective date for billing purposes and calculations of amounts owed shall be as of October 1, 1988. Upon execution, this Agreement shall be filed with the official records of the Broward County Clerk's Office.

2. Large Users Advisory Committee (LUAC). The parties agree that HOLLYWOOD shall, subject to the terms contained herein, have sole and exclusive authority as to the administration, operation and maintenance of the HOLLYWOOD System, including establishment of the annual budget, establishment and amendment of service fees, rates and other charges necessary for the efficient operation and maintenance of the HOLLYWOOD System; provided however, that commencing with the charges to be paid by PEMBROKE PARK during the 1991-92 Fiscal Year and each Fiscal Year thereafter, Hollywood will consult with PEMBROKE PARK and each of the other members of the Large User's Advisory Committee on or before May 15 of each Fiscal Year with respect to establishing the proposed respective fees, rates, RR&I contributions and other charges to be paid by the Large Users in the next ensuing Fiscal Year. In addition, HOLLYWOOD shall have the obligation to meet with the Large Users Advisory Committee at least quarterly to review rate and budgeting matters and the Committee shall have the right to make recommendations to

HOLLYWOOD concerning these matters. HOLLYWOOD also agrees to meet with the Large User's Advisory Committee and discuss any plans relating to relocation of System facilities prior to any definitive action.

3. Invalidity of Provision. In the event it is determined that any section, clause, sentence, or provision of this Agreement shall be invalid, then same shall not affect the validity of any other part of this Agreement which can be given effect without such invalid part or parts. The parties agree that this Agreement shall be binding upon the successors and assigns of the parties hereto and may be enforced by appropriate action of court, or courts of competent jurisdiction.

4. Legal Requirements. The parties agree that each has complied with all necessary legal requirements for execution of this Agreement, including but not limited to due consideration of the terms and conditions hereof by the appropriate governing body of each municipality and its city attorney, and public hearing on this matter; and each party hereto agrees to exchange with the other, certified copies of any official records of its governing body authorizing the execution of this Agreement on its behalf.

5. Notice. Any notice required to be given hereunder in writing shall be considered to be properly given if the same has been sent in writing by certified or registered mail to the following:

HOLLYWOOD: City of Hollywood
2600 Hollywood Boulevard
Hollywood, FL 33021

Attention: City Utilities Director
Copy to: City Attorney

PEMBROKE PARK: _____

_____

_____

6. Prior Agreements. This document, upon its execution by both parties shall supersede any and all prior negotiations, correspondence, conversations, Large User agreements, including the Prior Agreement and any amendments thereto, or understandings applicable to the matters contained herein and the parties agree that there are no commitments, agreements or understandings concerning the subject matter of this Agreement that are not contained in this document. Accordingly, it is agreed by the parties that there shall be no deviation from the terms hereof which shall be predicated upon any prior representation or agreements whether oral or written, unless said are specifically provided for herein.

7. Modification, Amendment or Alteration. Except as otherwise expressly provided herein as to certain matters which only require written notice, no modification or amendment to the terms or conditions of this Agreement shall be effective unless contained in a supplemental document executed with the same formality of this Agreement and attached hereto.

8. Findings. All of the recitations contained in the preamble of this Agreement are true and correct and incorporated herein by reference.

9. Counterpart Execution. This Agreement may be executed in counterpart originals, each of which shall be deemed an original. PEMBROKE PARK shall provide HOLLYWOOD with a certified copy of PEMBROKE PARK's resolution or evidence of other such action authorizing PEMBROKE PARK to execute this Agreement.

IN WITNESS WHEREOF, the parties hereto have made and executed this Agreement on the respective dates under each signature.

Signed, sealed and delivered
in the presence of:

Suzanne Torres

Carole Glover

HOLLYWOOD:

CITY OF HOLLYWOOD, a
Municipal Corporation of
the State of Florida

By: Sal Oliveri, Mayor

Dated: Oct. 30, 1990

Attest:

Martha S. Lambos, City Clerk

Prepared and approved as to
form and legality by:

Alan B. Koslow
City Attorney

(See prior page for additional signatures)
(Additional signatures to the Large User Wastewater Agreement between HOLLYWOOD and PEMBROKE PARK)

Approved:

Paul E. Wimberly
Finance Director

Robert A. Creighton
Utilities Director

PEMBROKE PARK:
a municipal corporation of
the State of Florida

By: Bill Lyddon
BILL LYDDON
Mayor-Commissioner


Dated: October 26, 1990

Attest: Theresa Ciummo
Clerk-Commissioner
THERESA CIUMMO

Approved as to Form and Legality:

A. J. RYAN, JR.
Town Attorney

By:_____

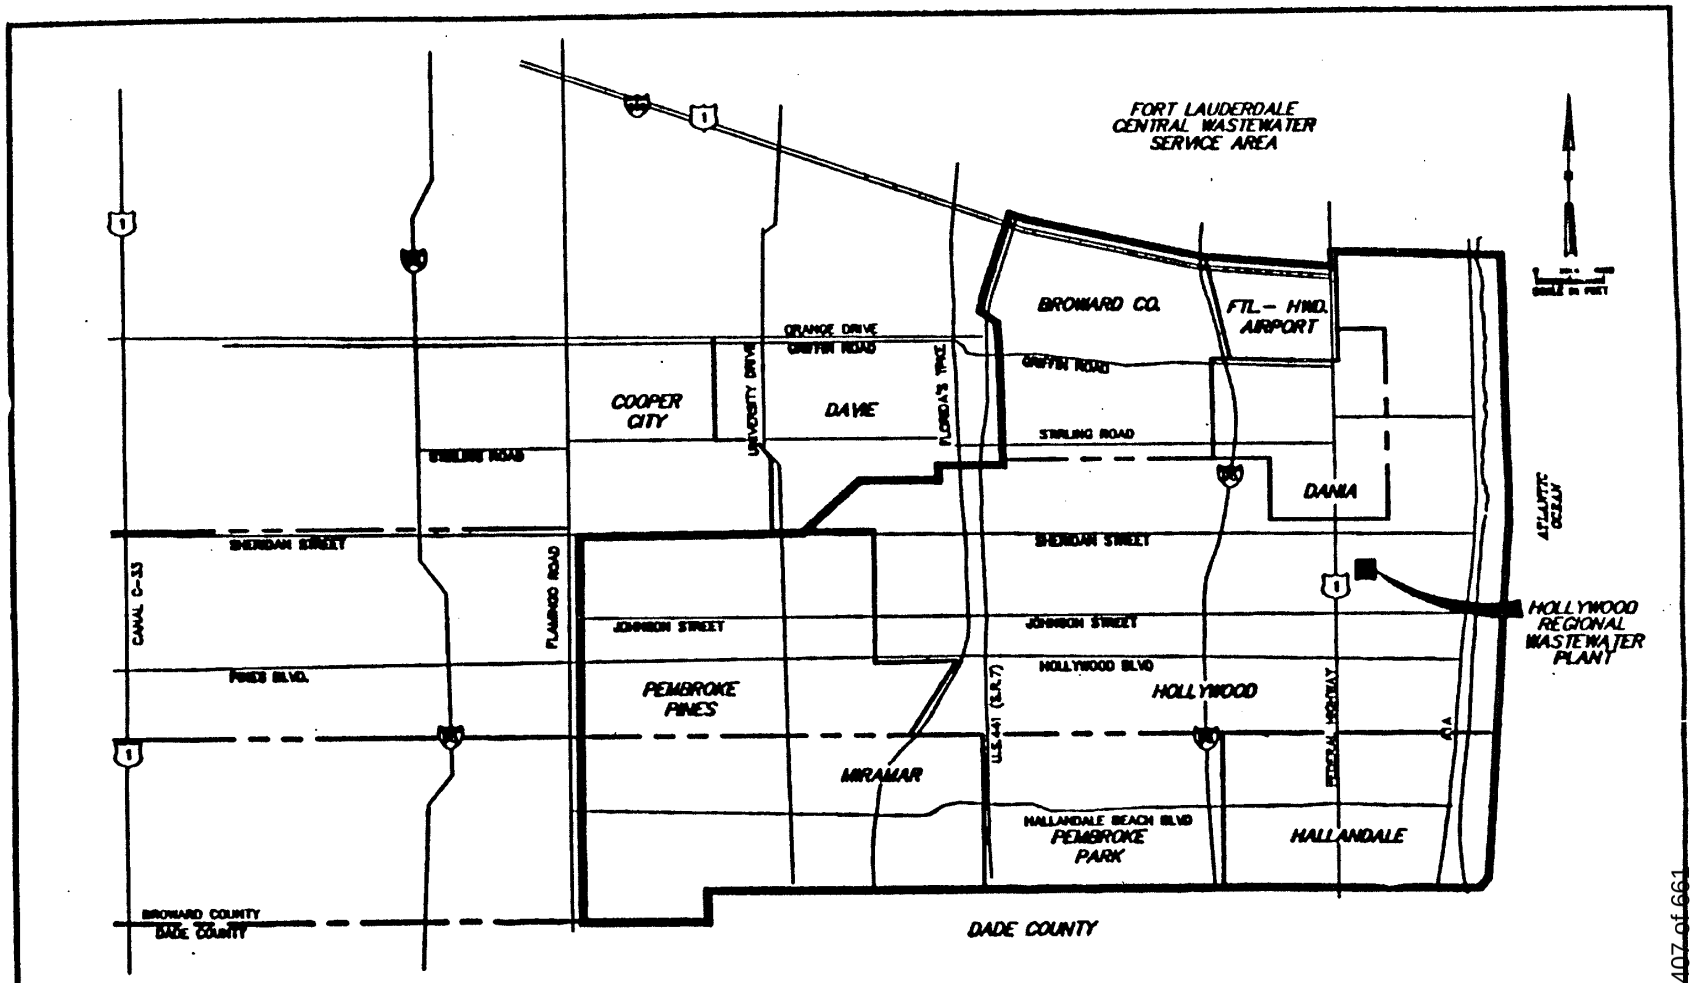

LEGEND

SOUTH BROWARD REGIONAL SERVICE AREA

CITY LIMITS

4840X100

SOUTH BROWARD REGIONAL SERVICE AREA

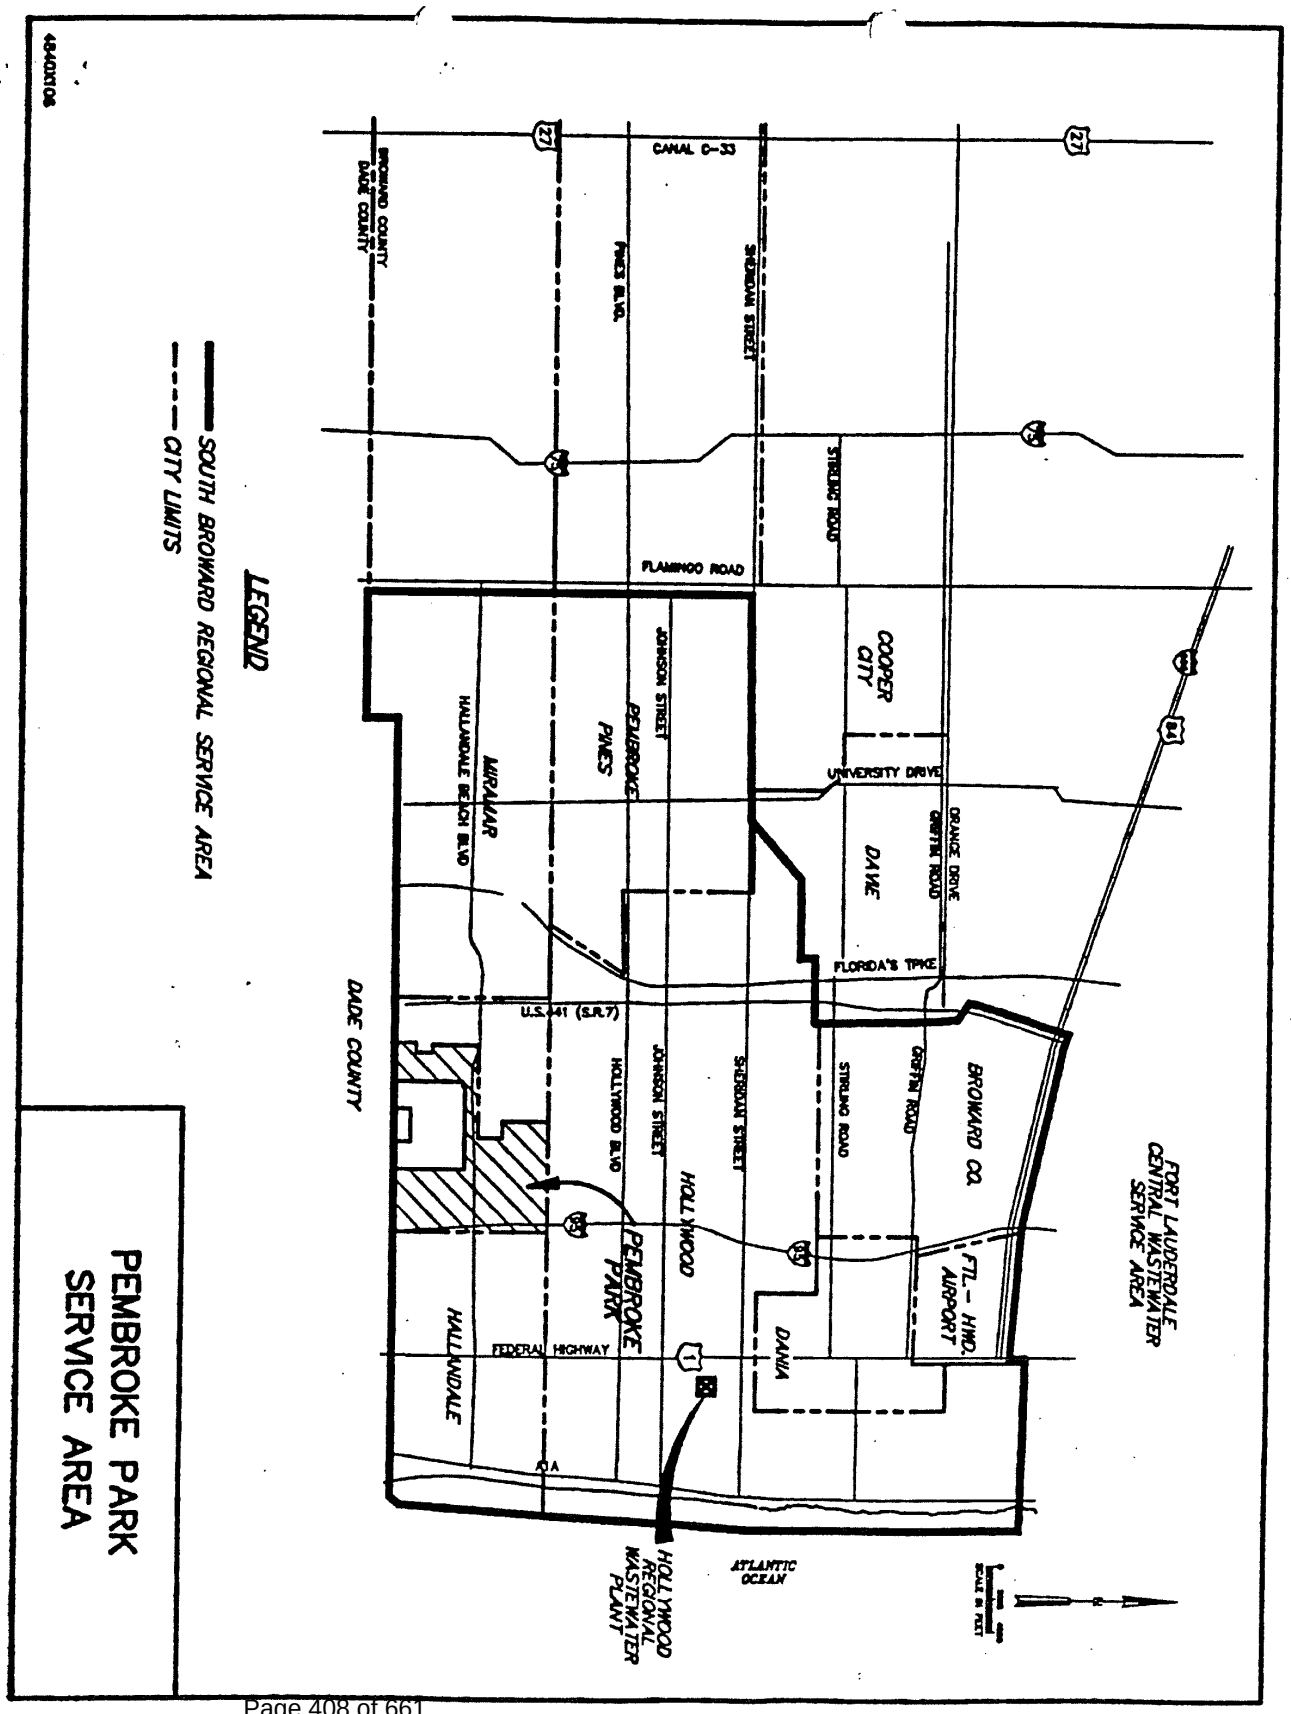

PEMBROKE PARK
SERVICE AREA
LEGEND
SOUTH BROWARD REGIONAL SERVICE AREA
CITY LIMITS
BROWARD COUNTY
DADE COUNTY
CANAL C-33
PINES BLVD.
SHERIDAN STREET
STIRLING ROAD
FLAMINGO ROAD
COOPER CITY
UNIVERSITY DRIVE
ORANGE DRIVE
GRIFFIN ROAD
DAVIE
MIRAMAR
HALLANDALE BEACH BLVD
PEMBROKE PINES
JOHNSON STREET
FLORIDA'S TPKE
U.S. 441 (S.R.7)
HOLLYWOOD BLVD
BROWARD CO.
FTL. - HWD. AIRPORT
PEMBROKE PARK
HOLLYWOOD
DANIA
FEDERAL HIGHWAY
HALLANDALE
I-95
I-75
A1A
ATLANTIC OCEAN
HOLLYWOOD REGIONAL WASTEWATER PLANT
FORT LAUDERDALE CENTRAL WASTEWATER SERVICE AREA

EXHIBIT "B"

HOLLYWOOD SOUTHERN REGIONAL WWTP

LARGE USER METER AND INTERCONNECT LOCATIONS

1. HALLANDALE
   METER AT LIFT STATION E-8, 800 THREE ISLAND BLVD.
   INTER-CONNECTION AT 13TH AVENUE WASHINGTON STREET
   MANHOLE #B334N

2. HALLANDALE
   METER AT LIFT STATION E-6, 1350 FUNSTON STREET
   INTER-CONNECTION AT 14TH & JACKSON STREET, VANBUREN ALLEY
   MANHOLE B27

3. HALLANDALE
   METER AT U.S. 1 & PEMBROKE ROAD
   INTER-CONNECTION AT 19TH AVENUE & PLUNKETT STREET
   MANHOLE 401A

4. HALLANDALE
   METER AT FLETCHER STREET & 22ND AVENUE
   INTER-CONNECTION AT 23RD TAFT STREET

5. PEMBROKE PARK
   COCA COLA PLANT, PEMBROKE ROAD
   INTER-CONNECTION AT 620 S. RAINBOW
   MANHOLE 353

6. MIRAMAR SEWER PLANT
   INTER-CONNECTION AT JOHNSON STREET & 62ND AVENUE

7. PEMBROKE PINES
   METER AT N.W. 77 WAY, 13TH STREET
   INTER-CONNECTION AT TAFT STREET AND 56TH

8. DANIA
   METER AT SHERIDAN & S.E. 5TH AVENUE
   INTER-CONNECTION AT 14TH & HARDING STREET
   MANHOLE 1002

9. COOPER CITY, DAVIE (TREATED)
   METER AT COOPER CITY AND DAVIE SEWER PLANTS
   INTER-CONNECTION AT HOLLYWOOD SEWER PLANT

10. BROWARD COUNTY
    METERS: S. 40TH AVE. AT 3A WTP
            S. 40TH AVE. AT STIRLING
    INTERCONNECT: N. 56TH AVE. AT TAFT STREET

Exhibit "C" (Continued)

EXHIBIT A.1
Current Flows

EXHIBIT A.1 CURRENT FLOWS

SOUTHERN REGIONAL WASTEWATER TREATMENT PLANT
July 2024 Large User Capacity Report (GPD)

Large User	Encumbered Flow*	Annual Average Daily Flow / Last 12 Months	Total Flow AADF + Enc.	Capacity** Allocations	% of Cap Used	% of Cap Used or Encumbered	Available Capacity
Broward County	756,117	3,877,153	4,633,270	5,883,000	65.90%	78.76%	1,249,730
Dania Beach	2,254,105	3,928,288	6,182,393	5,217,000	75.30%	118.50%	-965,393
Hallandale Beach	1,819,158	7,751,430	9,570,588	8,713,500	88.96%	109.84%	-857,088
Hollywood	1,387,989	18,754,011	20,142,000	21,811,500	85.98%	92.35%	1,669,500
Miramar ***	0	26,449	26,449	1,665,000	1.59%	1.59%	1,638,551
Pembroke Park	258,543	950,309	1,208,852	1,110,000	85.61%	108.91%	-98,852
Pembroke Pines	256,970	7,819,359	8,076,329	11,100,000	70.44%	72.76%	3,023,671
Total	6,732,881	43,107,000	49,839,881	55,500,000			5,660,119

WWTP AADF	**43.1**
Encumbered Flow	**6.7**
Total MGD	**49.8**

* Encumbered flows updated to reflect most recent activity

** 9/30/2012 Plant Capacity Officially Rated at 55.5 MGD

***Miramar Discontinued Monthly Flows to the SRWWTP on 01/10/2011 per Signed Agreement but open their interconnect as an emergency measure.

Updated 8/13/2024

EXHIBIT B
Broward County Interlocal Agreement

See Town Clerk for Resolution

(Resolution Passed Approx. 2003 – 2005)

EXHIBIT C
Coca Cola Rate Agreement

See Town Clerk for Agreement

EXHIBIT C.1
REDUCTION IN VOLUME BASED ON PRODUCTION DISTRIBUTION

See Town Clerk for Agreement

(RESOLUTION PASSED APPROX. 2010)

EXHIBIT C.2
CITY OF HOLLYWOOD EXCESSIVE WASTEWATER PH AND ACIDITY CONCENTRATION

See Town Clerk for Agreement

(RESOLUTION PASSED APPROX. 1996)

EXHIBIT D

MODEL DATA REPORT 2025 EXISTING CONDITIONS

EXHIBIT D.1
GRAVITY SEWER DATA TABLE REPORT

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1466	O2L34SA9	M34A9	0.1	M34A8	0	92.2	0.001	8	0.013	1.39	217.91	138.37	157.5	Vitrified Clay
536	O1L14SA2	M14A2	-3.6	M14A1	-4	102.8	0.004	8	0.013	3.42	536.17	346.58	154.7	Vitrified Clay
1517	O2L34SA3	M34A3	-4.4	M34A2	-4.5	34	0.004	8	0.01	4.12	645.2	418.76	154.1	PVC
998	O2L34SA6	M34A6	-1.9	M34A5	-2.1	77	0.002	8	0.013	2.33	365.33	247.26	147.8	Vitrified Clay
1120	O1L14SC1	M14C1	-2.7	M14A2	-3.6	279.4	0.003	8	0.013	2.8	438.06	302.61	144.8	Vitrified Clay
1115	O1L14SC2	M14C2	-2.4	M14C1	-2.7	92.4	0.003	8	0.013	2.08	326.45	298.52	109.4	Vitrified Clay
1113	O1L14SC3	M14C3	-2.3	M14C2	-2.4	22.4	0.003	8	0.013	2.08	326.45	303.48	107.6	Vitrified Clay
1353	O2L34SA8	M34A8	0	M34A7	-0.5	319.7	0.002	8	0.013	1.62	239.64	224.95	106.5	Vitrified Clay
1110	O1L14SC4	M14C4	-1.4	M14C3	-2.3	315.6	0.003	8	0.013	1.95	305.93	297.54	102.8	Vitrified Clay
1322	O1L17SA10	M17A10	0.6	M17A9	0	160.9	0.004	8	0.013	2.36	334.06	325.59	102.6	Vitrified Clay
1108	O1L14SC5	M14C5	-0.4	M14C4	-1.4	315.1	0.003	8	0.013	1.93	302.05	297.81	101.4	Vitrified Clay
360	O2L3SA1	M3A1	-1.8	W-3	-1.7	17.9	-0.004	8	0.013	2.32	363.07	362.33	100.2	
1323	O1L17SA9	M17A9	0	M17A8	-0.4	88.8	0.005	8	0.013	2.65	360.43	364.07	99	Vitrified Clay
3510	O2L35SA1	W-35	-1.4	M35A1	-1.3	20.3	0.005	8	0.01	3.58	452.83	494.45	91.6	PVC
1089	O1L17SA11	M17A11	1.6	M17A10	0.6	245.1	0.004	8	0.013	2.45	287.75	342.94	83.9	Vitrified Clay
1518	O2L34SA3	M34A4	-3	M34A3	-4.3	313	0.004	8	0.01	3.22	365.33	454.36	80.4	PVC
1057	O1L17SA2	M17A2	-6.6	M17A1	-7	144.5	0.002	12	0.013	2.44	618.26	775.54	79.7	Vitrified Clay
4001	O1L17SA1	M17A1	-7	W-17	-7.1	39.9	0.003	12	0.013	2.87	723.71	912.44	79.3	Vitrified Clay
988	O2L34SI1	M34A7	-0.5	M34A6	-1.9	332.4	0.004	8	0.013	2.43	255.24	349.46	73	Vitrified Clay
1465	O2L34SA10	M34A10	0.8	M34A9	0.1	233.6	0.003	8	0.013	2.06	213.65	296.91	72	Vitrified Clay
1032	O1L17SA3	M17A3	-6.4	M17A2	-6.6	112	0.002	12	0.013	2.13	492.86	692.29	71.2	Vitrified Clay
1459	O2L34SA11	M34A11	1.5	M34A10	0.8	233.9	0.003	8	0.013	2.12	213.13	307.09	69.4	Vitrified Clay
3993	O2L36SB1	M36A1	-5.2	M36B1	-4	279.6	0.004	8	0.01	3	263.87	452.17	58.4	PVC
4142	O2L1SA5	M1A4	1	M1A5	1.1	43.1	0.004	8	0.013	2.25	193.2	342.52	56.4	Vitrified Clay
4143	O2L1SA6	M1A5	1.1	M1A6	1.4	72.8	0.004	8	0.013	2.25	192.3	343.57	56	Vitrified Clay
376	O2L3SA2	M3A2	-1.3	M3A1	-1.8	107.4	0.005	8	0.013	2.42	204.57	370.12	55.3	Vitrified Clay
4081	O2L1SA4	M1A3	-0.1	M1A4	1	240.7	0.004	8	0.013	2.35	196.2	359.94	54.5	Vitrified Clay
733	O2L3SH1	M3H1	-0.1	M3A2	-1.3	318.9	0.004	8	0.013	2.15	178.63	329.9	54.1	Vitrified Clay
4285	O1L17SA4	M17A5	-5.7	M17A4	-6.3	285.4	0.002	12	0.013	2.17	405.47	751.26	54	Vitrified Clay
1100	O1L14SD1	M14D1	0.4	M14C5	-0.4	279.3	0.003	8	0.013	1.02	159.55	299.18	53.3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
646	O2L36SA4	M36A4	-2.2	M36A3	-2.4	220.4	0.001	8	0.01	1.38	112.69	212.41	53.1	PVC
1275	O2L22SA2	M22A2	-0.8	M22A1	-1.4	133.8	0.005	8	0.013	2.41	197.08	372.16	53	Vitrified Clay
737	O2L3SH2	M3H2	1.3	M3H1	-0.1	388.5	0.004	8	0.013	2.08	168.66	322.05	52.4	Vitrified Clay
3683	O2L22SA4	M22A3	0.9	M22A4	1.6	180.6	0.004	8	0.013	2.09	162.43	327.87	49.5	Vitrified Clay
4282	O1L17SA4	M17A4	-6.3	M17A3	-6.4	27.9	0.003	12	0.013	2.4	405.47	856.88	47.3	Vitrified Clay
4136	O2L1SA7	M1A6	1.4	M1A7	1.7	46.6	0.006	8	0.013	2.65	191.4	426.48	44.9	Vitrified Clay
1283	O2L22SA3	M22A3	0.9	M22A2	-0.8	259.4	0.007	8	0.013	2.68	179.44	442.87	40.5	
3863	O2L3SF1	M3A1	-1.8	M3F1	-0.4	341.2	0.004	8	0.013	2.09	139.17	344.92	40.3	Vitrified Clay
870	O2L1SA2	M1A2	-0.8	M1A1	-1	82.6	0.003	10	0.013	2.16	225.15	558.68	40.3	Vitrified Clay
3957	O2L3SF3	M3F2	1.5	M3F3	3.2	459.3	0.004	8	0.013	1.99	132.9	329.96	40.3	Vitrified Clay
1168	O1L14SB2	M14B2	-1.4	M14B1	-1.7	285.5	0.001	8	0.013	1.16	76.633	192.58	39.8	Vitrified Clay
1124	O1L14SC6	M14C6	0.5	M14C5	-0.4	305.7	0.003	8	0.013	0.75	116.85	299.16	39.1	Vitrified Clay
1126	O1L14SC7	M14C7	1	M14C6	0.5	170	0.003	8	0.013	0.71	111.15	288.2	38.6	Vitrified Clay
1617	O2L3SF2	M3F2	1.5	M3F1	-0.4	437.2	0.004	8	0.013	2.13	136.04	357.52	38.1	Vitrified Clay
653	O2L36SA2	M36A2	-4.1	M36A1	-5.2	310.1	0.003	8	0.01	2.46	156.76	414.13	37.9	PVC
1104	O1L14SD3	M14D3	2.1	M14D2	1.3	284.2	0.003	8	0.013	0.69	108.25	296.6	36.5	Vitrified Clay
1106	O1L14SD4	M14D4	2.8	M14D3	2.1	226.8	0.003	8	0.013	0.67	105.4	296.94	35.5	Vitrified Clay
4080	O2L2SR2	M1A2	-0.8	M1A3	-0.1	208.8	0.003	10	0.013	2.1	199.5	562.18	35.5	Vitrified Clay
707	O2L3SJ1	M3J1	3	M3H2	1.3	234.4	0.007	8	0.013	2.71	162.53	465.9	34.9	Vitrified Clay
1000	O2L34SA5	M34A5	-2.1	M34A4	-3	23.2	0.039	8	0.013	6.17	365.33	1067.6	34.2	Vitrified Clay
902	O2L23SB1	M23B1	1.9	M17A1	0.3	399.2	0.004	8	0.035	0.74	43.167	128.33	33.6	
419	O2L2SA1	M2A1	-2.1	W-2	-2.2	15.7	0.006	6	0.013	2.03	64.5	200.89	32.1	Vitrified Clay
651	O2L36SA3	M36A3	-2.4	M36A2	-4.1	354.7	0.005	8	0.01	2.7	148.91	479.4	31.1	PVC
1396	O1L17SB2	M17B1	2.2	M17B2	2.6	99.6	0.004	8	0.01	2.51	136.8	446.82	30.6	PVC
1710	O2L38SA2	M38A2	-7.2	M38A1	-8.8	395.9	0.004	8	0.01	2.47	127.39	449.63	28.3	PVC
3884	O2L38SA1	M38A1	-8.9	W-38	-9.1	23.9	0.008	8	0.01	3.53	182.2	644.52	28.3	PVC
1324	O1L17SA8	M17A8	-2.1	M17A6	-3.4	159.5	0.008	12	0.013	3.51	405.47	1443.4	28.1	Vitrified Clay
1402	O1L17SB4	M17B3	3.6	M17B4	4.2	217.7	0.003	8	0.01	2.02	102.6	370.1	27.7	PVC
683	O2L36SB2	M36B2	-3	M36B1	-4	327.4	0.003	8	0.01	2.16	108.22	397.39	27.2	PVC
3372	O2L7SC2	M7C2	-0.1	M7C1	-0.9	162.5	0.005	8	0.013	2.06	102.99	380.57	27.1	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1102	O1L14SD2	M14D2	3.2	M14D1	0.4	281.8	0.01	8	0.013	2.88	142.45	533.77	26.7	Vitrified Clay
1156	O1L14SA5	M14A5	-2.4	M14A4	-3.1	172.3	0.004	8	0.013	1.84	88.999	343.16	25.9	Vitrified Clay
1398	O1L17SB3	M17B3	3.4	M17B2	2.6	147.7	0.006	8	0.01	2.87	136.8	538.07	25.4	PVC
645	O2L36SA5	M36A5	-2	M36A4	-2.2	84.2	0.003	8	0.01	2.2	104.84	413.76	25.3	PVC
404	O2L1SA1	M1A1	-1	W-1	-1.2	11	0.012	10	0.013	3.65	270.45	1071.6	25.2	Vitrified Clay
4010	O2L19SA1	W-9	-0.4	M9A1	-0.3	20.8	0.005	8	0.01	2.56	116.55	488.56	23.9	PVC
589	O2L7SA2	M7A2	-2	M7A1	-5.5	246.6	0.014	6	0.013	2.76	68.033	300.43	22.6	Vitrified Clay
1404	O1L17SB5	M17B5	4.7	M17B4	4	146.5	0.004	8	0.01	2.35	102.6	454.91	22.6	PVC
3378	O2L7SC3	M7C3	0.7	M7C2	-0.1	139.7	0.006	8	0.013	2.1	91.361	410.39	22.3	Vitrified Clay
644	O2L36SA6	M36A6	-1.7	M36A5	-2	90.5	0.003	8	0.01	2.05	88.673	399.19	22.2	PVC
569	O2L7SD2	M7D2	1.8	M7D1	1	157	0.005	6	0.013	1.66	39.533	184.22	21.5	Vitrified Clay
457	O2L7SA1	M7A1	-5.5	W-7	-6.4	7.7	0.116	6	0.013	2.08	183.32	857.64	21.4	
524	O2L34SA2	M34A2	-4.6	M34A1	-5.5	25.8	0.036	12	0.012	7.36	694	3269.3	21.2	Ductile Iron
570	O2L7SD1	M7D1	1	M7A3	-0.6	136.4	0.012	6	0.013	2.43	56.333	272.74	20.7	Vitrified Clay
3512	O2L35SA2	M35A1	-1.2	M35A2	-0.1	286.5	0.004	8	0.01	2.19	89.89	436.87	20.6	PVC
4023	O2L5SA1	M5A1	-2.9	W-5	-3	10.6	0.005	6	0.01	2.01	46.17	225.16	20.5	PVC
1333	O1L40SA5	M40A4	2.7	M40A5	3.7	263.3	0.004	8	0.01	2.17	88.078	434.47	20.3	PVC
1551	O1L17SF1	M17F1	2.8	M17A11	1.6	282.2	0.004	8	0.013	1.79	72.577	358.04	20.3	Vitrified Clay
1329	O1L40SA3	M40A2	0.3	M40A3	1.4	286.8	0.004	8	0.01	2.18	88.078	436.66	20.2	PVC
3103	O2L34SG1	M34G1	3.8	M34F2	0.3	401.3	0.009	6	0.013	2.09	47.493	236.19	20.1	Vitrified Clay
3514	O2L35SA3	M35A2	0	M35A3	1.5	393.5	0.004	8	0.01	2.13	83.012	433.85	19.1	PVC
1016	O1L17SM1	M17M1	-0.8	M17A3	-1.3	132	0.004	8	0.01	2.21	85.5	450.98	19	PVC
1331	O1L40SA4	M40A3	1.5	M40A4	2.7	275	0.004	8	0.01	2.28	88.078	465.75	18.9	PVC
1327	O1L40SA2	M40A1	-0.6	M40A2	0.2	190.5	0.004	8	0.01	2.29	88.078	468.18	18.8	PVC
4128	O2L1SA8	M1A7	1.7	M1A8	1.9	44.8	0.004	12	0.013	2.19	187.8	1007.9	18.6	
912	O2L5SA2	M5A2	-2.7	M5A1	-2.9	53.7	0.005	6	0.01	1.94	41.445	223.47	18.5	PVC
643	O2L36SA7	M36A7	-0.7	M36A6	-1.7	299.2	0.003	8	0.01	1.92	72.508	395.17	18.3	PVC
4284	O1L17SA6	M17A6	-3.4	M17A5	-5.7	118.8	0.019	12	0.013	4.8	405.47	2230.1	18.2	Vitrified Clay
1408	O1L17SB6	M17B6	5.6	M17B5	4.7	229.2	0.004	8	0.01	2.15	79.8	444.28	18	PVC
4129	O2L1SA9	M1A8	1.9	M1A9	3	256.4	0.004	12	0.013	2.26	186.3	1056.8	17.6	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1304	O1L14SC8	M14C8	1.3	M14C7	1	89.7	0.003	8	0.01	0.45	71.25	407.81	17.5	PVC
588	O2L7SA3	M7A3	-0.6	M7A2	-2	283.5	0.005	8	0.013	1.82	65.633	379.78	17.3	Vitrified Clay
3247	O2L18SC9	M18C9	3.4	M18C2	3	99.5	0.004	8	0.01	2.11	75.649	441.38	17.1	PVC
1502	O2L18ASA5	M18A-A5	0.7	M18A-A4	0.2	162.3	0.003	8	0.01	1.88	67.499	395.19	17.1	PVC
1496	O2L18ASA3	M18A-A3	-0.3	M18A-A2	-0.7	102.4	0.004	8	0.01	0.49	76.004	446.05	17	PVC
1704	O2L38SA3	M38A3	-5.5	M38A2	-7.2	382.4	0.004	8	0.013	1.69	59.324	358.4	16.6	
1306	O1L14SC9	M14C9	1.7	M14C8	1.3	115.8	0.004	8	0.01	2.08	71.25	444.4	16	PVC
538	O1L14SA4	M14A4	-3.1	M14A3	-2.6	57	-0.008	8	0.01	0.63	98.119	619.43	15.8	PVC
1412	O1L17SB7	M17B6	5.3	M17B7	5.7	143.6	0.003	8	0.01	1.69	57	362.66	15.7	PVC
537	O1L14SA3	M14A3	-2.6	M14A2	-3.6	68.4	0.013	8	0.013	2.92	98.119	628.94	15.6	
1500	O2L18ASA4	M18A-A4	0.2	M18A-A3	-0.3	112.6	0.004	8	0.01	2.07	69.074	445.71	15.5	PVC
1172	O1L14SA7	M14A7	-1.6	M14A6	-0.5	131	-0.008	8	0.013	0.49	76.174	492.39	15.5	Vitrified Clay
1088	O1L17A12	M17A12	4	M17A11	3.1	217.3	0.004	8	0.013	1.67	55.575	362.32	15.3	Vitrified Clay
3995	O2L36SC2	M36C1	-2	M36C2	-0.5	271.5	0.005	8	0.01	2.41	80.072	522.31	15.3	PVC
1014	O1L17SM2	M17M2	-0.3	M17M1	-0.8	94.7	0.005	8	0.01	2.26	74.1	491.29	15.1	PVC
1553	O1L17SF2	M17F2	3.9	M17F1	2.8	296.1	0.004	8	0.013	1.53	49.777	335.02	14.9	Vitrified Clay
1012	O1L17SM3	M17M3	0.6	M17M2	-0.3	244	0.004	8	0.01	1.98	62.7	437.59	14.3	PVC
642	O2L36SA8	M36A8	0.2	M36A7	-0.7	292.1	0.003	8	0.01	1.8	56.344	399.96	14.1	PVC
1425	O2L32SA1	W-32	-1.6	M32A1	-1.2	120.4	0.004	8	0.01	1.95	59.743	435.71	13.7	PVC
1506	O2L18ASA6	M18A-A6	1.2	M18A-A5	0.7	121.8	0.004	8	0.01	2.04	61.199	460.67	13.3	PVC
3643	O2L18ASA2	M18A-A2	-0.7	M18A-A1	0.4	95.8	-0.011	8	0.013	0.49	76.004	575.97	13.2	
3846	O2L4SA3	M4A2	0.3	M4A3	0.7	92.3	0.005	6	0.013	1.34	22.365	171.88	13	Vitrified Clay
3365	O2L7SC1	M7C1	-0.9	M7A1	-5.5	181.5	0.025	8	0.013	3.77	109.59	864.45	12.7	Vitrified Clay
3994	O2L36SC1	M36B1	-4	M36C1	-2	190.4	0.011	8	0.01	3.16	90.812	724.35	12.5	PVC
3426	O2L36SA1	M36A1	-5.2	W-36	-9	68	0.057	12	0.013	7	473.73	3804.2	12.5	
568	O2L7SD3	M7D3	2.7	M7D2	1.8	157.5	0.005	6	0.013	1.42	22.733	182.79	12.4	Vitrified Clay
1512	O2L18ASA8	M18A-A8	2.1	M18A-A7	1.7	100.8	0.004	8	0.01	1.95	54.899	449.6	12.2	PVC
1377	O1L37SC1	M37A2	-2.8	M37A1	-3.2	98.7	0.004	8	0.01	2.01	56.185	465.32	12.1	PVC
1510	O2L18ASA7	M18A-A7	1.7	M18A-A6	1.2	120	0.004	8	0.01	2	55.844	464.08	12	PVC
1555	O1L17SF3	M17F3	4	M17F2	3.9	16.5	0.006	8	0.013	1.81	49.777	421.82	11.8	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1008	O1L17SM5	M17M5	1.9	M17M4	1	215.3	0.004	8	0.01	1.88	51.3	440.44	11.6	PVC
1010	O1L17SM4	M17M4	1	M17M3	0.6	105.8	0.004	8	0.01	1.89	51.3	444.2	11.5	PVC
1448	O2L31SA2	M31A2	-2.3	M31A1	-4	387.1	0.004	8	0.01	1.98	53.693	465.86	11.5	PVC
1606	O1L17SO1	M17O1	1.7	M17N1	0.1	315.6	0.005	8	0.01	2.11	57	498.88	11.4	PVC
682	O2L36SB3	M36B3	-0.1	M36B2	-3	325.9	0.009	8	0.01	2.78	73.19	660.47	11.1	PVC
865	O2L1SE3	M1E3	1.5	M1E2	0.7	171.5	0.005	6	0.013	1.28	18.75	172.65	10.9	Vitrified Clay
1166	O1L14SB1	M14B1	-1.7	M14A1	-4	304.2	0.007	10	0.013	2.27	91.913	847.57	10.8	Vitrified Clay
689	O2L36SD2	M36D2	1.9	M36D1	1	353.5	0.003	8	0.013	1.15	29.802	276.67	10.8	
1072	O1L17SQ1	M17Q2	-3.4	M17Q1	-4	143.7	0.004	8	0.013	0.24	37.05	344.55	10.8	Vitrified Clay
924	O2L5SA4	M5A4	-0.7	M5A3	-2.4	308.2	0.005	6	0.013	1.38	19.71	186.47	10.6	Vitrified Clay
794	O2L2SA2	M2A2	-1.3	M2A1	-2.1	174.8	0.005	8	0.013	1.52	38.7	366.74	10.6	Vitrified Clay
4012	O2L9SB1	M9A1	-0.3	M9B1	0.5	194.7	0.004	8	0.01	1.87	47.25	452	10.5	PVC
1128	O1L14SF1	M14F1	1.8	M14C7	1	250.4	0.003	8	0.013	1.25	31.35	302.71	10.4	Vitrified Clay
1414	O1L17SB9	M17B9	6.5	M17B7	6.1	98.6	0.004	8	0.01	1.83	45.6	443.5	10.3	PVC
1702	O2L38SA4	M38A4	-3.8	M38A3	-5.4	393.5	0.004	8	0.01	1.86	46.198	452.36	10.2	PVC
926	O2L5SA6	M5A6	0.5	M5A4	-0.7	280.1	0.005	6	0.013	1.24	17.19	169.58	10.1	Vitrified Clay
699	O1L17SL3	M17L3	1.8	M17L2	1.2	152.2	0.004	8	0.01	1.83	45.041	446.39	10.1	PVC
697	O1L17SL2	M17L2	1.2	M17L1	0.9	75.7	0.004	8	0.01	1.84	45.041	451.18	10	PVC
1373	O1L37SA3	M37A3	-1.6	M37A2	-2.8	245.7	0.005	8	0.01	1.96	47.831	482.4	9.9	PVC
1592	O2L16SA5	M16A5	0.6	M16A4	-0.3	203.9	0.004	8	0.013	1.38	31.711	348.09	9.1	Vitrified Clay
986	O2L34SF1	M34F1	0.8	M34A6	-0.3	324.1	0.004	12	0.013	1.68	86.002	952.5	9	
1006	O1L17SM6	M17M6	2.5	M17M5	1.9	150.5	0.004	8	0.01	1.76	39.9	445.1	9	PVC
1371	O1L37SA4	M37A4	-0.4	M37A3	-1.6	236.2	0.005	8	0.01	1.98	44.699	500.45	8.9	PVC
4321	O2L18SC1	M18A1	-3.1	M18C1	2.5	150.6	0.037	8	0.013	4.1	92.029	1041.2	8.8	Vitrified Clay
1712	O2L38SB1	M38A1	-2.9	M38B1	-1.6	300.5	0.004	8	0.01	1.83	40.853	465.5	8.8	PVC
1196	O1L14SA8	M14A8	-0.6	M14A7	-1.6	247.4	0.004	8	0.013	1.34	29.64	342.71	8.6	Vitrified Clay
928	O2L5SA7	M5A7	1.8	M5A6	0.5	282.1	0.005	6	0.013	1.18	14.67	169.64	8.6	Vitrified Clay
4475	O2L4SA2	M4A2	0.3	M4A1	0.1	16.8	0.011	6	0.013	1.81	22.365	260.6	8.6	Vitrified Clay
701	O1L17SL4	M17L4	2.3	M17L3	1.8	130.1	0.004	8	0.01	1.73	37.916	445.75	8.5	PVC
856	O2L1SJJ1	M1JJ1	1.7	M1D2	0.9	131.3	0.006	6	0.013	1.31	15.9	191.56	8.3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1586	O2L16SA3	M16A3	-1.4	M16A2	-2.6	24.9	0.045	8	0.013	4.44	95.475	1150.3	8.3	Vitrified Clay
680	O2L36SI1	M36I1	1.5	M36B3	-0.1	300.2	0.005	8	0.01	1.99	42.6	514.71	8.3	PVC
1170	O1L14SA6	M14A6	-0.5	M14A5	-2.4	64.2	0.029	8	0.013	3.56	76.174	923.17	8.3	Vitrified Clay
659	O2L36SC3	M36C3	3.9	M36C2	-0.5	309.8	0.014	8	0.01	3.24	69.331	843.1	8.2	PVC
3278	O2L18SC2	M18C2	3	M18C1	2.5	140.1	0.004	12	0.013	1.75	83.839	1019.8	8.2	
3429	O2L25SA2	M25A2	-0.4	M25A1	-1	132.9	0.004	8	0.013	1.37	29.097	355.25	8.2	Vitrified Clay
1198	O1L14SA9	M14A9	0.4	M14A8	-0.6	249.5	0.004	8	0.013	1.31	27.93	342.65	8.2	Vitrified Clay
532	O1L14SA1	M14A1	-4	W-14	-8.2	6.8	0.617	10	0.013	18.16	628.09	7726.2	8.1	
4014	O2L9SB2	M9B1	0.5	M9B2	1.5	123	0.008	6	0.01	2.01	23.625	295.15	8	PVC
953	O2L4SA4	M4A4	1.2	M4A3	0.7	103.7	0.005	6	0.013	1.15	13.545	169.51	8	Vitrified Clay
528	O2L34SA1	M34A1	-5.5	W-34	-11.1	5.9	0.953	13.8	0.012	29.8	1913.6	24545	7.8	Ductile Iron
1228	O1L14SA10	M14A10	1.2	M14A9	0.4	205.2	0.004	8	0.013	1.3	26.22	342.81	7.6	
1031	O1L17SN1	M17N1	0.1	M17A2	-1.9	188.1	0.011	12	0.013	2.77	125.4	1652.8	7.6	
1319	O1L17SQ4	M17Q4	4.1	M17Q3	3.3	199.6	0.004	8	0.013	1.29	25.65	343.31	7.5	Vitrified Clay
1582	O2L16SB2	M16B2	-1.7	M16B1	-2	109.3	0.003	8	0.013	1.16	22.896	311.19	7.4	Vitrified Clay
1698	O2L38SA5	M38A4	-3.7	M38A5	-2.1	397.1	0.004	8	0.01	1.68	33.072	450.33	7.3	PVC
1431	O2L32SB2	M32A2	0.8	M32A1	-1.2	242.9	0.008	8	0.01	2.34	45.938	630.08	7.3	PVC
3083	O2L16SA1	M16A1	-2.8	W-16	-7.3	31.2	0.145	8	0.013	7	149	2064.8	7.2	Vitrified Clay
930	O2L5SA8	M5A8	3.1	M5A7	1.8	281.1	0.005	6	0.013	1.11	12.15	169.28	7.2	Vitrified Clay
1605	O1L17SO2	M17O2	2.9	M17O1	1.7	258.3	0.005	8	0.01	1.76	34.2	476.53	7.2	PVC
3516	O2L35SD1	M35A3	1.5	M35D1	2	109.8	0.005	8	0.01	1.78	34.432	480.46	7.2	PVC
4096	O2L1SA10	M1A9	3	M1A10	4.3	221.4	0.006	8	0.013	1.51	28.75	410.73	7	Vitrified Clay
1718	O2L16SA2	M16A2	-2.6	M16A1	-2.8	25.6	0.007	12	0.013	2.24	95.475	1378.3	6.9	
692	O2L36SB4	M36B4	0.5	M36B3	-0.1	188.5	0.003	8	0.01	1.5	28.201	410.79	6.9	PVC
863	O2L1SK2	M1E4	3	M1E3	1.5	125.9	0.012	6	0.013	1.78	18.75	274.92	6.8	Vitrified Clay
4273	O2L32SC2	M32C1	0	M32C2	1	151.6	0.007	6	0.013	1.32	13.805	204.55	6.7	Vitrified Clay
1130	O1L14SF2	M14F2	2.5	M14F1	1.8	250.2	0.003	8	0.013	1.08	19.95	296.94	6.7	Vitrified Clay
3990	O2L35SA4	M35A3	1.5	M35A4	2.7	270.8	0.004	8	0.01	1.7	31.4	469.34	6.7	PVC
667	O2L36SG1	M36G1	5	M36C3	3.9	232.8	0.005	8	0.013	1.34	24.739	371.09	6.7	
1588	O2L16SD1	M16D1	-0.1	M16A3	-1.4	285.7	0.005	8	0.013	1.34	24.462	371.41	6.6	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
3713	O2L22SA1	M22A1	-1.4	W-23	-2.2	16.1	0.048	12	0.013	5.59	224.49	3518.3	6.4	
1433	O2L32SA3	M32A2	0.8	M32A3	1.1	73.4	0.005	8	0.01	1.78	31.068	500.5	6.2	PVC
793	O2L2SD1	M2D1	-1.7	M2A1	-2.1	55.3	0.007	6	0.013	1.31	12.9	207.87	6.2	Vitrified Clay
796	O2L2SC1	M2C1	-1.8	M2A1	-2.1	40	0.007	6	0.013	1.28	12.6	203.11	6.2	Vitrified Clay
1356	O2L16SA6	M16A6	1.1	M16A5	0.6	98.2	0.005	8	0.01	1.82	31.711	512.97	6.2	PVC
1394	O1L17SB1	M17B1	2.2	M17A11	1.6	20.6	0.03	10	0.01	5.03	136.8	2218.4	6.2	PVC
1477	O2L39SA1	W-39	-2	M39A1	-1.6	76	0.005	8	0.01	0.2	31.501	511.59	6.2	PVC
1418	O1L17SB10	M17B10	7	M17B9	6.5	112.2	0.004	8	0.012	1.32	22.8	372.14	6.1	Ductile Iron
869	O2L1SE1	M1E1	-0.3	M1A2	-0.8	104.8	0.005	8	0.013	1.35	23.25	382.92	6.1	Vitrified Clay
867	O2L1SE2	M1E2	0.7	M1E1	-0.3	210.7	0.004	8	0.013	1.27	21.45	363.06	5.9	Vitrified Clay
4182	O2L7SB2	M1D1	-0.2	M1A1	-1	175.9	0.005	8	0.013	1.28	21.6	366.44	5.9	Vitrified Clay
1444	O2L31SA3	M31A3	-0.1	M31A2	-2.3	325.9	0.007	8	0.01	2.03	34.205	581.9	5.9	PVC
1442	O2L31SA4	M31A4	0.4	M31A3	-0.1	326.6	0.001	8	0.01	0.92	15.54	264.6	5.9	PVC
703	O1L17SL5	M17L5	3.6	M17L4	2.3	301.8	0.004	8	0.01	1.59	26.516	455.56	5.8	PVC
911	O2L5SA3	M5A3	-2.4	M5A2	-2.7	54.7	0.005	8	0.01	1.66	27.585	476.76	5.8	PVC
3198	O2L18SA1	W-18	-5.2	M18A1	-3.1	11.3	0.186	8	0.013	0.86	134.55	2339.4	5.8	Vitrified Clay
1522	O2L34SC2	M34C2	-0.3	M34C1	-1	152.4	0.005	8	0.01	1.64	26.396	480.62	5.5	PVC
4181	O2L7SB2	M1D2	0.9	M1D1	-0.2	268.1	0.004	8	0.013	1.22	19.5	358.58	5.4	Vitrified Clay
3187	O2L30SE1	M30B2	0	M30B1	-0.5	58.1	0.009	6	0.013	1.41	12.6	233.56	5.4	Vitrified Clay
976	O2L34SF2	M34F2	1.9	M34F1	-0.8	304.3	0.009	12	0.013	2.23	78.915	1480.9	5.3	
3193	O2L30SB4	M30B4	1.7	M30B3	1	143.5	0.005	4	0.01	1.05	4.095	77.556	5.3	PVC
1351	O2L34SL	M34L1	1.6	M34A8	0	389.1	0.004	8	0.013	1.16	18.058	343.39	5.3	Vitrified Clay
1714	O2L38SB3	M38B1	-1.6	M38B2	0.1	298.2	0.006	8	0.01	1.77	27.236	527.58	5.2	PVC
4002	O1L17SQ0	M17Q0	0.6	W-17	-0.1	26.7	0.027	8	0.01	3.86	59.217	1150	5.1	PVC
1083	O1L17SG1	M17G1	4.8	M17A10	4.1	172.1	0.004	8	0.01	1.49	22.8	446.44	5.1	PVC
1174	O1L14SM1	M14M1	-0.4	M14A7	-1.6	293.9	0.004	8	0.013	1.15	17.385	343.06	5.1	Vitrified Clay
1593	O2L16SA4	M16A4	-0.3	M16A3	-1.4	188.8	0.006	12	0.013	1.85	62.92	1253.3	5	
848	O2L1SJJ2	M1JJ2	2.1	M1JJ1	1.7	66.2	0.007	6	0.013	1.21	10.2	203.87	5	Vitrified Clay
1563	O1L14SH2	M14H2	3.4	M14H1	3	117.6	0.004	8	0.013	1.14	17.1	342.84	5	Vitrified Clay
859	O2L1SB1	M1A1	-1	M1B1	-0.4	124.3	0.005	8	0.013	1.24	18.6	375.29	5	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1321	O1L17SQ3	M17Q3	3.3	M17Q2	-3.4	341	0.02	8	0.013	2.51	37.05	759.03	4.9	Vitrified Clay
4020	O2L5SD2	M5D1	-1	M5D2	-0.8	43.7	0.005	6	0.01	1.3	10.71	221.39	4.8	PVC
1055	O1L17ST2	M17T2	-3.3	M17T1	-3.5	39.8	0.004	12	0.013	1.48	48.45	1013.6	4.8	
1021	O1L17SO3	M17O3	4.1	M17O2	2.9	270.1	0.005	8	0.01	1.57	22.8	477.74	4.8	PVC
1450	O2L31SB3	M31B2	0.8	M31B1	-0.4	235.1	0.005	8	0.01	1.61	23.338	493.11	4.7	PVC
4021	O2L5SD3	M5D2	-0.8	M5D3	0.7	341.9	0.005	6	0.013	0.98	7.875	169	4.7	Vitrified Clay
3657	O2L31SB1	M31A1	-4	W-31	-9.6	36.6	0.153	8	0.01	8.32	125.43	2756.8	4.5	PVC
1208	O1L14SS2	M14S2	2.1	M14S1	1	288.3	0.004	8	0.013	1.05	14.82	325.73	4.5	Vitrified Clay
3992	O2L35SA5	M35A4	2.8	M35A4	3.6	218.5	0.004	8	0.01	1.36	19.14	423.99	4.5	PVC
1312	O1L14SG1	M14G1	2.4	M14C9	1.7	177.5	0.004	8	0.01	1.42	19.95	442.78	4.5	PVC
1696	O2L38SA5	M38A6	-1.1	M38A5	-2	224.6	0.004	8	0.01	1.45	19.946	451.2	4.4	PVC
1613	O2L3SD1	M3D1	-0.2	M3A1	-1.8	527	0.003	8	0.013	0.96	13.11	296.95	4.4	Vitrified Clay
1776	O2L30SA4	M30A4	1.4	M30A3	0.6	183.3	0.005	6	0.013	0.98	7.56	171.47	4.4	Vitrified Clay
3476	O1L40SA1	M40A1	-0.6	W-40	-1.5	10.6	0.085	8	0.01	6.6	90.528	2054.1	4.4	PVC
1202	O1L14SS1	M14S1	1	M14A7	-1.6	247.7	0.011	8	0.013	1.78	24.368	556.67	4.4	Vitrified Clay
732	O2L3SL1	M3L1	0.4	M3H1	-0.1	113.6	0.005	6	0.013	0.97	7.41	170.35	4.3	Vitrified Clay
661	O2L36SC4	M36C4	5.1	M36C3	3.9	227.5	0.005	8	0.01	1.58	21.482	494.65	4.3	PVC
4064	O2L2SP1	M2P1	0	M2A2	-1.3	292.9	0.004	8	0.013	1.14	15.3	357.43	4.3	Vitrified Clay
1053	O1L17ST3	M17T3	-2.8	M17T2	-3.3	99.7	0.005	12	0.013	1.6	48.45	1132.6	4.3	
576	O2L7SE1	M7E1	4.9	M7D3	2.7	432.8	0.005	6	0.013	1.02	7.7333	181.57	4.3	Vitrified Clay
4218	O2L25SA3	M25A2	-0.4	M25A3	0.2	107.7	0.006	8	0.013	1.29	17.127	404.83	4.2	Vitrified Clay
963	O2L4SA5	M4A5	1.8	M4A4	1.2	122.9	0.005	6	0.013	0.97	7.245	171.5	4.2	Vitrified Clay
3192	O2L30SF1	M30B3	1	M30B2	0	167.7	0.006	6	0.013	1.1	8.19	194.44	4.2	Vitrified Clay
137	O1L17SJ1	M17J1	3.7	M17A9	2.6	254	0.004	8	0.013	1.13	14.962	356.87	4.2	
1567	O1L14SH4	M14H4	4.2	M14H3	3.8	105.9	0.004	8	0.013	1.08	14.25	341.52	4.2	Vitrified Clay
3175	O2L30SA2	M30B1	-0.5	M30A1	-0.9	23.9	0.018	6	0.013	1.85	13.545	333.55	4.1	Vitrified Clay
1706	O2L38SC1	M38A2	-2	M38C1	-0.7	296.3	0.004	12	0.013	1.42	41.003	1030.2	4	
860	O2L1SB2	M1B1	-0.4	M1B2	1.2	373.3	0.004	8	0.013	1.09	13.8	354.63	3.9	Vitrified Clay
1612	O2L3SD2	M3D2	0.6	M3D1	-0.2	284.2	0.003	8	0.013	0.89	11.115	287.73	3.9	Vitrified Clay
735	O2L3SA3	M3A3	0.4	M3A2	-1.3	474.8	0.004	8	0.013	0.99	12.255	321.66	3.8	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1565	O1L14SH3	M14H3	3.8	M14H2	3.4	53.6	0.007	8	0.013	1.38	17.1	450.68	3.8	Vitrified Clay
1447	O2L31SB1	M31B1	-0.4	M31A1	-4	231.3	0.015	8	0.01	2.67	32.788	875.9	3.7	PVC
1025	O1L17SN2	M17N2	3.7	M17N1	0.1	202.6	0.018	8	0.01	2.84	34.2	935.91	3.7	PVC
1481	O2L39SA2	M39A1	-1.6	M39A2	-0.3	346.5	0.004	8	0.01	0.1	15.75	440.09	3.6	PVC
1435	O2L32SA4	M32A4	1.9	M32A3	1.1	179	0.004	8	0.01	1.4	16.517	465.42	3.5	PVC
3121	O2L29SB1	M29B1	-1	M29A1	-1.6	116	0.005	6	0.01	1.24	8.19	231.48	3.5	PVC
1749	O2L31SB3	M31B3	1.7	M31B2	0.8	175	0.005	8	0.01	1.52	17.767	505.55	3.5	PVC
4451	O2L18SB1	M18A1	-3.1	M18B1	-2.4	108	0.007	8	0.013	0.1	15.435	439.69	3.5	Vitrified Clay
1081	O1L17SH1	M17H1	2.6	M17A10	2.3	40.6	0.006	8	0.01	1.65	19.237	553.53	3.5	PVC
676	O2L36SB6	M36B6	3	M36B5	2.1	238.2	0.004	8	0.01	1.31	14.901	442.9	3.4	PVC
1210	O1L14SS3	M14S3	2.9	M14S2	2.1	210.9	0.004	8	0.013	0.99	11.115	334.02	3.3	Vitrified Clay
742	O2L3SA4	M3A4	1.4	M3A3	0.4	285.6	0.004	8	0.013	0.94	10.545	320.92	3.3	Vitrified Clay
1070	O1L17SQ1	M17Q1	-4	M17Q0	0.6	105.3	-0.043	8	0.013	0.24	37.05	1128.7	3.3	Vitrified Clay
1716	O2L38SB3	M38B2	0.1	M38B3	1.5	395.4	0.003	8	0.01	1.22	13.618	416.54	3.3	PVC
786	O2L2SD3	M2D3	1.5	M2D2	0	255.5	0.006	6	0.013	1.01	6.3	192.96	3.3	Vitrified Clay
3384	O2L25SB2	M25B2	0.9	M25B1	0.3	267.7	0.002	8	0.013	0.79	8.76	269.31	3.3	Vitrified Clay
1079	O1L17SH2	M17H2	3	M17H1	2.6	95.1	0.005	8	0.01	1.48	16.388	506.06	3.2	PVC
1308	O1L14SG1	M14C10	2.6	M14C9	1.7	204.6	0.004	8	0.01	1.3	14.25	446.3	3.2	PVC
691	O2L36SB5	M36B5	2.1	M36B4	0.5	346.3	0.004	8	0.01	1.36	14.901	467.13	3.2	PVC
1796	O2L26SA1	M26A1	-0.1	W-26	-0.3	30.7	0.007	6	0.019	0.72	4.41	139.01	3.2	
610	O2L2SA4	M2A4	1.5	M2A3	0.3	385.4	0.003	8	0.013	0.88	9.6	302.61	3.2	Vitrified Clay
1379	O1L37SC1	M37C1	-2.6	M37A1	-3.2	151.6	0.004	8	0.01	1.25	13.574	428.51	3.2	PVC
1349	O2L34SU1	M34U1	2.6	M34L1	1.6	241.1	0.004	8	0.013	1.02	10.978	351.02	3.1	Vitrified Clay
705	O1L17SL6	M17L6	4	M17L5	3.6	88.8	0.005	8	0.01	1.4	15.116	484.91	3.1	PVC
990	O2L34SI1	M34J1	0.1	M34A7	-0.5	104.2	0.006	6	0.013	1	6.0375	194.22	3.1	Vitrified Clay
3349	O2L25SA4	M25A4	1	M25A3	0.2	124.4	0.006	8	0.01	1.6	17.127	554.7	3.1	PVC
3390	O2L25SA5	M25A4	1	M25A5	1.5	128.6	0.004	8	0.01	1.28	13.662	443.97	3.1	PVC
3392	O2L25SA6	M25A6	1.9	M25A5	1.5	110	0.004	8	0.01	1.26	13.347	435.75	3.1	PVC
767	O2L2SA3	M2A3	0.3	M2A2	-1.3	170.1	0.009	8	0.013	1.48	15.6	517.85	3	Vitrified Clay
1610	O2L3SD3	M3D3	1.5	M3D2	0.6	298.5	0.003	8	0.013	0.85	8.835	299.44	3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4478	O2L4SG1	M4G1	3	M4A1	0.1	347.6	0.008	6	0.013	1.16	6.7725	230.02	2.9	Vitrified Clay
567	O2L7SD4	M7D4	4.4	M7D3	2.7	329.2	0.005	6	0.013	0.93	5.4	183.62	2.9	
932	O2L5SD4	M5D4	2.2	M5D3	0.7	315.1	0.005	6	0.013	0.87	5.04	173.17	2.9	Vitrified Clay
3518	O2L35SB1	M35A1	-1.3	M35B1	2	326.2	0.01	8	0.01	2.01	20.636	709.15	2.9	PVC
3358	O2L25SB1	M25B1	0.3	M25A1	-1	149.3	0.008	8	0.013	1.39	14.115	494.2	2.9	Vitrified Clay
3195	O2L30SF1	M30F1	1.8	M30B3	1	205.5	0.004	4	0.01	0.77	1.89	69.272	2.7	PVC
804	O2L2SC2	M2C2	-1.3	M2C1	-1.8	83.4	0.006	6	0.013	0.98	5.4	198.28	2.7	Vitrified Clay
666	O2L36SG2	M36G2	6	M36G1	5	235.8	0.004	8	0.01	1.26	12.37	454.49	2.7	PVC
1719	O2L16SB1	M16B1	-2	M16A1	-2.8	114.9	0.006	12	0.013	1.58	34.912	1283.3	2.7	
3113	O2L29SA2	M29A2	-0.7	M29A1	-1.6	160.7	0.006	8	0.01	1.46	14.175	527.71	2.7	PVC
595	O2L7SF1	M7F1	4.1	M7D2	1.8	335.2	0.007	6	0.013	1.01	5.4	207.68	2.6	
3996	O2L36SD1	M36B1	-4	M36D1	1	188.9	0.026	8	0.01	3.13	29.802	1147.1	2.6	PVC
1406	O1L17SI1	M17I1	4.9	M17B5	4.7	64.3	0.004	8	0.01	1.2	11.4	439.57	2.6	PVC
4269	O1L14SF3	M14F2	2.5	M14F3	3	132.3	0.004	8	0.013	0.9	8.55	330.07	2.6	Vitrified Clay
4418	O2L30SA2	M30A2	-0.2	M30A1	-0.9	85.8	0.009	8	0.013	1.37	12.915	501.36	2.6	
1416	O1L17SE1	M17E1	7	M17B9	6.5	115	0.004	8	0.01	1.21	11.4	445.98	2.6	PVC
1004	O1L17SM7	M17M7	3.8	M17M6	2.5	319.4	0.004	8	0.01	1.21	11.4	446.35	2.6	PVC
1410	O1L17SD1	M17D1	6.2	M17B6	5.6	164.6	0.004	8	0.01	1.21	11.4	446.41	2.6	PVC
1420	O1L17SB11	M17B11	7.8	M17B10	7	190.4	0.004	8	0.01	1.23	11.4	457.07	2.5	PVC
842	O2L1SJJ3	M1JJ3	2.7	M1JJ2	2.1	81.2	0.007	6	0.013	0.98	5.1	205.35	2.5	Vitrified Clay
637	O2L36SA9	M36A9	1	M36A8	0.2	86.2	0.009	8	0.01	1.81	16.625	670.63	2.5	PVC
3414	O2L18SA2	M18A2	-2.5	M18A1	-3.1	163.8	0.004	12	0.013	0.07	24.57	991.79	2.5	
784	O2L2SD4	M2D4	3	M2D3	1.5	383.8	0.004	6	0.013	0.75	3.9	157.44	2.5	Vitrified Clay
3419	O2L18SA3	M18A3	-1.6	M18A2	-2.5	255	0.003	8	0.013	0.05	7.875	320.4	2.5	Vitrified Clay
709	O2L3SH3	M3H3	1.8	M3H2	1.3	115.2	0.005	6	0.013	0.81	4.135	169.18	2.4	Vitrified Clay
3179	O2L30SB5	M30B5	2.2	M30B4	1.7	110.8	0.005	6	0.013	0.8	4.095	169.15	2.4	Vitrified Clay
3331	O2L25SC1	M25C1	0.6	M25A2	-0.4	133.3	0.008	6	0.013	1.05	5.355	221.35	2.4	Vitrified Clay
673	O2L36SF1	M36F1	3	M36D2	1.9	139.7	0.008	8	0.01	1.66	14.901	619.99	2.4	PVC
1427	O2L32SC1	M32A1	-0.6	M32C1	-0.4	27.1	0.007	8	0.01	1.53	13.805	574.73	2.4	PVC
1186	O1L14SM3	M14M3	3	M14M2	2.2	209.2	0.004	8	0.013	0.93	8.265	347.74	2.4	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
3305	O2L24SA1	M24D1	-0.9	M24A1	-1.6	169.2	0.004	6	0.013	0.75	3.78	159.65	2.4	Vitrified Clay
1027	O1L17SN3	M17N3	4.7	M17N2	3.7	210.4	0.005	8	0.01	1.28	11.4	483.64	2.4	PVC
639	O2L36SH2	M36H2	5.1	M36H1	3	229.5	0.009	8	0.01	1.77	15.703	669.54	2.3	PVC
1230	O1L14SA11	M14A11	2	M14A10	1.2	138.9	0.006	8	0.013	1.1	9.69	415.7	2.3	Vitrified Clay
3411	O2L18SE1	M18E1	-1.8	M18A2	-2.5	142.4	0.005	8	0.013	0.06	8.82	380.31	2.3	Vitrified Clay
663	O2L36SC5	M36C5	6	M36C4	5.1	220.1	0.004	8	0.01	1.22	10.741	463.16	2.3	PVC
4063	O2L2SR1	M2R1	1.8	M2P1	0	423.6	0.004	8	0.013	0.93	8.1	352.99	2.3	Vitrified Clay
1029	O1L17SN4	M17N4	5.3	M17N3	4.7	122.5	0.005	8	0.01	1.31	11.4	497.52	2.3	PVC
1603	O2L38SD1	M38D1	0.1	M38A6	-1	190.5	0.006	8	0.01	1.4	12.154	530.84	2.3	PVC
4479	O2L4SA1	M4A1	0.1	W-4	-4.6	7.7	0.602	6	0.013	8.39	44.529	1953.9	2.3	Vitrified Clay
592	O2L7SG1	M7G1	3.9	M7D1	1	328.7	0.009	6	0.013	1.11	5.4	237.34	2.3	
4018	O2L5SD1	M5A2	-2.7	M5D1	-1	360.5	0.005	8	0.01	1.25	10.71	475.56	2.3	PVC
1526	O2L34SC4	M34C4	2.9	M34C3	1.7	308.5	0.004	12	0.013	1.17	22.604	1009.7	2.2	Vitrified Clay
1561	O1L14SH1	M14H1	3	M14D2	1.3	47	0.036	8	0.013	2.67	22.8	1025.4	2.2	Vitrified Clay
1537	O2L34SB3	M34B3	2.9	M34B2	2.3	139.3	0.004	8	0.01	1.23	10.427	470.36	2.2	PVC
1535	O2L34SB2	M34B2	2.3	M34B1	1.7	122.7	0.004	8	0.01	1.23	10.427	471.99	2.2	PVC
647	O2L36SE1	M36E1	2.2	M36A3	-2.4	311.1	0.015	8	0.01	2.24	18.913	864.78	2.2	PVC
4028	O2L3SB1	M3A4	1.4	M3B1	1.9	100.8	0.005	6	0.013	0.78	3.705	170.08	2.2	Vitrified Clay
4066	O2L2SP2	M2P1	0	M2P2	0.5	91.8	0.006	6	0.013	0.9	4.2	196.19	2.1	
1463	O2L34SA12	M34A12	1.7	M34A11	1.5	31.8	0.004	8	0.013	0.92	7.6125	359.79	2.1	Vitrified Clay
1462	O2L34SA13	M34A13	2.1	M34A12	1.7	127.9	0.003	8	0.013	0.8	6.5625	314.43	2.1	Vitrified Clay
1528	O2L34SC5	M34C5	4.1	M34C4	2.9	308.2	0.004	12	0.013	1.15	21	1010.1	2.1	Vitrified Clay
1182	O1L14SM2	M14M2	2.2	M14M1	-0.4	216.3	0.012	8	0.013	1.51	12.255	591.62	2.1	Vitrified Clay
1068	O1L17SQ0	M17T1	-3.5	M17A1	-7	161.1	0.022	12	0.013	2.67	48.45	2353.3	2.1	
728	O2L3SL2	M3L2	0.9	M3L1	0.4	83.1	0.005	6	0.013	0.82	3.705	181.11	2	Vitrified Clay
4387	O2L32SB2	M32B1	2	M32B2	3	272.8	0.004	8	0.01	1.08	8.699	426.9	2	PVC
3181	O2L30SB6	M30B6	2.7	M30B5	2.2	91.7	0.005	6	0.013	0.84	3.78	186	2	Vitrified Clay
788	O2L2SD2	M2D2	0	M2D1	-1.7	68.4	0.025	6	0.013	1.8	8.1	398.66	2	Vitrified Clay
974	O2L34SF2	M34F3	2.7	M34F2	1.9	281.3	0.003	8	0.013	0.77	6.1235	303.34	2	Vitrified Clay
947	O2L4SB1	M4B1	2.5	M4A3	0.7	377.4	0.005	6	0.013	0.78	3.465	172.94	2	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1214	O1L14SS4	M14S4	3.7	M14S3	2.9	209.4	0.004	8	0.013	0.87	6.84	343.46	2	Vitrified Clay
3190	O2L30SE1	M30E1	1.5	M30B2	0	205.1	0.007	4	0.01	0.95	1.89	94.953	2	PVC
798	O2L2SF1	M2F1	0.4	M2C1	-1.8	420.7	0.005	6	0.013	0.81	3.6	182.25	2	Vitrified Clay
638	O2L36SH1	M36H1	3	M36A8	0.2	96.2	0.029	8	0.01	3.01	23.555	1198.8	2	PVC
3900	O2L34SA14	M34A13	2.1	M34A14	2.3	50.2	0.003	8	0.013	0.74	5.775	296.44	1.9	
4417	O2L30SA3	M30A3	0.6	M30A2	-0.2	86.2	0.009	8	0.013	1.25	9.765	501.36	1.9	
1533	O2L34SD1	M34D1	2.9	M34B1	1.7	285.9	0.004	8	0.01	1.13	8.778	451.03	1.9	PVC
3136	O2L34SL2	M34L2	2.3	M34L1	1.6	126.4	0.006	6	0.01	1.1	4.8225	248.74	1.9	PVC
1358	O2L16SA7	M16A7	2.8	M16A6	1.1	397.2	0.004	8	0.01	1.14	8.8737	458.56	1.9	PVC
3988	O1L37SC1	M14D5	3.5	M14D4	2.8	225.2	0.003	8	0.013	0.74	5.7	298.04	1.9	Vitrified Clay
1314	O1L14SG2	M14G2	3.3	M14G1	2.4	203	0.004	8	0.01	1.11	8.55	448.05	1.9	PVC
1539	O2L34SB4	M34B4	3.5	M34B3	2.9	146.2	0.004	8	0.01	1.13	8.6771	455.49	1.9	PVC
3126	O2L29SB2	M29B2	0	M29B1	-1	152.4	0.007	6	0.01	1.18	5.04	265.2	1.9	PVC
3225	O2L18SB2	M18B2	-1.6	M18B1	-2.4	137	0.006	8	0.013	0.05	7.875	422.13	1.9	Vitrified Clay
821	O2L1SB3	M1B2	1.2	M1B3	2.4	277.1	0.004	8	0.013	0.88	6.6	357.79	1.8	Vitrified Clay
1531	O2L34SD2	M34D2	3.6	M34D1	2.9	139.4	0.005	8	0.01	1.18	8.778	481.37	1.8	PVC
378	O2L3SG1	M3G1	0.2	M3A2	-1.3	398.5	0.004	8	0.013	0.81	5.985	330.52	1.8	Vitrified Clay
3902	O2L13SA1	W-13	2.7	M13A1	3.2	115.4	0.004	8	0.01	1.14	8.33	464.05	1.8	PVC
1601	O2L38SD2	M38D2	0.7	M38D1	0.2	191.8	0.002	8	0.01	0.83	6.0769	341.53	1.8	PVC
671	O2L36SD3	M36D3	3	M36D2	1.9	76.5	0.014	8	0.01	2.03	14.901	837.85	1.8	PVC
967	O2L4SG2	M4G2	5.4	M4G1	3	360.7	0.007	6	0.013	0.88	3.6225	205.41	1.8	Vitrified Clay
769	O2L2SJ1	M2A3	0.3	M2J1	0.1	127.5	-0.001	8	0.013	0.02	3.3	192.16	1.7	Vitrified Clay
695	O1L17SL1	M17L1	0.9	M17A8	-2.1	21.4	0.139	8	0.01	6.35	45.041	2631.4	1.7	PVC
636	O2L36SA10	M36A10	1.4	M36A9	1	88	0.005	8	0.01	1.17	8.3125	487.09	1.7	PVC
1520	O2L34SC1	M34C1	-1	M34A2	-4.6	374	0.01	12	0.01	2.17	34.417	2030.2	1.7	PVC
640	O2L36SH3	M36H3	6	M36H2	5.1	213.5	0.004	8	0.01	1.12	7.8517	465.33	1.7	PVC
585	O2L7SA4	M7A4	1.3	M7A3	-0.6	364.9	0.005	8	0.013	0.94	6.6	391.35	1.7	Vitrified Clay
757	O2L3SA6	M3A6	2.9	M3A5	1.7	259.6	0.005	6	0.013	0.72	2.85	169.07	1.7	Vitrified Clay
992	O2L34SJ2	M34K1	1.1	M34J1	0.1	182.5	0.006	6	0.013	0.8	3.15	187.35	1.7	Vitrified Clay
934	O2L5SD5	M5D5	3.4	M5D4	2.2	254	0.005	6	0.013	0.72	2.835	169.45	1.7	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1569	O1L14SH5	M14H5	5.2	M14H4	4.2	246.4	0.004	8	0.013	0.82	5.7	343.76	1.7	Vitrified Clay
3418	O2L18ASA4	M18A4	-0.9	M18A3	-1.6	164.1	0.004	8	0.013	0.04	5.67	343.92	1.6	Vitrified Clay
4104	O2L1SBB1	M1A7	1.7	M1BB1	2.4	89.8	0.008	6	0.013	0.93	3.6	218.9	1.6	Vitrified Clay
823	O2L1SB4	M1B3	2.4	M1B4	3.5	154.1	0.007	4	0.013	0.7	1.2	73.532	1.6	Vitrified Clay
4477	O2L4SH1	M4H1	2.5	M4A1	0.1	404.3	0.006	6	0.013	0.82	3.15	194.02	1.6	Vitrified Clay
1037	O1L17ST4	M17T4	1.1	M17T3	-2.8	190.2	0.021	12	0.013	2.41	37.05	2289.8	1.6	
1590	O2L16SD2	M16D2	2	M16D1	-0.1	279	0.008	8	0.013	1.11	7.5542	470.5	1.6	Vitrified Clay
1310	O1L14SC11	M14C11	3.1	M14C10	2.6	135.7	0.004	8	0.01	1.05	7.125	444.74	1.6	PVC
4009	O2L9SA2	M9A1	-0.3	M9A2	1.1	236.1	0.006	12	0.013	1.29	19.688	1231.2	1.6	
3981	O2L15SA1	W-15	3.5	M15A1	4.5	266.7	0.004	8	0.01	1.01	6.7375	431.72	1.6	PVC
894	O2L1SA11	M1A10	5.9	M1A11	6.4	146.8	0.003	8	0.01	0.96	6.25	411.46	1.5	PVC
1437	O2L32SD1	M32D1	1.4	M32A3	1.1	78.3	0.003	8	0.01	0.93	6.02	398.51	1.5	PVC
758	O2L3SA5	M3A5	1.7	M3A4	1.4	87.5	0.004	8	0.013	0.75	4.845	322.82	1.5	Vitrified Clay
3950	O2L29SA3	M29A2	-0.7	M29A3	0.2	149.9	0.006	8	0.01	1.23	7.875	529.4	1.5	PVC
1524	O2L34SC3	M34C3	1.7	M34C2	-0.3	30.9	0.064	8	0.01	4.12	26.396	1782.6	1.5	PVC
4153	O2L1SV1	M1U1	2.6	M1V1	3	43.4	0.009	4	0.013	0.76	1.2	81.985	1.5	Vitrified Clay
711	O2L3SH4	M3H4	2.5	M3H3	1.8	81.3	0.009	4	0.013	0.73	1.14	79.253	1.4	Vitrified Clay
4159	O2L1SS1	M1A4	1	M1S1	1.8	120.9	0.007	6	0.013	0.85	3	208.66	1.4	Vitrified Clay
613	O2L2SA5	M2A5	1.9	M2A4	1.5	124.8	0.004	8	0.013	0.77	4.8	336.41	1.4	Vitrified Clay
3435	O1L37SA1	M37A1	-3.2	W-37	-3.7	8.4	0.056	12	0.01	4.99	69.759	4904.3	1.4	PVC
1739	O2L16SB3	M16B3	-1.5	M16B2	-1.7	50.3	0.004	12	0.013	1.03	14.321	1008.4	1.4	
618	O2L3SD4	M3D4	2	M3D3	1.5	115	0.004	8	0.013	0.8	4.845	350.41	1.4	Vitrified Clay
4428	O2L16SC1	M16A1	-2.8	M16C1	2.2	437.7	0.011	8	0.013	1.3	7.875	576.76	1.4	
4057	O2L2ST1	M2R1	1.8	M2T1	2.3	85.8	0.006	6	0.013	0.8	2.7	198.53	1.4	Vitrified Clay
4030	O2L3SB2	M3B1	1.9	M3B2	2.8	214	0.005	6	0.013	0.68	2.28	169.53	1.3	Vitrified Clay
4271	O2L4SG3	M4G2	5.4	M4G3	6.2	100.2	0.008	6	0.013	0.9	2.9925	224.99	1.3	Vitrified Clay
1542	O2L34SB1	M34B1	1.7	M34A1	-5.5	102.4	0.071	8	0.01	4.2	24.795	1873.1	1.3	PVC
1039	O1L17SV1	M17V1	1.8	M17T4	1.1	162.6	0.005	12	0.013	1.07	14.25	1086	1.3	
4162	O2L1SS2	M1S1	1.8	M1S2	2.5	60.4	0.012	4	0.013	0.82	1.2	91.915	1.3	Vitrified Clay
1095	O1L17SP2	M17P2	4.1	M17P1	2.9	316.4	0.004	8	0.01	0.98	5.7	441.35	1.3	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1097	O1L17SP3	M17P3	4.5	M17P2	4.1	90	0.004	8	0.01	0.99	5.7	445.84	1.3	PVC
3644	O2L18ASA1	M18A-A1	-1	W-18A	-4	21.7	0.139	12	0.013	5.51	76.004	5961.7	1.3	
980	O2L34SH2	M34H1	-0.2	M34H2	0.9	195.1	0.006	6	0.013	0.74	2.3625	186.95	1.3	Vitrified Clay
835	O2L1SH3	M1H2	3.3	M1H3	3.6	46.6	0.007	4	0.013	0.64	0.9	71.885	1.3	Vitrified Clay
1773	O2L30SA5	M30A5	2.2	M30A4	1.4	174.9	0.004	8	0.013	0.77	4.41	355.13	1.2	Vitrified Clay
1093	O1L17SP1	M17P1	2.9	M17A1	-7	91.4	0.108	8	0.01	5.02	28.5	2316.4	1.2	PVC
3144	O2L34SL3	M34L3	2.9	M34L2	2.3	91.7	0.006	6	0.01	0.99	3.09	254.72	1.2	PVC
4098	O2L1SHH1	M1A9	3	M1HH1	3.5	77.2	0.006	6	0.013	0.77	2.4	198.6	1.2	Vitrified Clay
4050	O2L2SR3	M2R2	3.2	M2R3	3.7	81.2	0.006	6	0.013	0.77	2.4	198.81	1.2	Vitrified Clay
3320	O2L24SA2	M24A2	-1	M24A1	-1.6	142.9	0.004	6	0.013	0.62	1.89	159.05	1.2	Vitrified Clay
755	O2L3SA7	M3A7	3.5	M3A6	2.9	148.7	0.005	6	0.013	0.65	1.995	169.06	1.2	Vitrified Clay
819	O2L1SF1	M1F1	2.5	M1B2	1.2	315.9	0.004	8	0.013	0.76	4.2	356.39	1.2	Vitrified Clay
806	O2L2SC3	M2C3	0.9	M2C2	-1.3	422.1	0.005	6	0.013	0.7	2.1	182.37	1.2	Vitrified Clay
800	O2L2SF2	M2F2	2.1	M2F1	0.4	318	0.005	6	0.013	0.69	2.1	183.59	1.1	Vitrified Clay
649	O2L36SE2	M36E2	6	M36E1	2.2	273.3	0.014	8	0.01	1.76	9.4567	827	1.1	PVC
1786	O2L30SA1	M30A1	-0.9	W-30	-5.5	19.7	0.23	8	0.013	5.12	29.61	2601.4	1.1	
581	O2L7SA6	M7A6	4.9	M7A5	3.3	302.5	0.005	6	0.013	0.69	2.1	184.85	1.1	Vitrified Clay
1046	O1L17ST7	M17T7	2.4	M17T6	2.1	93.7	0.004	12	0.013	0.95	11.4	1004.7	1.1	
1048	O1L17ST6	M17T6	2.1	M17T5	1.8	68.2	0.004	12	0.013	0.95	11.4	1006.3	1.1	
3948	O2L10SA1	W-10	4.4	M10A1	5.5	238.1	0.005	6	0.01	0.83	2.4792	222.53	1.1	PVC
1708	O2L38SC2	M38C1	-0.6	M38C2	1	264.1	0.006	12	0.013	1.18	13.938	1252.3	1.1	
1400	O1L17SC1	M17C1	3.7	M17B3	3.4	65.6	0.004	12	0.013	0.97	11.4	1025.7	1.1	
901	O2L23SB2	M23B2	3.5	M23B1	1.9	401.3	0.004	8	0.013	0.72	3.7917	342.43	1.1	Vitrified Clay
3410	O2L18SE2	M18E2	-0.6	M18E1	-1.8	282.2	0.004	8	0.013	0.02	3.78	343.2	1.1	Vitrified Clay
827	O2L1SH1	M1B3	2.4	M1H1	2.9	94.6	0.006	8	0.013	0.86	4.5	409.82	1.1	Vitrified Clay
584	O2L7SA5	M7A5	3.3	M7A4	1.3	399.6	0.005	8	0.013	0.8	4.2	383.71	1.1	Vitrified Clay
978	O2L34SH1	M34F1	0.8	M34H1	-0.2	109.3	-0.01	8	0.013	0.04	5.775	530.12	1.1	Vitrified Clay
3984	O1L37SC2	M37C1	-2.6	M37C2	-1.4	255.1	0.005	8	0.01	1.03	5.2208	497.45	1	PVC
4122	O2L1SEE1	M1BB1	2.4	M1EE1	2.9	49.2	0.01	4	0.013	0.71	0.9	86.119	1	Vitrified Clay
1049	O1L17ST5	M17T5	1.8	M17T4	1.1	145.9	0.005	12	0.013	1.02	11.4	1107.6	1	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1232	O1L14SBB1	M14BB1	3.3	M14A11	2	308.7	0.004	8	0.013	0.7	3.42	342.62	1	Vitrified Clay
1190	O1L14SM4	M14M4	4.3	M14M3	3	319.5	0.004	8	0.013	0.7	3.42	343.3	1	Vitrified Clay
1246	O1L14SZ1	M14Z1	4.2	M14A10	1.2	321.9	0.009	8	0.013	1.05	5.13	519.69	1	Vitrified Clay
1508	O2L18ASD1	M18A-D1	2.5	M18A-A6	1.2	315.6	0.004	8	0.01	0.91	4.41	447.27	1	PVC
4072	O2L2SJ2	M2J1	0.1	M2J2	1	78.1	0.012	4	0.013	0.74	0.9	91.672	1	Vitrified Clay
3428	O2L25SA1	M25A1	-1	W-25	-5.9	50.8	0.097	12	0.013	4.35	48.252	4982.7	1	
722	O2L3SL3	M3L3	1.7	M3L2	0.9	125.3	0.007	6	0.013	0.74	1.995	207.43	1	Vitrified Clay
764	O2L2SB2	M2B2	2	M2B1	1	179.7	0.006	6	0.013	0.67	1.8	187.85	1	Vitrified Clay
1360	O2L16SA8	M16A8	3.5	M16A7	2.8	165.8	0.005	8	0.01	0.96	4.5675	477.36	1	PVC
4004	O2L13SA2	M13A1	3.2	M13A2	4.5	310.7	0.004	8	0.013	0.7	3.3337	350.8	1	
4107	O2L1SKK1	M1BB1	2.4	M1KK1	3.5	48.2	0.023	4	0.013	1.03	1.2	129.03	0.9	Vitrified Clay
611	O2L2SO1	M2O1	2.4	M2A4	1.5	315.3	0.003	8	0.013	0.59	2.7	297.71	0.9	Vitrified Clay
782	O2L2SI1	M2I1	4	M2D4	3	162	0.006	4	0.013	0.53	0.6	67.101	0.9	Vitrified Clay
1148	O1L14SJ1	M14J1	-1.9	M14A4	-2.9	254.3	0.004	8	0.01	0.88	3.99	446.55	0.9	PVC
1362	O2L16SA9	M16A9	3.9	M16A8	3.5	76.3	0.005	8	0.01	1.01	4.5675	516.97	0.9	PVC
1218	O1L14SS5	M14S5	4.7	M14S4	3.7	280	0.004	8	0.013	0.63	2.85	324.1	0.9	Vitrified Clay
380	O2L3SG2	M3G2	1.7	M3G1	0.2	419.3	0.004	8	0.013	0.63	2.85	324.4	0.9	Vitrified Clay
4105	O2L1SBB2	M1BB1	2.4	M1BB2	3	127.3	0.005	6	0.013	0.6	1.5	172.91	0.9	Vitrified Clay
619	O2L3SE1	M3E1	2.4	M3D3	1.5	300.9	0.003	8	0.013	0.58	2.565	296.6	0.9	Vitrified Clay
4032	O2L3SB3	M3B2	2.8	M3B3	3.3	104.3	0.005	6	0.013	0.58	1.425	169.07	0.8	Vitrified Clay
1317	O1L17SQ5	M17Q5	5.3	M17Q4	4.1	301.2	0.004	8	0.013	0.66	2.85	340.88	0.8	Vitrified Clay
3684	O2L22SA4	M22A4	1.6	M22A5	2.2	112.5	0.005	8	0.013	0.74	3.15	386.07	0.8	
4112	O2L1SBB3	M1BB2	3	M1BB3	3.9	118.3	0.008	4	0.013	0.57	0.6	74.498	0.8	Vitrified Clay
614	O2L2SA6	M2A6	2.8	M2A5	1.9	296.5	0.003	8	0.013	0.57	2.4	298.8	0.8	Vitrified Clay
1774	O2L30SI1	M30I1	2	M30A4	1.4	69.2	0.009	4	0.013	0.6	0.63	79.509	0.8	Vitrified Clay
1754	O2L31SB4	M31B4	3.4	M31B3	1.7	470.5	0.004	12	0.013	0.83	7.7198	975.16	0.8	
355	O1L17SJ2	M17J2	4.8	M17J1	3.7	259	0.004	8	0.01	0.86	3.5625	451.05	0.8	PVC
812	O2L2SR2	M2R2	3.2	M2R1	1.8	334.5	0.004	8	0.013	0.67	2.7	355.61	0.8	Vitrified Clay
1035	O1L17SU1	M17U1	-2.3	M17T3	-2.8	61.2	0.009	12	0.013	1.25	11.4	1501.6	0.8	
4160	O2L1SU1	M1S1	1.8	M1U1	2.6	83.5	0.01	6	0.013	0.81	1.8	246.46	0.7	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
909	O2L5SB1	M5B1	3	M5A3	-2.4	287.8	0.019	6	0.013	1.14	2.52	345.61	0.7	Vitrified Clay
1770	O2L30SA6	M30A6	2.7	M30A5	2.2	104.2	0.005	6	0.013	0.57	1.26	174.43	0.7	Vitrified Clay
3903	O2L5SC1	M5A1	-2.9	M5C1	2	250.8	0.02	6	0.013	1.15	2.52	352.74	0.7	Vitrified Clay
1158	O1L14SL1	M14L1	0.1	M14A5	-2.4	327.2	0.007	8	0.01	1.11	4.275	607.64	0.7	PVC
1142	O1L14SI1	M14I1	-0.8	M14A4	-2	306.5	0.004	8	0.01	0.82	3.135	446.62	0.7	PVC
4208	O2L30SA6	M30A7	2.8	M30A6	2.7	29.1	0.005	6	0.013	0.59	1.26	180.73	0.7	Vitrified Clay
4234	O2L7SC4	M7C3	0.7	M7C4	3	468.5	0.005	6	0.013	0.57	1.2	176.44	0.7	Vitrified Clay
1366	O2L16SG1	M16G1	2.5	M16A6	1.1	320.9	0.004	12	0.013	0.84	7.0875	1048.7	0.7	
4034	O2L3SB4	M3B3	3.3	M3B4	3.6	62.9	0.005	6	0.013	0.55	1.14	171.05	0.7	Vitrified Clay
4229	O2L25SJ1	M25B2	0.9	M25J1	3	400.1	0.005	6	0.013	0.58	1.2	181.15	0.7	Vitrified Clay
766	O2L2SB1	M2B1	1	M2A2	-1.3	308.4	0.007	8	0.013	0.83	3	467.41	0.6	Vitrified Clay
1077	O1L17SG1	M17H3	4.5	M17H2	3	366.1	0.004	8	0.01	0.79	2.85	445.26	0.6	PVC
1771	O2L30SK1	M30K1	3.1	M30A5	2.2	70.4	0.014	4	0.013	0.71	0.63	99.254	0.6	Vitrified Clay
1772	O2L30SJ1	M30J1	3.5	M30A5	2.2	99	0.014	4	0.013	0.71	0.63	99.722	0.6	Vitrified Clay
3172	O2L30SC1	M30C1	-0.5	M30A1	-0.9	29.6	0.014	6	0.013	0.95	1.89	300.19	0.6	Vitrified Clay
1204	O1L14SX1	M14X1	2	M14S1	1	246.8	0.004	8	0.013	0.61	2.1375	341.77	0.6	Vitrified Clay
1737	O2L16SH1	M16H1	-1.9	M16B1	-2	32.1	0.004	12	0.013	0.8	6.3	1017.5	0.6	
4214	O2L25SD1	M25C1	0.6	M25D1	2.3	116.5	0.014	4	0.013	0.72	0.63	102.26	0.6	Vitrified Clay
831	O2L1SI1	M1H1	2.9	M1H2	3.3	61.4	0.007	8	0.013	0.78	2.7	444.36	0.6	Vitrified Clay
771	O2L2SL1	M2L1	0.6	M2J1	0.1	86	0.006	6	0.013	0.62	1.2	197.66	0.6	Vitrified Clay
1236	O1L14SAA2	M14AA1	3.9	M14A10	1.2	248.8	0.011	8	0.013	1	3.42	568.69	0.6	Vitrified Clay
617	O2L3SD4	M3D5	4	M3D4	2	318.4	0.006	8	0.013	0.75	2.565	426.62	0.6	Vitrified Clay
955	O2L4SD1	M4D1	3.5	M4A4	1.2	332.6	0.007	6	0.013	0.65	1.26	210.31	0.6	Vitrified Clay
4198	O2L34SA15	M34A15	3.3	M34A14	2.3	255.6	0.004	8	0.01	0.77	2.625	445.41	0.6	PVC
1423	O2L34SE2	M34E2	1.5	M34E1	-0.9	213.2	0.011	6	0.01	1.08	2.0417	349.5	0.6	PVC
4238	O2L7SM1	M7C2	-0.1	M7M1	3	463.4	0.007	6	0.013	0.63	1.2	205.96	0.6	Vitrified Clay
904	O2L23SA2	M17A2	2.1	M17A1	0.3	327.5	0.006	8	0.013	0.7	2.3333	404.28	0.6	
1150	O1L14SJ2	M14J2	-0.7	M14J1	-1.9	303.7	0.004	8	0.01	0.77	2.565	445.06	0.6	PVC
1368	O2L16SG2	M16G2	3.4	M16G1	2.5	220.8	0.004	8	0.013	0.62	2.0475	361.35	0.6	
4287	O1L14SC7	M14C6	0.5	M14E1	4.8	106.4	0.041	6	0.013	1.55	2.85	508.53	0.6	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
972	O2L34SF2	M34F4	3.4	M34F3	2.7	291.5	0.002	12	0.013	0.59	4.286	772.29	0.6	
4388	O2L32SB1	M32B1	2	W-32	0	46.8	0.043	12	0.013	2.5	17.974	3305.6	0.5	
1335	O1L40SB2	M40A1	1.2	M40B2	1.9	188.5	0.004	8	0.01	0.77	2.45	453.49	0.5	PVC
1775	O2L30SH1	M30H1	3.1	M30A4	1.4	86.1	0.02	4	0.013	0.81	0.63	120.01	0.5	Vitrified Clay
3166	O2L30SA11	M30A11	4.4	M30A10	4	70.5	0.005	4	0.013	0.4	0.315	60.183	0.5	Vitrified Clay
1220	O1L14ST1	M14T1	3.1	M14S2	2.1	276.9	0.004	8	0.013	0.56	1.71	332.36	0.5	Vitrified Clay
4149	O2L1SU2	M1U1	2.6	M1U2	3.6	52.8	0.019	4	0.013	0.78	0.6	117.52	0.5	Vitrified Clay
1734	O2L16SF1	M16F1	3	M16B2	-1.7	436	0.011	8	0.013	0.93	2.8583	560.08	0.5	
4175	O2L1SK1	M1E2	0.7	M1K1	2	66.3	0.02	6	0.013	1.05	1.8	353.44	0.5	Vitrified Clay
790	O2L2SE1	M2E1	2	M2D1	-1.7	414.5	0.009	6	0.013	0.7	1.2	238.36	0.5	Vitrified Clay
753	O2L3SA8	M3A8	4.3	M3A7	3.5	166.7	0.005	6	0.013	0.5	0.855	170.04	0.5	Vitrified Clay
1234	O1L14SBB2	M14BB2	4.2	M14BB1	3.3	246.9	0.004	8	0.013	0.57	1.71	342.35	0.5	Vitrified Clay
1176	O1L14SN1	M14N1	0.9	M14M1	-0.4	327.3	0.004	8	0.013	0.57	1.71	342.87	0.5	Vitrified Clay
4207	O2L30SA8	M30A8	3.1	M30A7	2.8	52.5	0.006	6	0.013	0.56	0.945	190.42	0.5	Vitrified Clay
1733	O2L16SE1	M16E1	3	M16B1	-2	435.3	0.012	8	0.013	0.96	2.8583	581.84	0.5	
762	O2L2SB2	M2B3	3	M2B2	2	176.5	0.006	6	0.013	0.55	0.9	189.57	0.5	Vitrified Clay
228	O1L17SJ3	M17J3	5.2	M17J2	4.8	51.5	0.009	6	0.01	0.87	1.425	302.67	0.5	PVC
385	O2L23SA1	M17A1	0.3	W-23	-6.4	11	0.608	12	0.013	8.78	58.625	12469	0.5	
4044	O2L2SG1	M2F2	2.1	M2G1	2.8	135	0.006	4	0.013	0.41	0.3	64.717	0.5	Vitrified Clay
4220	O2L25SF1	M25A1	-1	M25F1	2	115.2	0.026	4	0.013	0.9	0.63	137.14	0.5	Vitrified Clay
4091	O2L1SQ1	M1A3	-0.1	M1Q1	2	86.1	0.024	6	0.013	1.12	1.8	392.33	0.5	Vitrified Clay
4224	O2L25SI1	M25B1	0.3	M25I1	3	105.6	0.026	4	0.013	0.9	0.63	137.33	0.5	Vitrified Clay
3106	O2L34SO1	M34O1	2.9	M34A9	0.1	177.4	0.016	6	0.01	1.17	1.89	412.04	0.5	PVC
802	O2L2SF3	M2F3	2.6	M2F2	2.1	89.5	0.006	4	0.013	0.43	0.3	66.799	0.4	Vitrified Clay
3599	O1L37SE1	M37C1	-2.6	M37E1	-1.6	235	0.004	8	0.01	0.75	2.0883	471.24	0.4	PVC
3598	O1L37SB1	M37A2	-2.8	M37B1	-1.7	233.9	0.005	8	0.01	0.77	2.0883	476.91	0.4	PVC
4118	O2L1SCC2	M1CC1	3.5	M1CC2	4	77.5	0.006	4	0.013	0.43	0.3	68.59	0.4	Vitrified Clay
825	O2L1SB5	M1B4	3.5	M1B5	4.5	152.8	0.007	4	0.013	0.43	0.3	69.091	0.4	Vitrified Clay
850	O2L1SOO1	M1JJ1	1.7	M1OO1	4.5	402.4	0.007	6	0.013	0.6	0.9	210.2	0.4	Vitrified Clay
1498	O2L18ASB1	M18A-B1	0.9	M18A-A3	-0.3	279.5	0.004	8	0.01	0.71	1.89	446.28	0.4	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1768	O2L30SA9	M30A9	3.8	M30A8	3.1	198.2	0.004	6	0.013	0.42	0.63	149.65	0.4	Vitrified Clay
1240	O1L14SA12	M14A12	3.5	M14A11	2	375.3	0.004	8	0.013	0.54	1.425	342.87	0.4	Vitrified Clay
1162	O1L14SK1	M14K1	0.6	M14A5	-2.4	260.8	0.012	8	0.01	1.18	3.135	757.49	0.4	PVC
4169	O2L1SM1	M1E1	-0.3	M1M1	2	75.2	0.03	4	0.013	0.9	0.6	147.72	0.4	Vitrified Clay
3520	O2L35SC1	M35A1	-1.3	M35C1	0	95.3	0.014	8	0.01	1.28	3.3168	823.44	0.4	PVC
3156	O2L30SL1	M30A7	2.8	M30L1	3.8	118.5	0.008	4	0.013	0.47	0.315	78.474	0.4	Vitrified Clay
4109	O2L1SKK2	M1KK1	3.5	M1KK2	4.5	130.6	0.008	4	0.013	0.45	0.3	74.737	0.4	Vitrified Clay
1192	O1L14SR1	M14R1	4.4	M14M4	4.3	130.4	0.001	6	0.013	0.2	0.285	73.133	0.4	Vitrified Clay
4100	O2L1SII1	M1HH1	3.5	M1II1	5	181.6	0.008	4	0.013	0.48	0.3	77.63	0.4	Vitrified Clay
1144	O1L14SI2	M14I2	0.5	M14I1	-0.8	310.4	0.004	8	0.01	0.69	1.71	447.43	0.4	PVC
4114	O2L1SBB4	M1BB3	3.9	M1BB4	5.1	138.4	0.009	4	0.013	0.49	0.3	79.521	0.4	Vitrified Clay
4185	O2L7SB2	M1D3	3	M1D4	4	114.4	0.009	4	0.013	0.49	0.3	79.857	0.4	Vitrified Clay
4197	O2L34SA16	M34A16	4.9	M34A15	3.3	402.3	0.004	4	0.01	0.43	0.2625	70.459	0.4	PVC
4247	O2L7SJ1	M7C1	-0.9	M7J1	4	296.3	0.017	6	0.013	0.87	1.2	323.84	0.4	Vitrified Clay
4068	O2L2SP3	M2P2	0.5	M2P3	3	262.3	0.009	4	0.013	0.5	0.3	82.722	0.4	Vitrified Clay
4102	O2L1SHH2	M1HH1	3.5	M1HH2	5.2	180.7	0.009	4	0.013	0.5	0.3	82.851	0.4	Vitrified Clay
4059	O2L2ST2	M2T1	2.3	M2T2	4.2	196	0.01	4	0.013	0.5	0.3	83.315	0.4	Vitrified Clay
3153	O2L34ST1	M34T1	3.5	M34A14	2.3	287.1	0.004	4	0.01	0.44	0.2625	73.273	0.4	PVC
4200	O2L29SA4	M29A3	0.2	M29A4	1.1	166	0.006	8	0.01	0.8	1.89	527.72	0.4	PVC
4078	O2L2SB2	M2B3	3	M2B4	4	102.3	0.01	4	0.013	0.51	0.3	84.454	0.4	Vitrified Clay
4061	O2L2SU1	M2T1	2.3	M2U1	3.5	125.5	0.01	4	0.013	0.51	0.3	84.562	0.4	Vitrified Clay
4054	O2L2SS1	M2R3	3.7	M2S1	4.7	101.9	0.01	4	0.013	0.51	0.3	85.33	0.4	Vitrified Clay
4036	O2L3SB5	M3B4	3.6	M3B5	4.4	85.4	0.009	4	0.013	0.49	0.285	81.087	0.4	Vitrified Clay
751	O2L3SA9	M3A9	5.2	M3A8	4.3	99.2	0.009	4	0.013	0.49	0.285	81.353	0.4	Vitrified Clay
4157	O2L1SW1	M1V1	3	M1W1	4	98.6	0.01	4	0.013	0.52	0.3	86.013	0.3	Vitrified Clay
3108	O2L34SO2	M34O2	3.3	M34O1	2.9	118.2	0.003	6	0.01	0.49	0.63	183.2	0.3	PVC
591	O2L7SG2	M7G2	5.6	M7G1	3.9	342.6	0.005	6	0.013	0.47	0.6	177.4	0.3	
223	O1L17SK1	M17K1	5.6	M17J2	4.8	50.6	0.017	6	0.01	1.12	1.425	421.99	0.3	PVC
566	O2L7SD5	M7D5	6.1	M7D4	4.4	340.5	0.005	6	0.013	0.47	0.6	177.93	0.3	
594	O2L7SF2	M7F2	5.8	M7F1	4.1	338.4	0.005	6	0.013	0.47	0.6	178.48	0.3	

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4420	O2L30SD1	M30A2	-0.2	M30D1	2	201.5	0.011	8	0.013	0.84	1.89	565.04	0.3	Vitrified Clay
1541	O2L34SB5	M34B5	4.3	M34B4	3.5	176.1	0.005	8	0.01	0.7	1.5799	475.18	0.3	PVC
713	O2L3SH5	M3H4	2.5	M3H5	4	149.7	0.01	4	0.013	0.51	0.285	85.772	0.3	Vitrified Clay
3164	O2L30SA10	M30A10	4	M30A9	3.8	35.3	0.006	6	0.013	0.5	0.63	189.65	0.3	Vitrified Clay
815	O2L1SG1	M1G1	4	M1F1	2.5	130.2	0.011	4	0.013	0.54	0.3	91.187	0.3	Vitrified Clay
1557	O1L17SF4	M17F4	5.2	M17F3	4	350.6	0.003	8	0.013	0.47	1.0417	317.28	0.3	Vitrified Clay
3427	O2L24SA1	M24A1	-1.6	W-24	-3.9	70.8	0.033	12	0.013	1.55	9.45	2895	0.3	
4120	O2L1SDD1	M1CC1	3.5	M1DD1	4	42.2	0.012	4	0.013	0.55	0.3	93.003	0.3	Vitrified Clay
1152	O1L14SJ3	M14J3	0.3	M14J2	-0.7	247	0.004	8	0.01	0.64	1.425	446.35	0.3	PVC
1188	O1L14SQ1	M14Q1	4.3	M14M3	3	115	0.011	6	0.013	0.7	0.855	268.8	0.3	Vitrified Clay
4093	O2L1SQ2	M1Q1	2	M1Q2	3.5	122	0.012	4	0.013	0.56	0.3	94.728	0.3	Vitrified Clay
4205	O2L29SB3	M29B3	2	M29B2	0	401.7	0.005	8	0.01	0.71	1.575	497.47	0.3	PVC
3138	O2L34SM1	M34M1	2.8	M34L2	2.3	85.6	0.006	6	0.01	0.64	0.7875	256.41	0.3	PVC
1422	O2L34SE1	M34A6	-1.9	M34E1	-0.9	335.6	0.003	10	0.01	0.62	2.0417	687.31	0.3	PVC
1279	O2L22SB2	M22B2	2.5	M22B1	1.2	179.2	0.007	6	0.013	0.53	0.63	213.64	0.3	
1277	O2L22SB1	M22B1	1.2	M22A2	-0.8	70.3	0.028	8	0.01	1.66	3.465	1177.4	0.3	PVC
3094	O2L29SA1	M29A1	-1.6	W-29	-5.9	16.2	0.267	12	0.013	4.7	24.255	8266.1	0.3	
575	O2L7SH1	M7H1	4.7	M7D2	1.8	426.1	0.007	6	0.013	0.51	0.6	207.04	0.3	Vitrified Clay
4453	O2L38SA7	M38A6	-1.1	M38A7	-0.5	81.2	0.007	8	0.01	0.84	1.715	596	0.3	PVC
4151	O2L1SU3	M1U2	3.6	M1U3	4.5	58.4	0.015	4	0.013	0.58	0.3	105.99	0.3	Vitrified Clay
4212	O2L25SC2	M25C1	0.6	M25C2	2.3	212.1	0.008	6	0.013	0.55	0.63	223.47	0.3	Vitrified Clay
1041	O1L17SV2	M17V2	2.8	M17V1	1.8	228.9	0.004	12	0.013	0.63	2.85	1013.8	0.3	
1738	O2L16SB4	M16B4	5	M16B3	-1.5	334.2	0.019	12	0.013	1.37	6.2417	2221.4	0.3	
4095	O2L1SR1	M1Q1	2	M1R1	4	122.7	0.016	4	0.013	0.59	0.3	109.04	0.3	Vitrified Clay
715	O2L3SI1	M3I1	4	M3H3	1.8	143.3	0.015	4	0.013	0.57	0.285	106.05	0.3	Vitrified Clay
4006	O2L10SA2	M10A1	5.5	M10A2	6	103.8	0.005	6	0.013	0.43	0.46667	174.81	0.3	
4124	O2L1SEE2	M1EE1	2.9	M1EE2	4	62.7	0.018	4	0.013	0.61	0.3	113.11	0.3	Vitrified Clay
982	O2L34SH3	M34H2	0.9	M34H3	2.5	261.6	0.006	6	0.013	0.48	0.525	199.95	0.3	Vitrified Clay
4179	O2L1SK2	M1K1	2	M1K2	4.5	137.6	0.018	4	0.013	0.62	0.3	115.13	0.3	Vitrified Clay
574	O2L7SI2	M7I2	4.6	M7D1	1	430	0.008	6	0.013	0.56	0.6	231.06	0.3	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4177	O2L1SL1	M1K1	2	M1L1	4.5	131	0.019	4	0.013	0.63	0.3	118.02	0.3	Vitrified Clay
4267	O1L37SA4	M37A4	-0.4	M37A5	3	204.8	0.017	6	0.01	1.01	1.0442	423.66	0.2	PVC
4216	O2L25SE1	M25A2	-0.4	M25E1	3	293.9	0.012	6	0.013	0.63	0.63	270.86	0.2	Vitrified Clay
3986	O1L37SC3	M37C2	-1.4	M37C3	-0.4	241.4	0.004	8	0.01	0.59	1.0442	451.48	0.2	PVC
1289	O2L26SA2	M26A1	0.8	M26A2	2.7	261.3	0.007	6	0.01	0.64	0.63	278.43	0.2	PVC
1242	O1L14SA13	M14A13	5	M14A12	3.5	145.1	0.01	6	0.013	0.59	0.57	256.01	0.2	Vitrified Clay
4195	O2L34SS1	M34A13	2.1	M34S1	3.8	85.5	0.02	4	0.013	0.62	0.2625	120.45	0.2	
3146	O2L34SL4	M34L4	3.9	M34L3	2.9	193.5	0.006	6	0.01	0.55	0.525	242.9	0.2	PVC
744	O2L3S132	M3C2	2	M3A4	1.4	213.7	0.003	6	0.013	0.3	0.285	134.54	0.2	Vitrified Clay
984	O2L34SI1	M34I1	1.5	M34H1	-0.2	169.9	0.01	6	0.013	0.58	0.525	253.69	0.2	Vitrified Clay
777	O2L2SL2	M2L2	3	M2L1	0.6	78.1	0.03	4	0.013	0.76	0.3	148.79	0.2	
4415	O2L30SG1	M30A3	0.6	M30G1	2	193.9	0.007	8	0.013	0.6	0.945	468.97	0.2	Vitrified Clay
773	O2L2SM1	M2M1	3	M2L1	0.6	77	0.031	4	0.013	0.76	0.3	149.83	0.2	Vitrified Clay
717	O2L3SK1	M3H3	1.8	M3K1	-5.1	102.4	-0.067	6	0.013	0.01	1.285	652.28	0.2	Vitrified Clay
907	O2L5SB2	M5B2	4	M5B1	3	247.1	0.004	6	0.013	0.36	0.315	160.2	0.2	Vitrified Clay
936	O2L5SA9	M5A9	4.5	M5A8	3.1	319	0.005	6	0.013	0.38	0.315	169.18	0.2	Vitrified Clay
938	O2L5SD6	M5D6	4.6	M5D5	3.4	274.1	0.005	6	0.013	0.38	0.315	169.39	0.2	Vitrified Clay
969	O2L4SA6	M4A6	4	M4A5	1.8	491.3	0.005	6	0.013	0.38	0.315	169.66	0.2	Vitrified Clay
949	O2L4SB2	M4B2	4.3	M4B1	2.5	390	0.005	6	0.013	0.38	0.315	171.56	0.2	Vitrified Clay
3403	O2L18ASA5	M18A5	0.3	M18A4	-0.9	301.5	0.004	8	0.013	0	0.63	343.58	0.2	Vitrified Clay
941	O2L4SH2	M4H2	4	M4H1	2.5	316.8	0.005	6	0.013	0.38	0.315	173.3	0.2	Vitrified Clay
3171	O2L30SC2	M30C2	1.3	M30C1	-0.5	360.4	0.005	6	0.013	0.39	0.315	177.98	0.2	Vitrified Clay
4138	O2L1SAA1	M1A6	1.4	M1AA1	4	65	0.04	4	0.013	0.84	0.3	169.78	0.2	Vitrified Clay
4126	O2L1SEE3	M1EE1	2.9	M1EE3	4	27.8	0.04	4	0.013	0.84	0.3	169.96	0.2	Vitrified Clay
3185	O2L30SM1	M30M1	4	M30B6	2.7	258.1	0.005	6	0.013	0.39	0.315	178.71	0.2	Vitrified Clay
1216	O1L14SW1	M14W1	4.2	M14S4	3.7	118.6	0.004	6	0.013	0.36	0.285	161.86	0.2	Vitrified Clay
4040	O2L2SD5	M2D4	3	M2D5	4.5	322.1	0.005	6	0.013	0.36	0.3	171.84	0.2	Vitrified Clay
3912	O2L7SA7	M7A6	4.9	M7A7	6.1	243.7	0.005	6	0.013	0.37	0.3	176.7	0.2	
1224	O1L14ST2	M14T2	3.4	M14T1	3.1	76.5	0.004	6	0.013	0.35	0.285	167.92	0.2	Vitrified Clay
1364	O2L30SA10	M16A10	5.1	M16A9	3.9	259.9	0.004	8	0.01	0.55	0.7875	466.92	0.2	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
573	O2L7SB2	M7B2	4.9	M7B1	3.6	269.8	0.005	6	0.013	0.37	0.3	178.14	0.2	Vitrified Clay
1222	O1L14SU1	M14U1	3.5	M14T1	3.1	85	0.005	6	0.013	0.35	0.285	170.58	0.2	Vitrified Clay
838	O2L1SJJ4	M1JJ4	4.5	M1JJ3	2.7	353.7	0.005	6	0.013	0.37	0.3	181.13	0.2	Vitrified Clay
1206	O1L14SX2	M14X2	3.3	M14X1	2	203.2	0.006	8	0.013	0.51	0.7125	432.09	0.2	Vitrified Clay
1248	O1L14SZ2	M14Z2	5.5	M14Z1	4.2	324.6	0.004	8	0.013	0.41	0.57	345.84	0.2	Vitrified Clay
1212	O1L14SV1	M14V1	3.9	M14S3	2.9	244	0.004	8	0.013	0.41	0.57	350.68	0.2	Vitrified Clay
808	O2L2SC4	M2C4	2.3	M2C3	0.9	265.7	0.005	6	0.013	0.38	0.3	184.63	0.2	Vitrified Clay
4070	O2L2SQ1	M2P2	0.5	M2Q1	1.9	253.9	0.005	6	0.013	0.38	0.3	185.02	0.2	Vitrified Clay
1238	O1L14SAA2	M14AA2	4.8	M14AA1	3.9	190	0.004	8	0.013	0.42	0.57	356.31	0.2	Vitrified Clay
4052	O2L2SR4	M2R3	3.7	M2R4	4.7	172.7	0.006	6	0.013	0.39	0.3	188.12	0.2	Vitrified Clay
4232	O2L25SB3	M25B2	0.9	M25B3	5	164.1	0.025	6	0.013	0.81	0.63	396.55	0.2	Vitrified Clay
1244	O1L14SBB3	M14BB3	5.2	M14BB2	4.2	191.8	0.005	6	0.013	0.37	0.285	180.39	0.2	Vitrified Clay
833	O2L1SI1	M1H2	3.3	M1I1	4.5	208.8	0.006	6	0.013	0.39	0.3	190.11	0.2	Vitrified Clay
779	O2L2SN1	M2N1	0.9	M2J1	0.1	139.6	0.006	6	0.013	0.39	0.3	190.42	0.2	Vitrified Clay
4145	O2L1SX1	M1A5	1.1	M1X1	4	57.3	0.05	4	0.013	0.92	0.3	190.78	0.2	Vitrified Clay
4184	O2L7SB2	M1D2	0.9	M1D3	3	413.4	0.005	8	0.013	0.45	0.6	383.21	0.2	Vitrified Clay
4455	O2L38SA8	M38A7	-0.5	M38A8	7	308.6	0.024	8	0.01	1.28	1.715	1099.1	0.2	PVC
994	O2L34SK2	M34K2	3	M34K1	1.1	410	0.005	6	0.013	0.35	0.2625	171.43	0.2	Vitrified Clay
844	O2L1SNN1	M1JJ2	2.1	M1NN1	4.5	391.2	0.006	6	0.013	0.4	0.3	196.01	0.2	Vitrified Clay
3183	O2L30SB7	M30B7	3.6	M30B6	2.7	220.4	0.004	6	0.01	0.42	0.315	209.19	0.2	PVC
916	O2L5SC2	M5C2	4	M5C1	2	273	0.007	6	0.013	0.43	0.315	215.53	0.1	Vitrified Clay
1504	O2L18ASC1	M18A-C1	2.3	M18A-A5	0.7	412.6	0.004	8	0.01	0.5	0.63	437.67	0.1	PVC
3123	O2L29SF1	M29F1	2.5	M29B1	-1	194.8	0.018	6	0.01	0.88	0.63	438.83	0.1	PVC
3425	O2L1SC1	M1C1	2	M1A1	-1	105.1	0.029	12	0.013	1.37	3.9	2718.9	0.1	
3408	O2L18SE3	M18E3	1.3	M18E2	-0.6	488.8	0.004	8	0.01	0.51	0.63	446.46	0.1	PVC
840	O2L1SKK1	M1JJ3	2.7	M1KK1	4.5	252.5	0.007	6	0.013	0.43	0.3	214.39	0.1	Vitrified Clay
957	O2L4SE1	M4E1	4	M4D1	3.5	61	0.008	6	0.013	0.45	0.315	227.98	0.1	Vitrified Clay
4155	O2L1SV2	M1V1	3	M1V2	4	15.4	0.065	4	0.013	0.95	0.3	217.54	0.1	Vitrified Clay
4038	O2L3SC1	M3B1	1.9	M3C1	4	35.5	0.061	4	0.013	0.91	0.285	210.32	0.1	Vitrified Clay
4255	O2L24SH1	M24A1	-1.6	M24H1	3	134.3	0.034	6	0.013	0.92	0.63	465.08	0.1	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4076	O2L2SK1	M2J2	1	M2K1	3	29.5	0.068	4	0.013	0.97	0.3	222.58	0.1	Vitrified Clay
792	O2L2SE2	M2E2	3	M2E1	2	126.6	0.008	6	0.013	0.44	0.3	223.85	0.1	Vitrified Clay
4083	O2L1SO1	M1A2	-0.8	M1O1	2	87.4	0.032	6	0.013	0.89	0.6	448.54	0.1	Vitrified Clay
4249	O2L24SD2	M24D1	-0.9	M24D2	3.7	130.1	0.035	6	0.013	0.94	0.63	473.45	0.1	Vitrified Clay
4074	O2L2SJ3	M2J2	1	M2J3	4	41.9	0.072	4	0.013	0.99	0.3	228.61	0.1	Vitrified Clay
1736	O2L16SH2	M16H2	4.2	M16H1	-1.9	332.4	0.018	12	0.013	1.06	2.8292	2162.4	0.1	
4085	O2L1SP1	M1O1	2	M1P1	4	27.7	0.072	4	0.013	0.99	0.3	229.54	0.1	Vitrified Clay
829	O2L1SI1	M1H1	2.9	M1J1	4.5	192.6	0.008	6	0.013	0.45	0.3	229.64	0.1	Vitrified Clay
962	O2L4SA6	M4F1	4	M4A5	1.8	243	0.009	6	0.013	0.48	0.315	242.34	0.1	Vitrified Clay
4189	O2L34SR1	M34A13	2.1	M34R1	3	16	0.056	4	0.013	0.87	0.2625	202.47	0.1	Vitrified Clay
4222	O2L25SG1	M25A1	-1	M25G1	8	237.8	0.038	6	0.013	0.96	0.63	489.09	0.1	Vitrified Clay
1160	O1L14SL2	M14L2	1.5	M14L1	0.1	355.4	0.004	8	0.01	0.49	0.57	445.64	0.1	PVC
1164	O1L14SK2	M14K2	1.6	M14K1	0.6	234.1	0.004	8	0.01	0.49	0.57	446.74	0.1	PVC
4147	O2L1SY1	M1A5	1.1	M1Y1	0	14.6	-0.078	4	0.013	0.01	0.3	238.72	0.1	Vitrified Clay
852	O2L1SOO2	M1OO1	4.5	M1OO2	5	55	0.009	6	0.013	0.47	0.3	240.13	0.1	Vitrified Clay
4171	O2L1SN3	M1M1	2	M1N3	4	24.9	0.08	4	0.013	1.04	0.3	241.96	0.1	Vitrified Clay
846	O2L1SLL1	M1JJ2	2.1	M1LL1	4.5	256.3	0.009	6	0.013	0.47	0.3	242.15	0.1	Vitrified Clay
4131	O2L1SFF1	M1A8	1.9	M1FF1	4	25.8	0.082	4	0.013	1.04	0.3	243.89	0.1	Vitrified Clay
4227	O2L25SH1	M25B1	0.3	M25H1	7	157.1	0.043	6	0.013	1	0.63	521.19	0.1	Vitrified Clay
4089	O2L1SO2	M1O1	2	M1O2	4	23.4	0.085	4	0.013	1.06	0.3	249.44	0.1	Vitrified Clay
4026	O2L4SC1	M4A3	0.7	M4C1	4	283.9	0.012	6	0.013	0.52	0.315	271.11	0.1	Vitrified Clay
1184	O1L14SP1	M14P1	3.8	M14M2	2.2	199.4	0.008	8	0.013	0.53	0.57	493.37	0.1	Vitrified Clay
1281	O2L22SE1	M22E1	2.6	M22B1	1.2	208.3	0.007	6	0.01	0.52	0.315	274.09	0.1	PVC
4173	O2L1SM2	M1M1	2	M1M2	4	21.1	0.095	4	0.013	1.11	0.3	262.71	0.1	Vitrified Clay
720	O2L3SL4	M3L4	4	M3L3	1.7	232.3	0.01	6	0.013	0.47	0.285	250.57	0.1	Vitrified Clay
4187	O2L1SH4	M1H3	3.6	M1H4	4.5	71.6	0.012	6	0.013	0.52	0.3	276.09	0.1	Vitrified Clay
959	O2L4SD2	M4D2	4	M4D1	3.5	37	0.014	6	0.013	0.55	0.315	292.76	0.1	Vitrified Clay
1180	O1L14SO1	M14O1	2.5	M14N1	0.9	135	0.012	6	0.013	0.51	0.285	275.52	0.1	Vitrified Clay
3134	O2L29SC2	M29C2	3	M29C1	2	129.4	0.008	8	0.01	0.64	0.63	619.81	0.1	PVC
615	O2L2SA7	M2A7	3.7	M2A6	2.8	300.7	0.003	8	0.013	0.31	0.3	296.71	0.1	Vitrified Clay

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
612	O2L2SO2	M2O2	3.4	M2O1	2.4	316.4	0.003	8	0.013	0.31	0.3	297.16	0.1	Vitrified Clay
4245	O2L7SK1	M7C1	-0.9	M7K1	3	264.7	0.015	6	0.013	0.56	0.3	305.68	0.1	Vitrified Clay
620	O2L3SE2	M3E2	3.3	M3E1	2.4	300.9	0.003	8	0.013	0.3	0.285	296.62	0.1	Vitrified Clay
616	O2L3SD6	M3D6	3.9	M3D5	2.9	314.4	0.003	8	0.013	0.3	0.285	298.11	0.1	Vitrified Clay
996	O2L34SJ2	M34J2	2.5	M34J1	0.1	194.9	0.012	6	0.013	0.5	0.2625	280.02	0.1	Vitrified Clay
3952	O2L29SD1	M29A3	0.2	M29D1	4	421.4	0.009	8	0.01	0.68	0.63	672.56	0.1	PVC
4133	O2L1SGG1	M1A8	1.9	M1GG1	4	14.5	0.144	4	0.013	1.31	0.3	324.64	0.1	Vitrified Clay
724	O2L3SM1	M3L2	0.9	M3M1	4.5	238.9	0.015	6	0.013	0.56	0.285	311.28	0.1	Vitrified Clay
3421	O2L18SG1	M18G1	-0.6	M18A3	-1.6	235.8	0.004	8	0.013	0	0.315	344.22	0.1	Vitrified Clay
3416	O2L18SF1	M18F1	-1.5	M18A2	-2.5	237.8	0.004	8	0.013	0	0.315	344.59	0.1	Vitrified Clay
4315	O2L18A	M18C2	3	M18D1	3.2	41.8	0.004	12	0.013	0.45	0.945	1048.7	0.1	
382	O2L3SG3	M3G3	3.1	M3G2	1.7	393.5	0.004	8	0.013	0.32	0.285	323.48	0.1	Vitrified Clay
817	O2L1SF2	M1F1	2.5	M1F2	4	371.7	0.004	8	0.013	0.34	0.3	342.68	0.1	Vitrified Clay
4257	O2L24SA3	M24A2	-1	M24A3	2	142.3	0.021	6	0.013	0.64	0.315	366.3	0.1	Vitrified Clay
730	O2L3SO1	M3O1	5	M3L1	0.4	255.7	0.018	6	0.013	0.59	0.285	337.04	0.1	Vitrified Clay
1194	O1L14SM5	M14M5	5.7	M14M4	4.3	345	0.004	8	0.013	0.34	0.285	343.01	0.1	Vitrified Clay
3119	O2L29SE1	M29E1	4	M29A2	-0.7	403.4	0.012	8	0.01	0.75	0.63	759.38	0.1	PVC
4253	O2L24SG1	M24A1	-1.6	M24G1	4	59.2	0.094	6	0.013	1.34	0.63	772.83	0.1	Vitrified Clay
4140	O2L1SZ1	M1A6	1.4	M1Z1	4	13.6	0.188	4	0.013	1.45	0.3	370.46	0.1	Vitrified Clay
1178	O1L14SN2	M14N2	2.5	M14N1	0.9	79	0.02	6	0.013	0.62	0.285	360.12	0.1	Vitrified Clay
4191	O2L34SP1	M34A12	1.7	M34P1	4	14.4	0.162	4	0.013	1.32	0.2625	343.6	0.1	Vitrified Clay
4251	O2L24SA1	M24D1	-0.9	M24E1	5.4	58.1	0.108	6	0.013	1.42	0.63	829.33	0.1	Vitrified Clay
3142	O2L34SM2	M34N1	3.5	M34M1	2.8	55.5	0.012	6	0.01	0.61	0.2625	358.36	0.1	PVC
4204	O2L29SB4	M29B4	2.5	M29B3	2	127.8	0.004	8	0.01	0.4	0.315	440.96	0.1	PVC
4210	O2L25SA7	M25A6	1.9	M25A7	3.5	403.5	0.004	8	0.01	0.4	0.315	443.97	0.1	PVC
3398	O2L25SK1	M25K1	2.4	M25A4	1	345.5	0.004	8	0.01	0.41	0.315	445.62	0.1	PVC
727	O2L3SN1	M3N1	-6.1	M3L1	0.4	241.6	-0.027	6	0.013	0	0.285	413.39	0.1	Vitrified Clay
4236	O2L7SC4	M7C3	0.7	M7N1	4	105.9	0.031	6	0.013	0.73	0.3	444.49	0.1	Vitrified Clay
4263	O2L7SB1	M7A1	-5.5	M7B1	3.6	238.5	0.038	12	0.013	1.25	2.1	3118.3	0.1	
3140	O2L34SM2	M34M2	3.8	M34M1	2.8	56.2	0.017	6	0.01	0.68	0.2625	429.13	0.1	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1154	O1L14SJ	M14J4	1.4	M14J3	0.3	245	0.004	8	0.01	0.41	0.285	468.11	0.1	PVC
1146	O1L14SI3	M14I3	1.5	M14I2	0.5	226.4	0.004	8	0.01	0.41	0.285	470.9	0.1	PVC
4116	O2L1SCC1	M1BB2	3	M1CC1	3.5	46.8	0.011	12	0.013	0.63	0.9	1652.3	0.1	
4243	O2L7SL1	M7C2	-0.1	M7L1	6	104.9	0.058	6	0.013	0.9	0.3	607.2	0	Vitrified Clay
4259	O2L24SB1	M24A2	-1	M24B1	3	60.7	0.066	6	0.013	0.95	0.315	647.42	0	
3985	O1L37SD1	M37C2	-1.4	M37D1	5	56.1	0.114	8	0.01	1.92	1.0442	2376.2	0	PVC
4202	O2L29SA5	M29A4	1.1	M29A5	4.6	254.7	0.014	8	0.01	0.65	0.315	827.15	0	PVC
1200	O1L14SY1	M14Y1	4.8	M14A9	0.4	202.7	0.022	8	0.013	0.57	0.285	800.48	0	Vitrified Clay
1226	O1L14SS6	M14S6	5.8	M14S5	4.7	286.6	0.004	12	0.013	0.31	0.285	1004.1	0	
3424	O2L1SC2	M1C2	4	M1C1	2	292.2	0.007	12	0.013	0.37	0.3	1322.9	0	
3132	O2L29SC1	M29C1	2	M29A1	-1.6	16.4	0.218	8	0.01	1.96	0.63	3292.1	0	PVC
4042	O2L2SH1	M2D4	3	M2H1	3.5	25.7	0.019	12	0.013	0.56	0.3	2230.3	0	
4164	O2L1ST1	M1S2	2.5	M1T1	4	60.1	0.025	12	0.013	0.6	0.3	2526.9	0	
4167	O2L1SS3	M1S2	2.5	M1S3	4	57.6	0.026	12	0.013	0.61	0.3	2580.6	0	
4193	O2L34SQ1	M34A12	1.7	M34Q1	3.8	89	0.024	12	0.013	0.57	0.2625	2474.3	0	
354	O1L17SM8	M17M8	4.2	M17M7	3.8	110	0.004	8	0.01	0	0	450.94	0	PVC
635	O2L36SA11	M36A11	2.8	M36A10	1.4	339.1	0.004	8	0.01	0	0	454.65	0	PVC
854	O2L1SMM1	M1MM1	4.5	M1JJ1	1.7	270.1	0.01	6	0.013	0	0	256.58	0	Vitrified Clay
1044	O1L17ST8	M17T8	2.8	M17T7	2.4	88.7	0.004	12	0.013	0	0	1004.2	0	
1051	O1L17SU2	M17U2	-1	M17U1	-2.3	275.1	0.005	12	0.013	0	0	1082.2	0	
1063	O1L17SR1	M17R1	1.8	M17Q0	0.6	400	0.003	8	0.013	0	0	299.51	0	Vitrified Clay
1065	O1L17SR2	M17R2	2.9	M17R1	1.8	268.2	0.004	8	0.013	0	0	342.55	0	Vitrified Clay
1067	O1L17SR3	M17R3	3.6	M17R2	2.9	161.2	0.005	8	0.013	0	0	367.43	0	Vitrified Clay
1074	O1L17SS1	M17S1	-1.4	M17Q2	-3.4	391.3	0.005	8	0.013	0	0	381.87	0	Vitrified Clay
1085	O1L17SG2	M17G2	7	M17G1	4.8	398.5	0.006	8	0.01	0	0	527.42	0	PVC
1271	O2L22SF1	M22F1	-1.8	M22A1	-0.5	112.4	-0.011	6	0.013	0	0	266.59	0	Vitrified Clay
1683	O2L19SA2	M19A2	1.5	M19A1	1	72.8	0.007	12	0.013	0	0	1324.9	0	Vitrified Clay
1684	O2L19SA1	M19A1	1	W-19	-4.4	16.7	0.321	12	0.013	0	0	9058.2	0	Vitrified Clay
3130	O2L29SG1	M29G1	2.5	M29B2	0	130.4	0.019	6	0.01	0	0	453.23	0	PVC
3983	O2L38SD3	M38D2	0.8	M38D3	1.1	72	0.004	8	0.01	0	0	462.79	0	PVC

Model Gravity Sewer Data Table 2025 Existing Conditions
Exhibit D1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1515	O2L46SA1	W-46	2	M46A1	2.4	72.7	-0.006	8	0.01	(N/A)	(N/A)	529.48	(N/A)	PVC

EXHIBIT D.2
SEWER MANHOLE DATA TABLE REPORT

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
359	M3A1	6.4	6.4	8964	-1.8	356.9	6.225	363.07	0.69	-1.1	FALSE	TRUE
456	M7A1	6.6	8.3	5184	-5.5	179.7	3.6	183.32	2.15	-3.4	FALSE	TRUE
522	M34A1	6.7	6.7	0	-5.5	1914	0	1913.6	0.85	-4.6	FALSE	TRUE
533	M14A2	5.6	7.5	0	-3.6	536.2	0	536.17	1.17	-2.4	FALSE	TRUE
535	M14A4	5.6	5.6	2872.8	-3.1	96.12	1.995	98.119	0.76	-2.3	FALSE	TRUE
598	M3D5	6.8	6.8	3283.2	2.9	0.285	2.28	2.565	1.06	4	FALSE	TRUE
712	M3H5	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
723	M3M1	5.5	5.5	410.4	4.5	0	0.285	0.285	0.01	4.5	FALSE	TRUE
725	M3N1	5.6	5.6	410.4	-6.1	0	0.285	0.285	6.58	0.5	FALSE	TRUE
816	M1F2	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
824	M1B5	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
828	M1J1	6	6	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
832	M1I1	5.8	5.8	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
839	M1KK1	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
843	M1NN1	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
845	M1LL1	6.3	6.3	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
851	M1OO2	6.4	6.4	432	5	0	0.3	0.3	0.01	5	FALSE	TRUE
897	M1D4	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
950	M4C1	5.5	5.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	TRUE
973	M34F2	4.8	4.8	36429.05	0.3	53.62	25.3	78.915	1.75	2	FALSE	TRUE
975	M34F1	4.8	4.8	1890	-0.8	84.69	1.313	86.002	1.78	1	FALSE	TRUE
977	M34H1	3.4	3.4	4158	-0.2	2.888	2.888	5.775	1.25	1	FALSE	TRUE
981	M34H3	4.1	4.1	756	2.5	0	0.525	0.525	0.02	2.5	FALSE	TRUE
985	M34A6	4.3	4.3	31753.4	-1.9	343.3	22.05	365.33	0.71	-1.2	FALSE	TRUE
1069	M17Q1	6.7	6.7	0	-4	37.05	0	37.05	4.78	0.8	FALSE	TRUE
1071	M17Q2	7.3	7.3	0	-3.4	37.05	0	37.05	4.2	0.8	FALSE	TRUE
1073	M17S1	7	7	0	-1.4	0	0	0	2.26	0.8	FALSE	TRUE
1098	M14C5	7.4	7.4	36936	-0.4	276.4	25.65	302.05	2.27	1.8	FALSE	TRUE
1099	M14D1	5.1	5.1	24624	0.4	142.5	17.1	159.55	1.66	2.1	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1103	M14D3	5.7	5.7	4104	2.1	105.4	2.85	108.25	1.4	3.5	FALSE	TRUE
1105	M14D4	6.1	6.1	16416	2.8	94	11.4	105.4	0.81	3.6	FALSE	TRUE
1107	M14C4	6.2	6.2	5582.01	-1.4	302.1	3.876	305.93	2.24	0.9	FALSE	TRUE
1109	M14C3	6.4	6.4	29548.8	-2.3	305.9	20.52	326.45	2.19	-0.1	FALSE	TRUE
1112	M14C2	6.4	6.4	0	-2.4	326.5	0	326.45	2.18	-0.2	FALSE	TRUE
1114	M14C1	6.4	6.4	0	-2.7	438.1	0	438.06	2.12	-0.6	FALSE	TRUE
1123	M14C6	7.1	7.1	4104	0.5	114	2.85	116.85	1.48	2	FALSE	TRUE
1125	M14C7	7.4	7.4	12312	1	102.6	8.55	111.15	1.08	2.1	FALSE	TRUE
1171	M14A7	6.4	6.4	6885.6	-1.6	71.39	4.782	76.174	1.41	-0.2	FALSE	TRUE
1288	M26A2	5	5	907.2	2.7	0	0.63	0.63	-0.03	2.7	FALSE	TRUE
1303	M14C8	8.1	8.1	0	1.3	71.25	0	71.25	0.78	2.1	FALSE	TRUE
1332	M40A5	9.2	9.2	126831.6	3.7	0	88.08	88.078	0.2	3.9	FALSE	TRUE
1334	M40B2	8	8	3528	4	0	2.45	2.45	-2.03	2	FALSE	TRUE
1386	M37D1	8.1	8.1	1503.6	5	0	1.044	1.0442	0.02	5	FALSE	TRUE
1464	M34A9	4.4	4.4	3402	0.1	215.5	2.363	217.91	0.65	0.7	FALSE	TRUE
1476	M39A1	5.9	5.9	22680.42	-1.6	15.75	15.75	31.501	3.6	2	FALSE	TRUE
1480	M39A2	5.9	5.9	22680.42	-0.3	0	15.75	15.75	2.25	2	FALSE	TRUE
1493	M18A-A2	5.1	5.1	0	-0.7	76	0	76.004	1.39	0.7	FALSE	TRUE
1495	M18A-A3	5.6	5.6	7257.6	-0.3	70.96	5.04	76.004	0.99	0.7	FALSE	TRUE
1516	M34A3	5.1	5.1	16068.5	-4.4	634	11.16	645.2	0.78	-3.6	FALSE	TRUE
1618	M3F3	5.9	5.9	0	3.2	132.9	0	132.9	0.29	3.5	FALSE	TRUE
1707	M38C2	7	7	20071.38	1	0	13.94	13.938	0.07	1.1	FALSE	TRUE
1715	M38B3	7.1	7.1	19609.59	1.5	0	13.62	13.618	0.08	1.6	FALSE	TRUE
3154	M30L1	4.2	4.2	453.6	3.8	0	0.315	0.315	0.02	3.8	FALSE	TRUE
3197	M18A1	5.6	5.6	3628.8	-3.1	132	2.52	134.55	4.11	1	FALSE	TRUE
3199	M18B2	5	5	11340	-1.6	0	7.875	7.875	2.57	1	FALSE	TRUE
3223	M18B1	5.1	5.1	10886.4	-2.4	7.875	7.56	15.435	3.4	1	FALSE	TRUE
3303	M24A1	6	6	3628.8	-1.6	6.93	2.52	9.45	0.68	-0.9	FALSE	TRUE
3401	M18A5	6.9	6.9	907.2	0.3	0	0.63	0.63	0.72	1	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3402	M18A4	6.3	6.3	7257.6	-0.9	0.63	5.04	5.67	1.93	1	FALSE	TRUE
3404	M18A2	5.4	5.4	10886.4	-2.5	17.01	7.56	24.57	3.48	1	FALSE	TRUE
3407	M18E2	7.1	7.1	4536	-0.6	0.63	3.15	3.78	1.65	1	FALSE	TRUE
3409	M18E1	6.2	6.2	7257.6	-1.8	3.78	5.04	8.82	2.78	1	FALSE	TRUE
3415	M18F1	6.9	6.9	453.6	-1.5	0	0.315	0.315	2.52	1	FALSE	TRUE
3417	M18A3	5.9	5.9	2721.6	-1.6	5.985	1.89	7.875	2.59	1	FALSE	TRUE
3420	M18G1	6.5	6.5	453.6	-0.6	0	0.315	0.315	1.64	1	FALSE	TRUE
3517	M35B1	6.5	6.5	29716.26	2	0	20.64	20.636	0.1	2.1	FALSE	TRUE
3519	M35C1	6	6	4776.24	0	0	3.317	3.3168	0.04	0	FALSE	TRUE
3911	M7A7	7.9	7.9	432	6.1	0	0.3	0.3	0.02	6.1	FALSE	TRUE
3951	M29D1	5.1	5.1	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
3980	M15A1	7	7	9702	4.5	0	6.738	6.7375	0.06	4.6	FALSE	TRUE
3991	M35A4	6.6	6.6	27561.66	3.6	0	19.14	19.14	0.1	3.7	FALSE	TRUE
4003	M13A2	6.2	6.2	4800.6	4.5	0	3.334	3.3337	0.05	4.5	FALSE	TRUE
4005	M10A2	9.3	9.3	672	6	0	0.467	0.46667	0.02	6	FALSE	TRUE
4008	M9A2	5.1	5.1	28350	1.1	0	19.69	19.688	0.09	1.2	FALSE	TRUE
4013	M9B2	5.3	5.3	34020	1.5	0	23.63	23.625	0.11	1.6	FALSE	TRUE
4035	M3B5	5	5	410.4	4.4	0	0.285	0.285	0.01	4.4	FALSE	TRUE
4037	M3C1	5.7	5.7	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
4039	M2D5	5.3	5.3	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4043	M2G1	5.6	5.6	432	2.8	0	0.3	0.3	0.02	2.9	FALSE	TRUE
4051	M2R4	6.2	6.2	432	4.7	0	0.3	0.3	0.02	4.7	FALSE	TRUE
4053	M2S1	6.1	6.1	432	4.7	0	0.3	0.3	0.01	4.8	FALSE	TRUE
4058	M2T2	6.1	6.1	432	4.2	0	0.3	0.3	0.01	4.2	FALSE	TRUE
4060	M2U1	6.2	6.2	432	3.5	0	0.3	0.3	0.01	3.6	FALSE	TRUE
4067	M2P3	6.1	6.1	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4069	M2Q1	6.9	6.9	432	1.9	0	0.3	0.3	0.02	1.9	FALSE	TRUE
4073	M2J3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4075	M2K1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4077	M2B4	5.5	5.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4084	M1P1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4088	M1O2	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4092	M1Q2	5.3	5.3	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	TRUE
4094	M1R1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4099	M1II1	5.8	5.8	432	5	0	0.3	0.3	0.02	5	FALSE	TRUE
4101	M1HH2	5.7	5.7	432	5.2	0	0.3	0.3	0.01	5.2	FALSE	TRUE
4108	M1KK2	6.5	6.5	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4113	M1BB4	5.6	5.6	432	5.1	0	0.3	0.3	0.01	5.1	FALSE	TRUE
4117	M1CC2	6	6	432	4	0	0.3	0.3	0.02	4	FALSE	TRUE
4119	M1DD1	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4123	M1EE2	6.1	6.1	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4125	M1EE3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4130	M1FF1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4132	M1GG1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4134	M1A6	6.5	6.5	432	1.4	192	0.3	192.3	0.36	1.8	FALSE	TRUE
4137	M1AA1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4139	M1Z1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4141	M1A5	6.5	6.5	432	1.1	192.9	0.3	193.2	0.36	1.5	FALSE	TRUE
4144	M1X1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4146	M1Y1	6.8	6.8	432	0	0	0.3	0.3	1.5	1.5	FALSE	TRUE
4150	M1U3	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4154	M1V2	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4156	M1W1	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4163	M1T1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4166	M1S3	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4170	M1N3	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4172	M1M2	5	5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4176	M1L1	5.1	5.1	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4178	M1K2	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4186	M1H4	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4188	M34R1	4.4	4.4	378	3	0	0.263	0.2625	0.01	3	FALSE	TRUE
4190	M34P1	4.8	4.8	378	4	0	0.263	0.2625	0.01	4	FALSE	TRUE
4192	M34Q1	4.3	4.3	378	3.8	0	0.263	0.2625	0.01	3.8	FALSE	TRUE
4194	M34S1	4.7	4.7	378	3.8	0	0.263	0.2625	0.01	3.8	FALSE	TRUE
4201	M29A5	5.6	5.6	453.6	4.6	0	0.315	0.315	0.01	4.6	FALSE	TRUE
4209	M25A7	4.1	4.1	453.6	3.5	0	0.315	0.315	0.01	3.5	FALSE	TRUE
4211	M25C2	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4213	M25D1	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4215	M25E1	5.3	5.3	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4219	M25F1	4.7	4.7	907.2	2	0	0.63	0.63	0.02	2	FALSE	TRUE
4221	M25G1	10	10	907.2	8	0	0.63	0.63	0.02	8	FALSE	TRUE
4223	M25I1	5.2	5.2	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4226	M25H1	10	10	907.2	7	0	0.63	0.63	0.02	7	FALSE	TRUE
4228	M25J1	5.2	5.2	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4231	M25B3	7.3	7.3	907.2	5	0	0.63	0.63	0.02	5	FALSE	TRUE
4233	M7C4	4.5	4.5	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4235	M7N1	8.2	8.2	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4237	M7M1	4.8	4.8	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4240	M7L1	9.9	9.9	432	6	0	0.3	0.3	0.01	6	FALSE	TRUE
4244	M7K1	5.3	5.3	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4246	M7J1	8.4	8.4	1728	4	0	1.2	1.2	0.03	4	FALSE	TRUE
4248	M24D2	5.7	5.7	907.2	3.7	0	0.63	0.63	0.02	3.7	FALSE	TRUE
4250	M24E1	8.4	8.4	907.2	5.4	0	0.63	0.63	0.02	5.4	FALSE	TRUE
4252	M24G1	6.8	6.8	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
4254	M24H1	5	5	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4256	M24A3	4.9	4.9	453.6	2	0	0.315	0.315	0.01	2	FALSE	TRUE
4258	M24B1	5.6	5.6	453.6	3	0	0.315	0.315	0.01	3	FALSE	TRUE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4266	M37A5	5	5	1503.6	3	0	1.044	1.0442	0.02	3	FALSE	TRUE
4270	M4G3	9	9	4309.2	6.2	0	2.993	2.9925	0.04	6.2	FALSE	TRUE
4272	M32C2	5.2	5.2	19879.02	1	0	13.81	13.805	0.09	1.1	FALSE	TRUE
4286	M14E1	8	8	4104	4.8	0	2.85	2.85	0.04	4.9	FALSE	TRUE
4386	M32B2	6	6	12526.5	3	0	8.699	8.699	0.07	3.1	FALSE	TRUE
4414	M30G1	3.4	3.4	1360.8	2	0	0.945	0.945	0.02	2	FALSE	TRUE
4419	M30D1	3.5	3.5	2721.6	2	0	1.89	1.89	0.03	2	FALSE	TRUE
4427	M16C1	4.7	4.7	11340	2.2	0	7.875	7.875	0.06	2.3	FALSE	TRUE
4454	M38A8	10.3	10.3	2469.6	7	0	1.715	1.715	0.03	7	FALSE	TRUE
67	M17A9	8.5	8.5	16416	0	349	11.4	360.43	0.54	0.5	FALSE	FALSE
68	M17J1	8.8	8.8	16416	3.7	3.563	11.4	14.962	0.09	3.8	FALSE	FALSE
222	M17K1	9.3	9.3	2052	5.6	0	1.425	1.425	0.03	5.6	FALSE	FALSE
226	M17J2	8.8	8.8	1026	4.8	2.85	0.713	3.5625	0.04	4.8	FALSE	FALSE
227	M17J3	9.2	9.2	2052	5.2	0	1.425	1.425	0.03	5.2	FALSE	FALSE
352	M17M8	7.2	7.2	0	4.2	0	0	0	0	4.2	FALSE	FALSE
353	M17M7	7	7	16416	3.8	0	11.4	11.4	0.07	3.8	FALSE	FALSE
375	M3A2	6.2	6.2	11080.8	-1.3	196.9	7.695	204.57	0.36	-0.9	FALSE	FALSE
377	M3G1	6.1	6.1	4514.4	0.2	2.85	3.135	5.985	0.06	0.3	FALSE	FALSE
379	M3G2	6.2	6.2	3693.6	1.7	0.285	2.565	2.85	0.04	1.7	FALSE	FALSE
381	M3G3	6.4	6.4	410.4	3.1	0	0.285	0.285	0.01	3.1	FALSE	FALSE
384	M17A1	4.4	4.4	18900	0.3	45.5	13.13	58.625	0.15	0.5	FALSE	FALSE
403	M1A1	7.2	7.2	1728	-1	269.3	1.2	270.45	0.34	-0.7	FALSE	FALSE
418	M2A1	5.8	5.8	432	-2.1	64.2	0.3	64.5	0.19	-1.9	FALSE	FALSE
424	M3J1	5.4	5.4	820.8	3	162	0.57	162.53	0.28	3.3	FALSE	FALSE
451	M1A9	6.3	6.3	1728	3	185.1	1.2	186.3	0.28	3.3	FALSE	FALSE
523	M34A2	5.7	5.7	20709.15	-4.6	679.6	14.38	694	0.53	-4.1	FALSE	FALSE
530	M14A1	6.3	6.3	0	-4	628.1	0	628.09	0.53	-3.4	FALSE	FALSE
534	M14A3	5.9	5.9	0	-2.6	98.12	0	98.119	0.24	-2.4	FALSE	FALSE
545	M7B1	8.4	8.4	2592	3.6	0.3	1.8	2.1	0.03	3.6	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
546	M7B2	7.7	7.7	432	4.9	0	0.3	0.3	0.02	4.9	FALSE	FALSE
549	M7A3	6.1	6.1	3888	-0.6	62.93	2.7	65.633	0.19	-0.4	FALSE	FALSE
550	M7D1	6	6	15552	1	45.53	10.8	56.333	0.18	1.2	FALSE	FALSE
551	M7D2	6	6	15552	1.8	28.73	10.8	39.533	0.16	2	FALSE	FALSE
552	M7D3	6.7	6.7	13824	2.7	13.13	9.6	22.733	0.12	2.8	FALSE	FALSE
553	M7E1	7.7	7.7	11136	4.9	0	7.733	7.7333	0.07	5	FALSE	FALSE
554	M7H1	6.7	6.7	864	4.7	0	0.6	0.6	0.02	4.7	FALSE	FALSE
555	M7I2	6.1	6.1	864	4.6	0	0.6	0.6	0.02	4.6	FALSE	FALSE
559	M7D4	7.4	7.4	6912	4.4	0.6	4.8	5.4	0.06	4.5	FALSE	FALSE
560	M7G2	7.1	7.1	864	5.6	0	0.6	0.6	0.02	5.6	FALSE	FALSE
561	M7F2	7.7	7.7	864	5.8	0	0.6	0.6	0.02	5.8	FALSE	FALSE
564	M7A6	8	8	2592	4.9	0.3	1.8	2.1	0.04	5	FALSE	FALSE
565	M7D5	7.7	7.7	864	6.1	0	0.6	0.6	0.02	6.1	FALSE	FALSE
580	M7A5	7.7	7.7	3024	3.3	2.1	2.1	4.2	0.05	3.3	FALSE	FALSE
583	M7A4	6.6	6.6	3456	1.3	4.2	2.4	6.6	0.06	1.4	FALSE	FALSE
587	M7A2	6.1	6.1	3456	-2	65.63	2.4	68.033	0.19	-1.8	FALSE	FALSE
590	M7G1	6.3	6.3	6912	3.9	0.6	4.8	5.4	0.05	4	FALSE	FALSE
593	M7F1	6.5	6.5	6912	4.1	0.6	4.8	5.4	0.06	4.2	FALSE	FALSE
596	M3D4	6.7	7.5	3283.2	2	2.565	2.28	4.845	0.05	2	FALSE	FALSE
597	M3D3	6.6	6.6	2052	1.5	7.41	1.425	8.835	0.08	1.6	FALSE	FALSE
599	M3D6	6.3	6.3	410.4	3.9	0	0.285	0.285	0.11	4	FALSE	FALSE
600	M2A7	6.4	6.4	432	3.7	0	0.3	0.3	0.02	3.8	FALSE	FALSE
601	M3E1	5.4	5.4	3283.2	2.4	0.285	2.28	2.565	0.04	2.5	FALSE	FALSE
602	M3E2	5.3	5.3	410.4	3.3	0	0.285	0.285	0.02	3.3	FALSE	FALSE
603	M2O2	6.1	6.1	432	3.4	0	0.3	0.3	0.02	3.4	FALSE	FALSE
604	M2A6	6.3	6.3	3024	2.8	0.3	2.1	2.4	0.04	2.9	FALSE	FALSE
605	M2O1	6.1	6.1	3456	2.4	0.3	2.4	2.7	0.05	2.5	FALSE	FALSE
606	M2A4	7.3	7.3	3024	1.5	7.5	2.1	9.6	0.08	1.5	FALSE	FALSE
607	M2A5	7.3	7.3	3456	1.9	2.4	2.4	4.8	0.06	2	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
608	M2A3	7.1	7.1	3888	0.3	12.9	2.7	15.6	0.08	0.3	FALSE	FALSE
622	M36A11	5.8	5.8	0	2.8	0	0	0	0	2.8	FALSE	FALSE
623	M36A10	5.9	5.9	11970	1.4	0	8.313	8.3125	0.06	1.5	FALSE	FALSE
624	M36A9	5.7	5.7	11970	1	8.313	8.313	16.625	0.09	1.1	FALSE	FALSE
625	M36A8	5.9	5.9	23276.4	0.2	40.18	16.16	56.344	0.17	0.4	FALSE	FALSE
627	M36A6	5.8	5.8	23276.4	-1.7	72.51	16.16	88.673	0.21	-1.4	FALSE	FALSE
628	M36A5	6.4	6.4	23276.4	-2	88.67	16.16	104.84	0.23	-1.7	FALSE	FALSE
629	M36A4	5.9	5.9	11306.4	-2.2	104.8	7.852	112.69	0.34	-1.9	FALSE	FALSE
630	M36A3	6.1	6.1	24924.06	-2.4	131.6	17.31	148.91	0.27	-2.2	FALSE	FALSE
631	M36E1	7.1	7.1	13617.66	2.2	9.457	9.457	18.913	0.09	2.3	FALSE	FALSE
632	M36H1	8.8	8.8	11306.4	3	15.7	7.852	23.555	0.1	3.1	FALSE	FALSE
633	M36H2	9.3	9.3	11306.4	5.1	7.852	7.852	15.703	0.08	5.2	FALSE	FALSE
634	M36H3	9.4	9.4	11306.4	6	0	7.852	7.8517	0.06	6.1	FALSE	FALSE
641	M36A7	5.6	5.6	23276.4	-0.7	56.34	16.16	72.508	0.19	-0.5	FALSE	FALSE
648	M36E2	7.1	7.1	13617.66	6	0	9.457	9.4567	0.07	6.1	FALSE	FALSE
650	M36A2	6.2	6.2	11306.4	-4.1	148.9	7.852	156.76	0.28	-3.8	FALSE	FALSE
652	M36A1	5.8	5.8	76461.84	-5.2	420.6	53.1	473.73	0.43	-4.7	FALSE	FALSE
654	M36B1	6.5	6.5	50449.56	-4	228.8	35.03	263.87	0.37	-3.6	FALSE	FALSE
656	M36C2	5.3	7.9	15466.92	-0.5	69.33	10.74	80.072	0.19	-0.3	FALSE	FALSE
658	M36C3	8.2	8.2	33278.7	3.9	46.22	23.11	69.331	0.18	4.1	FALSE	FALSE
660	M36C4	8.6	8.6	15466.92	5.1	10.74	10.74	21.482	0.1	5.1	FALSE	FALSE
662	M36C5	8.5	10.4	15466.92	6	0	10.74	10.741	0.07	6.1	FALSE	FALSE
664	M36G2	8.9	8.9	17812.2	6	0	12.37	12.37	0.08	6.1	FALSE	FALSE
665	M36G1	8.8	8.8	17811.78	5	12.37	12.37	24.739	0.12	5.1	FALSE	FALSE
668	M36D2	6	6	0	1.9	29.8	0	29.802	0.15	2.1	FALSE	FALSE
670	M36D3	5.9	5.9	21457.8	3	0	14.9	14.901	0.08	3.1	FALSE	FALSE
672	M36F1	5.5	5.5	21457.8	3	0	14.9	14.901	0.08	3.1	FALSE	FALSE
674	M36B6	5.7	5.7	21457.8	3	0	14.9	14.901	0.08	3.1	FALSE	FALSE
675	M36B5	6.5	6.5	0	2.1	14.9	0	14.901	0.08	2.1	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
677	M36B3	6.4	8.3	3439.8	-0.1	70.8	2.389	73.19	0.18	0.1	FALSE	FALSE
679	M36I1	7.1	8.2	2192.4	1.5	41.08	1.523	42.6	0.14	1.6	FALSE	FALSE
681	M36B2	6.3	6.3	50449.56	-3	73.19	35.03	108.22	0.24	-2.7	FALSE	FALSE
684	M36C1	8.3	8.3	15466.5	-2	80.07	10.74	90.812	0.21	-1.8	FALSE	FALSE
687	M36D1	8.3	8.3	0	1	29.8	0	29.802	0.12	1.1	FALSE	FALSE
690	M36B4	8	8	19152	0.5	14.9	13.3	28.201	0.12	0.7	FALSE	FALSE
693	M17A8	8.4	8.4	0	-2.1	405.5	0	405.47	0.4	-1.7	FALSE	FALSE
694	M17L1	7.7	10.5	0	0.9	45.04	0	45.041	0.14	1	FALSE	FALSE
696	M17L2	8.3	8.3	0	1.2	45.04	0	45.041	0.14	1.3	FALSE	FALSE
698	M17L3	6.7	6.7	10260	1.8	37.92	7.125	45.041	0.14	1.9	FALSE	FALSE
700	M17L4	7.6	7.6	16416	2.3	26.52	11.4	37.916	0.13	2.5	FALSE	FALSE
702	M17L5	7	7	16416	3.6	15.12	11.4	26.516	0.11	3.7	FALSE	FALSE
704	M17L6	7.2	7.2	21766.4	4	0	15.12	15.116	0.08	4.1	FALSE	FALSE
706	M3H2	5.4	5.4	2872.8	1.3	166.7	1.995	168.66	0.34	1.6	FALSE	FALSE
708	M3H3	5.5	5.5	2052	1.8	2.71	1.425	4.135	0.05	1.8	FALSE	FALSE
710	M3H4	4.9	4.9	1231.2	2.5	0.285	0.855	1.14	0.03	2.5	FALSE	FALSE
714	M3I1	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
716	M3K1	5.8	5.8	410.4	-5.1	0	1.285	1.285	6.93	1.8	FALSE	FALSE
718	M3L4	5.2	5.2	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
719	M3L3	3.9	3.9	2462.4	1.7	0.285	1.71	1.995	0.03	1.7	FALSE	FALSE
721	M3L2	5.7	5.7	2052	0.9	2.28	1.425	3.705	0.05	0.9	FALSE	FALSE
726	M3L1	5.9	5.9	4514.4	0.4	4.275	3.135	7.41	0.07	0.5	FALSE	FALSE
729	M3O1	6.3	6.3	410.4	5	0	0.285	0.285	0.01	5	FALSE	FALSE
731	M3H1	5.1	5.1	3693.6	-0.1	176.1	2.565	178.63	0.35	0.2	FALSE	FALSE
734	M3A3	6.1	6.1	2462.4	0.4	10.55	1.71	12.255	0.09	0.5	FALSE	FALSE
741	M3A4	5.8	5.8	2462.4	1.4	8.835	1.71	10.545	0.08	1.5	FALSE	FALSE
743	M3C2	5.6	5.6	410.4	2	0	0.285	0.285	0.02	2	FALSE	FALSE
749	M3A9	5.3	5.3	410.4	5	0	0.285	0.285	0.21	5.2	FALSE	FALSE
750	M3A8	5.4	5.4	820.8	4.3	0.285	0.57	0.855	0.03	4.3	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
752	M3A7	5.5	5.5	1641.6	3.5	0.855	1.14	1.995	0.04	3.6	FALSE	FALSE
754	M3A6	5.3	5.3	1231.2	2.9	1.995	0.855	2.85	0.05	2.9	FALSE	FALSE
756	M3A5	6.4	6.4	2872.8	1.7	2.85	1.995	4.845	0.06	1.8	FALSE	FALSE
760	M2B3	5.6	5.6	864	3	0.3	0.6	0.9	0.02	3	FALSE	FALSE
761	M2B2	5.9	5.9	1296	2	0.9	0.9	1.8	0.03	2	FALSE	FALSE
763	M2B1	5.9	5.9	1728	1	1.8	1.2	3	0.04	1	FALSE	FALSE
765	M2A2	6.2	6.2	6912	-1.3	33.9	4.8	38.7	0.15	-1.1	FALSE	FALSE
768	M2J1	6.1	6.1	1296	0.1	2.4	0.9	3.3	0.25	0.4	FALSE	FALSE
770	M2L1	5.7	5.7	864	0.6	0.6	0.6	1.2	0.03	0.7	FALSE	FALSE
772	M2M1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
776	M2L2	6	6	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
778	M2N1	6.1	6.1	432	0.9	0	0.3	0.3	0.02	0.9	FALSE	FALSE
780	M2I1	6	6	864	4	0	0.6	0.6	0.02	4	FALSE	FALSE
781	M2D4	5.5	5.5	3888	3	1.2	2.7	3.9	0.05	3.1	FALSE	FALSE
783	M2D3	5.4	5.4	3456	1.5	3.9	2.4	6.3	0.06	1.6	FALSE	FALSE
785	M2D2	5.4	5.4	2592	0	6.3	1.8	8.1	0.06	0.1	FALSE	FALSE
787	M2D1	5.8	5.8	5184	-1.7	9.3	3.6	12.9	0.08	-1.6	FALSE	FALSE
789	M2E1	5.9	5.9	1296	2	0.3	0.9	1.2	0.03	2	FALSE	FALSE
791	M2E2	5.8	5.8	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
795	M2C1	5.8	5.8	5184	-1.8	9	3.6	12.6	0.08	-1.7	FALSE	FALSE
797	M2F1	5.7	5.7	2160	0.4	2.1	1.5	3.6	0.05	0.4	FALSE	FALSE
799	M2F2	5.8	5.8	2160	2.1	0.6	1.5	2.1	0.04	2.1	FALSE	FALSE
801	M2F3	6.1	6.1	432	2.6	0	0.3	0.3	0.02	2.6	FALSE	FALSE
803	M2C2	5.6	5.6	4752	-1.3	2.1	3.3	5.4	0.06	-1.3	FALSE	FALSE
805	M2C3	5.7	5.7	2592	0.9	0.3	1.8	2.1	0.04	0.9	FALSE	FALSE
807	M2C4	5.3	5.3	432	2.3	0	0.3	0.3	0.02	2.3	FALSE	FALSE
809	M2R1	5.7	5.7	3888	1.8	5.4	2.7	8.1	0.07	1.8	FALSE	FALSE
811	M2R2	5.8	5.8	432	3.2	2.4	0.3	2.7	0.04	3.3	FALSE	FALSE
813	M1G1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
814	M1F1	6.1	6.1	5184	2.5	0.6	3.6	4.2	0.05	2.6	FALSE	FALSE
818	M1B2	6	6	4320	1.2	10.8	3	13.8	0.09	1.2	FALSE	FALSE
820	M1B3	5.9	5.9	1296	2.4	5.7	0.9	6.6	0.06	2.4	FALSE	FALSE
822	M1B4	5.6	5.6	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
826	M1H1	5.8	5.8	2160	2.9	3	1.5	4.5	0.05	2.9	FALSE	FALSE
830	M1H2	5.9	5.9	2160	3.3	1.2	1.5	2.7	0.04	3.3	FALSE	FALSE
834	M1H3	6.1	6.1	864	3.6	0.3	0.6	0.9	0.03	3.7	FALSE	FALSE
836	M1JJ4	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	FALSE
837	M1JJ3	6.1	6.1	6480	2.7	0.6	4.5	5.1	0.05	2.7	FALSE	FALSE
841	M1JJ2	6.3	6.3	6480	2.1	5.7	4.5	10.2	0.08	2.2	FALSE	FALSE
847	M1JJ1	6.6	6.6	6912	1.7	11.1	4.8	15.9	0.1	1.8	FALSE	FALSE
849	M1OO1	6.3	6.3	864	4.5	0.3	0.6	0.9	0.02	4.5	FALSE	FALSE
853	M1MM1	6.2	6.2	0	4.5	0	0	0	0	4.5	FALSE	FALSE
855	M1D2	6.7	6.7	4320	0.9	16.5	3	19.5	0.11	1	FALSE	FALSE
858	M1B1	6.5	6.5	6912	-0.4	13.8	4.8	18.6	0.1	-0.3	FALSE	FALSE
861	M1E4	6.6	6.6	27000	3	0	18.75	18.75	0.1	3.1	FALSE	FALSE
862	M1E3	5.7	5.7	0	1.5	18.75	0	18.75	0.11	1.6	FALSE	FALSE
864	M1E2	5.4	5.4	1296	0.7	20.55	0.9	21.45	0.11	0.8	FALSE	FALSE
866	M1E1	6.3	6.3	1728	-0.3	22.05	1.2	23.25	0.11	-0.1	FALSE	FALSE
868	M1A2	6.4	6.4	2592	-0.8	223.4	1.8	225.15	0.37	-0.4	FALSE	FALSE
871	M1A4	6.5	6.5	0	1	196.2	0	196.2	0.35	1.3	FALSE	FALSE
882	M1U1	6.1	6.1	0	2.6	1.8	0	1.8	0.03	2.6	FALSE	FALSE
884	M1A7	6.5	6.5	0	1.7	191.4	0	191.4	0.31	2	FALSE	FALSE
886	M1BB2	5.9	5.9	0	3	1.5	0	1.5	0.03	3	FALSE	FALSE
891	M1A10	6.7	6.7	32400	4.3	6.25	22.5	28.75	0.12	4.4	FALSE	FALSE
893	M1A11	8.2	8.2	9000	4.8	0	6.25	6.25	1.64	6.4	FALSE	FALSE
899	M23B2	6.9	6.9	5460	3.5	0	3.792	3.7917	0.05	3.6	FALSE	FALSE
900	M23B1	5.4	5.4	56700	1.9	3.792	39.38	43.167	0.27	2.2	FALSE	FALSE
903	M17A2	6.1	7.8	3360	2.1	0	2.333	2.3333	0.04	2.2	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
905	M5B2	6	6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
906	M5B1	6.4	6.4	3175.2	3	0.315	2.205	2.52	0.04	3	FALSE	FALSE
908	M5A3	6.2	6.2	7711.2	-2.4	22.23	5.355	27.585	0.11	-2.3	FALSE	FALSE
910	M5A2	6	6	4536	-2.7	38.3	3.15	41.445	0.15	-2.5	FALSE	FALSE
913	M5C1	6.4	6.4	3175.2	2	0.315	2.205	2.52	0.04	2	FALSE	FALSE
915	M5C2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
921	M5D3	6.3	6.3	4082.4	0.7	5.04	2.835	7.875	0.07	0.8	FALSE	FALSE
923	M5A4	6	6	3628.8	-0.7	17.19	2.52	19.71	0.11	-0.6	FALSE	FALSE
925	M5A6	5.8	5.8	3628.8	0.5	14.67	2.52	17.19	0.11	0.6	FALSE	FALSE
927	M5A7	6.5	6.5	3628.8	1.8	12.15	2.52	14.67	0.1	1.9	FALSE	FALSE
929	M5A8	6.3	6.3	4082.4	3.1	0.315	11.84	12.15	0.09	3.2	FALSE	FALSE
931	M5D4	6	6	3175.2	2.2	2.835	2.205	5.04	0.06	2.3	FALSE	FALSE
933	M5D5	6.3	6.3	3628.8	3.4	0.315	2.52	2.835	0.04	3.4	FALSE	FALSE
935	M5A9	5.8	5.8	453.6	4.5	0	0.315	0.315	0.02	4.5	FALSE	FALSE
937	M5D6	5.8	5.8	453.6	4.6	0	0.315	0.315	0.02	4.6	FALSE	FALSE
939	M4H2	5.9	5.9	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
940	M4H1	6.4	6.4	4082.4	2.5	0.315	2.835	3.15	0.04	2.5	FALSE	FALSE
944	M4A3	6.7	6.7	7257.6	0.7	17.33	5.04	22.365	0.12	0.8	FALSE	FALSE
946	M4B1	6.1	6.1	4536	2.5	0.315	3.15	3.465	0.05	2.5	FALSE	FALSE
948	M4B2	6.3	6.3	453.6	4.3	0	0.315	0.315	0.02	4.3	FALSE	FALSE
952	M4A4	6.7	6.7	7257.6	1.2	8.505	5.04	13.545	0.1	1.3	FALSE	FALSE
954	M4D1	6.5	6.5	907.2	3.5	0.63	0.63	1.26	0.03	3.5	FALSE	FALSE
956	M4E1	6.4	6.4	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
958	M4D2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
960	M4F1	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
961	M4A5	6.7	6.7	9525.6	1.8	0.63	6.615	7.245	0.07	1.8	FALSE	FALSE
964	M4G1	7.6	7.6	4536	3	3.623	3.15	6.7725	0.06	3.1	FALSE	FALSE
966	M4G2	7.4	7.4	907.2	5.4	2.993	0.63	3.6225	0.05	5.4	FALSE	FALSE
968	M4A6	7.2	7.2	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
970	M34F4	4.4	4.4	6171.9	1.8	0	4.286	4.286	1.63	3.5	FALSE	FALSE
971	M34F3	4.8	4.8	2646	1.2	4.286	1.838	6.1235	1.65	2.8	FALSE	FALSE
979	M34H2	5.1	5.1	2646	0.9	0.525	1.838	2.3625	0.17	1	FALSE	FALSE
983	M34I1	3.4	3.4	756	1.5	0	0.525	0.525	0.02	1.5	FALSE	FALSE
987	M34A7	4.3	4.3	13769	-0.5	245.7	9.562	255.24	0.42	-0.1	FALSE	FALSE
989	M34J1	3.2	3.2	3780	0.1	3.413	2.625	6.0375	0.06	0.2	FALSE	FALSE
991	M34K1	4.5	4.5	4158	1.1	0.263	2.888	3.15	0.05	1.1	FALSE	FALSE
993	M34K2	4.7	4.7	378	3	0	0.263	0.2625	0.01	3	FALSE	FALSE
995	M34J2	5	5	378	2.5	0	0.263	0.2625	0.01	2.5	FALSE	FALSE
997	M34A5	4.2	4.2	0	-2.1	365.3	0	365.33	0.43	-1.6	FALSE	FALSE
999	M34A4	4.1	4.1	0	-3	365.3	0	365.33	0.45	-2.5	FALSE	FALSE
1001	M34E2	7.1	7.1	2940	1.5	0	2.042	2.0417	0.03	1.5	FALSE	FALSE
1003	M17M6	7.1	7.1	41040	2.5	11.4	28.5	39.9	0.14	2.6	FALSE	FALSE
1005	M17M5	6.8	6.8	16416	1.9	39.9	11.4	51.3	0.15	2	FALSE	FALSE
1007	M17M4	6.8	6.8	0	1	51.3	0	51.3	0.15	1.2	FALSE	FALSE
1009	M17M3	6.8	6.8	16416	0.6	51.3	11.4	62.7	0.17	0.8	FALSE	FALSE
1011	M17M2	6.9	6.9	16416	-0.3	62.7	11.4	74.1	0.19	-0.1	FALSE	FALSE
1013	M17M1	7	7	16416	-0.8	74.1	11.4	85.5	0.2	-0.6	FALSE	FALSE
1015	M17A3	9.6	9.6	2720.8	-6.4	491	1.889	492.86	0.64	-5.8	FALSE	FALSE
1017	M17A6	8	8	0	-3.4	405.5	0	405.47	0.4	-3	FALSE	FALSE
1019	M17O3	8.4	8.4	32832	4.1	0	22.8	22.8	0.1	4.2	FALSE	FALSE
1020	M17O2	6.9	6.9	16416	2.9	22.8	11.4	34.2	0.13	3	FALSE	FALSE
1022	M17N1	6.7	6.7	49248	0.1	91.2	34.2	125.4	0.22	0.3	FALSE	FALSE
1024	M17N2	6.9	6.9	32832	3.7	11.4	22.8	34.2	0.13	3.8	FALSE	FALSE
1026	M17N3	6.8	6.8	0	4.7	11.4	0	11.4	0.07	4.7	FALSE	FALSE
1028	M17N4	7.6	7.6	16416	5.3	0	11.4	11.4	0.07	5.3	FALSE	FALSE
1030	M17A2	8	8	0	-6.6	618.3	0	618.26	0.67	-6	FALSE	FALSE
1033	M17U1	6.9	6.9	16416	-2.3	0	11.4	11.4	0.06	-2.2	FALSE	FALSE
1034	M17T3	8.1	8.1	0	-2.8	48.45	0	48.45	0.14	-2.7	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1036	M17T4	8.2	8.2	16416	1.1	25.65	11.4	37.05	0.12	1.2	FALSE	FALSE
1038	M17V1	7.1	7.1	16416	1.8	2.85	11.4	14.25	0.08	1.9	FALSE	FALSE
1040	M17V2	6.8	6.8	4104	2.8	0	2.85	2.85	0.04	2.8	FALSE	FALSE
1042	M17T8	8.5	8.5	0	2.8	0	0	0	0	2.8	FALSE	FALSE
1043	M17T7	8	8	16416	2.4	0	11.4	11.4	0.07	2.5	FALSE	FALSE
1045	M17T6	7.2	7.2	0	2.1	11.4	0	11.4	0.07	2.1	FALSE	FALSE
1047	M17T5	7.7	7.7	0	1.8	11.4	0	11.4	0.07	1.9	FALSE	FALSE
1050	M17U2	7.6	7.6	0	-1	0	0	0	0	-1	FALSE	FALSE
1052	M17T2	7	7	0	-3.3	48.45	0	48.45	0.15	-3.2	FALSE	FALSE
1054	M17T1	7.4	7.4	0	-3.5	48.45	0	48.45	0.13	-3.3	FALSE	FALSE
1056	M17A1	8.6	8.6	41040	-7	695.2	28.5	723.71	0.65	-6.3	FALSE	FALSE
1060	M17Q0	7.2	7.2	31920	0.6	37.05	22.17	59.217	0.17	0.8	FALSE	FALSE
1062	M17R1	6.9	6.9	0	1.8	0	0	0	0	1.8	FALSE	FALSE
1064	M17R2	7.1	7.1	0	2.9	0	0	0	0	2.9	FALSE	FALSE
1066	M17R3	7.6	7.6	0	3.6	0	0	0	0	3.6	FALSE	FALSE
1075	M17H3	8.4	8.4	4104	4.5	0	2.85	2.85	0.04	4.5	FALSE	FALSE
1076	M17H2	8.6	8.6	19494	3	2.85	13.54	16.388	0.09	3.1	FALSE	FALSE
1078	M17H1	8.7	8.7	4104	2.6	16.39	2.85	19.237	0.09	2.6	FALSE	FALSE
1080	M17A10	8.7	8.7	6156	0.6	329.8	4.275	334.06	0.56	1.1	FALSE	FALSE
1082	M17G1	9.6	9.6	32832	4.8	0	22.8	22.8	0.1	4.9	FALSE	FALSE
1084	M17G2	9.4	9.4	0	7	0	0	0	0	7	FALSE	FALSE
1086	M17A12	9.4	9.4	80028	4	0	55.58	55.575	0.18	4.2	FALSE	FALSE
1087	M17A11	8.9	8.9	32832	1.6	265	22.8	287.75	0.47	2	FALSE	FALSE
1092	M17P1	7	8.6	32832	2.9	5.7	22.8	28.5	0.11	3	FALSE	FALSE
1094	M17P2	7.4	7.4	0	4.1	5.7	0	5.7	0.05	4.2	FALSE	FALSE
1096	M17P3	8	9.5	8208	4.5	0	5.7	5.7	0.05	4.6	FALSE	FALSE
1101	M14D2	4.9	4.9	16416	1.3	131.1	11.4	142.45	2.14	3.4	FALSE	FALSE
1121	M14D5	6.3	6.3	8208	3.5	0	5.7	5.7	0.13	3.6	FALSE	FALSE
1127	M14F1	9.2	9.2	16416	1.8	19.95	11.4	31.35	0.3	2.1	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1129	M14F2	0	7.9	16416	2.5	8.55	11.4	19.95	0.12	2.6	FALSE	FALSE
1141	M14I1	5.4	5.4	2052	-0.8	1.71	1.425	3.135	0.04	-0.8	FALSE	FALSE
1143	M14I2	5.3	5.3	2052	0.5	0.285	1.425	1.71	0.03	0.5	FALSE	FALSE
1145	M14I3	5.8	5.8	410.4	1.5	0	0.285	0.285	0.01	1.5	FALSE	FALSE
1147	M14J1	5.4	5.4	2052	-1.9	2.565	1.425	3.99	0.04	-1.9	FALSE	FALSE
1149	M14J2	5.7	5.7	1641.6	-0.7	1.425	1.14	2.565	0.04	-0.7	FALSE	FALSE
1151	M14J3	5.7	5.7	1641.6	0.3	0.285	1.14	1.425	0.03	0.3	FALSE	FALSE
1153	M14J4	5.9	5.9	410.4	1.4	0	0.285	0.285	0.01	1.4	FALSE	FALSE
1155	M14A5	5.2	5.2	7797.6	-2.4	83.58	5.415	88.999	0.23	-2.1	FALSE	FALSE
1157	M14L1	5.5	5.5	5335.2	0.1	0.57	3.705	4.275	0.04	0.1	FALSE	FALSE
1159	M14L2	5.2	5.2	820.8	1.5	0	0.57	0.57	0.02	1.5	FALSE	FALSE
1161	M14K1	5.2	5.2	3693.6	0.6	0.57	2.565	3.135	0.04	0.7	FALSE	FALSE
1163	M14K2	5.6	5.6	820.8	1.6	0	0.57	0.57	0.02	1.6	FALSE	FALSE
1165	M14B1	6.5	6.5	22002	-1.7	76.63	15.28	91.913	0.2	-1.5	FALSE	FALSE
1167	M14B2	5.3	5.3	110352	-1.4	0	76.63	76.633	0.29	-1.1	FALSE	FALSE
1169	M14A6	5.1	5.1	0	-0.5	76.17	0	76.174	0.19	-0.3	FALSE	FALSE
1173	M14M1	5.3	5.3	4924.8	-0.4	13.97	3.42	17.385	0.24	-0.2	FALSE	FALSE
1175	M14N1	5.6	5.6	1641.6	0.9	0.57	1.14	1.71	0.03	0.9	FALSE	FALSE
1177	M14N2	5.5	5.5	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1179	M14O1	5.6	5.6	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1181	M14M2	6.6	6.6	4924.8	2.2	8.835	3.42	12.255	0.07	2.2	FALSE	FALSE
1183	M14P1	6.8	6.8	820.8	3.8	0	0.57	0.57	0.02	3.8	FALSE	FALSE
1185	M14M3	7.4	7.4	5745.6	3	4.275	3.99	8.265	0.07	3.1	FALSE	FALSE
1187	M14Q1	7.3	7.3	1231.2	4.3	0	0.855	0.855	0.02	4.3	FALSE	FALSE
1189	M14M4	8	8	4104	4.3	0.57	2.85	3.42	0.05	4.3	FALSE	FALSE
1191	M14R1	7.5	7.5	410.4	4.4	0	0.285	0.285	0.02	4.4	FALSE	FALSE
1193	M14M5	9.1	9.1	410.4	5.7	0	0.285	0.285	0.01	5.7	FALSE	FALSE
1195	M14A8	6.7	6.7	2462.4	-0.6	27.93	1.71	29.64	0.43	-0.2	FALSE	FALSE
1197	M14A9	8	8	2052	0.4	26.51	1.425	27.93	0.13	0.5	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1199	M14Y1	7.8	7.8	410.4	4.8	0	0.285	0.285	0.01	4.8	FALSE	FALSE
1201	M14S1	5.3	5.3	10670.4	1	16.96	7.41	24.368	0.11	1.1	FALSE	FALSE
1203	M14X1	6.4	6.4	2052	2	0.713	1.425	2.1375	0.04	2	FALSE	FALSE
1205	M14X2	7.3	7.3	1026	3.3	0	0.713	0.7125	0.02	3.3	FALSE	FALSE
1207	M14S2	5.7	5.7	2872.8	2.1	12.83	1.995	14.82	0.1	2.1	FALSE	FALSE
1209	M14S3	6	6	5335.2	2.9	7.41	3.705	11.115	0.08	2.9	FALSE	FALSE
1211	M14V1	7.6	7.6	820.8	3.9	0	0.57	0.57	0.02	3.9	FALSE	FALSE
1213	M14S4	7.7	7.7	5335.2	3.7	3.135	3.705	6.84	0.07	3.8	FALSE	FALSE
1215	M14W1	7.2	7.2	410.4	4.2	0	0.285	0.285	0.02	4.2	FALSE	FALSE
1217	M14S5	8	8	3693.6	4.7	0.285	2.565	2.85	0.04	4.7	FALSE	FALSE
1219	M14T1	6.3	6.3	1641.6	3.1	0.57	1.14	1.71	0.03	3.1	FALSE	FALSE
1221	M14U1	5.9	5.9	410.4	3.5	0	0.285	0.285	0.02	3.5	FALSE	FALSE
1223	M14T2	6.6	6.6	410.4	3.4	0	0.285	0.285	0.02	3.4	FALSE	FALSE
1225	M14S6	8.8	8.8	410.4	5.8	0	0.285	0.285	0.01	5.8	FALSE	FALSE
1227	M14A10	8.2	8.2	11491.2	1.2	18.24	7.98	26.22	0.12	1.3	FALSE	FALSE
1229	M14A11	8.3	8.3	6976.8	2	4.845	4.845	9.69	0.07	2.1	FALSE	FALSE
1231	M14BB1	8.4	8.4	2462.4	3.3	1.71	1.71	3.42	0.05	3.3	FALSE	FALSE
1233	M14BB2	8.4	8.4	2052	4.2	0.285	1.425	1.71	0.03	4.3	FALSE	FALSE
1235	M14AA1	8.6	8.6	4104	3.9	0.57	2.85	3.42	0.04	4	FALSE	FALSE
1237	M14AA2	8.4	8.4	820.8	4.8	0	0.57	0.57	0.02	4.8	FALSE	FALSE
1239	M14A12	8.9	8.9	1231.2	3.5	0.57	0.855	1.425	0.03	3.6	FALSE	FALSE
1241	M14A13	9	9	820.8	5	0	0.57	0.57	0.02	5	FALSE	FALSE
1243	M14BB3	8.4	8.4	410.4	5.2	0	0.285	0.285	0.02	5.2	FALSE	FALSE
1245	M14Z1	8.4	8.4	6566.4	4.2	0.57	4.56	5.13	0.05	4.2	FALSE	FALSE
1247	M14Z2	8.4	8.4	820.8	5.5	0	0.57	0.57	0.02	5.5	FALSE	FALSE
1269	M22A1	5	5	39480	-1.4	197.1	27.42	224.49	0.29	-1.1	FALSE	FALSE
1270	M22F1	4.7	4.7	0	-1.8	0	0	0	1.26	-0.5	FALSE	FALSE
1274	M22A2	4.8	4.8	20412	-0.8	182.9	14.18	197.08	0.34	-0.4	FALSE	FALSE
1276	M22B1	6.2	6.2	3628.8	1.2	0.945	2.52	3.465	0.04	1.2	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1278	M22B2	5.6	5.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
1280	M22E1	5.3	5.3	453.6	2.6	0	0.315	0.315	0.01	2.6	FALSE	FALSE
1282	M22A3	5.2	5.2	24494.4	0.9	162.4	17.01	179.44	0.3	1.2	FALSE	FALSE
1284	M22A5	5.4	5.4	4536	2.2	0	3.15	3.15	0.04	2.2	FALSE	FALSE
1287	M26A1	5.4	5.4	5443.2	0	0.63	3.78	4.41	-0.03	0	FALSE	FALSE
1305	M14C9	7.3	7.3	53352	1.7	34.2	37.05	71.25	0.33	2.1	FALSE	FALSE
1307	M14C10	7.6	7.6	10260	2.6	7.125	7.125	14.25	0.08	2.6	FALSE	FALSE
1309	M14C11	8.2	8.2	10260	3.1	0	7.125	7.125	0.06	3.2	FALSE	FALSE
1311	M14G1	8	8	16416	2.4	8.55	11.4	19.95	0.1	2.5	FALSE	FALSE
1313	M14G2	8.2	8.2	12312	3.3	0	8.55	8.55	0.06	3.3	FALSE	FALSE
1315	M17Q5	7.6	7.6	4104	5.3	0	2.85	2.85	0.04	5.3	FALSE	FALSE
1316	M17Q4	7.2	7.2	32832	4.1	2.85	22.8	25.65	0.12	4.2	FALSE	FALSE
1318	M17Q3	7.2	7.2	16416	3.3	25.65	11.4	37.05	0.13	3.4	FALSE	FALSE
1325	M40A1	8	8	0	-0.6	90.53	0	90.528	0.21	-0.4	FALSE	FALSE
1326	M40A2	7.9	7.9	0	0.3	88.08	0	88.078	0.1	0.4	FALSE	FALSE
1328	M40A3	8.4	8.4	0	1.5	88.08	0	88.078	0.1	1.6	FALSE	FALSE
1330	M40A4	7.5	7.5	0	2.7	88.08	0	88.078	0.2	2.9	FALSE	FALSE
1347	M34U1	5.1	5.1	15807.75	2.6	0	10.98	10.978	0.08	2.7	FALSE	FALSE
1348	M34L1	4.7	4.7	3250.8	1.6	15.8	2.258	18.058	0.1	1.7	FALSE	FALSE
1350	M34A8	4.6	4.6	5292	0	236	3.675	239.64	0.58	0.6	FALSE	FALSE
1354	M16A5	5.8	5.8	0	0.6	31.71	0	31.711	0.14	0.7	FALSE	FALSE
1355	M16A6	5.4	5.4	22680	1.1	15.96	15.75	31.711	0.12	1.2	FALSE	FALSE
1357	M16A7	6.2	6.2	6200.88	2.8	4.568	4.306	8.8737	0.06	2.8	FALSE	FALSE
1359	M16A8	6.1	6.1	0	3.5	4.568	0	4.5675	0.05	3.6	FALSE	FALSE
1361	M16A9	7	7	5443.2	3.9	0.788	3.78	4.5675	0.04	4	FALSE	FALSE
1363	M16A10	6.9	6.9	1134	5.1	0	0.788	0.7875	0.02	5.1	FALSE	FALSE
1365	M16G1	4.2	4.2	7257.6	2.5	2.048	5.04	7.0875	0.06	2.5	FALSE	FALSE
1367	M16G2	5.5	5.5	2948.4	3.4	0	2.048	2.0475	0.04	3.5	FALSE	FALSE
1369	M37A4	5.5	5.5	1503.6	-0.4	43.66	1.044	44.699	0.14	-0.3	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1370	M37A3	5.4	5.4	4510.8	-1.6	44.7	3.133	47.831	0.15	-1.5	FALSE	FALSE
1372	M37A2	5.3	5.3	9021.6	-2.8	49.92	6.265	56.185	0.16	-2.6	FALSE	FALSE
1374	M37B1	4.8	4.8	3007.2	-1.7	0	2.088	2.0883	0.03	-1.7	FALSE	FALSE
1376	M37A1	5.7	5.7	0	-3.2	69.76	0	69.759	0.16	-3	FALSE	FALSE
1378	M37C1	6	6	9021.6	-2.6	7.309	6.265	13.574	0.08	-2.6	FALSE	FALSE
1380	M37E1	5.3	5.3	3007.2	-1.6	0	2.088	2.0883	0.03	-1.6	FALSE	FALSE
1382	M37C2	6.3	6.3	4510.8	-1.4	2.088	3.133	5.2208	0.05	-1.3	FALSE	FALSE
1384	M37C3	5.1	5.1	1503.6	-0.4	0	1.044	1.0442	0.02	-0.4	FALSE	FALSE
1393	M17B1	8.8	8.8	0	2.2	136.8	0	136.8	0.24	2.4	FALSE	FALSE
1395	M17B2	9	9	0	2.6	136.8	0	136.8	0.26	2.8	FALSE	FALSE
1397	M17B3	8	8	32832	3.4	114	22.8	136.8	0.26	3.7	FALSE	FALSE
1399	M17C1	7.7	7.7	16416	3.7	0	11.4	11.4	0.07	3.8	FALSE	FALSE
1401	M17B4	8.1	8.1	0	4	102.6	0	102.6	0.44	4.5	FALSE	FALSE
1403	M17B5	9.7	9.7	16416	4.7	91.2	11.4	102.6	0.22	4.9	FALSE	FALSE
1405	M17I1	8.1	8.1	16416	4.9	0	11.4	11.4	0.07	5	FALSE	FALSE
1407	M17B6	7.7	7.7	16416	5.6	68.4	11.4	79.8	0.19	5.8	FALSE	FALSE
1409	M17D1	8.1	8.1	16416	6.2	0	11.4	11.4	0.07	6.3	FALSE	FALSE
1411	M17B7	8.1	8.1	16416	6.1	45.6	11.4	57	-0.27	5.9	FALSE	FALSE
1413	M17B9	7.6	7.6	16416	6.5	34.2	11.4	45.6	0.15	6.7	FALSE	FALSE
1415	M17E1	8.6	8.6	16416	7	0	11.4	11.4	0.07	7.1	FALSE	FALSE
1417	M17B10	10.2	10.2	16416	7	11.4	11.4	22.8	0.11	7.1	FALSE	FALSE
1419	M17B11	10.3	10.3	16416	7.8	0	11.4	11.4	0.07	7.8	FALSE	FALSE
1421	M34E1	5.1	5.1	0	-0.9	2.042	0	2.0417	0.03	-0.9	FALSE	FALSE
1424	M32A1	5.8	5.8	0	-1.2	59.74	0	59.743	0.17	-1	FALSE	FALSE
1426	M32C1	5.7	5.7	0	0	13.81	0	13.805	-0.31	-0.3	FALSE	FALSE
1430	M32A2	7.2	7.2	21413.28	0.8	31.07	14.87	45.938	0.15	0.9	FALSE	FALSE
1432	M32A3	5.6	5.6	12285	1.1	22.54	8.531	31.068	0.12	1.3	FALSE	FALSE
1434	M32A4	5.3	5.3	23784.18	1.9	0	16.52	16.517	0.09	2	FALSE	FALSE
1436	M32D1	4.8	4.8	8668.8	1.4	0	6.02	6.02	0.06	1.4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1440	M31A4	5.5	5.5	22378.02	0.4	0	15.54	15.54	0.11	0.5	FALSE	FALSE
1441	M31A3	7.4	7.4	26877.48	-0.1	15.54	18.67	34.205	0.13	0.1	FALSE	FALSE
1443	M31A2	7.7	7.7	28061.88	-2.3	34.21	19.49	53.693	0.16	-2.1	FALSE	FALSE
1445	M31A1	6.2	6.2	56089.32	-4	86.48	38.95	125.43	0.24	-3.7	FALSE	FALSE
1446	M31B1	5.8	5.8	13608	-0.4	23.34	9.45	32.788	0.12	-0.3	FALSE	FALSE
1449	M31B2	6.3	6.3	8022	0.8	17.77	5.571	23.338	0.1	0.9	FALSE	FALSE
1451	M31B4	4.3	4.3	11116.56	3.4	0	7.72	7.7198	0.06	3.5	FALSE	FALSE
1455	M34A13	4.7	4.7	378	2.1	6.3	0.263	6.5625	0.07	2.2	FALSE	FALSE
1456	M34A11	4.4	4.4	0	1.5	213.1	0	213.13	0.41	1.9	FALSE	FALSE
1458	M34A10	4.4	4.4	756	0.8	213.1	0.525	213.65	0.42	1.2	FALSE	FALSE
1461	M34A12	4.5	4.5	756	1.7	7.088	0.525	7.6125	0.27	1.9	FALSE	FALSE
1497	M18A-B1	5.3	5.3	2721.6	0.9	0	1.89	1.89	0.03	0.9	FALSE	FALSE
1499	M18A-A4	5.5	5.5	2268	0.2	67.5	1.575	69.074	0.55	0.7	FALSE	FALSE
1501	M18A-A5	5.3	5.3	8164.8	0.7	61.83	5.67	67.499	0.19	0.9	FALSE	FALSE
1503	M18A-C1	8.2	8.2	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	FALSE
1505	M18A-A6	5.4	5.4	1360.8	1.2	60.25	0.945	61.199	0.17	1.4	FALSE	FALSE
1507	M18A-D1	9.2	9.2	6350.4	2.5	0	4.41	4.41	0.05	2.5	FALSE	FALSE
1509	M18A-A7	7.7	7.7	1360.8	1.7	54.9	0.945	55.844	0.16	1.9	FALSE	FALSE
1511	M18A-A8	8.3	8.3	2268	2.1	53.32	1.575	54.899	0.16	2.3	FALSE	FALSE
1513	M46A1	4.9	4.9	(N/A)	0.8	(N/A)	(N/A)	(N/A)	(N/A)	(N/A)	FALSE	FALSE
1519	M34C1	6.5	6.5	11550	-1	26.4	8.021	34.417	0.11	-0.9	FALSE	FALSE
1521	M34C2	7.1	7.1	0	-0.3	26.4	0	26.396	0.11	-0.2	FALSE	FALSE
1523	M34C3	7.2	7.2	5460	1.7	22.6	3.792	26.396	0.11	1.8	FALSE	FALSE
1525	M34C4	7.6	7.6	2310	2.9	21	1.604	22.604	0.1	3	FALSE	FALSE
1527	M34C5	8.5	8.5	30240	4.1	0	21	21	0.1	4.2	FALSE	FALSE
1529	M34D2	5.5	5.5	12640.25	3.6	0	8.778	8.778	0.06	3.6	FALSE	FALSE
1530	M34D1	5.7	5.7	0	2.9	8.778	0	8.778	0.06	3	FALSE	FALSE
1532	M34B1	5.8	5.8	8050	1.7	19.21	5.59	24.795	0.11	1.8	FALSE	FALSE
1534	M34B2	6.7	6.7	0	2.3	10.43	0	10.427	0.07	2.3	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1536	M34B3	5.7	5.7	2520	2.9	8.677	1.75	10.427	0.07	3	FALSE	FALSE
1538	M34B4	5.3	5.3	10220	3.5	1.58	7.097	8.6771	0.06	3.6	FALSE	FALSE
1540	M34B5	6	6	2275	4.3	0	1.58	1.5799	0.03	4.3	FALSE	FALSE
1550	M17F1	9.1	9.1	32832	2.8	49.78	22.8	72.577	0.2	3	FALSE	FALSE
1552	M17F2	8.9	8.9	0	3.9	49.78	0	49.777	0.17	4.1	FALSE	FALSE
1554	M17F3	10.9	10.9	70178.4	4	1.042	48.74	49.777	0.15	4.2	FALSE	FALSE
1556	M17F4	10	10	1500	5.2	0	1.042	1.0417	0.03	5.2	FALSE	FALSE
1560	M14H1	5.6	5.6	8208	3	17.1	5.7	22.8	0.46	3.4	FALSE	FALSE
1562	M14H2	5.6	5.6	0	3.4	17.1	0	17.1	0.1	3.5	FALSE	FALSE
1564	M14H3	5.6	5.6	4104	3.8	14.25	2.85	17.1	0.09	3.9	FALSE	FALSE
1566	M14H4	5.9	5.9	12312	4.2	5.7	8.55	14.25	0.09	4.3	FALSE	FALSE
1568	M14H5	5.7	5.7	8208	5.2	0	5.7	5.7	0.06	5.3	FALSE	FALSE
1579	M16B1	6.4	6.4	4116	-2	32.05	2.858	34.912	0.11	-1.9	FALSE	FALSE
1581	M16B2	6	6	8232	-1.7	17.18	5.717	22.896	0.12	-1.5	FALSE	FALSE
1583	M16A2	6	6	0	-2.6	95.48	0	95.475	0.19	-2.4	FALSE	FALSE
1585	M16A3	5.4	5.4	11655	-1.4	87.38	8.094	95.475	0.21	-1.2	FALSE	FALSE
1587	M16D1	6.1	6.1	24347.4	-0.1	7.554	16.91	24.462	0.12	0	FALSE	FALSE
1589	M16D2	4.8	4.8	10878	2	0	7.554	7.5542	0.06	2.1	FALSE	FALSE
1591	M16A4	4.1	4.1	44940	-0.3	31.71	31.21	62.92	0.15	-0.1	FALSE	FALSE
1599	M38D2	8	8	8750.7	0.7	0	6.077	6.0769	0.06	0.7	FALSE	FALSE
1600	M38D1	5.7	5.7	8750.7	0.1	6.077	6.077	12.154	0.07	0.2	FALSE	FALSE
1602	M38A6	6	6	8750.7	-1.1	13.87	6.077	19.946	0.1	-1	FALSE	FALSE
1604	M17O1	6.9	6.9	32832	1.7	34.2	22.8	57	0.16	1.8	FALSE	FALSE
1609	M3D2	6.3	6.3	3283.2	0.6	8.835	2.28	11.115	0.09	0.7	FALSE	FALSE
1611	M3D1	6.4	6.4	2872.8	-0.2	11.12	1.995	13.11	0.1	-0.1	FALSE	FALSE
1614	M3F1	6.6	6.6	4514.4	-0.4	136	3.135	139.17	0.29	-0.1	FALSE	FALSE
1616	M3F2	6	6	4514.4	1.5	132.9	3.135	136.04	0.29	1.8	FALSE	FALSE
1680	M19A2	5.2	5.2	0	1.5	0	0	0	0	1.5	FALSE	FALSE
1681	M19A1	5.4	5.4	0	1	0	0	0	0	1	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1695	M38A5	4.9	4.9	18901.68	-2.1	19.95	13.13	33.072	0.12	-2	FALSE	FALSE
1697	M38A4	5	5	18901.68	-3.8	33.07	13.13	46.198	0.15	-3.7	FALSE	FALSE
1701	M38A3	5.1	5.1	18901.68	-5.5	46.2	13.13	59.324	0.18	-5.4	FALSE	FALSE
1703	M38A2	6.6	6.6	38973.06	-7.2	100.3	27.07	127.39	0.25	-7	FALSE	FALSE
1705	M38C1	7	7	38973.06	-0.7	13.94	27.07	41.003	0.14	-0.6	FALSE	FALSE
1709	M38A1	6.1	6.1	20090.99	-8.9	168.3	13.95	182.2	0.3	-8.6	FALSE	FALSE
1711	M38B1	6.5	6.5	19609.59	-1.6	27.24	13.62	40.853	0.14	-1.4	FALSE	FALSE
1713	M38B2	7.1	7.1	19609.59	0.1	13.62	13.62	27.236	0.11	0.2	FALSE	FALSE
1717	M16A1	5.9	5.9	15456	-2.8	138.3	10.73	149	0.27	-2.5	FALSE	FALSE
1726	M16H1	6.4	6.4	4998	-1.9	2.829	3.471	6.3	0.06	-1.8	FALSE	FALSE
1727	M16F1	5.3	5.3	4116	3	0	2.858	2.8583	0.04	3	FALSE	FALSE
1729	M16B4	7.2	7.2	8988	5	0	6.242	6.2417	0.05	5	FALSE	FALSE
1731	M16B3	7.2	7.2	11634	-1.5	6.242	8.079	14.321	0.08	-1.4	FALSE	FALSE
1732	M16E1	5.3	5.3	4116	3	0	2.858	2.8583	0.04	3	FALSE	FALSE
1735	M16H2	6.7	6.7	4074	4.2	0	2.829	2.8292	0.03	4.2	FALSE	FALSE
1751	M31B3	5.4	5.4	14468.16	1.7	7.72	10.05	17.767	0.09	1.7	FALSE	FALSE
1755	M30A9	4.1	4.1	0	3.8	0.63	0	0.63	0.02	3.8	FALSE	FALSE
1756	M30A8	4.4	4.4	453.6	3.1	0.63	0.315	0.945	0.03	3.1	FALSE	FALSE
1757	M30A6	3.3	3.3	0	2.7	1.26	0	1.26	0.03	2.7	FALSE	FALSE
1758	M30K1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1759	M30A5	3.8	3.8	2721.6	2.2	2.52	1.89	4.41	0.05	2.2	FALSE	FALSE
1760	M30J1	4	4	907.2	3.5	0	0.63	0.63	0.02	3.5	FALSE	FALSE
1761	M30A4	3.6	3.6	2721.6	1.4	5.67	1.89	7.56	0.07	1.5	FALSE	FALSE
1762	M30I1	3.4	3.4	907.2	2	0	0.63	0.63	0.02	2	FALSE	FALSE
1763	M30H1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1764	M30A3	3.7	3.7	1814.4	0.6	8.505	1.26	9.765	0.07	0.6	FALSE	FALSE
1767	M30A1	3.5	3.5	1814.4	-0.9	28.35	1.26	29.61	0.12	-0.8	FALSE	FALSE
1836	M29A1	4.5	4.5	1814.4	-1.6	23	1.26	24.255	0.09	-1.5	FALSE	FALSE
3102	M34G1	5.2	5.2	68390	3.8	0	47.49	47.493	0.16	4	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3105	M34O1	5.3	5.3	1814.4	2.9	0.63	1.26	1.89	0.03	2.9	FALSE	FALSE
3107	M34O2	5	5	907.2	3.3	0	0.63	0.63	0.02	3.3	FALSE	FALSE
3112	M29A2	4.5	4.5	8164.8	-0.7	8.505	5.67	14.175	0.08	-0.6	FALSE	FALSE
3118	M29E1	5.4	5.4	907.2	4	0	0.63	0.63	0.02	4	FALSE	FALSE
3120	M29B1	4.2	4.2	3628.8	-1	5.67	2.52	8.19	0.07	-0.9	FALSE	FALSE
3122	M29F1	4.6	4.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
3125	M29B2	4.5	4.5	4989.6	0	1.575	3.465	5.04	0.05	0.1	FALSE	FALSE
3127	M29B4	4.6	4.6	453.6	2.5	0	0.315	0.315	0.01	2.5	FALSE	FALSE
3129	M29G1	4.5	4.5	0	2.5	0	0	0	0	2.5	FALSE	FALSE
3131	M29C1	5	5	0	2	0.63	0	0.63	0.02	2	FALSE	FALSE
3133	M29C2	5.1	5.1	907.2	3	0	0.63	0.63	0.02	3	FALSE	FALSE
3135	M34L2	4.3	4.3	1360.8	2.3	3.878	0.945	4.8225	0.05	2.4	FALSE	FALSE
3137	M34M1	4.4	4.4	378	2.8	0.525	0.263	0.7875	0.02	2.9	FALSE	FALSE
3139	M34M2	4.8	4.8	378	3.8	0	0.263	0.2625	0.01	3.8	FALSE	FALSE
3141	M34N1	4.5	4.5	378	3.5	0	0.263	0.2625	0.01	3.5	FALSE	FALSE
3143	M34L3	4.2	4.2	3693.6	2.9	0.525	2.565	3.09	0.04	2.9	FALSE	FALSE
3145	M34L4	4.4	4.4	756	3.9	0	0.525	0.525	0.02	3.9	FALSE	FALSE
3147	M34A16	5	5	378	4.9	0	0.263	0.2625	0.01	4.9	FALSE	FALSE
3148	M34A14	4.3	4.3	4158	2.3	2.888	2.888	5.775	0.06	2.3	FALSE	FALSE
3152	M34T1	4	4	378	3.5	0	0.263	0.2625	0.01	3.5	FALSE	FALSE
3155	M30A10	4.6	4.6	453.6	4	0.315	0.315	0.63	0.02	4	FALSE	FALSE
3165	M30A11	4.6	4.6	453.6	4.4	0	0.315	0.315	0.02	4.4	FALSE	FALSE
3168	M30C2	4	4	453.6	1.3	0	0.315	0.315	0.02	1.3	FALSE	FALSE
3170	M30C1	4	4	2268	-0.5	0.315	1.575	1.89	0.03	-0.5	FALSE	FALSE
3174	M30B1	3.2	3.2	1360.8	-0.5	12.6	0.945	13.545	0.08	-0.4	FALSE	FALSE
3176	M30B4	4	4	0	1.7	4.095	0	4.095	0.05	1.8	FALSE	FALSE
3178	M30B5	4.8	4.8	453.6	2.2	3.78	0.315	4.095	0.05	2.3	FALSE	FALSE
3180	M30B6	4.9	4.9	4536	2.7	0.63	3.15	3.78	0.05	2.7	FALSE	FALSE
3182	M30B7	4.1	4.1	453.6	3.6	0	0.315	0.315	0.01	3.6	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3184	M30M1	4.6	4.6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
3186	M30B2	2.8	2.8	3628.8	0	10.08	2.52	12.6	0.08	0.1	FALSE	FALSE
3189	M30E1	3	3	2721.6	1.5	0	1.89	1.89	0.03	1.5	FALSE	FALSE
3191	M30B3	2.8	2.8	3175.2	1	5.985	2.205	8.19	0.07	1.1	FALSE	FALSE
3194	M30F1	2.6	2.6	2721.6	1.8	0	1.89	1.89	0.04	1.8	FALSE	FALSE
3243	M18C9	5.3	5.3	453.6	3.4	75.33	0.315	75.649	0.19	3.6	FALSE	FALSE
3246	M18C2	5.5	5.5	10432.8	3	76.59	7.245	83.839	0.19	3.2	FALSE	FALSE
3276	M18C1	5.4	5.4	11793.6	2.5	83.84	8.19	92.029	0.21	2.7	FALSE	FALSE
3304	M24D1	7.9	7.9	3628.8	-0.9	1.26	2.52	3.78	0.06	-0.8	FALSE	FALSE
3319	M24A2	5.4	5.4	1814.4	-1	0.63	1.26	1.89	0.11	-0.9	FALSE	FALSE
3328	M25A1	4.6	4.6	5443.2	-1	44.47	3.78	48.252	0.13	-0.8	FALSE	FALSE
3330	M25C1	5.6	5.6	5896.8	0.6	1.26	4.095	5.355	0.05	0.7	FALSE	FALSE
3346	M25A4	4.6	4.6	4536	1	13.98	3.15	17.127	0.09	1.1	FALSE	FALSE
3348	M25A2	5.6	5.6	8618.4	-0.4	23.11	5.985	29.097	0.13	-0.3	FALSE	FALSE
3357	M25B1	5.3	5.3	5896.8	0.3	10.02	4.095	14.115	0.08	0.3	FALSE	FALSE
3364	M7C1	8	8	7344	-0.9	104.5	5.1	109.59	0.23	-0.7	FALSE	FALSE
3377	M7C3	8.3	8.3	9936	0.7	84.46	6.9	91.361	0.21	0.9	FALSE	FALSE
3383	M25B2	5.4	5.4	9979.2	0.9	1.83	6.93	8.76	0.08	1	FALSE	FALSE
3389	M25A5	4	4	453.6	1.5	13.35	0.315	13.662	0.08	1.6	FALSE	FALSE
3391	M25A6	4.6	4.6	18765.6	1.9	0.315	13.03	13.347	0.08	2	FALSE	FALSE
3397	M25K1	4.2	4.2	453.6	2.4	0	0.315	0.315	0.01	2.4	FALSE	FALSE
3406	M18E3	7	7	907.2	1.3	0	0.63	0.63	0.02	1.3	FALSE	FALSE
3422	M1C2	6.7	6.7	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
3423	M1C1	6.4	6.4	5184	2	0.3	3.6	3.9	0.04	2	FALSE	FALSE
3509	M35A1	6	6	0	-1.3	452.8	0	452.83	0.5	-0.8	FALSE	FALSE
3511	M35A2	6.7	6.7	9904.23	-0.1	83.01	6.878	89.89	0.21	0.1	FALSE	FALSE
3513	M35A3	6.7	6.7	24740.52	1.5	65.83	17.18	83.012	0.2	1.7	FALSE	FALSE
3515	M35D1	6	6	49581.63	2	0	34.43	34.432	0.13	2.1	FALSE	FALSE
3642	M18A-A1	5.1	5.1	0	-1	76	0	76.004	0.17	-0.8	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3682	M22A4	5.5	5.5	0	1.6	162.4	0	162.43	0.33	1.9	FALSE	FALSE
3901	M13A1	5.5	5.5	7194.6	3.2	3.334	4.996	8.33	0.06	3.3	FALSE	FALSE
3947	M10A1	9.3	9.3	2898	5.5	0.467	2.013	2.4792	0.04	5.5	FALSE	FALSE
3949	M29A3	4.6	4.6	7711.2	0.2	2.52	5.355	7.875	0.06	0.2	FALSE	FALSE
3982	M38D3	6.5	6.5	0	1.1	0	0	0	0	1.1	FALSE	FALSE
3989	M35A4	6.8	6.8	17653.86	2.7	19.14	12.26	31.4	0.12	2.8	FALSE	FALSE
4007	M9A1	6.9	6.9	71442	-0.3	66.94	49.61	116.55	0.24	-0.1	FALSE	FALSE
4011	M9B1	5.8	5.8	34020	0.5	23.63	23.63	47.25	0.15	0.6	FALSE	FALSE
4017	M5D1	6	6	0	-1	10.71	0	10.71	0.07	-1	FALSE	FALSE
4019	M5D2	6.2	6.2	4082.4	-0.8	7.875	2.835	10.71	0.08	-0.8	FALSE	FALSE
4022	M5A1	6.4	6.4	3175.2	-2.9	43.97	2.205	46.17	0.16	-2.8	FALSE	FALSE
4024	M4A2	7.5	7.5	0	0.3	22.37	0	22.365	0.11	0.4	FALSE	FALSE
4027	M3B1	5.7	5.7	1641.6	1.9	2.565	1.14	3.705	0.05	1.9	FALSE	FALSE
4029	M3B2	5.8	5.8	1231.2	2.8	1.425	0.855	2.28	0.04	2.9	FALSE	FALSE
4031	M3B3	5.5	5.5	410.4	3.3	1.14	0.285	1.425	0.03	3.3	FALSE	FALSE
4033	M3B4	5.4	5.4	1231.2	3.6	0.285	0.855	1.14	0.03	3.6	FALSE	FALSE
4041	M2H1	5.5	5.5	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	FALSE
4049	M2R3	5.9	5.9	2592	3.7	0.6	1.8	2.4	0.04	3.8	FALSE	FALSE
4056	M2T1	5.9	5.9	3024	2.3	0.6	2.1	2.7	0.04	2.3	FALSE	FALSE
4062	M2P1	6	6	4320	0	12.3	3	15.3	0.09	0.1	FALSE	FALSE
4065	M2P2	6.1	6.1	5184	0.5	0.6	3.6	4.2	0.05	0.6	FALSE	FALSE
4071	M2J2	6.4	6.4	432	1	0.6	0.3	0.9	0.02	1	FALSE	FALSE
4079	M1A3	6.4	6.4	2160	-0.1	198	1.5	199.5	0.34	0.3	FALSE	FALSE
4082	M1O1	5.5	5.5	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4090	M1Q1	5.4	5.4	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4097	M1HH1	5.6	5.6	2592	3.5	0.6	1.8	2.4	0.04	3.5	FALSE	FALSE
4103	M1BB1	6.3	6.3	0	2.4	3.6	0	3.6	0.04	2.4	FALSE	FALSE
4106	M1KK1	6.8	6.8	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
4111	M1BB3	5.9	5.9	432	3.9	0.3	0.3	0.6	0.02	3.9	FALSE	FALSE

Model Manhole Data Table 2025 Existing Conditions
Exhibit D2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4115	M1CC1	6.3	6.3	432	3.5	0.6	0.3	0.9	0.02	3.5	FALSE	FALSE
4121	M1EE1	6.2	6.2	432	2.9	0.6	0.3	0.9	0.02	2.9	FALSE	FALSE
4127	M1A8	6.4	6.4	1296	1.9	186.9	0.9	187.8	0.29	2.2	FALSE	FALSE
4148	M1U2	5.8	5.8	432	3.6	0.3	0.3	0.6	0.02	3.6	FALSE	FALSE
4152	M1V1	6.4	6.4	864	3	0.6	0.6	1.2	0.03	3	FALSE	FALSE
4158	M1S1	6.2	6.2	0	1.8	3	0	3	0.04	1.8	FALSE	FALSE
4161	M1S2	5.7	5.7	864	2.5	0.6	0.6	1.2	0.03	2.5	FALSE	FALSE
4168	M1M1	5.3	5.3	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4174	M1K1	5.1	5.1	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4180	M1D1	7	7	3024	-0.2	19.5	2.1	21.6	0.11	-0.1	FALSE	FALSE
4183	M1D3	6.4	6.4	432	3	0.3	0.3	0.6	0.02	3	FALSE	FALSE
4196	M34A15	4	4	3402	3.3	0.263	2.363	2.625	0.04	3.3	FALSE	FALSE
4199	M29A4	4.7	4.7	2268	1.1	0.315	1.575	1.89	0.03	1.1	FALSE	FALSE
4203	M29B3	4.6	4.6	1814.4	2	0.315	1.26	1.575	0.03	2	FALSE	FALSE
4206	M30A7	3.7	3.7	0	2.8	1.26	0	1.26	0.03	2.8	FALSE	FALSE
4217	M25A3	4.2	4.2	0	0.2	17.13	0	17.127	0.09	0.3	FALSE	FALSE
4239	M7C2	8.6	8.6	14580	-0.1	92.86	10.13	102.99	0.24	0.1	FALSE	FALSE
4268	M14F3	8.3	8.3	12312	3	0	8.55	8.55	0.07	3.1	FALSE	FALSE
4280	M17A4	9.5	9.5	0	-6.3	405.5	0	405.47	0.59	-5.8	FALSE	FALSE
4283	M17A5	8.4	8.4	0	-5.7	405.5	0	405.47	0.52	-5.2	FALSE	FALSE
4314	M18D1	5.2	5.2	1360.8	3.2	0	0.945	0.945	0.03	3.2	FALSE	FALSE
4384	M32B1	6.3	6.3	13356	2	8.699	9.275	17.974	0.08	2.1	FALSE	FALSE
4416	M30A2	3.6	3.6	1814.4	-0.2	11.66	1.26	12.915	0.08	-0.1	FALSE	FALSE
4452	M38A7	6.3	6.3	0	-0.5	1.715	0	1.715	0.03	-0.5	FALSE	FALSE
4476	M4A1	7.5	7.5	17628	0.1	32.29	12.24	44.529	0.16	0.3	FALSE	FALSE

EXHIBIT D.3
FORCE MAIN DATA TABLE REPORT

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3880	O1L42FB2	PMP-42a	O1L42J1		25	6.4	2	0.013	111.61	111.61	11.4	10	114%	6.74
3494	O2L19FB2	PMP-19B	O1L34J2	Steel	342	8.2	8	0.013	1747.5	1747.5	11.15	10	112%	28.55
3495	O2L19F2	O1L34J2	O2L19J1	Steel	49	6.8	8	0.013	1747.5	1747.5	11.15	10	112%	4.09
3508	O2L19F1	O2L19J1	O2L34J2	Ductile Iron		20.7	8	0.012	1747.5	1747.5	11.15	10	112%	1.06
3489	O2L34F1	O1L34J1	O-2	Ductile Iron		17.4	12	0.012	3723.9	3723.9	10.56	10	106%	0.5
3507	O2L34F2	O2L34J2	O1L34J1	Ductile Iron		23.9	12	0.012	3552.1	3552.1	10.08	10	101%	0.63
1744	O2L31FA2	PMP-31A	O2L31J2	Steel	77	8	3	0.013	201.26	201.26	9.13	10	91%	26.91
3919	O2L45FA2	PMP-45a	O2L45J2	PVC	25	7.6	2	0.01	86.238	86.238	8.81	10	88%	4.18
3921	O2L45F2	O2L45J1	O2L45J2	PVC		39.6	2	0.01	-86.238	-86.238	8.81	10	88%	6.62
3720	O2L18A-F1	O2L18AJ1	M18C9	PVC		71.5	2	0.01	75.334	75.334	7.69	10	77%	9.31
3650	O2L36F2	O2L36J2	O2L36J1	Ductile Iron		585.8	8	0.013	1194.8	1194.8	7.63	10	76%	14.88
3652	O2L36F1	M34A1	O2L36J1	Ductile Iron		48	8	0.012	-1194.8	-1194.8	7.63	10	76%	1.22
527	O2L34FA2	PMP-34A	O2L34J6	Ductile Iron	154	11.3	8	0.012	1150.9	1150.9	7.35	10	74%	3.65
2455	O2L34F5	O2L34J5	O2L34J4	Ductile Iron		2007	8	0.012	1150.9	1150.9	7.35	10	74%	47.56
3624	O2L34F6	O2L34J6	O2L34J5	Ductile Iron		46.9	8	0.012	1150.9	1150.9	7.35	10	74%	1.11
1296	O2L26F1	O2L26J1	M22A4	PVC		142.1	3	0.01	159.28	159.28	7.23	10	72%	10.27
1792	O2L26FB2	PMP-26B	O2L26J1	Steel	79	10.1	3	0.013	159.28	159.28	7.23	10	72%	9.28
446	O2L6FA2	PMP-6A	O2L6J1		74	6.9	3	0.013	153.95	153.95	6.99	10	70%	5.02
3077	O2L16FA2	PMP-16A	O2L16J2	Ductile Iron	77	7.6	4	0.012	269.04	269.04	6.87	10	69%	10.94
3739	O2L16F2	O2L16J2	O2L16J1	PVC		363.9	4	0.01	269.04	269.04	6.87	10	69%	17.1
3811	O2L32F1	O2L32J1	M34A3	PVC		681.8	4	0.01	268.71	268.71	6.86	10	69%	31.97
474	O1L14FA1	PMP-14A	O1L14J3	Steel	134	7.5	6	0.013	547.15	547.15	6.21	10	62%	5.29
3606	O1L14FA2	W-14	PMP-14A	Ductile Iron	44	7.8	6	0.012	547.15	547.15	6.21	10	62%	1.07
4399	O2L47F2	O2L47J2	O2L47J1	PVC		13.6	2	0.01	56.842	56.842	5.8	10	58%	1.05
4410	O2L47FB1	PMP-47B	O2L47J2	PVC	40	7.3	2	0.01	56.842	56.842	5.8	10	58%	3.09
3942	O2L33F2	O2L33J2	O2L33J1	PVC		32.6	2	0.01	56.531	56.531	5.77	10	58%	2.49
3944	O2L33FA2	PMP-33A	O2L33J2	Steel	70	5.9	2	0.013	56.531	56.531	5.77	10	58%	8.7
3821	O2L7FA2	PMP-7A	O2L7J2	Ductile Iron	104	7.6	4	0.012	213.42	213.42	5.45	10	55%	3.18
3825	O2L7F2	O2L7J2	O2L7J1	PVC		31.1	4	0.01	213.42	213.42	5.45	10	55%	0.95

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3927	O2L46FA2	PMP-46a	O2L46J1	PVC	25	6.3	2	0.01	53.324	53.324	5.45	10	55%	1.72
3932	O2L46F1	O2L46J1	M18A-A8	PVC		213.3	2	0.01	53.324	53.324	5.45	10	55%	14.64
3587	O2L44F2	O1L44J2	O1L44J1	PVC		124.3	2	0.01	52.785	52.785	5.39	10	54%	8.37
3695	O2L44FA2	PMP-44a	O1L44J2	PVC	25	7.1	2	0.01	52.785	52.785	5.39	10	54%	1.68
217	O2L11F1	O2L11J1	O2L10J2	PVC		477.6	6	0.01	455.24	455.24	5.17	10	52%	8.25
477	O2L10F2	O2L10J2	O2L10J1	PVC		613.4	6	0.01	455.24	455.24	5.17	10	52%	10.59
3964	O2L10F1	O2L10J1	O2L36J3	Ductile Iron		287.1	6	0.012	455.24	455.24	5.17	10	52%	4.96
3664	O2L31F2	O2L31J2	O2L31J1	PVC		1088.2	4	0.01	201.26	201.26	5.14	10	51%	29.87
3506	O2L34F3	O2L34J3	O2L34J2	Ductile Iron		21.1	12	0.012	1804.6	1804.6	5.12	10	51%	0.16
3089	O2L29FA2	PMP-29A	O2L29J2	Steel	78	11.7	3	0.013	104.88	104.88	4.76	10	48%	7.74
3095	O2L29F2	O2L29J2	O2L29J1	PVC		12.7	3	0.01	104.88	104.88	4.76	10	48%	0.42
1691	O2L22A2	PMP-22A	O2L22J2	Steel	113	7.5	4	0.013	183.34	183.34	4.68	10	47%	4.24
3716	O2L22F1	O2L22J2	O2L22J1	PVC		973.6	4	0.013	183.34	183.34	4.68	10	47%	22.48
216	O2L12F1	O2L12J1	O2L11J1	PVC		333.4	6	0.01	409.22	409.22	4.64	10	46%	4.73
4402	O2L47F1	O2L47J1	M34A11	PVC		559.7	3	0.01	100.64	100.64	4.57	10	46%	17.28
3725	O2L18F4	O2L18J3	O2L18J2	Ductile Iron		170.7	3	0.012	97.859	97.859	4.44	10	44%	5.01
163	O2L18F1	O2L18J1	O2L36J2	Ductile Iron		130.4	8	0.012	689.45	689.45	4.4	10	44%	1.2
3730	O2L18F3	O2L18J2	O2L18J1	Cast iron		1013.7	8	0.012	689.45	689.45	4.4	10	44%	13.04
3527	O2L35FA2	PMP-35A	O2L35J2	Steel	90	6.9	4	0.013	171.8	171.8	4.39	10	44%	3
3529	O2L35F2	O2L35J2	O2L35J1	PVC		9.4	4	0.01	171.8	171.8	4.39	10	44%	0.19
3536	O2L35F1	O2L35J1	O1L34J1	PVC		2583.6	4	0.01	171.8	171.8	4.39	10	44%	52.9
3975	O1L43FA1	PMP-43a	O1L43J1	PVC	25	7.5	2	0.01	42.611	42.611	4.35	10	44%	1.13
3978	O1L43F1	O1L43J1	M37A4	PVC		533.5	2	0.01	42.611	42.611	4.35	10	44%	24.17
4470	O2L48F1	O2L48J1	M36I1	PVC		570.6	2	0.01	41.077	41.077	4.19	10	42%	24.15
1798	O1LS14F1	O1L14J1	O-1	PVC		10.5	10	0.01	1019.9	1019.9	4.17	10	42%	0.07
423	O2L2F1	O2L2J1	M3J1	Asbestos Cement		569.4	4	0.011	161.96	161.96	4.13	10	41%	12.47
3865	O2L2FA2	PMP-2A	O2L2J1	Ductile Iron	112	10.6	4	0.012	161.96	161.96	4.13	10	41%	2.06
390	O2L23FB2	PMP-23B	O2L23F1	Steel	84	8.2	3	0.013	89.097	89.097	4.04	10	40%	3.37
3979	O2L22F1	O2L22J1	O2L34J3	Ductile Iron		348.7	8	0.012	619.27	619.27	3.95	10	40%	2.62

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3830	O2L6F1	O2L6J1	M1A9	PVC		631.6	4	0.01	153.95	153.95	3.93	10	39%	10.55
464	O1L17FB2	W-17	PMP-17B	Steel	21.1	9.5	6	0.013	333.17	333.17	3.78	10	38%	0.33
3728	O2L1F1	O2L1J1	O2L18J2	Cast iron		255.1	8	0.012	591.6	591.6	3.78	10	38%	2.47
427	O2L25FA2	PMP-25A	O2L25J1	Ductile Iron	84	10.6	3	0.012	82.961	82.961	3.77	10	38%	1.81
3827	O2L25F1	O2L25J1	M7C3	PVC		626.2	3	0.01	82.961	82.961	3.77	10	38%	13.52
511	O2F32FB1	W-32	PMP-32B	Ductile Iron	16.1	9.7	4	0.012	142.69	142.69	3.64	10	36%	0.23
3913	O2L32FB2	PMP-32B	O2L32J2	Ductile Iron	101	6.8	4	0.012	142.69	142.69	3.64	10	36%	1.47
3998	O2L32F2	O2L32J2	O2L32J1	PVC		521.1	4	0.01	142.69	142.69	3.64	10	36%	7.56
2443	O1L14F2	O1L14J2	O1L14J1	PVC		1384.7	10	0.01	880.32	880.32	3.6	10	36%	6.74
3482	O1L40FA1	PMP-40a	O1L40J1	Ductile Iron	70	13.3	4	0.012	139.62	139.62	3.56	10	36%	0.98
3955	O1L40F1	O1L14J1	O1L40J1	Cast iron		1155.4	4	0.012	-139.62	-139.62	3.56	10	36%	22.6
409	O2L1FA2	PMP-1A	O2L1J2	Ductile Iron	10	6.4	4	0.012	137.79	137.79	3.52	10	35%	20.12
3873	O2L1F2	O2L1J2	O2L1J1	PVC		347.6	4	0.012	137.79	137.79	3.52	10	35%	4.73
3586	O2L38F1	O2L38J1	M35A1	PVC		1300	6	0.01	309.12	309.12	3.51	10	35%	10.96
3882	O2L38FA2	PMP-38a	O2L38J1	Steel	100	6.2	6	0.013	309.12	309.12	3.51	10	35%	1.37
3753	O1L14F3	O1L14J3	O1L14J2	Ductile Iron		14.8	8	0.012	547.15	547.15	3.49	10	35%	0.09
1669	O2L45F1	O2L45J1	O2L12J1	PVC		161.3	6	0.01	302.14	302.14	3.43	10	34%	1.3
434	O2L18A-FB2	PMP-18A-b	O2L18AJ1	Steel	66	8.2	3	0.013	75.334	75.334	3.42	10	34%	1.94
3835	O2L5F2	O2L5J2	O2L5J1	Asbestos Cement		693.6	4	0.011	132.9	132.9	3.39	10	34%	10.76
3841	O2L5F1	O2L5J1	M3F3	Asbestos Cement		90.1	4	0.011	132.9	132.9	3.39	10	34%	1.37
3747	O2L15F2	O2L15J2	O2L15J1	PVC		27.2	3	0.01	74.29	74.29	3.37	10	34%	0.48
3749	O2L15FA2	PMP-15A	O2L15J2	Ductile Iron	78	6	3	0.012	74.29	74.29	3.37	10	34%	1.37
1813	O2L34F4	O2L34J4	O2L34J3	PVC		2328.2	12	0.01	1185.3	1185.3	3.36	10	34%	8.08
3968	O2L36F3	O2L36J2	O2L36J3	Ductile Iron		1431.2	8	0.012	-505.32	-505.32	3.23	10	32%	7.39
3809	O2L9FA1	W-9	PMP-9A	Cast iron	27	8	4	0.012	126.02	126.02	3.22	10	32%	0.44
3810	O2L9FA2	PMP-9A	O2L9J1	Cast iron	76	6.1	4	0.012	126.02	126.02	3.22	10	32%	1.23
3815	O2L9F1	O2L9J1	O2L32J1	Ductile Iron		555	4	0.012	126.02	126.02	3.22	10	32%	6.4
489	O2L4F5	O2L4J5	O2L4J4	Ductile Iron		30.3	4	0.012	124.51	124.51	3.18	10	32%	0.34
3085	O2L4FA2	PMP-4A	O2L4J5	Ductile Iron	105	7.3	4	0.012	124.51	124.51	3.18	10	32%	1.18

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3851	O2L4F4	O2L4J4	O2L4J3	Asbestos Cement		752.6	4	0.011	124.51	124.51	3.18	10	32%	10.12
3854	O2L4F3	O2L4J3	O2L4J2	Asbestos Cement		1169.3	4	0.011	124.51	124.51	3.18	10	32%	15.73
3856	O2L4F2	O2L4J2	O2L4J1	Asbestos Cement		374.9	4	0.011	124.51	124.51	3.18	10	32%	5.04
3858	O2L4F1	O2L4J1	O2L5J2	Asbestos Cement		42	4	0.011	124.51	124.51	3.18	10	32%	0.57
1490	O2L39F1	O2L39J1	M35A1	PVC		751.7	2	0.01	29.869	29.869	3.05	10	31%	17.64
3890	O2L39FA2	PMP-39a	O2L39J1	Ductile Iron	25	9	2	0.012	29.869	29.869	3.05	10	31%	0.59
199	O2L7F1	O2L1J1	O2L7J1	Cast iron		671.6	8	0.012	-453.81	-453.81	2.9	10	29%	2.84
1140	O1L42F1	O1L42J1	M14C1	Ductile Iron		1075.3	4	0.012	111.61	111.61	2.85	10	29%	9.9
3603	O2L16F1	O2L16J1	O2L41J1	Ductile Iron		496.3	8	0.013	435.92	435.92	2.78	10	28%	1.95
3604	O2L41F1	O2L41J1	O2L22J1	Ductile Iron		785.4	8	0.013	435.92	435.92	2.78	10	28%	3.08
3775	O2L12FB2	PMP-12B	O2L12J2	PVC	90	7.2	4	0.01	107.08	107.08	2.73	10	27%	0.77
3778	O2L12F2	O2L12J2	O2L12J1	PVC		30.5	4	0.01	107.08	107.08	2.73	10	27%	0.26
3864	O2L24F1	O2L24J1	O2L7J1	Asbestos Cement		561.1	6	0.011	240.39	240.39	2.73	10	27%	3.54
3672	O2L29F1	O2L29J1	M34A11	Ductile Iron		604.4	4	0.012	104.88	104.88	2.68	10	27%	4.96
395	O2L3FA2	PMP-3A	O2L3J2	Ductile Iron	98	6.9	4	0.012	104.48	104.48	2.67	10	27%	1.9
4048	O2L3F2	O2L3J1	O2L3J2	Cast iron		1248	4	0.012	-104.48	-104.48	2.67	10	27%	14.27
1668	O2L33F1	O2L33J1	O2L45J1	PVC		820.9	6	0.01	215.9	215.9	2.45	10	25%	3.56
143	O2L18AFB2	PMP-18B	O2L18J3	Ductile Iron	66	10.5	3	0.01	51.242	51.242	2.33	10	23%	0.58
3711	O2L23F1	O2L23F1	O2L24J1	PVC		474	4	0.01	89.097	89.097	2.27	10	23%	2.88
3451	O1L37F1	M14D4	O1L37J1	PVC		61.8	4	0.01	-88.302	-88.302	2.25	10	23%	0.37
3452	O1L37FA1	PMP-37a	O1L37J1	Steel	78	8.8	4	0.013	88.302	88.302	2.25	10	23%	0.76
466	O1L17FB1	PMP-17B	O1L17J4		155	8.3	8	0.012	333.17	333.17	2.13	10	21%	0.37
468	O1L17F3	O1L17J4	O1L17J3	Steel		7.9	8	0.013	333.17	333.17	2.13	10	21%	0.03
2441	O1L17F1	O1L17J1	O1L14J2	Ductile Iron		255.7	8	0.012	333.17	333.17	2.13	10	21%	0.61
2460	O1L17F2	O1L17J1	O1L17J2	Ductile Iron		1095.9	8	0.012	-333.17	-333.17	2.13	10	21%	2.61
2462	O1L17F2	O1L17J2	O1L17J3	PVC		1271	8	0.01	-333.17	-333.17	2.13	10	21%	3.03
393	O2L24FA2	PMP-24A	O2L24J2	Steel	84	8.3	3	0.013	46.812	46.812	2.12	10	21%	1.02
3708	O2L24F2	O2L24J2	O2L24J1	PVC		542.3	3	0.01	46.812	46.812	2.12	10	21%	4.06
407	O2L18A-FA2	PMP-18A	O2L18J3	Steel	66	10.8	3	0.013	46.617	46.617	2.12	10	21%	0.8

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3785	O2L11FA2	PMP-11A	O2L11J1	Ductile Iron	77	5.9	3	0.012	46.023	46.023	2.09	10	21%	0.56
3788	O2L11F2	O2L11J1	O2L11J1	Ductile Iron		41.5	3	0.012	46.023	46.023	2.09	10	21%	0.3
1783	O2L30FA2	PMP-30A	O2L30J1	PVC	77	8.8	3	0.01	43.798	43.798	1.99	10	20%	1.12
3659	O2L30F1	O2L30J1	O2L47J1	PVC		413.1	3	0.01	43.798	43.798	1.99	10	20%	2.73
4472	O2L48FA2	PMP-48A	O2L48J1	PVC	70	6.2	3	0.01	41.077	41.077	1.86	10	19%	0.41
214	O2L15F1	O2L15J1	O2L33J1	PVC		1180.6	6	0.01	159.37	159.37	1.81	10	18%	2.92
3486	O2L19FB1	W-19	PMP-19B	Steel	0.1	7.7	20	0.013	1747.5	1747.5	1.78	10	18%	0
3762	O2L13FA1	W-13	PMP-13A	Ductile Iron	16	7.3	3	0.012	32.293	32.293	1.47	10	15%	0.06
517	O2L36FA2	PMP-36A	O2L36J4	Steel	90	7.2	4	0.013	50.074	50.074	1.28	10	13%	0.31
3614	O2L36F4	O2L36J4	O2L36J3	Ductile Iron		1394.3	4	0.012	50.074	50.074	1.28	10	13%	2.91
3862	O2L3F1	O2L3J1	O2L24J1	Cast iron		2688.9	6	0.012	104.48	104.48	1.19	10	12%	4.27
506	O2L34FA1	W-34	PMP-34A	Ductile Iron	0.1	10.6	20	0.012	1150.9	1150.9	1.18	10	12%	0
3663	O2L31F1	O2L31J1	O2L16J1	Ductile Iron		653.2	8	0.012	166.88	166.88	1.07	10	11%	0.43
213	O2L13F1	O2L13J1	O2L15J1			584.2	6	0.013	85.077	85.077	0.97	10	10%	0.54
3764	O2L13FA2	PMP-13A	O2L13J2	Ductile Iron	69	8.5	4	0.012	32.293	32.293	0.82	10	8%	0.06
3767	O2L13F2	O2L13J2	O2L13J1	Ductile Iron		24.7	4	0.012	32.293	32.293	0.82	10	8%	0.02
212	O2L44F1	O1L44J1	O2L13J1	PVC		1303.2	6	0.01	52.785	52.785	0.6	10	6%	0.42
3881	O2L38FA1	W-38	PMP-38a	Steel	0.1	7.5	20	0.013	309.12	309.12	0.32	10	3%	0
3081	O2L16FA1	W-16	PMP-16A	Steel	1	8	20	0.013	269.04	269.04	0.27	10	3%	0
3662	O2L19F1	O2L34J4	O2L31J1	Cast iron		48.8	8	0.013	-34.375	-34.375	0.22	10	2%	0
3819	O2L7FA1	W-7	PMP-7A	Ductile Iron	1.1	7.1	20	0.012	213.42	213.42	0.22	10	2%	0
3925	O2L46FA1	W-46	PMP-46a	PVC	0.1	7.6	10	0.01	53.324	53.324	0.22	10	2%	0
3694	O2L44FA1	W-44	PMP-44a	PVC	0.1	8.1	10	0.01	52.785	52.785	0.22	10	2%	0
3832	O2L5FA2	PMP-5A	O2L5J3	Ductile Iron	93	6.7	4	0.012	8.3964	8.3964	0.21	10	2%	0.01
3834	O2L5F3	O2L5J3	O2L5J2	Ductile Iron		16.9	4	0.012	8.3964	8.3964	0.21	10	2%	0
1743	O2L31FA1	W-31	PMP-31A	Ductile Iron	0.1	8.6	20	0.012	201.26	201.26	0.21	10	2%	0
1690	02L23FA1	W-23	PMP-22A	Ductile Iron	1	8.7	20	0.012	183.34	183.34	0.19	10	2%	0
3525	O2L35FA1	W-35	PMP-35A	Steel	0.1	7.2	20	0.013	171.8	171.8	0.18	10	2%	0
417	O2L2FA1	W-2	PMP-2A	Steel	0.1	8.7	20	0.013	161.96	161.96	0.17	10	2%	0

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
1791	O2L26FB1	W-26	PMP-26B	PVC	0.1	7.7	20	0.01	159.28	159.28	0.16	10	2%	0
445	O2L6FA1	W-6	PMP-6A	Ductile Iron	0.1	7.5	20	0.012	153.95	153.95	0.16	10	2%	0
3481	O1L40FA2	W-40	PMP-40a	PVC	0.1	9.8	20	0.01	139.62	139.62	0.14	10	1%	0
3870	O2L1FA1	W-1	PMP-1A	Steel	0.1	7.5	20	0.013	137.79	137.79	0.14	10	1%	0
3849	O2L4FA1	W-4	PMP-4A	Ductile Iron	0.1	8.2	20	0.012	124.51	124.51	0.13	10	1%	0
3879	O1L42FB1	W-42	PMP-42a		1	7	20	0.013	111.61	111.61	0.11	10	1%	0
3773	O2L12FB1	W-12	PMP-12B	Ductile Iron	0.1	9	20	0.012	107.08	107.08	0.11	10	1%	0
3090	O2L29FA1	W-29	PMP-29A	PVC	0.1	11.1	20	0.01	104.88	104.88	0.11	10	1%	0
373	O2L3FA1	W-3	PMP-3A	Ductile Iron	0.1	7.8	20	0.012	104.48	104.48	0.11	10	1%	0
389	O2L23FB1	W-23	PMP-23B	Steel	1	8.2	20	0.013	89.097	89.097	0.09	10	1%	0
3453	O1L37FA2	W-37	PMP-37a	PVC	0.1	9.7	20	0.01	88.302	88.302	0.09	10	1%	0
3918	O2L45FA1	W-45	PMP-45a	PVC	0.1	7.1	20	0.01	86.238	86.238	0.09	10	1%	0
426	O2L25FA1	W-25	PMP-25A	Ductile Iron	0.1	7.7	20	0.012	82.961	82.961	0.08	10	1%	0
432	O2L18A-FA1	W-18A	PMP-18A-b	Steel	0.1	13.2	20	0.013	75.334	75.334	0.08	10	1%	0
3961	O2L15FA1	W-15	PMP-15A	Ductile Iron		7.2	20	0.012	74.29	74.29	0.08	10	1%	0
4405	O2L47FB1	W-47	PMP-47B	PVC	0.1	9.5	20	0.01	56.842	56.842	0.06	10	1%	0
3943	O2L11FA1	W-33	PMP-33A	Ductile Iron	0.1	6.7	20	0.012	56.531	56.531	0.06	10	1%	0
149	O2L18FB1	W-18	PMP-18B	Ductile Iron	0.1	8.9	20	0.01	51.242	51.242	0.05	10	1%	0
516	O2L36FA1	W-36	PMP-36A	Steel	0.1	8.2	20	0.013	50.074	50.074	0.05	10	1%	0
392	O2L24FA1	W-24	PMP-24A	PVC	0.1	9.1	20	0.01	46.812	46.812	0.05	10	1%	0
406	O2L18FA1	W-18	PMP-18A	Steel	0.1	8.8	20	0.013	46.617	46.617	0.05	10	1%	0
3783	O2L11FA1	W-11	PMP-11A	Ductile Iron	0.1	8.4	20	0.012	46.023	46.023	0.05	10	1%	0
1782	O2L30FA1	W-30	PMP-30A	Cast iron	0.1	8	20	0.012	43.798	43.798	0.04	10	0%	0
3974	O1L43FA2	W-35	PMP-43a	PVC	0.1	7.6	20	0.01	42.611	42.611	0.04	10	0%	0
4471	O2L48FA1	W-48	PMP-48A	PVC	0.1	8.1	20	0.01	41.077	41.077	0.04	10	0%	0
3889	O2L39FA1	W-39	PMP-39a	PVC	0.1	8.2	20	0.01	29.869	29.869	0.03	10	0%	0
3831	O2L5FA1	W-5	PMP-5A	Ductile Iron	0.1	7.6	20	0.012	8.3964	8.3964	0.01	10	0%	0
3605	O2L41F2	O2L41J2	O2L41J1			192.7	1.3	0.013	-0.00012	-0.00012	0	10	0%	0
3899	O2L41FA2	PMP-41a	O2L41J2	PVC	25	7	2	0.01	-0.00012	-0.00012	0	10	0%	0

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3797	O2L10F3	O2L10J3	O2L10J2	Ductile Iron		37.5	3	0.012	-1.95E-05	-1.95E-05	0	10	0%	0
2437	NA	O2L4J4	na			163.1	4	0.011	3.19E-05	3.19E-05	0	10	0%	0
3898	O2L41FA1	W-41	PMP-41a	PVC	0.1	7.2	20	0.01	-0.00012	-0.00012	0	10	0%	0
2433	NA	M3F3	na			97.3	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
2435	NA	na	na			126.6	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
3793	O2L10FA1	W-10	PMP-10A	Ductile Iron	0.1	8.3	20	0.012	-1.61E-05	-1.61E-05	0	10	0%	0
3795	O2L10FA2	PMP-10A	O2L10J3	Ductile Iron	99	6.6	3	0.012	0	0	0	10	0%	0
142	O2L24FB1	W-24	PMP-24B	Ductile Iron	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
150	O2L25FB2	PMP-25B	O2L25J1	Ductile Iron	84	9.2	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
151	O2L24FB2	PMP-24B	O2L24J2	Steel	84	7.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
152	O2L22FB1	W-23	PMP-22B	Ductile Iron	1	7.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
165	O1L17FA2	W-17	PMP-17A	Steel	21.1	6.7	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
166	O2L22FB2	PMP-22B	O2L22J2	Ductile Iron	112	7.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
168	O1L14FB2	W-14	PMP-14B	Ductile Iron	44	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
170	O2L34FC1	W-34	PMP-34C	Ductile Iron	0.1	6.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
177	O2L36FB1	W-36	PMP-36B	Ductile Iron	0.1	9.2	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
184	O2L36FB2	PMP-36B	O2L36J4	Ductile Iron	90	7.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
374	O2L3FB1	W-3	PMP-3B	Ductile Iron	0.1	8.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
386	O2L23FA1	W-23	PMP-23A	Steel	1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
387	O2L23FA2	PMP-23A	O2L23F1	Steel	84	9	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
394	O2L3FB2	PMP-3B	O2L3J2	Ductile Iron	98	8.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
401	O2L1FB2	PMP-1B	O2L1J2	Ductile Iron	10	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
413	O2L2FB1	W-2	PMP-2B	Steel	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
415	O2L2FB2	PMP-2B	O2L2J1	Ductile Iron	112	9.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
435	O2L18A-FA2	PMP-18A-a	O2L18AJ1	Steel	66	8.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
436	O2L18A-FA1	PMP-18A-a	W-18A	Steel	0.1	8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
443	O2L6FB2	PMP-6B	O2L6J1	PVC	74	6.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
444	O2L6FB1	W-6	PMP-6B	Ductile Iron	0.1	7	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
467	O1L17FA1	PMP-17A	O1L17J4	Steel	155	8.3	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
473	O1L14FB1	PMP-14B	O1L14J3	Steel	134	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
486	O2L4FB2	PMP4B	O2L4J5	Ductile Iron	105	6.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
487	O2L4FB1	W-4	PMP4B	Ductile Iron	0.1	8.5	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
492	O2L5FB1	W-5	PMP-5B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
494	O2L5FB2	PMP-5B	O2L5J3	Ductile Iron	93	5.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
513	O2F32FA1	W-32	PMP-32A	Ductile Iron	16.1	9.8	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
514	O2L32FA2	PMP-32A	O2L32J2	Ductile Iron	101	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
526	O2L34FC2	PMP-34C	O2L34J6	Ductile Iron	154	7.8	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1693	O2L34FB1	W-34	PMP-34B	Ductile Iron	0.1	8.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1694	O2L34FB2	PMP-34B	O2L34J6	Ductile Iron	154	9.4	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1745	O2L31FB2	PMP-31B	O2L31J2	Steel	77	9.6	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1746	O2L31FB1	W-31	PMP-31B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1784	O2L30FB2	PMP-30B	O2L30J1	PVC	77	8.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1785	O2L30FB1	W-30	PMP-30B	Cast iron	0.1	7.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1793	O2L26FA2	PMP-26A	O2L26J1	Steel	79	6.1	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1794	O2L26FA1	W-26	PMP-26A	PVC	1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2454	NA	J-97	na			612.3	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2466	NA	na	J-97			2074.5	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3078	O2L16FB2	PMP-16B	O2L16J2	Ductile Iron	77	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3082	O2L16FB1	W-16	PMP-16B	Steel	1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3086	O2L29FB1	W-29	PMP-29B	PVC	0.1	10	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3088	O2L29FB2	PMP-29B	O2L29J2	PVC	78	11.7	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3454	O1L37FB1	PMP-37b	O1L37J1	Ductile Iron	78	6.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3455	O1L37FB2	W-37	PMP-37b		0.1	8.8	10	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3483	O1L40FB2	W-40	PMP-40b	PVC	0.1	12.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3484	O1L40FB1	PMP-40b	O1L40J1	Ductile Iron	70	10	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3487	O2L19FA1	W-19	PMP-19A	Steel	0.1	7.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3493	O2L19FA2	PMP-19A	O1L34J2	Steel	341	8.5	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3566	O2L38FB1	W-38	PMP-38b	Steel	0.1	8.3	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3568	O2L38FB2	PMP-38b	O2L38J1	Steel	100	7.3	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3651	O2L34BYEPA	O2L36J1	O2L34J5	Ductile Iron		15.2	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3696	O2L44FB1	W-44	PMP-44b	PVC	0.1	8.3	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3697	O2L44FB2	PMP-44b	O1L44J2		25	6.8	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3744	O2L15FB2	PMP-15B	O2L15J2	Ductile Iron	78	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3768	O2L13FB1	W-13	PMP-13B	Ductile Iron	16	9.1	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3769	O2L13FB2	PMP-13B	O2L13J2	Ductile Iron	69	9.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3779	O2L12FA1	W-12	PMP-12A	Ductile Iron	0.1	8.2	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3780	O2L12FA2	PMP-12A	O2L12J2	Ductile Iron	90	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3789	O2L11FB1	W-11	PMP-11B	Ductile Iron	0.1	8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3790	O2L11FB2	PMP-11B	O2L11J1	Ductile Iron	77	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3799	O2L10FB1	W-10	PMP-10B	Ductile Iron	0.1	5.6	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3800	O2L10FB2	PMP-10B	O2L10J3	Ductile Iron	99	7.5	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3803	O2L9FB2	PMP-9B	O2L9J1	Ductile Iron	76	5.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3808	O2L9FB1	W-9	PMP-9B	Cast iron	27	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3817	O2L7FB1	W-7	PMP-7B	Ductile Iron	0.1	7.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3823	O2L7FB2	PMP-7B	O2L7J2	Ductile Iron	104	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3869	O2L1FB1	W-1	PMP-1B	Steel	0.1	7.2	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3877	O1L42FA1	W-42	PMP-42b		0.1	8.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3878	O1L42FA2	PMP-42b	O1L42J1		25	7.7	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3887	O2L39FB1	W-39	PMP-39b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3888	O2L39FB2	PMP-39b	O2L39J1	Ductile Iron	25	8.3	2	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3891	O2L35FB2	W-35	PMP-35B	Steel	0.1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3892	O2L35FB2	PMP-35B	O2L35J2	Steel	90	6.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3896	O2L41FB1	W-41	PMP-41b	PVC	0.1	6.9	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3897	O2L41FB2	PMP-41b	O2L41J2	PVC	25	7	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3916	O2L45FB1	W-45	PMP-45b		0.1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3917	O2L45FB2	PMP-45b	O2L45J2	PVC	25	7.4	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3933	O2L46FB1	W-46	PMP-46b	PVC	0.1	8.1	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 2025 Existing Conditions
Exhibit D3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3934	O2L46FB2	PMP-46b	O2L46J1		25	6.2	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3937	O2L33FB1	W-33	PMP-33B	Ductile Iron	0.1	6.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3939	O2L33FB2	PMP-33B	O2L33J2	Steel	70	5.8	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3960	O2L15FB1	W-15	PMP-15B	Ductile Iron		7.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3972	O1L14FB2	W-35	PMP-43b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3973	O1L14FB1	PMP-43b	O1L43J1	PVC	25	7.3	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4408	O2L47FA1	W-47	PMP-47A	PVC	0.1	9.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4409	O2L47FA2	PMP-47A	O2L47J2	PVC	40	6.2	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4462	O2L48FB1	W-48	PMP-48B	PVC	0.1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4464	O2L48FB2	PMP-48B	O2L48J1	PVC	70	7.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

EXHIBIT D.4
PRESSURE NODE DATA TABLE REPORT

Model Pressure Node Data Table 2025 Existing Conditions
Exhibit D4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
1341	O1L14J1	6.7	3.5	58.1	24	54.6		921853.18	600253.72	TRUE
2432	O1L14J2	6.4	0	64.8	28	64.8		920948.59	600723.96	TRUE
472	O1L14J3	6.4	8	64.9	25	56.9		920955.16	600715.27	TRUE
127	O1L17J1	6	5.3	65.4	26	60.2		920692.99	600715.98	TRUE
2461	O1L17J2	6.8	4	68	28	64		920723	599620.53	TRUE
87	O1L17J3	7.9	5	71.1	29	66.1		920698	598426.1	TRUE
465	O1L17J4	7	5	71.1	29	66.1		920705.89	598426.09	TRUE
2428	O1L34J1	8	5	23.5	8	18.5		927366.12	604992.24	TRUE
3492	O1L34J2	6.8	4.8	29.3	11	24.5		927390.3	604966.61	TRUE
3445	O1L37J1	6	3	3.5	0	0.5		919806.96	599800.73	TRUE
1337	O1L40J1	7.7	4	80.7	33	76.7		921532.85	599443.59	TRUE
1132	O1L42J1	5.8	3	7.6	2	4.6		919732.18	600929.27	TRUE
3588	O1L43J1	7.1	5	23.9	8	18.9		919610.41	600547.6	TRUE
116	O1L44J1	6.8	5.3	55.9	22	50.7		921909.68	600337.73	TRUE
1678	O1L44J2	6.2	0	64.3	28	64.3		921913.59	600458.39	TRUE
88	O2L10J1	8	4	23.6	8	19.6		927114.51	600739.53	TRUE
136	O2L10J2	7.8	5	34.2	13	29.2		926523.21	600750.87	TRUE
3794	O2L10J3	8.7	6.5	34.2	12	27.7		926513.68	600783.24	TRUE
135	O2L11J1	7.9	5.5	42.4	16	36.9		926045.89	600735.78	TRUE
3784	O2L11J1	10.5	8.5	42.7	15	34.2		926041.8	600777.04	TRUE
134	O2L12J1	8.1	6	47.2	18	41.2		925712.64	600726.09	TRUE
3774	O2L12J2	8.2	6.2	47.4	18	41.2		925711.36	600756.56	TRUE
131	O2L13J1	6.1	3	55.5	23	52.5		922967.26	600629.79	TRUE
3763	O2L13J2	6.2	4.2	55.5	22	51.3		922961.39	600653.77	TRUE
132	O2L15J1	6.8	4	55	22	51		923551.18	600648.88	TRUE
3743	O2L15J2	7	5	55.4	22	50.4		923546.24	600675.67	TRUE
107	O2L16J1	4.7	2.5	32	13	29.5		928422.75	604385.66	TRUE
2407	O2L16J2	6.7	4	49	19	45		928763.58	604418.47	TRUE
433	O2L18AJ1	4.7	2.5	12.9	4	10.4		928854.97	600361.74	TRUE
93	O2L18J1	7.7	4	12.5	4	8.5		928569.18	600970.36	TRUE

Model Pressure Node Data Table 2025 Existing Conditions
Exhibit D4

3726	O2L18J2	4.9	2.9	25.5	10	22.6		928608.77	599957.47	TRUE
126	O2L18J3	5.7	3	30.5	12	27.5		928767.45	599971.15	TRUE
3504	O2L19J1	8.3	7.8	25.2	8	17.4		927390.21	604973.37	TRUE
104	O2L1J1	6	4	28	10	24		928617.92	599702.49	TRUE
398	O2L1J2	6.6	4	32.7	12	28.7		928285.14	599671.66	TRUE
105	O2L22J1	6.9	4	26.9	10	22.9		927748.42	604998.77	TRUE
106	O2L22J2	5.5	3	49.4	20	46.4		927483.96	604307.21	TRUE
118	O2L23F1	4.3	1.2	37.2	16	36		929940.07	600105.19	TRUE
97	O2L24J1	6.9	4	34.4	13	30.4		929844.61	599734.74	TRUE
102	O2L24J2	5.4	3	38.4	15	35.4		929700.1	600158.28	TRUE
101	O2L25J1	4.5	2.7	14.5	5	11.8		929283.22	600655.84	TRUE
1790	O2L26J1	5.6	3.6	12.1	4	8.5		927480.33	603912.05	TRUE
2416	O2L29J1	4.5	2	6.8	2	4.8		929271.35	603049.66	TRUE
3087	O2L29J2	4.5	2	7.2	2	5.2		929284.01	603049.29	TRUE
414	O2L2J1	5.8	3.3	15.8	5	12.5		928996	598338.88	TRUE
1781	O2L30J1	3.1	1	21.8	9	20.8		929239.57	603452.81	TRUE
3661	O2L31J1	4.8	2.5	32.4	13	29.9		928446.71	603732.88	TRUE
1742	O2L31J2	6.6	4	62.3	25	58.3		929288.83	604013.67	TRUE
100	O2L32J1	5.7	4	27.9	10	23.9		928486.55	602372.06	TRUE
125	O2L32J2	5.3	4	35.5	14	31.5		927974.57	602351.14	TRUE
133	O2L33J1	8.3	6	52	20	46		924731.1	600689.88	TRUE
3938	O2L33J2	9.2	6	54.5	21	48.5		924723.91	600721.68	TRUE
3505	O2L34J2	8.1	4.6	24.1	8	19.6		927389.97	604994.04	TRUE
3498	O2L34J3	8.4	3.8	24.3	9	20.5		927411.01	604994.99	TRUE
1810	O2L34J4	4.8	4	32.4	12	28.4		928447.42	603684.11	TRUE
120	O2L34J5	5.9	2	79.9	34	77.9		928527.32	601678.68	TRUE
525	O2L34J6	5.9	10.1	81.1	31	70.9		928480.51	601676.24	TRUE
3528	O2L35J1	5.9	3	76.4	32	73.4		925402.48	604500.5	TRUE
3526	O2L35J2	0	0	76.6	33	76.6		925402.8	604509.91	TRUE
3649	O2L36J1	6	4	-3.6	-3	-7.6		928527.66	601663.48	TRUE
91	O2L36J2	7.4	5	11.3	3	6.3		928541.4	601077.86	TRUE
90	O2L36J3	8.9	4	18.6	6	14.6		927111.29	601021.17	TRUE
89	O2L36J4	6.1	4	21.6	8	17.6		926952.73	602311.3	TRUE
3567	O2L38J1	6.5	3.5	10.2	3	6.7		925476.79	603270.8	TRUE

Model Pressure Node Data Table 2025 Existing Conditions
Exhibit D4

1482	O2L39J1	6.5	4	16.5	5	12.5		925456.86	603835.44	TRUE
4047	O2L3J1	6.9	5	38.6	15	33.6		929945.67	597047.95	TRUE
124	O2L3J2	6.4	5	52.9	21	47.9		928698.06	597016.74	TRUE
3602	O2L41J1	5.5	4	30	11	26		928396.68	604881.25	TRUE
1639	O2L41J2	6.4	4	30	11	26		928579.21	604893.45	TRUE
1667	O2L45J1	8.1	6	48.5	18	42.5		925551.4	600721.93	TRUE
1670	O2L45J2	9.4	7.4	55.1	21	47.7		925547.33	600761.31	TRUE
3926	O2L46J1	6.6	3	16.9	6	13.9		928915.95	600879.36	TRUE
4400	O2L47J1	2.2	1.4	19.1	8	17.7		928837.69	603432.35	TRUE
4396	O2L47J2	5	3	20.1	7	17.1		928830.59	603426.03	TRUE
4463	O2L48J1	0	0	25.8	11	25.8		926212.08	601305.88	TRUE
3855	O2L4J1	6.3	4.3	16.2	5	11.9		927327.5	597718.21	TRUE
3853	O2L4J2	6.2	4.2	21.3	7	17.1		927318.45	598092.97	TRUE
3850	O2L4J3	5.8	3.8	37	14	33.2		927280.07	599261.59	TRUE
488	O2L4J4	7	5	47.1	18	42.1		927253.84	600013.72	TRUE
484	O2L4J5	7.6	6	47.5	18	41.5		927276.73	600022.08	TRUE
3838	O2L5J1	6	4	4.9	0	0.9		927367.89	597001.13	TRUE
3857	O2L5J2	6.3	4	15.7	5	11.7		927330.85	597676.29	TRUE
493	O2L5J3	6.3	4.8	15.7	5	10.8		927336.66	597692.12	TRUE
442	O2L6J1	6.3	4	13.9	4	9.9		928475.95	600682.36	TRUE
95	O2L7J1	6.6	4	30.8	12	26.8		929283.52	599729.39	TRUE
3820	O2L7J2	6.9	4.9	31.8	12	26.9		929290.49	599699.06	TRUE
3802	O2L9J1	6.5	3.5	34.3	13	30.8		928210.32	602646.01	TRUE
2434	na	0	0	3.5	2	3.5		927359.5	596967.77	TRUE
2436	na	0	0	3.5	2	3.5		927353.71	597094.23	TRUE
2438	na	0	0	47.1	20	47.1		927262.9	599779.52	TRUE

EXHIBIT D.5.
PUMP DATA TABLE REPORT

Model Pump Data Table 2025 Existing Conditions
Exhibit D5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
63	PMP-1A	TRUE	6.7	-3.8	Pump Definition - LS1	137.79	54.6	-1.8	52.8
396	PMP-1B	FALSE	6.7	-3.8	Pump Definition - LS1	(N/A)	(N/A)	(N/A)	(N/A)
412	PMP-2A	TRUE	6.3	-4.7	Pump Definition - LS2	161.96	21.5	-3.7	17.9
411	PMP-2B	FALSE	6.4	-4.7	Pump Definition - LS2	(N/A)	(N/A)	(N/A)	(N/A)
365	PMP-3A	TRUE	6.4	-2.9	Pump Definition - LS3	104.48	56.7	-1.9	54.8
62	PMP-3B	FALSE	6.4	-2.9	Pump Definition - LS3	(N/A)	(N/A)	(N/A)	(N/A)
481	PMP-4A	TRUE	7.6	-3.6	Pump Definition - LS4	124.51	50.2	-1.6	48.6
491	PMP-5A	TRUE	6	-6.2	Pump Definition - LS5	8.3964	19.8	-4.2	15.7
490	PMP-5B	FALSE	6	-6.2	Pump Definition - LS5	(N/A)	(N/A)	(N/A)	(N/A)
440	PMP-6A	TRUE	6.5	-2.9	Pump Definition - LS6	153.95	20.3	-1.4	18.9
441	PMP-6B	FALSE	6.5	-2.9	Pump Definition - LS6	(N/A)	(N/A)	(N/A)	(N/A)
453	PMP-7A	TRUE	6.8	-5.4	Pump Definition - LS7	213.42	38.3	-3.4	34.9
60	PMP-7B	FALSE	6.8	-5.4	Pump Definition - LS7	(N/A)	(N/A)	(N/A)	(N/A)
3801	PMP-9A	TRUE	6	3.5	Pump Definition - LS9	126.02	37	-1.4	35.6
51	PMP-9B	FALSE	6	3.5	Pump Definition - LS9	(N/A)	(N/A)	(N/A)	(N/A)
3791	PMP-10A	TRUE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	-1.93E-05	26	3.9	29.9
3792	PMP-10B	FALSE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3781	PMP-11A	TRUE	10.5	3	Pump Definition - LS11	46.023	33.8	9.5	43.3
3782	PMP-11B	FALSE	10.5	3	Pump Definition - LS11	(N/A)	(N/A)	(N/A)	(N/A)
3772	PMP-12A	FALSE	8.7	2.5	Pump Definition - LS12	(N/A)	(N/A)	(N/A)	(N/A)
3771	PMP-12B	TRUE	8.7	2.5	Pump Definition - LS12	107.08	40.2	8	48.2
3760	PMP-13A	TRUE	6.7	4.7	Pump Definition - LS13	32.293	53.4	2.1	55.6
3761	PMP-13B	FALSE	6.7	4.7	Pump Definition - LS13	(N/A)	(N/A)	(N/A)	(N/A)
469	PMP-14A	TRUE	6.4	8	Pump Definition - LS14	547.15	74.8	-4.7	70.2
48	PMP-14B	FALSE	6.4	8	Pump Definition - LS14	(N/A)	(N/A)	(N/A)	(N/A)
3741	PMP-15A	TRUE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	74.29	54.3	2.5	56.8
3740	PMP-15B	FALSE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
2476	PMP-16A	TRUE	5.9	-6.3	Pump Definition - LS16	269.04	64.3	-4.3	60
2481	PMP-16B	FALSE	5.9	-6.3	Pump Definition - LS16	(N/A)	(N/A)	(N/A)	(N/A)

Model Pump Data Table 2025 Existing Conditions
Exhibit D5

49	PMP-17A	FALSE	7	9	Pump Definition - LS17	(N/A)	(N/A)	(N/A)	(N/A)
463	PMP-17B	TRUE	7.5	9	Pump Definition - LS17	333.17	82.8	-11.3	71.5
405	PMP-18A	TRUE	5.7	-5	Pump Definition - LS18	46.617	30.3	1	31.3
431	PMP-18A-a	FALSE	6.1	-3.5	Pump Definition - LS18a	(N/A)	(N/A)	(N/A)	(N/A)
430	PMP-18A-b	TRUE	6.1	-3.5	Pump Definition - LS18a	75.334	15.8	-1	14.8
61	PMP-18B	TRUE	5.7	-5	Pump Definition - LS18	51.242	30.1	1	31.1
539	PMP-19A	FALSE	6.8	-4.1	Pump Definition - LS19	(N/A)	(N/A)	(N/A)	(N/A)
53	PMP-19B	TRUE	6.8	-2.5	Pump Definition - LS19	1747.5	59.9	-2.1	57.8
1689	PMP-22A	TRUE	5.4	-9.7	Pump Definition - LS22	183.34	60.8	-7.2	53.6
52	PMP-22B	FALSE	5.9	-9.7	Pump Definition - LS22	(N/A)	(N/A)	(N/A)	(N/A)
59	PMP-23A	FALSE	4.5	-5.9	Pump Definition - LS23	(N/A)	(N/A)	(N/A)	(N/A)
388	PMP-23B	TRUE	-5.9	-5.9	Pump Definition - LS23	89.097	44	-3.4	40.6
391	PMP-24A	TRUE	5.6	-3.4	Pump Definition - LS24	46.812	40.3	-0.9	39.4
58	PMP-24B	FALSE	5.6	-3.4	Pump Definition - LS24	(N/A)	(N/A)	(N/A)	(N/A)
425	PMP-25A	TRUE	5.1	-5.4	Pump Definition - LS24-LS25	82.961	19.2	-2.9	16.3
57	PMP-25B	FALSE	5.1	-5.4	Pump Definition - LS24-LS25	(N/A)	(N/A)	(N/A)	(N/A)
1788	PMP-26A	FALSE	5.6	-4.2	Pump Definition - LS26	(N/A)	(N/A)	(N/A)	(N/A)
1789	PMP-26B	TRUE	5.6	-4.2	Pump Definition - LS26	159.28	25.2	-3.8	21.4
2479	PMP-29A	TRUE	4.4	-4.9	Pump Definition - LS29	104.88	18.9	-3.9	15
2480	PMP-29B	FALSE	3.5	-4.9	Pump Definition - LS29	(N/A)	(N/A)	(N/A)	(N/A)
1779	PMP-30A	TRUE	4.1	-5	Pump Definition - LS30	43.798	25.4	-2.5	22.9
1780	PMP-30B	FALSE	4.1	-5	Pump Definition - LS30	(N/A)	(N/A)	(N/A)	(N/A)
1740	PMP-31A	TRUE	6.2	-8	Pump Definition - LS31	201.26	95.7	-6.6	89.2
1741	PMP-31B	FALSE	6.2	-8	Pump Definition - LS31	(N/A)	(N/A)	(N/A)	(N/A)
508	PMP-32A	FALSE	8	10	Pump Definition - LS32	(N/A)	(N/A)	(N/A)	(N/A)
50	PMP-32B	TRUE	8	10	Pump Definition - LS32	142.69	42.3	-5.3	37
3935	PMP-33A	TRUE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	56.531	60.2	3	63.2
3936	PMP-33B	FALSE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
505	PMP-34A	TRUE	6.9	-10.5	Pump Definition - LS34	1150.9	90.7	-6	84.7
1692	PMP-34B	FALSE	6.9	-10.5	Pump Definition - LS34	(N/A)	(N/A)	(N/A)	(N/A)
56	PMP-34C	FALSE	6.9	-10.5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
3522	PMP-35A	TRUE	6	-5	Pump Definition - LS35	171.8	81	-1.4	79.6
3521	PMP-35B	FALSE	6	-5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
515	PMP-36A	TRUE	6.7	-8.5	Pump Definition - LS36	50.074	27.4	-5.5	21.9

Model Pump Data Table 2025 Existing Conditions
Exhibit D5

64	PMP-36B	FALSE	7.5	-8.5	Pump Definition - LS36	(N/A)	(N/A)	(N/A)	(N/A)
3443	PMP-37a	TRUE	6.3	-7	Pump Definition - LS37	88.302	8.9	-4.7	4.3
3444	PMP-37b	FALSE	6.5	-7	Pump Definition - LS37	(N/A)	(N/A)	(N/A)	(N/A)
3565	PMP-38a	TRUE	6.5	-15.4	Pump Definition - LS38	309.12	21.7	-10.2	11.5
3564	PMP-38b	FALSE	6.5	-15.4	Pump Definition - LS38	(N/A)	(N/A)	(N/A)	(N/A)
3886	PMP-39a	TRUE	6	-5	Pump Definition - LS39	29.869	15.1	2	17.1
3885	PMP-39b	FALSE	6	-5	Pump Definition - LS39	(N/A)	(N/A)	(N/A)	(N/A)
3479	PMP-40a	TRUE	8	5	Pump Definition - LS40	139.62	86.6	-5	81.6
3480	PMP-40b	FALSE	8	5	Pump Definition - LS40	(N/A)	(N/A)	(N/A)	(N/A)
3895	PMP-41a	TRUE	6.5	0	Pump Definition - LS10-LS42-LS43 Privite	0	0	4	30
3894	PMP-41b	FALSE	0	6.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3875	PMP-42a	TRUE	5	0	Pump Definition - LS10-LS42-LS43 Privite	111.61	11.8	2.5	14.3
3876	PMP-42b	FALSE	5	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3970	PMP-43a	TRUE	9.4	1	Pump Definition - LS10-LS42-LS43 Privite	42.611	21	4	25
3971	PMP-43b	FALSE	7.4	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3693	PMP-44a	TRUE	6.8	0.5	Pump Definition - LS15-LS33-LS44-LS45	52.785	61.5	4.5	66
3692	PMP-44b	FALSE	6.7	0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
3915	PMP-45a	TRUE	9.3	3.5	Pump Definition - LS15-LS33-LS44-LS45	86.238	50.3	9	59.3
3914	PMP-45b	FALSE	9.3	3.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3923	PMP-46a	TRUE	6.5	-3	Pump Definition - LS10-LS42-LS43 Privite	53.324	19.7	-1	18.7
3924	PMP-46b	FALSE	6.3	-3	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4407	PMP-47A	FALSE	5	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4404	PMP-47B	TRUE	5	1	Pump Definition - LS10-LS42-LS43 Privite	56.842	19.2	4	23.2
4460	PMP-48A	TRUE	0	0	Pump Definition - LS10-LS42-LS43 Privite	41.077	21.2	5	26.2
4461	PMP-48B	FALSE	0	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
482	PMP4B	FALSE	7.6	-3.6	Pump Definition - LS4	(N/A)	(N/A)	(N/A)	(N/A)

EXHIBIT D.6
OUTFALL DATA TABLE REPORT

Model Outfall Data Table 2025 Existing Conditions
Exhibt D6

ID	Label	Elev (Grd) (ft)	Elev (Invt) (ft)	Boundary Condition Type	Elev (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Flow (Total Out) (gpm)	Notes
1797	O-1	6.8	3.5	User Defined Tailwater	58	58	1019.9	Measured 58 ft of Head or 25 psi at 12:00 PM Tuesday in August 2023
3488	O-2	6.5	3.5	User Defined Tailwater	23	23	3723.9	Measured 10 psi or 23 feet of Head on Monday 6/12/2023

EXHIBIT E.1
Gravity Sewer Date Table Report

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
536	O1L14SA2	M14A2	-3.6	M14A1	-4	102.8	0.004	8	0.013	4.22	660.86	346.58	190.7	93.6	Vitrified Clay
1120	O1L14SC1	M14C1	-2.7	M14A2	-3.6	279.4	0.003	8	0.013	3.59	562.74	302.61	186	100	Vitrified Clay
1466	O2L34SA9	M34A9	0.1	M34A8	0	92.2	0.001	8	0.013	1.39	217.91	138.37	157.5	92.2	Vitrified Clay
1517	O2L34SA3	M34A3	-4.4	M34A2	-4.5	34	0.004	8	0.01	4.12	645.2	418.76	154.1	92.2	PVC
1115	O1L14SC2	M14C2	-2.4	M14C1	-2.7	92.4	0.003	8	0.013	2.88	451.14	298.52	151.1	100	Vitrified Clay
1113	O1L14SC3	M14C3	-2.3	M14C2	-2.4	22.4	0.003	8	0.013	2.88	451.14	303.48	148.7	100	Vitrified Clay
998	O2L34SA6	M34A6	-1.9	M34A5	-2.1	77	0.002	8	0.013	2.33	365.33	247.26	147.8	82	Vitrified Clay
1110	O1L14SC4	M14C4	-1.4	M14C3	-2.3	315.6	0.003	8	0.013	2.75	430.62	297.54	144.7	100	Vitrified Clay
1322	O1L17SA10	M17A10	0.6	M17A9	0	160.9	0.004	8	0.013	2.77	434.53	325.59	133.5	100	Vitrified Clay
1323	O1L17SA9	M17A9	0	M17A8	-0.4	88.8	0.005	8	0.013	2.94	460.89	364.07	126.6	86.1	Vitrified Clay
1089	O1L17SA11	M17A11	1.6	M17A10	0.6	245.1	0.004	8	0.013	2.48	388.21	342.94	113.2	100	Vitrified Clay
1353	O2L34SA8	M34A8	0	M34A7	-0.5	319.7	0.002	8	0.013	1.62	239.64	224.95	106.5	75	Vitrified Clay
1108	O1L14SC5	M14C5	-0.4	M14C4	-1.4	315.1	0.003	8	0.013	1.93	302.05	297.81	101.4	100	Vitrified Clay
360	O2L3SA1	M3A1	-1.8	W-3	-1.7	17.9	-0.004	8	0.013	2.32	363.07	362.33	100.2	81.9	
1275	O2L22SA2	M22A2	-0.8	M22A1	-1.4	133.8	0.005	8	0.013	2.71	362.49	372.16	97.4	71.8	Vitrified Clay
1057	O1L17SA2	M17A2	-6.6	M17A1	-7	144.5	0.002	12	0.013	2.5	718.72	775.54	92.7	72.9	Vitrified Clay
3510	O2L35SA1	W-35	-1.4	M35A1	-1.3	20.3	0.005	8	0.01	3.58	452.83	494.45	91.6	73.4	PVC
4001	O1L17SA1	M17A1	-7	W-17	-7.1	39.9	0.003	12	0.013	2.93	824.17	912.44	90.3	64.2	Vitrified Clay
1032	O1L17SA3	M17A3	-6.4	M17A2	-6.6	112	0.002	12	0.013	2.21	593.32	692.29	85.7	73.9	Vitrified Clay
1518	O2L34SA3	M34A4	-3	M34A3	-4.3	313	0.004	8	0.01	3.22	365.33	454.36	80.4	84	PVC
3683	O2L22SA4	M22A3	0.9	M22A4	1.6	180.6	0.004	8	0.013	2.29	244.36	327.87	74.5	59.8	Vitrified Clay
988	O2L34SI1	M34A7	-0.5	M34A6	-1.9	332.4	0.004	8	0.013	2.43	255.24	349.46	73	81.7	Vitrified Clay
1465	O2L34SA10	M34A10	0.8	M34A9	0.1	233.6	0.003	8	0.013	2.06	213.65	296.91	72	80.4	Vitrified Clay
1459	O2L34SA11	M34A11	1.5	M34A10	0.8	233.9	0.003	8	0.013	2.12	213.13	307.09	69.4	62.1	Vitrified Clay
4285	O1L17SA4	M17A5	-5.7	M17A4	-6.3	285.4	0.002	12	0.013	2.29	505.93	751.26	67.3	64	Vitrified Clay
4282	O1L17SA4	M17A4	-6.3	M17A3	-6.4	27.9	0.003	12	0.013	2.53	505.93	856.88	59	70.4	Vitrified Clay
1283	O2L22SA3	M22A3	0.9	M22A2	-0.8	259.4	0.007	8	0.013	2.94	261.37	442.87	59	67.5	
3993	O2L36SB1	M36A1	-5.2	M36B1	-4	279.6	0.004	8	0.01	3	263.87	452.17	58.4	59.8	PVC
4142	O2L1SA5	M1A4	1	M1A5	1.1	43.1	0.004	8	0.013	2.25	193.2	342.52	56.4	53.2	Vitrified Clay
4143	O2L1SA6	M1A5	1.1	M1A6	1.4	72.8	0.004	8	0.013	2.25	192.3	343.57	56	53.6	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
376	O2L3SA2	M3A2	-1.3	M3A1	-1.8	107.4	0.005	8	0.013	2.42	204.57	370.12	55.3	77	Vitrified Clay
4081	O2L1SA4	M1A3	-0.1	M1A4	1	240.7	0.004	8	0.013	2.35	196.2	359.94	54.5	52	Vitrified Clay
733	O2L3SH1	M3H1	-0.1	M3A2	-1.3	318.9	0.004	8	0.013	2.15	178.63	329.9	54.1	53.2	Vitrified Clay
1100	O1L14SD1	M14D1	0.4	M14C5	-0.4	279.3	0.003	8	0.013	1.02	159.55	299.18	53.3	100	Vitrified Clay
646	O2L36SA4	M36A4	-2.2	M36A3	-2.4	220.4	0.001	8	0.01	1.38	112.69	212.41	53.1	45.9	PVC
737	O2L3SH2	M3H2	1.3	M3H1	-0.1	388.5	0.004	8	0.013	2.08	168.66	322.05	52.4	51.9	Vitrified Clay
4136	O2L1SA7	M1A6	1.4	M1A7	1.7	46.6	0.006	8	0.013	2.65	191.4	426.48	44.9	50.2	Vitrified Clay
3863	O2L3SF1	M3A1	-1.8	M3F1	-0.4	341.2	0.004	8	0.013	2.09	139.17	344.92	40.3	72.1	Vitrified Clay
870	O2L1SA2	M1A2	-0.8	M1A1	-1	82.6	0.003	10	0.013	2.16	225.15	558.68	40.3	42.5	Vitrified Clay
3957	O2L3SF3	M3F2	1.5	M3F3	3.2	459.3	0.004	8	0.013	1.99	132.9	329.96	40.3	43.4	Vitrified Clay
1168	O1L14SB2	M14B2	-1.4	M14B1	-1.7	285.5	0.001	8	0.013	1.16	76.633	192.58	39.8	36.6	Vitrified Clay
1124	O1L14SC6	M14C6	0.5	M14C5	-0.4	305.7	0.003	8	0.013	0.75	116.85	299.16	39.1	100	Vitrified Clay
1396	O1L17SB2	M17B1	2.2	M17B2	2.6	99.6	0.004	8	0.01	2.67	173.14	446.82	38.7	92	PVC
1126	O1L14SC7	M14C7	1	M14C6	0.5	170	0.003	8	0.013	0.71	111.15	288.2	38.6	100	Vitrified Clay
1617	O2L3SF2	M3F2	1.5	M3F1	-0.4	437.2	0.004	8	0.013	2.13	136.04	357.52	38.1	43.5	Vitrified Clay
653	O2L36SA2	M36A2	-4.1	M36A1	-5.2	310.1	0.003	8	0.01	2.46	156.76	414.13	37.9	53.7	PVC
1402	O1L17SB4	M17B3	3.6	M17B4	4.2	217.7	0.003	8	0.01	2.19	138.94	370.1	37.5	40.6	PVC
1104	O1L14SD3	M14D3	2.1	M14D2	1.3	284.2	0.003	8	0.013	0.69	108.25	296.6	36.5	100	Vitrified Clay
1106	O1L14SD4	M14D4	2.8	M14D3	2.1	226.8	0.003	8	0.013	0.67	105.4	296.94	35.5	100	Vitrified Clay
4080	O2L2SR2	M1A2	-0.8	M1A3	-0.1	208.8	0.003	10	0.013	2.1	199.5	562.18	35.5	42.6	Vitrified Clay
1324	O1L17SA8	M17A8	-2.1	M17A6	-3.4	159.5	0.008	12	0.013	3.73	505.93	1443.4	35.1	42.8	Vitrified Clay
707	O2L3SJ1	M3J1	3	M3H2	1.3	234.4	0.007	8	0.013	2.71	162.53	465.9	34.9	46.7	Vitrified Clay
1000	O2L34SA5	M34A5	-2.1	M34A4	-3	23.2	0.039	8	0.013	6.17	365.33	1067.6	34.2	66	Vitrified Clay
902	O2L23SB1	M23B1	1.9	M17A1	0.3	399.2	0.004	8	0.035	0.74	43.167	128.33	33.6	31.1	
1398	O1L17SB3	M17B3	3.4	M17B2	2.6	147.7	0.006	8	0.01	3.06	173.14	538.07	32.2	63.7	PVC
419	O2L2SA1	M2A1	-2.1	W-2	-2.2	15.7	0.006	6	0.013	2.03	64.5	200.89	32.1	38.3	Vitrified Clay
651	O2L36SA3	M36A3	-2.4	M36A2	-4.1	354.7	0.005	8	0.01	2.7	148.91	479.4	31.1	41.4	PVC
1404	O1L17SB5	M17B5	4.7	M17B4	4	146.5	0.004	8	0.01	2.55	138.94	454.91	30.5	55.6	PVC
1710	O2L38SA2	M38A2	-7.2	M38A1	-8.8	395.9	0.004	8	0.01	2.47	127.39	449.63	28.3	36.7	PVC
3884	O2L38SA1	M38A1	-8.9	W-38	-9.1	23.9	0.008	8	0.01	3.53	182.2	644.52	28.3	40.5	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1551	O1L17SF1	M17F1	2.8	M17A11	1.6	282.2	0.004	8	0.013	1.96	101.08	358.04	28.2	78.9	Vitrified Clay
683	O2L36SB2	M36B2	-3	M36B1	-4	327.4	0.003	8	0.01	2.16	108.22	397.39	27.2	45.3	PVC
3372	O2L7SC2	M7C2	-0.1	M7C1	-0.9	162.5	0.005	8	0.013	2.06	102.99	380.57	27.1	34.9	Vitrified Clay
1102	O1L14SD2	M14D2	3.2	M14D1	0.4	281.8	0.01	8	0.013	0.91	142.45	533.77	26.7	100	Vitrified Clay
1408	O1L17SB6	M17B6	5.6	M17B5	4.7	229.2	0.004	8	0.01	2.38	116.14	444.28	26.1	36.9	PVC
1156	O1L14SA5	M14A5	-2.4	M14A4	-3.1	172.3	0.004	8	0.013	1.84	88.999	343.16	25.9	97.8	Vitrified Clay
645	O2L36SA5	M36A5	-2	M36A4	-2.2	84.2	0.003	8	0.01	2.2	104.84	413.76	25.3	43	PVC
404	O2L1SA1	M1A1	-1	W-1	-1.2	11	0.012	10	0.013	3.65	270.45	1071.6	25.2	37.8	Vitrified Clay
1088	O1L17A12	M17A12	4	M17A11	3.1	217.3	0.004	8	0.013	1.92	91.2	362.32	25.2	32.7	Vitrified Clay
4010	O2L19SA1	W-9	-0.4	M9A1	-0.3	20.8	0.005	8	0.01	2.56	116.55	488.56	23.9	34.3	PVC
1553	O1L17SF2	M17F2	3.9	M17F1	2.8	296.1	0.004	8	0.013	1.74	78.277	335.02	23.4	45.4	Vitrified Clay
4284	O1L17SA6	M17A6	-3.4	M17A5	-5.7	118.8	0.019	12	0.013	5.12	505.93	2230.1	22.7	52.4	Vitrified Clay
589	O2L7SA2	M7A2	-2	M7A1	-5.5	246.6	0.014	6	0.013	2.76	68.033	300.43	22.6	69.4	Vitrified Clay
3378	O2L7SC3	M7C3	0.7	M7C2	-0.1	139.7	0.006	8	0.013	2.1	91.361	410.39	22.3	33.8	Vitrified Clay
644	O2L36SA6	M36A6	-1.7	M36A5	-2	90.5	0.003	8	0.01	2.05	88.673	399.19	22.2	33.2	PVC
3684	O2L22SA4	M22A4	1.6	M22A5	2.2	112.5	0.005	8	0.013	1.97	85.088	386.07	22	48.1	
569	O2L7SD2	M7D2	1.8	M7D1	1	157	0.005	6	0.013	1.66	39.533	184.22	21.5	33.3	Vitrified Clay
457	O2L7SA1	M7A1	-5.5	W-7	-6.4	7.7	0.116	6	0.013	2.08	183.32	857.64	21.4	100	
524	O2L34SA2	M34A2	-4.6	M34A1	-5.5	25.8	0.036	12	0.012	7.36	694	3269.3	21.2	69.1	Ductile Iron
570	O2L7SD1	M7D1	1	M7A3	-0.6	136.4	0.012	6	0.013	2.43	56.333	272.74	20.7	36.3	Vitrified Clay
3512	O2L35SA2	M35A1	-1.2	M35A2	-0.1	286.5	0.004	8	0.01	2.19	89.89	436.87	20.6	45.6	PVC
4023	O2L5SA1	M5A1	-2.9	W-5	-3	10.6	0.005	6	0.01	2.01	46.17	225.16	20.5	31.2	PVC
1333	O1L40SA5	M40A4	2.7	M40A5	3.7	263.3	0.004	8	0.01	2.17	88.078	434.47	20.3	30.5	PVC
1329	O1L40SA3	M40A2	0.3	M40A3	1.4	286.8	0.004	8	0.01	2.18	88.078	436.66	20.2	30.5	PVC
3103	O2L34SG1	M34G1	3.8	M34F2	0.3	401.3	0.009	6	0.013	2.09	47.493	236.19	20.1	66.1	Vitrified Clay
3514	O2L35SA3	M35A2	0	M35A3	1.5	393.5	0.004	8	0.01	2.13	83.012	433.85	19.1	29.6	PVC
1016	O1L17SM1	M17M1	-0.8	M17A3	-1.3	132	0.004	8	0.01	2.21	85.5	450.98	19	29.8	PVC
1331	O1L40SA4	M40A3	1.5	M40A4	2.7	275	0.004	8	0.01	2.28	88.078	465.75	18.9	30	PVC
1327	O1L40SA2	M40A1	-0.6	M40A2	0.2	190.5	0.004	8	0.01	2.29	88.078	468.18	18.8	33.8	PVC
4128	O2L1SA8	M1A7	1.7	M1A8	1.9	44.8	0.004	12	0.013	2.19	187.8	1007.9	18.6	30.3	

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1555	O1L17SF3	M17F3	4	M17F2	3.9	16.5	0.006	8	0.013	2.06	78.277	421.82	18.6	31.1	Vitrified Clay
912	O2L5SA2	M5A2	-2.7	M5A1	-2.9	53.7	0.005	6	0.01	1.94	41.445	223.47	18.5	30.8	PVC
643	O2L36SA7	M36A7	-0.7	M36A6	-1.7	299.2	0.003	8	0.01	1.92	72.508	395.17	18.3	30.6	PVC
4129	O2L1SA9	M1A8	1.9	M1A9	3	256.4	0.004	12	0.013	2.26	186.3	1056.8	17.6	28.8	
1304	O1L14SC8	M14C8	1.3	M14C7	1	89.7	0.003	8	0.01	0.45	71.25	407.81	17.5	100	PVC
588	O2L7SA3	M7A3	-0.6	M7A2	-2	283.5	0.005	8	0.013	1.82	65.633	379.78	17.3	28.6	Vitrified Clay
3247	O2L18SC9	M18C9	3.4	M18C2	3	99.5	0.004	8	0.01	2.11	75.649	441.38	17.1	28.6	PVC
1502	O2L18ASA5	M18A-A5	0.7	M18A-A	0.2	162.3	0.003	8	0.01	1.88	67.499	395.19	17.1	55.5	PVC
1496	O2L18ASA3	M18A-A3	-0.3	M18A-A	-0.7	102.4	0.004	8	0.01	0.49	76.004	446.05	17	100	PVC
1704	O2L38SA3	M38A3	-5.5	M38A2	-7.2	382.4	0.004	8	0.013	1.69	59.324	358.4	16.6	32.2	
1306	O1L14SC9	M14C9	1.7	M14C8	1.3	115.8	0.004	8	0.01	0.45	71.25	444.4	16	100	PVC
538	O1L14SA4	M14A4	-3.1	M14A3	-2.6	57	-0.008	8	0.01	0.63	98.119	619.43	15.8	100	PVC
1412	O1L17SB7	M17B6	5.3	M17B7	5.7	143.6	0.003	8	0.01	1.69	57	362.66	15.7	50.5	PVC
537	O1L14SA3	M14A3	-2.6	M14A2	-3.6	68.4	0.013	8	0.013	0.63	98.119	628.94	15.6	100	
1500	O2L18ASA4	M18A-A4	0.2	M18A-A	-0.3	112.6	0.004	8	0.01	2.07	69.074	445.71	15.5	91.5	PVC
1172	O1L14SA7	M14A7	-1.6	M14A6	-0.5	131	-0.008	8	0.013	0.49	76.174	492.39	15.5	64.2	Vitrified Clay
3995	O2L36SC2	M36C1	-2	M36C2	-0.5	271.5	0.005	8	0.01	2.41	80.072	522.31	15.3	30.1	PVC
1014	O1L17SM2	M17M2	-0.3	M17M1	-0.8	94.7	0.005	8	0.01	2.26	74.1	491.29	15.1	29	PVC
1012	O1L17SM3	M17M3	0.6	M17M2	-0.3	244	0.004	8	0.01	1.98	62.7	437.59	14.3	26.8	PVC
642	O2L36SA8	M36A8	0.2	M36A7	-0.7	292.1	0.003	8	0.01	1.8	56.344	399.96	14.1	27.2	PVC
1425	O2L32SA1	W-32	-1.6	M32A1	-1.2	120.4	0.004	8	0.01	1.95	59.743	435.71	13.7	25	PVC
1506	O2L18ASA6	M18A-A6	1.2	M18A-A	0.7	121.8	0.004	8	0.01	2.04	61.199	460.67	13.3	26.6	PVC
3643	O2L18ASA2	M18A-A2	-0.7	M18A-A	0.4	95.8	-0.011	8	0.013	0.49	76.004	575.97	13.2	64.1	
3846	O2L4SA3	M4A2	0.3	M4A3	0.7	92.3	0.005	6	0.013	1.34	22.365	171.88	13	23.1	Vitrified Clay
3365	O2L7SC1	M7C1	-0.9	M7A1	-5.5	181.5	0.025	8	0.013	3.77	109.59	864.45	12.7	67.1	Vitrified Clay
3994	O2L36SC1	M36B1	-4	M36C1	-2	190.4	0.011	8	0.01	3.16	90.812	724.35	12.5	43	PVC
3426	O2L36SA1	M36A1	-5.2	W-36	-9	68	0.057	12	0.013	7	473.73	3804.2	12.5	71.6	
568	O2L7SD3	M7D3	2.7	M7D2	1.8	157.5	0.005	6	0.013	1.42	22.733	182.79	12.4	27.6	Vitrified Clay
1512	O2L18ASA8	M18A-A8	2.1	M18A-A	1.7	100.8	0.004	8	0.01	1.95	54.899	449.6	12.2	24	PVC
1377	O1L37SC1	M37A2	-2.8	M37A1	-3.2	98.7	0.004	8	0.01	2.01	56.185	465.32	12.1	23.8	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1510	O2L18ASA7	M18A-A7	1.7	M18A-A	1.2	120	0.004	8	0.01	2	55.844	464.08	12	24.7	PVC
1008	O1L17SM5	M17M5	1.9	M17M4	1	215.3	0.004	8	0.01	1.88	51.3	440.44	11.6	23.1	PVC
1010	O1L17SM4	M17M4	1	M17M3	0.6	105.8	0.004	8	0.01	1.89	51.3	444.2	11.5	24.4	PVC
1448	O2L31SA2	M31A2	-2.3	M31A1	-4	387.1	0.004	8	0.01	1.98	53.693	465.86	11.5	30.1	PVC
1606	O1L17SO1	M17O1	1.7	M17N1	0.1	315.6	0.005	8	0.01	2.11	57	498.88	11.4	28.5	PVC
3713	O2L22SA1	M22A1	-1.4	W-23	-2.2	16.1	0.048	12	0.013	6.58	389.91	3518.3	11.1	31.1	
682	O2L36SB3	M36B3	-0.1	M36B2	-3	325.9	0.009	8	0.01	2.78	73.19	660.47	11.1	31.7	PVC
865	O2L1SE3	M1E3	1.5	M1E2	0.7	171.5	0.005	6	0.013	1.28	18.75	172.65	10.9	22.1	Vitrified Clay
1166	O1L14SB1	M14B1	-1.7	M14A1	-4	304.2	0.007	10	0.013	2.27	91.913	847.57	10.8	46.6	Vitrified Clay
689	O2L36SD2	M36D2	1.9	M36D1	1	353.5	0.003	8	0.013	1.15	29.802	276.67	10.8	19.8	
1072	O1L17SQ1	M17Q2	-3.4	M17Q1	-4	143.7	0.004	8	0.013	0.24	37.05	344.55	10.8	100	Vitrified Clay
924	O2L5SA4	M5A4	-0.7	M5A3	-2.4	308.2	0.005	6	0.013	1.38	19.71	186.47	10.6	22.2	Vitrified Clay
794	O2L2SA2	M2A2	-1.3	M2A1	-2.1	174.8	0.005	8	0.013	1.52	38.7	366.74	10.6	25.6	Vitrified Clay
4012	O2L9SB1	M9A1	-0.3	M9B1	0.5	194.7	0.004	8	0.01	1.87	47.25	452	10.5	28.7	PVC
1128	O1L14SF1	M14F1	1.8	M14C7	1	250.4	0.003	8	0.013	0.2	31.35	302.71	10.4	100	Vitrified Clay
1414	O1L17SB9	M17B9	6.5	M17B7	6.1	98.6	0.004	8	0.01	1.83	45.6	443.5	10.3	21.7	PVC
1702	O2L38SA4	M38A4	-3.8	M38A3	-5.4	393.5	0.004	8	0.01	1.86	46.198	452.36	10.2	21.8	PVC
926	O2L5SA6	M5A6	0.5	M5A4	-0.7	280.1	0.005	6	0.013	1.24	17.19	169.58	10.1	21.7	Vitrified Clay
699	O1L17SL3	M17L3	1.8	M17L2	1.2	152.2	0.004	8	0.01	1.83	45.041	446.39	10.1	21.5	PVC
697	O1L17SL2	M17L2	1.2	M17L1	0.9	75.7	0.004	8	0.01	1.84	45.041	451.18	10	21.5	PVC
1373	O1L37SA3	M37A3	-1.6	M37A2	-2.8	245.7	0.005	8	0.01	1.96	47.831	482.4	9.9	23.3	PVC
532	O1L14SA1	M14A1	-4	W-14	-8.2	6.8	0.617	10	0.013	19.16	752.77	7726.2	9.7	84.9	
1557	O1L17SF4	M17F4	5.2	M17F3	4	350.6	0.003	8	0.013	1.27	29.542	317.28	9.3	24.9	Vitrified Clay
1592	O2L16SA5	M16A5	0.6	M16A4	-0.3	203.9	0.004	8	0.013	1.38	31.711	348.09	9.1	21.7	Vitrified Clay
986	O2L34SF1	M34F1	0.8	M34A6	-0.3	324.1	0.004	12	0.013	1.68	86.002	952.5	9	19.1	
1006	O1L17SM6	M17M6	2.5	M17M5	1.9	150.5	0.004	8	0.01	1.76	39.9	445.1	9	21.7	PVC
1371	O1L37SA4	M37A4	-0.4	M37A3	-1.6	236.2	0.005	8	0.01	1.98	44.699	500.45	8.9	21.9	PVC
4321	O2L18SC1	M18A1	-3.1	M18C1	2.5	150.6	0.037	8	0.013	4.1	92.029	1041.2	8.8	65.6	Vitrified Clay
1712	O2L38SB1	M38A1	-2.9	M38B1	-1.6	300.5	0.004	8	0.01	1.83	40.853	465.5	8.8	20.3	PVC
1196	O1L14SA8	M14A8	-0.6	M14A7	-1.6	247.4	0.004	8	0.013	1.34	29.64	342.71	8.6	82.2	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
928	O2L5SA7	M5A7	1.8	M5A6	0.5	282.1	0.005	6	0.013	1.18	14.67	169.64	8.6	20.7	Vitrified Clay
4475	O2L4SA2	M4A2	0.3	M4A1	0.1	16.8	0.011	6	0.013	1.81	22.365	260.6	8.6	26.5	Vitrified Clay
701	O1L17SL4	M17L4	2.3	M17L3	1.8	130.1	0.004	8	0.01	1.73	37.916	445.75	8.5	20.7	PVC
856	O2L1SJJ1	M1JJ1	1.7	M1D2	0.9	131.3	0.006	6	0.013	1.31	15.9	191.56	8.3	20.3	Vitrified Clay
1586	O2L16SA3	M16A3	-1.4	M16A2	-2.6	24.9	0.045	8	0.013	4.44	95.475	1150.3	8.3	25.7	Vitrified Clay
680	O2L36SI1	M36I1	1.5	M36B3	-0.1	300.2	0.005	8	0.01	1.99	42.6	514.71	8.3	24.4	PVC
1170	O1L14SA6	M14A6	-0.5	M14A5	-2.4	64.2	0.029	8	0.013	3.56	76.174	923.17	8.3	62	Vitrified Clay
659	O2L36SC3	M36C3	3.9	M36C2	-0.5	309.8	0.014	8	0.01	3.24	69.331	843.1	8.2	28	PVC
3278	O2L18SC2	M18C2	3	M18C1	2.5	140.1	0.004	12	0.013	1.75	83.839	1019.8	8.2	20.1	
3429	O2L25SA2	M25A2	-0.4	M25A1	-1	132.9	0.004	8	0.013	1.37	29.097	355.25	8.2	19.7	Vitrified Clay
1198	O1L14SA9	M14A9	0.4	M14A8	-0.6	249.5	0.004	8	0.013	1.31	27.93	342.65	8.2	41.9	Vitrified Clay
4014	O2L9SB2	M9B1	0.5	M9B2	1.5	123	0.008	6	0.01	2.01	23.625	295.15	8	26	PVC
953	O2L4SA4	M4A4	1.2	M4A3	0.7	103.7	0.005	6	0.013	1.15	13.545	169.51	8	21.7	Vitrified Clay
1394	O1L17SB1	M17B1	2.2	M17A11	1.6	20.6	0.03	10	0.01	0.71	173.14	2218.4	7.8	100	PVC
528	O2L34SA1	M34A1	-5.5	W-34	-11.1	5.9	0.953	14	0.012	29.8	1913.6	24545	7.8	87.2	Ductile Iron
1228	O1L14SA10	M14A10	1.2	M14A9	0.4	205.2	0.004	8	0.013	1.3	26.22	342.81	7.6	19	
1031	O1L17SN1	M17N1	0.1	M17A2	-1.9	188.1	0.011	12	0.013	2.77	125.4	1652.8	7.6	20.2	
1319	O1L17SQ4	M17Q4	4.1	M17Q3	3.3	199.6	0.004	8	0.013	1.29	25.65	343.31	7.5	19	Vitrified Clay
1277	O2L22SB1	M22B1	1.2	M22A2	-0.8	70.3	0.028	8	0.01	4.39	86.94	1177.4	7.4	55	PVC
1582	O2L16SB2	M16B2	-1.7	M16B1	-2	109.3	0.003	8	0.013	1.16	22.896	311.19	7.4	17.7	Vitrified Clay
1698	O2L38SA5	M38A4	-3.7	M38A5	-2.1	397.1	0.004	8	0.01	1.68	33.072	450.33	7.3	18.4	PVC
1431	O2L32SB2	M32A2	0.8	M32A1	-1.2	242.9	0.008	8	0.01	2.34	45.938	630.08	7.3	23.4	PVC
3083	O2L16SA1	M16A1	-2.8	W-16	-7.3	31.2	0.145	8	0.013	7	149	2064.8	7.2	70.1	Vitrified Clay
930	O2L5SA8	M5A8	3.1	M5A7	1.8	281.1	0.005	6	0.013	1.11	12.15	169.28	7.2	19	Vitrified Clay
1605	O1L17SO2	M17O2	2.9	M17O1	1.7	258.3	0.005	8	0.01	1.76	34.2	476.53	7.2	21.6	PVC
3516	O2L35SD1	M35A3	1.5	M35D1	2	109.8	0.005	8	0.01	1.78	34.432	480.46	7.2	24.3	PVC
4096	O2L1SA10	M1A9	3	M1A10	4.3	221.4	0.006	8	0.013	1.51	28.75	410.73	7	30.3	Vitrified Clay
1718	O2L16SA2	M16A2	-2.6	M16A1	-2.8	25.6	0.007	12	0.013	2.24	95.475	1378.3	6.9	22.8	
692	O2L36SB4	M36B4	0.5	M36B3	-0.1	188.5	0.003	8	0.01	1.5	28.201	410.79	6.9	22.7	PVC
863	O2L1SK2	M1E4	3	M1E3	1.5	125.9	0.012	6	0.013	1.78	18.75	274.92	6.8	21.1	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
4273	O2L32SC2	M32C1	0	M32C2	1	151.6	0.007	6	0.013	1.32	13.805	204.55	6.7	17.3	Vitrified Clay
1130	O1L14SF2	M14F2	2.5	M14F1	1.8	250.2	0.003	8	0.013	0.13	19.95	296.94	6.7	100	Vitrified Clay
3990	O2L35SA4	M35A3	1.5	M35A4	2.7	270.8	0.004	8	0.01	1.7	31.4	469.34	6.7	23.1	PVC
667	O2L36SG1	M36G1	5	M36C3	3.9	232.8	0.005	8	0.013	1.34	24.739	371.09	6.7	22.2	
1588	O2L16SD1	M16D1	-0.1	M16A3	-1.4	285.7	0.005	8	0.013	1.34	24.462	371.41	6.6	24.6	Vitrified Clay
1433	O2L32SA3	M32A2	0.8	M32A3	1.1	73.4	0.005	8	0.01	1.78	31.068	500.5	6.2	19.9	PVC
793	O2L2SD1	M2D1	-1.7	M2A1	-2.1	55.3	0.007	6	0.013	1.31	12.9	207.87	6.2	27.9	Vitrified Clay
796	O2L2SC1	M2C1	-1.8	M2A1	-2.1	40	0.007	6	0.013	1.28	12.6	203.11	6.2	27.9	Vitrified Clay
1356	O2L16SA6	M16A6	1.1	M16A5	0.6	98.2	0.005	8	0.01	1.82	31.711	512.97	6.2	19.2	PVC
1477	O2L39SA1	W-39	-2	M39A1	-1.6	76	0.005	8	0.01	0.2	31.501	511.59	6.2	100	PVC
1418	O1L17SB10	M17B10	7	M17B9	6.5	112.2	0.004	8	0.012	1.32	22.8	372.14	6.1	19.3	Ductile Iron
869	O2L1SE1	M1E1	-0.3	M1A2	-0.8	104.8	0.005	8	0.013	1.35	23.25	382.92	6.1	35.9	Vitrified Clay
867	O2L1SE2	M1E2	0.7	M1E1	-0.3	210.7	0.004	8	0.013	1.27	21.45	363.06	5.9	16.6	Vitrified Clay
4182	O2L7SB2	M1D1	-0.2	M1A1	-1	175.9	0.005	8	0.013	1.28	21.6	366.44	5.9	33.8	Vitrified Clay
1444	O2L31SA3	M31A3	-0.1	M31A2	-2.3	325.9	0.007	8	0.01	2.03	34.205	581.9	5.9	21.2	PVC
1442	O2L31SA4	M31A4	0.4	M31A3	-0.1	326.6	0.001	8	0.01	0.92	15.54	264.6	5.9	17.6	PVC
703	O1L17SL5	M17L5	3.6	M17L4	2.3	301.8	0.004	8	0.01	1.59	26.516	455.56	5.8	18.2	PVC
911	O2L5SA3	M5A3	-2.4	M5A2	-2.7	54.7	0.005	8	0.01	1.66	27.585	476.76	5.8	19.7	PVC
3198	O2L18SA1	W-18	-5.2	M18A1	-3.1	11.3	0.186	8	0.013	0.86	134.55	2339.4	5.8	100	Vitrified Clay
1522	O2L34SC2	M34C2	-0.3	M34C1	-1	152.4	0.005	8	0.01	1.64	26.396	480.62	5.5	16.7	PVC
4181	O2L7SB2	M1D2	0.9	M1D1	-0.2	268.1	0.004	8	0.013	1.22	19.5	358.58	5.4	16.2	Vitrified Clay
3187	O2L30SE1	M30B2	0	M30B1	-0.5	58.1	0.009	6	0.013	1.41	12.6	233.56	5.4	16.6	Vitrified Clay
976	O2L34SF2	M34F2	1.9	M34F1	-0.8	304.3	0.009	12	0.013	2.23	78.915	1480.9	5.3	58.6	
3193	O2L30SB4	M30B4	1.7	M30B3	1	143.5	0.005	4	0.01	1.05	4.095	77.556	5.3	18.3	PVC
1351	O2L34SL	M34L1	1.6	M34A8	0	389.1	0.004	8	0.013	1.16	18.058	343.39	5.3	51	Vitrified Clay
1714	O2L38SB3	M38B1	-1.6	M38B2	0.1	298.2	0.006	8	0.01	1.77	27.236	527.58	5.2	18.7	PVC
4002	O1L17SQ0	M17Q0	0.6	W-17	-0.1	26.7	0.027	8	0.01	3.86	59.217	1150	5.1	20.2	PVC
1083	O1L17SG1	M17G1	4.8	M17A10	4.1	172.1	0.004	8	0.01	1.49	22.8	446.44	5.1	15.3	PVC
1174	O1L14SM1	M14M1	-0.4	M14A7	-1.6	293.9	0.004	8	0.013	1.15	17.385	343.06	5.1	67.9	Vitrified Clay
1593	O2L16SA4	M16A4	-0.3	M16A3	-1.4	188.8	0.006	12	0.013	1.85	62.92	1253.3	5	18.3	

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
848	O2L1SJJ2	M1JJ2	2.1	M1JJ1	1.7	66.2	0.007	6	0.013	1.21	10.2	203.87	5	17.4	Vitrified Clay
1563	O1L14SH2	M14H2	3.4	M14H1	3	117.6	0.004	8	0.013	0.11	17.1	342.84	5	100	Vitrified Clay
859	O2L1SB1	M1A1	-1	M1B1	-0.4	124.3	0.005	8	0.013	1.24	18.6	375.29	5	33.1	Vitrified Clay
1321	O1L17SQ3	M17Q3	3.3	M17Q2	-3.4	341	0.02	8	0.013	2.51	37.05	759.03	4.9	59.8	Vitrified Clay
4020	O2L5SD2	M5D1	-1	M5D2	-0.8	43.7	0.005	6	0.01	1.3	10.71	221.39	4.8	15	PVC
1055	O1L17ST2	M17T2	-3.3	M17T1	-3.5	39.8	0.004	12	0.013	1.48	48.45	1013.6	4.8	14.1	
1021	O1L17SO3	M17O3	4.1	M17O2	2.9	270.1	0.005	8	0.01	1.57	22.8	477.74	4.8	17.1	PVC
1450	O2L31SB3	M31B2	0.8	M31B1	-0.4	235.1	0.005	8	0.01	1.61	23.338	493.11	4.7	17	PVC
4021	O2L5SD3	M5D2	-0.8	M5D3	0.7	341.9	0.005	6	0.013	0.98	7.875	169	4.7	14.9	Vitrified Clay
3657	O2L31SB1	M31A1	-4	W-31	-9.6	36.6	0.153	8	0.01	8.32	125.43	2756.8	4.5	68.3	PVC
1208	O1L14SS2	M14S2	2.1	M14S1	1	288.3	0.004	8	0.013	1.05	14.82	325.73	4.5	15.2	Vitrified Clay
3992	O2L35SA5	M35A4	2.8	M35A4	3.6	218.5	0.004	8	0.01	1.36	19.14	423.99	4.5	14.2	PVC
1312	O1L14SG1	M14G1	2.4	M14C9	1.7	177.5	0.004	8	0.01	0.13	19.95	442.78	4.5	100	PVC
1696	O2L38SA5	M38A6	-1.1	M38A5	-2	224.6	0.004	8	0.01	1.45	19.946	451.2	4.4	14.3	PVC
1613	O2L3SD1	M3D1	-0.2	M3A1	-1.8	527	0.003	8	0.013	0.96	13.11	296.95	4.4	57.1	Vitrified Clay
1776	O2L30SA4	M30A4	1.4	M30A3	0.6	183.3	0.005	6	0.013	0.98	7.56	171.47	4.4	13.8	Vitrified Clay
3476	O1L40SA1	M40A1	-0.6	W-40	-1.5	10.6	0.085	8	0.01	6.6	90.528	2054.1	4.4	22.9	PVC
1202	O1L14SS1	M14S1	1	M14A7	-1.6	247.7	0.011	8	0.013	1.78	24.368	556.67	4.4	57.9	Vitrified Clay
732	O2L3SL1	M3L1	0.4	M3H1	-0.1	113.6	0.005	6	0.013	0.97	7.41	170.35	4.3	42	Vitrified Clay
661	O2L36SC4	M36C4	5.1	M36C3	3.9	227.5	0.005	8	0.01	1.58	21.482	494.65	4.3	20.9	PVC
4064	O2L2SP1	M2P1	0	M2A2	-1.3	292.9	0.004	8	0.013	1.14	15.3	357.43	4.3	18	Vitrified Clay
1053	O1L17ST3	M17T3	-2.8	M17T2	-3.3	99.7	0.005	12	0.013	1.6	48.45	1132.6	4.3	14.5	
576	O2L7SE1	M7E1	4.9	M7D3	2.7	432.8	0.005	6	0.013	1.02	7.7333	181.57	4.3	18.9	Vitrified Clay
4218	O2L25SA3	M25A2	-0.4	M25A3	0.2	107.7	0.006	8	0.013	1.29	17.127	404.83	4.2	16.7	Vitrified Clay
963	O2L4SA5	M4A5	1.8	M4A4	1.2	122.9	0.005	6	0.013	0.97	7.245	171.5	4.2	16.5	Vitrified Clay
3192	O2L30SF1	M30B3	1	M30B2	0	167.7	0.006	6	0.013	1.1	8.19	194.44	4.2	15.1	Vitrified Clay
137	O1L17SJ1	M17J1	3.7	M17A9	2.6	254	0.004	8	0.013	1.13	14.962	356.87	4.2	13.2	
1567	O1L14SH4	M14H4	4.2	M14H3	3.8	105.9	0.004	8	0.013	0.09	14.25	341.52	4.2	100	Vitrified Clay
3175	O2L30SA2	M30B1	-0.5	M30A1	-0.9	23.9	0.018	6	0.013	1.85	13.545	333.55	4.1	20.1	Vitrified Clay
1706	O2L38SC1	M38A2	-2	M38C1	-0.7	296.3	0.004	12	0.013	1.42	41.003	1030.2	4	13	

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
860	O2L1SB2	M1B1	-0.4	M1B2	1.2	373.3	0.004	8	0.013	1.09	13.8	354.63	3.9	14.3	Vitrified Clay
1612	O2L3SD2	M3D2	0.6	M3D1	-0.2	284.2	0.003	8	0.013	0.89	11.115	287.73	3.9	13.9	Vitrified Clay
735	O2L3SA3	M3A3	0.4	M3A2	-1.3	474.8	0.004	8	0.013	0.99	12.255	321.66	3.8	33.7	Vitrified Clay
1565	O1L14SH3	M14H3	3.8	M14H2	3.4	53.6	0.007	8	0.013	0.11	17.1	450.68	3.8	100	Vitrified Clay
1447	O2L31SB1	M31B1	-0.4	M31A1	-4	231.3	0.015	8	0.01	2.67	32.788	875.9	3.7	27.5	PVC
1025	O1L17SN2	M17N2	3.7	M17N1	0.1	202.6	0.018	8	0.01	2.84	34.2	935.91	3.7	25.7	PVC
1481	O2L39SA2	M39A1	-1.6	M39A2	-0.3	346.5	0.004	8	0.01	0.1	15.75	440.09	3.6	100	PVC
1435	O2L32SA4	M32A4	1.9	M32A3	1.1	179	0.004	8	0.01	1.4	16.517	465.42	3.5	15.4	PVC
3121	O2L29SB1	M29B1	-1	M29A1	-1.6	116	0.005	6	0.01	1.24	8.19	231.48	3.5	16	PVC
1749	O2L31SB3	M31B3	1.7	M31B2	0.8	175	0.005	8	0.01	1.52	17.767	505.55	3.5	14.5	PVC
4451	O2L18SB1	M18A1	-3.1	M18B1	-2.4	108	0.007	8	0.013	0.1	15.435	439.69	3.5	100	Vitrified Clay
1081	O1L17SH1	M17H1	2.6	M17A10	2.3	40.6	0.006	8	0.01	1.65	19.237	553.53	3.5	13.4	PVC
676	O2L36SB6	M36B6	3	M36B5	2.1	238.2	0.004	8	0.01	1.31	14.901	442.9	3.4	12.4	PVC
1210	O1L14SS3	M14S3	2.9	M14S2	2.1	210.9	0.004	8	0.013	0.99	11.115	334.02	3.3	13.5	Vitrified Clay
742	O2L3SA4	M3A4	1.4	M3A3	0.4	285.6	0.004	8	0.013	0.94	10.545	320.92	3.3	12.9	Vitrified Clay
1070	O1L17SQ1	M17Q1	-4	M17Q0	0.6	105.3	-0.043	8	0.013	0.24	37.05	1128.7	3.3	62.5	Vitrified Clay
1716	O2L38SB3	M38B2	0.1	M38B3	1.5	395.4	0.003	8	0.01	1.22	13.618	416.54	3.3	14.6	PVC
786	O2L2SD3	M2D3	1.5	M2D2	0	255.5	0.006	6	0.013	1.01	6.3	192.96	3.3	12.7	Vitrified Clay
3384	O2L25SB2	M25B2	0.9	M25B1	0.3	267.7	0.002	8	0.013	0.79	8.76	269.31	3.3	12.2	Vitrified Clay
1079	O1L17SH2	M17H2	3	M17H1	2.6	95.1	0.005	8	0.01	1.48	16.388	506.06	3.2	13.5	PVC
1308	O1L14SG1	M14C10	2.6	M14C9	1.7	204.6	0.004	8	0.01	0.09	14.25	446.3	3.2	100	PVC
691	O2L36SB5	M36B5	2.1	M36B4	0.5	346.3	0.004	8	0.01	1.36	14.901	467.13	3.2	15	PVC
1796	O2L26SA1	M26A1	-0.1	W-26	-0.3	30.7	0.007	6	0.019	0.72	4.41	139.01	3.2	10.9	
610	O2L2SA4	M2A4	1.5	M2A3	0.3	385.4	0.003	8	0.013	0.88	9.6	302.61	3.2	12.4	Vitrified Clay
1379	O1L37SC1	M37C1	-2.6	M37A1	-3.2	151.6	0.004	8	0.01	1.25	13.574	428.51	3.2	18.2	PVC
1349	O2L34SU1	M34U1	2.6	M34L1	1.6	241.1	0.004	8	0.013	1.02	10.978	351.02	3.1	13.8	Vitrified Clay
705	O1L17SL6	M17L6	4	M17L5	3.6	88.8	0.005	8	0.01	1.4	15.116	484.91	3.1	14.5	PVC
990	O2L34SI1	M34J1	0.1	M34A7	-0.5	104.2	0.006	6	0.013	1	6.0375	194.22	3.1	48.3	Vitrified Clay
3349	O2L25SA4	M25A4	1	M25A3	0.2	124.4	0.006	8	0.01	1.6	17.127	554.7	3.1	13.6	PVC
3390	O2L25SA5	M25A4	1	M25A5	1.5	128.6	0.004	8	0.01	1.28	13.662	443.97	3.1	12.6	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
3392	O2L25SA6	M25A6	1.9	M25A5	1.5	110	0.004	8	0.01	1.26	13.347	435.75	3.1	12	PVC
767	O2L2SA3	M2A3	0.3	M2A2	-1.3	170.1	0.009	8	0.013	1.48	15.6	517.85	3	17.3	Vitrified Clay
1610	O2L3SD3	M3D3	1.5	M3D2	0.6	298.5	0.003	8	0.013	0.85	8.835	299.44	3	12.6	Vitrified Clay
4478	O2L4SG1	M4G1	3	M4A1	0.1	347.6	0.008	6	0.013	1.16	6.7725	230.02	2.9	21.5	Vitrified Clay
567	O2L7SD4	M7D4	4.4	M7D3	2.7	329.2	0.005	6	0.013	0.93	5.4	183.62	2.9	17.8	
932	O2L5SD4	M5D4	2.2	M5D3	0.7	315.1	0.005	6	0.013	0.87	5.04	173.17	2.9	13.2	Vitrified Clay
3518	O2L35SB1	M35A1	-1.3	M35B1	2	326.2	0.01	8	0.01	2.01	20.636	709.15	2.9	44.9	PVC
3358	O2L25SB1	M25B1	0.3	M25A1	-1	149.3	0.008	8	0.013	1.39	14.115	494.2	2.9	16	Vitrified Clay
3195	O2L30SF1	M30F1	1.8	M30B3	1	205.5	0.004	4	0.01	0.77	1.89	69.272	2.7	16.2	PVC
804	O2L2SC2	M2C2	-1.3	M2C1	-1.8	83.4	0.006	6	0.013	0.98	5.4	198.28	2.7	14.1	Vitrified Clay
666	O2L36SG2	M36G2	6	M36G1	5	235.8	0.004	8	0.01	1.26	12.37	454.49	2.7	14.4	PVC
1719	O2L16SB1	M16B1	-2	M16A1	-2.8	114.9	0.006	12	0.013	1.58	34.912	1283.3	2.7	19.1	
3113	O2L29SA2	M29A2	-0.7	M29A1	-1.6	160.7	0.006	8	0.01	1.46	14.175	527.71	2.7	13.1	PVC
595	O2L7SF1	M7F1	4.1	M7D2	1.8	335.2	0.007	6	0.013	1.01	5.4	207.68	2.6	21.3	
3996	O2L36SD1	M36B1	-4	M36D1	1	188.9	0.026	8	0.01	3.13	29.802	1147.1	2.6	36.2	PVC
1406	O1L17SI1	M17I1	4.9	M17B5	4.7	64.3	0.004	8	0.01	1.2	11.4	439.57	2.6	24.9	PVC
4269	O1L14SF3	M14F2	2.5	M14F3	3	132.3	0.004	8	0.013	0.05	8.55	330.07	2.6	100	Vitrified Clay
4418	O2L30SA2	M30A2	-0.2	M30A1	-0.9	85.8	0.009	8	0.013	1.37	12.915	501.36	2.6	14.5	
1416	O1L17SE1	M17E1	7	M17B9	6.5	115	0.004	8	0.01	1.21	11.4	445.98	2.6	16.4	PVC
1004	O1L17SM7	M17M7	3.8	M17M6	2.5	319.4	0.004	8	0.01	1.21	11.4	446.35	2.6	15.7	PVC
1410	O1L17SD1	M17D1	6.2	M17B6	5.6	164.6	0.004	8	0.01	1.21	11.4	446.41	2.6	23.1	PVC
1420	O1L17SB11	M17B11	7.8	M17B10	7	190.4	0.004	8	0.01	1.23	11.4	457.07	2.5	13.8	PVC
842	O2L1SJJ3	M1JJ3	2.7	M1JJ2	2.1	81.2	0.007	6	0.013	0.98	5.1	205.35	2.5	13	Vitrified Clay
637	O2L36SA9	M36A9	1	M36A8	0.2	86.2	0.009	8	0.01	1.81	16.625	670.63	2.5	19.2	PVC
3414	O2L18SA2	M18A2	-2.5	M18A1	-3.1	163.8	0.004	12	0.013	0.07	24.57	991.79	2.5	100	
784	O2L2SD4	M2D4	3	M2D3	1.5	383.8	0.004	6	0.013	0.75	3.9	157.44	2.5	11.6	Vitrified Clay
3419	O2L18SA3	M18A3	-1.6	M18A2	-2.5	255	0.003	8	0.013	0.05	7.875	320.4	2.5	100	Vitrified Clay
709	O2L3SH3	M3H3	1.8	M3H2	1.3	115.2	0.005	6	0.013	0.81	4.135	169.18	2.4	39.7	Vitrified Clay
3179	O2L30SB5	M30B5	2.2	M30B4	1.7	110.8	0.005	6	0.013	0.8	4.095	169.15	2.4	10.6	Vitrified Clay
3331	O2L25SC1	M25C1	0.6	M25A2	-0.4	133.3	0.008	6	0.013	1.05	5.355	221.35	2.4	18.3	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
673	O2L36SF1	M36F1	3	M36D2	1.9	139.7	0.008	8	0.01	1.66	14.901	619.99	2.4	17.2	PVC
1427	O2L32SC1	M32A1	-0.6	M32C1	-0.4	27.1	0.007	8	0.01	1.53	13.805	574.73	2.4	11.3	PVC
1186	O1L14SM3	M14M3	3	M14M2	2.2	209.2	0.004	8	0.013	0.93	8.265	347.74	2.4	10.9	Vitrified Clay
3305	O2L24SA1	M24D1	-0.9	M24A1	-1.6	169.2	0.004	6	0.013	0.75	3.78	159.65	2.4	55.5	Vitrified Clay
1027	O1L17SN3	M17N3	4.7	M17N2	3.7	210.4	0.005	8	0.01	1.28	11.4	483.64	2.4	14.8	PVC
639	O2L36SH2	M36H2	5.1	M36H1	3	229.5	0.009	8	0.01	1.77	15.703	669.54	2.3	14.1	PVC
1230	O1L14SA11	M14A11	2	M14A10	1.2	138.9	0.006	8	0.013	1.1	9.69	415.7	2.3	14.6	Vitrified Clay
3411	O2L18SE1	M18E1	-1.8	M18A2	-2.5	142.4	0.005	8	0.013	0.06	8.82	380.31	2.3	100	Vitrified Clay
663	O2L36SC5	M36C5	6	M36C4	5.1	220.1	0.004	8	0.01	1.22	10.741	463.16	2.3	12.7	PVC
4063	O2L2SR1	M2R1	1.8	M2P1	0	423.6	0.004	8	0.013	0.93	8.1	352.99	2.3	12.3	Vitrified Clay
1029	O1L17SN4	M17N4	5.3	M17N3	4.7	122.5	0.005	8	0.01	1.31	11.4	497.52	2.3	10.6	PVC
1603	O2L38SD1	M38D1	0.1	M38A6	-1	190.5	0.006	8	0.01	1.4	12.154	530.84	2.3	10.8	PVC
4479	O2L4SA1	M4A1	0.1	W-4	-4.6	7.7	0.602	6	0.013	8.39	44.529	1953.9	2.3	65.6	Vitrified Clay
592	O2L7SG1	M7G1	3.9	M7D1	1	328.7	0.009	6	0.013	1.11	5.4	237.34	2.3	22.9	
4018	O2L5SD1	M5A2	-2.7	M5D1	-1	360.5	0.005	8	0.01	1.25	10.71	475.56	2.3	16.5	PVC
1526	O2L34SC4	M34C4	2.9	M34C3	1.7	308.5	0.004	12	0.013	1.17	22.604	1009.7	2.2	10.7	Vitrified Clay
1561	O1L14SH1	M14H1	3	M14D2	1.3	47	0.036	8	0.013	0.15	22.8	1025.4	2.2	100	Vitrified Clay
1537	O2L34SB3	M34B3	2.9	M34B2	2.3	139.3	0.004	8	0.01	1.23	10.427	470.36	2.2	10.3	PVC
1535	O2L34SB2	M34B2	2.3	M34B1	1.7	122.7	0.004	8	0.01	1.23	10.427	471.99	2.2	13.1	PVC
647	O2L36SE1	M36E1	2.2	M36A3	-2.4	311.1	0.015	8	0.01	2.24	18.913	864.78	2.2	27	PVC
4028	O2L3SB1	M3A4	1.4	M3B1	1.9	100.8	0.005	6	0.013	0.78	3.705	170.08	2.2	13.4	Vitrified Clay
4066	O2L2SP2	M2P1	0	M2P2	0.5	91.8	0.006	6	0.013	0.9	4.2	196.19	2.1	14.4	
1463	O2L34SA12	M34A12	1.7	M34A11	1.5	31.8	0.004	8	0.013	0.92	7.6125	359.79	2.1	50.8	Vitrified Clay
1462	O2L34SA13	M34A13	2.1	M34A12	1.7	127.9	0.003	8	0.013	0.8	6.5625	314.43	2.1	25.2	Vitrified Clay
1528	O2L34SC5	M34C5	4.1	M34C4	2.9	308.2	0.004	12	0.013	1.15	21	1010.1	2.1	10.2	Vitrified Clay
1182	O1L14SM2	M14M2	2.2	M14M1	-0.4	216.3	0.012	8	0.013	1.51	12.255	591.62	2.1	23.5	Vitrified Clay
1068	O1L17SQ0	M17T1	-3.5	M17A1	-7	161.1	0.022	12	0.013	2.67	48.45	2353.3	2.1	42	
728	O2L3SL2	M3L2	0.9	M3L1	0.4	83.1	0.005	6	0.013	0.82	3.705	181.11	2	12.1	Vitrified Clay
4387	O2L32SB2	M32B1	2	M32B2	3	272.8	0.004	8	0.01	1.08	8.699	426.9	2	11	PVC
3181	O2L30SB6	M30B6	2.7	M30B5	2.2	91.7	0.005	6	0.013	0.84	3.78	186	2	10.3	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
788	O2L2SD2	M2D2	0	M2D1	-1.7	68.4	0.025	6	0.013	1.8	8.1	398.66	2	14.9	Vitrified Clay
974	O2L34SF2	M34F3	2.7	M34F2	1.9	281.3	0.003	8	0.013	0.77	6.1235	303.34	2	17.8	Vitrified Clay
947	O2L4SB1	M4B1	2.5	M4A3	0.7	377.4	0.005	6	0.013	0.78	3.465	172.94	2	17.1	Vitrified Clay
1214	O1L14SS4	M14S4	3.7	M14S3	2.9	209.4	0.004	8	0.013	0.87	6.84	343.46	2	11.1	Vitrified Clay
3190	O2L30SE1	M30E1	1.5	M30B2	0	205.1	0.007	4	0.01	0.95	1.89	94.953	2	17.5	PVC
798	O2L2SF1	M2F1	0.4	M2C1	-1.8	420.7	0.005	6	0.013	0.81	3.6	182.25	2	13.3	Vitrified Clay
638	O2L36SH1	M36H1	3	M36A8	0.2	96.2	0.029	8	0.01	3.01	23.555	1198.8	2	20.5	PVC
3900	O2L34SA14	M34A13	2.1	M34A14	2.3	50.2	0.003	8	0.013	0.74	5.775	296.44	1.9	9.8	
4417	O2L30SA3	M30A3	0.6	M30A2	-0.2	86.2	0.009	8	0.013	1.25	9.765	501.36	1.9	10.7	
1533	O2L34SD1	M34D1	2.9	M34B1	1.7	285.9	0.004	8	0.01	1.13	8.778	451.03	1.9	12.8	PVC
3136	O2L34SL2	M34L2	2.3	M34L1	1.6	126.4	0.006	6	0.01	1.1	4.8225	248.74	1.9	15.4	PVC
1358	O2L16SA7	M16A7	2.8	M16A6	1.1	397.2	0.004	8	0.01	1.14	8.8737	458.56	1.9	13.9	PVC
3988	O1L37SC1	M14D5	3.5	M14D4	2.8	225.2	0.003	8	0.013	0.04	5.7	298.04	1.9	100	Vitrified Clay
1314	O1L14SG2	M14G2	3.3	M14G1	2.4	203	0.004	8	0.01	0.05	8.55	448.05	1.9	100	PVC
1539	O2L34SB4	M34B4	3.5	M34B3	2.9	146.2	0.004	8	0.01	1.13	8.6771	455.49	1.9	10	PVC
3126	O2L29SB2	M29B2	0	M29B1	-1	152.4	0.007	6	0.01	1.18	5.04	265.2	1.9	11.7	PVC
3225	O2L18SB2	M18B2	-1.6	M18B1	-2.4	137	0.006	8	0.013	0.05	7.875	422.13	1.9	100	Vitrified Clay
821	O2L1SB3	M1B2	1.2	M1B3	2.4	277.1	0.004	8	0.013	0.88	6.6	357.79	1.8	11.5	Vitrified Clay
1531	O2L34SD2	M34D2	3.6	M34D1	2.9	139.4	0.005	8	0.01	1.18	8.778	481.37	1.8	9.6	PVC
378	O2L3SG1	M3G1	0.2	M3A2	-1.3	398.5	0.004	8	0.013	0.81	5.985	330.52	1.8	31.7	Vitrified Clay
3902	O2L13SA1	W-13	2.7	M13A1	3.2	115.4	0.004	8	0.01	1.14	8.33	464.05	1.8	9.2	PVC
1601	O2L38SD2	M38D2	0.7	M38D1	0.2	191.8	0.002	8	0.01	0.83	6.0769	341.53	1.8	8.6	PVC
671	O2L36SD3	M36D3	3	M36D2	1.9	76.5	0.014	8	0.01	2.03	14.901	837.85	1.8	17.2	PVC
967	O2L4SG2	M4G2	5.4	M4G1	3	360.7	0.007	6	0.013	0.88	3.6225	205.41	1.8	10.6	Vitrified Clay
769	O2L2SJ1	M2A3	0.3	M2J1	0.1	127.5	-0.001	8	0.013	0.02	3.3	192.16	1.7	25.2	Vitrified Clay
695	O1L17SL1	M17L1	0.9	M17A8	-2.1	21.4	0.139	8	0.01	6.35	45.041	2631.4	1.7	44.3	PVC
636	O2L36SA10	M36A10	1.4	M36A9	1	88	0.005	8	0.01	1.17	8.3125	487.09	1.7	11.1	PVC
1520	O2L34SC1	M34C1	-1	M34A2	-4.6	374	0.01	12	0.01	2.17	34.417	2030.2	1.7	32	PVC
640	O2L36SH3	M36H3	6	M36H2	5.1	213.5	0.004	8	0.01	1.12	7.8517	465.33	1.7	10.8	PVC
585	O2L7SA4	M7A4	1.3	M7A3	-0.6	364.9	0.005	8	0.013	0.94	6.6	391.35	1.7	18.6	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
757	O2L3SA6	M3A6	2.9	M3A5	1.7	259.6	0.005	6	0.013	0.72	2.85	169.07	1.7	10.2	Vitrified Clay
992	O2L34SJ2	M34K1	1.1	M34J1	0.1	182.5	0.006	6	0.013	0.8	3.15	187.35	1.7	10.5	Vitrified Clay
934	O2L5SD5	M5D5	3.4	M5D4	2.2	254	0.005	6	0.013	0.72	2.835	169.45	1.7	10.4	Vitrified Clay
1569	O1L14SH5	M14H5	5.2	M14H4	4.2	246.4	0.004	8	0.013	0.82	5.7	343.76	1.7	54.5	Vitrified Clay
3418	O2L18ASA4	M18A4	-0.9	M18A3	-1.6	164.1	0.004	8	0.013	0.04	5.67	343.92	1.6	100	Vitrified Clay
4104	O2L1SBB1	M1A7	1.7	M1BB1	2.4	89.8	0.008	6	0.013	0.93	3.6	218.9	1.6	35.8	Vitrified Clay
823	O2L1SB4	M1B3	2.4	M1B4	3.5	154.1	0.007	4	0.013	0.7	1.2	73.532	1.6	13.9	Vitrified Clay
4477	O2L4SH1	M4H1	2.5	M4A1	0.1	404.3	0.006	6	0.013	0.82	3.15	194.02	1.6	20	Vitrified Clay
1037	O1L17ST4	M17T4	1.1	M17T3	-2.8	190.2	0.021	12	0.013	2.41	37.05	2289.8	1.6	12.9	
1590	O2L16SD2	M16D2	2	M16D1	-0.1	279	0.008	8	0.013	1.11	7.5542	470.5	1.6	13.1	Vitrified Clay
1310	O1L14SC11	M14C11	3.1	M14C10	2.6	135.7	0.004	8	0.01	0.05	7.125	444.74	1.6	100	PVC
4009	O2L9SA2	M9A1	-0.3	M9A2	1.1	236.1	0.006	12	0.013	1.29	19.688	1231.2	1.6	16.2	
3981	O2L15SA1	W-15	3.5	M15A1	4.5	266.7	0.004	8	0.01	1.01	6.7375	431.72	1.6	8.5	PVC
894	O2L1SA11	M1A10	5.9	M1A11	6.4	146.8	0.003	8	0.01	0.96	6.25	411.46	1.5	8.3	PVC
1437	O2L32SD1	M32D1	1.4	M32A3	1.1	78.3	0.003	8	0.01	0.93	6.02	398.51	1.5	13.2	PVC
758	O2L3SA5	M3A5	1.7	M3A4	1.4	87.5	0.004	8	0.013	0.75	4.845	322.82	1.5	10.5	Vitrified Clay
3950	O2L29SA3	M29A2	-0.7	M29A3	0.2	149.9	0.006	8	0.01	1.23	7.875	529.4	1.5	10.5	PVC
1524	O2L34SC3	M34C3	1.7	M34C2	-0.3	30.9	0.064	8	0.01	4.12	26.396	1782.6	1.5	12.5	PVC
4153	O2L1SV1	M1U1	2.6	M1V1	3	43.4	0.009	4	0.013	0.76	1.2	81.985	1.5	8.8	Vitrified Clay
711	O2L3SH4	M3H4	2.5	M3H3	1.8	81.3	0.009	4	0.013	0.73	1.14	79.253	1.4	12.3	Vitrified Clay
4159	O2L1SS1	M1A4	1	M1S1	1.8	120.9	0.007	6	0.013	0.85	3	208.66	1.4	39.3	Vitrified Clay
613	O2L2SA5	M2A5	1.9	M2A4	1.5	124.8	0.004	8	0.013	0.77	4.8	336.41	1.4	10.3	Vitrified Clay
3435	O1L37SA1	M37A1	-3.2	W-37	-3.7	8.4	0.056	12	0.01	4.99	69.759	4904.3	1.4	12.4	PVC
1739	O2L16SB3	M16B3	-1.5	M16B2	-1.7	50.3	0.004	12	0.013	1.03	14.321	1008.4	1.4	10.3	
618	O2L3SD4	M3D4	2	M3D3	1.5	115	0.004	8	0.013	0.8	4.845	350.41	1.4	10	Vitrified Clay
4428	O2L16SC1	M16A1	-2.8	M16C1	2.2	437.7	0.011	8	0.013	1.3	7.875	576.76	1.4	24.5	
4057	O2L2ST1	M2R1	1.8	M2T1	2.3	85.8	0.006	6	0.013	0.8	2.7	198.53	1.4	11	Vitrified Clay
4030	O2L3SB2	M3B1	1.9	M3B2	2.8	214	0.005	6	0.013	0.68	2.28	169.53	1.3	9.1	Vitrified Clay
4271	O2L4SG3	M4G2	5.4	M4G3	6.2	100.2	0.008	6	0.013	0.9	2.9925	224.99	1.3	8.7	Vitrified Clay
1542	O2L34SB1	M34B1	1.7	M34A1	-5.5	102.4	0.071	8	0.01	4.2	24.795	1873.1	1.3	58	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1039	O1L17SV1	M17V1	1.8	M17T4	1.1	162.6	0.005	12	0.013	1.07	14.25	1086	1.3	9.9	
4162	O2L1SS2	M1S1	1.8	M1S2	2.5	60.4	0.012	4	0.013	0.82	1.2	91.915	1.3	10.4	Vitrified Clay
1095	O1L17SP2	M17P2	4.1	M17P1	2.9	316.4	0.004	8	0.01	0.98	5.7	441.35	1.3	12.5	PVC
1097	O1L17SP3	M17P3	4.5	M17P2	4.1	90	0.004	8	0.01	0.99	5.7	445.84	1.3	7.9	PVC
3644	O2L18ASA1	M18A-A1	-1	W-18A	-4	21.7	0.139	12	0.013	5.51	76.004	5961.7	1.3	58.4	
980	O2L34SH2	M34H1	-0.2	M34H2	0.9	195.1	0.006	6	0.013	0.74	2.3625	186.95	1.3	67.3	Vitrified Clay
835	O2L1SH3	M1H2	3.3	M1H3	3.6	46.6	0.007	4	0.013	0.64	0.9	71.885	1.3	9.5	Vitrified Clay
1773	O2L30SA5	M30A5	2.2	M30A4	1.4	174.9	0.004	8	0.013	0.77	4.41	355.13	1.2	9.3	Vitrified Clay
1093	O1L17SP1	M17P1	2.9	M17A1	-7	91.4	0.108	8	0.01	5.02	28.5	2316.4	1.2	58.6	PVC
3144	O2L34SL3	M34L3	2.9	M34L2	2.3	91.7	0.006	6	0.01	0.99	3.09	254.72	1.2	9	PVC
4098	O2L1SHH1	M1A9	3	M1HH1	3.5	77.2	0.006	6	0.013	0.77	2.4	198.6	1.2	32.2	Vitrified Clay
4050	O2L2SR3	M2R2	3.2	M2R3	3.7	81.2	0.006	6	0.013	0.77	2.4	198.81	1.2	8	Vitrified Clay
3320	O2L24SA2	M24A2	-1	M24A1	-1.6	142.9	0.004	6	0.013	0.62	1.89	159.05	1.2	61	Vitrified Clay
755	O2L3SA7	M3A7	3.5	M3A6	2.9	148.7	0.005	6	0.013	0.65	1.995	169.06	1.2	8.3	Vitrified Clay
819	O2L1SF1	M1F1	2.5	M1B2	1.2	315.9	0.004	8	0.013	0.76	4.2	356.39	1.2	10.6	Vitrified Clay
806	O2L2SC3	M2C3	0.9	M2C2	-1.3	422.1	0.005	6	0.013	0.7	2.1	182.37	1.2	9.4	Vitrified Clay
800	O2L2SF2	M2F2	2.1	M2F1	0.4	318	0.005	6	0.013	0.69	2.1	183.59	1.1	8.7	Vitrified Clay
649	O2L36SE2	M36E2	6	M36E1	2.2	273.3	0.014	8	0.01	1.76	9.4567	827	1.1	11.9	PVC
1786	O2L30SA1	M30A1	-0.9	W-30	-5.5	19.7	0.23	8	0.013	5.12	29.61	2601.4	1.1	58.7	
581	O2L7SA6	M7A6	4.9	M7A5	3.3	302.5	0.005	6	0.013	0.69	2.1	184.85	1.1	8.7	Vitrified Clay
1046	O1L17ST7	M17T7	2.4	M17T6	2.1	93.7	0.004	12	0.013	0.95	11.4	1004.7	1.1	7.5	
1048	O1L17ST6	M17T6	2.1	M17T5	1.8	68.2	0.004	12	0.013	0.95	11.4	1006.3	1.1	7.3	
3948	O2L10SA1	W-10	4.4	M10A1	5.5	238.1	0.005	6	0.01	0.83	2.4792	222.53	1.1	7.3	PVC
1708	O2L38SC2	M38C1	-0.6	M38C2	1	264.1	0.006	12	0.013	1.18	13.938	1252.3	1.1	7.3	
1400	O1L17SC1	M17C1	3.7	M17B3	3.4	65.6	0.004	12	0.013	0.97	11.4	1025.7	1.1	18.1	
901	O2L23SB2	M23B2	3.5	M23B1	1.9	401.3	0.004	8	0.013	0.72	3.7917	342.43	1.1	23.7	Vitrified Clay
3410	O2L18SE2	M18E2	-0.6	M18E1	-1.8	282.2	0.004	8	0.013	0.02	3.78	343.2	1.1	100	Vitrified Clay
827	O2L1SH1	M1B3	2.4	M1H1	2.9	94.6	0.006	8	0.013	0.86	4.5	409.82	1.1	8.4	Vitrified Clay
584	O2L7SA5	M7A5	3.3	M7A4	1.3	399.6	0.005	8	0.013	0.8	4.2	383.71	1.1	8.2	Vitrified Clay
978	O2L34SH1	M34F1	0.8	M34H1	-0.2	109.3	-0.01	8	0.013	0.04	5.775	530.12	1.1	65.2	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
3984	O1L37SC2	M37C1	-2.6	M37C2	-1.4	255.1	0.005	8	0.01	1.03	5.2208	497.45	1	9.7	PVC
4122	O2L1SEE1	M1BB1	2.4	M1EE1	2.9	49.2	0.01	4	0.013	0.71	0.9	86.119	1	10.3	Vitrified Clay
1049	O1L17ST5	M17T5	1.8	M17T4	1.1	145.9	0.005	12	0.013	1.02	11.4	1107.6	1	9.4	
1232	O1L14SBB1	M14BB1	3.3	M14A11	2	308.7	0.004	8	0.013	0.7	3.42	342.62	1	8.8	Vitrified Clay
1190	O1L14SM4	M14M4	4.3	M14M3	3	319.5	0.004	8	0.013	0.7	3.42	343.3	1	8.9	Vitrified Clay
1246	O1L14SZ1	M14Z1	4.2	M14A10	1.2	321.9	0.009	8	0.013	1.05	5.13	519.69	1	12.9	Vitrified Clay
1508	O2L18ASD1	M18A-D1	2.5	M18A-A	1.2	315.6	0.004	8	0.01	0.91	4.41	447.27	1	16.2	PVC
4072	O2L2SJ2	M2J1	0.1	M2J2	1	78.1	0.012	4	0.013	0.74	0.9	91.672	1	41.5	Vitrified Clay
3428	O2L25SA1	M25A1	-1	W-25	-5.9	50.8	0.097	12	0.013	4.35	48.252	4982.7	1	56.7	
722	O2L3SL3	M3L3	1.7	M3L2	0.9	125.3	0.007	6	0.013	0.74	1.995	207.43	1	8.4	Vitrified Clay
764	O2L2SB2	M2B2	2	M2B1	1	179.7	0.006	6	0.013	0.67	1.8	187.85	1	7.3	Vitrified Clay
1360	O2L16SA8	M16A8	3.5	M16A7	2.8	165.8	0.005	8	0.01	0.96	4.5675	477.36	1	8.3	PVC
4004	O2L13SA2	M13A1	3.2	M13A2	4.5	310.7	0.004	8	0.013	0.7	3.3337	350.8	1	8.1	
4107	O2L1SKK1	M1BB1	2.4	M1KK1	3.5	48.2	0.023	4	0.013	1.03	1.2	129.03	0.9	10.9	Vitrified Clay
611	O2L2SO1	M2O1	2.4	M2A4	1.5	315.3	0.003	8	0.013	0.59	2.7	297.71	0.9	9.5	Vitrified Clay
782	O2L2SI1	M2I1	4	M2D4	3	162	0.006	4	0.013	0.53	0.6	67.101	0.9	11.5	Vitrified Clay
1148	O1L14SJ1	M14J1	-1.9	M14A4	-2.9	254.3	0.004	8	0.01	0.88	3.99	446.55	0.9	59.1	PVC
1362	O2L16SA9	M16A9	3.9	M16A8	3.5	76.3	0.005	8	0.01	1.01	4.5675	516.97	0.9	6.8	PVC
1218	O1L14SS5	M14S5	4.7	M14S4	3.7	280	0.004	8	0.013	0.63	2.85	324.1	0.9	8.2	Vitrified Clay
380	O2L3SG2	M3G2	1.7	M3G1	0.2	419.3	0.004	8	0.013	0.63	2.85	324.4	0.9	8	Vitrified Clay
4105	O2L1SBB2	M1BB1	2.4	M1BB2	3	127.3	0.005	6	0.013	0.6	1.5	172.91	0.9	7.8	Vitrified Clay
619	O2L3SE1	M3E1	2.4	M3D3	1.5	300.9	0.003	8	0.013	0.58	2.565	296.6	0.9	9.2	Vitrified Clay
4032	O2L3SB3	M3B2	2.8	M3B3	3.3	104.3	0.005	6	0.013	0.58	1.425	169.07	0.8	7.3	Vitrified Clay
1317	O1L17SQ5	M17Q5	5.3	M17Q4	4.1	301.2	0.004	8	0.013	0.66	2.85	340.88	0.8	12.5	Vitrified Clay
4112	O2L1SBB3	M1BB2	3	M1BB3	3.9	118.3	0.008	4	0.013	0.57	0.6	74.498	0.8	8.2	Vitrified Clay
614	O2L2SA6	M2A6	2.8	M2A5	1.9	296.5	0.003	8	0.013	0.57	2.4	298.8	0.8	7.4	Vitrified Clay
1774	O2L30SI1	M30I1	2	M30A4	1.4	69.2	0.009	4	0.013	0.6	0.63	79.509	0.8	13.9	Vitrified Clay
1754	O2L31SB4	M31B4	3.4	M31B3	1.7	470.5	0.004	12	0.013	0.83	7.7198	975.16	0.8	7.6	
355	O1L17SJ2	M17J2	4.8	M17J1	3.7	259	0.004	8	0.01	0.86	3.5625	451.05	0.8	10.1	PVC
812	O2L2SR2	M2R2	3.2	M2R1	1.8	334.5	0.004	8	0.013	0.67	2.7	355.61	0.8	8.3	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1035	O1L17SU1	M17U1	-2.3	M17T3	-2.8	61.2	0.009	12	0.013	1.25	11.4	1501.6	0.8	10.3	
4160	O2L1SU1	M1S1	1.8	M1U1	2.6	83.5	0.01	6	0.013	0.81	1.8	246.46	0.7	7.2	Vitrified Clay
909	O2L5SB1	M5B1	3	M5A3	-2.4	287.8	0.019	6	0.013	1.14	2.52	345.61	0.7	14.9	Vitrified Clay
1770	O2L30SA6	M30A6	2.7	M30A5	2.2	104.2	0.005	6	0.013	0.57	1.26	174.43	0.7	8.3	Vitrified Clay
3903	O2L5SC1	M5A1	-2.9	M5C1	2	250.8	0.02	6	0.013	1.15	2.52	352.74	0.7	19.4	Vitrified Clay
1158	O1L14SL1	M14L1	0.1	M14A5	-2.4	327.2	0.007	8	0.01	1.11	4.275	607.64	0.7	51.1	PVC
1142	O1L14SI1	M14I1	-0.8	M14A4	-2	306.5	0.004	8	0.01	0.82	3.135	446.62	0.7	20.4	PVC
4208	O2L30SA6	M30A7	2.8	M30A6	2.7	29.1	0.005	6	0.013	0.59	1.26	180.73	0.7	6	Vitrified Clay
4234	O2L7SC4	M7C3	0.7	M7C4	3	468.5	0.005	6	0.013	0.57	1.2	176.44	0.7	24.4	Vitrified Clay
1366	O2L16SG1	M16G1	2.5	M16A6	1.1	320.9	0.004	12	0.013	0.84	7.0875	1048.7	0.7	9	
4034	O2L3SB4	M3B3	3.3	M3B4	3.6	62.9	0.005	6	0.013	0.55	1.14	171.05	0.7	6.2	Vitrified Clay
4229	O2L25SJ1	M25B2	0.9	M25J1	3	400.1	0.005	6	0.013	0.58	1.2	181.15	0.7	11.1	Vitrified Clay
766	O2L2SB1	M2B1	1	M2A2	-1.3	308.4	0.007	8	0.013	0.83	3	467.41	0.6	13.8	Vitrified Clay
1077	O1L17SG1	M17H3	4.5	M17H2	3	366.1	0.004	8	0.01	0.79	2.85	445.26	0.6	9.3	PVC
1771	O2L30SK1	M30K1	3.1	M30A5	2.2	70.4	0.014	4	0.013	0.71	0.63	99.254	0.6	10.9	Vitrified Clay
1772	O2L30SJ1	M30J1	3.5	M30A5	2.2	99	0.014	4	0.013	0.71	0.63	99.722	0.6	10.9	Vitrified Clay
3172	O2L30SC1	M30C1	-0.5	M30A1	-0.9	29.6	0.014	6	0.013	0.95	1.89	300.19	0.6	14.8	Vitrified Clay
1204	O1L14SX1	M14X1	2	M14S1	1	246.8	0.004	8	0.013	0.61	2.1375	341.77	0.6	10.7	Vitrified Clay
1737	O2L16SH1	M16H1	-1.9	M16B1	-2	32.1	0.004	12	0.013	0.8	6.3	1017.5	0.6	8.5	
4214	O2L25SD1	M25C1	0.6	M25D1	2.3	116.5	0.014	4	0.013	0.72	0.63	102.26	0.6	11.1	Vitrified Clay
831	O2L1SI1	M1H1	2.9	M1H2	3.3	61.4	0.007	8	0.013	0.78	2.7	444.36	0.6	6.5	Vitrified Clay
771	O2L2SL1	M2L1	0.6	M2J1	0.1	86	0.006	6	0.013	0.62	1.2	197.66	0.6	28	Vitrified Clay
1236	O1L14SAA2	M14AA1	3.9	M14A1(	1.2	248.8	0.011	8	0.013	1	3.42	568.69	0.6	12.3	Vitrified Clay
617	O2L3SD4	M3D5	4	M3D4	2	318.4	0.006	8	0.013	0.75	2.565	426.62	0.6	6.9	Vitrified Clay
955	O2L4SD1	M4D1	3.5	M4A4	1.2	332.6	0.007	6	0.013	0.65	1.26	210.31	0.6	12.3	Vitrified Clay
4198	O2L34SA15	M34A15	3.3	M34A14	2.3	255.6	0.004	8	0.01	0.77	2.625	445.41	0.6	7.6	PVC
1423	O2L34SE2	M34E2	1.5	M34E1	-0.9	213.2	0.011	6	0.01	1.08	2.0417	349.5	0.6	6.6	PVC
4238	O2L7SM1	M7C2	-0.1	M7M1	3	463.4	0.007	6	0.013	0.63	1.2	205.96	0.6	26.5	Vitrified Clay
904	O2L23SA2	M17A2	2.1	M17A1	0.3	327.5	0.006	8	0.013	0.7	2.3333	404.28	0.6	13.8	
1150	O1L14SJ2	M14J2	-0.7	M14J1	-1.9	303.7	0.004	8	0.01	0.77	2.565	445.06	0.6	11.9	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1368	O2L16SG2	M16G2	3.4	M16G1	2.5	220.8	0.004	8	0.013	0.62	2.0475	361.35	0.6	7.1	
4287	O1L14SC7	M14C6	0.5	M14E1	4.8	106.4	0.041	6	0.013	1.55	2.85	508.53	0.6	75	
972	O2L34SF2	M34F4	3.4	M34F3	2.7	291.5	0.002	12	0.013	0.59	4.286	772.29	0.6	6	
4388	O2L32SB1	M32B1	2	W-32	0	46.8	0.043	12	0.013	2.5	17.974	3305.6	0.5	6.7	
1335	O1L40SB2	M40A1	1.2	M40B2	1.9	188.5	0.004	8	0.01	0.77	2.45	453.49	0.5	5.1	PVC
1775	O2L30SH1	M30H1	3.1	M30A4	1.4	86.1	0.02	4	0.013	0.81	0.63	120.01	0.5	13.7	Vitrified Clay
3166	O2L30SA11	M30A11	4.4	M30A10	4	70.5	0.005	4	0.013	0.4	0.315	60.183	0.5	5.7	Vitrified Clay
1220	O1L14ST1	M14T1	3.1	M14S2	2.1	276.9	0.004	8	0.013	0.56	1.71	332.36	0.5	9.9	Vitrified Clay
4149	O2L1SU2	M1U1	2.6	M1U2	3.6	52.8	0.019	4	0.013	0.78	0.6	117.52	0.5	7.5	Vitrified Clay
1734	O2L16SF1	M16F1	3	M16B2	-1.7	436	0.011	8	0.013	0.93	2.8583	560.08	0.5	11.9	
4175	O2L1SK1	M1E2	0.7	M1K1	2	66.3	0.02	6	0.013	1.05	1.8	353.44	0.5	14.1	Vitrified Clay
790	O2L2SE1	M2E1	2	M2D1	-1.7	414.5	0.009	6	0.013	0.7	1.2	238.36	0.5	11	Vitrified Clay
753	O2L3SA8	M3A8	4.3	M3A7	3.5	166.7	0.005	6	0.013	0.5	0.855	170.04	0.5	6.3	Vitrified Clay
1234	O1L14SBB2	M14BB2	4.2	M14BB1	3.3	246.9	0.004	8	0.013	0.57	1.71	342.35	0.5	6.1	Vitrified Clay
1176	O1L14SN1	M14N1	0.9	M14M1	-0.4	327.3	0.004	8	0.013	0.57	1.71	342.87	0.5	20.4	Vitrified Clay
4207	O2L30SA8	M30A8	3.1	M30A7	2.8	52.5	0.006	6	0.013	0.56	0.945	190.42	0.5	5.5	Vitrified Clay
1733	O2L16SE1	M16E1	3	M16B1	-2	435.3	0.012	8	0.013	0.96	2.8583	581.84	0.5	11.2	
762	O2L2SB2	M2B3	3	M2B2	2	176.5	0.006	6	0.013	0.55	0.9	189.57	0.5	6	Vitrified Clay
228	O1L17SJ3	M17J3	5.2	M17J2	4.8	51.5	0.009	6	0.01	0.87	1.425	302.67	0.5	7	PVC
385	O2L23SA1	M17A1	0.3	W-23	-6.4	11	0.608	12	0.013	8.78	58.625	12469	0.5	57.4	
4044	O2L2SG1	M2F2	2.1	M2G1	2.8	135	0.006	4	0.013	0.41	0.3	64.717	0.5	8.2	Vitrified Clay
4220	O2L25SF1	M25A1	-1	M25F1	2	115.2	0.026	4	0.013	0.9	0.63	137.14	0.5	23	Vitrified Clay
4091	O2L1SQ1	M1A3	-0.1	M1Q1	2	86.1	0.024	6	0.013	1.12	1.8	392.33	0.5	37.3	Vitrified Clay
4224	O2L25SI1	M25B1	0.3	M25I1	3	105.6	0.026	4	0.013	0.9	0.63	137.33	0.5	15	Vitrified Clay
3106	O2L34SO1	M34O1	2.9	M34A9	0.1	177.4	0.016	6	0.01	1.17	1.89	412.04	0.5	53.1	PVC
802	O2L2SF3	M2F3	2.6	M2F2	2.1	89.5	0.006	4	0.013	0.43	0.3	66.799	0.4	8.1	Vitrified Clay
3599	O1L37SE1	M37C1	-2.6	M37E1	-1.6	235	0.004	8	0.01	0.75	2.0883	471.24	0.4	8.5	PVC
3598	O1L37SB1	M37A2	-2.8	M37B1	-1.7	233.9	0.005	8	0.01	0.77	2.0883	476.91	0.4	14.5	PVC
4118	O2L1SCC2	M1CC1	3.5	M1CC2	4	77.5	0.006	4	0.013	0.43	0.3	68.59	0.4	5.1	Vitrified Clay
825	O2L1SB5	M1B4	3.5	M1B5	4.5	152.8	0.007	4	0.013	0.43	0.3	69.091	0.4	6.9	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
850	O2L1SOO1	M1JJ1	1.7	M1OO1	4.5	402.4	0.007	6	0.013	0.6	0.9	210.2	0.4	12.1	Vitrified Clay
1498	O2L18ASB1	M18A-B1	0.9	M18A-A	-0.3	279.5	0.004	8	0.01	0.71	1.89	446.28	0.4	52.3	PVC
1768	O2L30SA9	M30A9	3.8	M30A8	3.1	198.2	0.004	6	0.013	0.42	0.63	149.65	0.4	4.9	Vitrified Clay
1240	O1L14SA12	M14A12	3.5	M14A11	2	375.3	0.004	8	0.013	0.54	1.425	342.87	0.4	7.6	Vitrified Clay
1162	O1L14SK1	M14K1	0.6	M14A5	-2.4	260.8	0.012	8	0.01	1.18	3.135	757.49	0.4	50.7	PVC
4169	O2L1SM1	M1E1	-0.3	M1M1	2	75.2	0.03	4	0.013	0.9	0.6	147.72	0.4	19.6	Vitrified Clay
3520	O2L35SC1	M35A1	-1.3	M35C1	0	95.3	0.014	8	0.01	1.28	3.3168	823.44	0.4	40.5	PVC
3156	O2L30SL1	M30A7	2.8	M30L1	3.8	118.5	0.008	4	0.013	0.47	0.315	78.474	0.4	6.8	Vitrified Clay
4109	O2L1SKK2	M1KK1	3.5	M1KK2	4.5	130.6	0.008	4	0.013	0.45	0.3	74.737	0.4	6.5	Vitrified Clay
1192	O1L14SR1	M14R1	4.4	M14M4	4.3	130.4	0.001	6	0.013	0.2	0.285	73.133	0.4	7	Vitrified Clay
4100	O2L1SII1	M1HH1	3.5	M1II1	5	181.6	0.008	4	0.013	0.48	0.3	77.63	0.4	8	Vitrified Clay
1144	O1L14SI2	M14I2	0.5	M14I1	-0.8	310.4	0.004	8	0.01	0.69	1.71	447.43	0.4	5.2	PVC
4114	O2L1SBB4	M1BB3	3.9	M1BB4	5.1	138.4	0.009	4	0.013	0.49	0.3	79.521	0.4	5.4	Vitrified Clay
4185	O2L7SB2	M1D3	3	M1D4	4	114.4	0.009	4	0.013	0.49	0.3	79.857	0.4	5.2	Vitrified Clay
4197	O2L34SA16	M34A16	4.9	M34A15	3.3	402.3	0.004	4	0.01	0.43	0.2625	70.459	0.4	7.7	PVC
4247	O2L7SJ1	M7C1	-0.9	M7J1	4	296.3	0.017	6	0.013	0.87	1.2	323.84	0.4	25.3	Vitrified Clay
4068	O2L2SP3	M2P2	0.5	M2P3	3	262.3	0.009	4	0.013	0.5	0.3	82.722	0.4	9.8	Vitrified Clay
4102	O2L1SHH2	M1HH1	3.5	M1HH2	5.2	180.7	0.009	4	0.013	0.5	0.3	82.851	0.4	7.9	Vitrified Clay
4059	O2L2ST2	M2T1	2.3	M2T2	4.2	196	0.01	4	0.013	0.5	0.3	83.315	0.4	8.3	Vitrified Clay
3153	O2L34ST1	M34T1	3.5	M34A14	2.3	287.1	0.004	4	0.01	0.44	0.2625	73.273	0.4	11.9	PVC
4200	O2L29SA4	M29A3	0.2	M29A4	1.1	166	0.006	8	0.01	0.8	1.89	527.72	0.4	6.6	PVC
4078	O2L2SB2	M2B3	3	M2B4	4	102.3	0.01	4	0.013	0.51	0.3	84.454	0.4	5.9	Vitrified Clay
4061	O2L2SU1	M2T1	2.3	M2U1	3.5	125.5	0.01	4	0.013	0.51	0.3	84.562	0.4	8.3	Vitrified Clay
4054	O2L2SS1	M2R3	3.7	M2S1	4.7	101.9	0.01	4	0.013	0.51	0.3	85.33	0.4	7.9	Vitrified Clay
4036	O2L3SB5	M3B4	3.6	M3B5	4.4	85.4	0.009	4	0.013	0.49	0.285	81.087	0.4	6.5	Vitrified Clay
751	O2L3SA9	M3A9	5.2	M3A8	4.3	99.2	0.009	4	0.013	0.49	0.285	81.353	0.4	6	Vitrified Clay
4157	O2L1SW1	M1V1	3	M1W1	4	98.6	0.01	4	0.013	0.52	0.3	86.013	0.3	6.4	Vitrified Clay
3108	O2L34SO2	M34O2	3.3	M34O1	2.9	118.2	0.003	6	0.01	0.49	0.63	183.2	0.3	5.3	PVC
591	O2L7SG2	M7G2	5.6	M7G1	3.9	342.6	0.005	6	0.013	0.47	0.6	177.4	0.3	7.4	
223	O1L17SK1	M17K1	5.6	M17J2	4.8	50.6	0.017	6	0.01	1.12	1.425	421.99	0.3	7	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
566	O2L7SD5	M7D5	6.1	M7D4	4.4	340.5	0.005	6	0.013	0.47	0.6	177.93	0.3	8	
594	O2L7SF2	M7F2	5.8	M7F1	4.1	338.4	0.005	6	0.013	0.47	0.6	178.48	0.3	7.7	
4420	O2L30SD1	M30A2	-0.2	M30D1	2	201.5	0.011	8	0.013	0.84	1.89	565.04	0.3	7.9	Vitrified Clay
1541	O2L34SB5	M34B5	4.3	M34B4	3.5	176.1	0.005	8	0.01	0.7	1.5799	475.18	0.3	6.9	PVC
713	O2L3SH5	M3H4	2.5	M3H5	4	149.7	0.01	4	0.013	0.51	0.285	85.772	0.3	6.3	Vitrified Clay
3164	O2L30SA10	M30A10	4	M30A9	3.8	35.3	0.006	6	0.013	0.5	0.63	189.65	0.3	4.4	Vitrified Clay
815	O2L1SG1	M1G1	4	M1F1	2.5	130.2	0.011	4	0.013	0.54	0.3	91.187	0.3	9.7	Vitrified Clay
3427	O2L24SA1	M24A1	-1.6	W-24	-3.9	70.8	0.033	12	0.013	1.55	9.45	2895	0.3	84	
4120	O2L1SDD1	M1CC1	3.5	M1DD1	4	42.2	0.012	4	0.013	0.55	0.3	93.003	0.3	4.8	Vitrified Clay
1152	O1L14SJ3	M14J3	0.3	M14J2	-0.7	247	0.004	8	0.01	0.64	1.425	446.35	0.3	4.8	PVC
1188	O1L14SQ1	M14Q1	4.3	M14M3	3	115	0.011	6	0.013	0.7	0.855	268.8	0.3	9.2	Vitrified Clay
4093	O2L1SQ2	M1Q1	2	M1Q2	3.5	122	0.012	4	0.013	0.56	0.3	94.728	0.3	6.6	Vitrified Clay
4205	O2L29SB3	M29B3	2	M29B2	0	401.7	0.005	8	0.01	0.71	1.575	497.47	0.3	5.9	PVC
3138	O2L34SM1	M34M1	2.8	M34L2	2.3	85.6	0.006	6	0.01	0.64	0.7875	256.41	0.3	7.1	PVC
1422	O2L34SE1	M34A6	-1.9	M34E1	-0.9	335.6	0.003	10	0.01	0.62	2.0417	687.31	0.3	44.8	PVC
1279	O2L22SB2	M22B2	2.5	M22B1	1.2	179.2	0.007	6	0.013	0.53	0.63	213.64	0.3	22.2	
3094	O2L29SA1	M29A1	-1.6	W-29	-5.9	16.2	0.267	12	0.013	4.7	24.255	8266.1	0.3	54.7	
575	O2L7SH1	M7H1	4.7	M7D2	1.8	426.1	0.007	6	0.013	0.51	0.6	207.04	0.3	17.7	Vitrified Clay
4453	O2L38SA7	M38A6	-1.1	M38A7	-0.5	81.2	0.007	8	0.01	0.84	1.715	596	0.3	9.3	PVC
4151	O2L1SU3	M1U2	3.6	M1U3	4.5	58.4	0.015	4	0.013	0.58	0.3	105.99	0.3	5	Vitrified Clay
4212	O2L25SC2	M25C1	0.6	M25C2	2.3	212.1	0.008	6	0.013	0.55	0.63	223.47	0.3	7.3	Vitrified Clay
1041	O1L17SV2	M17V2	2.8	M17V1	1.8	228.9	0.004	12	0.013	0.63	2.85	1013.8	0.3	6	
1738	O2L16SB4	M16B4	5	M16B3	-1.5	334.2	0.019	12	0.013	1.37	6.2417	2221.4	0.3	6.5	
4095	O2L1SR1	M1Q1	2	M1R1	4	122.7	0.016	4	0.013	0.59	0.3	109.04	0.3	6.6	Vitrified Clay
715	O2L3SI1	M3I1	4	M3H3	1.8	143.3	0.015	4	0.013	0.57	0.285	106.05	0.3	10.1	Vitrified Clay
4006	O2L10SA2	M10A1	5.5	M10A2	6	103.8	0.005	6	0.013	0.43	0.4667	174.81	0.3	5.6	
4124	O2L1SEE2	M1EE1	2.9	M1EE2	4	62.7	0.018	4	0.013	0.61	0.3	113.11	0.3	5.7	Vitrified Clay
982	O2L34SH3	M34H2	0.9	M34H3	2.5	261.6	0.006	6	0.013	0.48	0.525	199.95	0.3	19.2	Vitrified Clay
4179	O2L1SK2	M1K1	2	M1K2	4.5	137.6	0.018	4	0.013	0.62	0.3	115.13	0.3	6.6	Vitrified Clay
574	O2L7SI2	M7I2	4.6	M7D1	1	430	0.008	6	0.013	0.56	0.6	231.06	0.3	19.4	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
4177	O2L1SL1	M1K1	2	M1L1	4.5	131	0.019	4	0.013	0.63	0.3	118.02	0.3	6.6	Vitrified Clay
4267	O1L37SA4	M37A4	-0.4	M37A5	3	204.8	0.017	6	0.01	1.01	1.0442	423.66	0.2	16.7	PVC
4216	O2L25SE1	M25A2	-0.4	M25E1	3	293.9	0.012	6	0.013	0.63	0.63	270.86	0.2	14.7	Vitrified Clay
3986	O1L37SC3	M37C2	-1.4	M37C3	-0.4	241.4	0.004	8	0.01	0.59	1.0442	451.48	0.2	5.4	PVC
1289	O2L26SA2	M26A1	0.8	M26A2	2.7	261.3	0.007	6	0.01	0.64	0.63	278.43	0.2	3.6	PVC
1242	O1L14SA13	M14A13	5	M14A12	3.5	145.1	0.01	6	0.013	0.59	0.57	256.01	0.2	4.9	Vitrified Clay
4195	O2L34SS1	M34A13	2.1	M34S1	3.8	85.5	0.02	4	0.013	0.62	0.2625	120.45	0.2	11.9	
3146	O2L34SL4	M34L4	3.9	M34L3	2.9	193.5	0.006	6	0.01	0.55	0.525	242.9	0.2	5.7	PVC
744	O2L3S132	M3C2	2	M3A4	1.4	213.7	0.003	6	0.013	0.3	0.285	134.54	0.2	10	Vitrified Clay
984	O2L34SI1	M34I1	1.5	M34H1	-0.2	169.9	0.01	6	0.013	0.58	0.525	253.69	0.2	51.7	Vitrified Clay
777	O2L2SL2	M2L2	3	M2L1	0.6	78.1	0.03	4	0.013	0.76	0.3	148.79	0.2	6.2	
4415	O2L30SG1	M30A3	0.6	M30G1	2	193.9	0.007	8	0.013	0.6	0.945	468.97	0.2	6.6	Vitrified Clay
773	O2L2SM1	M2M1	3	M2L1	0.6	77	0.031	4	0.013	0.76	0.3	149.83	0.2	6.2	Vitrified Clay
717	O2L3SK1	M3H3	1.8	M3K1	-5.1	102.4	-0.067	6	0.013	0.01	1.285	652.28	0.2	55.4	Vitrified Clay
907	O2L5SB2	M5B2	4	M5B1	3	247.1	0.004	6	0.013	0.36	0.315	160.2	0.2	5.2	Vitrified Clay
936	O2L5SA9	M5A9	4.5	M5A8	3.1	319	0.005	6	0.013	0.38	0.315	169.18	0.2	10.7	Vitrified Clay
938	O2L5SD6	M5D6	4.6	M5D5	3.4	274.1	0.005	6	0.013	0.38	0.315	169.39	0.2	6.1	Vitrified Clay
969	O2L4SA6	M4A6	4	M4A5	1.8	491.3	0.005	6	0.013	0.38	0.315	169.66	0.2	8.6	Vitrified Clay
949	O2L4SB2	M4B2	4.3	M4B1	2.5	390	0.005	6	0.013	0.38	0.315	171.56	0.2	6.5	Vitrified Clay
3403	O2L18ASA5	M18A5	0.3	M18A4	-0.9	301.5	0.004	8	0.013	0	0.63	343.58	0.2	100	Vitrified Clay
941	O2L4SH2	M4H2	4	M4H1	2.5	316.8	0.005	6	0.013	0.38	0.315	173.3	0.2	6	Vitrified Clay
3171	O2L30SC2	M30C2	1.3	M30C1	-0.5	360.4	0.005	6	0.013	0.39	0.315	177.98	0.2	4.7	Vitrified Clay
4138	O2L1SAA1	M1A6	1.4	M1AA1	4	65	0.04	4	0.013	0.84	0.3	169.78	0.2	52	Vitrified Clay
4126	O2L1SEE3	M1EE1	2.9	M1EE3	4	27.8	0.04	4	0.013	0.84	0.3	169.96	0.2	5.7	Vitrified Clay
3185	O2L30SM1	M30M1	4	M30B6	2.7	258.1	0.005	6	0.013	0.39	0.315	178.71	0.2	6.5	Vitrified Clay
1216	O1L14SW1	M14W1	4.2	M14S4	3.7	118.6	0.004	6	0.013	0.36	0.285	161.86	0.2	8.1	Vitrified Clay
4040	O2L2SD5	M2D4	3	M2D5	4.5	322.1	0.005	6	0.013	0.36	0.3	171.84	0.2	7	Vitrified Clay
3912	O2L7SA7	M7A6	4.9	M7A7	6.1	243.7	0.005	6	0.013	0.37	0.3	176.7	0.2	5.3	
1224	O1L14ST2	M14T2	3.4	M14T1	3.1	76.5	0.004	6	0.013	0.35	0.285	167.92	0.2	5	Vitrified Clay
1364	O2L30SA10	M16A10	5.1	M16A9	3.9	259.9	0.004	8	0.01	0.55	0.7875	466.92	0.2	4.9	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
573	O2L7SB2	M7B2	4.9	M7B1	3.6	269.8	0.005	6	0.013	0.37	0.3	178.14	0.2	4.3	Vitrified Clay
1222	O1L14SU1	M14U1	3.5	M14T1	3.1	85	0.005	6	0.013	0.35	0.285	170.58	0.2	5	Vitrified Clay
838	O2L1SJJ4	M1JJ4	4.5	M1JJ3	2.7	353.7	0.005	6	0.013	0.37	0.3	181.13	0.2	7	Vitrified Clay
1206	O1L14SX2	M14X2	3.3	M14X1	2	203.2	0.006	8	0.013	0.51	0.7125	432.09	0.2	4.4	Vitrified Clay
1248	O1L14SZ2	M14Z2	5.5	M14Z1	4.2	324.6	0.004	8	0.013	0.41	0.57	345.84	0.2	5.1	Vitrified Clay
1212	O1L14SV1	M14V1	3.9	M14S3	2.9	244	0.004	8	0.013	0.41	0.57	350.68	0.2	7.8	Vitrified Clay
808	O2L2SC4	M2C4	2.3	M2C3	0.9	265.7	0.005	6	0.013	0.38	0.3	184.63	0.2	5.3	Vitrified Clay
4070	O2L2SQ1	M2P2	0.5	M2Q1	1.9	253.9	0.005	6	0.013	0.38	0.3	185.02	0.2	6.6	Vitrified Clay
1238	O1L14SAA2	M14AA2	4.8	M14AA1	3.9	190	0.004	8	0.013	0.42	0.57	356.31	0.2	4.4	Vitrified Clay
4052	O2L2SR4	M2R3	3.7	M2R4	4.7	172.7	0.006	6	0.013	0.39	0.3	188.12	0.2	5.3	Vitrified Clay
4232	O2L25SB3	M25B2	0.9	M25B3	5	164.1	0.025	6	0.013	0.81	0.63	396.55	0.2	10	Vitrified Clay
1244	O1L14SBB3	M14BB3	5.2	M14BB2	4.2	191.8	0.005	6	0.013	0.37	0.285	180.39	0.2	4.9	Vitrified Clay
833	O2L1SI1	M1H2	3.3	M1I1	4.5	208.8	0.006	6	0.013	0.39	0.3	190.11	0.2	5.2	Vitrified Clay
779	O2L2SN1	M2N1	0.9	M2J1	0.1	139.6	0.006	6	0.013	0.39	0.3	190.42	0.2	26.7	Vitrified Clay
4145	O2L1SX1	M1A5	1.1	M1X1	4	57.3	0.05	4	0.013	0.92	0.3	190.78	0.2	52	Vitrified Clay
4184	O2L7SB2	M1D2	0.9	M1D3	3	413.4	0.005	8	0.013	0.45	0.6	383.21	0.2	9.4	Vitrified Clay
4455	O2L38SA8	M38A7	-0.5	M38A8	7	308.6	0.024	8	0.01	1.28	1.715	1099.1	0.2	3.6	PVC
994	O2L34SK2	M34K2	3	M34K1	1.1	410	0.005	6	0.013	0.35	0.2625	171.43	0.2	6	Vitrified Clay
844	O2L1SNN1	M1JJ2	2.1	M1NN1	4.5	391.2	0.006	6	0.013	0.4	0.3	196.01	0.2	9.1	Vitrified Clay
3183	O2L30SB7	M30B7	3.6	M30B6	2.7	220.4	0.004	6	0.01	0.42	0.315	209.19	0.2	6.4	PVC
916	O2L5SC2	M5C2	4	M5C1	2	273	0.007	6	0.013	0.43	0.315	215.53	0.1	5.1	Vitrified Clay
1504	O2L18ASC1	M18A-C1	2.3	M18A-A	0.7	412.6	0.004	8	0.01	0.5	0.63	437.67	0.1	15.4	PVC
3123	O2L29SF1	M29F1	2.5	M29B1	-1	194.8	0.018	6	0.01	0.88	0.63	438.83	0.1	8.4	PVC
3425	O2L1SC1	M1C1	2	M1A1	-1	105.1	0.029	12	0.013	1.37	3.9	2718.9	0.1	18.9	
3408	O2L18SE3	M18E3	1.3	M18E2	-0.6	488.8	0.004	8	0.01	0.51	0.63	446.46	0.1	51.4	PVC
840	O2L1SKK1	M1JJ3	2.7	M1KK1	4.5	252.5	0.007	6	0.013	0.43	0.3	214.39	0.1	6.8	Vitrified Clay
957	O2L4SE1	M4E1	4	M4D1	3.5	61	0.008	6	0.013	0.45	0.315	227.98	0.1	4.2	Vitrified Clay
4155	O2L1SV2	M1V1	3	M1V2	4	15.4	0.065	4	0.013	0.95	0.3	217.54	0.1	6.3	Vitrified Clay
4038	O2L3SC1	M3B1	1.9	M3C1	4	35.5	0.061	4	0.013	0.91	0.285	210.32	0.1	9.7	Vitrified Clay
4255	O2L24SH1	M24A1	-1.6	M24H1	3	134.3	0.034	6	0.013	0.92	0.63	465.08	0.1	51.8	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
4076	O2L2SK1	M2J2	1	M2K1	3	29.5	0.068	4	0.013	0.97	0.3	222.58	0.1	5.7	Vitrified Clay
792	O2L2SE2	M2E2	3	M2E1	2	126.6	0.008	6	0.013	0.44	0.3	223.85	0.1	3.9	Vitrified Clay
4083	O2L1SO1	M1A2	-0.8	M1O1	2	87.4	0.032	6	0.013	0.89	0.6	448.54	0.1	38.6	Vitrified Clay
4249	O2L24SD2	M24D1	-0.9	M24D2	3.7	130.1	0.035	6	0.013	0.94	0.63	473.45	0.1	7.3	Vitrified Clay
4074	O2L2SJ3	M2J2	1	M2J3	4	41.9	0.072	4	0.013	0.99	0.3	228.61	0.1	5.7	Vitrified Clay
1736	O2L16SH2	M16H2	4.2	M16H1	-1.9	332.4	0.018	12	0.013	1.06	2.8292	2162.4	0.1	4.4	
4085	O2L1SP1	M1O1	2	M1P1	4	27.7	0.072	4	0.013	0.99	0.3	229.54	0.1	4.7	Vitrified Clay
829	O2L1SI1	M1H1	2.9	M1J1	4.5	192.6	0.008	6	0.013	0.45	0.3	229.64	0.1	6.3	Vitrified Clay
962	O2L4SA6	M4F1	4	M4A5	1.8	243	0.009	6	0.013	0.48	0.315	242.34	0.1	8.3	Vitrified Clay
4189	O2L34SR1	M34A13	2.1	M34R1	3	16	0.056	4	0.013	0.87	0.2625	202.47	0.1	11.9	Vitrified Clay
4222	O2L25SG1	M25A1	-1	M25G1	8	237.8	0.038	6	0.013	0.96	0.63	489.09	0.1	15.1	Vitrified Clay
1160	O1L14SL2	M14L2	1.5	M14L1	0.1	355.4	0.004	8	0.01	0.49	0.57	445.64	0.1	4.6	PVC
1164	O1L14SK2	M14K2	1.6	M14K1	0.6	234.1	0.004	8	0.01	0.49	0.57	446.74	0.1	4.2	PVC
4147	O2L1SY1	M1A5	1.1	M1Y1	0	14.6	-0.078	4	0.013	0.01	0.3	238.72	0.1	100	Vitrified Clay
852	O2L1SOO2	M1OO1	4.5	M1OO2	5	55	0.009	6	0.013	0.47	0.3	240.13	0.1	3.7	Vitrified Clay
4171	O2L1SN3	M1M1	2	M1N3	4	24.9	0.08	4	0.013	1.04	0.3	241.96	0.1	5	Vitrified Clay
846	O2L1SLL1	M1JJ2	2.1	M1LL1	4.5	256.3	0.009	6	0.013	0.47	0.3	242.15	0.1	8.9	Vitrified Clay
4131	O2L1SFF1	M1A8	1.9	M1FF1	4	25.8	0.082	4	0.013	1.04	0.3	243.89	0.1	45.9	Vitrified Clay
4227	O2L25SH1	M25B1	0.3	M25H1	7	157.1	0.043	6	0.013	1	0.63	521.19	0.1	9.8	Vitrified Clay
4089	O2L1SO2	M1O1	2	M1O2	4	23.4	0.085	4	0.013	1.06	0.3	249.44	0.1	4.7	Vitrified Clay
4026	O2L4SC1	M4A3	0.7	M4C1	4	283.9	0.012	6	0.013	0.52	0.315	271.11	0.1	13.5	Vitrified Clay
1184	O1L14SP1	M14P1	3.8	M14M2	2.2	199.4	0.008	8	0.013	0.53	0.57	493.37	0.1	6.9	Vitrified Clay
1281	O2L22SE1	M22E1	2.6	M22B1	1.2	208.3	0.007	6	0.01	0.52	0.315	274.09	0.1	21.5	PVC
4173	O2L1SM2	M1M1	2	M1M2	4	21.1	0.095	4	0.013	1.11	0.3	262.71	0.1	5	Vitrified Clay
720	O2L3SL4	M3L4	4	M3L3	1.7	232.3	0.01	6	0.013	0.47	0.285	250.57	0.1	4.8	Vitrified Clay
4187	O2L1SH4	M1H3	3.6	M1H4	4.5	71.6	0.012	6	0.013	0.52	0.3	276.09	0.1	3.8	Vitrified Clay
959	O2L4SD2	M4D2	4	M4D1	3.5	37	0.014	6	0.013	0.55	0.315	292.76	0.1	4.1	Vitrified Clay
1180	O1L14SO1	M14O1	2.5	M14N1	0.9	135	0.012	6	0.013	0.51	0.285	275.52	0.1	4.6	Vitrified Clay
3134	O2L29SC2	M29C2	3	M29C1	2	129.4	0.008	8	0.01	0.64	0.63	619.81	0.1	2.5	PVC
615	O2L2SA7	M2A7	3.7	M2A6	2.8	300.7	0.003	8	0.013	0.31	0.3	296.71	0.1	4.4	Vitrified Clay

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
612	O2L2SO2	M2O2	3.4	M2O1	2.4	316.4	0.003	8	0.013	0.31	0.3	297.16	0.1	4.6	Vitrified Clay
4245	O2L7SK1	M7C1	-0.9	M7K1	3	264.7	0.015	6	0.013	0.56	0.3	305.68	0.1	24	Vitrified Clay
620	O2L3SE2	M3E2	3.3	M3E1	2.4	300.9	0.003	8	0.013	0.3	0.285	296.62	0.1	4.5	Vitrified Clay
616	O2L3SD6	M3D6	3.9	M3D5	2.9	314.4	0.003	8	0.013	0.3	0.285	298.11	0.1	58	Vitrified Clay
996	O2L34SJ2	M34J2	2.5	M34J1	0.1	194.9	0.012	6	0.013	0.5	0.2625	280.02	0.1	7.2	Vitrified Clay
3952	O2L29SD1	M29A3	0.2	M29D1	4	421.4	0.009	8	0.01	0.68	0.63	672.56	0.1	5.7	PVC
4133	O2L1SGG1	M1A8	1.9	M1GG1	4	14.5	0.144	4	0.013	1.31	0.3	324.64	0.1	45.9	Vitrified Clay
724	O2L3SM1	M3L2	0.9	M3M1	4.5	238.9	0.015	6	0.013	0.56	0.285	311.28	0.1	6.2	Vitrified Clay
3421	O2L18SG1	M18G1	-0.6	M18A3	-1.6	235.8	0.004	8	0.013	0	0.315	344.22	0.1	100	Vitrified Clay
3416	O2L18SF1	M18F1	-1.5	M18A2	-2.5	237.8	0.004	8	0.013	0	0.315	344.59	0.1	100	Vitrified Clay
4315	O2L18A	M18C2	3	M18D1	3.2	41.8	0.004	12	0.013	0.45	0.945	1048.7	0.1	11	
382	O2L3SG3	M3G3	3.1	M3G2	1.7	393.5	0.004	8	0.013	0.32	0.285	323.48	0.1	4.5	Vitrified Clay
817	O2L1SF2	M1F1	2.5	M1F2	4	371.7	0.004	8	0.013	0.34	0.3	342.68	0.1	4.9	Vitrified Clay
4257	O2L24SA3	M24A2	-1	M24A3	2	142.3	0.021	6	0.013	0.64	0.315	366.3	0.1	12.3	Vitrified Clay
730	O2L3SO1	M3O1	5	M3L1	0.4	255.7	0.018	6	0.013	0.59	0.285	337.04	0.1	8.3	Vitrified Clay
1194	O1L14SM5	M14M5	5.7	M14M4	4.3	345	0.004	8	0.013	0.34	0.285	343.01	0.1	4.6	Vitrified Clay
3119	O2L29SE1	M29E1	4	M29A2	-0.7	403.4	0.012	8	0.01	0.75	0.63	759.38	0.1	7.3	PVC
4253	O2L24SG1	M24A1	-1.6	M24G1	4	59.2	0.094	6	0.013	1.34	0.63	772.83	0.1	51.8	Vitrified Clay
4140	O2L1SZ1	M1A6	1.4	M1Z1	4	13.6	0.188	4	0.013	1.45	0.3	370.46	0.1	52	Vitrified Clay
1178	O1L14SN2	M14N2	2.5	M14N1	0.9	79	0.02	6	0.013	0.62	0.285	360.12	0.1	4.6	Vitrified Clay
4191	O2L34SP1	M34A12	1.7	M34P1	4	14.4	0.162	4	0.013	1.32	0.2625	343.6	0.1	42.2	Vitrified Clay
4251	O2L24SA1	M24D1	-0.9	M24E1	5.4	58.1	0.108	6	0.013	1.42	0.63	829.33	0.1	7.3	Vitrified Clay
3142	O2L34SM2	M34N1	3.5	M34M1	2.8	55.5	0.012	6	0.01	0.61	0.2625	358.36	0.1	3.2	PVC
4204	O2L29SB4	M29B4	2.5	M29B3	2	127.8	0.004	8	0.01	0.4	0.315	440.96	0.1	3.1	PVC
4210	O2L25SA7	M25A6	1.9	M25A7	3.5	403.5	0.004	8	0.01	0.4	0.315	443.97	0.1	7	PVC
3398	O2L25SK1	M25K1	2.4	M25A4	1	345.5	0.004	8	0.01	0.41	0.315	445.62	0.1	7.6	PVC
727	O2L3SN1	M3N1	-6.1	M3L1	0.4	241.6	-0.027	6	0.013	0	0.285	413.39	0.1	57.1	Vitrified Clay
4236	O2L7SC4	M7C3	0.7	M7N1	4	105.9	0.031	6	0.013	0.73	0.3	444.49	0.1	22.6	Vitrified Clay
4263	O2L7SB1	M7A1	-5.5	M7B1	3.6	238.5	0.038	12	0.013	1.25	2.1	3118.3	0.1	51.4	
3140	O2L34SM2	M34M2	3.8	M34M1	2.8	56.2	0.017	6	0.01	0.68	0.2625	429.13	0.1	3.2	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1154	O1L14SJ	M14J4	1.4	M14J3	0.3	245	0.004	8	0.01	0.41	0.285	468.11	0.1	3	PVC
1146	O1L14SI3	M14I3	1.5	M14I2	0.5	226.4	0.004	8	0.01	0.41	0.285	470.9	0.1	3.2	PVC
4116	O2L1SCC1	M1BB2	3	M1CC1	3.5	46.8	0.011	12	0.013	0.63	0.9	1652.3	0.1	2.6	
4243	O2L7SL1	M7C2	-0.1	M7L1	6	104.9	0.058	6	0.013	0.9	0.3	607.2	0	24.9	Vitrified Clay
4259	O2L24SB1	M24A2	-1	M24B1	3	60.7	0.066	6	0.013	0.95	0.315	647.42	0	12.3	
3985	O1L37SD1	M37C2	-1.4	M37D1	5	56.1	0.114	8	0.01	1.92	1.0442	2376.2	0	5.3	PVC
4202	O2L29SA5	M29A4	1.1	M29A5	4.6	254.7	0.014	8	0.01	0.65	0.315	827.15	0	3.1	PVC
1200	O1L14SY1	M14Y1	4.8	M14A9	0.4	202.7	0.022	8	0.013	0.57	0.285	800.48	0	10.5	Vitrified Clay
1226	O1L14SS6	M14S6	5.8	M14S5	4.7	286.6	0.004	12	0.013	0.31	0.285	1004.1	0	2.9	
3424	O2L1SC2	M1C2	4	M1C1	2	292.2	0.007	12	0.013	0.37	0.3	1322.9	0	2.5	
3132	O2L29SC1	M29C1	2	M29A1	-1.6	16.4	0.218	8	0.01	1.96	0.63	3292.1	0	8.4	PVC
4042	O2L2SH1	M2D4	3	M2H1	3.5	25.7	0.019	12	0.013	0.56	0.3	2230.3	0	3.2	
4164	O2L1ST1	M1S2	2.5	M1T1	4	60.1	0.025	12	0.013	0.6	0.3	2526.9	0	1.9	
4167	O2L1SS3	M1S2	2.5	M1S3	4	57.6	0.026	12	0.013	0.61	0.3	2580.6	0	1.9	
4193	O2L34SQ1	M34A12	1.7	M34Q1	3.8	89	0.024	12	0.013	0.57	0.2625	2474.3	0	13.9	
354	O1L17SM8	M17M8	4.2	M17M7	3.8	110	0.004	8	0.01	0	0	450.94	0	5.5	PVC
635	O2L36SA11	M36A11	2.8	M36A10	1.4	339.1	0.004	8	0.01	0	0	454.65	0	4.6	PVC
854	O2L1SMM1	M1MM1	4.5	M1JJ1	1.7	270.1	0.01	6	0.013	0	0	256.58	0	9.8	Vitrified Clay
1044	O1L17ST8	M17T8	2.8	M17T7	2.4	88.7	0.004	12	0.013	0	0	1004.2	0	3.7	
1051	O1L17SU2	M17U2	-1	M17U1	-2.3	275.1	0.005	12	0.013	0	0	1082.2	0	3.2	
1063	O1L17SR1	M17R1	1.8	M17Q0	0.6	400	0.003	8	0.013	0	0	299.51	0	12.5	Vitrified Clay
1065	O1L17SR2	M17R2	2.9	M17R1	1.8	268.2	0.004	8	0.013	0	0	342.55	0	0	Vitrified Clay
1067	O1L17SR3	M17R3	3.6	M17R2	2.9	161.2	0.005	8	0.013	0	0	367.43	0	0	Vitrified Clay
1074	O1L17SS1	M17S1	-1.4	M17Q2	-3.4	391.3	0.005	8	0.013	0	0	381.87	0	100	Vitrified Clay
1085	O1L17SG2	M17G2	7	M17G1	4.8	398.5	0.006	8	0.01	0	0	527.42	0	7.7	PVC
1271	O2L22SF1	M22F1	-1.8	M22A1	-0.5	112.4	-0.011	6	0.013	0	0	266.59	0	50	Vitrified Clay
1683	O2L19SA2	M19A2	1.5	M19A1	1	72.8	0.007	12	0.013	0	0	1324.9	0	0	Vitrified Clay
1684	O2L19SA1	M19A1	1	W-19	-4.4	16.7	0.321	12	0.013	0	0	9058.2	0	50	Vitrified Clay
3130	O2L29SG1	M29G1	2.5	M29B2	0	130.4	0.019	6	0.01	0	0	453.23	0	5.1	PVC
3983	O2L38SD3	M38D2	0.8	M38D3	1.1	72	0.004	8	0.01	0	0	462.79	0	0	PVC

Model Gravity Sewer Data Table 25 Units Per Acre Build-Out
Exhibit E1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's n	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Depth/ Rise (%)	Material
1515	O2L46SA1	W-46	2	M46A1	2.4	72.7	-0.006	8	0.01	(N/A)	(N/A)	529.48	(N/A)	(N/A)	PVC

EXHIBIT E.2
SEWER MANHOLE DATA TABLE REPORT

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
67	M17A9	8.5	8.5	16416	0	449.5	11.4	460.89	0.79	0.8	FALSE	TRUE
359	M3A1	6.4	6.4	8964	-1.8	356.9	6.225	363.07	0.69	-1.1	FALSE	TRUE
456	M7A1	6.6	8.3	5184	-5.5	179.7	3.6	183.32	2.15	-3.4	FALSE	TRUE
522	M34A1	6.7	6.7	0	-5.5	1914	0	1913.6	0.85	-4.6	FALSE	TRUE
533	M14A2	5.6	7.5	0	-3.6	660.9	0	660.86	1.73	-1.8	FALSE	TRUE
534	M14A3	5.9	5.9	0	-2.6	98.12	0	98.119	0.83	-1.8	FALSE	TRUE
535	M14A4	5.6	5.6	2872.8	-3.1	96.12	1.995	98.119	1.28	-1.8	FALSE	TRUE
598	M3D5	6.8	6.8	3283.2	2.9	0.285	2.28	2.565	1.06	4	FALSE	TRUE
712	M3H5	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
723	M3M1	5.5	5.5	410.4	4.5	0	0.285	0.285	0.01	4.5	FALSE	TRUE
725	M3N1	5.6	5.6	410.4	-6.1	0	0.285	0.285	6.58	0.5	FALSE	TRUE
816	M1F2	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
824	M1B5	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
828	M1J1	6	6	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
832	M1I1	5.8	5.8	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
839	M1KK1	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
843	M1NN1	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
845	M1LL1	6.3	6.3	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
851	M1OO2	6.4	6.4	432	5	0	0.3	0.3	0.01	5	FALSE	TRUE
897	M1D4	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
950	M4C1	5.5	5.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	TRUE
973	M34F2	4.8	4.8	36429.05	0.3	53.62	25.298	78.915	1.75	2	FALSE	TRUE
975	M34F1	4.8	4.8	1890	-0.8	84.69	1.3125	86.002	1.78	1	FALSE	TRUE
977	M34H1	3.4	3.4	4158	-0.2	2.888	2.8875	5.775	1.25	1	FALSE	TRUE
981	M34H3	4.1	4.1	756	2.5	0	0.525	0.525	0.02	2.5	FALSE	TRUE
985	M34A6	4.3	4.3	31753.4	-1.9	343.3	22.051	365.33	0.71	-1.2	FALSE	TRUE
1056	M17A1	8.6	8.6	41040	-7	795.7	28.5	824.17	0.71	-6.3	FALSE	TRUE
1069	M17Q1	6.7	6.7	0	-4	37.05	0	37.05	4.78	0.8	FALSE	TRUE
1071	M17Q2	7.3	7.3	0	-3.4	37.05	0	37.05	4.2	0.8	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1073	M17S1	7	7	0	-1.4	0	0	0	2.26	0.8	FALSE	TRUE
1080	M17A10	8.7	8.7	6156	0.6	430.3	4.275	434.53	1.25	1.8	FALSE	TRUE
1087	M17A11	8.9	8.9	32832	1.6	365.4	22.8	388.21	1.52	3.1	FALSE	TRUE
1098	M14C5	7.4	7.4	36936	-0.4	276.4	25.65	302.05	5.38	4.9	FALSE	TRUE
1099	M14D1	5.1	5.1	24624	0.4	142.5	17.1	159.55	4.66	5.1	TRUE	TRUE
1101	M14D2	4.9	4.9	16416	1.3	131.1	11.4	142.45	3.67	4.9	TRUE	TRUE
1103	M14D3	5.7	5.7	4104	2.1	105.4	2.85	108.25	2.93	5.1	FALSE	TRUE
1105	M14D4	6.1	6.1	16416	2.8	94	11.4	105.4	2.34	5.1	FALSE	TRUE
1107	M14C4	6.2	6.2	185132.02	-1.4	302.1	128.56	430.62	5.35	4	FALSE	TRUE
1109	M14C3	6.4	6.4	29548.8	-2.3	430.6	20.52	451.14	4.31	2	FALSE	TRUE
1112	M14C2	6.4	6.4	0	-2.4	451.1	0	451.14	4.23	1.8	FALSE	TRUE
1114	M14C1	6.4	6.4	0	-2.7	562.7	0	562.74	3.87	1.2	FALSE	TRUE
1121	M14D5	6.3	6.3	8208	3.5	0	5.7	5.7	1.66	5.1	FALSE	TRUE
1123	M14C6	7.1	7.1	4104	0.5	114	2.85	116.85	4.59	5.1	FALSE	TRUE
1125	M14C7	7.4	7.4	12312	1	102.6	8.55	111.15	4.18	5.2	FALSE	TRUE
1127	M14F1	9.2	9.2	16416	1.8	19.95	11.4	31.35	3.41	5.2	FALSE	TRUE
1129	M14F2	0	7.9	16416	2.5	8.55	11.4	19.95	2.66	5.2	FALSE	TRUE
1171	M14A7	6.4	6.4	6885.6	-1.6	71.39	4.7817	76.174	1.41	-0.2	FALSE	TRUE
1284	M22A5	5.4	5.4	122526	2.2	0	85.088	85.088	0.21	2.4	FALSE	TRUE
1288	M26A2	5	5	907.2	2.7	0	0.63	0.63	-0.03	2.7	FALSE	TRUE
1303	M14C8	8.1	8.1	0	1.3	71.25	0	71.25	3.89	5.2	FALSE	TRUE
1305	M14C9	7.3	7.3	53352	1.7	34.2	37.05	71.25	3.44	5.2	FALSE	TRUE
1307	M14C10	7.6	7.6	10260	2.6	7.125	7.125	14.25	2.62	5.2	FALSE	TRUE
1309	M14C11	8.2	8.2	10260	3.1	0	7.125	7.125	2.08	5.2	FALSE	TRUE
1311	M14G1	8	8	16416	2.4	8.55	11.4	19.95	2.74	5.2	FALSE	TRUE
1313	M14G2	8.2	8.2	12312	3.3	0	8.55	8.55	1.92	5.2	FALSE	TRUE
1332	M40A5	9.2	9.2	126831.6	3.7	0	88.078	88.078	0.2	3.9	FALSE	TRUE
1334	M40B2	8	8	3528	4	0	2.45	2.45	-2.03	2	FALSE	TRUE
1386	M37D1	8.1	8.1	1503.6	5	0	1.0442	1.0442	0.02	5	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1393	M17B1	8.8	8.8	0	2.2	173.1	0	173.14	0.91	3.1	FALSE	TRUE
1464	M34A9	4.4	4.4	3402	0.1	215.5	2.3625	217.91	0.65	0.7	FALSE	TRUE
1476	M39A1	5.9	5.9	22680.42	-1.6	15.75	15.75	31.501	3.6	2	FALSE	TRUE
1480	M39A2	5.9	5.9	22680.42	-0.3	0	15.75	15.75	2.25	2	FALSE	TRUE
1493	M18A-A2	5.1	5.1	0	-0.7	76	0	76.004	1.39	0.7	FALSE	TRUE
1495	M18A-A3	5.6	5.6	7257.6	-0.3	70.96	5.04	76.004	0.99	0.7	FALSE	TRUE
1516	M34A3	5.1	5.1	16068.5	-4.4	634	11.159	645.2	0.78	-3.6	FALSE	TRUE
1560	M14H1	5.6	5.6	8208	3	17.1	5.7	22.8	1.99	4.9	FALSE	TRUE
1562	M14H2	5.6	5.6	0	3.4	17.1	0	17.1	1.52	4.9	FALSE	TRUE
1564	M14H3	5.6	5.6	4104	3.8	14.25	2.85	17.1	1.15	4.9	FALSE	TRUE
1566	M14H4	5.9	5.9	12312	4.2	5.7	8.55	14.25	0.73	4.9	FALSE	TRUE
1618	M3F3	5.9	5.9	0	3.2	132.9	0	132.9	0.29	3.5	FALSE	TRUE
1707	M38C2	7	7	20071.38	1	0	13.938	13.938	0.07	1.1	FALSE	TRUE
1715	M38B3	7.1	7.1	19609.59	1.5	0	13.618	13.618	0.08	1.6	FALSE	TRUE
3154	M30L1	4.2	4.2	453.6	3.8	0	0.315	0.315	0.02	3.8	FALSE	TRUE
3197	M18A1	5.6	5.6	3628.8	-3.1	132	2.52	134.55	4.11	1	FALSE	TRUE
3199	M18B2	5	5	11340	-1.6	0	7.875	7.875	2.57	1	FALSE	TRUE
3223	M18B1	5.1	5.1	10886.4	-2.4	7.875	7.56	15.435	3.4	1	FALSE	TRUE
3303	M24A1	6	6	3628.8	-1.6	6.93	2.52	9.45	0.68	-0.9	FALSE	TRUE
3401	M18A5	6.9	6.9	907.2	0.3	0	0.63	0.63	0.72	1	FALSE	TRUE
3402	M18A4	6.3	6.3	7257.6	-0.9	0.63	5.04	5.67	1.93	1	FALSE	TRUE
3404	M18A2	5.4	5.4	10886.4	-2.5	17.01	7.56	24.57	3.48	1	FALSE	TRUE
3407	M18E2	7.1	7.1	4536	-0.6	0.63	3.15	3.78	1.65	1	FALSE	TRUE
3409	M18E1	6.2	6.2	7257.6	-1.8	3.78	5.04	8.82	2.78	1	FALSE	TRUE
3415	M18F1	6.9	6.9	453.6	-1.5	0	0.315	0.315	2.52	1	FALSE	TRUE
3417	M18A3	5.9	5.9	2721.6	-1.6	5.985	1.89	7.875	2.59	1	FALSE	TRUE
3420	M18G1	6.5	6.5	453.6	-0.6	0	0.315	0.315	1.64	1	FALSE	TRUE
3517	M35B1	6.5	6.5	29716.26	2	0	20.636	20.636	0.1	2.1	FALSE	TRUE
3519	M35C1	6	6	4776.24	0	0	3.3168	3.3168	0.04	0	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3911	M7A7	7.9	7.9	432	6.1	0	0.3	0.3	0.02	6.1	FALSE	TRUE
3951	M29D1	5.1	5.1	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
3980	M15A1	7	7	9702	4.5	0	6.7375	6.7375	0.06	4.6	FALSE	TRUE
3991	M35A4	6.6	6.6	27561.66	3.6	0	19.14	19.14	0.1	3.7	FALSE	TRUE
4003	M13A2	6.2	6.2	4800.6	4.5	0	3.3337	3.3337	0.05	4.5	FALSE	TRUE
4005	M10A2	9.3	9.3	672	6	0	0.46667	0.46667	0.02	6	FALSE	TRUE
4008	M9A2	5.1	5.1	28350	1.1	0	19.688	19.688	0.09	1.2	FALSE	TRUE
4013	M9B2	5.3	5.3	34020	1.5	0	23.625	23.625	0.11	1.6	FALSE	TRUE
4035	M3B5	5	5	410.4	4.4	0	0.285	0.285	0.01	4.4	FALSE	TRUE
4037	M3C1	5.7	5.7	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
4039	M2D5	5.3	5.3	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4043	M2G1	5.6	5.6	432	2.8	0	0.3	0.3	0.02	2.9	FALSE	TRUE
4051	M2R4	6.2	6.2	432	4.7	0	0.3	0.3	0.02	4.7	FALSE	TRUE
4053	M2S1	6.1	6.1	432	4.7	0	0.3	0.3	0.01	4.8	FALSE	TRUE
4058	M2T2	6.1	6.1	432	4.2	0	0.3	0.3	0.01	4.2	FALSE	TRUE
4060	M2U1	6.2	6.2	432	3.5	0	0.3	0.3	0.01	3.6	FALSE	TRUE
4067	M2P3	6.1	6.1	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4069	M2Q1	6.9	6.9	432	1.9	0	0.3	0.3	0.02	1.9	FALSE	TRUE
4073	M2J3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4075	M2K1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4077	M2B4	5.5	5.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4084	M1P1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4088	M1O2	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4092	M1Q2	5.3	5.3	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	TRUE
4094	M1R1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4099	M1II1	5.8	5.8	432	5	0	0.3	0.3	0.02	5	FALSE	TRUE
4101	M1HH2	5.7	5.7	432	5.2	0	0.3	0.3	0.01	5.2	FALSE	TRUE
4108	M1KK2	6.5	6.5	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4113	M1BB4	5.6	5.6	432	5.1	0	0.3	0.3	0.01	5.1	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4117	M1CC2	6	6	432	4	0	0.3	0.3	0.02	4	FALSE	TRUE
4119	M1DD1	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4123	M1EE2	6.1	6.1	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4125	M1EE3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4130	M1FF1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4132	M1GG1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4134	M1A6	6.5	6.5	432	1.4	192	0.29999	192.3	0.36	1.8	FALSE	TRUE
4137	M1AA1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4139	M1Z1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4141	M1A5	6.5	6.5	432	1.1	192.9	0.3	193.2	0.36	1.5	FALSE	TRUE
4144	M1X1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4146	M1Y1	6.8	6.8	432	0	0	0.3	0.3	1.5	1.5	FALSE	TRUE
4150	M1U3	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4154	M1V2	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4156	M1W1	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4163	M1T1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4166	M1S3	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4170	M1N3	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4172	M1M2	5	5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4176	M1L1	5.1	5.1	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4178	M1K2	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4186	M1H4	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4188	M34R1	4.4	4.4	378	3	0	0.2625	0.2625	0.01	3	FALSE	TRUE
4190	M34P1	4.8	4.8	378	4	0	0.2625	0.2625	0.01	4	FALSE	TRUE
4192	M34Q1	4.3	4.3	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4194	M34S1	4.7	4.7	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4201	M29A5	5.6	5.6	453.6	4.6	0	0.315	0.315	0.01	4.6	FALSE	TRUE
4209	M25A7	4.1	4.1	453.6	3.5	0	0.315	0.315	0.01	3.5	FALSE	TRUE
4211	M25C2	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4213	M25D1	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4215	M25E1	5.3	5.3	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4219	M25F1	4.7	4.7	907.2	2	0	0.63	0.63	0.02	2	FALSE	TRUE
4221	M25G1	10	10	907.2	8	0	0.63	0.63	0.02	8	FALSE	TRUE
4223	M25I1	5.2	5.2	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4226	M25H1	10	10	907.2	7	0	0.63	0.63	0.02	7	FALSE	TRUE
4228	M25J1	5.2	5.2	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4231	M25B3	7.3	7.3	907.2	5	0	0.63	0.63	0.02	5	FALSE	TRUE
4233	M7C4	4.5	4.5	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4235	M7N1	8.2	8.2	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4237	M7M1	4.8	4.8	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4240	M7L1	9.9	9.9	432	6	0	0.3	0.3	0.01	6	FALSE	TRUE
4244	M7K1	5.3	5.3	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4246	M7J1	8.4	8.4	1728	4	0	1.2	1.2	0.03	4	FALSE	TRUE
4248	M24D2	5.7	5.7	907.2	3.7	0	0.63	0.63	0.02	3.7	FALSE	TRUE
4250	M24E1	8.4	8.4	907.2	5.4	0	0.63	0.63	0.02	5.4	FALSE	TRUE
4252	M24G1	6.8	6.8	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
4254	M24H1	5	5	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4256	M24A3	4.9	4.9	453.6	2	0	0.315	0.315	0.01	2	FALSE	TRUE
4258	M24B1	5.6	5.6	453.6	3	0	0.315	0.315	0.01	3	FALSE	TRUE
4266	M37A5	5	5	1503.6	3	0	1.0442	1.0442	0.02	3	FALSE	TRUE
4268	M14F3	8.3	8.3	12312	3	0	8.55	8.55	2.17	5.2	FALSE	TRUE
4270	M4G3	9	9	4309.2	6.2	0	2.9925	2.9925	0.04	6.2	FALSE	TRUE
4272	M32C2	5.2	5.2	19879.02	1	0	13.805	13.805	0.09	1.1	FALSE	TRUE
4286	M14E1	8	8	4104	4.8	0	2.85	2.85	0.25	5.1	FALSE	TRUE
4386	M32B2	6	6	12526.5	3	0	8.699	8.699	0.07	3.1	FALSE	TRUE
4414	M30G1	3.4	3.4	1360.8	2	0	0.945	0.945	0.02	2	FALSE	TRUE
4419	M30D1	3.5	3.5	2721.6	2	0	1.89	1.89	0.03	2	FALSE	TRUE
4427	M16C1	4.7	4.7	11340	2.2	0	7.875	7.875	0.06	2.3	FALSE	TRUE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4454	M38A8	10.3	10.3	2469.6	7	0	1.715	1.715	0.03	7	FALSE	TRUE
68	M17J1	8.8	8.8	16416	3.7	3.563	11.4	14.962	0.09	3.8	FALSE	FALSE
222	M17K1	9.3	9.3	2052	5.6	0	1.425	1.425	0.03	5.6	FALSE	FALSE
226	M17J2	8.8	8.8	1026	4.8	2.85	0.7125	3.5625	0.04	4.8	FALSE	FALSE
227	M17J3	9.2	9.2	2052	5.2	0	1.425	1.425	0.03	5.2	FALSE	FALSE
352	M17M8	7.2	7.2	0	4.2	0	0	0	0	4.2	FALSE	FALSE
353	M17M7	7	7	16416	3.8	0	11.4	11.4	0.07	3.8	FALSE	FALSE
375	M3A2	6.2	6.2	11080.8	-1.3	196.9	7.695	204.57	0.36	-0.9	FALSE	FALSE
377	M3G1	6.1	6.1	4514.4	0.2	2.85	3.135	5.985	0.06	0.3	FALSE	FALSE
379	M3G2	6.2	6.2	3693.6	1.7	0.285	2.565	2.85	0.04	1.7	FALSE	FALSE
381	M3G3	6.4	6.4	410.4	3.1	0	0.285	0.285	0.01	3.1	FALSE	FALSE
384	M17A1	4.4	4.4	18900	0.3	45.5	13.125	58.625	0.15	0.5	FALSE	FALSE
403	M1A1	7.2	7.2	1728	-1	269.3	1.2	270.45	0.34	-0.7	FALSE	FALSE
418	M2A1	5.8	5.8	432	-2.1	64.2	0.3	64.5	0.19	-1.9	FALSE	FALSE
424	M3J1	5.4	5.4	820.8	3	162	0.57	162.53	0.28	3.3	FALSE	FALSE
451	M1A9	6.3	6.3	1728	3	185.1	1.2	186.3	0.28	3.3	FALSE	FALSE
523	M34A2	5.7	5.7	20709.15	-4.6	679.6	14.381	694	0.53	-4.1	FALSE	FALSE
530	M14A1	6.3	6.3	0	-4	752.8	0	752.77	0.58	-3.4	FALSE	FALSE
545	M7B1	8.4	8.4	2592	3.6	0.3	1.8	2.1	0.03	3.6	FALSE	FALSE
546	M7B2	7.7	7.7	432	4.9	0	0.3	0.3	0.02	4.9	FALSE	FALSE
549	M7A3	6.1	6.1	3888	-0.6	62.93	2.7	65.633	0.19	-0.4	FALSE	FALSE
550	M7D1	6	6	15552	1	45.53	10.8	56.333	0.18	1.2	FALSE	FALSE
551	M7D2	6	6	15552	1.8	28.73	10.8	39.533	0.16	2	FALSE	FALSE
552	M7D3	6.7	6.7	13824	2.7	13.13	9.6	22.733	0.12	2.8	FALSE	FALSE
553	M7E1	7.7	7.7	11136	4.9	0	7.7333	7.7333	0.07	5	FALSE	FALSE
554	M7H1	6.7	6.7	864	4.7	0	0.6	0.6	0.02	4.7	FALSE	FALSE
555	M7I2	6.1	6.1	864	4.6	0	0.6	0.6	0.02	4.6	FALSE	FALSE
559	M7D4	7.4	7.4	6912	4.4	0.6	4.8	5.4	0.06	4.5	FALSE	FALSE
560	M7G2	7.1	7.1	864	5.6	0	0.6	0.6	0.02	5.6	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
561	M7F2	7.7	7.7	864	5.8	0	0.6	0.6	0.02	5.8	FALSE	FALSE
564	M7A6	8	8	2592	4.9	0.3	1.8	2.1	0.04	5	FALSE	FALSE
565	M7D5	7.7	7.7	864	6.1	0	0.6	0.6	0.02	6.1	FALSE	FALSE
580	M7A5	7.7	7.7	3024	3.3	2.1	2.1	4.2	0.05	3.3	FALSE	FALSE
583	M7A4	6.6	6.6	3456	1.3	4.2	2.4	6.6	0.06	1.4	FALSE	FALSE
587	M7A2	6.1	6.1	3456	-2	65.63	2.4	68.033	0.19	-1.8	FALSE	FALSE
590	M7G1	6.3	6.3	6912	3.9	0.6	4.8	5.4	0.05	4	FALSE	FALSE
593	M7F1	6.5	6.5	6912	4.1	0.6	4.8	5.4	0.06	4.2	FALSE	FALSE
596	M3D4	6.7	7.5	3283.2	2	2.565	2.28	4.845	0.05	2	FALSE	FALSE
597	M3D3	6.6	6.6	2052	1.5	7.41	1.425	8.835	0.08	1.6	FALSE	FALSE
599	M3D6	6.3	6.3	410.4	3.9	0	0.285	0.285	0.11	4	FALSE	FALSE
600	M2A7	6.4	6.4	432	3.7	0	0.3	0.3	0.02	3.8	FALSE	FALSE
601	M3E1	5.4	5.4	3283.2	2.4	0.285	2.28	2.565	0.04	2.5	FALSE	FALSE
602	M3E2	5.3	5.3	410.4	3.3	0	0.285	0.285	0.02	3.3	FALSE	FALSE
603	M2O2	6.1	6.1	432	3.4	0	0.3	0.3	0.02	3.4	FALSE	FALSE
604	M2A6	6.3	6.3	3024	2.8	0.3	2.1	2.4	0.04	2.9	FALSE	FALSE
605	M2O1	6.1	6.1	3456	2.4	0.3	2.4	2.7	0.05	2.5	FALSE	FALSE
606	M2A4	7.3	7.3	3024	1.5	7.5	2.1	9.6	0.08	1.5	FALSE	FALSE
607	M2A5	7.3	7.3	3456	1.9	2.4	2.4	4.8	0.06	2	FALSE	FALSE
608	M2A3	7.1	7.1	3888	0.3	12.9	2.7	15.6	0.08	0.3	FALSE	FALSE
622	M36A11	5.8	5.8	0	2.8	0	0	0	0	2.8	FALSE	FALSE
623	M36A10	5.9	5.9	11970	1.4	0	8.3125	8.3125	0.06	1.5	FALSE	FALSE
624	M36A9	5.7	5.7	11970	1	8.313	8.3125	16.625	0.09	1.1	FALSE	FALSE
625	M36A8	5.9	5.9	23276.4	0.2	40.18	16.164	56.344	0.17	0.4	FALSE	FALSE
627	M36A6	5.8	5.8	23276.4	-1.7	72.51	16.164	88.673	0.21	-1.4	FALSE	FALSE
628	M36A5	6.4	6.4	23276.4	-2	88.67	16.164	104.84	0.23	-1.7	FALSE	FALSE
629	M36A4	5.9	5.9	11306.4	-2.2	104.8	7.8517	112.69	0.34	-1.9	FALSE	FALSE
630	M36A3	6.1	6.1	24924.06	-2.4	131.6	17.308	148.91	0.27	-2.2	FALSE	FALSE
631	M36E1	7.1	7.1	13617.66	2.2	9.457	9.4567	18.913	0.09	2.3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
632	M36H1	8.8	8.8	11306.4	3	15.7	7.8517	23.555	0.1	3.1	FALSE	FALSE
633	M36H2	9.3	9.3	11306.4	5.1	7.852	7.8517	15.703	0.08	5.2	FALSE	FALSE
634	M36H3	9.4	9.4	11306.4	6	0	7.8517	7.8517	0.06	6.1	FALSE	FALSE
641	M36A7	5.6	5.6	23276.4	-0.7	56.34	16.164	72.508	0.19	-0.5	FALSE	FALSE
648	M36E2	7.1	7.1	13617.66	6	0	9.4567	9.4567	0.07	6.1	FALSE	FALSE
650	M36A2	6.2	6.2	11306.4	-4.1	148.9	7.8517	156.76	0.28	-3.8	FALSE	FALSE
652	M36A1	5.8	5.8	76461.84	-5.2	420.6	53.098	473.73	0.43	-4.7	FALSE	FALSE
654	M36B1	6.5	6.5	50449.56	-4	228.8	35.034	263.87	0.37	-3.6	FALSE	FALSE
656	M36C2	5.3	7.9	15466.92	-0.5	69.33	10.741	80.072	0.19	-0.3	FALSE	FALSE
658	M36C3	8.2	8.2	33278.7	3.9	46.22	23.11	69.331	0.18	4.1	FALSE	FALSE
660	M36C4	8.6	8.6	15466.92	5.1	10.74	10.741	21.482	0.1	5.1	FALSE	FALSE
662	M36C5	8.5	10.4	15466.92	6	0	10.741	10.741	0.07	6.1	FALSE	FALSE
664	M36G2	8.9	8.9	17812.2	6	0	12.37	12.37	0.08	6.1	FALSE	FALSE
665	M36G1	8.8	8.8	17811.78	5	12.37	12.369	24.739	0.12	5.1	FALSE	FALSE
668	M36D2	6	6	0	1.9	29.8	0	29.802	0.15	2.1	FALSE	FALSE
670	M36D3	5.9	5.9	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
672	M36F1	5.5	5.5	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
674	M36B6	5.7	5.7	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
675	M36B5	6.5	6.5	0	2.1	14.9	0	14.901	0.08	2.1	FALSE	FALSE
677	M36B3	6.4	8.3	3439.8	-0.1	70.8	2.3888	73.19	0.18	0.1	FALSE	FALSE
679	M36I1	7.1	8.2	2192.4	1.5	41.08	1.5225	42.6	0.14	1.6	FALSE	FALSE
681	M36B2	6.3	6.3	50449.56	-3	73.19	35.034	108.22	0.24	-2.7	FALSE	FALSE
684	M36C1	8.3	8.3	15466.5	-2	80.07	10.741	90.812	0.21	-1.8	FALSE	FALSE
687	M36D1	8.3	8.3	0	1	29.8	0	29.802	0.12	1.1	FALSE	FALSE
690	M36B4	8	8	19152	0.5	14.9	13.3	28.201	0.12	0.7	FALSE	FALSE
693	M17A8	8.4	8.4	0	-2.1	505.9	0	505.93	0.45	-1.7	FALSE	FALSE
694	M17L1	7.7	10.5	0	0.9	45.04	0	45.041	0.14	1	FALSE	FALSE
696	M17L2	8.3	8.3	0	1.2	45.04	0	45.041	0.14	1.3	FALSE	FALSE
698	M17L3	6.7	6.7	10260	1.8	37.92	7.125	45.041	0.14	1.9	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
700	M17L4	7.6	7.6	16416	2.3	26.52	11.4	37.916	0.13	2.5	FALSE	FALSE
702	M17L5	7	7	16416	3.6	15.12	11.4	26.516	0.11	3.7	FALSE	FALSE
704	M17L6	7.2	7.2	21766.4	4	0	15.116	15.116	0.08	4.1	FALSE	FALSE
706	M3H2	5.4	5.4	2872.8	1.3	166.7	1.995	168.66	0.34	1.6	FALSE	FALSE
708	M3H3	5.5	5.5	2052	1.8	2.71	1.425	4.135	0.05	1.8	FALSE	FALSE
710	M3H4	4.9	4.9	1231.2	2.5	0.285	0.855	1.14	0.03	2.5	FALSE	FALSE
714	M3I1	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
716	M3K1	5.8	5.8	410.4	-5.1	0	1.285	1.285	6.93	1.8	FALSE	FALSE
718	M3L4	5.2	5.2	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
719	M3L3	3.9	3.9	2462.4	1.7	0.285	1.71	1.995	0.03	1.7	FALSE	FALSE
721	M3L2	5.7	5.7	2052	0.9	2.28	1.425	3.705	0.05	0.9	FALSE	FALSE
726	M3L1	5.9	5.9	4514.4	0.4	4.275	3.135	7.41	0.07	0.5	FALSE	FALSE
729	M3O1	6.3	6.3	410.4	5	0	0.285	0.285	0.01	5	FALSE	FALSE
731	M3H1	5.1	5.1	3693.6	-0.1	176.1	2.565	178.63	0.35	0.2	FALSE	FALSE
734	M3A3	6.1	6.1	2462.4	0.4	10.55	1.71	12.255	0.09	0.5	FALSE	FALSE
741	M3A4	5.8	5.8	2462.4	1.4	8.835	1.71	10.545	0.08	1.5	FALSE	FALSE
743	M3C2	5.6	5.6	410.4	2	0	0.285	0.285	0.02	2	FALSE	FALSE
749	M3A9	5.3	5.3	410.4	5	0	0.285	0.285	0.21	5.2	FALSE	FALSE
750	M3A8	5.4	5.4	820.8	4.3	0.285	0.57	0.855	0.03	4.3	FALSE	FALSE
752	M3A7	5.5	5.5	1641.6	3.5	0.855	1.14	1.995	0.04	3.6	FALSE	FALSE
754	M3A6	5.3	5.3	1231.2	2.9	1.995	0.855	2.85	0.05	2.9	FALSE	FALSE
756	M3A5	6.4	6.4	2872.8	1.7	2.85	1.995	4.845	0.06	1.8	FALSE	FALSE
760	M2B3	5.6	5.6	864	3	0.3	0.6	0.9	0.02	3	FALSE	FALSE
761	M2B2	5.9	5.9	1296	2	0.9	0.9	1.8	0.03	2	FALSE	FALSE
763	M2B1	5.9	5.9	1728	1	1.8	1.2	3	0.04	1	FALSE	FALSE
765	M2A2	6.2	6.2	6912	-1.3	33.9	4.8	38.7	0.15	-1.1	FALSE	FALSE
768	M2J1	6.1	6.1	1296	0.1	2.4	0.9	3.3	0.25	0.4	FALSE	FALSE
770	M2L1	5.7	5.7	864	0.6	0.6	0.6	1.2	0.03	0.7	FALSE	FALSE
772	M2M1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
776	M2L2	6	6	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
778	M2N1	6.1	6.1	432	0.9	0	0.3	0.3	0.02	0.9	FALSE	FALSE
780	M2I1	6	6	864	4	0	0.6	0.6	0.02	4	FALSE	FALSE
781	M2D4	5.5	5.5	3888	3	1.2	2.7	3.9	0.05	3.1	FALSE	FALSE
783	M2D3	5.4	5.4	3456	1.5	3.9	2.4	6.3	0.06	1.6	FALSE	FALSE
785	M2D2	5.4	5.4	2592	0	6.3	1.8	8.1	0.06	0.1	FALSE	FALSE
787	M2D1	5.8	5.8	5184	-1.7	9.3	3.6	12.9	0.08	-1.6	FALSE	FALSE
789	M2E1	5.9	5.9	1296	2	0.3	0.9	1.2	0.03	2	FALSE	FALSE
791	M2E2	5.8	5.8	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
795	M2C1	5.8	5.8	5184	-1.8	9	3.6	12.6	0.08	-1.7	FALSE	FALSE
797	M2F1	5.7	5.7	2160	0.4	2.1	1.5	3.6	0.05	0.4	FALSE	FALSE
799	M2F2	5.8	5.8	2160	2.1	0.6	1.5	2.1	0.04	2.1	FALSE	FALSE
801	M2F3	6.1	6.1	432	2.6	0	0.3	0.3	0.02	2.6	FALSE	FALSE
803	M2C2	5.6	5.6	4752	-1.3	2.1	3.3	5.4	0.06	-1.3	FALSE	FALSE
805	M2C3	5.7	5.7	2592	0.9	0.3	1.8	2.1	0.04	0.9	FALSE	FALSE
807	M2C4	5.3	5.3	432	2.3	0	0.3	0.3	0.02	2.3	FALSE	FALSE
809	M2R1	5.7	5.7	3888	1.8	5.4	2.7	8.1	0.07	1.8	FALSE	FALSE
811	M2R2	5.8	5.8	432	3.2	2.4	0.3	2.7	0.04	3.3	FALSE	FALSE
813	M1G1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
814	M1F1	6.1	6.1	5184	2.5	0.6	3.6	4.2	0.05	2.6	FALSE	FALSE
818	M1B2	6	6	4320	1.2	10.8	3	13.8	0.09	1.2	FALSE	FALSE
820	M1B3	5.9	5.9	1296	2.4	5.7	0.9	6.6	0.06	2.4	FALSE	FALSE
822	M1B4	5.6	5.6	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
826	M1H1	5.8	5.8	2160	2.9	3	1.5	4.5	0.05	2.9	FALSE	FALSE
830	M1H2	5.9	5.9	2160	3.3	1.2	1.5	2.7	0.04	3.3	FALSE	FALSE
834	M1H3	6.1	6.1	864	3.6	0.3	0.6	0.9	0.03	3.7	FALSE	FALSE
836	M1JJ4	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	FALSE
837	M1JJ3	6.1	6.1	6480	2.7	0.6	4.5	5.1	0.05	2.7	FALSE	FALSE
841	M1JJ2	6.3	6.3	6480	2.1	5.7	4.5	10.2	0.08	2.2	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
847	M1JJ1	6.6	6.6	6912	1.7	11.1	4.8	15.9	0.1	1.8	FALSE	FALSE
849	M1OO1	6.3	6.3	864	4.5	0.3	0.6	0.9	0.02	4.5	FALSE	FALSE
853	M1MM1	6.2	6.2	0	4.5	0	0	0	0	4.5	FALSE	FALSE
855	M1D2	6.7	6.7	4320	0.9	16.5	3	19.5	0.11	1	FALSE	FALSE
858	M1B1	6.5	6.5	6912	-0.4	13.8	4.8	18.6	0.1	-0.3	FALSE	FALSE
861	M1E4	6.6	6.6	27000	3	0	18.75	18.75	0.1	3.1	FALSE	FALSE
862	M1E3	5.7	5.7	0	1.5	18.75	0	18.75	0.11	1.6	FALSE	FALSE
864	M1E2	5.4	5.4	1296	0.7	20.55	0.9	21.45	0.11	0.8	FALSE	FALSE
866	M1E1	6.3	6.3	1728	-0.3	22.05	1.2	23.25	0.11	-0.1	FALSE	FALSE
868	M1A2	6.4	6.4	2592	-0.8	223.4	1.8	225.15	0.37	-0.4	FALSE	FALSE
871	M1A4	6.5	6.5	0	1	196.2	0	196.2	0.35	1.3	FALSE	FALSE
882	M1U1	6.1	6.1	0	2.6	1.8	0	1.8	0.03	2.6	FALSE	FALSE
884	M1A7	6.5	6.5	0	1.7	191.4	0	191.4	0.31	2	FALSE	FALSE
886	M1BB2	5.9	5.9	0	3	1.5	0	1.5	0.03	3	FALSE	FALSE
891	M1A10	6.7	6.7	32400	4.3	6.25	22.5	28.75	0.12	4.4	FALSE	FALSE
893	M1A11	8.2	8.2	9000	4.8	0	6.25	6.25	1.64	6.4	FALSE	FALSE
899	M23B2	6.9	6.9	5460	3.5	0	3.7917	3.7917	0.05	3.6	FALSE	FALSE
900	M23B1	5.4	5.4	56700	1.9	3.792	39.375	43.167	0.27	2.2	FALSE	FALSE
903	M17A2	6.1	7.8	3360	2.1	0	2.3333	2.3333	0.04	2.2	FALSE	FALSE
905	M5B2	6	6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
906	M5B1	6.4	6.4	3175.2	3	0.315	2.205	2.52	0.04	3	FALSE	FALSE
908	M5A3	6.2	6.2	7711.2	-2.4	22.23	5.355	27.585	0.11	-2.3	FALSE	FALSE
910	M5A2	6	6	4536	-2.7	38.3	3.15	41.445	0.15	-2.5	FALSE	FALSE
913	M5C1	6.4	6.4	3175.2	2	0.315	2.205	2.52	0.04	2	FALSE	FALSE
915	M5C2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
921	M5D3	6.3	6.3	4082.4	0.7	5.04	2.835	7.875	0.07	0.8	FALSE	FALSE
923	M5A4	6	6	3628.8	-0.7	17.19	2.52	19.71	0.11	-0.6	FALSE	FALSE
925	M5A6	5.8	5.8	3628.8	0.5	14.67	2.52	17.19	0.11	0.6	FALSE	FALSE
927	M5A7	6.5	6.5	3628.8	1.8	12.15	2.52	14.67	0.1	1.9	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
929	M5A8	6.3	6.3	4082.4	3.1	0.315	11.835	12.15	0.09	3.2	FALSE	FALSE
931	M5D4	6	6	3175.2	2.2	2.835	2.205	5.04	0.06	2.3	FALSE	FALSE
933	M5D5	6.3	6.3	3628.8	3.4	0.315	2.52	2.835	0.04	3.4	FALSE	FALSE
935	M5A9	5.8	5.8	453.6	4.5	0	0.315	0.315	0.02	4.5	FALSE	FALSE
937	M5D6	5.8	5.8	453.6	4.6	0	0.315	0.315	0.02	4.6	FALSE	FALSE
939	M4H2	5.9	5.9	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
940	M4H1	6.4	6.4	4082.4	2.5	0.315	2.835	3.15	0.04	2.5	FALSE	FALSE
944	M4A3	6.7	6.7	7257.6	0.7	17.33	5.04	22.365	0.12	0.8	FALSE	FALSE
946	M4B1	6.1	6.1	4536	2.5	0.315	3.15	3.465	0.05	2.5	FALSE	FALSE
948	M4B2	6.3	6.3	453.6	4.3	0	0.315	0.315	0.02	4.3	FALSE	FALSE
952	M4A4	6.7	6.7	7257.6	1.2	8.505	5.04	13.545	0.1	1.3	FALSE	FALSE
954	M4D1	6.5	6.5	907.2	3.5	0.63	0.63	1.26	0.03	3.5	FALSE	FALSE
956	M4E1	6.4	6.4	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
958	M4D2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
960	M4F1	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
961	M4A5	6.7	6.7	9525.6	1.8	0.63	6.615	7.245	0.07	1.8	FALSE	FALSE
964	M4G1	7.6	7.6	4536	3	3.623	3.15	6.7725	0.06	3.1	FALSE	FALSE
966	M4G2	7.4	7.4	907.2	5.4	2.993	0.63	3.6225	0.05	5.4	FALSE	FALSE
968	M4A6	7.2	7.2	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
970	M34F4	4.4	4.4	6171.9	1.8	0	4.286	4.286	1.63	3.5	FALSE	FALSE
971	M34F3	4.8	4.8	2646	1.2	4.286	1.8375	6.1235	1.65	2.8	FALSE	FALSE
979	M34H2	5.1	5.1	2646	0.9	0.525	1.8375	2.3625	0.17	1	FALSE	FALSE
983	M34I1	3.4	3.4	756	1.5	0	0.525	0.525	0.02	1.5	FALSE	FALSE
987	M34A7	4.3	4.3	13769	-0.5	245.7	9.5618	255.24	0.42	-0.1	FALSE	FALSE
989	M34J1	3.2	3.2	3780	0.1	3.413	2.625	6.0375	0.06	0.2	FALSE	FALSE
991	M34K1	4.5	4.5	4158	1.1	0.263	2.8875	3.15	0.05	1.1	FALSE	FALSE
993	M34K2	4.7	4.7	378	3	0	0.2625	0.2625	0.01	3	FALSE	FALSE
995	M34J2	5	5	378	2.5	0	0.2625	0.2625	0.01	2.5	FALSE	FALSE
997	M34A5	4.2	4.2	0	-2.1	365.3	0	365.33	0.43	-1.6	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
999	M34A4	4.1	4.1	0	-3	365.3	0	365.33	0.45	-2.5	FALSE	FALSE
1001	M34E2	7.1	7.1	2940	1.5	0	2.0417	2.0417	0.03	1.5	FALSE	FALSE
1003	M17M6	7.1	7.1	41040	2.5	11.4	28.5	39.9	0.14	2.6	FALSE	FALSE
1005	M17M5	6.8	6.8	16416	1.9	39.9	11.4	51.3	0.15	2	FALSE	FALSE
1007	M17M4	6.8	6.8	0	1	51.3	0	51.3	0.15	1.2	FALSE	FALSE
1009	M17M3	6.8	6.8	16416	0.6	51.3	11.4	62.7	0.17	0.8	FALSE	FALSE
1011	M17M2	6.9	6.9	16416	-0.3	62.7	11.4	74.1	0.19	-0.1	FALSE	FALSE
1013	M17M1	7	7	16416	-0.8	74.1	11.4	85.5	0.2	-0.6	FALSE	FALSE
1015	M17A3	9.6	9.6	2720.8	-6.4	591.4	1.8895	593.32	0.73	-5.7	FALSE	FALSE
1017	M17A6	8	8	0	-3.4	505.9	0	505.93	0.45	-3	FALSE	FALSE
1019	M17O3	8.4	8.4	32832	4.1	0	22.8	22.8	0.1	4.2	FALSE	FALSE
1020	M17O2	6.9	6.9	16416	2.9	22.8	11.4	34.2	0.13	3	FALSE	FALSE
1022	M17N1	6.7	6.7	49248	0.1	91.2	34.2	125.4	0.22	0.3	FALSE	FALSE
1024	M17N2	6.9	6.9	32832	3.7	11.4	22.8	34.2	0.13	3.8	FALSE	FALSE
1026	M17N3	6.8	6.8	0	4.7	11.4	0	11.4	0.07	4.7	FALSE	FALSE
1028	M17N4	7.6	7.6	16416	5.3	0	11.4	11.4	0.07	5.3	FALSE	FALSE
1030	M17A2	8	8	0	-6.6	718.7	0	718.72	0.75	-5.9	FALSE	FALSE
1033	M17U1	6.9	6.9	16416	-2.3	0	11.4	11.4	0.06	-2.2	FALSE	FALSE
1034	M17T3	8.1	8.1	0	-2.8	48.45	0	48.45	0.14	-2.7	FALSE	FALSE
1036	M17T4	8.2	8.2	16416	1.1	25.65	11.4	37.05	0.12	1.2	FALSE	FALSE
1038	M17V1	7.1	7.1	16416	1.8	2.85	11.4	14.25	0.08	1.9	FALSE	FALSE
1040	M17V2	6.8	6.8	4104	2.8	0	2.85	2.85	0.04	2.8	FALSE	FALSE
1042	M17T8	8.5	8.5	0	2.8	0	0	0	0	2.8	FALSE	FALSE
1043	M17T7	8	8	16416	2.4	0	11.4	11.4	0.07	2.5	FALSE	FALSE
1045	M17T6	7.2	7.2	0	2.1	11.4	0	11.4	0.07	2.1	FALSE	FALSE
1047	M17T5	7.7	7.7	0	1.8	11.4	0	11.4	0.07	1.9	FALSE	FALSE
1050	M17U2	7.6	7.6	0	-1	0	0	0	0	-1	FALSE	FALSE
1052	M17T2	7	7	0	-3.3	48.45	0	48.45	0.15	-3.2	FALSE	FALSE
1054	M17T1	7.4	7.4	0	-3.5	48.45	0	48.45	0.13	-3.3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1060	M17Q0	7.2	7.2	31920	0.6	37.05	22.167	59.217	0.17	0.8	FALSE	FALSE
1062	M17R1	6.9	6.9	0	1.8	0	0	0	0	1.8	FALSE	FALSE
1064	M17R2	7.1	7.1	0	2.9	0	0	0	0	2.9	FALSE	FALSE
1066	M17R3	7.6	7.6	0	3.6	0	0	0	0	3.6	FALSE	FALSE
1075	M17H3	8.4	8.4	4104	4.5	0	2.85	2.85	0.04	4.5	FALSE	FALSE
1076	M17H2	8.6	8.6	19494	3	2.85	13.538	16.388	0.09	3.1	FALSE	FALSE
1078	M17H1	8.7	8.7	4104	2.6	16.39	2.85	19.237	0.09	2.6	FALSE	FALSE
1082	M17G1	9.6	9.6	32832	4.8	0	22.8	22.8	0.1	4.9	FALSE	FALSE
1084	M17G2	9.4	9.4	0	7	0	0	0	0	7	FALSE	FALSE
1086	M17A12	9.4	9.4	131328	4	0	91.2	91.2	0.23	4.2	FALSE	FALSE
1092	M17P1	7	8.6	32832	2.9	5.7	22.8	28.5	0.11	3	FALSE	FALSE
1094	M17P2	7.4	7.4	0	4.1	5.7	0	5.7	0.05	4.2	FALSE	FALSE
1096	M17P3	8	9.5	8208	4.5	0	5.7	5.7	0.05	4.6	FALSE	FALSE
1141	M14I1	5.4	5.4	2052	-0.8	1.71	1.425	3.135	0.04	-0.8	FALSE	FALSE
1143	M14I2	5.3	5.3	2052	0.5	0.285	1.425	1.71	0.03	0.5	FALSE	FALSE
1145	M14I3	5.8	5.8	410.4	1.5	0	0.285	0.285	0.01	1.5	FALSE	FALSE
1147	M14J1	5.4	5.4	2052	-1.9	2.565	1.425	3.99	0.12	-1.8	FALSE	FALSE
1149	M14J2	5.7	5.7	1641.6	-0.7	1.425	1.14	2.565	0.04	-0.7	FALSE	FALSE
1151	M14J3	5.7	5.7	1641.6	0.3	0.285	1.14	1.425	0.03	0.3	FALSE	FALSE
1153	M14J4	5.9	5.9	410.4	1.4	0	0.285	0.285	0.01	1.4	FALSE	FALSE
1155	M14A5	5.2	5.2	7797.6	-2.4	83.58	5.415	88.999	0.64	-1.7	FALSE	FALSE
1157	M14L1	5.5	5.5	5335.2	0.1	0.57	3.705	4.275	0.04	0.1	FALSE	FALSE
1159	M14L2	5.2	5.2	820.8	1.5	0	0.57	0.57	0.02	1.5	FALSE	FALSE
1161	M14K1	5.2	5.2	3693.6	0.6	0.57	2.565	3.135	0.04	0.7	FALSE	FALSE
1163	M14K2	5.6	5.6	820.8	1.6	0	0.57	0.57	0.02	1.6	FALSE	FALSE
1165	M14B1	6.5	6.5	22002	-1.7	76.63	15.279	91.913	0.2	-1.5	FALSE	FALSE
1167	M14B2	5.3	5.3	110352	-1.4	0	76.633	76.633	0.29	-1.1	FALSE	FALSE
1169	M14A6	5.1	5.1	0	-0.5	76.17	0	76.174	0.19	-0.3	FALSE	FALSE
1173	M14M1	5.3	5.3	4924.8	-0.4	13.97	3.42	17.385	0.24	-0.2	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1175	M14N1	5.6	5.6	1641.6	0.9	0.57	1.14	1.71	0.03	0.9	FALSE	FALSE
1177	M14N2	5.5	5.5	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1179	M14O1	5.6	5.6	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1181	M14M2	6.6	6.6	4924.8	2.2	8.835	3.42	12.255	0.07	2.2	FALSE	FALSE
1183	M14P1	6.8	6.8	820.8	3.8	0	0.57	0.57	0.02	3.8	FALSE	FALSE
1185	M14M3	7.4	7.4	5745.6	3	4.275	3.99	8.265	0.07	3.1	FALSE	FALSE
1187	M14Q1	7.3	7.3	1231.2	4.3	0	0.855	0.855	0.02	4.3	FALSE	FALSE
1189	M14M4	8	8	4104	4.3	0.57	2.85	3.42	0.05	4.3	FALSE	FALSE
1191	M14R1	7.5	7.5	410.4	4.4	0	0.285	0.285	0.02	4.4	FALSE	FALSE
1193	M14M5	9.1	9.1	410.4	5.7	0	0.285	0.285	0.01	5.7	FALSE	FALSE
1195	M14A8	6.7	6.7	2462.4	-0.6	27.93	1.71	29.64	0.43	-0.2	FALSE	FALSE
1197	M14A9	8	8	2052	0.4	26.51	1.425	27.93	0.13	0.5	FALSE	FALSE
1199	M14Y1	7.8	7.8	410.4	4.8	0	0.285	0.285	0.01	4.8	FALSE	FALSE
1201	M14S1	5.3	5.3	10670.4	1	16.96	7.41	24.368	0.11	1.1	FALSE	FALSE
1203	M14X1	6.4	6.4	2052	2	0.713	1.425	2.1375	0.04	2	FALSE	FALSE
1205	M14X2	7.3	7.3	1026	3.3	0	0.7125	0.7125	0.02	3.3	FALSE	FALSE
1207	M14S2	5.7	5.7	2872.8	2.1	12.83	1.995	14.82	0.1	2.1	FALSE	FALSE
1209	M14S3	6	6	5335.2	2.9	7.41	3.705	11.115	0.08	2.9	FALSE	FALSE
1211	M14V1	7.6	7.6	820.8	3.9	0	0.57	0.57	0.02	3.9	FALSE	FALSE
1213	M14S4	7.7	7.7	5335.2	3.7	3.135	3.705	6.84	0.07	3.8	FALSE	FALSE
1215	M14W1	7.2	7.2	410.4	4.2	0	0.285	0.285	0.02	4.2	FALSE	FALSE
1217	M14S5	8	8	3693.6	4.7	0.285	2.565	2.85	0.04	4.7	FALSE	FALSE
1219	M14T1	6.3	6.3	1641.6	3.1	0.57	1.14	1.71	0.03	3.1	FALSE	FALSE
1221	M14U1	5.9	5.9	410.4	3.5	0	0.285	0.285	0.02	3.5	FALSE	FALSE
1223	M14T2	6.6	6.6	410.4	3.4	0	0.285	0.285	0.02	3.4	FALSE	FALSE
1225	M14S6	8.8	8.8	410.4	5.8	0	0.285	0.285	0.01	5.8	FALSE	FALSE
1227	M14A10	8.2	8.2	11491.2	1.2	18.24	7.98	26.22	0.12	1.3	FALSE	FALSE
1229	M14A11	8.3	8.3	6976.8	2	4.845	4.845	9.69	0.07	2.1	FALSE	FALSE
1231	M14BB1	8.4	8.4	2462.4	3.3	1.71	1.71	3.42	0.05	3.3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1233	M14BB2	8.4	8.4	2052	4.2	0.285	1.425	1.71	0.03	4.3	FALSE	FALSE
1235	M14AA1	8.6	8.6	4104	3.9	0.57	2.85	3.42	0.04	4	FALSE	FALSE
1237	M14AA2	8.4	8.4	820.8	4.8	0	0.57	0.57	0.02	4.8	FALSE	FALSE
1239	M14A12	8.9	8.9	1231.2	3.5	0.57	0.855	1.425	0.03	3.6	FALSE	FALSE
1241	M14A13	9	9	820.8	5	0	0.57	0.57	0.02	5	FALSE	FALSE
1243	M14BB3	8.4	8.4	410.4	5.2	0	0.285	0.285	0.02	5.2	FALSE	FALSE
1245	M14Z1	8.4	8.4	6566.4	4.2	0.57	4.56	5.13	0.05	4.2	FALSE	FALSE
1247	M14Z2	8.4	8.4	820.8	5.5	0	0.57	0.57	0.02	5.5	FALSE	FALSE
1269	M22A1	5	5	39480	-1.4	362.5	27.417	389.91	0.39	-1	FALSE	FALSE
1270	M22F1	4.7	4.7	0	-1.8	0	0	0	1.26	-0.5	FALSE	FALSE
1274	M22A2	4.8	4.8	20412	-0.8	348.3	14.175	362.49	0.53	-0.3	FALSE	FALSE
1276	M22B1	6.2	6.2	123832.8	1.2	0.945	85.995	86.94	0.2	1.4	FALSE	FALSE
1278	M22B2	5.6	5.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
1280	M22E1	5.3	5.3	453.6	2.6	0	0.315	0.315	0.01	2.6	FALSE	FALSE
1282	M22A3	5.2	5.2	24494.4	0.9	244.4	17.01	261.37	0.37	1.3	FALSE	FALSE
1287	M26A1	5.4	5.4	5443.2	0	0.63	3.78	4.41	-0.03	0	FALSE	FALSE
1315	M17Q5	7.6	7.6	4104	5.3	0	2.85	2.85	0.04	5.3	FALSE	FALSE
1316	M17Q4	7.2	7.2	32832	4.1	2.85	22.8	25.65	0.12	4.2	FALSE	FALSE
1318	M17Q3	7.2	7.2	16416	3.3	25.65	11.4	37.05	0.13	3.4	FALSE	FALSE
1325	M40A1	8	8	0	-0.6	90.53	0	90.528	0.21	-0.4	FALSE	FALSE
1326	M40A2	7.9	7.9	0	0.3	88.08	0	88.078	0.1	0.4	FALSE	FALSE
1328	M40A3	8.4	8.4	0	1.5	88.08	0	88.078	0.1	1.6	FALSE	FALSE
1330	M40A4	7.5	7.5	0	2.7	88.08	0	88.078	0.2	2.9	FALSE	FALSE
1347	M34U1	5.1	5.1	15807.75	2.6	0	10.978	10.978	0.08	2.7	FALSE	FALSE
1348	M34L1	4.7	4.7	3250.8	1.6	15.8	2.2575	18.058	0.1	1.7	FALSE	FALSE
1350	M34A8	4.6	4.6	5292	0	236	3.675	239.64	0.58	0.6	FALSE	FALSE
1354	M16A5	5.8	5.8	0	0.6	31.71	0	31.711	0.14	0.7	FALSE	FALSE
1355	M16A6	5.4	5.4	22680	1.1	15.96	15.75	31.711	0.12	1.2	FALSE	FALSE
1357	M16A7	6.2	6.2	6200.88	2.8	4.568	4.3062	8.8737	0.06	2.8	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1359	M16A8	6.1	6.1	0	3.5	4.568	0	4.5675	0.05	3.6	FALSE	FALSE
1361	M16A9	7	7	5443.2	3.9	0.788	3.78	4.5675	0.04	4	FALSE	FALSE
1363	M16A10	6.9	6.9	1134	5.1	0	0.7875	0.7875	0.02	5.1	FALSE	FALSE
1365	M16G1	4.2	4.2	7257.6	2.5	2.048	5.04	7.0875	0.06	2.5	FALSE	FALSE
1367	M16G2	5.5	5.5	2948.4	3.4	0	2.0475	2.0475	0.04	3.5	FALSE	FALSE
1369	M37A4	5.5	5.5	1503.6	-0.4	43.66	1.0442	44.699	0.14	-0.3	FALSE	FALSE
1370	M37A3	5.4	5.4	4510.8	-1.6	44.7	3.1325	47.831	0.15	-1.5	FALSE	FALSE
1372	M37A2	5.3	5.3	9021.6	-2.8	49.92	6.265	56.185	0.16	-2.6	FALSE	FALSE
1374	M37B1	4.8	4.8	3007.2	-1.7	0	2.0883	2.0883	0.03	-1.7	FALSE	FALSE
1376	M37A1	5.7	5.7	0	-3.2	69.76	0	69.759	0.16	-3	FALSE	FALSE
1378	M37C1	6	6	9021.6	-2.6	7.309	6.265	13.574	0.08	-2.6	FALSE	FALSE
1380	M37E1	5.3	5.3	3007.2	-1.6	0	2.0883	2.0883	0.03	-1.6	FALSE	FALSE
1382	M37C2	6.3	6.3	4510.8	-1.4	2.088	3.1325	5.2208	0.05	-1.3	FALSE	FALSE
1384	M37C3	5.1	5.1	1503.6	-0.4	0	1.0442	1.0442	0.02	-0.4	FALSE	FALSE
1395	M17B2	9	9	0	2.6	173.1	0	173.14	0.56	3.1	FALSE	FALSE
1397	M17B3	8	8	32832	3.4	150.3	22.8	173.14	0.29	3.7	FALSE	FALSE
1399	M17C1	7.7	7.7	16416	3.7	0	11.4	11.4	0.07	3.8	FALSE	FALSE
1401	M17B4	8.1	8.1	0	4	138.9	0	138.94	0.48	4.5	FALSE	FALSE
1403	M17B5	9.7	9.7	16416	4.7	127.5	11.4	138.94	0.26	4.9	FALSE	FALSE
1405	M17I1	8.1	8.1	16416	4.9	0	11.4	11.4	0.07	5	FALSE	FALSE
1407	M17B6	7.7	7.7	68742	5.6	68.4	47.737	116.14	0.23	5.8	FALSE	FALSE
1409	M17D1	8.1	8.1	16416	6.2	0	11.4	11.4	0.07	6.3	FALSE	FALSE
1411	M17B7	8.1	8.1	16416	6.1	45.6	11.4	57	-0.27	5.9	FALSE	FALSE
1413	M17B9	7.6	7.6	16416	6.5	34.2	11.4	45.6	0.15	6.7	FALSE	FALSE
1415	M17E1	8.6	8.6	16416	7	0	11.4	11.4	0.07	7.1	FALSE	FALSE
1417	M17B10	10.2	10.2	16416	7	11.4	11.4	22.8	0.11	7.1	FALSE	FALSE
1419	M17B11	10.3	10.3	16416	7.8	0	11.4	11.4	0.07	7.8	FALSE	FALSE
1421	M34E1	5.1	5.1	0	-0.9	2.042	0	2.0417	0.03	-0.9	FALSE	FALSE
1424	M32A1	5.8	5.8	0	-1.2	59.74	0	59.743	0.17	-1	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1426	M32C1	5.7	5.7	0	0	13.81	0	13.805	-0.31	-0.3	FALSE	FALSE
1430	M32A2	7.2	7.2	21413.28	0.8	31.07	14.87	45.938	0.15	0.9	FALSE	FALSE
1432	M32A3	5.6	5.6	12285	1.1	22.54	8.5313	31.068	0.12	1.3	FALSE	FALSE
1434	M32A4	5.3	5.3	23784.18	1.9	0	16.517	16.517	0.09	2	FALSE	FALSE
1436	M32D1	4.8	4.8	8668.8	1.4	0	6.02	6.02	0.06	1.4	FALSE	FALSE
1440	M31A4	5.5	5.5	22378.02	0.4	0	15.54	15.54	0.11	0.5	FALSE	FALSE
1441	M31A3	7.4	7.4	26877.48	-0.1	15.54	18.665	34.205	0.13	0.1	FALSE	FALSE
1443	M31A2	7.7	7.7	28061.88	-2.3	34.21	19.487	53.693	0.16	-2.1	FALSE	FALSE
1445	M31A1	6.2	6.2	56089.32	-4	86.48	38.951	125.43	0.24	-3.7	FALSE	FALSE
1446	M31B1	5.8	5.8	13608	-0.4	23.34	9.45	32.788	0.12	-0.3	FALSE	FALSE
1449	M31B2	6.3	6.3	8022	0.8	17.77	5.5708	23.338	0.1	0.9	FALSE	FALSE
1451	M31B4	4.3	4.3	11116.56	3.4	0	7.7198	7.7198	0.06	3.5	FALSE	FALSE
1455	M34A13	4.7	4.7	378	2.1	6.3	0.2625	6.5625	0.07	2.2	FALSE	FALSE
1456	M34A11	4.4	4.4	0	1.5	213.1	0	213.13	0.41	1.9	FALSE	FALSE
1458	M34A10	4.4	4.4	756	0.8	213.1	0.525	213.65	0.42	1.2	FALSE	FALSE
1461	M34A12	4.5	4.5	756	1.7	7.088	0.525	7.6125	0.27	1.9	FALSE	FALSE
1497	M18A-B1	5.3	5.3	2721.6	0.9	0	1.89	1.89	0.03	0.9	FALSE	FALSE
1499	M18A-A4	5.5	5.5	2268	0.2	67.5	1.575	69.074	0.55	0.7	FALSE	FALSE
1501	M18A-A5	5.3	5.3	8164.8	0.7	61.83	5.67	67.499	0.19	0.9	FALSE	FALSE
1503	M18A-C1	8.2	8.2	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	FALSE
1505	M18A-A6	5.4	5.4	1360.8	1.2	60.25	0.945	61.199	0.17	1.4	FALSE	FALSE
1507	M18A-D1	9.2	9.2	6350.4	2.5	0	4.41	4.41	0.05	2.5	FALSE	FALSE
1509	M18A-A7	7.7	7.7	1360.8	1.7	54.9	0.945	55.844	0.16	1.9	FALSE	FALSE
1511	M18A-A8	8.3	8.3	2268	2.1	53.32	1.575	54.899	0.16	2.3	FALSE	FALSE
1513	M46A1	4.9	4.9	(N/A)	0.8	(N/A)	(N/A)	(N/A)	(N/A)	(N/A)	FALSE	FALSE
1519	M34C1	6.5	6.5	11550	-1	26.4	8.0208	34.417	0.11	-0.9	FALSE	FALSE
1521	M34C2	7.1	7.1	0	-0.3	26.4	0	26.396	0.11	-0.2	FALSE	FALSE
1523	M34C3	7.2	7.2	5460	1.7	22.6	3.7917	26.396	0.11	1.8	FALSE	FALSE
1525	M34C4	7.6	7.6	2310	2.9	21	1.6042	22.604	0.1	3	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1527	M34C5	8.5	8.5	30240	4.1	0	21	21	0.1	4.2	FALSE	FALSE
1529	M34D2	5.5	5.5	12640.25	3.6	0	8.778	8.778	0.06	3.6	FALSE	FALSE
1530	M34D1	5.7	5.7	0	2.9	8.778	0	8.778	0.06	3	FALSE	FALSE
1532	M34B1	5.8	5.8	8050	1.7	19.21	5.5903	24.795	0.11	1.8	FALSE	FALSE
1534	M34B2	6.7	6.7	0	2.3	10.43	0	10.427	0.07	2.3	FALSE	FALSE
1536	M34B3	5.7	5.7	2520	2.9	8.677	1.75	10.427	0.07	3	FALSE	FALSE
1538	M34B4	5.3	5.3	10220	3.5	1.58	7.0972	8.6771	0.06	3.6	FALSE	FALSE
1540	M34B5	6	6	2275	4.3	0	1.5799	1.5799	0.03	4.3	FALSE	FALSE
1550	M17F1	9.1	9.1	32832	2.8	78.28	22.8	101.08	0.39	3.2	FALSE	FALSE
1552	M17F2	8.9	8.9	0	3.9	78.28	0	78.277	0.22	4.1	FALSE	FALSE
1554	M17F3	10.9	10.9	70178.4	4	29.54	48.735	78.277	0.19	4.2	FALSE	FALSE
1556	M17F4	10	10	42540	5.2	0	29.542	29.542	0.14	5.4	FALSE	FALSE
1568	M14H5	5.7	5.7	8208	5.2	0	5.7	5.7	0.06	5.3	FALSE	FALSE
1579	M16B1	6.4	6.4	4116	-2	32.05	2.8583	34.912	0.11	-1.9	FALSE	FALSE
1581	M16B2	6	6	8232	-1.7	17.18	5.7167	22.896	0.12	-1.5	FALSE	FALSE
1583	M16A2	6	6	0	-2.6	95.48	0	95.475	0.19	-2.4	FALSE	FALSE
1585	M16A3	5.4	5.4	11655	-1.4	87.38	8.0938	95.475	0.21	-1.2	FALSE	FALSE
1587	M16D1	6.1	6.1	24347.4	-0.1	7.554	16.908	24.462	0.12	0	FALSE	FALSE
1589	M16D2	4.8	4.8	10878	2	0	7.5542	7.5542	0.06	2.1	FALSE	FALSE
1591	M16A4	4.1	4.1	44940	-0.3	31.71	31.208	62.92	0.15	-0.1	FALSE	FALSE
1599	M38D2	8	8	8750.7	0.7	0	6.0769	6.0769	0.06	0.7	FALSE	FALSE
1600	M38D1	5.7	5.7	8750.7	0.1	6.077	6.0769	12.154	0.07	0.2	FALSE	FALSE
1602	M38A6	6	6	8750.7	-1.1	13.87	6.0769	19.946	0.1	-1	FALSE	FALSE
1604	M17O1	6.9	6.9	32832	1.7	34.2	22.8	57	0.16	1.8	FALSE	FALSE
1609	M3D2	6.3	6.3	3283.2	0.6	8.835	2.28	11.115	0.09	0.7	FALSE	FALSE
1611	M3D1	6.4	6.4	2872.8	-0.2	11.12	1.995	13.11	0.1	-0.1	FALSE	FALSE
1614	M3F1	6.6	6.6	4514.4	-0.4	136	3.135	139.17	0.29	-0.1	FALSE	FALSE
1616	M3F2	6	6	4514.4	1.5	132.9	3.135	136.04	0.29	1.8	FALSE	FALSE
1680	M19A2	5.2	5.2	0	1.5	0	0	0	0	1.5	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1681	M19A1	5.4	5.4	0	1	0	0	0	0	1	FALSE	FALSE
1695	M38A5	4.9	4.9	18901.68	-2.1	19.95	13.126	33.072	0.12	-2	FALSE	FALSE
1697	M38A4	5	5	18901.68	-3.8	33.07	13.126	46.198	0.15	-3.7	FALSE	FALSE
1701	M38A3	5.1	5.1	18901.68	-5.5	46.2	13.126	59.324	0.18	-5.4	FALSE	FALSE
1703	M38A2	6.6	6.6	38973.06	-7.2	100.3	27.065	127.39	0.25	-7	FALSE	FALSE
1705	M38C1	7	7	38973.06	-0.7	13.94	27.065	41.003	0.14	-0.6	FALSE	FALSE
1709	M38A1	6.1	6.1	20090.99	-8.9	168.3	13.952	182.2	0.3	-8.6	FALSE	FALSE
1711	M38B1	6.5	6.5	19609.59	-1.6	27.24	13.618	40.853	0.14	-1.4	FALSE	FALSE
1713	M38B2	7.1	7.1	19609.59	0.1	13.62	13.618	27.236	0.11	0.2	FALSE	FALSE
1717	M16A1	5.9	5.9	15456	-2.8	138.3	10.733	149	0.27	-2.5	FALSE	FALSE
1726	M16H1	6.4	6.4	4998	-1.9	2.829	3.4708	6.3	0.06	-1.8	FALSE	FALSE
1727	M16F1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1729	M16B4	7.2	7.2	8988	5	0	6.2417	6.2417	0.05	5	FALSE	FALSE
1731	M16B3	7.2	7.2	11634	-1.5	6.242	8.0792	14.321	0.08	-1.4	FALSE	FALSE
1732	M16E1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1735	M16H2	6.7	6.7	4074	4.2	0	2.8292	2.8292	0.03	4.2	FALSE	FALSE
1751	M31B3	5.4	5.4	14468.16	1.7	7.72	10.047	17.767	0.09	1.7	FALSE	FALSE
1755	M30A9	4.1	4.1	0	3.8	0.63	0	0.63	0.02	3.8	FALSE	FALSE
1756	M30A8	4.4	4.4	453.6	3.1	0.63	0.315	0.945	0.03	3.1	FALSE	FALSE
1757	M30A6	3.3	3.3	0	2.7	1.26	0	1.26	0.03	2.7	FALSE	FALSE
1758	M30K1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1759	M30A5	3.8	3.8	2721.6	2.2	2.52	1.89	4.41	0.05	2.2	FALSE	FALSE
1760	M30J1	4	4	907.2	3.5	0	0.63	0.63	0.02	3.5	FALSE	FALSE
1761	M30A4	3.6	3.6	2721.6	1.4	5.67	1.89	7.56	0.07	1.5	FALSE	FALSE
1762	M30I1	3.4	3.4	907.2	2	0	0.63	0.63	0.02	2	FALSE	FALSE
1763	M30H1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1764	M30A3	3.7	3.7	1814.4	0.6	8.505	1.26	9.765	0.07	0.6	FALSE	FALSE
1767	M30A1	3.5	3.5	1814.4	-0.9	28.35	1.26	29.61	0.12	-0.8	FALSE	FALSE
1836	M29A1	4.5	4.5	1814.4	-1.6	23	1.26	24.255	0.09	-1.5	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3102	M34G1	5.2	5.2	68390	3.8	0	47.493	47.493	0.16	4	FALSE	FALSE
3105	M34O1	5.3	5.3	1814.4	2.9	0.63	1.26	1.89	0.03	2.9	FALSE	FALSE
3107	M34O2	5	5	907.2	3.3	0	0.63	0.63	0.02	3.3	FALSE	FALSE
3112	M29A2	4.5	4.5	8164.8	-0.7	8.505	5.67	14.175	0.08	-0.6	FALSE	FALSE
3118	M29E1	5.4	5.4	907.2	4	0	0.63	0.63	0.02	4	FALSE	FALSE
3120	M29B1	4.2	4.2	3628.8	-1	5.67	2.52	8.19	0.07	-0.9	FALSE	FALSE
3122	M29F1	4.6	4.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
3125	M29B2	4.5	4.5	4989.6	0	1.575	3.465	5.04	0.05	0.1	FALSE	FALSE
3127	M29B4	4.6	4.6	453.6	2.5	0	0.315	0.315	0.01	2.5	FALSE	FALSE
3129	M29G1	4.5	4.5	0	2.5	0	0	0	0	2.5	FALSE	FALSE
3131	M29C1	5	5	0	2	0.63	0	0.63	0.02	2	FALSE	FALSE
3133	M29C2	5.1	5.1	907.2	3	0	0.63	0.63	0.02	3	FALSE	FALSE
3135	M34L2	4.3	4.3	1360.8	2.3	3.878	0.945	4.8225	0.05	2.4	FALSE	FALSE
3137	M34M1	4.4	4.4	378	2.8	0.525	0.2625	0.7875	0.02	2.9	FALSE	FALSE
3139	M34M2	4.8	4.8	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	FALSE
3141	M34N1	4.5	4.5	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3143	M34L3	4.2	4.2	3693.6	2.9	0.525	2.565	3.09	0.04	2.9	FALSE	FALSE
3145	M34L4	4.4	4.4	756	3.9	0	0.525	0.525	0.02	3.9	FALSE	FALSE
3147	M34A16	5	5	378	4.9	0	0.2625	0.2625	0.01	4.9	FALSE	FALSE
3148	M34A14	4.3	4.3	4158	2.3	2.888	2.8875	5.775	0.06	2.3	FALSE	FALSE
3152	M34T1	4	4	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3155	M30A10	4.6	4.6	453.6	4	0.315	0.315	0.63	0.02	4	FALSE	FALSE
3165	M30A11	4.6	4.6	453.6	4.4	0	0.315	0.315	0.02	4.4	FALSE	FALSE
3168	M30C2	4	4	453.6	1.3	0	0.315	0.315	0.02	1.3	FALSE	FALSE
3170	M30C1	4	4	2268	-0.5	0.315	1.575	1.89	0.03	-0.5	FALSE	FALSE
3174	M30B1	3.2	3.2	1360.8	-0.5	12.6	0.945	13.545	0.08	-0.4	FALSE	FALSE
3176	M30B4	4	4	0	1.7	4.095	0	4.095	0.05	1.8	FALSE	FALSE
3178	M30B5	4.8	4.8	453.6	2.2	3.78	0.315	4.095	0.05	2.3	FALSE	FALSE
3180	M30B6	4.9	4.9	4536	2.7	0.63	3.15	3.78	0.05	2.7	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3182	M30B7	4.1	4.1	453.6	3.6	0	0.315	0.315	0.01	3.6	FALSE	FALSE
3184	M30M1	4.6	4.6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
3186	M30B2	2.8	2.8	3628.8	0	10.08	2.52	12.6	0.08	0.1	FALSE	FALSE
3189	M30E1	3	3	2721.6	1.5	0	1.89	1.89	0.03	1.5	FALSE	FALSE
3191	M30B3	2.8	2.8	3175.2	1	5.985	2.205	8.19	0.07	1.1	FALSE	FALSE
3194	M30F1	2.6	2.6	2721.6	1.8	0	1.89	1.89	0.04	1.8	FALSE	FALSE
3243	M18C9	5.3	5.3	453.6	3.4	75.33	0.315	75.649	0.19	3.6	FALSE	FALSE
3246	M18C2	5.5	5.5	10432.8	3	76.59	7.245	83.839	0.19	3.2	FALSE	FALSE
3276	M18C1	5.4	5.4	11793.6	2.5	83.84	8.19	92.029	0.21	2.7	FALSE	FALSE
3304	M24D1	7.9	7.9	3628.8	-0.9	1.26	2.52	3.78	0.06	-0.8	FALSE	FALSE
3319	M24A2	5.4	5.4	1814.4	-1	0.63	1.26	1.89	0.11	-0.9	FALSE	FALSE
3328	M25A1	4.6	4.6	5443.2	-1	44.47	3.78	48.252	0.13	-0.8	FALSE	FALSE
3330	M25C1	5.6	5.6	5896.8	0.6	1.26	4.095	5.355	0.05	0.7	FALSE	FALSE
3346	M25A4	4.6	4.6	4536	1	13.98	3.15	17.127	0.09	1.1	FALSE	FALSE
3348	M25A2	5.6	5.6	8618.4	-0.4	23.11	5.985	29.097	0.13	-0.3	FALSE	FALSE
3357	M25B1	5.3	5.3	5896.8	0.3	10.02	4.095	14.115	0.08	0.3	FALSE	FALSE
3364	M7C1	8	8	7344	-0.9	104.5	5.1	109.59	0.23	-0.7	FALSE	FALSE
3377	M7C3	8.3	8.3	9936	0.7	84.46	6.9	91.361	0.21	0.9	FALSE	FALSE
3383	M25B2	5.4	5.4	9979.2	0.9	1.83	6.93	8.76	0.08	1	FALSE	FALSE
3389	M25A5	4	4	453.6	1.5	13.35	0.315	13.662	0.08	1.6	FALSE	FALSE
3391	M25A6	4.6	4.6	18765.6	1.9	0.315	13.032	13.347	0.08	2	FALSE	FALSE
3397	M25K1	4.2	4.2	453.6	2.4	0	0.315	0.315	0.01	2.4	FALSE	FALSE
3406	M18E3	7	7	907.2	1.3	0	0.63	0.63	0.02	1.3	FALSE	FALSE
3422	M1C2	6.7	6.7	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
3423	M1C1	6.4	6.4	5184	2	0.3	3.6	3.9	0.04	2	FALSE	FALSE
3509	M35A1	6	6	0	-1.3	452.8	0	452.83	0.5	-0.8	FALSE	FALSE
3511	M35A2	6.7	6.7	9904.23	-0.1	83.01	6.8779	89.89	0.21	0.1	FALSE	FALSE
3513	M35A3	6.7	6.7	24740.52	1.5	65.83	17.181	83.012	0.2	1.7	FALSE	FALSE
3515	M35D1	6	6	49581.63	2	0	34.432	34.432	0.13	2.1	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3642	M18A-A1	5.1	5.1	0	-1	76	0	76.004	0.17	-0.8	FALSE	FALSE
3682	M22A4	5.5	5.5	0	1.6	244.4	0	244.36	0.43	2	FALSE	FALSE
3901	M13A1	5.5	5.5	7194.6	3.2	3.334	4.9963	8.33	0.06	3.3	FALSE	FALSE
3947	M10A1	9.3	9.3	2898	5.5	0.467	2.0125	2.4792	0.04	5.5	FALSE	FALSE
3949	M29A3	4.6	4.6	7711.2	0.2	2.52	5.355	7.875	0.06	0.2	FALSE	FALSE
3982	M38D3	6.5	6.5	0	1.1	0	0	0	0	1.1	FALSE	FALSE
3989	M35A4	6.8	6.8	17653.86	2.7	19.14	12.26	31.4	0.12	2.8	FALSE	FALSE
4007	M9A1	6.9	6.9	71442	-0.3	66.94	49.613	116.55	0.24	-0.1	FALSE	FALSE
4011	M9B1	5.8	5.8	34020	0.5	23.63	23.625	47.25	0.15	0.6	FALSE	FALSE
4017	M5D1	6	6	0	-1	10.71	0	10.71	0.07	-1	FALSE	FALSE
4019	M5D2	6.2	6.2	4082.4	-0.8	7.875	2.835	10.71	0.08	-0.8	FALSE	FALSE
4022	M5A1	6.4	6.4	3175.2	-2.9	43.97	2.205	46.17	0.16	-2.8	FALSE	FALSE
4024	M4A2	7.5	7.5	0	0.3	22.37	0	22.365	0.11	0.4	FALSE	FALSE
4027	M3B1	5.7	5.7	1641.6	1.9	2.565	1.14	3.705	0.05	1.9	FALSE	FALSE
4029	M3B2	5.8	5.8	1231.2	2.8	1.425	0.855	2.28	0.04	2.9	FALSE	FALSE
4031	M3B3	5.5	5.5	410.4	3.3	1.14	0.285	1.425	0.03	3.3	FALSE	FALSE
4033	M3B4	5.4	5.4	1231.2	3.6	0.285	0.855	1.14	0.03	3.6	FALSE	FALSE
4041	M2H1	5.5	5.5	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	FALSE
4049	M2R3	5.9	5.9	2592	3.7	0.6	1.8	2.4	0.04	3.8	FALSE	FALSE
4056	M2T1	5.9	5.9	3024	2.3	0.6	2.1	2.7	0.04	2.3	FALSE	FALSE
4062	M2P1	6	6	4320	0	12.3	3	15.3	0.09	0.1	FALSE	FALSE
4065	M2P2	6.1	6.1	5184	0.5	0.6	3.6	4.2	0.05	0.6	FALSE	FALSE
4071	M2J2	6.4	6.4	432	1	0.6	0.3	0.9	0.02	1	FALSE	FALSE
4079	M1A3	6.4	6.4	2160	-0.1	198	1.5	199.5	0.34	0.3	FALSE	FALSE
4082	M1O1	5.5	5.5	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4090	M1Q1	5.4	5.4	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4097	M1HH1	5.6	5.6	2592	3.5	0.6	1.8	2.4	0.04	3.5	FALSE	FALSE
4103	M1BB1	6.3	6.3	0	2.4	3.6	0	3.6	0.04	2.4	FALSE	FALSE
4106	M1KK1	6.8	6.8	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE

Model Manhole Data Table 25 Unit Per Acre Build-Out
Exhibit E2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4111	M1BB3	5.9	5.9	432	3.9	0.3	0.3	0.6	0.02	3.9	FALSE	FALSE
4115	M1CC1	6.3	6.3	432	3.5	0.6	0.3	0.9	0.02	3.5	FALSE	FALSE
4121	M1EE1	6.2	6.2	432	2.9	0.6	0.3	0.9	0.02	2.9	FALSE	FALSE
4127	M1A8	6.4	6.4	1296	1.9	186.9	0.89999	187.8	0.29	2.2	FALSE	FALSE
4148	M1U2	5.8	5.8	432	3.6	0.3	0.3	0.6	0.02	3.6	FALSE	FALSE
4152	M1V1	6.4	6.4	864	3	0.6	0.6	1.2	0.03	3	FALSE	FALSE
4158	M1S1	6.2	6.2	0	1.8	3	0	3	0.04	1.8	FALSE	FALSE
4161	M1S2	5.7	5.7	864	2.5	0.6	0.6	1.2	0.03	2.5	FALSE	FALSE
4168	M1M1	5.3	5.3	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4174	M1K1	5.1	5.1	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4180	M1D1	7	7	3024	-0.2	19.5	2.1	21.6	0.11	-0.1	FALSE	FALSE
4183	M1D3	6.4	6.4	432	3	0.3	0.3	0.6	0.02	3	FALSE	FALSE
4196	M34A15	4	4	3402	3.3	0.263	2.3625	2.625	0.04	3.3	FALSE	FALSE
4199	M29A4	4.7	4.7	2268	1.1	0.315	1.575	1.89	0.03	1.1	FALSE	FALSE
4203	M29B3	4.6	4.6	1814.4	2	0.315	1.26	1.575	0.03	2	FALSE	FALSE
4206	M30A7	3.7	3.7	0	2.8	1.26	0	1.26	0.03	2.8	FALSE	FALSE
4217	M25A3	4.2	4.2	0	0.2	17.13	0	17.127	0.09	0.3	FALSE	FALSE
4239	M7C2	8.6	8.6	14580	-0.1	92.86	10.125	102.99	0.24	0.1	FALSE	FALSE
4280	M17A4	9.5	9.5	0	-6.3	505.9	0	505.93	0.68	-5.7	FALSE	FALSE
4283	M17A5	8.4	8.4	0	-5.7	505.9	0	505.93	0.6	-5.1	FALSE	FALSE
4314	M18D1	5.2	5.2	1360.8	3.2	0	0.945	0.945	0.03	3.2	FALSE	FALSE
4384	M32B1	6.3	6.3	13356	2	8.699	9.275	17.974	0.08	2.1	FALSE	FALSE
4416	M30A2	3.6	3.6	1814.4	-0.2	11.66	1.26	12.915	0.08	-0.1	FALSE	FALSE
4452	M38A7	6.3	6.3	0	-0.5	1.715	0	1.715	0.03	-0.5	FALSE	FALSE
4476	M4A1	7.5	7.5	17628	0.1	32.29	12.242	44.529	0.16	0.3	FALSE	FALSE

EXHIBIT E.3
FORCEMAIN DATA TABLE REPORT

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3880	O1L42FB2	PMP-42a	O1L42J1		25	6.4	2	0.013	111.61	111.61	11.4	10	114%	6.74
3494	O2L19FB2	PMP-19B	O1L34J2	Steel	342	8.2	8	0.013	1747.5	1747.5	11.15	10	112%	28.55
3495	O2L19F2	O1L34J2	O2L19J1	Steel	49	6.8	8	0.013	1747.5	1747.5	11.15	10	112%	4.09
3508	O2L19F1	O2L19J1	O2L34J2	Ductile Iron		20.7	8	0.012	1747.5	1747.5	11.15	10	112%	1.06
3489	O2L34F1	O1L34J1	O-2	Ductile Iron		17.4	12	0.012	3723.9	3723.9	10.56	10	106%	0.5
3507	O2L34F2	O2L34J2	O1L34J1	Ductile Iron		23.9	12	0.012	3552.1	3552.1	10.08	10	101%	0.63
1744	O2L31FA2	PMP-31A	O2L31J2	Steel	77	8	3	0.013	201.26	201.26	9.13	10	91%	26.91
3919	O2L45FA2	PMP-45a	O2L45J2	PVC	25	7.6	2	0.01	86.238	86.238	8.81	10	88%	4.18
3921	O2L45F2	O2L45J1	O2L45J2	PVC		39.6	2	0.01	-86.238	-86.238	8.81	10	88%	6.62
3720	O2L18A-F1	O2L18AJ1	M18C9	PVC		71.5	2	0.01	75.334	75.334	7.69	10	77%	9.31
3650	O2L36F2	O2L36J2	O2L36J1	Ductile Iron		585.8	8	0.013	1194.8	1194.8	7.63	10	76%	14.88
3652	O2L36F1	M34A1	O2L36J1	Ductile Iron		48	8	0.012	-1194.8	-1194.8	7.63	10	76%	1.22
527	O2L34FA2	PMP-34A	O2L34J6	Ductile Iron	154	11.3	8	0.012	1150.9	1150.9	7.35	10	74%	3.65
2455	O2L34F5	O2L34J5	O2L34J4	Ductile Iron		2007	8	0.012	1150.9	1150.9	7.35	10	74%	47.56
3624	O2L34F6	O2L34J6	O2L34J5	Ductile Iron		46.9	8	0.012	1150.9	1150.9	7.35	10	74%	1.11
1296	O2L26F1	O2L26J1	M22A4	PVC		142.1	3	0.01	159.28	159.28	7.23	10	72%	10.27
1792	O2L26FB2	PMP-26B	O2L26J1	Steel	79	10.1	3	0.013	159.28	159.28	7.23	10	72%	9.28
446	O2L6FA2	PMP-6A	O2L6J1		74	6.9	3	0.013	153.95	153.95	6.99	10	70%	5.02
3077	O2L16FA2	PMP-16A	O2L16J2	Ductile Iron	77	7.6	4	0.012	269.04	269.04	6.87	10	69%	10.94
3739	O2L16F2	O2L16J2	O2L16J1	PVC		363.9	4	0.01	269.04	269.04	6.87	10	69%	17.1
3811	O2L32F1	O2L32J1	M34A3	PVC		681.8	4	0.01	268.71	268.71	6.86	10	69%	31.97
474	O1L14FA1	PMP-14A	O1L14J3	Steel	134	7.5	6	0.013	547.15	547.15	6.21	10	62%	5.29
3606	O1L14FA2	W-14	PMP-14A	Ductile Iron	44	7.8	6	0.012	547.15	547.15	6.21	10	62%	1.07
4399	O2L47F2	O2L47J2	O2L47J1	PVC		13.6	2	0.01	56.842	56.842	5.8	10	58%	1.05
4410	O2L47FB1	PMP-47B	O2L47J2	PVC	40	7.3	2	0.01	56.842	56.842	5.8	10	58%	3.09
3942	O2L33F2	O2L33J2	O2L33J1	PVC		32.6	2	0.01	56.531	56.531	5.77	10	58%	2.49
3944	O2L33FA2	PMP-33A	O2L33J2	Steel	70	5.9	2	0.013	56.531	56.531	5.77	10	58%	8.7
3821	O2L7FA2	PMP-7A	O2L7J2	Ductile Iron	104	7.6	4	0.012	213.42	213.42	5.45	10	55%	3.18
3825	O2L7F2	O2L7J2	O2L7J1	PVC		31.1	4	0.01	213.42	213.42	5.45	10	55%	0.95

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3927	O2L46FA2	PMP-46a	O2L46J1	PVC	25	6.3	2	0.01	53.324	53.324	5.45	10	55%	1.72
3932	O2L46F1	O2L46J1	M18A-A8	PVC		213.3	2	0.01	53.324	53.324	5.45	10	55%	14.64
3587	O2L44F2	O1L44J2	O1L44J1	PVC		124.3	2	0.01	52.785	52.785	5.39	10	54%	8.37
3695	O2L44FA2	PMP-44a	O1L44J2	PVC	25	7.1	2	0.01	52.785	52.785	5.39	10	54%	1.68
217	O2L11F1	O2L11J1	O2L10J2	PVC		477.6	6	0.01	455.24	455.24	5.17	10	52%	8.25
477	O2L10F2	O2L10J2	O2L10J1	PVC		613.4	6	0.01	455.24	455.24	5.17	10	52%	10.59
3964	O2L10F1	O2L10J1	O2L36J3	Ductile Iron		287.1	6	0.012	455.24	455.24	5.17	10	52%	4.96
3664	O2L31F2	O2L31J2	O2L31J1	PVC		1088.2	4	0.01	201.26	201.26	5.14	10	51%	29.87
3506	O2L34F3	O2L34J3	O2L34J2	Ductile Iron		21.1	12	0.012	1804.6	1804.6	5.12	10	51%	0.16
3089	O2L29FA2	PMP-29A	O2L29J2	Steel	78	11.7	3	0.013	104.88	104.88	4.76	10	48%	7.74
3095	O2L29F2	O2L29J2	O2L29J1	PVC		12.7	3	0.01	104.88	104.88	4.76	10	48%	0.42
1691	O2L22A2	PMP-22A	O2L22J2	Steel	113	7.5	4	0.013	183.34	183.34	4.68	10	47%	4.24
3716	O2L22F1	O2L22J2	O2L22J1	PVC		973.6	4	0.013	183.34	183.34	4.68	10	47%	22.48
216	O2L12F1	O2L12J1	O2L11J1	PVC		333.4	6	0.01	409.22	409.22	4.64	10	46%	4.73
4402	O2L47F1	O2L47J1	M34A11	PVC		559.7	3	0.01	100.64	100.64	4.57	10	46%	17.28
3725	O2L18F4	O2L18J3	O2L18J2	Ductile Iron		170.7	3	0.012	97.859	97.859	4.44	10	44%	5.01
163	O2L18F1	O2L18J1	O2L36J2	Ductile Iron		130.4	8	0.012	689.45	689.45	4.4	10	44%	1.2
3730	O2L18F3	O2L18J2	O2L18J1	Cast iron		1013.7	8	0.012	689.45	689.45	4.4	10	44%	13.04
3527	O2L35FA2	PMP-35A	O2L35J2	Steel	90	6.9	4	0.013	171.8	171.8	4.39	10	44%	3
3529	O2L35F2	O2L35J2	O2L35J1	PVC		9.4	4	0.01	171.8	171.8	4.39	10	44%	0.19
3536	O2L35F1	O2L35J1	O1L34J1	PVC		2583.6	4	0.01	171.8	171.8	4.39	10	44%	52.9
3975	O1L43FA1	PMP-43a	O1L43J1	PVC	25	7.5	2	0.01	42.611	42.611	4.35	10	44%	1.13
3978	O1L43F1	O1L43J1	M37A4	PVC		533.5	2	0.01	42.611	42.611	4.35	10	44%	24.17
4470	O2L48F1	O2L48J1	M36I1	PVC		570.6	2	0.01	41.077	41.077	4.19	10	42%	24.15
1798	O1LS14F1	O1L14J1	O-1	PVC		10.5	10	0.01	1019.9	1019.9	4.17	10	42%	0.07
423	O2L2F1	O2L2J1	M3J1	Asbestos Cement		569.4	4	0.011	161.96	161.96	4.13	10	41%	12.47
3865	O2L2FA2	PMP-2A	O2L2J1	Ductile Iron	112	10.6	4	0.012	161.96	161.96	4.13	10	41%	2.06
390	O2L23FB2	PMP-23B	O2L23F1	Steel	84	8.2	3	0.013	89.097	89.097	4.04	10	40%	3.37
3979	O2L22F1	O2L22J1	O2L34J3	Ductile Iron		348.7	8	0.012	619.27	619.27	3.95	10	40%	2.62

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3830	O2L6F1	O2L6J1	M1A9	PVC		631.6	4	0.01	153.95	153.95	3.93	10	39%	10.55
464	O1L17FB2	W-17	PMP-17B	Steel	21.1	9.5	6	0.013	333.17	333.17	3.78	10	38%	0.33
3728	O2L1F1	O2L1J1	O2L18J2	Cast iron		255.1	8	0.012	591.6	591.6	3.78	10	38%	2.47
427	O2L25FA2	PMP-25A	O2L25J1	Ductile Iron	84	10.6	3	0.012	82.961	82.961	3.77	10	38%	1.81
3827	O2L25F1	O2L25J1	M7C3	PVC		626.2	3	0.01	82.961	82.961	3.77	10	38%	13.52
511	O2F32FB1	W-32	PMP-32B	Ductile Iron	16.1	9.7	4	0.012	142.69	142.69	3.64	10	36%	0.23
3913	O2L32FB2	PMP-32B	O2L32J2	Ductile Iron	101	6.8	4	0.012	142.69	142.69	3.64	10	36%	1.47
3998	O2L32F2	O2L32J2	O2L32J1	PVC		521.1	4	0.01	142.69	142.69	3.64	10	36%	7.56
2443	O1L14F2	O1L14J2	O1L14J1	PVC		1384.7	10	0.01	880.32	880.32	3.6	10	36%	6.74
3482	O1L40FA1	PMP-40a	O1L40J1	Ductile Iron	70	13.3	4	0.012	139.62	139.62	3.56	10	36%	0.98
3955	O1L40F1	O1L14J1	O1L40J1	Cast iron		1155.4	4	0.012	-139.62	-139.62	3.56	10	36%	22.6
409	O2L1FA2	PMP-1A	O2L1J2	Ductile Iron	10	6.4	4	0.012	137.79	137.79	3.52	10	35%	20.12
3873	O2L1F2	O2L1J2	O2L1J1	PVC		347.6	4	0.012	137.79	137.79	3.52	10	35%	4.73
3586	O2L38F1	O2L38J1	M35A1	PVC		1300	6	0.01	309.12	309.12	3.51	10	35%	10.96
3882	O2L38FA2	PMP-38a	O2L38J1	Steel	100	6.2	6	0.013	309.12	309.12	3.51	10	35%	1.37
3753	O1L14F3	O1L14J3	O1L14J2	Ductile Iron		14.8	8	0.012	547.15	547.15	3.49	10	35%	0.09
1669	O2L45F1	O2L45J1	O2L12J1	PVC		161.3	6	0.01	302.14	302.14	3.43	10	34%	1.3
434	O2L18A-FB	PMP-18A-B	O2L18AJ1	Steel	66	8.2	3	0.013	75.334	75.334	3.42	10	34%	1.94
3835	O2L5F2	O2L5J2	O2L5J1	Asbestos Cement		693.6	4	0.011	132.9	132.9	3.39	10	34%	10.76
3841	O2L5F1	O2L5J1	M3F3	Asbestos Cement		90.1	4	0.011	132.9	132.9	3.39	10	34%	1.37
3747	O2L15F2	O2L15J2	O2L15J1	PVC		27.2	3	0.01	74.29	74.29	3.37	10	34%	0.48
3749	O2L15FA2	PMP-15A	O2L15J2	Ductile Iron	78	6	3	0.012	74.29	74.29	3.37	10	34%	1.37
1813	O2L34F4	O2L34J4	O2L34J3	PVC		2328.2	12	0.01	1185.3	1185.3	3.36	10	34%	8.08
3968	O2L36F3	O2L36J2	O2L36J3	Ductile Iron		1431.2	8	0.012	-505.32	-505.32	3.23	10	32%	7.39
3809	O2L9FA1	W-9	PMP-9A	Cast iron	27	8	4	0.012	126.02	126.02	3.22	10	32%	0.44
3810	O2L9FA2	PMP-9A	O2L9J1	Cast iron	76	6.1	4	0.012	126.02	126.02	3.22	10	32%	1.23
3815	O2L9F1	O2L9J1	O2L32J1	Ductile Iron		555	4	0.012	126.02	126.02	3.22	10	32%	6.4
489	O2L4F5	O2L4J5	O2L4J4	Ductile Iron		30.3	4	0.012	124.51	124.51	3.18	10	32%	0.34
3085	O2L4FA2	PMP-4A	O2L4J5	Ductile Iron	105	7.3	4	0.012	124.51	124.51	3.18	10	32%	1.18

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3851	O2L4F4	O2L4J4	O2L4J3	Asbestos Cement		752.6	4	0.011	124.51	124.51	3.18	10	32%	10.12
3854	O2L4F3	O2L4J3	O2L4J2	Asbestos Cement		1169.3	4	0.011	124.51	124.51	3.18	10	32%	15.73
3856	O2L4F2	O2L4J2	O2L4J1	Asbestos Cement		374.9	4	0.011	124.51	124.51	3.18	10	32%	5.04
3858	O2L4F1	O2L4J1	O2L5J2	Asbestos Cement		42	4	0.011	124.51	124.51	3.18	10	32%	0.57
1490	O2L39F1	O2L39J1	M35A1	PVC		751.7	2	0.01	29.869	29.869	3.05	10	31%	17.64
3890	O2L39FA2	PMP-39a	O2L39J1	Ductile Iron	25	9	2	0.012	29.869	29.869	3.05	10	31%	0.59
199	O2L7F1	O2L1J1	O2L7J1	Cast iron		671.6	8	0.012	-453.81	-453.81	2.9	10	29%	2.84
1140	O1L42F1	O1L42J1	M14C1	Ductile Iron		1075.3	4	0.012	111.61	111.61	2.85	10	29%	9.9
3603	O2L16F1	O2L16J1	O2L41J1	Ductile Iron		496.3	8	0.013	435.92	435.92	2.78	10	28%	1.95
3604	O2L41F1	O2L41J1	O2L22J1	Ductile Iron		785.4	8	0.013	435.92	435.92	2.78	10	28%	3.08
3775	O2L12FB2	PMP-12B	O2L12J2	PVC	90	7.2	4	0.01	107.08	107.08	2.73	10	27%	0.77
3778	O2L12F2	O2L12J2	O2L12J1	PVC		30.5	4	0.01	107.08	107.08	2.73	10	27%	0.26
3864	O2L24F1	O2L24J1	O2L7J1	Asbestos Cement		561.1	6	0.011	240.39	240.39	2.73	10	27%	3.54
3672	O2L29F1	O2L29J1	M34A11	Ductile Iron		604.4	4	0.012	104.88	104.88	2.68	10	27%	4.96
395	O2L3FA2	PMP-3A	O2L3J2	Ductile Iron	98	6.9	4	0.012	104.48	104.48	2.67	10	27%	1.9
4048	O2L3F2	O2L3J1	O2L3J2	Cast iron		1248	4	0.012	-104.48	-104.48	2.67	10	27%	14.27
1668	O2L33F1	O2L33J1	O2L45J1	PVC		820.9	6	0.01	215.9	215.9	2.45	10	25%	3.56
143	O2L18AFB2	PMP-18B	O2L18J3	Ductile Iron	66	10.5	3	0.01	51.242	51.242	2.33	10	23%	0.58
3711	O2L23F1	O2L23F1	O2L24J1	PVC		474	4	0.01	89.097	89.097	2.27	10	23%	2.88
3451	O1L37F1	M14D4	O1L37J1	PVC		61.8	4	0.01	-88.302	-88.302	2.25	10	23%	0.37
3452	O1L37FA1	PMP-37a	O1L37J1	Steel	78	8.8	4	0.013	88.302	88.302	2.25	10	23%	0.76
466	O1L17FB1	PMP-17B	O1L17J4		155	8.3	8	0.012	333.17	333.17	2.13	10	21%	0.37
468	O1L17F3	O1L17J4	O1L17J3	Steel		7.9	8	0.013	333.17	333.17	2.13	10	21%	0.03
2441	O1L17F1	O1L17J1	O1L14J2	Ductile Iron		255.7	8	0.012	333.17	333.17	2.13	10	21%	0.61
2460	O1L17F2	O1L17J1	O1L17J2	Ductile Iron		1095.9	8	0.012	-333.17	-333.17	2.13	10	21%	2.61
2462	O1L17F2	O1L17J2	O1L17J3	PVC		1271	8	0.01	-333.17	-333.17	2.13	10	21%	3.03
393	O2L24FA2	PMP-24A	O2L24J2	Steel	84	8.3	3	0.013	46.812	46.812	2.12	10	21%	1.02
3708	O2L24F2	O2L24J2	O2L24J1	PVC		542.3	3	0.01	46.812	46.812	2.12	10	21%	4.06
407	O2L18A-FA	PMP-18A	O2L18J3	Steel	66	10.8	3	0.013	46.617	46.617	2.12	10	21%	0.8

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3785	O2L11FA2	PMP-11A	O2L11J1	Ductile Iron	77	5.9	3	0.012	46.023	46.023	2.09	10	21%	0.56
3788	O2L11F2	O2L11J1	O2L11J1	Ductile Iron		41.5	3	0.012	46.023	46.023	2.09	10	21%	0.3
1783	O2L30FA2	PMP-30A	O2L30J1	PVC	77	8.8	3	0.01	43.798	43.798	1.99	10	20%	1.12
3659	O2L30F1	O2L30J1	O2L47J1	PVC		413.1	3	0.01	43.798	43.798	1.99	10	20%	2.73
4472	O2L48FA2	PMP-48A	O2L48J1	PVC	70	6.2	3	0.01	41.077	41.077	1.86	10	19%	0.41
214	O2L15F1	O2L15J1	O2L33J1	PVC		1180.6	6	0.01	159.37	159.37	1.81	10	18%	2.92
3486	O2L19FB1	W-19	PMP-19B	Steel	0.1	7.7	20	0.013	1747.5	1747.5	1.78	10	18%	0
3762	O2L13FA1	W-13	PMP-13A	Ductile Iron	16	7.3	3	0.012	32.293	32.293	1.47	10	15%	0.06
517	O2L36FA2	PMP-36A	O2L36J4	Steel	90	7.2	4	0.013	50.074	50.074	1.28	10	13%	0.31
3614	O2L36F4	O2L36J4	O2L36J3	Ductile Iron		1394.3	4	0.012	50.074	50.074	1.28	10	13%	2.91
3862	O2L3F1	O2L3J1	O2L24J1	Cast iron		2688.9	6	0.012	104.48	104.48	1.19	10	12%	4.27
506	O2L34FA1	W-34	PMP-34A	Ductile Iron	0.1	10.6	20	0.012	1150.9	1150.9	1.18	10	12%	0
3663	O2L31F1	O2L31J1	O2L16J1	Ductile Iron		653.2	8	0.012	166.88	166.88	1.07	10	11%	0.43
213	O2L13F1	O2L13J1	O2L15J1			584.2	6	0.013	85.077	85.077	0.97	10	10%	0.54
3764	O2L13FA2	PMP-13A	O2L13J2	Ductile Iron	69	8.5	4	0.012	32.293	32.293	0.82	10	8%	0.06
3767	O2L13F2	O2L13J2	O2L13J1	Ductile Iron		24.7	4	0.012	32.293	32.293	0.82	10	8%	0.02
212	O2L44F1	O1L44J1	O2L13J1	PVC		1303.2	6	0.01	52.785	52.785	0.6	10	6%	0.42
3881	O2L38FA1	W-38	PMP-38a	Steel	0.1	7.5	20	0.013	309.12	309.12	0.32	10	3%	0
3081	O2L16FA1	W-16	PMP-16A	Steel	1	8	20	0.013	269.04	269.04	0.27	10	3%	0
3662	O2L19F1	O2L34J4	O2L31J1	Cast iron		48.8	8	0.013	-34.375	-34.375	0.22	10	2%	0
3819	O2L7FA1	W-7	PMP-7A	Ductile Iron	1.1	7.1	20	0.012	213.42	213.42	0.22	10	2%	0
3925	O2L46FA1	W-46	PMP-46a	PVC	0.1	7.6	10	0.01	53.324	53.324	0.22	10	2%	0
3694	O2L44FA1	W-44	PMP-44a	PVC	0.1	8.1	10	0.01	52.785	52.785	0.22	10	2%	0
3832	O2L5FA2	PMP-5A	O2L5J3	Ductile Iron	93	6.7	4	0.012	8.3964	8.3964	0.21	10	2%	0.01
3834	O2L5F3	O2L5J3	O2L5J2	Ductile Iron		16.9	4	0.012	8.3964	8.3964	0.21	10	2%	0
1743	O2L31FA1	W-31	PMP-31A	Ductile Iron	0.1	8.6	20	0.012	201.26	201.26	0.21	10	2%	0
1690	02L23FA1	W-23	PMP-22A	Ductile Iron	1	8.7	20	0.012	183.34	183.34	0.19	10	2%	0
3525	O2L35FA1	W-35	PMP-35A	Steel	0.1	7.2	20	0.013	171.8	171.8	0.18	10	2%	0
417	O2L2FA1	W-2	PMP-2A	Steel	0.1	8.7	20	0.013	161.96	161.96	0.17	10	2%	0

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
1791	O2L26FB1	W-26	PMP-26B	Natural stream we	0.1	7.7	20	0.045	159.28	159.28	0.16	10	2%	0
445	O2L6FA1	W-6	PMP-6A	Ductile Iron	0.1	7.5	20	0.012	153.95	153.95	0.16	10	2%	0
3481	O1L40FA2	W-40	PMP-40a	PVC	0.1	9.8	20	0.01	139.62	139.62	0.14	10	1%	0
3870	O2L1FA1	W-1	PMP-1A	Steel	0.1	7.5	20	0.013	137.79	137.79	0.14	10	1%	0
3849	O2L4FA1	W-4	PMP-4A	Ductile Iron	0.1	8.2	20	0.012	124.51	124.51	0.13	10	1%	0
3879	O1L42FB1	W-42	PMP-42a		1	7	20	0.013	111.61	111.61	0.11	10	1%	0
3773	O2L12FB1	W-12	PMP-12B	Ductile Iron	0.1	9	20	0.012	107.08	107.08	0.11	10	1%	0
3090	O2L29FA1	W-29	PMP-29A	PVC	0.1	11.1	20	0.01	104.88	104.88	0.11	10	1%	0
373	O2L3FA1	W-3	PMP-3A	Ductile Iron	0.1	7.8	20	0.012	104.48	104.48	0.11	10	1%	0
389	O2L23FB1	W-23	PMP-23B	Steel	1	8.2	20	0.013	89.097	89.097	0.09	10	1%	0
3453	O1L37FA2	W-37	PMP-37a	PVC	0.1	9.7	20	0.01	88.302	88.302	0.09	10	1%	0
3918	O2L45FA1	W-45	PMP-45a	PVC	0.1	7.1	20	0.01	86.238	86.238	0.09	10	1%	0
426	O2L25FA1	W-25	PMP-25A	Ductile Iron	0.1	7.7	20	0.012	82.961	82.961	0.08	10	1%	0
432	O2L18A-FA	W-18A	PMP-18A-b	Steel	0.1	13.2	20	0.013	75.334	75.334	0.08	10	1%	0
3961	O2L15FA1	W-15	PMP-15A	Ductile Iron		7.2	20	0.012	74.29	74.29	0.08	10	1%	0
4405	O2L47FB1	W-47	PMP-47B	PVC	0.1	9.5	20	0.01	56.842	56.842	0.06	10	1%	0
3943	O2L11FA1	W-33	PMP-33A	Ductile Iron	0.1	6.7	20	0.012	56.531	56.531	0.06	10	1%	0
149	O2L18FB1	W-18	PMP-18B	Ductile Iron	0.1	8.9	20	0.01	51.242	51.242	0.05	10	1%	0
516	O2L36FA1	W-36	PMP-36A	Steel	0.1	8.2	20	0.013	50.074	50.074	0.05	10	1%	0
392	O2L24FA1	W-24	PMP-24A	PVC	0.1	9.1	20	0.01	46.812	46.812	0.05	10	1%	0
406	O2L18FA1	W-18	PMP-18A	Steel	0.1	8.8	20	0.013	46.617	46.617	0.05	10	1%	0
3783	O2L11FA1	W-11	PMP-11A	Ductile Iron	0.1	8.4	20	0.012	46.023	46.023	0.05	10	1%	0
1782	O2L30FA1	W-30	PMP-30A	Cast iron	0.1	8	20	0.012	43.798	43.798	0.04	10	0%	0
3974	O1L43FA2	W-35	PMP-43a	PVC	0.1	7.6	20	0.01	42.611	42.611	0.04	10	0%	0
4471	O2L48FA1	W-48	PMP-48A	PVC	0.1	8.1	20	0.01	41.077	41.077	0.04	10	0%	0
3889	O2L39FA1	W-39	PMP-39a	PVC	0.1	8.2	20	0.01	29.869	29.869	0.03	10	0%	0
3831	O2L5FA1	W-5	PMP-5A	Ductile Iron	0.1	7.6	20	0.012	8.3964	8.3964	0.01	10	0%	0
3605	O2L41F2	O2L41J2	O2L41J1			192.7	1.3	0.013	-0.00012	-0.00012	0	10	0%	0
3899	O2L41FA2	PMP-41a	O2L41J2	PVC	25	7	2	0.01	-0.00012	-0.00012	0	10	0%	0

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3797	O2L10F3	O2L10J3	O2L10J2	Ductile Iron		37.5	3	0.012	-1.95E-05	-1.95E-05	0	10	0%	0
2437	NA	O2L4J4	na			163.1	4	0.011	3.19E-05	3.19E-05	0	10	0%	0
3898	O2L41FA1	W-41	PMP-41a	PVC	0.1	7.2	20	0.01	-0.00012	-0.00012	0	10	0%	0
2433	NA	M3F3	na			97.3	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
2435	NA	na	na			126.6	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
3793	O2L10FA1	W-10	PMP-10A	Ductile Iron	0.1	8.3	20	0.012	-1.61E-05	-1.61E-05	0	10	0%	0
3795	O2L10FA2	PMP-10A	O2L10J3	Ductile Iron	99	6.6	3	0.012	0	0	0	10	0%	0
142	O2L24FB1	W-24	PMP-24B	Ductile Iron	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
150	O2L25FB2	PMP-25B	O2L25J1	Ductile Iron	84	9.2	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
151	O2L24FB2	PMP-24B	O2L24J2	Steel	84	7.3	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
152	O2L22FB1	W-23	PMP-22B	Ductile Iron	1	7.4	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
165	O1L17FA2	W-17	PMP-17A	Steel	21.1	6.7	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
166	O2L22FB2	PMP-22B	O2L22J2	Ductile Iron	112	7.3	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
168	O1L14FB2	W-14	PMP-14B	Ductile Iron	44	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
170	O2L34FC1	W-34	PMP-34C	Ductile Iron	0.1	6.9	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
177	O2L36FB1	W-36	PMP-36B	Ductile Iron	0.1	9.2	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
184	O2L36FB2	PMP-36B	O2L36J4	Ductile Iron	90	7.9	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
374	O2L3FB1	W-3	PMP-3B	Ductile Iron	0.1	8.3	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
386	O2L23FA1	W-23	PMP-23A	Steel	1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
387	O2L23FA2	PMP-23A	O2L23F1	Steel	84	9	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
394	O2L3FB2	PMP-3B	O2L3J2	Ductile Iron	98	8.4	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
401	O2L1FB2	PMP-1B	O2L1J2	Ductile Iron	10	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
413	O2L2FB1	W-2	PMP-2B	Steel	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
415	O2L2FB2	PMP-2B	O2L2J1	Ductile Iron	112	9.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
435	O2L18A-FA	PMP-18A-a	O2L18AJ1	Steel	66	8.3	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
436	O2L18A-FA	PMP-18A-a	W-18A	Steel	0.1	8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
443	O2L6FB2	PMP-6B	O2L6J1	PVC	74	6.1	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
444	O2L6FB1	W-6	PMP-6B	Ductile Iron	0.1	7	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
467	O1L17FA1	PMP-17A	O1L17J4	Steel	155	8.3	8	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
473	O1L14FB1	PMP-14B	O1L14J3	Steel	134	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
486	O2L4FB2	PMP4B	O2L4J5	Ductile Iron	105	6.6	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
487	O2L4FB1	W-4	PMP4B	Ductile Iron	0.1	8.5	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
492	O2L5FB1	W-5	PMP-5B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
494	O2L5FB2	PMP-5B	O2L5J3	Ductile Iron	93	5.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
513	O2F32FA1	W-32	PMP-32A	Ductile Iron	16.1	9.8	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
514	O2L32FA2	PMP-32A	O2L32J2	Ductile Iron	101	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
526	O2L34FC2	PMP-34C	O2L34J6	Ductile Iron	154	7.8	8	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1693	O2L34FB1	W-34	PMP-34B	Ductile Iron	0.1	8.4	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1694	O2L34FB2	PMP-34B	O2L34J6	Ductile Iron	154	9.4	8	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1745	O2L31FB2	PMP-31B	O2L31J2	Steel	77	9.6	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1746	O2L31FB1	W-31	PMP-31B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1784	O2L30FB2	PMP-30B	O2L30J1	PVC	77	8.1	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1785	O2L30FB1	W-30	PMP-30B	Cast iron	0.1	7.4	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1793	O2L26FA2	PMP-26A	O2L26J1	Steel	79	6.1	3	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
1794	O2L26FA1	W-26	PMP-26A	PVC	1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
2454	NA	J-97	na			612.3	4	0.011	(N/A)	(N/A)	(N/A)	10	######	(N/A)
2466	NA	na	J-97			2074.5	4	0.011	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3078	O2L16FB2	PMP-16B	O2L16J2	Ductile Iron	77	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3082	O2L16FB1	W-16	PMP-16B	Steel	1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3086	O2L29FB1	W-29	PMP-29B	PVC	0.1	10	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3088	O2L29FB2	PMP-29B	O2L29J2	PVC	78	11.7	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3454	O1L37FB1	PMP-37b	O1L37J1	Ductile Iron	78	6.4	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3455	O1L37FB2	W-37	PMP-37b		0.1	8.8	10	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3483	O1L40FB2	W-40	PMP-40b	PVC	0.1	12.3	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3484	O1L40FB1	PMP-40b	O1L40J1	Ductile Iron	70	10	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3487	O2L19FA1	W-19	PMP-19A	Steel	0.1	7.9	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3493	O2L19FA2	PMP-19A	O1L34J2	Steel	341	8.5	8	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3566	O2L38FB1	W-38	PMP-38b	Steel	0.1	8.3	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3568	O2L38FB2	PMP-38b	O2L38J1	Steel	100	7.3	6	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3651	O2L34BYEF	O2L36J1	O2L34J5	Ductile Iron		15.2	8	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3696	O2L44FB1	W-44	PMP-44b	PVC	0.1	8.3	10	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3697	O2L44FB2	PMP-44b	O1L44J2		25	6.8	0	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3744	O2L15FB2	PMP-15B	O2L15J2	Ductile Iron	78	6	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3768	O2L13FB1	W-13	PMP-13B	Ductile Iron	16	9.1	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3769	O2L13FB2	PMP-13B	O2L13J2	Ductile Iron	69	9.6	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3779	O2L12FA1	W-12	PMP-12A	Ductile Iron	0.1	8.2	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3780	O2L12FA2	PMP-12A	O2L12J2	Ductile Iron	90	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3789	O2L11FB1	W-11	PMP-11B	Ductile Iron	0.1	8	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3790	O2L11FB2	PMP-11B	O2L11J1	Ductile Iron	77	6	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3799	O2L10FB1	W-10	PMP-10B	Ductile Iron	0.1	5.6	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3800	O2L10FB2	PMP-10B	O2L10J3	Ductile Iron	99	7.5	3	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3803	O2L9FB2	PMP-9B	O2L9J1	Ductile Iron	76	5.9	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3808	O2L9FB1	W-9	PMP-9B	Cast iron	27	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3817	O2L7FB1	W-7	PMP-7B	Ductile Iron	0.1	7.3	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3823	O2L7FB2	PMP-7B	O2L7J2	Ductile Iron	104	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3869	O2L1FB1	W-1	PMP-1B	Steel	0.1	7.2	0	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3877	O1L42FA1	W-42	PMP-42b		0.1	8.8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3878	O1L42FA2	PMP-42b	O1L42J1		25	7.7	2	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3887	O2L39FB1	W-39	PMP-39b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3888	O2L39FB2	PMP-39b	O2L39J1	Ductile Iron	25	8.3	2	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3891	O2L35FB2	W-35	PMP-35B	Steel	0.1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3892	O2L35FB2	PMP-35B	O2L35J2	Steel	90	6.3	4	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3896	O2L41FB1	W-41	PMP-41b	PVC	0.1	6.9	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3897	O2L41FB2	PMP-41b	O2L41J2	PVC	25	7	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3916	O2L45FB1	W-45	PMP-45b		0.1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3917	O2L45FB2	PMP-45b	O2L45J2	PVC	25	7.4	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3933	O2L46FB1	W-46	PMP-46b	PVC	0.1	8.1	10	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)

Model Forcemain Data Table 25 Units Per Acre Build-Out
Exhibit E3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3934	O2L46FB2	PMP-46b	O2L46J1		25	6.2	2	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3937	O2L33FB1	W-33	PMP-33B	Ductile Iron	0.1	6.8	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3939	O2L33FB2	PMP-33B	O2L33J2	Steel	70	5.8	2	0.013	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3960	O2L15FB1	W-15	PMP-15B	Ductile Iron		7.8	20	0.012	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3972	O1L14FB2	W-35	PMP-43b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
3973	O1L14FB1	PMP-43b	O1L43J1	PVC	25	7.3	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4408	O2L47FA1	W-47	PMP-47A	PVC	0.1	9.3	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4409	O2L47FA2	PMP-47A	O2L47J2	PVC	40	6.2	2	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4462	O2L48FB1	W-48	PMP-48B	PVC	0.1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)
4464	O2L48FB2	PMP-48B	O2L48J1	PVC	70	7.1	3	0.01	(N/A)	(N/A)	(N/A)	10	######	(N/A)

EXHIBIT E.4
PRESSURE NODE DATE TABLE REPORT

Model Pressure Node Data Table 25 Units Per Acre
Exhibit E4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
1341	O1L14J1	6.7	3.5	58.1	24	54.6		921853.18	600253.72	TRUE
2432	O1L14J2	6.4	0	64.8	28	64.8		920948.59	600723.96	TRUE
472	O1L14J3	6.4	8	64.9	25	56.9		920955.16	600715.27	TRUE
127	O1L17J1	6	5.3	65.4	26	60.2		920692.99	600715.98	TRUE
2461	O1L17J2	6.8	4	68	28	64		920723	599620.53	TRUE
87	O1L17J3	7.9	5	71.1	29	66.1		920698	598426.1	TRUE
465	O1L17J4	7	5	71.1	29	66.1		920705.89	598426.09	TRUE
2428	O1L34J1	8	5	23.5	8	18.5		927366.12	604992.24	TRUE
3492	O1L34J2	6.8	4.8	29.3	11	24.5		927390.3	604966.61	TRUE
3445	O1L37J1	6	3	3.5	0	0.5		919806.96	599800.73	TRUE
1337	O1L40J1	7.7	4	80.7	33	76.7		921532.85	599443.59	TRUE
1132	O1L42J1	5.8	3	7.6	2	4.6		919732.18	600929.27	TRUE
3588	O1L43J1	7.1	5	23.9	8	18.9		919610.41	600547.6	TRUE
116	O1L44J1	6.8	5.3	55.9	22	50.7		921909.68	600337.73	TRUE
1678	O1L44J2	6.2	0	64.3	28	64.3		921913.59	600458.39	TRUE
88	O2L10J1	8	4	23.6	8	19.6		927114.51	600739.53	TRUE
136	O2L10J2	7.8	5	34.2	13	29.2		926523.21	600750.87	TRUE
3794	O2L10J3	8.7	6.5	34.2	12	27.7		926513.68	600783.24	TRUE
135	O2L11J1	7.9	5.5	42.4	16	36.9		926045.89	600735.78	TRUE
3784	O2L11J1	10.5	8.5	42.7	15	34.2		926041.8	600777.04	TRUE
134	O2L12J1	8.1	6	47.2	18	41.2		925712.64	600726.09	TRUE
3774	O2L12J2	8.2	6.2	47.4	18	41.2		925711.36	600756.56	TRUE
131	O2L13J1	6.1	3	55.5	23	52.5		922967.26	600629.79	TRUE
3763	O2L13J2	6.2	4.2	55.5	22	51.3		922961.39	600653.77	TRUE
132	O2L15J1	6.8	4	55	22	51		923551.18	600648.88	TRUE
3743	O2L15J2	7	5	55.4	22	50.4		923546.24	600675.67	TRUE
107	O2L16J1	4.7	2.5	32	13	29.5		928422.75	604385.66	TRUE
2407	O2L16J2	6.7	4	49	19	45		928763.58	604418.47	TRUE
433	O2L18AJ1	4.7	2.5	12.9	4	10.4		928854.97	600361.74	TRUE
93	O2L18J1	7.7	4	12.5	4	8.5		928569.18	600970.36	TRUE

Model Pressure Node Data Table 25 Units Per Acre
Exhibit E4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
3726	O2L18J2	4.9	2.9	25.5	10	22.6		928608.77	599957.47	TRUE
126	O2L18J3	5.7	3	30.5	12	27.5		928767.45	599971.15	TRUE
3504	O2L19J1	8.3	7.8	25.2	8	17.4		927390.21	604973.37	TRUE
104	O2L1J1	6	4	28	10	24		928617.92	599702.49	TRUE
398	O2L1J2	6.6	4	32.7	12	28.7		928285.14	599671.66	TRUE
105	O2L22J1	6.9	4	26.9	10	22.9		927748.42	604998.77	TRUE
106	O2L22J2	5.5	3	49.4	20	46.4		927483.96	604307.21	TRUE
118	O2L23F1	4.3	1.2	37.2	16	36		929940.07	600105.19	TRUE
97	O2L24J1	6.9	4	34.4	13	30.4		929844.61	599734.74	TRUE
102	O2L24J2	5.4	3	38.4	15	35.4		929700.1	600158.28	TRUE
101	O2L25J1	4.5	2.7	14.5	5	11.8		929283.22	600655.84	TRUE
1790	O2L26J1	5.6	3.6	12.1	4	8.5		927480.33	603912.05	TRUE
2416	O2L29J1	4.5	2	6.8	2	4.8		929271.35	603049.66	TRUE
3087	O2L29J2	4.5	2	7.2	2	5.2		929284.01	603049.29	TRUE
414	O2L2J1	5.8	3.3	15.8	5	12.5		928996	598338.88	TRUE
1781	O2L30J1	3.1	1	21.8	9	20.8		929239.57	603452.81	TRUE
3661	O2L31J1	4.8	2.5	32.4	13	29.9		928446.71	603732.88	TRUE
1742	O2L31J2	6.6	4	62.3	25	58.3		929288.83	604013.67	TRUE
100	O2L32J1	5.7	4	27.9	10	23.9		928486.55	602372.06	TRUE
125	O2L32J2	5.3	4	35.5	14	31.5		927974.57	602351.14	TRUE
133	O2L33J1	8.3	6	52	20	46		924731.1	600689.88	TRUE
3938	O2L33J2	9.2	6	54.5	21	48.5		924723.91	600721.68	TRUE
3505	O2L34J2	8.1	4.6	24.1	8	19.6		927389.97	604994.04	TRUE
3498	O2L34J3	8.4	3.8	24.3	9	20.5		927411.01	604994.99	TRUE
1810	O2L34J4	4.8	4	32.4	12	28.4		928447.42	603684.11	TRUE
120	O2L34J5	5.9	2	79.9	34	77.9		928527.32	601678.68	TRUE
525	O2L34J6	5.9	10.1	81.1	31	70.9		928480.51	601676.24	TRUE
3528	O2L35J1	5.9	3	76.4	32	73.4		925402.48	604500.5	TRUE
3526	O2L35J2	0	0	76.6	33	76.6		925402.8	604509.91	TRUE
3649	O2L36J1	6	4	-3.6	-3	-7.6		928527.66	601663.48	TRUE

Model Pressure Node Data Table 25 Units Per Acre
Exhibit E4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
91	O2L36J2	7.4	5	11.3	3	6.3		928541.4	601077.86	TRUE
90	O2L36J3	8.9	4	18.6	6	14.6		927111.29	601021.17	TRUE
89	O2L36J4	6.1	4	21.6	8	17.6		926952.73	602311.3	TRUE
3567	O2L38J1	6.5	3.5	10.2	3	6.7		925476.79	603270.8	TRUE
1482	O2L39J1	6.5	4	16.5	5	12.5		925456.86	603835.44	TRUE
4047	O2L3J1	6.9	5	38.6	15	33.6		929945.67	597047.95	TRUE
124	O2L3J2	6.4	5	52.9	21	47.9		928698.06	597016.74	TRUE
3602	O2L41J1	5.5	4	30	11	26		928396.68	604881.25	TRUE
1639	O2L41J2	6.4	4	30	11	26		928579.21	604893.45	TRUE
1667	O2L45J1	8.1	6	48.5	18	42.5		925551.4	600721.93	TRUE
1670	O2L45J2	9.4	7.4	55.1	21	47.7		925547.33	600761.31	TRUE
3926	O2L46J1	6.6	3	16.9	6	13.9		928915.95	600879.36	TRUE
4400	O2L47J1	2.2	1.4	19.1	8	17.7		928837.69	603432.35	TRUE
4396	O2L47J2	5	3	20.1	7	17.1		928830.59	603426.03	TRUE
4463	O2L48J1	0	0	25.8	11	25.8		926212.08	601305.88	TRUE
3855	O2L4J1	6.3	4.3	16.2	5	11.9		927327.5	597718.21	TRUE
3853	O2L4J2	6.2	4.2	21.3	7	17.1		927318.45	598092.97	TRUE
3850	O2L4J3	5.8	3.8	37	14	33.2		927280.07	599261.59	TRUE
488	O2L4J4	7	5	47.1	18	42.1		927253.84	600013.72	TRUE
484	O2L4J5	7.6	6	47.5	18	41.5		927276.73	600022.08	TRUE
3838	O2L5J1	6	4	4.9	0	0.9		927367.89	597001.13	TRUE
3857	O2L5J2	6.3	4	15.7	5	11.7		927330.85	597676.29	TRUE
493	O2L5J3	6.3	4.8	15.7	5	10.8		927336.66	597692.12	TRUE
442	O2L6J1	6.3	4	13.9	4	9.9		928475.95	600682.36	TRUE
95	O2L7J1	6.6	4	30.8	12	26.8		929283.52	599729.39	TRUE
3820	O2L7J2	6.9	4.9	31.8	12	26.9		929290.49	599699.06	TRUE
3802	O2L9J1	6.5	3.5	34.3	13	30.8		928210.32	602646.01	TRUE
2434	na	0	0	3.5	2	3.5		927359.5	596967.77	TRUE
2436	na	0	0	3.5	2	3.5		927353.71	597094.23	TRUE
2438	na	0	0	47.1	20	47.1		927262.9	599779.52	TRUE

EXHIBIT E.5
PUMP DATA TABLE REPORT

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
63	PMP-1A	TRUE	6.7	-3.8	Pump Definition - LS1	137.79	54.6	-1.8	52.8
396	PMP-1B	FALSE	6.7	-3.8	Pump Definition - LS1	(N/A)	(N/A)	(N/A)	(N/A)
412	PMP-2A	TRUE	6.3	-4.7	Pump Definition - LS2	161.96	21.5	-3.7	17.9
411	PMP-2B	FALSE	6.4	-4.7	Pump Definition - LS2	(N/A)	(N/A)	(N/A)	(N/A)
365	PMP-3A	TRUE	6.4	-2.9	Pump Definition - LS3	104.48	56.7	-1.9	54.8
62	PMP-3B	FALSE	6.4	-2.9	Pump Definition - LS3	(N/A)	(N/A)	(N/A)	(N/A)
481	PMP-4A	TRUE	7.6	-3.6	Pump Definition - LS4	124.51	50.2	-1.6	48.6
491	PMP-5A	TRUE	6	-6.2	Pump Definition - LS5	8.3964	19.8	-4.2	15.7
490	PMP-5B	FALSE	6	-6.2	Pump Definition - LS5	(N/A)	(N/A)	(N/A)	(N/A)
440	PMP-6A	TRUE	6.5	-2.9	Pump Definition - LS6	153.95	20.3	-1.4	18.9
441	PMP-6B	FALSE	6.5	-2.9	Pump Definition - LS6	(N/A)	(N/A)	(N/A)	(N/A)
453	PMP-7A	TRUE	6.8	-5.4	Pump Definition - LS7	213.42	38.3	-3.4	34.9
60	PMP-7B	FALSE	6.8	-5.4	Pump Definition - LS7	(N/A)	(N/A)	(N/A)	(N/A)
3801	PMP-9A	TRUE	6	3.5	Pump Definition - LS9	126.02	37	-1.4	35.6
51	PMP-9B	FALSE	6	3.5	Pump Definition - LS9	(N/A)	(N/A)	(N/A)	(N/A)
3791	PMP-10A	TRUE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	-1.93E-05	26	3.9	29.9
3792	PMP-10B	FALSE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3781	PMP-11A	TRUE	10.5	3	Pump Definition - LS11	46.023	33.8	9.5	43.3
3782	PMP-11B	FALSE	10.5	3	Pump Definition - LS11	(N/A)	(N/A)	(N/A)	(N/A)
3772	PMP-12A	FALSE	8.7	2.5	Pump Definition - LS12	(N/A)	(N/A)	(N/A)	(N/A)
3771	PMP-12B	TRUE	8.7	2.5	Pump Definition - LS12	107.08	40.2	8	48.2
3760	PMP-13A	TRUE	6.7	4.7	Pump Definition - LS13	32.293	53.4	2.1	55.6
3761	PMP-13B	FALSE	6.7	4.7	Pump Definition - LS13	(N/A)	(N/A)	(N/A)	(N/A)
469	PMP-14A	TRUE	6.4	8	Pump Definition - LS14	547.15	74.8	-4.7	70.2
48	PMP-14B	FALSE	6.4	8	Pump Definition - LS14	(N/A)	(N/A)	(N/A)	(N/A)
3741	PMP-15A	TRUE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	74.29	54.3	2.5	56.8
3740	PMP-15B	FALSE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
2476	PMP-16A	TRUE	5.9	-6.3	Pump Definition - LS16	269.04	64.3	-4.3	60
2481	PMP-16B	FALSE	5.9	-6.3	Pump Definition - LS16	(N/A)	(N/A)	(N/A)	(N/A)

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
49	PMP-17A	FALSE	7	9	Pump Definition - LS17	(N/A)	(N/A)	(N/A)	(N/A)
463	PMP-17B	TRUE	7.5	9	Pump Definition - LS17	333.17	82.8	-11.3	71.5
405	PMP-18A	TRUE	5.7	-5	Pump Definition - LS18	46.617	30.3	1	31.3
431	PMP-18A-a	FALSE	6.1	-3.5	Pump Definition - LS18a	(N/A)	(N/A)	(N/A)	(N/A)
430	PMP-18A-b	TRUE	6.1	-3.5	Pump Definition - LS18a	75.334	15.8	-1	14.8
61	PMP-18B	TRUE	5.7	-5	Pump Definition - LS18	51.242	30.1	1	31.1
539	PMP-19A	FALSE	6.8	-4.1	Pump Definition - LS19	(N/A)	(N/A)	(N/A)	(N/A)
53	PMP-19B	TRUE	6.8	-2.5	Pump Definition - LS19	1747.5	59.9	-2.1	57.8
1689	PMP-22A	TRUE	5.4	-9.7	Pump Definition - LS22	183.34	60.8	-7.2	53.6
52	PMP-22B	FALSE	5.9	-9.7	Pump Definition - LS22	(N/A)	(N/A)	(N/A)	(N/A)
59	PMP-23A	FALSE	4.5	-5.9	Pump Definition - LS23	(N/A)	(N/A)	(N/A)	(N/A)
388	PMP-23B	TRUE	-5.9	-5.9	Pump Definition - LS23	89.097	44	-3.4	40.6
391	PMP-24A	TRUE	5.6	-3.4	Pump Definition - LS24	46.812	40.3	-0.9	39.4
58	PMP-24B	FALSE	5.6	-3.4	Pump Definition - LS24	(N/A)	(N/A)	(N/A)	(N/A)
425	PMP-25A	TRUE	5.1	-5.4	Pump Definition - LS24-LS25	82.961	19.2	-2.9	16.3
57	PMP-25B	FALSE	5.1	-5.4	Pump Definition - LS24-LS25	(N/A)	(N/A)	(N/A)	(N/A)
1788	PMP-26A	FALSE	5.6	-4.2	Pump Definition - LS26	(N/A)	(N/A)	(N/A)	(N/A)
1789	PMP-26B	TRUE	5.6	-4.2	Pump Definition - LS26	159.28	25.2	-3.8	21.4
2479	PMP-29A	TRUE	4.4	-4.9	Pump Definition - LS29	104.88	18.9	-3.9	15
2480	PMP-29B	FALSE	3.5	-4.9	Pump Definition - LS29	(N/A)	(N/A)	(N/A)	(N/A)
1779	PMP-30A	TRUE	4.1	-5	Pump Definition - LS30	43.798	25.4	-2.5	22.9
1780	PMP-30B	FALSE	4.1	-5	Pump Definition - LS30	(N/A)	(N/A)	(N/A)	(N/A)
1740	PMP-31A	TRUE	6.2	-8	Pump Definition - LS31	201.26	95.7	-6.6	89.2
1741	PMP-31B	FALSE	6.2	-8	Pump Definition - LS31	(N/A)	(N/A)	(N/A)	(N/A)
508	PMP-32A	FALSE	8	10	Pump Definition - LS32	(N/A)	(N/A)	(N/A)	(N/A)
50	PMP-32B	TRUE	8	10	Pump Definition - LS32	142.69	42.3	-5.3	37
3935	PMP-33A	TRUE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	56.531	60.2	3	63.2
3936	PMP-33B	FALSE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
505	PMP-34A	TRUE	6.9	-10.5	Pump Definition - LS34	1150.9	90.7	-6	84.7

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
1692	PMP-34B	FALSE	6.9	-10.5	Pump Definition - LS34	(N/A)	(N/A)	(N/A)	(N/A)
56	PMP-34C	FALSE	6.9	-10.5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
3522	PMP-35A	TRUE	6	-5	Pump Definition - LS35	171.8	81	-1.4	79.6
3521	PMP-35B	FALSE	6	-5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
515	PMP-36A	TRUE	6.7	-8.5	Pump Definition - LS36	50.074	27.4	-5.5	21.9
64	PMP-36B	FALSE	7.5	-8.5	Pump Definition - LS36	(N/A)	(N/A)	(N/A)	(N/A)
3443	PMP-37a	TRUE	6.3	-7	Pump Definition - LS37	88.302	8.9	-4.7	4.3
3444	PMP-37b	FALSE	6.5	-7	Pump Definition - LS37	(N/A)	(N/A)	(N/A)	(N/A)
3565	PMP-38a	TRUE	6.5	-15.4	Pump Definition - LS38	309.12	21.7	-10.2	11.5
3564	PMP-38b	FALSE	6.5	-15.4	Pump Definition - LS38	(N/A)	(N/A)	(N/A)	(N/A)
3886	PMP-39a	TRUE	6	-5	Pump Definition - LS39	29.869	15.1	2	17.1
3885	PMP-39b	FALSE	6	-5	Pump Definition - LS39	(N/A)	(N/A)	(N/A)	(N/A)
3479	PMP-40a	TRUE	8	5	Pump Definition - LS40	139.62	86.6	-5	81.6
3480	PMP-40b	FALSE	8	5	Pump Definition - LS40	(N/A)	(N/A)	(N/A)	(N/A)
3895	PMP-41a	TRUE	6.5	0	Pump Definition - LS10-LS42-LS43 Privite	0	0	4	30
3894	PMP-41b	FALSE	0	6.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3875	PMP-42a	TRUE	5	0	Pump Definition - LS10-LS42-LS43 Privite	111.61	11.8	2.5	14.3
3876	PMP-42b	FALSE	5	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3970	PMP-43a	TRUE	9.4	1	Pump Definition - LS10-LS42-LS43 Privite	42.611	21	4	25
3971	PMP-43b	FALSE	7.4	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3693	PMP-44a	TRUE	6.8	0.5	Pump Definition - LS15-LS33-LS44-LS45	52.785	61.5	4.5	66
3692	PMP-44b	FALSE	6.7	0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
3915	PMP-45a	TRUE	9.3	3.5	Pump Definition - LS15-LS33-LS44-LS45	86.238	50.3	9	59.3
3914	PMP-45b	FALSE	9.3	3.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3923	PMP-46a	TRUE	6.5	-3	Pump Definition - LS10-LS42-LS43 Privite	53.324	19.7	-1	18.7
3924	PMP-46b	FALSE	6.3	-3	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4407	PMP-47A	FALSE	5	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4404	PMP-47B	TRUE	5	1	Pump Definition - LS10-LS42-LS43 Privite	56.842	19.2	4	23.2
4460	PMP-48A	TRUE	0	0	Pump Definition - LS10-LS42-LS43 Privite	41.077	21.2	5	26.2

Model Pump Data Table 25 Units Per Acre Build-Out
Exhibit E5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
4461	PMP-48B	FALSE	0	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
482	PMP4B	FALSE	7.6	-3.6	Pump Definition - LS4	(N/A)	(N/A)	(N/A)	(N/A)

EXHIBIT E.6
OUTFALL DATA TABLE REPORT

Model Outfall Data Table 25 Units Per Acre
Exhibit E6

ID	Label	Elevation (Ground) (ft)	Elev (Invert) (ft)	Boundary Condition Type	Elevation (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Flow (Total Out) (gpm)	Notes
1797	O-1	6.8	3.5	User Defined Tailwater	58	58	1020	Measured 58 ft of Head or 25 psi at 12:00 PM Tuesday August 2023
3488	O-2	6.5	3.5	User Defined Tailwater	23	23	3724	Measured 10 psi or 23 feet of Head on Monday 6/12/2023

EXHIBIT F.1
GRAVITY SEWER DATA TABLE REPORT

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1120	O1L14SC1	M14C1	-2.7	M14A2	-3.6	279.4	0.003	8	0.013	4.39	687.4	302.61	227.2	Vitrified Clay
536	O1L14SA2	M14A2	-3.6	M14A1	-4	102.8	0.004	8	0.013	5.01	785.6	346.58	226.7	Vitrified Clay
1115	O1L14SC2	M14C2	-2.4	M14C1	-2.7	92.4	0.003	8	0.013	3.68	575.8	298.52	192.9	Vitrified Clay
1113	O1L14SC3	M14C3	-2.3	M14C2	-2.4	22.4	0.003	8	0.013	3.68	575.8	303.48	189.7	Vitrified Clay
1110	O1L14SC4	M14C4	-1.4	M14C3	-2.3	315.6	0.003	8	0.013	3.54	555.3	297.54	186.6	Vitrified Clay
1322	O1L17SA10	M17A10	0.6	M17A9	0	160.9	0.004	8	0.013	3.43	537.1	325.59	165	Vitrified Clay
1466	O2L34SA9	M34A9	0.1	M34A8	0	92.2	0.001	8	0.013	1.39	217.9	138.37	157.5	Vitrified Clay
1323	O1L17SA9	M17A9	0	M17A8	-0.4	88.8	0.005	8	0.013	3.6	563.5	364.07	154.8	Vitrified Clay
1517	O2L34SA3	M34A3	-4.4	M34A2	-4.5	34	0.004	8	0.01	4.12	645.2	418.76	154.1	PVC
998	O2L34SA6	M34A6	-1.9	M34A5	-2.1	77	0.002	8	0.013	2.33	365.3	247.26	147.8	Vitrified Clay
1089	O1L17SA11	M17A11	1.6	M17A10	0.6	245.1	0.004	8	0.013	3.13	490.8	342.94	143.1	Vitrified Clay
1275	O2L22SA2	M22A2	-0.8	M22A1	-1.4	133.8	0.005	8	0.013	2.94	460.5	372.16	123.7	Vitrified Clay
1353	O2L34SA8	M34A8	0	M34A7	-0.5	319.7	0.002	8	0.013	1.62	239.6	224.95	106.5	Vitrified Clay
1057	O1L17SA2	M17A2	-6.6	M17A1	-7	144.5	0.002	12	0.013	2.48	821.3	775.54	105.9	Vitrified Clay
4001	O1L17SA1	M17A1	-7	W-17	-7.1	39.9	0.003	12	0.013	2.95	926.8	912.44	101.6	Vitrified Clay
1108	O1L14SC5	M14C5	-0.4	M14C4	-1.4	315.1	0.003	8	0.013	1.93	302.1	297.81	101.4	Vitrified Clay
1032	O1L17SA3	M17A3	-6.4	M17A2	-6.6	112	0.002	12	0.013	2.24	695.9	692.29	100.5	Vitrified Clay
360	O2L3SA1	M3A1	-1.8	W-3	-1.7	17.9	-0.004	8	0.013	2.31	362.1	362.33	99.9	
3683	O2L22SA4	M22A3	0.9	M22A4	1.6	180.6	0.004	8	0.013	2.39	326.5	327.87	99.6	Vitrified Clay
3510	O2L35SA1	W-35	-1.4	M35A1	-1.3	20.3	0.005	8	0.01	3.58	452.8	494.45	91.6	PVC
4285	O1L17SA4	M17A5	-5.7	M17A4	-6.3	285.4	0.002	12	0.013	2.37	608.5	751.26	81	Vitrified Clay
1518	O2L34SA3	M34A4	-3	M34A3	-4.3	313	0.004	8	0.01	3.22	365.3	454.36	80.4	PVC
1283	O2L22SA3	M22A3	0.9	M22A2	-0.8	259.4	0.007	8	0.013	3.12	343.5	442.87	77.6	
988	O2L34SI1	M34A7	-0.5	M34A6	-1.9	332.4	0.004	8	0.013	2.43	255.2	349.46	73	Vitrified Clay
1465	O2L34SA10	M34A10	0.8	M34A9	0.1	233.6	0.003	8	0.013	2.06	213.7	296.91	72	Vitrified Clay
4282	O1L17SA4	M17A4	-6.3	M17A3	-6.4	27.9	0.003	12	0.013	2.64	608.5	856.88	71	Vitrified Clay
1459	O2L34SA11	M34A11	1.5	M34A10	0.8	233.9	0.003	8	0.013	2.12	213.1	307.09	69.4	Vitrified Clay
3993	O2L36SB1	M36A1	-5.2	M36B1	-4	279.6	0.004	8	0.01	3	263.9	452.17	58.4	PVC
4142	O2L1SA5	M1A4	1	M1A5	1.1	43.1	0.004	8	0.013	2.25	193.2	342.52	56.4	Vitrified Clay
4143	O2L1SA6	M1A5	1.1	M1A6	1.4	72.8	0.004	8	0.013	2.25	192.3	343.57	56	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
376	O2L3SA2	M3A2	-1.3	M3A1	-1.8	107.4	0.005	8	0.013	2.42	203.6	370.12	55	Vitrified Clay
4081	O2L1SA4	M1A3	-0.1	M1A4	1	240.7	0.004	8	0.013	2.35	196.2	359.94	54.5	Vitrified Clay
733	O2L3SH1	M3H1	-0.1	M3A2	-1.3	318.9	0.004	8	0.013	2.14	177.6	329.9	53.8	Vitrified Clay
1100	O1L14SD1	M14D1	0.4	M14C5	-0.4	279.3	0.003	8	0.013	1.02	159.6	299.18	53.3	Vitrified Clay
646	O2L36SA4	M36A4	-2.2	M36A3	-2.4	220.4	0.001	8	0.01	1.38	112.7	212.41	53.1	PVC
737	O2L3SH2	M3H2	1.3	M3H1	-0.1	388.5	0.004	8	0.013	2.08	167.7	322.05	52.1	Vitrified Clay
1402	O1L17SB4	M17B3	3.6	M17B4	4.2	217.7	0.003	8	0.01	1.12	176	370.1	47.6	PVC
1396	O1L17SB2	M17B1	2.2	M17B2	2.6	99.6	0.004	8	0.01	1.34	210.2	446.82	47	PVC
4136	O2L1SA7	M1A6	1.4	M1A7	1.7	46.6	0.006	8	0.013	2.65	191.4	426.48	44.9	Vitrified Clay
3684	O2L22SA4	M22A4	1.6	M22A5	2.2	112.5	0.005	8	0.013	2.38	167.2	386.07	43.3	
419	O2L2SA1	M2A1	-2.1	W-2	-2.2	15.7	0.004	6	0.013	1.64	64.5	150.5	42.9	Vitrified Clay
1324	O1L17SA8	M17A8	-2.1	M17A6	-3.4	159.5	0.008	12	0.013	3.92	608.5	1443.4	42.2	Vitrified Clay
3863	O2L3SF1	M3A1	-1.8	M3F1	-0.4	341.2	0.004	8	0.013	2.09	139.2	344.92	40.3	Vitrified Clay
870	O2L1SA2	M1A2	-0.8	M1A1	-1	82.6	0.003	10	0.013	2.16	225.2	558.68	40.3	Vitrified Clay
3957	O2L3SF3	M3F2	1.5	M3F3	3.2	459.3	0.004	8	0.013	1.99	132.9	329.96	40.3	Vitrified Clay
1168	O1L14SB2	M14B2	-1.4	M14B1	-1.7	285.5	0.001	8	0.013	1.16	76.63	192.58	39.8	Vitrified Clay
1398	O1L17SB3	M17B3	3.4	M17B2	2.6	147.7	0.006	8	0.01	1.34	210.2	538.07	39.1	PVC
1124	O1L14SC6	M14C6	0.5	M14C5	-0.4	305.7	0.003	8	0.013	0.75	116.9	299.16	39.1	Vitrified Clay
1404	O1L17SB5	M17B5	4.7	M17B4	4	146.5	0.004	8	0.01	2.72	176	454.91	38.7	PVC
1126	O1L14SC7	M14C7	1	M14C6	0.5	170	0.003	8	0.013	0.71	111.2	288.2	38.6	Vitrified Clay
1617	O2L3SF2	M3F2	1.5	M3F1	-0.4	437.2	0.004	8	0.013	2.13	136	357.52	38.1	Vitrified Clay
653	O2L36SA2	M36A2	-4.1	M36A1	-5.2	310.1	0.003	8	0.01	2.46	156.8	414.13	37.9	PVC
1271	O2L22SF1	M22F1	-1.8	M22A1	-0.5	112.4	-0.011	6	0.013	1.13	99.38	266.59	37.3	Vitrified Clay
1104	O1L14SD3	M14D3	2.1	M14D2	1.3	284.2	0.003	8	0.013	0.69	108.3	296.6	36.5	Vitrified Clay
1551	O1L17SF1	M17F1	2.8	M17A11	1.6	282.2	0.004	8	0.013	0.83	130.3	358.04	36.4	Vitrified Clay
1106	O1L14SD4	M14D4	2.8	M14D3	2.1	226.8	0.003	8	0.013	0.67	105.4	296.94	35.5	Vitrified Clay
4080	O2L2SR2	M1A2	-0.8	M1A3	-0.1	208.8	0.003	10	0.013	2.1	199.5	562.18	35.5	Vitrified Clay
1088	O1L17A12	M17A12	4	M17A11	3.1	217.3	0.004	8	0.013	0.81	127.5	362.32	35.2	Vitrified Clay
707	O2L3SJ1	M3J1	3	M3H2	1.3	234.4	0.007	8	0.013	2.71	162.5	465.9	34.9	Vitrified Clay
1408	O1L17SB6	M17B6	5.6	M17B5	4.7	229.2	0.004	8	0.01	2.58	153.2	444.28	34.5	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1000	O2L34SA5	M34A5	-2.1	M34A4	-3	23.2	0.039	8	0.013	6.17	365.3	1067.6	34.2	Vitrified Clay
902	O2L23SB1	M23B1	1.9	M17A1	0.3	399.2	0.004	8	0.035	0.74	43.17	128.33	33.6	
1553	O1L17SF2	M17F2	3.9	M17F1	2.8	296.1	0.004	8	0.013	0.69	107.5	335.02	32.1	Vitrified Clay
651	O2L36SA3	M36A3	-2.4	M36A2	-4.1	354.7	0.005	8	0.01	2.7	148.9	479.4	31.1	PVC
1710	O2L38SA2	M38A2	-7.2	M38A1	-8.8	395.9	0.004	8	0.01	2.47	127.4	449.63	28.3	PVC
3884	O2L38SA1	M38A1	-8.9	W-38	-9.1	23.9	0.008	8	0.01	3.53	182.2	644.52	28.3	PVC
4284	O1L17SA6	M17A6	-3.4	M17A5	-5.7	118.8	0.019	12	0.013	5.39	608.5	2230.1	27.3	Vitrified Clay
683	O2L36SB2	M36B2	-3	M36B1	-4	327.4	0.003	8	0.01	2.16	108.2	397.39	27.2	PVC
3372	O2L7SC2	M7C2	-0.1	M7C1	-0.9	162.5	0.005	8	0.013	2.06	103	380.57	27.1	Vitrified Clay
1102	O1L14SD2	M14D2	3.2	M14D1	0.4	281.8	0.01	8	0.013	0.91	142.5	533.77	26.7	Vitrified Clay
1156	O1L14SA5	M14A5	-2.4	M14A4	-3.1	172.3	0.004	8	0.013	0.57	89	343.16	25.9	Vitrified Clay
1555	O1L17SF3	M17F3	4	M17F2	3.9	16.5	0.006	8	0.013	0.69	107.5	421.82	25.5	Vitrified Clay
645	O2L36SA5	M36A5	-2	M36A4	-2.2	84.2	0.003	8	0.01	2.2	104.8	413.76	25.3	PVC
404	O2L1SA1	M1A1	-1	W-1	-1.2	11	0.012	10	0.013	3.65	270.5	1071.6	25.2	Vitrified Clay
4010	O2L19SA1	W-9	-0.4	M9A1	-0.3	20.8	0.005	8	0.01	2.56	116.6	488.56	23.9	PVC
524	O2L34SA2	M34A2	-4.6	M34A1	-5.5	25.8	0.031	12	0.012	6.98	694	3033.5	22.9	Ductile Iron
589	O2L7SA2	M7A2	-2	M7A1	-5.5	246.6	0.014	6	0.013	2.76	68.03	300.43	22.6	Vitrified Clay
3378	O2L7SC3	M7C3	0.7	M7C2	-0.1	139.7	0.006	8	0.013	2.1	91.36	410.39	22.3	Vitrified Clay
644	O2L36SA6	M36A6	-1.7	M36A5	-2	90.5	0.003	8	0.01	2.05	88.67	399.19	22.2	PVC
569	O2L7SD2	M7D2	1.8	M7D1	1	157	0.005	6	0.013	1.66	39.53	184.22	21.5	Vitrified Clay
457	O2L7SA1	M7A1	-5.5	W-7	-6.4	7.7	0.116	6	0.013	2.08	183.3	857.64	21.4	
570	O2L7SD1	M7D1	1	M7A3	-0.6	136.4	0.012	6	0.013	2.43	56.33	272.74	20.7	Vitrified Clay
3512	O2L35SA2	M35A1	-1.2	M35A2	-0.1	286.5	0.004	8	0.01	2.19	89.89	436.87	20.6	PVC
1333	O1L40SA5	M40A4	2.7	M40A5	3.7	263.3	0.004	8	0.01	2.17	88.08	434.47	20.3	PVC
1329	O1L40SA3	M40A2	0.3	M40A3	1.4	286.8	0.004	8	0.01	2.18	88.08	436.66	20.2	PVC
3103	O2L34SG1	M34G1	3.8	M34F2	0.3	401.3	0.009	6	0.013	2.09	47.49	236.19	20.1	Vitrified Clay
3514	O2L35SA3	M35A2	0	M35A3	1.5	393.5	0.004	8	0.01	2.13	83.01	433.85	19.1	PVC
1016	O1L17SM1	M17M1	-0.8	M17A3	-1.3	132	0.004	8	0.01	2.21	85.5	450.98	19	PVC
1331	O1L40SA4	M40A3	1.5	M40A4	2.7	275	0.004	8	0.01	2.28	88.08	465.75	18.9	PVC
1327	O1L40SA2	M40A1	-0.6	M40A2	0.2	190.5	0.004	8	0.01	2.29	88.08	468.18	18.8	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4128	O2L1SA8	M1A7	1.7	M1A8	1.9	44.8	0.004	12	0.013	2.19	187.8	1007.9	18.6	
1557	O1L17SF4	M17F4	5.2	M17F3	4	350.6	0.003	8	0.013	1.55	58.75	317.28	18.5	Vitrified Clay
643	O2L36SA7	M36A7	-0.7	M36A6	-1.7	299.2	0.003	8	0.01	1.92	72.51	395.17	18.3	PVC
4129	O2L1SA9	M1A8	1.9	M1A9	3	256.4	0.004	12	0.013	2.26	186.3	1056.8	17.6	
1304	O1L14SC8	M14C8	1.3	M14C7	1	89.7	0.003	8	0.01	0.45	71.25	407.81	17.5	PVC
588	O2L7SA3	M7A3	-0.6	M7A2	-2	283.5	0.005	8	0.013	1.82	65.63	379.78	17.3	Vitrified Clay
3247	O2L18SC9	M18C9	3.4	M18C2	3	99.5	0.004	8	0.01	2.11	75.65	441.38	17.1	PVC
1502	O2L18ASA5	M18A-A5	0.7	M18A-A4	0.2	162.3	0.003	8	0.01	1.88	67.5	395.19	17.1	PVC
1496	O2L18ASA3	M18A-A3	-0.3	M18A-A2	-0.7	102.4	0.004	8	0.01	0.49	76	446.05	17	PVC
3713	O2L22SA1	M22A1	-1.4	W-23	-2.2	16.1	0.048	12	0.013	7.4	587.3	3518.3	16.7	
1704	O2L38SA3	M38A3	-5.5	M38A2	-7.2	382.4	0.004	8	0.013	1.69	59.32	358.4	16.6	
4023	O2L5SA1	M5A1	-2.9	W-5	-3	10.6	0.005	6	0.01	1.89	37.17	225.16	16.5	PVC
1306	O1L14SC9	M14C9	1.7	M14C8	1.3	115.8	0.004	8	0.01	0.45	71.25	444.4	16	PVC
538	O1L14SA4	M14A4	-3.1	M14A3	-2.6	57	-0.008	8	0.01	0.63	98.12	619.43	15.8	PVC
1412	O1L17SB7	M17B6	5.3	M17B7	5.7	143.6	0.003	8	0.01	1.69	57	362.66	15.7	PVC
537	O1L14SA3	M14A3	-2.6	M14A2	-3.6	68.4	0.013	8	0.013	0.63	98.12	628.94	15.6	
1500	O2L18ASA4	M18A-A4	0.2	M18A-A3	-0.3	112.6	0.004	8	0.01	2.07	69.07	445.71	15.5	PVC
1172	O1L14SA7	M14A7	-1.6	M14A6	-0.5	131	-0.008	8	0.013	0.49	76.17	492.39	15.5	Vitrified Clay
3995	O2L36SC2	M36C1	-2	M36C2	-0.5	271.5	0.005	8	0.01	2.41	80.07	522.31	15.3	PVC
1014	O1L17SM2	M17M2	-0.3	M17M1	-0.8	94.7	0.005	8	0.01	2.26	74.1	491.29	15.1	PVC
912	O2L5SA2	M5A2	-2.7	M5A1	-2.9	53.7	0.005	6	0.01	1.81	32.45	223.47	14.5	PVC
1012	O1L17SM3	M17M3	0.6	M17M2	-0.3	244	0.004	8	0.01	1.98	62.7	437.59	14.3	PVC
642	O2L36SA8	M36A8	0.2	M36A7	-0.7	292.1	0.003	8	0.01	1.8	56.34	399.96	14.1	PVC
1425	O2L32SA1	W-32	-1.6	M32A1	-1.2	120.4	0.004	8	0.01	1.95	59.74	435.71	13.7	PVC
1506	O2L18ASA6	M18A-A6	1.2	M18A-A5	0.7	121.8	0.004	8	0.01	2.04	61.2	460.67	13.3	PVC
3643	O2L18ASA2	M18A-A2	-0.7	M18A-A1	0.4	95.8	-0.011	8	0.013	0.49	76	575.97	13.2	
3846	O2L4SA3	M4A2	0.3	M4A3	0.7	92.3	0.005	6	0.013	1.34	22.37	171.88	13	Vitrified Clay
3365	O2L7SC1	M7C1	-0.9	M7A1	-5.5	181.5	0.025	8	0.013	3.77	109.6	864.45	12.7	Vitrified Clay
3994	O2L36SC1	M36B1	-4	M36C1	-2	190.4	0.011	8	0.01	3.16	90.81	724.35	12.5	PVC
3426	O2L36SA1	M36A1	-5.2	W-36	-9	68	0.057	12	0.013	7	473.7	3804.2	12.5	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
568	O2L7SD3	M7D3	2.7	M7D2	1.8	157.5	0.005	6	0.013	1.42	22.73	182.79	12.4	Vitrified Clay
1512	O2L18ASA8	M18A-A8	2.1	M18A-A7	1.7	100.8	0.004	8	0.01	1.95	54.9	449.6	12.2	PVC
1377	O1L37SC1	M37A2	-2.8	M37A1	-3.2	98.7	0.004	8	0.01	2.01	56.19	465.32	12.1	PVC
1510	O2L18ASA7	M18A-A7	1.7	M18A-A6	1.2	120	0.004	8	0.01	2	55.84	464.08	12	PVC
1008	O1L17SM5	M17M5	1.9	M17M4	1	215.3	0.004	8	0.01	1.88	51.3	440.44	11.6	PVC
1010	O1L17SM4	M17M4	1	M17M3	0.6	105.8	0.004	8	0.01	1.89	51.3	444.2	11.5	PVC
1448	O2L31SA2	M31A2	-2.3	M31A1	-4	387.1	0.004	8	0.01	1.98	53.69	465.86	11.5	PVC
1606	O1L17SO1	M17O1	1.7	M17N1	0.1	315.6	0.005	8	0.01	2.11	57	498.88	11.4	PVC
682	O2L36SB3	M36B3	-0.1	M36B2	-3	325.9	0.009	8	0.01	2.78	73.19	660.47	11.1	PVC
865	O2L1SE3	M1E3	1.5	M1E2	0.7	171.5	0.005	6	0.013	1.28	18.75	172.65	10.9	Vitrified Clay
1166	O1L14SB1	M14B1	-1.7	M14A1	-4	304.2	0.007	10	0.013	2.27	91.91	847.57	10.8	Vitrified Clay
1072	O1L17SQ1	M17Q2	-3.4	M17Q1	-4	143.7	0.004	8	0.013	0.24	37.05	344.55	10.8	Vitrified Clay
794	O2L2SA2	M2A2	-1.3	M2A1	-2.1	174.8	0.005	8	0.013	1.52	38.7	366.74	10.6	Vitrified Clay
4012	O2L9SB1	M9A1	-0.3	M9B1	0.5	194.7	0.004	8	0.01	1.87	47.25	452	10.5	PVC
1128	O1L14SF1	M14F1	1.8	M14C7	1	250.4	0.003	8	0.013	0.2	31.35	302.71	10.4	Vitrified Clay
1414	O1L17SB9	M17B9	6.5	M17B7	6.1	98.6	0.004	8	0.01	1.83	45.6	443.5	10.3	PVC
1702	O2L38SA4	M38A4	-3.8	M38A3	-5.4	393.5	0.004	8	0.01	1.86	46.2	452.36	10.2	PVC
699	O1L17SL3	M17L3	1.8	M17L2	1.2	152.2	0.004	8	0.01	1.83	45.04	448.12	10.1	PVC
697	O1L17SL2	M17L2	1.2	M17L1	0.9	75.7	0.004	8	0.01	1.84	45.04	451.18	10	PVC
1373	O1L37SA3	M37A3	-1.6	M37A2	-2.8	245.7	0.005	8	0.01	1.96	47.83	482.4	9.9	PVC
1394	O1L17SB1	M17B1	2.2	M17A11	1.6	20.6	0.03	10	0.01	0.86	210.2	2218.4	9.5	PVC
1592	O2L16SA5	M16A5	0.6	M16A4	-0.3	203.9	0.004	8	0.013	1.38	31.71	348.09	9.1	Vitrified Clay
986	O2L34SF1	M34F1	0.8	M34A6	-0.3	324.1	0.004	12	0.013	1.68	86	952.5	9	
1006	O1L17SM6	M17M6	2.5	M17M5	1.9	150.5	0.004	8	0.01	1.76	39.9	445.1	9	PVC
1371	O1L37SA4	M37A4	-0.4	M37A3	-1.6	236.2	0.005	8	0.01	1.98	44.7	500.45	8.9	PVC
4321	O2L18SC1	M18A1	-3.1	M18C1	2.5	150.6	0.037	8	0.013	4.1	92.03	1041.2	8.8	Vitrified Clay
1712	O2L38SB1	M38A1	-2.9	M38B1	-1.6	300.5	0.004	8	0.01	1.83	40.85	465.5	8.8	PVC
1277	O2L22SB1	M22B1	1.2	M22A2	-0.8	70.3	0.028	8	0.01	4.62	102.8	1177.4	8.7	PVC
689	O2L36SD2	M36D2	1.9	M36D1	1	353.5	0.004	8	0.013	1.34	29.8	343.01	8.7	
1196	O1L14SA8	M14A8	-0.6	M14A7	-1.6	247.4	0.004	8	0.013	1.34	29.64	342.71	8.6	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4475	O2L4SA2	M4A2	0.3	M4A1	0.1	16.8	0.011	6	0.013	1.81	22.37	260.6	8.6	Vitrified Clay
701	O1L17SL4	M17L4	2.3	M17L3	1.8	130.1	0.004	8	0.01	1.73	37.92	445.75	8.5	PVC
856	O2L1SJJ1	M1JJ1	1.7	M1D2	0.9	131.3	0.006	6	0.013	1.31	15.9	191.56	8.3	Vitrified Clay
1586	O2L16SA3	M16A3	-1.4	M16A2	-2.6	24.9	0.045	8	0.013	4.44	95.48	1150.3	8.3	Vitrified Clay
680	O2L36SI1	M36I1	1.5	M36B3	-0.1	300.2	0.005	8	0.01	1.99	42.6	514.71	8.3	PVC
1170	O1L14SA6	M14A6	-0.5	M14A5	-2.4	64.2	0.029	8	0.013	3.56	76.17	923.17	8.3	Vitrified Clay
659	O2L36SC3	M36C3	3.9	M36C2	-0.5	309.8	0.014	8	0.01	3.24	69.33	843.1	8.2	PVC
3278	O2L18SC2	M18C2	3	M18C1	2.5	140.1	0.004	12	0.013	1.75	83.84	1019.8	8.2	
3429	O2L25SA2	M25A2	-0.4	M25A1	-1	132.9	0.004	8	0.013	1.37	29.1	355.25	8.2	Vitrified Clay
1198	O1L14SA9	M14A9	0.4	M14A8	-0.6	249.5	0.004	8	0.013	1.31	27.93	342.65	8.2	Vitrified Clay
4014	O2L9SB2	M9B1	0.5	M9B2	1.5	123	0.008	6	0.01	2.01	23.63	295.15	8	PVC
953	O2L4SA4	M4A4	1.2	M4A3	0.7	103.7	0.005	6	0.013	1.15	13.55	169.51	8	Vitrified Clay
1228	O1L14SA10	M14A10	1.2	M14A9	0.4	205.2	0.004	8	0.013	1.3	26.22	342.81	7.6	
1031	O1L17SN1	M17N1	0.1	M17A2	-1.9	188.1	0.011	12	0.013	2.77	125.4	1652.8	7.6	
532	O1L14SA1	M14A1	-4	W-14	-8.2	6.8	1.403	10	0.013	26.73	877.5	11649	7.5	
1319	O1L17SQ4	M17Q4	4.1	M17Q3	3.3	199.6	0.004	8	0.013	1.29	25.65	343.31	7.5	Vitrified Clay
1582	O2L16SB2	M16B2	-1.7	M16B1	-2	109.3	0.003	8	0.013	1.16	22.9	311.19	7.4	Vitrified Clay
1698	O2L38SA5	M38A4	-3.7	M38A5	-2.1	397.1	0.004	8	0.01	1.68	33.07	450.33	7.3	PVC
1431	O2L32SB2	M32A2	0.8	M32A1	-1.2	242.9	0.008	8	0.01	2.34	45.94	630.08	7.3	PVC
3083	O2L16SA1	M16A1	-2.8	W-16	-7.3	31.2	0.145	8	0.013	7	149	2064.8	7.2	Vitrified Clay
1605	O1L17SO2	M17O2	2.9	M17O1	1.7	258.3	0.005	8	0.01	1.76	34.2	476.53	7.2	PVC
3516	O2L35SD1	M35A3	1.5	M35D1	2	109.8	0.005	8	0.01	1.78	34.43	480.46	7.2	PVC
4096	O2L1SA10	M1A9	3	M1A10	4.3	221.4	0.006	8	0.013	1.51	28.75	410.73	7	Vitrified Clay
1718	O2L16SA2	M16A2	-2.6	M16A1	-2.8	25.6	0.007	12	0.013	2.24	95.48	1378.3	6.9	
692	O2L36SB4	M36B4	0.5	M36B3	-0.1	188.5	0.003	8	0.01	1.5	28.2	410.79	6.9	PVC
863	O2L1SK2	M1E4	3	M1E3	1.5	125.9	0.012	6	0.013	1.78	18.75	274.92	6.8	Vitrified Clay
4273	O2L32SC2	M32C1	0	M32C2	1	151.6	0.007	6	0.013	1.32	13.81	204.55	6.7	Vitrified Clay
1130	O1L14SF2	M14F2	2.5	M14F1	1.8	250.2	0.003	8	0.013	0.13	19.95	296.94	6.7	Vitrified Clay
3990	O2L35SA4	M35A3	1.5	M35A4	2.7	270.8	0.004	8	0.01	1.7	31.4	469.34	6.7	PVC
667	O2L36SG1	M36G1	5	M36C3	3.9	232.8	0.005	8	0.013	1.34	24.74	371.09	6.7	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1588	O2L16SD1	M16D1	-0.1	M16A3	-1.4	285.7	0.005	8	0.013	1.34	24.46	371.41	6.6	Vitrified Clay
1433	O2L32SA3	M32A2	0.8	M32A3	1.1	73.4	0.005	8	0.01	1.78	31.07	500.5	6.2	PVC
793	O2L2SD1	M2D1	-1.7	M2A1	-2.1	55.3	0.007	6	0.013	1.31	12.9	207.87	6.2	Vitrified Clay
796	O2L2SC1	M2C1	-1.8	M2A1	-2.1	40	0.007	6	0.013	1.28	12.6	203.11	6.2	Vitrified Clay
1356	O2L16SA6	M16A6	1.1	M16A5	0.6	98.2	0.005	8	0.01	1.82	31.71	512.97	6.2	PVC
1477	O2L39SA1	W-39	-2	M39A1	-1.6	76	0.005	8	0.01	0.2	31.5	511.59	6.2	PVC
1418	O1L17SB10	M17B10	7	M17B9	6.5	112.2	0.004	8	0.012	1.32	22.8	372.14	6.1	Ductile Iron
869	O2L1SE1	M1E1	-0.3	M1A2	-0.8	104.8	0.005	8	0.013	1.35	23.25	382.92	6.1	Vitrified Clay
867	O2L1SE2	M1E2	0.7	M1E1	-0.3	210.7	0.004	8	0.013	1.27	21.45	363.06	5.9	Vitrified Clay
4182	O2L7SB2	M1D1	-0.2	M1A1	-1	175.9	0.005	8	0.013	1.28	21.6	366.44	5.9	Vitrified Clay
1444	O2L31SA3	M31A3	-0.1	M31A2	-2.3	325.9	0.007	8	0.01	2.03	34.21	581.9	5.9	PVC
1442	O2L31SA4	M31A4	0.4	M31A3	-0.1	326.6	0.001	8	0.01	0.92	15.54	264.6	5.9	PVC
703	O1L17SL5	M17L5	3.6	M17L4	2.3	301.8	0.004	8	0.01	1.59	26.52	455.56	5.8	PVC
3198	O2L18SA1	W-18	-5.2	M18A1	-3.1	11.3	0.186	8	0.013	0.86	134.6	2339.4	5.8	Vitrified Clay
924	O2L5SA4	M5A4	-0.7	M5A3	-2.4	308.2	0.005	6	0.013	1.15	10.71	186.47	5.7	Vitrified Clay
528	O2L34SA1	M34A1	-5.5	W-34	-11.1	5.9	1.877	14	0.012	37.83	1914	34448	5.6	Ductile Iron
1522	O2L34SC2	M34C2	-0.3	M34C1	-1	152.4	0.005	8	0.01	1.64	26.4	480.62	5.5	PVC
4181	O2L7SB2	M1D2	0.9	M1D1	-0.2	268.1	0.004	8	0.013	1.22	19.5	358.58	5.4	Vitrified Clay
3187	O2L30SE1	M30B2	0	M30B1	-0.5	58.1	0.009	6	0.013	1.41	12.6	233.56	5.4	Vitrified Clay
976	O2L34SF2	M34F2	1.9	M34F1	-0.8	304.3	0.009	12	0.013	2.23	78.92	1480.9	5.3	
3193	O2L30SB4	M30B4	1.7	M30B3	1	143.5	0.005	4	0.01	1.05	4.095	77.556	5.3	PVC
1351	O2L34SL	M34L1	1.6	M34A8	0	389.1	0.004	8	0.013	1.16	18.06	343.39	5.3	Vitrified Clay
1714	O2L38SB3	M38B1	-1.6	M38B2	0.1	298.2	0.006	8	0.01	1.77	27.24	527.58	5.2	PVC
4002	O1L17SQ0	M17Q0	0.6	W-17	-0.1	26.7	0.027	8	0.01	3.86	59.22	1150	5.1	PVC
1083	O1L17SG1	M17G1	4.8	M17A10	4.1	172.1	0.004	8	0.01	1.49	22.8	446.44	5.1	PVC
1174	O1L14SM1	M14M1	-0.4	M14A7	-1.6	293.9	0.004	8	0.013	1.15	17.39	343.06	5.1	Vitrified Clay
1593	O2L16SA4	M16A4	-0.3	M16A3	-1.4	188.8	0.006	12	0.013	1.85	62.92	1253.3	5	
848	O2L1SJJ2	M1JJ2	2.1	M1JJ1	1.7	66.2	0.007	6	0.013	1.21	10.2	203.87	5	Vitrified Clay
1563	O1L14SH2	M14H2	3.4	M14H1	3	117.6	0.004	8	0.013	0.11	17.1	342.84	5	Vitrified Clay
859	O2L1SB1	M1A1	-1	M1B1	-0.4	124.3	0.005	8	0.013	1.24	18.6	375.29	5	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1321	O1L17SQ3	M17Q3	3.3	M17Q2	-3.4	341	0.02	8	0.013	2.51	37.05	759.03	4.9	Vitrified Clay
4020	O2L5SD2	M5D1	-1	M5D2	-0.8	43.7	0.005	6	0.01	1.3	10.71	221.39	4.8	PVC
926	O2L5SA6	M5A6	0.5	M5A4	-0.7	280.1	0.005	6	0.013	0.99	8.19	169.58	4.8	Vitrified Clay
1055	O1L17ST2	M17T2	-3.3	M17T1	-3.5	39.8	0.004	12	0.013	1.48	48.45	1013.6	4.8	
1021	O1L17SO3	M17O3	4.1	M17O2	2.9	270.1	0.005	8	0.01	1.57	22.8	477.74	4.8	PVC
1450	O2L31SB3	M31B2	0.8	M31B1	-0.4	235.1	0.005	8	0.01	1.61	23.34	493.11	4.7	PVC
4021	O2L5SD3	M5D2	-0.8	M5D3	0.7	341.9	0.005	6	0.013	0.98	7.875	169	4.7	Vitrified Clay
3657	O2L31SB1	M31A1	-4	W-31	-9.6	36.6	0.153	8	0.01	8.32	125.4	2756.8	4.5	PVC
1208	O1L14SS2	M14S2	2.1	M14S1	1	288.3	0.004	8	0.013	1.05	14.82	325.73	4.5	Vitrified Clay
3992	O2L35SA5	M35A4	2.8	M35A4	3.6	218.5	0.004	8	0.01	1.36	19.14	423.99	4.5	PVC
1312	O1L14SG1	M14G1	2.4	M14C9	1.7	177.5	0.004	8	0.01	0.13	19.95	442.78	4.5	PVC
1696	O2L38SA5	M38A6	-1.1	M38A5	-2	224.6	0.004	8	0.01	1.45	19.95	451.2	4.4	PVC
1613	O2L3SD1	M3D1	-0.2	M3A1	-1.8	527	0.003	8	0.013	0.96	13.11	296.95	4.4	Vitrified Clay
1776	O2L30SA4	M30A4	1.4	M30A3	0.6	183.3	0.005	6	0.013	0.98	7.56	171.47	4.4	Vitrified Clay
3476	O1L40SA1	M40A1	-0.6	W-40	-1.5	10.6	0.085	8	0.01	6.6	90.53	2054.1	4.4	PVC
1202	O1L14SS1	M14S1	1	M14A7	-1.6	247.7	0.011	8	0.013	1.78	24.37	556.67	4.4	Vitrified Clay
732	O2L3SL1	M3L1	0.4	M3H1	-0.1	113.6	0.005	6	0.013	0.97	7.41	170.35	4.3	Vitrified Clay
661	O2L36SC4	M36C4	5.1	M36C3	3.9	227.5	0.005	8	0.01	1.58	21.48	494.65	4.3	PVC
4064	O2L2SP1	M2P1	0	M2A2	-1.3	292.9	0.004	8	0.013	1.14	15.3	357.43	4.3	Vitrified Clay
1053	O1L17ST3	M17T3	-2.8	M17T2	-3.3	99.7	0.005	12	0.013	1.6	48.45	1132.6	4.3	
576	O2L7SE1	M7E1	4.9	M7D3	2.7	432.8	0.005	6	0.013	1.02	7.733	181.57	4.3	Vitrified Clay
4218	O2L25SA3	M25A2	-0.4	M25A3	0.2	107.7	0.006	8	0.013	1.29	17.13	404.83	4.2	Vitrified Clay
963	O2L4SA5	M4A5	1.8	M4A4	1.2	122.9	0.005	6	0.013	0.97	7.245	171.5	4.2	Vitrified Clay
3192	O2L30SF1	M30B3	1	M30B2	0	167.7	0.006	6	0.013	1.1	8.19	194.44	4.2	Vitrified Clay
137	O1L17SJ1	M17J1	3.7	M17A9	2.6	254	0.004	8	0.013	1.13	14.96	356.87	4.2	
1567	O1L14SH4	M14H4	4.2	M14H3	3.8	105.9	0.004	8	0.013	0.09	14.25	341.52	4.2	Vitrified Clay
3175	O2L30SA2	M30B1	-0.5	M30A1	-0.9	23.9	0.018	6	0.013	1.85	13.55	333.55	4.1	Vitrified Clay
1706	O2L38SC1	M38A2	-2	M38C1	-0.7	296.3	0.004	12	0.013	1.42	41	1030.2	4	
911	O2L5SA3	M5A3	-2.4	M5A2	-2.7	54.7	0.005	8	0.01	1.47	18.59	476.76	3.9	PVC
860	O2L1SB2	M1B1	-0.4	M1B2	1.2	373.3	0.004	8	0.013	1.09	13.8	354.63	3.9	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1612	O2L3SD2	M3D2	0.6	M3D1	-0.2	284.2	0.003	8	0.013	0.89	11.12	287.73	3.9	Vitrified Clay
735	O2L3SA3	M3A3	0.4	M3A2	-1.3	474.8	0.004	8	0.013	0.99	12.26	321.66	3.8	Vitrified Clay
1565	O1L14SH3	M14H3	3.8	M14H2	3.4	53.6	0.007	8	0.013	0.11	17.1	450.68	3.8	Vitrified Clay
1447	O2L31SB1	M31B1	-0.4	M31A1	-4	231.3	0.015	8	0.01	2.67	32.79	875.9	3.7	PVC
1025	O1L17SN2	M17N2	3.7	M17N1	0.1	202.6	0.018	8	0.01	2.84	34.2	935.91	3.7	PVC
1481	O2L39SA2	M39A1	-1.6	M39A2	-0.3	346.5	0.004	8	0.01	0.1	15.75	440.09	3.6	PVC
1435	O2L32SA4	M32A4	1.9	M32A3	1.1	179	0.004	8	0.01	1.4	16.52	465.42	3.5	PVC
3121	O2L29SB1	M29B1	-1	M29A1	-1.6	116	0.005	6	0.01	1.24	8.19	231.48	3.5	PVC
1749	O2L31SB3	M31B3	1.7	M31B2	0.8	175	0.005	8	0.01	1.52	17.77	505.55	3.5	PVC
4451	O2L18SB1	M18A1	-3.1	M18B1	-2.4	108	0.007	8	0.013	0.1	15.44	439.69	3.5	Vitrified Clay
1081	O1L17SH1	M17H1	2.6	M17A10	2.3	40.6	0.006	8	0.01	1.65	19.24	553.53	3.5	PVC
676	O2L36SB6	M36B6	3	M36B5	2.1	238.2	0.004	8	0.01	1.31	14.9	442.9	3.4	PVC
928	O2L5SA7	M5A7	1.8	M5A6	0.5	282.1	0.005	6	0.013	0.89	5.67	169.64	3.3	Vitrified Clay
1210	O1L14SS3	M14S3	2.9	M14S2	2.1	210.9	0.004	8	0.013	0.99	11.12	334.02	3.3	Vitrified Clay
705	O1L17SL6	M17L6	4	M17L5	3.6	88.8	0.004	8	0.01	1.35	15.12	456.92	3.3	PVC
742	O2L3SA4	M3A4	1.4	M3A3	0.4	285.6	0.004	8	0.013	0.94	10.55	320.92	3.3	Vitrified Clay
1070	O1L17SQ1	M17Q1	-4	M17Q0	0.6	105.3	-0.043	8	0.013	0.24	37.05	1128.7	3.3	Vitrified Clay
1716	O2L38SB3	M38B2	0.1	M38B3	1.5	395.4	0.003	8	0.01	1.22	13.62	416.54	3.3	PVC
786	O2L2SD3	M2D3	1.5	M2D2	0	255.5	0.006	6	0.013	1.01	6.3	192.96	3.3	Vitrified Clay
3384	O2L25SB2	M25B2	0.9	M25B1	0.3	267.7	0.002	8	0.013	0.79	8.76	269.31	3.3	Vitrified Clay
1079	O1L17SH2	M17H2	3	M17H1	2.6	95.1	0.005	8	0.01	1.48	16.39	506.06	3.2	PVC
1308	O1L14SG1	M14C10	2.6	M14C9	1.7	204.6	0.004	8	0.01	0.09	14.25	446.3	3.2	PVC
691	O2L36SB5	M36B5	2.1	M36B4	0.5	346.3	0.004	8	0.01	1.36	14.9	467.13	3.2	PVC
610	O2L2SA4	M2A4	1.5	M2A3	0.3	385.4	0.003	8	0.013	0.88	9.6	302.61	3.2	Vitrified Clay
1379	O1L37SC1	M37C1	-2.6	M37A1	-3.2	151.6	0.004	8	0.01	1.25	13.57	428.51	3.2	PVC
1349	O2L34SU1	M34U1	2.6	M34L1	1.6	241.1	0.004	8	0.013	1.02	10.98	351.02	3.1	Vitrified Clay
990	O2L34SI1	M34J1	0.1	M34A7	-0.5	104.2	0.006	6	0.013	1	6.038	194.22	3.1	Vitrified Clay
3349	O2L25SA4	M25A4	1	M25A3	0.2	124.4	0.006	8	0.01	1.6	17.13	554.7	3.1	PVC
3390	O2L25SA5	M25A4	1	M25A5	1.5	128.6	0.004	8	0.01	1.28	13.66	443.97	3.1	PVC
3392	O2L25SA6	M25A6	1.9	M25A5	1.5	110	0.004	8	0.01	1.26	13.35	435.75	3.1	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
767	O2L2SA3	M2A3	0.3	M2A2	-1.3	170.1	0.009	8	0.013	1.48	15.6	517.85	3	Vitrified Clay
1610	O2L3SD3	M3D3	1.5	M3D2	0.6	298.5	0.003	8	0.013	0.85	8.835	299.44	3	Vitrified Clay
4478	O2L4SG1	M4G1	3	M4A1	0.1	347.6	0.008	6	0.013	1.16	6.773	230.02	2.9	Vitrified Clay
567	O2L7SD4	M7D4	4.4	M7D3	2.7	329.2	0.005	6	0.013	0.93	5.4	183.62	2.9	
932	O2L5SD4	M5D4	2.2	M5D3	0.7	315.1	0.005	6	0.013	0.87	5.04	173.17	2.9	Vitrified Clay
3518	O2L35SB1	M35A1	-1.3	M35B1	2	326.2	0.01	8	0.01	2.01	20.64	709.15	2.9	PVC
3358	O2L25SB1	M25B1	0.3	M25A1	-1	149.3	0.008	8	0.013	1.39	14.12	494.2	2.9	Vitrified Clay
3195	O2L30SF1	M30F1	1.8	M30B3	1	205.5	0.004	4	0.01	0.77	1.89	69.272	2.7	PVC
804	O2L2SC2	M2C2	-1.3	M2C1	-1.8	83.4	0.006	6	0.013	0.98	5.4	198.28	2.7	Vitrified Clay
666	O2L36SG2	M36G2	6	M36G1	5	235.8	0.004	8	0.01	1.26	12.37	454.49	2.7	PVC
1719	O2L16SB1	M16B1	-2	M16A1	-2.8	114.9	0.006	12	0.013	1.58	34.91	1283.3	2.7	
3113	O2L29SA2	M29A2	-0.7	M29A1	-1.6	160.7	0.006	8	0.01	1.46	14.18	527.71	2.7	PVC
595	O2L7SF1	M7F1	4.1	M7D2	1.8	335.2	0.007	6	0.013	1.01	5.4	207.68	2.6	
3996	O2L36SD1	M36B1	-4	M36D1	1	188.9	0.026	8	0.01	3.13	29.8	1147.1	2.6	PVC
1406	O1L17SI1	M17I1	4.9	M17B5	4.7	64.3	0.004	8	0.01	1.2	11.4	439.57	2.6	PVC
4269	O1L14SF3	M14F2	2.5	M14F3	3	132.3	0.004	8	0.013	0.05	8.55	330.07	2.6	Vitrified Clay
4418	O2L30SA2	M30A2	-0.2	M30A1	-0.9	85.8	0.009	8	0.013	1.37	12.92	501.36	2.6	
1416	O1L17SE1	M17E1	7	M17B9	6.5	115	0.004	8	0.01	1.21	11.4	445.98	2.6	PVC
1004	O1L17SM7	M17M7	3.8	M17M6	2.5	319.4	0.004	8	0.01	1.21	11.4	446.35	2.6	PVC
1410	O1L17SD1	M17D1	6.2	M17B6	5.6	164.6	0.004	8	0.01	1.21	11.4	446.41	2.6	PVC
1420	O1L17SB11	M17B11	7.8	M17B10	7	190.4	0.004	8	0.01	1.23	11.4	457.07	2.5	PVC
842	O2L1SJJ3	M1JJ3	2.7	M1JJ2	2.1	81.2	0.007	6	0.013	0.98	5.1	205.35	2.5	Vitrified Clay
637	O2L36SA9	M36A9	1	M36A8	0.2	86.2	0.009	8	0.01	1.81	16.63	670.63	2.5	PVC
3414	O2L18SA2	M18A2	-2.5	M18A1	-3.1	163.8	0.004	12	0.013	0.07	24.57	991.79	2.5	
784	O2L2SD4	M2D4	3	M2D3	1.5	383.8	0.004	6	0.013	0.75	3.9	157.44	2.5	Vitrified Clay
3419	O2L18SA3	M18A3	-1.6	M18A2	-2.5	255	0.003	8	0.013	0.05	7.875	320.4	2.5	Vitrified Clay
3179	O2L30SB5	M30B5	2.2	M30B4	1.7	110.8	0.005	6	0.013	0.8	4.095	169.15	2.4	Vitrified Clay
3331	O2L25SC1	M25C1	0.6	M25A2	-0.4	133.3	0.008	6	0.013	1.05	5.355	221.35	2.4	Vitrified Clay
673	O2L36SF1	M36F1	3	M36D2	1.9	139.7	0.008	8	0.01	1.66	14.9	619.99	2.4	PVC
1427	O2L32SC1	M32A1	-0.6	M32C1	-0.4	27.1	0.007	8	0.01	1.53	13.81	574.73	2.4	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1186	O1L14SM3	M14M3	3	M14M2	2.2	209.2	0.004	8	0.013	0.93	8.265	347.74	2.4	Vitrified Clay
3305	O2L24SA1	M24D1	-0.9	M24A1	-1.6	169.2	0.004	6	0.013	0.75	3.78	159.65	2.4	Vitrified Clay
1027	O1L17SN3	M17N3	4.7	M17N2	3.7	210.4	0.005	8	0.01	1.28	11.4	483.64	2.4	PVC
639	O2L36SH2	M36H2	5.1	M36H1	3	229.5	0.009	8	0.01	1.77	15.7	669.54	2.3	PVC
1230	O1L14SA11	M14A11	2	M14A10	1.2	138.9	0.006	8	0.013	1.1	9.69	415.7	2.3	Vitrified Clay
3411	O2L18SE1	M18E1	-1.8	M18A2	-2.5	142.4	0.005	8	0.013	0.06	8.82	380.31	2.3	Vitrified Clay
663	O2L36SC5	M36C5	6	M36C4	5.1	220.1	0.004	8	0.01	1.22	10.74	463.16	2.3	PVC
4063	O2L2SR1	M2R1	1.8	M2P1	0	423.6	0.004	8	0.013	0.93	8.1	352.99	2.3	Vitrified Clay
1029	O1L17SN4	M17N4	5.3	M17N3	4.7	122.5	0.005	8	0.01	1.31	11.4	497.52	2.3	PVC
1603	O2L38SD1	M38D1	0.1	M38A6	-1	190.5	0.006	8	0.01	1.4	12.15	530.84	2.3	PVC
4479	O2L4SA1	M4A1	0.1	W-4	-4.6	7.7	0.602	6	0.013	8.39	44.53	1953.9	2.3	Vitrified Clay
592	O2L7SG1	M7G1	3.9	M7D1	1	328.7	0.009	6	0.013	1.11	5.4	237.34	2.3	
4018	O2L5SD1	M5A2	-2.7	M5D1	-1	360.5	0.005	8	0.01	1.25	10.71	475.56	2.3	PVC
1526	O2L34SC4	M34C4	2.9	M34C3	1.7	308.5	0.004	12	0.013	1.17	22.6	1009.7	2.2	Vitrified Clay
1561	O1L14SH1	M14H1	3	M14D2	1.3	47	0.036	8	0.013	0.15	22.8	1025.4	2.2	Vitrified Clay
1537	O2L34SB3	M34B3	2.9	M34B2	2.3	139.3	0.004	8	0.01	1.23	10.43	470.36	2.2	PVC
1535	O2L34SB2	M34B2	2.3	M34B1	1.7	122.7	0.004	8	0.01	1.23	10.43	471.99	2.2	PVC
647	O2L36SE1	M36E1	2.2	M36A3	-2.4	311.1	0.015	8	0.01	2.24	18.91	864.78	2.2	PVC
4028	O2L3SB1	M3A4	1.4	M3B1	1.9	100.8	0.005	6	0.013	0.78	3.705	170.08	2.2	Vitrified Clay
4066	O2L2SP2	M2P1	0	M2P2	0.5	91.8	0.006	6	0.013	0.9	4.2	196.19	2.1	
1463	O2L34SA12	M34A12	1.7	M34A11	1.5	31.8	0.004	8	0.013	0.92	7.613	359.79	2.1	Vitrified Clay
1462	O2L34SA13	M34A13	2.1	M34A12	1.7	127.9	0.003	8	0.013	0.8	6.563	314.43	2.1	Vitrified Clay
1528	O2L34SC5	M34C5	4.1	M34C4	2.9	308.2	0.004	12	0.013	1.15	21	1010.1	2.1	Vitrified Clay
1182	O1L14SM2	M14M2	2.2	M14M1	-0.4	216.3	0.012	8	0.013	1.51	12.26	591.62	2.1	Vitrified Clay
1068	O1L17SQ0	M17T1	-3.5	M17A1	-7	161.1	0.022	12	0.013	2.67	48.45	2353.3	2.1	
728	O2L3SL2	M3L2	0.9	M3L1	0.4	83.1	0.005	6	0.013	0.82	3.705	181.11	2	Vitrified Clay
4387	O2L32SB2	M32B1	2	M32B2	3	272.8	0.004	8	0.01	1.08	8.699	426.9	2	PVC
3181	O2L30SB6	M30B6	2.7	M30B5	2.2	91.7	0.005	6	0.013	0.84	3.78	186	2	Vitrified Clay
788	O2L2SD2	M2D2	0	M2D1	-1.7	68.4	0.025	6	0.013	1.8	8.1	398.66	2	Vitrified Clay
974	O2L34SF2	M34F3	2.7	M34F2	1.9	281.3	0.003	8	0.013	0.77	6.124	303.34	2	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
947	O2L4SB1	M4B1	2.5	M4A3	0.7	377.4	0.005	6	0.013	0.78	3.465	172.94	2	Vitrified Clay
1214	O1L14SS4	M14S4	3.7	M14S3	2.9	209.4	0.004	8	0.013	0.87	6.84	343.46	2	Vitrified Clay
3190	O2L30SE1	M30E1	1.5	M30B2	0	205.1	0.007	4	0.01	0.95	1.89	94.953	2	PVC
1796	O2L26SA1	M26A1	-0.1	W-26	-0.3	30.7	0.017	6	0.019	0.99	4.41	222.44	2	
798	O2L2SF1	M2F1	0.4	M2C1	-1.8	420.7	0.005	6	0.013	0.81	3.6	182.25	2	Vitrified Clay
638	O2L36SH1	M36H1	3	M36A8	0.2	96.2	0.029	8	0.01	3.01	23.56	1198.8	2	PVC
3900	O2L34SA14	M34A13	2.1	M34A14	2.3	50.2	0.003	8	0.013	0.74	5.775	296.44	1.9	
4417	O2L30SA3	M30A3	0.6	M30A2	-0.2	86.2	0.009	8	0.013	1.25	9.765	501.36	1.9	
1533	O2L34SD1	M34D1	2.9	M34B1	1.7	285.9	0.004	8	0.01	1.13	8.778	451.03	1.9	PVC
3136	O2L34SL2	M34L2	2.3	M34L1	1.6	126.4	0.006	6	0.01	1.1	4.823	248.74	1.9	PVC
1358	O2L16SA7	M16A7	2.8	M16A6	1.1	397.2	0.004	8	0.01	1.14	8.874	458.56	1.9	PVC
3988	O1L37SC1	M14D5	3.5	M14D4	2.8	225.2	0.003	8	0.013	0.04	5.7	298.04	1.9	Vitrified Clay
1314	O1L14SG2	M14G2	3.3	M14G1	2.4	203	0.004	8	0.01	0.05	8.55	448.05	1.9	PVC
1539	O2L34SB4	M34B4	3.5	M34B3	2.9	146.2	0.004	8	0.01	1.13	8.677	455.49	1.9	PVC
3126	O2L29SB2	M29B2	0	M29B1	-1	152.4	0.007	6	0.01	1.18	5.04	265.2	1.9	PVC
3225	O2L18SB2	M18B2	-1.6	M18B1	-2.4	137	0.006	8	0.013	0.05	7.875	422.13	1.9	Vitrified Clay
930	O2L5SA8	M5A8	3.1	M5A7	1.8	281.1	0.005	6	0.013	0.74	3.15	169.28	1.9	Vitrified Clay
709	O2L3SH3	M3H3	1.8	M3H2	1.3	115.2	0.005	6	0.013	0.74	3.135	169.18	1.9	Vitrified Clay
821	O2L1SB3	M1B2	1.2	M1B3	2.4	277.1	0.004	8	0.013	0.88	6.6	357.79	1.8	Vitrified Clay
1531	O2L34SD2	M34D2	3.6	M34D1	2.9	139.4	0.005	8	0.01	1.18	8.778	481.37	1.8	PVC
378	O2L3SG1	M3G1	0.2	M3A2	-1.3	398.5	0.004	8	0.013	0.81	5.985	330.52	1.8	Vitrified Clay
3902	O2L13SA1	W-13	2.7	M13A1	3.2	115.4	0.004	8	0.01	1.14	8.33	464.05	1.8	PVC
1601	O2L38SD2	M38D2	0.7	M38D1	0.2	191.8	0.002	8	0.01	0.83	6.077	341.53	1.8	PVC
671	O2L36SD3	M36D3	3	M36D2	1.9	76.5	0.014	8	0.01	2.03	14.9	837.85	1.8	PVC
967	O2L4SG2	M4G2	5.4	M4G1	3	360.7	0.007	6	0.013	0.88	3.623	205.41	1.8	Vitrified Clay
769	O2L2SJ1	M2A3	0.3	M2J1	0.1	127.5	-0.001	8	0.013	0.02	3.3	192.16	1.7	Vitrified Clay
695	O1L17SL1	M17L1	0.9	M17A8	-2.1	21.4	0.139	8	0.01	6.35	45.04	2631.4	1.7	PVC
636	O2L36SA10	M36A10	1.4	M36A9	1	88	0.005	8	0.01	1.17	8.313	487.09	1.7	PVC
1520	O2L34SC1	M34C1	-1	M34A2	-4.6	374	0.01	12	0.01	2.17	34.42	2030.2	1.7	PVC
640	O2L36SH3	M36H3	6	M36H2	5.1	213.5	0.004	8	0.01	1.12	7.852	465.33	1.7	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
585	O2L7SA4	M7A4	1.3	M7A3	-0.6	364.9	0.005	8	0.013	0.94	6.6	391.35	1.7	Vitrified Clay
757	O2L3SA6	M3A6	2.9	M3A5	1.7	259.6	0.005	6	0.013	0.72	2.85	169.07	1.7	Vitrified Clay
992	O2L34SJ2	M34K1	1.1	M34J1	0.1	182.5	0.006	6	0.013	0.8	3.15	187.35	1.7	Vitrified Clay
934	O2L5SD5	M5D5	3.4	M5D4	2.2	254	0.005	6	0.013	0.72	2.835	169.45	1.7	Vitrified Clay
1569	O1L14SH5	M14H5	5.2	M14H4	4.2	246.4	0.004	8	0.013	0.82	5.7	343.76	1.7	Vitrified Clay
3418	O2L18ASA4	M18A4	-0.9	M18A3	-1.6	164.1	0.004	8	0.013	0.04	5.67	343.92	1.6	Vitrified Clay
4104	O2L1SBB1	M1A7	1.7	M1BB1	2.4	89.8	0.008	6	0.013	0.93	3.6	218.9	1.6	Vitrified Clay
823	O2L1SB4	M1B3	2.4	M1B4	3.5	154.1	0.007	4	0.013	0.7	1.2	73.532	1.6	Vitrified Clay
4477	O2L4SH1	M4H1	2.5	M4A1	0.1	404.3	0.006	6	0.013	0.82	3.15	194.02	1.6	Vitrified Clay
1037	O1L17ST4	M17T4	1.1	M17T3	-2.8	190.2	0.021	12	0.013	2.41	37.05	2289.8	1.6	
1590	O2L16SD2	M16D2	2	M16D1	-0.1	279	0.008	8	0.013	1.11	7.554	470.5	1.6	Vitrified Clay
1310	O1L14SC11	M14C11	3.1	M14C10	2.6	135.7	0.004	8	0.01	0.05	7.125	444.74	1.6	PVC
4009	O2L9SA2	M9A1	-0.3	M9A2	1.1	236.1	0.006	12	0.013	1.29	19.69	1231.2	1.6	
3981	O2L15SA1	W-15	3.5	M15A1	4.5	266.7	0.004	8	0.01	1.01	6.738	431.72	1.6	PVC
894	O2L1SA11	M1A10	5.9	M1A11	6.4	146.8	0.003	8	0.01	0.96	6.25	411.46	1.5	PVC
1437	O2L32SD1	M32D1	1.4	M32A3	1.1	78.3	0.003	8	0.01	0.93	6.02	398.51	1.5	PVC
758	O2L3SA5	M3A5	1.7	M3A4	1.4	87.5	0.004	8	0.013	0.75	4.845	322.82	1.5	Vitrified Clay
3950	O2L29SA3	M29A2	-0.7	M29A3	0.2	149.9	0.006	8	0.01	1.23	7.875	529.4	1.5	PVC
1524	O2L34SC3	M34C3	1.7	M34C2	-0.3	30.9	0.064	8	0.01	4.12	26.4	1782.6	1.5	PVC
4153	O2L1SV1	M1U1	2.6	M1V1	3	43.4	0.009	4	0.013	0.76	1.2	81.985	1.5	Vitrified Clay
711	O2L3SH4	M3H4	2.5	M3H3	1.8	81.3	0.009	4	0.013	0.73	1.14	79.253	1.4	Vitrified Clay
4159	O2L1SS1	M1A4	1	M1S1	1.8	120.9	0.007	6	0.013	0.85	3	208.66	1.4	Vitrified Clay
613	O2L2SA5	M2A5	1.9	M2A4	1.5	124.8	0.004	8	0.013	0.77	4.8	336.41	1.4	Vitrified Clay
3435	O1L37SA1	M37A1	-3.2	W-37	-3.7	8.4	0.056	12	0.01	4.99	69.76	4904.3	1.4	PVC
1739	O2L16SB3	M16B3	-1.5	M16B2	-1.7	50.3	0.004	12	0.013	1.03	14.32	1008.4	1.4	
618	O2L3SD4	M3D4	2	M3D3	1.5	115	0.004	8	0.013	0.8	4.845	350.41	1.4	Vitrified Clay
4428	O2L16SC1	M16A1	-2.8	M16C1	2.2	437.7	0.011	8	0.013	1.3	7.875	576.76	1.4	
4057	O2L2ST1	M2R1	1.8	M2T1	2.3	85.8	0.006	6	0.013	0.8	2.7	198.53	1.4	Vitrified Clay
4030	O2L3SB2	M3B1	1.9	M3B2	2.8	214	0.005	6	0.013	0.68	2.28	169.53	1.3	Vitrified Clay
4271	O2L4SG3	M4G2	5.4	M4G3	6.2	100.2	0.008	6	0.013	0.9	2.993	224.99	1.3	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1542	O2L34SB1	M34B1	1.7	M34A1	-5.5	102.4	0.071	8	0.01	4.2	24.8	1873.1	1.3	PVC
1039	O1L17SV1	M17V1	1.8	M17T4	1.1	162.6	0.005	12	0.013	1.07	14.25	1086	1.3	
4162	O2L1SS2	M1S1	1.8	M1S2	2.5	60.4	0.012	4	0.013	0.82	1.2	91.915	1.3	Vitrified Clay
1095	O1L17SP2	M17P2	4.1	M17P1	2.9	316.4	0.004	8	0.01	0.98	5.7	441.35	1.3	PVC
1097	O1L17SP3	M17P3	4.5	M17P2	4.1	90	0.004	8	0.01	0.99	5.7	445.84	1.3	PVC
3644	O2L18ASA1	M18A-A1	-1	W-18A	-4	21.7	0.139	12	0.013	5.51	76	5961.7	1.3	
980	O2L34SH2	M34H1	-0.2	M34H2	0.9	195.1	0.006	6	0.013	0.74	2.363	186.95	1.3	Vitrified Clay
835	O2L1SH3	M1H2	3.3	M1H3	3.6	46.6	0.007	4	0.013	0.64	0.9	71.885	1.3	Vitrified Clay
1773	O2L30SA5	M30A5	2.2	M30A4	1.4	174.9	0.004	8	0.013	0.77	4.41	355.13	1.2	Vitrified Clay
1093	O1L17SP1	M17P1	2.9	M17A1	-7	91.4	0.108	8	0.01	5.02	28.5	2316.4	1.2	PVC
3144	O2L34SL3	M34L3	2.9	M34L2	2.3	91.7	0.006	6	0.01	0.99	3.09	254.72	1.2	PVC
4098	O2L1SHH1	M1A9	3	M1HH1	3.5	77.2	0.006	6	0.013	0.77	2.4	198.6	1.2	Vitrified Clay
4050	O2L2SR3	M2R2	3.2	M2R3	3.7	81.2	0.006	6	0.013	0.77	2.4	198.81	1.2	Vitrified Clay
3320	O2L24SA2	M24A2	-1	M24A1	-1.6	142.9	0.004	6	0.013	0.62	1.89	159.05	1.2	Vitrified Clay
755	O2L3SA7	M3A7	3.5	M3A6	2.9	148.7	0.005	6	0.013	0.65	1.995	169.06	1.2	Vitrified Clay
819	O2L1SF1	M1F1	2.5	M1B2	1.2	315.9	0.004	8	0.013	0.76	4.2	356.39	1.2	Vitrified Clay
806	O2L2SC3	M2C3	0.9	M2C2	-1.3	422.1	0.005	6	0.013	0.7	2.1	182.37	1.2	Vitrified Clay
800	O2L2SF2	M2F2	2.1	M2F1	0.4	318	0.005	6	0.013	0.69	2.1	183.59	1.1	Vitrified Clay
649	O2L36SE2	M36E2	6	M36E1	2.2	273.3	0.014	8	0.01	1.76	9.457	827	1.1	PVC
1786	O2L30SA1	M30A1	-0.9	W-30	-5.5	19.7	0.23	8	0.013	5.12	29.61	2601.4	1.1	
581	O2L7SA6	M7A6	4.9	M7A5	3.3	302.5	0.005	6	0.013	0.69	2.1	184.85	1.1	Vitrified Clay
1046	O1L17ST7	M17T7	2.4	M17T6	2.1	93.7	0.004	12	0.013	0.95	11.4	1004.7	1.1	
1048	O1L17ST6	M17T6	2.1	M17T5	1.8	68.2	0.004	12	0.013	0.95	11.4	1006.3	1.1	
3948	O2L10SA1	W-10	4.4	M10A1	5.5	238.1	0.005	6	0.01	0.83	2.479	222.53	1.1	PVC
1708	O2L38SC2	M38C1	-0.6	M38C2	1	264.1	0.006	12	0.013	1.18	13.94	1252.3	1.1	
1400	O1L17SC1	M17C1	3.7	M17B3	3.4	65.6	0.004	12	0.013	0.03	11.4	1025.7	1.1	
901	O2L23SB2	M23B2	3.5	M23B1	1.9	401.3	0.004	8	0.013	0.72	3.792	342.43	1.1	Vitrified Clay
3410	O2L18SE2	M18E2	-0.6	M18E1	-1.8	282.2	0.004	8	0.013	0.02	3.78	343.2	1.1	Vitrified Clay
827	O2L1SH1	M1B3	2.4	M1H1	2.9	94.6	0.006	8	0.013	0.86	4.5	409.82	1.1	Vitrified Clay
584	O2L7SA5	M7A5	3.3	M7A4	1.3	399.6	0.005	8	0.013	0.8	4.2	383.71	1.1	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
978	O2L34SH1	M34F1	0.8	M34H1	-0.2	109.3	-0.01	8	0.013	0.04	5.775	530.12	1.1	Vitrified Clay
3984	O1L37SC2	M37C1	-2.6	M37C2	-1.4	255.1	0.005	8	0.01	1.03	5.221	497.45	1	PVC
4122	O2L1SEE1	M1BB1	2.4	M1EE1	2.9	49.2	0.01	4	0.013	0.71	0.9	86.119	1	Vitrified Clay
1049	O1L17ST5	M17T5	1.8	M17T4	1.1	145.9	0.005	12	0.013	1.02	11.4	1107.6	1	
1232	O1L14SBB1	M14BB1	3.3	M14A11	2	308.7	0.004	8	0.013	0.7	3.42	342.62	1	Vitrified Clay
1190	O1L14SM4	M14M4	4.3	M14M3	3	319.5	0.004	8	0.013	0.7	3.42	343.3	1	Vitrified Clay
1246	O1L14SZ1	M14Z1	4.2	M14A10	1.2	321.9	0.009	8	0.013	1.05	5.13	519.69	1	Vitrified Clay
1508	O2L18ASD1	M18A-D1	2.5	M18A-A6	1.2	315.6	0.004	8	0.01	0.91	4.41	447.27	1	PVC
4072	O2L2SJ2	M2J1	0.1	M2J2	1	78.1	0.012	4	0.013	0.74	0.9	91.672	1	Vitrified Clay
3428	O2L25SA1	M25A1	-1	W-25	-5.9	50.8	0.097	12	0.013	4.35	48.25	4982.7	1	
722	O2L3SL3	M3L3	1.7	M3L2	0.9	125.3	0.007	6	0.013	0.74	1.995	207.43	1	Vitrified Clay
764	O2L2SB2	M2B2	2	M2B1	1	179.7	0.006	6	0.013	0.67	1.8	187.85	1	Vitrified Clay
1360	O2L16SA8	M16A8	3.5	M16A7	2.8	165.8	0.005	8	0.01	0.96	4.568	477.36	1	PVC
4004	O2L13SA2	M13A1	3.2	M13A2	4.5	310.7	0.004	8	0.013	0.7	3.334	350.8	1	
4107	O2L1SKK1	M1BB1	2.4	M1KK1	3.5	48.2	0.023	4	0.013	1.03	1.2	129.03	0.9	Vitrified Clay
611	O2L2SO1	M2O1	2.4	M2A4	1.5	315.3	0.003	8	0.013	0.59	2.7	297.71	0.9	Vitrified Clay
782	O2L2SI1	M2I1	4	M2D4	3	162	0.006	4	0.013	0.53	0.6	67.101	0.9	Vitrified Clay
1148	O1L14SJ1	M14J1	-1.9	M14A4	-2.9	254.3	0.004	8	0.01	0.03	3.99	446.55	0.9	PVC
1362	O2L16SA9	M16A9	3.9	M16A8	3.5	76.3	0.005	8	0.01	1.01	4.568	516.97	0.9	PVC
1218	O1L14SS5	M14S5	4.7	M14S4	3.7	280	0.004	8	0.013	0.63	2.85	324.1	0.9	Vitrified Clay
380	O2L3SG2	M3G2	1.7	M3G1	0.2	419.3	0.004	8	0.013	0.63	2.85	324.4	0.9	Vitrified Clay
4105	O2L1SBB2	M1BB1	2.4	M1BB2	3	127.3	0.005	6	0.013	0.6	1.5	172.91	0.9	Vitrified Clay
619	O2L3SE1	M3E1	2.4	M3D3	1.5	300.9	0.003	8	0.013	0.58	2.565	296.6	0.9	Vitrified Clay
4032	O2L3SB3	M3B2	2.8	M3B3	3.3	104.3	0.005	6	0.013	0.58	1.425	169.07	0.8	Vitrified Clay
1317	O1L17SQ5	M17Q5	5.3	M17Q4	4.1	301.2	0.004	8	0.013	0.66	2.85	340.88	0.8	Vitrified Clay
4112	O2L1SBB3	M1BB2	3	M1BB3	3.9	118.3	0.008	4	0.013	0.57	0.6	74.498	0.8	Vitrified Clay
614	O2L2SA6	M2A6	2.8	M2A5	1.9	296.5	0.003	8	0.013	0.57	2.4	298.8	0.8	Vitrified Clay
1774	O2L30SI1	M30I1	2	M30A4	1.4	69.2	0.009	4	0.013	0.6	0.63	79.509	0.8	Vitrified Clay
1754	O2L31SB4	M31B4	3.4	M31B3	1.7	470.5	0.004	12	0.013	0.83	7.72	975.16	0.8	
355	O1L17SJ2	M17J2	4.8	M17J1	3.7	259	0.004	8	0.01	0.86	3.563	451.05	0.8	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
812	O2L2SR2	M2R2	3.2	M2R1	1.8	334.5	0.004	8	0.013	0.67	2.7	355.61	0.8	Vitrified Clay
1035	O1L17SU1	M17U1	-2.3	M17T3	-2.8	61.2	0.009	12	0.013	1.25	11.4	1501.6	0.8	
4160	O2L1SU1	M1S1	1.8	M1U1	2.6	83.5	0.01	6	0.013	0.81	1.8	246.46	0.7	Vitrified Clay
909	O2L5SB1	M5B1	3	M5A3	-2.4	287.8	0.019	6	0.013	1.14	2.52	345.61	0.7	Vitrified Clay
1770	O2L30SA6	M30A6	2.7	M30A5	2.2	104.2	0.005	6	0.013	0.57	1.26	174.43	0.7	Vitrified Clay
3903	O2L5SC1	M5A1	-2.9	M5C1	2	250.8	0.02	6	0.013	1.15	2.52	352.74	0.7	Vitrified Clay
1158	O1L14SL1	M14L1	0.1	M14A5	-2.4	327.2	0.007	8	0.01	1.11	4.275	607.64	0.7	PVC
1142	O1L14SI1	M14I1	-0.8	M14A4	-2	306.5	0.004	8	0.01	0.82	3.135	446.62	0.7	PVC
4208	O2L30SA6	M30A7	2.8	M30A6	2.7	29.1	0.005	6	0.013	0.59	1.26	180.73	0.7	Vitrified Clay
4234	O2L7SC4	M7C3	0.7	M7C4	3	468.5	0.005	6	0.013	0.57	1.2	176.44	0.7	Vitrified Clay
1366	O2L16SG1	M16G1	2.5	M16A6	1.1	320.9	0.004	12	0.013	0.84	7.088	1048.7	0.7	
4034	O2L3SB4	M3B3	3.3	M3B4	3.6	62.9	0.005	6	0.013	0.55	1.14	171.05	0.7	Vitrified Clay
4229	O2L25SJ1	M25B2	0.9	M25J1	3	400.1	0.005	6	0.013	0.58	1.2	181.15	0.7	Vitrified Clay
766	O2L2SB1	M2B1	1	M2A2	-1.3	308.4	0.007	8	0.013	0.83	3	467.41	0.6	Vitrified Clay
1077	O1L17SG1	M17H3	4.5	M17H2	3	366.1	0.004	8	0.01	0.79	2.85	445.26	0.6	PVC
1771	O2L30SK1	M30K1	3.1	M30A5	2.2	70.4	0.014	4	0.013	0.71	0.63	99.254	0.6	Vitrified Clay
1772	O2L30SJ1	M30J1	3.5	M30A5	2.2	99	0.014	4	0.013	0.71	0.63	99.722	0.6	Vitrified Clay
3172	O2L30SC1	M30C1	-0.5	M30A1	-0.9	29.6	0.014	6	0.013	0.95	1.89	300.19	0.6	Vitrified Clay
1204	O1L14SX1	M14X1	2	M14S1	1	246.8	0.004	8	0.013	0.61	2.138	341.77	0.6	Vitrified Clay
1737	O2L16SH1	M16H1	-1.9	M16B1	-2	32.1	0.004	12	0.013	0.8	6.3	1017.5	0.6	
4214	O2L25SD1	M25C1	0.6	M25D1	2.3	116.5	0.014	4	0.013	0.72	0.63	102.26	0.6	Vitrified Clay
831	O2L1SI1	M1H1	2.9	M1H2	3.3	61.4	0.007	8	0.013	0.78	2.7	444.36	0.6	Vitrified Clay
771	O2L2SL1	M2L1	0.6	M2J1	0.1	86	0.006	6	0.013	0.62	1.2	197.66	0.6	Vitrified Clay
1236	O1L14SAA2	M14AA1	3.9	M14A10	1.2	248.8	0.011	8	0.013	1	3.42	568.69	0.6	Vitrified Clay
617	O2L3SD4	M3D5	4	M3D4	2	318.4	0.006	8	0.013	0.75	2.565	426.62	0.6	Vitrified Clay
955	O2L4SD1	M4D1	3.5	M4A4	1.2	332.6	0.007	6	0.013	0.65	1.26	210.31	0.6	Vitrified Clay
4198	O2L34SA15	M34A15	3.3	M34A14	2.3	255.6	0.004	8	0.01	0.77	2.625	445.41	0.6	PVC
1423	O2L34SE2	M34E2	1.5	M34E1	-0.9	213.2	0.011	6	0.01	1.08	2.042	349.5	0.6	PVC
4238	O2L7SM1	M7C2	-0.1	M7M1	3	463.4	0.007	6	0.013	0.63	1.2	205.96	0.6	Vitrified Clay
904	O2L23SA2	M17A2	2.1	M17A1	0.3	327.5	0.006	8	0.013	0.7	2.333	404.28	0.6	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1150	O1L14SJ2	M14J2	-0.7	M14J1	-1.9	303.7	0.004	8	0.01	0.77	2.565	445.06	0.6	PVC
1368	O2L16SG2	M16G2	3.4	M16G1	2.5	220.8	0.004	8	0.013	0.62	2.048	361.35	0.6	
4287	O1L14SC7	M14C6	0.5	M14E1	4.8	106.4	0.041	6	0.013	0.03	2.85	508.53	0.6	
972	O2L34SF2	M34F4	3.4	M34F3	2.7	291.5	0.002	12	0.013	0.59	4.286	772.29	0.6	
4388	O2L32SB1	M32B1	2	W-32	0	46.8	0.043	12	0.013	2.5	17.97	3305.6	0.5	
1335	O1L40SB2	M40A1	1.2	M40B2	1.9	188.5	0.004	8	0.01	0.77	2.45	453.49	0.5	PVC
1775	O2L30SH1	M30H1	3.1	M30A4	1.4	86.1	0.02	4	0.013	0.81	0.63	120.01	0.5	Vitrified Clay
3166	O2L30SA11	M30A11	4.4	M30A10	4	70.5	0.005	4	0.013	0.4	0.315	60.183	0.5	Vitrified Clay
1220	O1L14ST1	M14T1	3.1	M14S2	2.1	276.9	0.004	8	0.013	0.56	1.71	332.36	0.5	Vitrified Clay
4149	O2L1SU2	M1U1	2.6	M1U2	3.6	52.8	0.019	4	0.013	0.78	0.6	117.52	0.5	Vitrified Clay
1734	O2L16SF1	M16F1	3	M16B2	-1.7	436	0.011	8	0.013	0.93	2.858	560.08	0.5	
4175	O2L1SK1	M1E2	0.7	M1K1	2	66.3	0.02	6	0.013	1.05	1.8	353.44	0.5	Vitrified Clay
790	O2L2SE1	M2E1	2	M2D1	-1.7	414.5	0.009	6	0.013	0.7	1.2	238.36	0.5	Vitrified Clay
753	O2L3SA8	M3A8	4.3	M3A7	3.5	166.7	0.005	6	0.013	0.5	0.855	170.04	0.5	Vitrified Clay
1234	O1L14SBB2	M14BB2	4.2	M14BB1	3.3	246.9	0.004	8	0.013	0.57	1.71	342.35	0.5	Vitrified Clay
1176	O1L14SN1	M14N1	0.9	M14M1	-0.4	327.3	0.004	8	0.013	0.57	1.71	342.87	0.5	Vitrified Clay
4207	O2L30SA8	M30A8	3.1	M30A7	2.8	52.5	0.006	6	0.013	0.56	0.945	190.42	0.5	Vitrified Clay
1733	O2L16SE1	M16E1	3	M16B1	-2	435.3	0.012	8	0.013	0.96	2.858	581.84	0.5	
762	O2L2SB2	M2B3	3	M2B2	2	176.5	0.006	6	0.013	0.55	0.9	189.57	0.5	Vitrified Clay
228	O1L17SJ3	M17J3	5.2	M17J2	4.8	51.5	0.009	6	0.01	0.87	1.425	302.67	0.5	PVC
385	O2L23SA1	M17A1	0.3	W-23	-6.4	11	0.608	12	0.013	8.78	58.63	12469	0.5	
4044	O2L2SG1	M2F2	2.1	M2G1	2.8	135	0.006	4	0.013	0.41	0.3	64.717	0.5	Vitrified Clay
4220	O2L25SF1	M25A1	-1	M25F1	2	115.2	0.026	4	0.013	0.9	0.63	137.14	0.5	Vitrified Clay
4091	O2L1SQ1	M1A3	-0.1	M1Q1	2	86.1	0.024	6	0.013	1.12	1.8	392.33	0.5	Vitrified Clay
4224	O2L25SI1	M25B1	0.3	M25I1	3	105.6	0.026	4	0.013	0.9	0.63	137.33	0.5	Vitrified Clay
3106	O2L34SO1	M34O1	2.9	M34A9	0.1	177.4	0.016	6	0.01	1.17	1.89	412.04	0.5	PVC
802	O2L2SF3	M2F3	2.6	M2F2	2.1	89.5	0.006	4	0.013	0.43	0.3	66.799	0.4	Vitrified Clay
3599	O1L37SE1	M37C1	-2.6	M37E1	-1.6	235	0.004	8	0.01	0.75	2.088	471.24	0.4	PVC
3598	O1L37SB1	M37A2	-2.8	M37B1	-1.7	233.9	0.005	8	0.01	0.77	2.088	476.91	0.4	PVC
4118	O2L1SCC2	M1CC1	3.5	M1CC2	4	77.5	0.006	4	0.013	0.43	0.3	68.59	0.4	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
825	O2L1SB5	M1B4	3.5	M1B5	4.5	152.8	0.007	4	0.013	0.43	0.3	69.091	0.4	Vitrified Clay
850	O2L1SOO1	M1JJ1	1.7	M1OO1	4.5	402.4	0.007	6	0.013	0.6	0.9	210.2	0.4	Vitrified Clay
1498	O2L18ASB1	M18A-B1	0.9	M18A-A3	-0.3	279.5	0.004	8	0.01	0.71	1.89	446.28	0.4	PVC
1768	O2L30SA9	M30A9	3.8	M30A8	3.1	198.2	0.004	6	0.013	0.42	0.63	149.65	0.4	Vitrified Clay
1240	O1L14SA12	M14A12	3.5	M14A11	2	375.3	0.004	8	0.013	0.54	1.425	342.87	0.4	Vitrified Clay
1162	O1L14SK1	M14K1	0.6	M14A5	-2.4	260.8	0.012	8	0.01	1.18	3.135	757.49	0.4	PVC
4169	O2L1SM1	M1E1	-0.3	M1M1	2	75.2	0.03	4	0.013	0.9	0.6	147.72	0.4	Vitrified Clay
3520	O2L35SC1	M35A1	-1.3	M35C1	0	95.3	0.014	8	0.01	1.28	3.317	823.44	0.4	PVC
3156	O2L30SL1	M30A7	2.8	M30L1	3.8	118.5	0.008	4	0.013	0.47	0.315	78.474	0.4	Vitrified Clay
4109	O2L1SKK2	M1KK1	3.5	M1KK2	4.5	130.6	0.008	4	0.013	0.45	0.3	74.737	0.4	Vitrified Clay
1192	O1L14SR1	M14R1	4.4	M14M4	4.3	130.4	0.001	6	0.013	0.2	0.285	73.133	0.4	Vitrified Clay
4100	O2L1SII1	M1HH1	3.5	M1II1	5	181.6	0.008	4	0.013	0.48	0.3	77.63	0.4	Vitrified Clay
1144	O1L14SI2	M14I2	0.5	M14I1	-0.8	310.4	0.004	8	0.01	0.69	1.71	447.43	0.4	PVC
4114	O2L1SBB4	M1BB3	3.9	M1BB4	5.1	138.4	0.009	4	0.013	0.49	0.3	79.521	0.4	Vitrified Clay
4185	O2L7SB2	M1D3	3	M1D4	4	114.4	0.009	4	0.013	0.49	0.3	79.857	0.4	Vitrified Clay
4197	O2L34SA16	M34A16	4.9	M34A15	3.3	402.3	0.004	4	0.01	0.43	0.263	70.459	0.4	PVC
4247	O2L7SJ1	M7C1	-0.9	M7J1	4	296.3	0.017	6	0.013	0.87	1.2	323.84	0.4	Vitrified Clay
4068	O2L2SP3	M2P2	0.5	M2P3	3	262.3	0.009	4	0.013	0.5	0.3	82.722	0.4	Vitrified Clay
4102	O2L1SHH2	M1HH1	3.5	M1HH2	5.2	180.7	0.009	4	0.013	0.5	0.3	82.851	0.4	Vitrified Clay
4059	O2L2ST2	M2T1	2.3	M2T2	4.2	196	0.01	4	0.013	0.5	0.3	83.315	0.4	Vitrified Clay
3153	O2L34ST1	M34T1	3.5	M34A14	2.3	287.1	0.004	4	0.01	0.44	0.263	73.273	0.4	PVC
4200	O2L29SA4	M29A3	0.2	M29A4	1.1	166	0.006	8	0.01	0.8	1.89	527.72	0.4	PVC
4078	O2L2SB2	M2B3	3	M2B4	4	102.3	0.01	4	0.013	0.51	0.3	84.454	0.4	Vitrified Clay
4061	O2L2SU1	M2T1	2.3	M2U1	3.5	125.5	0.01	4	0.013	0.51	0.3	84.562	0.4	Vitrified Clay
4054	O2L2SS1	M2R3	3.7	M2S1	4.7	101.9	0.01	4	0.013	0.51	0.3	85.33	0.4	Vitrified Clay
4036	O2L3SB5	M3B4	3.6	M3B5	4.4	85.4	0.009	4	0.013	0.49	0.285	81.087	0.4	Vitrified Clay
751	O2L3SA9	M3A9	5.2	M3A8	4.3	99.2	0.009	4	0.013	0.49	0.285	81.353	0.4	Vitrified Clay
4157	O2L1SW1	M1V1	3	M1W1	4	98.6	0.01	4	0.013	0.52	0.3	86.013	0.3	Vitrified Clay
3108	O2L34SO2	M34O2	3.3	M34O1	2.9	118.2	0.003	6	0.01	0.49	0.63	183.2	0.3	PVC
591	O2L7SG2	M7G2	5.6	M7G1	3.9	342.6	0.005	6	0.013	0.47	0.6	177.4	0.3	

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
223	O1L17SK1	M17K1	5.6	M17J2	4.8	50.6	0.017	6	0.01	1.12	1.425	421.99	0.3	PVC
566	O2L7SD5	M7D5	6.1	M7D4	4.4	340.5	0.005	6	0.013	0.47	0.6	177.93	0.3	
594	O2L7SF2	M7F2	5.8	M7F1	4.1	338.4	0.005	6	0.013	0.47	0.6	178.48	0.3	
4420	O2L30SD1	M30A2	-0.2	M30D1	2	201.5	0.011	8	0.013	0.84	1.89	565.04	0.3	Vitrified Clay
1541	O2L34SB5	M34B5	4.3	M34B4	3.5	176.1	0.005	8	0.01	0.7	1.58	475.18	0.3	PVC
713	O2L3SH5	M3H4	2.5	M3H5	4	149.7	0.01	4	0.013	0.51	0.285	85.772	0.3	Vitrified Clay
3164	O2L30SA10	M30A10	4	M30A9	3.8	35.3	0.006	6	0.013	0.5	0.63	189.65	0.3	Vitrified Clay
815	O2L1SG1	M1G1	4	M1F1	2.5	130.2	0.011	4	0.013	0.54	0.3	91.187	0.3	Vitrified Clay
3427	O2L24SA1	M24A1	-1.6	W-24	-3.9	70.8	0.033	12	0.013	1.55	9.45	2895	0.3	
4120	O2L1SDD1	M1CC1	3.5	M1DD1	4	42.2	0.012	4	0.013	0.55	0.3	93.003	0.3	Vitrified Clay
1152	O1L14SJ3	M14J3	0.3	M14J2	-0.7	247	0.004	8	0.01	0.64	1.425	446.35	0.3	PVC
1188	O1L14SQ1	M14Q1	4.3	M14M3	3	115	0.011	6	0.013	0.7	0.855	268.8	0.3	Vitrified Clay
4093	O2L1SQ2	M1Q1	2	M1Q2	3.5	122	0.012	4	0.013	0.56	0.3	94.728	0.3	Vitrified Clay
4205	O2L29SB3	M29B3	2	M29B2	0	401.7	0.005	8	0.01	0.71	1.575	497.47	0.3	PVC
3138	O2L34SM1	M34M1	2.8	M34L2	2.3	85.6	0.006	6	0.01	0.64	0.788	256.41	0.3	PVC
1422	O2L34SE1	M34A6	-1.9	M34E1	-0.9	335.6	0.003	10	0.01	0.62	2.042	687.31	0.3	PVC
1279	O2L22SB2	M22B2	2.5	M22B1	1.2	179.2	0.007	6	0.013	0.53	0.63	213.64	0.3	
3094	O2L29SA1	M29A1	-1.6	W-29	-5.9	16.2	0.267	12	0.013	4.7	24.26	8266.1	0.3	
575	O2L7SH1	M7H1	4.7	M7D2	1.8	426.1	0.007	6	0.013	0.51	0.6	207.04	0.3	Vitrified Clay
4453	O2L38SA7	M38A6	-1.1	M38A7	-0.5	81.2	0.007	8	0.01	0.84	1.715	596	0.3	PVC
4151	O2L1SU3	M1U2	3.6	M1U3	4.5	58.4	0.015	4	0.013	0.58	0.3	105.99	0.3	Vitrified Clay
4212	O2L25SC2	M25C1	0.6	M25C2	2.3	212.1	0.008	6	0.013	0.55	0.63	223.47	0.3	Vitrified Clay
1041	O1L17SV2	M17V2	2.8	M17V1	1.8	228.9	0.004	12	0.013	0.63	2.85	1013.8	0.3	
1738	O2L16SB4	M16B4	5	M16B3	-1.5	334.2	0.019	12	0.013	1.37	6.242	2221.4	0.3	
4095	O2L1SR1	M1Q1	2	M1R1	4	122.7	0.016	4	0.013	0.59	0.3	109.04	0.3	Vitrified Clay
715	O2L3SI1	M3I1	4	M3H3	1.8	143.3	0.015	4	0.013	0.57	0.285	106.05	0.3	Vitrified Clay
4006	O2L10SA2	M10A1	5.5	M10A2	6	103.8	0.005	6	0.013	0.43	0.467	174.81	0.3	
4124	O2L1SEE2	M1EE1	2.9	M1EE2	4	62.7	0.018	4	0.013	0.61	0.3	113.11	0.3	Vitrified Clay
982	O2L34SH3	M34H2	0.9	M34H3	2.5	261.6	0.006	6	0.013	0.48	0.525	199.95	0.3	Vitrified Clay
4179	O2L1SK2	M1K1	2	M1K2	4.5	137.6	0.018	4	0.013	0.62	0.3	115.13	0.3	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
574	O2L7SI2	M7I2	4.6	M7D1	1	430	0.008	6	0.013	0.56	0.6	231.06	0.3	Vitrified Clay
4177	O2L1SL1	M1K1	2	M1L1	4.5	131	0.019	4	0.013	0.63	0.3	118.02	0.3	Vitrified Clay
4267	O1L37SA4	M37A4	-0.4	M37A5	3	204.8	0.017	6	0.01	1.01	1.044	423.66	0.2	PVC
4216	O2L25SE1	M25A2	-0.4	M25E1	3	293.9	0.012	6	0.013	0.63	0.63	270.86	0.2	Vitrified Clay
3986	O1L37SC3	M37C2	-1.4	M37C3	-0.4	241.4	0.004	8	0.01	0.59	1.044	451.48	0.2	PVC
1289	O2L26SA2	M26A1	0.8	M26A2	2.7	261.3	0.007	6	0.01	0.64	0.63	278.43	0.2	PVC
1242	O1L14SA13	M14A13	5	M14A12	3.5	145.1	0.01	6	0.013	0.59	0.57	256.01	0.2	Vitrified Clay
4195	O2L34SS1	M34A13	2.1	M34S1	3.8	85.5	0.02	4	0.013	0.62	0.263	120.45	0.2	
3146	O2L34SL4	M34L4	3.9	M34L3	2.9	193.5	0.006	6	0.01	0.55	0.525	242.9	0.2	PVC
744	O2L3S132	M3C2	2	M3A4	1.4	213.7	0.003	6	0.013	0.3	0.285	134.54	0.2	Vitrified Clay
984	O2L34SI1	M34I1	1.5	M34H1	-0.2	169.9	0.01	6	0.013	0.58	0.525	253.69	0.2	Vitrified Clay
777	O2L2SL2	M2L2	3	M2L1	0.6	78.1	0.03	4	0.013	0.76	0.3	148.79	0.2	
4415	O2L30SG1	M30A3	0.6	M30G1	2	193.9	0.007	8	0.013	0.6	0.945	468.97	0.2	Vitrified Clay
773	O2L2SM1	M2M1	3	M2L1	0.6	77	0.031	4	0.013	0.76	0.3	149.83	0.2	Vitrified Clay
907	O2L5SB2	M5B2	4	M5B1	3	247.1	0.004	6	0.013	0.36	0.315	160.2	0.2	Vitrified Clay
936	O2L5SA9	M5A9	4.5	M5A8	3.1	319	0.005	6	0.013	0.38	0.315	169.18	0.2	Vitrified Clay
938	O2L5SD6	M5D6	4.6	M5D5	3.4	274.1	0.005	6	0.013	0.38	0.315	169.39	0.2	Vitrified Clay
969	O2L4SA6	M4A6	4	M4A5	1.8	491.3	0.005	6	0.013	0.38	0.315	169.66	0.2	Vitrified Clay
949	O2L4SB2	M4B2	4.3	M4B1	2.5	390	0.005	6	0.013	0.38	0.315	171.56	0.2	Vitrified Clay
3403	O2L18ASA5	M18A5	0.3	M18A4	-0.9	301.5	0.004	8	0.013	0	0.63	343.58	0.2	Vitrified Clay
941	O2L4SH2	M4H2	4	M4H1	2.5	316.8	0.005	6	0.013	0.38	0.315	173.3	0.2	Vitrified Clay
3171	O2L30SC2	M30C2	1.3	M30C1	-0.5	360.4	0.005	6	0.013	0.39	0.315	177.98	0.2	Vitrified Clay
4138	O2L1SAA1	M1A6	1.4	M1AA1	4	65	0.04	4	0.013	0.84	0.3	169.78	0.2	Vitrified Clay
4126	O2L1SEE3	M1EE1	2.9	M1EE3	4	27.8	0.04	4	0.013	0.84	0.3	169.96	0.2	Vitrified Clay
3185	O2L30SM1	M30M1	4	M30B6	2.7	258.1	0.005	6	0.013	0.39	0.315	178.71	0.2	Vitrified Clay
1216	O1L14SW1	M14W1	4.2	M14S4	3.7	118.6	0.004	6	0.013	0.36	0.285	161.86	0.2	Vitrified Clay
4040	O2L2SD5	M2D4	3	M2D5	4.5	322.1	0.005	6	0.013	0.36	0.3	171.84	0.2	Vitrified Clay
3912	O2L7SA7	M7A6	4.9	M7A7	6.1	243.7	0.005	6	0.013	0.37	0.3	176.7	0.2	
1224	O1L14ST2	M14T2	3.4	M14T1	3.1	76.5	0.004	6	0.013	0.35	0.285	167.92	0.2	Vitrified Clay
1364	O2L30SA10	M16A10	5.1	M16A9	3.9	259.9	0.004	8	0.01	0.55	0.788	466.92	0.2	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
573	O2L7SB2	M7B2	4.9	M7B1	3.6	269.8	0.005	6	0.013	0.37	0.3	178.14	0.2	Vitrified Clay
1222	O1L14SU1	M14U1	3.5	M14T1	3.1	85	0.005	6	0.013	0.35	0.285	170.58	0.2	Vitrified Clay
838	O2L1SJJ4	M1JJ4	4.5	M1JJ3	2.7	353.7	0.005	6	0.013	0.37	0.3	181.13	0.2	Vitrified Clay
1206	O1L14SX2	M14X2	3.3	M14X1	2	203.2	0.006	8	0.013	0.51	0.713	432.09	0.2	Vitrified Clay
1248	O1L14SZ2	M14Z2	5.5	M14Z1	4.2	324.6	0.004	8	0.013	0.41	0.57	345.84	0.2	Vitrified Clay
1212	O1L14SV1	M14V1	3.9	M14S3	2.9	244	0.004	8	0.013	0.41	0.57	350.68	0.2	Vitrified Clay
808	O2L2SC4	M2C4	2.3	M2C3	0.9	265.7	0.005	6	0.013	0.38	0.3	184.63	0.2	Vitrified Clay
4070	O2L2SQ1	M2P2	0.5	M2Q1	1.9	253.9	0.005	6	0.013	0.38	0.3	185.02	0.2	Vitrified Clay
1238	O1L14SAA2	M14AA2	4.8	M14AA1	3.9	190	0.004	8	0.013	0.42	0.57	356.31	0.2	Vitrified Clay
4052	O2L2SR4	M2R3	3.7	M2R4	4.7	172.7	0.006	6	0.013	0.39	0.3	188.12	0.2	Vitrified Clay
4232	O2L25SB3	M25B2	0.9	M25B3	5	164.1	0.025	6	0.013	0.81	0.63	396.55	0.2	Vitrified Clay
1244	O1L14SBB3	M14BB3	5.2	M14BB2	4.2	191.8	0.005	6	0.013	0.37	0.285	180.39	0.2	Vitrified Clay
833	O2L1SI1	M1H2	3.3	M1I1	4.5	208.8	0.006	6	0.013	0.39	0.3	190.11	0.2	Vitrified Clay
779	O2L2SN1	M2N1	0.9	M2J1	0.1	139.6	0.006	6	0.013	0.39	0.3	190.42	0.2	Vitrified Clay
4145	O2L1SX1	M1A5	1.1	M1X1	4	57.3	0.05	4	0.013	0.92	0.3	190.78	0.2	Vitrified Clay
4184	O2L7SB2	M1D2	0.9	M1D3	3	413.4	0.005	8	0.013	0.45	0.6	383.21	0.2	Vitrified Clay
4455	O2L38SA8	M38A7	-0.5	M38A8	7	308.6	0.024	8	0.01	1.28	1.715	1099.1	0.2	PVC
994	O2L34SK2	M34K2	3	M34K1	1.1	410	0.005	6	0.013	0.35	0.263	171.43	0.2	Vitrified Clay
844	O2L1SNN1	M1JJ2	2.1	M1NN1	4.5	391.2	0.006	6	0.013	0.4	0.3	196.01	0.2	Vitrified Clay
3183	O2L30SB7	M30B7	3.6	M30B6	2.7	220.4	0.004	6	0.01	0.42	0.315	209.19	0.2	PVC
916	O2L5SC2	M5C2	4	M5C1	2	273	0.007	6	0.013	0.43	0.315	215.53	0.1	Vitrified Clay
1504	O2L18ASC1	M18A-C1	2.3	M18A-A5	0.7	412.6	0.004	8	0.01	0.5	0.63	437.67	0.1	PVC
3123	O2L29SF1	M29F1	2.5	M29B1	-1	194.8	0.018	6	0.01	0.88	0.63	438.83	0.1	PVC
3425	O2L1SC1	M1C1	2	M1A1	-1	105.1	0.029	12	0.013	1.37	3.9	2718.9	0.1	
3408	O2L18SE3	M18E3	1.3	M18E2	-0.6	488.8	0.004	8	0.01	0.51	0.63	446.46	0.1	PVC
840	O2L1SKK1	M1JJ3	2.7	M1KK1	4.5	252.5	0.007	6	0.013	0.43	0.3	214.39	0.1	Vitrified Clay
957	O2L4SE1	M4E1	4	M4D1	3.5	61	0.008	6	0.013	0.45	0.315	227.98	0.1	Vitrified Clay
4155	O2L1SV2	M1V1	3	M1V2	4	15.4	0.065	4	0.013	0.95	0.3	217.54	0.1	Vitrified Clay
4038	O2L3SC1	M3B1	1.9	M3C1	4	35.5	0.061	4	0.013	0.91	0.285	210.32	0.1	Vitrified Clay
4255	O2L24SH1	M24A1	-1.6	M24H1	3	134.3	0.034	6	0.013	0.92	0.63	465.08	0.1	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
4076	O2L2SK1	M2J2	1	M2K1	3	29.5	0.068	4	0.013	0.97	0.3	222.58	0.1	Vitrified Clay
792	O2L2SE2	M2E2	3	M2E1	2	126.6	0.008	6	0.013	0.44	0.3	223.85	0.1	Vitrified Clay
4083	O2L1SO1	M1A2	-0.8	M1O1	2	87.4	0.032	6	0.013	0.89	0.6	448.54	0.1	Vitrified Clay
4249	O2L24SD2	M24D1	-0.9	M24D2	3.7	130.1	0.035	6	0.013	0.94	0.63	473.45	0.1	Vitrified Clay
4074	O2L2SJ3	M2J2	1	M2J3	4	41.9	0.072	4	0.013	0.99	0.3	228.61	0.1	Vitrified Clay
1736	O2L16SH2	M16H2	4.2	M16H1	-1.9	332.4	0.018	12	0.013	1.06	2.829	2162.4	0.1	
4085	O2L1SP1	M1O1	2	M1P1	4	27.7	0.072	4	0.013	0.99	0.3	229.54	0.1	Vitrified Clay
829	O2L1SI1	M1H1	2.9	M1J1	4.5	192.6	0.008	6	0.013	0.45	0.3	229.64	0.1	Vitrified Clay
962	O2L4SA6	M4F1	4	M4A5	1.8	243	0.009	6	0.013	0.48	0.315	242.34	0.1	Vitrified Clay
4189	O2L34SR1	M34A13	2.1	M34R1	3	16	0.056	4	0.013	0.87	0.263	202.47	0.1	Vitrified Clay
4222	O2L25SG1	M25A1	-1	M25G1	8	237.8	0.038	6	0.013	0.96	0.63	489.09	0.1	Vitrified Clay
1160	O1L14SL2	M14L2	1.5	M14L1	0.1	355.4	0.004	8	0.01	0.49	0.57	445.64	0.1	PVC
1164	O1L14SK2	M14K2	1.6	M14K1	0.6	234.1	0.004	8	0.01	0.49	0.57	446.74	0.1	PVC
4147	O2L1SY1	M1A5	1.1	M1Y1	0	14.6	-0.078	4	0.013	0.01	0.3	238.72	0.1	Vitrified Clay
852	O2L1SOO2	M1OO1	4.5	M1OO2	5	55	0.009	6	0.013	0.47	0.3	240.13	0.1	Vitrified Clay
4171	O2L1SN3	M1M1	2	M1N3	4	24.9	0.08	4	0.013	1.04	0.3	241.96	0.1	Vitrified Clay
846	O2L1SLL1	M1JJ2	2.1	M1LL1	4.5	256.3	0.009	6	0.013	0.47	0.3	242.15	0.1	Vitrified Clay
4131	O2L1SFF1	M1A8	1.9	M1FF1	4	25.8	0.082	4	0.013	1.04	0.3	243.89	0.1	Vitrified Clay
4227	O2L25SH1	M25B1	0.3	M25H1	7	157.1	0.043	6	0.013	1	0.63	521.19	0.1	Vitrified Clay
4089	O2L1SO2	M1O1	2	M1O2	4	23.4	0.085	4	0.013	1.06	0.3	249.44	0.1	Vitrified Clay
4026	O2L4SC1	M4A3	0.7	M4C1	4	283.9	0.012	6	0.013	0.52	0.315	271.11	0.1	Vitrified Clay
1184	O1L14SP1	M14P1	3.8	M14M2	2.2	199.4	0.008	8	0.013	0.53	0.57	493.37	0.1	Vitrified Clay
1281	O2L22SE1	M22E1	2.6	M22B1	1.2	208.3	0.007	6	0.01	0.52	0.315	274.09	0.1	PVC
4173	O2L1SM2	M1M1	2	M1M2	4	21.1	0.095	4	0.013	1.11	0.3	262.71	0.1	Vitrified Clay
720	O2L3SL4	M3L4	4	M3L3	1.7	232.3	0.01	6	0.013	0.47	0.285	250.57	0.1	Vitrified Clay
4187	O2L1SH4	M1H3	3.6	M1H4	4.5	71.6	0.012	6	0.013	0.52	0.3	276.09	0.1	Vitrified Clay
959	O2L4SD2	M4D2	4	M4D1	3.5	37	0.014	6	0.013	0.55	0.315	292.76	0.1	Vitrified Clay
1180	O1L14SO1	M14O1	2.5	M14N1	0.9	135	0.012	6	0.013	0.51	0.285	275.52	0.1	Vitrified Clay
3134	O2L29SC2	M29C2	3	M29C1	2	129.4	0.008	8	0.01	0.64	0.63	619.81	0.1	PVC
615	O2L2SA7	M2A7	3.7	M2A6	2.8	300.7	0.003	8	0.013	0.31	0.3	296.71	0.1	Vitrified Clay

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
612	O2L2SO2	M2O2	3.4	M2O1	2.4	316.4	0.003	8	0.013	0.31	0.3	297.16	0.1	Vitrified Clay
4245	O2L7SK1	M7C1	-0.9	M7K1	3	264.7	0.015	6	0.013	0.56	0.3	305.68	0.1	Vitrified Clay
620	O2L3SE2	M3E2	3.3	M3E1	2.4	300.9	0.003	8	0.013	0.3	0.285	296.62	0.1	Vitrified Clay
616	O2L3SD6	M3D6	3.9	M3D5	2.9	314.4	0.003	8	0.013	0.3	0.285	298.11	0.1	Vitrified Clay
996	O2L34SJ2	M34J2	2.5	M34J1	0.1	194.9	0.012	6	0.013	0.5	0.263	280.02	0.1	Vitrified Clay
3952	O2L29SD1	M29A3	0.2	M29D1	4	421.4	0.009	8	0.01	0.68	0.63	672.56	0.1	PVC
4133	O2L1SGG1	M1A8	1.9	M1GG1	4	14.5	0.144	4	0.013	1.31	0.3	324.64	0.1	Vitrified Clay
724	O2L3SM1	M3L2	0.9	M3M1	4.5	238.9	0.015	6	0.013	0.56	0.285	311.28	0.1	Vitrified Clay
3421	O2L18SG1	M18G1	-0.6	M18A3	-1.6	235.8	0.004	8	0.013	0	0.315	344.22	0.1	Vitrified Clay
3416	O2L18SF1	M18F1	-1.5	M18A2	-2.5	237.8	0.004	8	0.013	0	0.315	344.59	0.1	Vitrified Clay
4315	O2L18A	M18C2	3	M18D1	3.2	41.8	0.004	12	0.013	0.45	0.945	1048.7	0.1	
382	O2L3SG3	M3G3	3.1	M3G2	1.7	393.5	0.004	8	0.013	0.32	0.285	323.48	0.1	Vitrified Clay
817	O2L1SF2	M1F1	2.5	M1F2	4	371.7	0.004	8	0.013	0.34	0.3	342.68	0.1	Vitrified Clay
4257	O2L24SA3	M24A2	-1	M24A3	2	142.3	0.021	6	0.013	0.64	0.315	366.3	0.1	Vitrified Clay
730	O2L3SO1	M3O1	5	M3L1	0.4	255.7	0.018	6	0.013	0.59	0.285	337.04	0.1	Vitrified Clay
1194	O1L14SM5	M14M5	5.7	M14M4	4.3	345	0.004	8	0.013	0.34	0.285	343.01	0.1	Vitrified Clay
3119	O2L29SE1	M29E1	4	M29A2	-0.7	403.4	0.012	8	0.01	0.75	0.63	759.38	0.1	PVC
4253	O2L24SG1	M24A1	-1.6	M24G1	4	59.2	0.094	6	0.013	1.34	0.63	772.83	0.1	Vitrified Clay
4140	O2L1SZ1	M1A6	1.4	M1Z1	4	13.6	0.188	4	0.013	1.45	0.3	370.46	0.1	Vitrified Clay
1178	O1L14SN2	M14N2	2.5	M14N1	0.9	79	0.02	6	0.013	0.62	0.285	360.12	0.1	Vitrified Clay
4191	O2L34SP1	M34A12	1.7	M34P1	4	14.4	0.162	4	0.013	1.32	0.263	343.6	0.1	Vitrified Clay
4251	O2L24SA1	M24D1	-0.9	M24E1	5.4	58.1	0.108	6	0.013	1.42	0.63	829.33	0.1	Vitrified Clay
3142	O2L34SM2	M34N1	3.5	M34M1	2.8	55.5	0.012	6	0.01	0.61	0.263	358.36	0.1	PVC
4204	O2L29SB4	M29B4	2.5	M29B3	2	127.8	0.004	8	0.01	0.4	0.315	440.96	0.1	PVC
4210	O2L25SA7	M25A6	1.9	M25A7	3.5	403.5	0.004	8	0.01	0.4	0.315	443.97	0.1	PVC
3398	O2L25SK1	M25K1	2.4	M25A4	1	345.5	0.004	8	0.01	0.41	0.315	445.62	0.1	PVC
727	O2L3SN1	M3N1	-6.1	M3L1	0.4	241.6	-0.027	6	0.013	0	0.285	413.39	0.1	Vitrified Clay
4236	O2L7SC4	M7C3	0.7	M7N1	4	105.9	0.031	6	0.013	0.73	0.3	444.49	0.1	Vitrified Clay
4263	O2L7SB1	M7A1	-5.5	M7B1	3.6	238.5	0.038	12	0.013	1.25	2.1	3118.3	0.1	
3140	O2L34SM2	M34M2	3.8	M34M1	2.8	56.2	0.017	6	0.01	0.68	0.263	429.13	0.1	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1154	O1L14SJ	M14J4	1.4	M14J3	0.3	245	0.004	8	0.01	0.41	0.285	468.11	0.1	PVC
1146	O1L14SI3	M14I3	1.5	M14I2	0.5	226.4	0.004	8	0.01	0.41	0.285	470.9	0.1	PVC
4116	O2L1SCC1	M1BB2	3	M1CC1	3.5	46.8	0.011	12	0.013	0.63	0.9	1652.3	0.1	
4243	O2L7SL1	M7C2	-0.1	M7L1	6	104.9	0.058	6	0.013	0.9	0.3	607.2	0	Vitrified Clay
4259	O2L24SB1	M24A2	-1	M24B1	3	60.7	0.066	6	0.013	0.95	0.315	647.42	0	
3985	O1L37SD1	M37C2	-1.4	M37D1	5	56.1	0.114	8	0.01	1.92	1.044	2376.2	0	PVC
717	O2L3SK1	M3H3	1.8	M3K1	-5.1	102.4	-0.067	6	0.013	0	0.285	652.28	0	Vitrified Clay
4202	O2L29SA5	M29A4	1.1	M29A5	4.6	254.7	0.014	8	0.01	0.65	0.315	827.15	0	PVC
1200	O1L14SY1	M14Y1	4.8	M14A9	0.4	202.7	0.022	8	0.013	0.57	0.285	800.48	0	Vitrified Clay
1226	O1L14SS6	M14S6	5.8	M14S5	4.7	286.6	0.004	12	0.013	0.31	0.285	1004.1	0	
3424	O2L1SC2	M1C2	4	M1C1	2	292.2	0.007	12	0.013	0.37	0.3	1322.9	0	
3132	O2L29SC1	M29C1	2	M29A1	-1.6	16.4	0.218	8	0.01	1.96	0.63	3292.1	0	PVC
4042	O2L2SH1	M2D4	3	M2H1	3.5	25.7	0.019	12	0.013	0.56	0.3	2230.3	0	
4164	O2L1ST1	M1S2	2.5	M1T1	4	60.1	0.025	12	0.013	0.6	0.3	2526.9	0	
4167	O2L1SS3	M1S2	2.5	M1S3	4	57.6	0.026	12	0.013	0.61	0.3	2580.6	0	
4193	O2L34SQ1	M34A12	1.7	M34Q1	3.8	89	0.024	12	0.013	0.57	0.263	2474.3	0	
354	O1L17SM8	M17M8	4.2	M17M7	3.8	110	0.004	8	0.01	0	0	450.94	0	PVC
635	O2L36SA11	M36A11	2.8	M36A10	1.4	339.1	0.004	8	0.01	0	0	454.65	0	PVC
854	O2L1SMM1	M1MM1	4.5	M1JJ1	1.7	270.1	0.01	6	0.013	0	0	256.58	0	Vitrified Clay
1044	O1L17ST8	M17T8	2.8	M17T7	2.4	88.7	0.004	12	0.013	0	0	1004.2	0	
1051	O1L17SU2	M17U2	-1	M17U1	-2.3	275.1	0.005	12	0.013	0	0	1082.2	0	
1063	O1L17SR1	M17R1	1.8	M17Q0	0.6	400	0.003	8	0.013	0	0	299.51	0	Vitrified Clay
1065	O1L17SR2	M17R2	2.9	M17R1	1.8	268.2	0.004	8	0.013	0	0	342.55	0	Vitrified Clay
1067	O1L17SR3	M17R3	3.6	M17R2	2.9	161.2	0.005	8	0.013	0	0	367.43	0	Vitrified Clay
1074	O1L17SS1	M17S1	-1.4	M17Q2	-3.4	391.3	0.005	8	0.013	0	0	381.87	0	Vitrified Clay
1085	O1L17SG2	M17G2	7	M17G1	4.8	398.5	0.006	8	0.01	0	0	527.42	0	PVC
1683	O2L19SA2	M19A2	1.5	M19A1	1	72.8	0.007	12	0.013	0	0	1324.9	0	Vitrified Clay
1684	O2L19SA1	M19A1	1	W-19	-4.4	16.7	0.321	12	0.013	0	0	9058.2	0	Vitrified Clay
3130	O2L29SG1	M29G1	2.5	M29B2	0	130.4	0.019	6	0.01	0	0	453.23	0	PVC
3983	O2L38SD3	M38D2	0.8	M38D3	1.1	72	0.004	8	0.01	0	0	462.79	0	PVC

Model Gravity Sewer Data Table 50 Unit Per Acre Build Out
Exhibit F1

ID	Label	Start Node	Invert (Start) (ft)	Stop Node	Invert (Stop) (ft)	Length (Scaled) (ft)	Slope (Calculated) (ft/ft)	Dia (in)	Manning's (n)	Vel (ft/s)	Flow (gpm)	Capacity (Full Flow) (gpm)	Flow / Capacity (Design) (%)	Material
1515	O2L46SA1	W-46	2	M46A1	2.4	72.7	-0.006	8	0.01	(N/A)	(N/A)	529.48	(N/A)	PVC

EXHIBIT F.2
SEWER MANHOLE DATA TABLE REPORT

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
67	M17A9	8.5	8.5	16416	0	552.09	11.4	563.49	1.15	1.2	FALSE	TRUE
359	M3A1	6.4	6.4	8964	-1.8	355.85	6.225	362.07	0.69	-1.1	FALSE	TRUE
456	M7A1	6.6	8.3	5184	-5.5	179.72	3.6	183.32	2.15	-3.4	FALSE	TRUE
522	M34A1	6.7	6.7	0	-5.5	1913.6	0	1913.6	0.85	-4.6	FALSE	TRUE
533	M14A2	5.6	7.5	0	-3.6	785.55	0	785.55	2.38	-1.2	FALSE	TRUE
534	M14A3	5.9	5.9	0	-2.6	98.119	0	98.119	1.48	-1.1	FALSE	TRUE
535	M14A4	5.6	5.6	2872.8	-3.1	96.124	1.995	98.119	1.94	-1.1	FALSE	TRUE
598	M3D5	6.8	6.8	3283.2	2.9	0.285	2.28	2.565	1.06	4	FALSE	TRUE
712	M3H5	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
723	M3M1	5.5	5.5	410.4	4.5	0	0.285	0.285	0.01	4.5	FALSE	TRUE
725	M3N1	5.6	5.6	410.4	-6.1	0	0.285	0.285	6.58	0.5	FALSE	TRUE
816	M1F2	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
824	M1B5	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
828	M1J1	6	6	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
832	M1I1	5.8	5.8	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
839	M1KK1	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
843	M1NN1	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
845	M1LL1	6.3	6.3	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
851	M1OO2	6.4	6.4	432	5	0	0.3	0.3	0.01	5	FALSE	TRUE
897	M1D4	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
950	M4C1	5.5	5.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	TRUE
973	M34F2	4.8	4.8	36429.05	0.3	53.617	25.298	78.915	1.75	2	FALSE	TRUE
975	M34F1	4.8	4.8	1890	-0.8	84.69	1.3125	86.002	1.78	1	FALSE	TRUE
977	M34H1	3.4	3.4	4158	-0.2	2.8875	2.8875	5.775	1.25	1	FALSE	TRUE
981	M34H3	4.1	4.1	756	2.5	0	0.525	0.525	0.02	2.5	FALSE	TRUE
985	M34A6	4.3	4.3	31753.4	-1.9	343.28	22.051	365.33	0.71	-1.2	FALSE	TRUE
1056	M17A1	8.6	8.6	41040	-7	898.27	28.5	926.77	0.76	-6.2	FALSE	TRUE
1069	M17Q1	6.7	6.7	0	-4	37.05	0	37.05	4.78	0.8	FALSE	TRUE
1071	M17Q2	7.3	7.3	0	-3.4	37.05	0	37.05	4.2	0.8	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1073	M17S1	7	7	0	-1.4	0	0	0	2.26	0.8	FALSE	TRUE
1080	M17A10	8.7	8.7	6156	0.6	532.85	4.275	537.13	2.15	2.7	FALSE	TRUE
1086	M17A12	9.4	9.4	183654	4	0	127.54	127.54	0.84	4.9	FALSE	TRUE
1087	M17A11	8.9	8.9	32832	1.6	468.01	22.8	490.81	3.18	4.7	FALSE	TRUE
1098	M14C5	7.4	7.4	36936	-0.4	276.4	25.65	302.05	7.65	7.2	FALSE	TRUE
1099	M14D1	5.1	5.1	24624	0.4	142.45	17.1	159.55	4.66	5.1	TRUE	TRUE
1101	M14D2	4.9	4.9	16416	1.3	131.05	11.4	142.45	3.67	4.9	TRUE	TRUE
1103	M14D3	5.7	5.7	4104	2.1	105.4	2.85	108.25	2.93	5.1	FALSE	TRUE
1105	M14D4	6.1	6.1	16416	2.8	94.002	11.4	105.4	2.34	5.1	FALSE	TRUE
1107	M14C4	6.2	6.2	364682	-1.4	302.05	253.25	555.3	7.62	6.2	TRUE	TRUE
1109	M14C3	6.4	6.4	29548.8	-2.3	555.3	20.52	575.82	6.95	4.6	FALSE	TRUE
1112	M14C2	6.4	6.4	0	-2.4	575.82	0	575.82	6.76	4.4	FALSE	TRUE
1114	M14C1	6.4	6.4	0	-2.7	687.43	0	687.43	6	3.3	FALSE	TRUE
1121	M14D5	6.3	6.3	8208	3.5	0	5.7	5.7	1.66	5.1	FALSE	TRUE
1123	M14C6	7.1	7.1	4104	0.5	114	2.85	116.85	6.64	7.1	TRUE	TRUE
1125	M14C7	7.4	7.4	12312	1	102.6	8.55	111.15	6.23	7.2	FALSE	TRUE
1127	M14F1	9.2	9.2	16416	1.8	19.95	11.4	31.35	5.46	7.2	FALSE	TRUE
1129	M14F2	0	7.9	16416	2.5	8.55	11.4	19.95	4.71	7.2	FALSE	TRUE
1147	M14J1	5.4	5.4	2052	-1.9	2.565	1.425	3.99	0.78	-1.1	FALSE	TRUE
1155	M14A5	5.2	5.2	7797.6	-2.4	83.584	5.415	88.999	1.29	-1.1	FALSE	TRUE
1171	M14A7	6.4	6.4	6885.6	-1.6	71.393	4.7817	76.174	1.41	-0.2	FALSE	TRUE
1270	M22F1	4.7	4.7	143100	-1.8	0	99.375	99.375	1.79	0	FALSE	TRUE
1274	M22A2	4.8	4.8	20412	-0.8	446.34	14.175	460.51	0.88	0.1	FALSE	TRUE
1284	M22A5	5.4	5.4	240786	2.2	0	167.21	167.21	0.31	2.5	FALSE	TRUE
1288	M26A2	5	5	907.2	2.7	0	0.63	0.63	-0.03	2.7	FALSE	TRUE
1303	M14C8	8.1	8.1	0	1.3	71.25	0	71.25	5.94	7.2	FALSE	TRUE
1305	M14C9	7.3	7.3	53352	1.7	34.2	37.05	71.25	5.49	7.2	FALSE	TRUE
1307	M14C10	7.6	7.6	10260	2.6	7.125	7.125	14.25	4.67	7.2	FALSE	TRUE
1309	M14C11	8.2	8.2	10260	3.1	0	7.125	7.125	4.13	7.2	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1311	M14G1	8	8	16416	2.4	8.55	11.4	19.95	4.79	7.2	FALSE	TRUE
1313	M14G2	8.2	8.2	12312	3.3	0	8.55	8.55	3.97	7.2	FALSE	TRUE
1332	M40A5	9.2	9.2	126831.6	3.7	0	88.078	88.078	0.2	3.9	FALSE	TRUE
1334	M40B2	8	8	3528	4	0	2.45	2.45	-2.03	2	FALSE	TRUE
1386	M37D1	8.1	8.1	1503.6	5	0	1.0442	1.0442	0.02	5	FALSE	TRUE
1393	M17B1	8.8	8.8	0	2.2	210.19	0	210.19	2.56	4.7	FALSE	TRUE
1395	M17B2	9	9	0	2.6	210.19	0	210.19	2.25	4.8	FALSE	TRUE
1397	M17B3	8	8	32832	3.4	187.39	22.8	210.19	1.52	5	FALSE	TRUE
1399	M17C1	7.7	7.7	16416	3.7	0	11.4	11.4	1.25	5	FALSE	TRUE
1401	M17B4	8.1	8.1	0	4	175.99	0	175.99	1.06	5.1	FALSE	TRUE
1464	M34A9	4.4	4.4	3402	0.1	215.54	2.3625	217.91	0.65	0.7	FALSE	TRUE
1476	M39A1	5.9	5.9	22680.42	-1.6	15.75	15.75	31.501	3.6	2	FALSE	TRUE
1480	M39A2	5.9	5.9	22680.42	-0.3	0	15.75	15.75	2.25	2	FALSE	TRUE
1493	M18A-A2	5.1	5.1	0	-0.7	76.004	0	76.004	1.39	0.7	FALSE	TRUE
1495	M18A-A3	5.6	5.6	7257.6	-0.3	70.964	5.04	76.004	0.99	0.7	FALSE	TRUE
1516	M34A3	5.1	5.1	16068.5	-4.4	634.04	11.159	645.2	0.78	-3.6	FALSE	TRUE
1550	M17F1	9.1	9.1	32832	2.8	107.49	22.8	130.29	2.11	4.9	FALSE	TRUE
1552	M17F2	8.9	8.9	0	3.9	107.49	0	107.49	1.1	5	FALSE	TRUE
1554	M17F3	10.9	10.9	70178.4	4	58.754	48.735	107.49	1	5	FALSE	TRUE
1560	M14H1	5.6	5.6	8208	3	17.1	5.7	22.8	1.99	4.9	FALSE	TRUE
1562	M14H2	5.6	5.6	0	3.4	17.1	0	17.1	1.52	4.9	FALSE	TRUE
1564	M14H3	5.6	5.6	4104	3.8	14.25	2.85	17.1	1.15	4.9	FALSE	TRUE
1566	M14H4	5.9	5.9	12312	4.2	5.7	8.55	14.25	0.73	4.9	FALSE	TRUE
1618	M3F3	5.9	5.9	0	3.2	132.9	0	132.9	0.29	3.5	FALSE	TRUE
1707	M38C2	7	7	20071.38	1	0	13.938	13.938	0.07	1.1	FALSE	TRUE
1715	M38B3	7.1	7.1	19609.59	1.5	0	13.618	13.618	0.08	1.6	FALSE	TRUE
3154	M30L1	4.2	4.2	453.6	3.8	0	0.315	0.315	0.02	3.8	FALSE	TRUE
3197	M18A1	5.6	5.6	3628.8	-3.1	132.03	2.52	134.55	4.11	1	FALSE	TRUE
3199	M18B2	5	5	11340	-1.6	0	7.875	7.875	2.57	1	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3223	M18B1	5.1	5.1	10886.4	-2.4	7.875	7.56	15.435	3.4	1	FALSE	TRUE
3303	M24A1	6	6	3628.8	-1.6	6.93	2.52	9.45	0.68	-0.9	FALSE	TRUE
3401	M18A5	6.9	6.9	907.2	0.3	0	0.63	0.63	0.72	1	FALSE	TRUE
3402	M18A4	6.3	6.3	7257.6	-0.9	0.63	5.04	5.67	1.93	1	FALSE	TRUE
3404	M18A2	5.4	5.4	10886.4	-2.5	17.01	7.56	24.57	3.48	1	FALSE	TRUE
3407	M18E2	7.1	7.1	4536	-0.6	0.63	3.15	3.78	1.65	1	FALSE	TRUE
3409	M18E1	6.2	6.2	7257.6	-1.8	3.78	5.04	8.82	2.78	1	FALSE	TRUE
3415	M18F1	6.9	6.9	453.6	-1.5	0	0.315	0.315	2.52	1	FALSE	TRUE
3417	M18A3	5.9	5.9	2721.6	-1.6	5.985	1.89	7.875	2.59	1	FALSE	TRUE
3420	M18G1	6.5	6.5	453.6	-0.6	0	0.315	0.315	1.64	1	FALSE	TRUE
3517	M35B1	6.5	6.5	29716.26	2	0	20.636	20.636	0.1	2.1	FALSE	TRUE
3519	M35C1	6	6	4776.24	0	0	3.3168	3.3168	0.04	0	FALSE	TRUE
3911	M7A7	7.9	7.9	432	6.1	0	0.3	0.3	0.02	6.1	FALSE	TRUE
3951	M29D1	5.1	5.1	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE
3980	M15A1	7	7	9702	4.5	0	6.7375	6.7375	0.06	4.6	FALSE	TRUE
3991	M35A4	6.6	6.6	27561.66	3.6	0	19.14	19.14	0.1	3.7	FALSE	TRUE
4003	M13A2	6.2	6.2	4800.6	4.5	0	3.3337	3.3337	0.05	4.5	FALSE	TRUE
4005	M10A2	9.3	9.3	672	6	0	0.46667	0.46667	0.02	6	FALSE	TRUE
4008	M9A2	5.1	5.1	28350	1.1	0	19.688	19.688	0.09	1.2	FALSE	TRUE
4013	M9B2	5.3	5.3	34020	1.5	0	23.625	23.625	0.11	1.6	FALSE	TRUE
4035	M3B5	5	5	410.4	4.4	0	0.285	0.285	0.01	4.4	FALSE	TRUE
4037	M3C1	5.7	5.7	410.4	4	0	0.285	0.285	0.01	4	FALSE	TRUE
4039	M2D5	5.3	5.3	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4043	M2G1	5.6	5.6	432	2.8	0	0.3	0.3	0.02	2.9	FALSE	TRUE
4051	M2R4	6.2	6.2	432	4.7	0	0.3	0.3	0.02	4.7	FALSE	TRUE
4053	M2S1	6.1	6.1	432	4.7	0	0.3	0.3	0.01	4.8	FALSE	TRUE
4058	M2T2	6.1	6.1	432	4.2	0	0.3	0.3	0.01	4.2	FALSE	TRUE
4060	M2U1	6.2	6.2	432	3.5	0	0.3	0.3	0.01	3.6	FALSE	TRUE
4067	M2P3	6.1	6.1	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4069	M2Q1	6.9	6.9	432	1.9	0	0.3	0.3	0.02	1.9	FALSE	TRUE
4073	M2J3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4075	M2K1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4077	M2B4	5.5	5.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4084	M1P1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4088	M1O2	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4092	M1Q2	5.3	5.3	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	TRUE
4094	M1R1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4099	M1II1	5.8	5.8	432	5	0	0.3	0.3	0.02	5	FALSE	TRUE
4101	M1HH2	5.7	5.7	432	5.2	0	0.3	0.3	0.01	5.2	FALSE	TRUE
4108	M1KK2	6.5	6.5	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	TRUE
4113	M1BB4	5.6	5.6	432	5.1	0	0.3	0.3	0.01	5.1	FALSE	TRUE
4117	M1CC2	6	6	432	4	0	0.3	0.3	0.02	4	FALSE	TRUE
4119	M1DD1	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4123	M1EE2	6.1	6.1	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4125	M1EE3	6	6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4130	M1FF1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4132	M1GG1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4134	M1A6	6.5	6.5	432	1.4	192	0.29999	192.3	0.36	1.8	FALSE	TRUE
4137	M1AA1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4139	M1Z1	6.5	6.5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4141	M1A5	6.5	6.5	432	1.1	192.9	0.3	193.2	0.36	1.5	FALSE	TRUE
4144	M1X1	6.3	6.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4146	M1Y1	6.8	6.8	432	0	0	0.3	0.3	1.5	1.5	FALSE	TRUE
4150	M1U3	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4154	M1V2	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4156	M1W1	6.4	6.4	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4163	M1T1	5.6	5.6	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4166	M1S3	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4170	M1N3	5.3	5.3	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4172	M1M2	5	5	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4176	M1L1	5.1	5.1	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4178	M1K2	5.8	5.8	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4186	M1H4	6.2	6.2	432	4.5	0	0.3	0.3	0.01	4.5	FALSE	TRUE
4188	M34R1	4.4	4.4	378	3	0	0.2625	0.2625	0.01	3	FALSE	TRUE
4190	M34P1	4.8	4.8	378	4	0	0.2625	0.2625	0.01	4	FALSE	TRUE
4192	M34Q1	4.3	4.3	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4194	M34S1	4.7	4.7	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	TRUE
4201	M29A5	5.6	5.6	453.6	4.6	0	0.315	0.315	0.01	4.6	FALSE	TRUE
4209	M25A7	4.1	4.1	453.6	3.5	0	0.315	0.315	0.01	3.5	FALSE	TRUE
4211	M25C2	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4213	M25D1	4.3	4.3	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	TRUE
4215	M25E1	5.3	5.3	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4219	M25F1	4.7	4.7	907.2	2	0	0.63	0.63	0.02	2	FALSE	TRUE
4221	M25G1	10	10	907.2	8	0	0.63	0.63	0.02	8	FALSE	TRUE
4223	M25I1	5.2	5.2	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4226	M25H1	10	10	907.2	7	0	0.63	0.63	0.02	7	FALSE	TRUE
4228	M25J1	5.2	5.2	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4231	M25B3	7.3	7.3	907.2	5	0	0.63	0.63	0.02	5	FALSE	TRUE
4233	M7C4	4.5	4.5	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4235	M7N1	8.2	8.2	432	4	0	0.3	0.3	0.01	4	FALSE	TRUE
4237	M7M1	4.8	4.8	1728	3	0	1.2	1.2	0.03	3	FALSE	TRUE
4240	M7L1	9.9	9.9	432	6	0	0.3	0.3	0.01	6	FALSE	TRUE
4244	M7K1	5.3	5.3	432	3	0	0.3	0.3	0.01	3	FALSE	TRUE
4246	M7J1	8.4	8.4	1728	4	0	1.2	1.2	0.03	4	FALSE	TRUE
4248	M24D2	5.7	5.7	907.2	3.7	0	0.63	0.63	0.02	3.7	FALSE	TRUE
4250	M24E1	8.4	8.4	907.2	5.4	0	0.63	0.63	0.02	5.4	FALSE	TRUE
4252	M24G1	6.8	6.8	907.2	4	0	0.63	0.63	0.02	4	FALSE	TRUE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4254	M24H1	5	5	907.2	3	0	0.63	0.63	0.02	3	FALSE	TRUE
4256	M24A3	4.9	4.9	453.6	2	0	0.315	0.315	0.01	2	FALSE	TRUE
4258	M24B1	5.6	5.6	453.6	3	0	0.315	0.315	0.01	3	FALSE	TRUE
4266	M37A5	5	5	1503.6	3	0	1.0442	1.0442	0.02	3	FALSE	TRUE
4268	M14F3	8.3	8.3	12312	3	0	8.55	8.55	4.22	7.2	FALSE	TRUE
4270	M4G3	9	9	4309.2	6.2	0	2.9925	2.9925	0.04	6.2	FALSE	TRUE
4272	M32C2	5.2	5.2	19879.02	1	0	13.805	13.805	0.09	1.1	FALSE	TRUE
4286	M14E1	8	8	4104	4.8	0	2.85	2.85	2.3	7.1	FALSE	TRUE
4386	M32B2	6	6	12526.5	3	0	8.699	8.699	0.07	3.1	FALSE	TRUE
4414	M30G1	3.4	3.4	1360.8	2	0	0.945	0.945	0.02	2	FALSE	TRUE
4419	M30D1	3.5	3.5	2721.6	2	0	1.89	1.89	0.03	2	FALSE	TRUE
4427	M16C1	4.7	4.7	11340	2.2	0	7.875	7.875	0.06	2.3	FALSE	TRUE
4454	M38A8	10.3	10.3	2469.6	7	0	1.715	1.715	0.03	7	FALSE	TRUE
68	M17J1	8.8	8.8	16416	3.7	3.5625	11.4	14.962	0.09	3.8	FALSE	FALSE
222	M17K1	9.3	9.3	2052	5.6	0	1.425	1.425	0.03	5.6	FALSE	FALSE
226	M17J2	8.8	8.8	1026	4.8	2.85	0.7125	3.5625	0.04	4.8	FALSE	FALSE
227	M17J3	9.2	9.2	2052	5.2	0	1.425	1.425	0.03	5.2	FALSE	FALSE
352	M17M8	7.2	7.2	0	4.2	0	0	0	0	4.2	FALSE	FALSE
353	M17M7	7	7	16416	3.8	0	11.4	11.4	0.07	3.8	FALSE	FALSE
375	M3A2	6.2	6.2	11080.8	-1.3	195.87	7.695	203.57	0.36	-0.9	FALSE	FALSE
377	M3G1	6.1	6.1	4514.4	0.2	2.85	3.135	5.985	0.06	0.3	FALSE	FALSE
379	M3G2	6.2	6.2	3693.6	1.7	0.285	2.565	2.85	0.04	1.7	FALSE	FALSE
381	M3G3	6.4	6.4	410.4	3.1	0	0.285	0.285	0.01	3.1	FALSE	FALSE
384	M17A1	4.4	4.4	18900	0.3	45.5	13.125	58.625	0.15	0.5	FALSE	FALSE
403	M1A1	7.2	7.2	1728	-1	269.25	1.2	270.45	0.34	-0.7	FALSE	FALSE
418	M2A1	5.8	5.8	432	-2.1	64.2	0.3	64.5	0.23	-1.9	FALSE	FALSE
424	M3J1	5.4	5.4	820.8	3	161.96	0.57	162.53	0.28	3.3	FALSE	FALSE
451	M1A9	6.3	6.3	1728	3	185.1	1.2	186.3	0.28	3.3	FALSE	FALSE
523	M34A2	5.7	5.7	20709.15	-4.6	679.62	14.381	694	0.53	-4.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
530	M14A1	6.3	6.3	0	-4	877.46	0	877.46	0.63	-3.3	FALSE	FALSE
545	M7B1	8.4	8.4	2592	3.6	0.3	1.8	2.1	0.03	3.6	FALSE	FALSE
546	M7B2	7.7	7.7	432	4.9	0	0.3	0.3	0.02	4.9	FALSE	FALSE
549	M7A3	6.1	6.1	3888	-0.6	62.933	2.7	65.633	0.19	-0.4	FALSE	FALSE
550	M7D1	6	6	15552	1	45.533	10.8	56.333	0.18	1.2	FALSE	FALSE
551	M7D2	6	6	15552	1.8	28.733	10.8	39.533	0.16	2	FALSE	FALSE
552	M7D3	6.7	6.7	13824	2.7	13.133	9.6	22.733	0.12	2.8	FALSE	FALSE
553	M7E1	7.7	7.7	11136	4.9	0	7.7333	7.7333	0.07	5	FALSE	FALSE
554	M7H1	6.7	6.7	864	4.7	0	0.6	0.6	0.02	4.7	FALSE	FALSE
555	M7I2	6.1	6.1	864	4.6	0	0.6	0.6	0.02	4.6	FALSE	FALSE
559	M7D4	7.4	7.4	6912	4.4	0.6	4.8	5.4	0.06	4.5	FALSE	FALSE
560	M7G2	7.1	7.1	864	5.6	0	0.6	0.6	0.02	5.6	FALSE	FALSE
561	M7F2	7.7	7.7	864	5.8	0	0.6	0.6	0.02	5.8	FALSE	FALSE
564	M7A6	8	8	2592	4.9	0.3	1.8	2.1	0.04	5	FALSE	FALSE
565	M7D5	7.7	7.7	864	6.1	0	0.6	0.6	0.02	6.1	FALSE	FALSE
580	M7A5	7.7	7.7	3024	3.3	2.1	2.1	4.2	0.05	3.3	FALSE	FALSE
583	M7A4	6.6	6.6	3456	1.3	4.2	2.4	6.6	0.06	1.4	FALSE	FALSE
587	M7A2	6.1	6.1	3456	-2	65.633	2.4	68.033	0.19	-1.8	FALSE	FALSE
590	M7G1	6.3	6.3	6912	3.9	0.6	4.8	5.4	0.05	4	FALSE	FALSE
593	M7F1	6.5	6.5	6912	4.1	0.6	4.8	5.4	0.06	4.2	FALSE	FALSE
596	M3D4	6.7	7.5	3283.2	2	2.565	2.28	4.845	0.05	2	FALSE	FALSE
597	M3D3	6.6	6.6	2052	1.5	7.41	1.425	8.835	0.08	1.6	FALSE	FALSE
599	M3D6	6.3	6.3	410.4	3.9	0	0.285	0.285	0.11	4	FALSE	FALSE
600	M2A7	6.4	6.4	432	3.7	0	0.3	0.3	0.02	3.8	FALSE	FALSE
601	M3E1	5.4	5.4	3283.2	2.4	0.285	2.28	2.565	0.04	2.5	FALSE	FALSE
602	M3E2	5.3	5.3	410.4	3.3	0	0.285	0.285	0.02	3.3	FALSE	FALSE
603	M2O2	6.1	6.1	432	3.4	0	0.3	0.3	0.02	3.4	FALSE	FALSE
604	M2A6	6.3	6.3	3024	2.8	0.3	2.1	2.4	0.04	2.9	FALSE	FALSE
605	M2O1	6.1	6.1	3456	2.4	0.3	2.4	2.7	0.05	2.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
606	M2A4	7.3	7.3	3024	1.5	7.5	2.1	9.6	0.08	1.5	FALSE	FALSE
607	M2A5	7.3	7.3	3456	1.9	2.4	2.4	4.8	0.06	2	FALSE	FALSE
608	M2A3	7.1	7.1	3888	0.3	12.9	2.7	15.6	0.08	0.3	FALSE	FALSE
622	M36A11	5.8	5.8	0	2.8	0	0	0	0	2.8	FALSE	FALSE
623	M36A10	5.9	5.9	11970	1.4	0	8.3125	8.3125	0.06	1.5	FALSE	FALSE
624	M36A9	5.7	5.7	11970	1	8.3125	8.3125	16.625	0.09	1.1	FALSE	FALSE
625	M36A8	5.9	5.9	23276.4	0.2	40.18	16.164	56.344	0.17	0.4	FALSE	FALSE
627	M36A6	5.8	5.8	23276.4	-1.7	72.508	16.164	88.673	0.21	-1.4	FALSE	FALSE
628	M36A5	6.4	6.4	23276.4	-2	88.673	16.164	104.84	0.23	-1.7	FALSE	FALSE
629	M36A4	5.9	5.9	11306.4	-2.2	104.84	7.8517	112.69	0.34	-1.9	FALSE	FALSE
630	M36A3	6.1	6.1	24924.06	-2.4	131.6	17.308	148.91	0.27	-2.2	FALSE	FALSE
631	M36E1	7.1	7.1	13617.66	2.2	9.4567	9.4567	18.913	0.09	2.3	FALSE	FALSE
632	M36H1	8.8	8.8	11306.4	3	15.703	7.8517	23.555	0.1	3.1	FALSE	FALSE
633	M36H2	9.3	9.3	11306.4	5.1	7.8517	7.8517	15.703	0.08	5.2	FALSE	FALSE
634	M36H3	9.4	9.4	11306.4	6	0	7.8517	7.8517	0.06	6.1	FALSE	FALSE
641	M36A7	5.6	5.6	23276.4	-0.7	56.344	16.164	72.508	0.19	-0.5	FALSE	FALSE
648	M36E2	7.1	7.1	13617.66	6	0	9.4567	9.4567	0.07	6.1	FALSE	FALSE
650	M36A2	6.2	6.2	11306.4	-4.1	148.91	7.8517	156.76	0.28	-3.8	FALSE	FALSE
652	M36A1	5.8	5.8	76461.84	-5.2	420.64	53.098	473.73	0.43	-4.7	FALSE	FALSE
654	M36B1	6.5	6.5	50449.56	-4	228.84	35.034	263.87	0.37	-3.6	FALSE	FALSE
656	M36C2	5.3	7.9	15466.92	-0.5	69.331	10.741	80.072	0.19	-0.3	FALSE	FALSE
658	M36C3	8.2	8.2	33278.7	3.9	46.221	23.11	69.331	0.18	4.1	FALSE	FALSE
660	M36C4	8.6	8.6	15466.92	5.1	10.741	10.741	21.482	0.1	5.1	FALSE	FALSE
662	M36C5	8.5	10.4	15466.92	6	0	10.741	10.741	0.07	6.1	FALSE	FALSE
664	M36G2	8.9	8.9	17812.2	6	0	12.37	12.37	0.08	6.1	FALSE	FALSE
665	M36G1	8.8	8.8	17811.78	5	12.37	12.369	24.739	0.12	5.1	FALSE	FALSE
668	M36D2	6	6	0	1.9	29.802	0	29.802	0.13	2.1	FALSE	FALSE
670	M36D3	5.9	5.9	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
672	M36F1	5.5	5.5	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
674	M36B6	5.7	5.7	21457.8	3	0	14.901	14.901	0.08	3.1	FALSE	FALSE
675	M36B5	6.5	6.5	0	2.1	14.901	0	14.901	0.08	2.1	FALSE	FALSE
677	M36B3	6.4	8.3	3439.8	-0.1	70.801	2.3888	73.19	0.18	0.1	FALSE	FALSE
679	M36I1	7.1	8.2	2192.4	1.5	41.077	1.5225	42.6	0.14	1.6	FALSE	FALSE
681	M36B2	6.3	6.3	50449.56	-3	73.19	35.034	108.22	0.24	-2.7	FALSE	FALSE
684	M36C1	8.3	8.3	15466.5	-2	80.072	10.741	90.812	0.21	-1.8	FALSE	FALSE
687	M36D1	8.3	8.3	0	1	29.802	0	29.802	0.12	1.1	FALSE	FALSE
690	M36B4	8	8	19152	0.5	14.901	13.3	28.201	0.12	0.7	FALSE	FALSE
693	M17A8	8.4	8.4	0	-2.1	608.53	0	608.53	0.49	-1.6	FALSE	FALSE
694	M17L1	7.7	10.5	0	0.9	45.041	0	45.041	0.14	1	FALSE	FALSE
696	M17L2	8.3	8.3	0	1.2	45.041	0	45.041	0.14	1.3	FALSE	FALSE
698	M17L3	6.7	6.7	10260	1.8	37.916	7.125	45.041	0.14	1.9	FALSE	FALSE
700	M17L4	7.6	7.6	16416	2.3	26.516	11.4	37.916	0.13	2.5	FALSE	FALSE
702	M17L5	7	7	16416	3.6	15.116	11.4	26.516	0.11	3.7	FALSE	FALSE
704	M17L6	7.2	7.2	21766.4	4	0	15.116	15.116	0.08	4.1	FALSE	FALSE
706	M3H2	5.4	5.4	2872.8	1.3	165.66	1.995	167.66	0.34	1.6	FALSE	FALSE
708	M3H3	5.5	5.5	2052	1.8	1.71	1.425	3.135	0.05	1.8	FALSE	FALSE
710	M3H4	4.9	4.9	1231.2	2.5	0.285	0.855	1.14	0.03	2.5	FALSE	FALSE
714	M3I1	5.6	5.6	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
716	M3K1	5.8	5.8	410.4	-5.1	0	0.285	0.285	6.92	1.8	FALSE	FALSE
718	M3L4	5.2	5.2	410.4	4	0	0.285	0.285	0.01	4	FALSE	FALSE
719	M3L3	3.9	3.9	2462.4	1.7	0.285	1.71	1.995	0.03	1.7	FALSE	FALSE
721	M3L2	5.7	5.7	2052	0.9	2.28	1.425	3.705	0.05	0.9	FALSE	FALSE
726	M3L1	5.9	5.9	4514.4	0.4	4.275	3.135	7.41	0.07	0.5	FALSE	FALSE
729	M3O1	6.3	6.3	410.4	5	0	0.285	0.285	0.01	5	FALSE	FALSE
731	M3H1	5.1	5.1	3693.6	-0.1	175.07	2.565	177.63	0.35	0.2	FALSE	FALSE
734	M3A3	6.1	6.1	2462.4	0.4	10.545	1.71	12.255	0.09	0.5	FALSE	FALSE
741	M3A4	5.8	5.8	2462.4	1.4	8.835	1.71	10.545	0.08	1.5	FALSE	FALSE
743	M3C2	5.6	5.6	410.4	2	0	0.285	0.285	0.02	2	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
749	M3A9	5.3	5.3	410.4	5	0	0.285	0.285	0.21	5.2	FALSE	FALSE
750	M3A8	5.4	5.4	820.8	4.3	0.285	0.57	0.855	0.03	4.3	FALSE	FALSE
752	M3A7	5.5	5.5	1641.6	3.5	0.855	1.14	1.995	0.04	3.6	FALSE	FALSE
754	M3A6	5.3	5.3	1231.2	2.9	1.995	0.855	2.85	0.05	2.9	FALSE	FALSE
756	M3A5	6.4	6.4	2872.8	1.7	2.85	1.995	4.845	0.06	1.8	FALSE	FALSE
760	M2B3	5.6	5.6	864	3	0.3	0.6	0.9	0.02	3	FALSE	FALSE
761	M2B2	5.9	5.9	1296	2	0.9	0.9	1.8	0.03	2	FALSE	FALSE
763	M2B1	5.9	5.9	1728	1	1.8	1.2	3	0.04	1	FALSE	FALSE
765	M2A2	6.2	6.2	6912	-1.3	33.9	4.8	38.7	0.15	-1.1	FALSE	FALSE
768	M2J1	6.1	6.1	1296	0.1	2.4	0.9	3.3	0.25	0.4	FALSE	FALSE
770	M2L1	5.7	5.7	864	0.6	0.6	0.6	1.2	0.03	0.7	FALSE	FALSE
772	M2M1	5.9	5.9	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
776	M2L2	6	6	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
778	M2N1	6.1	6.1	432	0.9	0	0.3	0.3	0.02	0.9	FALSE	FALSE
780	M2I1	6	6	864	4	0	0.6	0.6	0.02	4	FALSE	FALSE
781	M2D4	5.5	5.5	3888	3	1.2	2.7	3.9	0.05	3.1	FALSE	FALSE
783	M2D3	5.4	5.4	3456	1.5	3.9	2.4	6.3	0.06	1.6	FALSE	FALSE
785	M2D2	5.4	5.4	2592	0	6.3	1.8	8.1	0.06	0.1	FALSE	FALSE
787	M2D1	5.8	5.8	5184	-1.7	9.3	3.6	12.9	0.08	-1.6	FALSE	FALSE
789	M2E1	5.9	5.9	1296	2	0.3	0.9	1.2	0.03	2	FALSE	FALSE
791	M2E2	5.8	5.8	432	3	0	0.3	0.3	0.01	3	FALSE	FALSE
795	M2C1	5.8	5.8	5184	-1.8	9	3.6	12.6	0.08	-1.7	FALSE	FALSE
797	M2F1	5.7	5.7	2160	0.4	2.1	1.5	3.6	0.05	0.4	FALSE	FALSE
799	M2F2	5.8	5.8	2160	2.1	0.6	1.5	2.1	0.04	2.1	FALSE	FALSE
801	M2F3	6.1	6.1	432	2.6	0	0.3	0.3	0.02	2.6	FALSE	FALSE
803	M2C2	5.6	5.6	4752	-1.3	2.1	3.3	5.4	0.06	-1.3	FALSE	FALSE
805	M2C3	5.7	5.7	2592	0.9	0.3	1.8	2.1	0.04	0.9	FALSE	FALSE
807	M2C4	5.3	5.3	432	2.3	0	0.3	0.3	0.02	2.3	FALSE	FALSE
809	M2R1	5.7	5.7	3888	1.8	5.4	2.7	8.1	0.07	1.8	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
811	M2R2	5.8	5.8	432	3.2	2.4	0.3	2.7	0.04	3.3	FALSE	FALSE
813	M1G1	5.8	5.8	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
814	M1F1	6.1	6.1	5184	2.5	0.6	3.6	4.2	0.05	2.6	FALSE	FALSE
818	M1B2	6	6	4320	1.2	10.8	3	13.8	0.09	1.2	FALSE	FALSE
820	M1B3	5.9	5.9	1296	2.4	5.7	0.9	6.6	0.06	2.4	FALSE	FALSE
822	M1B4	5.6	5.6	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE
826	M1H1	5.8	5.8	2160	2.9	3	1.5	4.5	0.05	2.9	FALSE	FALSE
830	M1H2	5.9	5.9	2160	3.3	1.2	1.5	2.7	0.04	3.3	FALSE	FALSE
834	M1H3	6.1	6.1	864	3.6	0.3	0.6	0.9	0.03	3.7	FALSE	FALSE
836	M1JJ4	6	6	432	4.5	0	0.3	0.3	0.02	4.5	FALSE	FALSE
837	M1JJ3	6.1	6.1	6480	2.7	0.6	4.5	5.1	0.05	2.7	FALSE	FALSE
841	M1JJ2	6.3	6.3	6480	2.1	5.7	4.5	10.2	0.08	2.2	FALSE	FALSE
847	M1JJ1	6.6	6.6	6912	1.7	11.1	4.8	15.9	0.1	1.8	FALSE	FALSE
849	M1OO1	6.3	6.3	864	4.5	0.3	0.6	0.9	0.02	4.5	FALSE	FALSE
853	M1MM1	6.2	6.2	0	4.5	0	0	0	0	4.5	FALSE	FALSE
855	M1D2	6.7	6.7	4320	0.9	16.5	3	19.5	0.11	1	FALSE	FALSE
858	M1B1	6.5	6.5	6912	-0.4	13.8	4.8	18.6	0.1	-0.3	FALSE	FALSE
861	M1E4	6.6	6.6	27000	3	0	18.75	18.75	0.1	3.1	FALSE	FALSE
862	M1E3	5.7	5.7	0	1.5	18.75	0	18.75	0.11	1.6	FALSE	FALSE
864	M1E2	5.4	5.4	1296	0.7	20.55	0.9	21.45	0.11	0.8	FALSE	FALSE
866	M1E1	6.3	6.3	1728	-0.3	22.05	1.2	23.25	0.11	-0.1	FALSE	FALSE
868	M1A2	6.4	6.4	2592	-0.8	223.35	1.8	225.15	0.37	-0.4	FALSE	FALSE
871	M1A4	6.5	6.5	0	1	196.2	0	196.2	0.35	1.3	FALSE	FALSE
882	M1U1	6.1	6.1	0	2.6	1.8	0	1.8	0.03	2.6	FALSE	FALSE
884	M1A7	6.5	6.5	0	1.7	191.4	0	191.4	0.31	2	FALSE	FALSE
886	M1BB2	5.9	5.9	0	3	1.5	0	1.5	0.03	3	FALSE	FALSE
891	M1A10	6.7	6.7	32400	4.3	6.25	22.5	28.75	0.12	4.4	FALSE	FALSE
893	M1A11	8.2	8.2	9000	4.8	0	6.25	6.25	1.64	6.4	FALSE	FALSE
899	M23B2	6.9	6.9	5460	3.5	0	3.7917	3.7917	0.05	3.6	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
900	M23B1	5.4	5.4	56700	1.9	3.7917	39.375	43.167	0.27	2.2	FALSE	FALSE
903	M17A2	6.1	7.8	3360	2.1	0	2.3333	2.3333	0.04	2.2	FALSE	FALSE
905	M5B2	6	6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
906	M5B1	6.4	6.4	3175.2	3	0.315	2.205	2.52	0.04	3	FALSE	FALSE
908	M5A3	6.2	6.2	7711.2	-2.4	13.23	5.355	18.585	0.09	-2.3	FALSE	FALSE
910	M5A2	6	6	4536	-2.7	29.295	3.15	32.445	0.13	-2.5	FALSE	FALSE
913	M5C1	6.4	6.4	3175.2	2	0.315	2.205	2.52	0.04	2	FALSE	FALSE
915	M5C2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
921	M5D3	6.3	6.3	4082.4	0.7	5.04	2.835	7.875	0.07	0.8	FALSE	FALSE
923	M5A4	6	6	3628.8	-0.7	8.19	2.52	10.71	0.08	-0.6	FALSE	FALSE
925	M5A6	5.8	5.8	3628.8	0.5	5.67	2.52	8.19	0.07	0.6	FALSE	FALSE
927	M5A7	6.5	6.5	3628.8	1.8	3.15	2.52	5.67	0.06	1.9	FALSE	FALSE
929	M5A8	6.3	6.3	4082.4	3.1	0.315	2.835	3.15	0.05	3.1	FALSE	FALSE
931	M5D4	6	6	3175.2	2.2	2.835	2.205	5.04	0.06	2.3	FALSE	FALSE
933	M5D5	6.3	6.3	3628.8	3.4	0.315	2.52	2.835	0.04	3.4	FALSE	FALSE
935	M5A9	5.8	5.8	453.6	4.5	0	0.315	0.315	0.02	4.5	FALSE	FALSE
937	M5D6	5.8	5.8	453.6	4.6	0	0.315	0.315	0.02	4.6	FALSE	FALSE
939	M4H2	5.9	5.9	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
940	M4H1	6.4	6.4	4082.4	2.5	0.315	2.835	3.15	0.04	2.5	FALSE	FALSE
944	M4A3	6.7	6.7	7257.6	0.7	17.325	5.04	22.365	0.12	0.8	FALSE	FALSE
946	M4B1	6.1	6.1	4536	2.5	0.315	3.15	3.465	0.05	2.5	FALSE	FALSE
948	M4B2	6.3	6.3	453.6	4.3	0	0.315	0.315	0.02	4.3	FALSE	FALSE
952	M4A4	6.7	6.7	7257.6	1.2	8.505	5.04	13.545	0.1	1.3	FALSE	FALSE
954	M4D1	6.5	6.5	907.2	3.5	0.63	0.63	1.26	0.03	3.5	FALSE	FALSE
956	M4E1	6.4	6.4	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
958	M4D2	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
960	M4F1	6.5	6.5	453.6	4	0	0.315	0.315	0.01	4	FALSE	FALSE
961	M4A5	6.7	6.7	9525.6	1.8	0.63	6.615	7.245	0.07	1.8	FALSE	FALSE
964	M4G1	7.6	7.6	4536	3	3.6225	3.15	6.7725	0.06	3.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
966	M4G2	7.4	7.4	907.2	5.4	2.9925	0.63	3.6225	0.05	5.4	FALSE	FALSE
968	M4A6	7.2	7.2	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
970	M34F4	4.4	4.4	6171.9	1.8	0	4.286	4.286	1.63	3.5	FALSE	FALSE
971	M34F3	4.8	4.8	2646	1.2	4.286	1.8375	6.1235	1.65	2.8	FALSE	FALSE
979	M34H2	5.1	5.1	2646	0.9	0.525	1.8375	2.3625	0.17	1	FALSE	FALSE
983	M34I1	3.4	3.4	756	1.5	0	0.525	0.525	0.02	1.5	FALSE	FALSE
987	M34A7	4.3	4.3	13769	-0.5	245.68	9.5618	255.24	0.42	-0.1	FALSE	FALSE
989	M34J1	3.2	3.2	3780	0.1	3.4125	2.625	6.0375	0.06	0.2	FALSE	FALSE
991	M34K1	4.5	4.5	4158	1.1	0.2625	2.8875	3.15	0.05	1.1	FALSE	FALSE
993	M34K2	4.7	4.7	378	3	0	0.2625	0.2625	0.01	3	FALSE	FALSE
995	M34J2	5	5	378	2.5	0	0.2625	0.2625	0.01	2.5	FALSE	FALSE
997	M34A5	4.2	4.2	0	-2.1	365.33	0	365.33	0.43	-1.6	FALSE	FALSE
999	M34A4	4.1	4.1	0	-3	365.33	0	365.33	0.45	-2.5	FALSE	FALSE
1001	M34E2	7.1	7.1	2940	1.5	0	2.0417	2.0417	0.03	1.5	FALSE	FALSE
1003	M17M6	7.1	7.1	41040	2.5	11.4	28.5	39.9	0.14	2.6	FALSE	FALSE
1005	M17M5	6.8	6.8	16416	1.9	39.9	11.4	51.3	0.15	2	FALSE	FALSE
1007	M17M4	6.8	6.8	0	1	51.3	0	51.3	0.15	1.2	FALSE	FALSE
1009	M17M3	6.8	6.8	16416	0.6	51.3	11.4	62.7	0.17	0.8	FALSE	FALSE
1011	M17M2	6.9	6.9	16416	-0.3	62.7	11.4	74.1	0.19	-0.1	FALSE	FALSE
1013	M17M1	7	7	16416	-0.8	74.1	11.4	85.5	0.2	-0.6	FALSE	FALSE
1015	M17A3	9.6	9.6	2720.8	-6.4	694.03	1.8894	695.92	0.83	-5.6	FALSE	FALSE
1017	M17A6	8	8	0	-3.4	608.53	0	608.53	0.49	-2.9	FALSE	FALSE
1019	M17O3	8.4	8.4	32832	4.1	0	22.8	22.8	0.1	4.2	FALSE	FALSE
1020	M17O2	6.9	6.9	16416	2.9	22.8	11.4	34.2	0.13	3	FALSE	FALSE
1022	M17N1	6.7	6.7	49248	0.1	91.2	34.2	125.4	0.22	0.3	FALSE	FALSE
1024	M17N2	6.9	6.9	32832	3.7	11.4	22.8	34.2	0.13	3.8	FALSE	FALSE
1026	M17N3	6.8	6.8	0	4.7	11.4	0	11.4	0.07	4.7	FALSE	FALSE
1028	M17N4	7.6	7.6	16416	5.3	0	11.4	11.4	0.07	5.3	FALSE	FALSE
1030	M17A2	8	8	0	-6.6	821.32	0	821.32	0.84	-5.8	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1033	M17U1	6.9	6.9	16416	-2.3	0	11.4	11.4	0.06	-2.2	FALSE	FALSE
1034	M17T3	8.1	8.1	0	-2.8	48.45	0	48.45	0.14	-2.7	FALSE	FALSE
1036	M17T4	8.2	8.2	16416	1.1	25.65	11.4	37.05	0.12	1.2	FALSE	FALSE
1038	M17V1	7.1	7.1	16416	1.8	2.85	11.4	14.25	0.08	1.9	FALSE	FALSE
1040	M17V2	6.8	6.8	4104	2.8	0	2.85	2.85	0.04	2.8	FALSE	FALSE
1042	M17T8	8.5	8.5	0	2.8	0	0	0	0	2.8	FALSE	FALSE
1043	M17T7	8	8	16416	2.4	0	11.4	11.4	0.07	2.5	FALSE	FALSE
1045	M17T6	7.2	7.2	0	2.1	11.4	0	11.4	0.07	2.1	FALSE	FALSE
1047	M17T5	7.7	7.7	0	1.8	11.4	0	11.4	0.07	1.9	FALSE	FALSE
1050	M17U2	7.6	7.6	0	-1	0	0	0	0	-1	FALSE	FALSE
1052	M17T2	7	7	0	-3.3	48.45	0	48.45	0.15	-3.2	FALSE	FALSE
1054	M17T1	7.4	7.4	0	-3.5	48.45	0	48.45	0.13	-3.3	FALSE	FALSE
1060	M17Q0	7.2	7.2	31920	0.6	37.05	22.167	59.217	0.17	0.8	FALSE	FALSE
1062	M17R1	6.9	6.9	0	1.8	0	0	0	0	1.8	FALSE	FALSE
1064	M17R2	7.1	7.1	0	2.9	0	0	0	0	2.9	FALSE	FALSE
1066	M17R3	7.6	7.6	0	3.6	0	0	0	0	3.6	FALSE	FALSE
1075	M17H3	8.4	8.4	4104	4.5	0	2.85	2.85	0.04	4.5	FALSE	FALSE
1076	M17H2	8.6	8.6	19494	3	2.85	13.538	16.388	0.09	3.1	FALSE	FALSE
1078	M17H1	8.7	8.7	4104	2.6	16.388	2.85	19.237	0.18	2.7	FALSE	FALSE
1082	M17G1	9.6	9.6	32832	4.8	0	22.8	22.8	0.1	4.9	FALSE	FALSE
1084	M17G2	9.4	9.4	0	7	0	0	0	0	7	FALSE	FALSE
1092	M17P1	7	8.6	32832	2.9	5.7	22.8	28.5	0.11	3	FALSE	FALSE
1094	M17P2	7.4	7.4	0	4.1	5.7	0	5.7	0.05	4.2	FALSE	FALSE
1096	M17P3	8	9.5	8208	4.5	0	5.7	5.7	0.05	4.6	FALSE	FALSE
1141	M14I1	5.4	5.4	2052	-0.8	1.71	1.425	3.135	0.04	-0.8	FALSE	FALSE
1143	M14I2	5.3	5.3	2052	0.5	0.285	1.425	1.71	0.03	0.5	FALSE	FALSE
1145	M14I3	5.8	5.8	410.4	1.5	0	0.285	0.285	0.01	1.5	FALSE	FALSE
1149	M14J2	5.7	5.7	1641.6	-0.7	1.425	1.14	2.565	0.04	-0.7	FALSE	FALSE
1151	M14J3	5.7	5.7	1641.6	0.3	0.285	1.14	1.425	0.03	0.3	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1153	M14J4	5.9	5.9	410.4	1.4	0	0.285	0.285	0.01	1.4	FALSE	FALSE
1157	M14L1	5.5	5.5	5335.2	0.1	0.57	3.705	4.275	0.04	0.1	FALSE	FALSE
1159	M14L2	5.2	5.2	820.8	1.5	0	0.57	0.57	0.02	1.5	FALSE	FALSE
1161	M14K1	5.2	5.2	3693.6	0.6	0.57	2.565	3.135	0.04	0.7	FALSE	FALSE
1163	M14K2	5.6	5.6	820.8	1.6	0	0.57	0.57	0.02	1.6	FALSE	FALSE
1165	M14B1	6.5	6.5	22002	-1.7	76.633	15.279	91.913	0.2	-1.5	FALSE	FALSE
1167	M14B2	5.3	5.3	110352	-1.4	0	76.633	76.633	0.29	-1.1	FALSE	FALSE
1169	M14A6	5.1	5.1	0	-0.5	76.174	0	76.174	0.19	-0.3	FALSE	FALSE
1173	M14M1	5.3	5.3	4924.8	-0.4	13.965	3.42	17.385	0.24	-0.2	FALSE	FALSE
1175	M14N1	5.6	5.6	1641.6	0.9	0.57	1.14	1.71	0.03	0.9	FALSE	FALSE
1177	M14N2	5.5	5.5	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1179	M14O1	5.6	5.6	410.4	2.5	0	0.285	0.285	0.01	2.5	FALSE	FALSE
1181	M14M2	6.6	6.6	4924.8	2.2	8.835	3.42	12.255	0.07	2.2	FALSE	FALSE
1183	M14P1	6.8	6.8	820.8	3.8	0	0.57	0.57	0.02	3.8	FALSE	FALSE
1185	M14M3	7.4	7.4	5745.6	3	4.275	3.99	8.265	0.07	3.1	FALSE	FALSE
1187	M14Q1	7.3	7.3	1231.2	4.3	0	0.855	0.855	0.02	4.3	FALSE	FALSE
1189	M14M4	8	8	4104	4.3	0.57	2.85	3.42	0.05	4.3	FALSE	FALSE
1191	M14R1	7.5	7.5	410.4	4.4	0	0.285	0.285	0.02	4.4	FALSE	FALSE
1193	M14M5	9.1	9.1	410.4	5.7	0	0.285	0.285	0.01	5.7	FALSE	FALSE
1195	M14A8	6.7	6.7	2462.4	-0.6	27.93	1.71	29.64	0.43	-0.2	FALSE	FALSE
1197	M14A9	8	8	2052	0.4	26.505	1.425	27.93	0.13	0.5	FALSE	FALSE
1199	M14Y1	7.8	7.8	410.4	4.8	0	0.285	0.285	0.01	4.8	FALSE	FALSE
1201	M14S1	5.3	5.3	10670.4	1	16.957	7.41	24.368	0.11	1.1	FALSE	FALSE
1203	M14X1	6.4	6.4	2052	2	0.7125	1.425	2.1375	0.04	2	FALSE	FALSE
1205	M14X2	7.3	7.3	1026	3.3	0	0.7125	0.7125	0.02	3.3	FALSE	FALSE
1207	M14S2	5.7	5.7	2872.8	2.1	12.825	1.995	14.82	0.1	2.1	FALSE	FALSE
1209	M14S3	6	6	5335.2	2.9	7.41	3.705	11.115	0.08	2.9	FALSE	FALSE
1211	M14V1	7.6	7.6	820.8	3.9	0	0.57	0.57	0.02	3.9	FALSE	FALSE
1213	M14S4	7.7	7.7	5335.2	3.7	3.135	3.705	6.84	0.07	3.8	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1215	M14W1	7.2	7.2	410.4	4.2	0	0.285	0.285	0.02	4.2	FALSE	FALSE
1217	M14S5	8	8	3693.6	4.7	0.285	2.565	2.85	0.04	4.7	FALSE	FALSE
1219	M14T1	6.3	6.3	1641.6	3.1	0.57	1.14	1.71	0.03	3.1	FALSE	FALSE
1221	M14U1	5.9	5.9	410.4	3.5	0	0.285	0.285	0.02	3.5	FALSE	FALSE
1223	M14T2	6.6	6.6	410.4	3.4	0	0.285	0.285	0.02	3.4	FALSE	FALSE
1225	M14S6	8.8	8.8	410.4	5.8	0	0.285	0.285	0.01	5.8	FALSE	FALSE
1227	M14A10	8.2	8.2	11491.2	1.2	18.24	7.98	26.22	0.12	1.3	FALSE	FALSE
1229	M14A11	8.3	8.3	6976.8	2	4.845	4.845	9.69	0.07	2.1	FALSE	FALSE
1231	M14BB1	8.4	8.4	2462.4	3.3	1.71	1.71	3.42	0.05	3.3	FALSE	FALSE
1233	M14BB2	8.4	8.4	2052	4.2	0.285	1.425	1.71	0.03	4.3	FALSE	FALSE
1235	M14AA1	8.6	8.6	4104	3.9	0.57	2.85	3.42	0.04	4	FALSE	FALSE
1237	M14AA2	8.4	8.4	820.8	4.8	0	0.57	0.57	0.02	4.8	FALSE	FALSE
1239	M14A12	8.9	8.9	1231.2	3.5	0.57	0.855	1.425	0.03	3.6	FALSE	FALSE
1241	M14A13	9	9	820.8	5	0	0.57	0.57	0.02	5	FALSE	FALSE
1243	M14BB3	8.4	8.4	410.4	5.2	0	0.285	0.285	0.02	5.2	FALSE	FALSE
1245	M14Z1	8.4	8.4	6566.4	4.2	0.57	4.56	5.13	0.05	4.2	FALSE	FALSE
1247	M14Z2	8.4	8.4	820.8	5.5	0	0.57	0.57	0.02	5.5	FALSE	FALSE
1269	M22A1	5	5	39480	-1.4	559.89	27.417	587.31	0.48	-0.9	FALSE	FALSE
1276	M22B1	6.2	6.2	146728.8	1.2	0.945	101.9	102.84	0.22	1.4	FALSE	FALSE
1278	M22B2	5.6	5.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
1280	M22E1	5.3	5.3	453.6	2.6	0	0.315	0.315	0.01	2.6	FALSE	FALSE
1282	M22A3	5.2	5.2	24494.4	0.9	326.49	17.01	343.5	0.44	1.4	FALSE	FALSE
1287	M26A1	5.4	5.4	5443.2	0	0.63	3.78	4.41	-0.04	0	FALSE	FALSE
1315	M17Q5	7.6	7.6	4104	5.3	0	2.85	2.85	0.04	5.3	FALSE	FALSE
1316	M17Q4	7.2	7.2	32832	4.1	2.85	22.8	25.65	0.12	4.2	FALSE	FALSE
1318	M17Q3	7.2	7.2	16416	3.3	25.65	11.4	37.05	0.13	3.4	FALSE	FALSE
1325	M40A1	8	8	0	-0.6	90.528	0	90.528	0.21	-0.4	FALSE	FALSE
1326	M40A2	7.9	7.9	0	0.3	88.078	0	88.078	0.1	0.4	FALSE	FALSE
1328	M40A3	8.4	8.4	0	1.5	88.078	0	88.078	0.1	1.6	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1330	M40A4	7.5	7.5	0	2.7	88.078	0	88.078	0.2	2.9	FALSE	FALSE
1347	M34U1	5.1	5.1	15807.75	2.6	0	10.978	10.978	0.08	2.7	FALSE	FALSE
1348	M34L1	4.7	4.7	3250.8	1.6	15.8	2.2575	18.058	0.1	1.7	FALSE	FALSE
1350	M34A8	4.6	4.6	5292	0	235.96	3.675	239.64	0.58	0.6	FALSE	FALSE
1354	M16A5	5.8	5.8	0	0.6	31.711	0	31.711	0.14	0.7	FALSE	FALSE
1355	M16A6	5.4	5.4	22680	1.1	15.961	15.75	31.711	0.12	1.2	FALSE	FALSE
1357	M16A7	6.2	6.2	6200.88	2.8	4.5675	4.3062	8.8737	0.06	2.8	FALSE	FALSE
1359	M16A8	6.1	6.1	0	3.5	4.5675	0	4.5675	0.05	3.6	FALSE	FALSE
1361	M16A9	7	7	5443.2	3.9	0.7875	3.78	4.5675	0.04	4	FALSE	FALSE
1363	M16A10	6.9	6.9	1134	5.1	0	0.7875	0.7875	0.02	5.1	FALSE	FALSE
1365	M16G1	4.2	4.2	7257.6	2.5	2.0475	5.04	7.0875	0.06	2.5	FALSE	FALSE
1367	M16G2	5.5	5.5	2948.4	3.4	0	2.0475	2.0475	0.04	3.5	FALSE	FALSE
1369	M37A4	5.5	5.5	1503.6	-0.4	43.655	1.0442	44.699	0.14	-0.3	FALSE	FALSE
1370	M37A3	5.4	5.4	4510.8	-1.6	44.699	3.1325	47.831	0.15	-1.5	FALSE	FALSE
1372	M37A2	5.3	5.3	9021.6	-2.8	49.92	6.265	56.185	0.16	-2.6	FALSE	FALSE
1374	M37B1	4.8	4.8	3007.2	-1.7	0	2.0883	2.0883	0.03	-1.7	FALSE	FALSE
1376	M37A1	5.7	5.7	0	-3.2	69.759	0	69.759	0.16	-3	FALSE	FALSE
1378	M37C1	6	6	9021.6	-2.6	7.3092	6.265	13.574	0.08	-2.6	FALSE	FALSE
1380	M37E1	5.3	5.3	3007.2	-1.6	0	2.0883	2.0883	0.03	-1.6	FALSE	FALSE
1382	M37C2	6.3	6.3	4510.8	-1.4	2.0883	3.1325	5.2208	0.05	-1.3	FALSE	FALSE
1384	M37C3	5.1	5.1	1503.6	-0.4	0	1.0442	1.0442	0.02	-0.4	FALSE	FALSE
1403	M17B5	9.7	9.7	16416	4.7	164.59	11.4	175.99	0.53	5.2	FALSE	FALSE
1405	M17I1	8.1	8.1	16416	4.9	0	11.4	11.4	0.28	5.2	FALSE	FALSE
1407	M17B6	7.7	7.7	122094	5.6	68.4	84.788	153.19	0.27	5.8	FALSE	FALSE
1409	M17D1	8.1	8.1	16416	6.2	0	11.4	11.4	0.07	6.3	FALSE	FALSE
1411	M17B7	8.1	8.1	16416	6.1	45.6	11.4	57	-0.26	5.9	FALSE	FALSE
1413	M17B9	7.6	7.6	16416	6.5	34.2	11.4	45.6	0.15	6.7	FALSE	FALSE
1415	M17E1	8.6	8.6	16416	7	0	11.4	11.4	0.07	7.1	FALSE	FALSE
1417	M17B10	10.2	10.2	16416	7	11.4	11.4	22.8	0.11	7.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1419	M17B11	10.3	10.3	16416	7.8	0	11.4	11.4	0.07	7.8	FALSE	FALSE
1421	M34E1	5.1	5.1	0	-0.9	2.0417	0	2.0417	0.03	-0.9	FALSE	FALSE
1424	M32A1	5.8	5.8	0	-1.2	59.743	0	59.743	0.17	-1	FALSE	FALSE
1426	M32C1	5.7	5.7	0	0	13.805	0	13.805	-0.31	-0.3	FALSE	FALSE
1430	M32A2	7.2	7.2	21413.28	0.8	31.068	14.87	45.938	0.15	0.9	FALSE	FALSE
1432	M32A3	5.6	5.6	12285	1.1	22.537	8.5313	31.068	0.12	1.3	FALSE	FALSE
1434	M32A4	5.3	5.3	23784.18	1.9	0	16.517	16.517	0.09	2	FALSE	FALSE
1436	M32D1	4.8	4.8	8668.8	1.4	0	6.02	6.02	0.06	1.4	FALSE	FALSE
1440	M31A4	5.5	5.5	22378.02	0.4	0	15.54	15.54	0.11	0.5	FALSE	FALSE
1441	M31A3	7.4	7.4	26877.48	-0.1	15.54	18.665	34.205	0.13	0.1	FALSE	FALSE
1443	M31A2	7.7	7.7	28061.88	-2.3	34.205	19.487	53.693	0.16	-2.1	FALSE	FALSE
1445	M31A1	6.2	6.2	56089.32	-4	86.481	38.951	125.43	0.24	-3.7	FALSE	FALSE
1446	M31B1	5.8	5.8	13608	-0.4	23.338	9.45	32.788	0.12	-0.3	FALSE	FALSE
1449	M31B2	6.3	6.3	8022	0.8	17.767	5.5708	23.338	0.1	0.9	FALSE	FALSE
1451	M31B4	4.3	4.3	11116.56	3.4	0	7.7198	7.7198	0.06	3.5	FALSE	FALSE
1455	M34A13	4.7	4.7	378	2.1	6.3	0.2625	6.5625	0.07	2.2	FALSE	FALSE
1456	M34A11	4.4	4.4	0	1.5	213.13	0	213.13	0.41	1.9	FALSE	FALSE
1458	M34A10	4.4	4.4	756	0.8	213.13	0.525	213.65	0.42	1.2	FALSE	FALSE
1461	M34A12	4.5	4.5	756	1.7	7.0875	0.525	7.6125	0.27	1.9	FALSE	FALSE
1497	M18A-B1	5.3	5.3	2721.6	0.9	0	1.89	1.89	0.03	0.9	FALSE	FALSE
1499	M18A-A4	5.5	5.5	2268	0.2	67.499	1.575	69.074	0.55	0.7	FALSE	FALSE
1501	M18A-A5	5.3	5.3	8164.8	0.7	61.829	5.67	67.499	0.19	0.9	FALSE	FALSE
1503	M18A-C1	8.2	8.2	907.2	2.3	0	0.63	0.63	0.02	2.3	FALSE	FALSE
1505	M18A-A6	5.4	5.4	1360.8	1.2	60.254	0.945	61.199	0.17	1.4	FALSE	FALSE
1507	M18A-D1	9.2	9.2	6350.4	2.5	0	4.41	4.41	0.05	2.5	FALSE	FALSE
1509	M18A-A7	7.7	7.7	1360.8	1.7	54.899	0.945	55.844	0.16	1.9	FALSE	FALSE
1511	M18A-A8	8.3	8.3	2268	2.1	53.324	1.575	54.899	0.16	2.3	FALSE	FALSE
1513	M46A1	4.9	4.9	(N/A)	0.8	(N/A)	(N/A)	(N/A)	(N/A)	(N/A)	FALSE	FALSE
1519	M34C1	6.5	6.5	11550	-1	26.396	8.0208	34.417	0.11	-0.9	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1521	M34C2	7.1	7.1	0	-0.3	26.396	0	26.396	0.11	-0.2	FALSE	FALSE
1523	M34C3	7.2	7.2	5460	1.7	22.604	3.7917	26.396	0.11	1.8	FALSE	FALSE
1525	M34C4	7.6	7.6	2310	2.9	21	1.6042	22.604	0.1	3	FALSE	FALSE
1527	M34C5	8.5	8.5	30240	4.1	0	21	21	0.1	4.2	FALSE	FALSE
1529	M34D2	5.5	5.5	12640.25	3.6	0	8.778	8.778	0.06	3.6	FALSE	FALSE
1530	M34D1	5.7	5.7	0	2.9	8.778	0	8.778	0.06	3	FALSE	FALSE
1532	M34B1	5.8	5.8	8050	1.7	19.205	5.5903	24.795	0.11	1.8	FALSE	FALSE
1534	M34B2	6.7	6.7	0	2.3	10.427	0	10.427	0.07	2.3	FALSE	FALSE
1536	M34B3	5.7	5.7	2520	2.9	8.6771	1.75	10.427	0.07	3	FALSE	FALSE
1538	M34B4	5.3	5.3	10220	3.5	1.5799	7.0972	8.6771	0.06	3.6	FALSE	FALSE
1540	M34B5	6	6	2275	4.3	0	1.5799	1.5799	0.03	4.3	FALSE	FALSE
1556	M17F4	10	10	84606	5.2	0	58.754	58.754	0.19	5.4	FALSE	FALSE
1568	M14H5	5.7	5.7	8208	5.2	0	5.7	5.7	0.06	5.3	FALSE	FALSE
1579	M16B1	6.4	6.4	4116	-2	32.054	2.8583	34.912	0.11	-1.9	FALSE	FALSE
1581	M16B2	6	6	8232	-1.7	17.179	5.7167	22.896	0.12	-1.5	FALSE	FALSE
1583	M16A2	6	6	0	-2.6	95.475	0	95.475	0.19	-2.4	FALSE	FALSE
1585	M16A3	5.4	5.4	11655	-1.4	87.382	8.0938	95.475	0.21	-1.2	FALSE	FALSE
1587	M16D1	6.1	6.1	24347.4	-0.1	7.5542	16.908	24.462	0.12	0	FALSE	FALSE
1589	M16D2	4.8	4.8	10878	2	0	7.5542	7.5542	0.06	2.1	FALSE	FALSE
1591	M16A4	4.1	4.1	44940	-0.3	31.711	31.208	62.92	0.15	-0.1	FALSE	FALSE
1599	M38D2	8	8	8750.7	0.7	0	6.0769	6.0769	0.06	0.7	FALSE	FALSE
1600	M38D1	5.7	5.7	8750.7	0.1	6.0769	6.0769	12.154	0.07	0.2	FALSE	FALSE
1602	M38A6	6	6	8750.7	-1.1	13.869	6.0769	19.946	0.1	-1	FALSE	FALSE
1604	M17O1	6.9	6.9	32832	1.7	34.2	22.8	57	0.16	1.8	FALSE	FALSE
1609	M3D2	6.3	6.3	3283.2	0.6	8.835	2.28	11.115	0.09	0.7	FALSE	FALSE
1611	M3D1	6.4	6.4	2872.8	-0.2	11.115	1.995	13.11	0.1	-0.1	FALSE	FALSE
1614	M3F1	6.6	6.6	4514.4	-0.4	136.04	3.135	139.17	0.29	-0.1	FALSE	FALSE
1616	M3F2	6	6	4514.4	1.5	132.9	3.135	136.04	0.29	1.8	FALSE	FALSE
1680	M19A2	5.2	5.2	0	1.5	0	0	0	0	1.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
1681	M19A1	5.4	5.4	0	1	0	0	0	0	1	FALSE	FALSE
1695	M38A5	4.9	4.9	18901.68	-2.1	19.946	13.126	33.072	0.12	-2	FALSE	FALSE
1697	M38A4	5	5	18901.68	-3.8	33.072	13.126	46.198	0.15	-3.7	FALSE	FALSE
1701	M38A3	5.1	5.1	18901.68	-5.5	46.198	13.126	59.324	0.18	-5.4	FALSE	FALSE
1703	M38A2	6.6	6.6	38973.06	-7.2	100.33	27.065	127.39	0.25	-7	FALSE	FALSE
1705	M38C1	7	7	38973.06	-0.7	13.938	27.065	41.003	0.14	-0.6	FALSE	FALSE
1709	M38A1	6.1	6.1	20090.99	-8.9	168.25	13.952	182.2	0.3	-8.6	FALSE	FALSE
1711	M38B1	6.5	6.5	19609.59	-1.6	27.236	13.618	40.853	0.14	-1.4	FALSE	FALSE
1713	M38B2	7.1	7.1	19609.59	0.1	13.618	13.618	27.236	0.11	0.2	FALSE	FALSE
1717	M16A1	5.9	5.9	15456	-2.8	138.26	10.733	149	0.27	-2.5	FALSE	FALSE
1726	M16H1	6.4	6.4	4998	-1.9	2.8292	3.4708	6.3	0.06	-1.8	FALSE	FALSE
1727	M16F1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1729	M16B4	7.2	7.2	8988	5	0	6.2417	6.2417	0.05	5	FALSE	FALSE
1731	M16B3	7.2	7.2	11634	-1.5	6.2417	8.0792	14.321	0.08	-1.4	FALSE	FALSE
1732	M16E1	5.3	5.3	4116	3	0	2.8583	2.8583	0.04	3	FALSE	FALSE
1735	M16H2	6.7	6.7	4074	4.2	0	2.8292	2.8292	0.03	4.2	FALSE	FALSE
1751	M31B3	5.4	5.4	14468.16	1.7	7.7198	10.047	17.767	0.09	1.7	FALSE	FALSE
1755	M30A9	4.1	4.1	0	3.8	0.63	0	0.63	0.02	3.8	FALSE	FALSE
1756	M30A8	4.4	4.4	453.6	3.1	0.63	0.315	0.945	0.03	3.1	FALSE	FALSE
1757	M30A6	3.3	3.3	0	2.7	1.26	0	1.26	0.03	2.7	FALSE	FALSE
1758	M30K1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1759	M30A5	3.8	3.8	2721.6	2.2	2.52	1.89	4.41	0.05	2.2	FALSE	FALSE
1760	M30J1	4	4	907.2	3.5	0	0.63	0.63	0.02	3.5	FALSE	FALSE
1761	M30A4	3.6	3.6	2721.6	1.4	5.67	1.89	7.56	0.07	1.5	FALSE	FALSE
1762	M30I1	3.4	3.4	907.2	2	0	0.63	0.63	0.02	2	FALSE	FALSE
1763	M30H1	4	4	907.2	3.1	0	0.63	0.63	0.02	3.1	FALSE	FALSE
1764	M30A3	3.7	3.7	1814.4	0.6	8.505	1.26	9.765	0.07	0.6	FALSE	FALSE
1767	M30A1	3.5	3.5	1814.4	-0.9	28.35	1.26	29.61	0.12	-0.8	FALSE	FALSE
1836	M29A1	4.5	4.5	1814.4	-1.6	22.995	1.26	24.255	0.09	-1.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3102	M34G1	5.2	5.2	68390	3.8	0	47.493	47.493	0.16	4	FALSE	FALSE
3105	M34O1	5.3	5.3	1814.4	2.9	0.63	1.26	1.89	0.03	2.9	FALSE	FALSE
3107	M34O2	5	5	907.2	3.3	0	0.63	0.63	0.02	3.3	FALSE	FALSE
3112	M29A2	4.5	4.5	8164.8	-0.7	8.505	5.67	14.175	0.08	-0.6	FALSE	FALSE
3118	M29E1	5.4	5.4	907.2	4	0	0.63	0.63	0.02	4	FALSE	FALSE
3120	M29B1	4.2	4.2	3628.8	-1	5.67	2.52	8.19	0.07	-0.9	FALSE	FALSE
3122	M29F1	4.6	4.6	907.2	2.5	0	0.63	0.63	0.02	2.5	FALSE	FALSE
3125	M29B2	4.5	4.5	4989.6	0	1.575	3.465	5.04	0.05	0.1	FALSE	FALSE
3127	M29B4	4.6	4.6	453.6	2.5	0	0.315	0.315	0.01	2.5	FALSE	FALSE
3129	M29G1	4.5	4.5	0	2.5	0	0	0	0	2.5	FALSE	FALSE
3131	M29C1	5	5	0	2	0.63	0	0.63	0.02	2	FALSE	FALSE
3133	M29C2	5.1	5.1	907.2	3	0	0.63	0.63	0.02	3	FALSE	FALSE
3135	M34L2	4.3	4.3	1360.8	2.3	3.8775	0.945	4.8225	0.05	2.4	FALSE	FALSE
3137	M34M1	4.4	4.4	378	2.8	0.525	0.2625	0.7875	0.02	2.9	FALSE	FALSE
3139	M34M2	4.8	4.8	378	3.8	0	0.2625	0.2625	0.01	3.8	FALSE	FALSE
3141	M34N1	4.5	4.5	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3143	M34L3	4.2	4.2	3693.6	2.9	0.525	2.565	3.09	0.04	2.9	FALSE	FALSE
3145	M34L4	4.4	4.4	756	3.9	0	0.525	0.525	0.02	3.9	FALSE	FALSE
3147	M34A16	5	5	378	4.9	0	0.2625	0.2625	0.01	4.9	FALSE	FALSE
3148	M34A14	4.3	4.3	4158	2.3	2.8875	2.8875	5.775	0.06	2.3	FALSE	FALSE
3152	M34T1	4	4	378	3.5	0	0.2625	0.2625	0.01	3.5	FALSE	FALSE
3155	M30A10	4.6	4.6	453.6	4	0.315	0.315	0.63	0.02	4	FALSE	FALSE
3165	M30A11	4.6	4.6	453.6	4.4	0	0.315	0.315	0.02	4.4	FALSE	FALSE
3168	M30C2	4	4	453.6	1.3	0	0.315	0.315	0.02	1.3	FALSE	FALSE
3170	M30C1	4	4	2268	-0.5	0.315	1.575	1.89	0.03	-0.5	FALSE	FALSE
3174	M30B1	3.2	3.2	1360.8	-0.5	12.6	0.945	13.545	0.08	-0.4	FALSE	FALSE
3176	M30B4	4	4	0	1.7	4.095	0	4.095	0.05	1.8	FALSE	FALSE
3178	M30B5	4.8	4.8	453.6	2.2	3.78	0.315	4.095	0.05	2.3	FALSE	FALSE
3180	M30B6	4.9	4.9	4536	2.7	0.63	3.15	3.78	0.05	2.7	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3182	M30B7	4.1	4.1	453.6	3.6	0	0.315	0.315	0.01	3.6	FALSE	FALSE
3184	M30M1	4.6	4.6	453.6	4	0	0.315	0.315	0.02	4	FALSE	FALSE
3186	M30B2	2.8	2.8	3628.8	0	10.08	2.52	12.6	0.08	0.1	FALSE	FALSE
3189	M30E1	3	3	2721.6	1.5	0	1.89	1.89	0.03	1.5	FALSE	FALSE
3191	M30B3	2.8	2.8	3175.2	1	5.985	2.205	8.19	0.07	1.1	FALSE	FALSE
3194	M30F1	2.6	2.6	2721.6	1.8	0	1.89	1.89	0.04	1.8	FALSE	FALSE
3243	M18C9	5.3	5.3	453.6	3.4	75.334	0.315	75.649	0.19	3.6	FALSE	FALSE
3246	M18C2	5.5	5.5	10432.8	3	76.594	7.245	83.839	0.19	3.2	FALSE	FALSE
3276	M18C1	5.4	5.4	11793.6	2.5	83.839	8.19	92.029	0.21	2.7	FALSE	FALSE
3304	M24D1	7.9	7.9	3628.8	-0.9	1.26	2.52	3.78	0.06	-0.8	FALSE	FALSE
3319	M24A2	5.4	5.4	1814.4	-1	0.63	1.26	1.89	0.11	-0.9	FALSE	FALSE
3328	M25A1	4.6	4.6	5443.2	-1	44.472	3.78	48.252	0.13	-0.8	FALSE	FALSE
3330	M25C1	5.6	5.6	5896.8	0.6	1.26	4.095	5.355	0.05	0.7	FALSE	FALSE
3346	M25A4	4.6	4.6	4536	1	13.977	3.15	17.127	0.09	1.1	FALSE	FALSE
3348	M25A2	5.6	5.6	8618.4	-0.4	23.112	5.985	29.097	0.13	-0.3	FALSE	FALSE
3357	M25B1	5.3	5.3	5896.8	0.3	10.02	4.095	14.115	0.08	0.3	FALSE	FALSE
3364	M7C1	8	8	7344	-0.9	104.49	5.1	109.59	0.23	-0.7	FALSE	FALSE
3377	M7C3	8.3	8.3	9936	0.7	84.461	6.9	91.361	0.21	0.9	FALSE	FALSE
3383	M25B2	5.4	5.4	9979.2	0.9	1.83	6.93	8.76	0.08	1	FALSE	FALSE
3389	M25A5	4	4	453.6	1.5	13.347	0.315	13.662	0.08	1.6	FALSE	FALSE
3391	M25A6	4.6	4.6	18765.6	1.9	0.315	13.032	13.347	0.08	2	FALSE	FALSE
3397	M25K1	4.2	4.2	453.6	2.4	0	0.315	0.315	0.01	2.4	FALSE	FALSE
3406	M18E3	7	7	907.2	1.3	0	0.63	0.63	0.02	1.3	FALSE	FALSE
3422	M1C2	6.7	6.7	432	4	0	0.3	0.3	0.01	4	FALSE	FALSE
3423	M1C1	6.4	6.4	5184	2	0.3	3.6	3.9	0.04	2	FALSE	FALSE
3509	M35A1	6	6	0	-1.3	452.83	0	452.83	0.5	-0.8	FALSE	FALSE
3511	M35A2	6.7	6.7	9904.23	-0.1	83.012	6.8779	89.89	0.21	0.1	FALSE	FALSE
3513	M35A3	6.7	6.7	24740.52	1.5	65.831	17.181	83.012	0.2	1.7	FALSE	FALSE
3515	M35D1	6	6	49581.63	2	0	34.432	34.432	0.13	2.1	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
3642	M18A-A1	5.1	5.1	0	-1	76.004	0	76.004	0.17	-0.8	FALSE	FALSE
3682	M22A4	5.5	5.5	0	1.6	326.49	0	326.49	0.54	2.1	FALSE	FALSE
3901	M13A1	5.5	5.5	7194.6	3.2	3.3337	4.9963	8.33	0.06	3.3	FALSE	FALSE
3947	M10A1	9.3	9.3	2898	5.5	0.46667	2.0125	2.4792	0.04	5.5	FALSE	FALSE
3949	M29A3	4.6	4.6	7711.2	0.2	2.52	5.355	7.875	0.06	0.2	FALSE	FALSE
3982	M38D3	6.5	6.5	0	1.1	0	0	0	0	1.1	FALSE	FALSE
3989	M35A4	6.8	6.8	17653.86	2.7	19.14	12.26	31.4	0.12	2.8	FALSE	FALSE
4007	M9A1	6.9	6.9	71442	-0.3	66.938	49.613	116.55	0.24	-0.1	FALSE	FALSE
4011	M9B1	5.8	5.8	34020	0.5	23.625	23.625	47.25	0.15	0.6	FALSE	FALSE
4017	M5D1	6	6	0	-1	10.71	0	10.71	0.07	-1	FALSE	FALSE
4019	M5D2	6.2	6.2	4082.4	-0.8	7.875	2.835	10.71	0.08	-0.8	FALSE	FALSE
4022	M5A1	6.4	6.4	3175.2	-2.9	34.965	2.205	37.17	0.14	-2.8	FALSE	FALSE
4024	M4A2	7.5	7.5	0	0.3	22.365	0	22.365	0.11	0.4	FALSE	FALSE
4027	M3B1	5.7	5.7	1641.6	1.9	2.565	1.14	3.705	0.05	1.9	FALSE	FALSE
4029	M3B2	5.8	5.8	1231.2	2.8	1.425	0.855	2.28	0.04	2.9	FALSE	FALSE
4031	M3B3	5.5	5.5	410.4	3.3	1.14	0.285	1.425	0.03	3.3	FALSE	FALSE
4033	M3B4	5.4	5.4	1231.2	3.6	0.285	0.855	1.14	0.03	3.6	FALSE	FALSE
4041	M2H1	5.5	5.5	432	3.5	0	0.3	0.3	0.01	3.5	FALSE	FALSE
4049	M2R3	5.9	5.9	2592	3.7	0.6	1.8	2.4	0.04	3.8	FALSE	FALSE
4056	M2T1	5.9	5.9	3024	2.3	0.6	2.1	2.7	0.04	2.3	FALSE	FALSE
4062	M2P1	6	6	4320	0	12.3	3	15.3	0.09	0.1	FALSE	FALSE
4065	M2P2	6.1	6.1	5184	0.5	0.6	3.6	4.2	0.05	0.6	FALSE	FALSE
4071	M2J2	6.4	6.4	432	1	0.6	0.3	0.9	0.02	1	FALSE	FALSE
4079	M1A3	6.4	6.4	2160	-0.1	198	1.5	199.5	0.34	0.3	FALSE	FALSE
4082	M1O1	5.5	5.5	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4090	M1Q1	5.4	5.4	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4097	M1HH1	5.6	5.6	2592	3.5	0.6	1.8	2.4	0.04	3.5	FALSE	FALSE
4103	M1BB1	6.3	6.3	0	2.4	3.6	0	3.6	0.04	2.4	FALSE	FALSE
4106	M1KK1	6.8	6.8	1296	3.5	0.3	0.9	1.2	0.03	3.5	FALSE	FALSE

Model Manhole Data Table 50 Unit Per Acre Build-Out
Exhibit F2

ID	Label	Elev (Grd) (ft)	Elevation (Rim) (ft)	Base Load (Local Sanitary) (gpd)	Elev (Invt) (ft)	Flow (Total In) (gpm)	Flow (Local In) (gpm)	Flow (Total Out) (gpm)	Depth (Out) (ft)	Hydraulic Grade Line (Out) (ft)	Is Overflowing?	Is Surcharged?
4111	M1BB3	5.9	5.9	432	3.9	0.3	0.3	0.6	0.02	3.9	FALSE	FALSE
4115	M1CC1	6.3	6.3	432	3.5	0.6	0.3	0.9	0.02	3.5	FALSE	FALSE
4121	M1EE1	6.2	6.2	432	2.9	0.6	0.3	0.9	0.02	2.9	FALSE	FALSE
4127	M1A8	6.4	6.4	1296	1.9	186.9	0.89999	187.8	0.29	2.2	FALSE	FALSE
4148	M1U2	5.8	5.8	432	3.6	0.3	0.3	0.6	0.02	3.6	FALSE	FALSE
4152	M1V1	6.4	6.4	864	3	0.6	0.6	1.2	0.03	3	FALSE	FALSE
4158	M1S1	6.2	6.2	0	1.8	3	0	3	0.04	1.8	FALSE	FALSE
4161	M1S2	5.7	5.7	864	2.5	0.6	0.6	1.2	0.03	2.5	FALSE	FALSE
4168	M1M1	5.3	5.3	0	2	0.6	0	0.6	0.02	2	FALSE	FALSE
4174	M1K1	5.1	5.1	1728	2	0.6	1.2	1.8	0.03	2	FALSE	FALSE
4180	M1D1	7	7	3024	-0.2	19.5	2.1	21.6	0.11	-0.1	FALSE	FALSE
4183	M1D3	6.4	6.4	432	3	0.3	0.3	0.6	0.02	3	FALSE	FALSE
4196	M34A15	4	4	3402	3.3	0.2625	2.3625	2.625	0.04	3.3	FALSE	FALSE
4199	M29A4	4.7	4.7	2268	1.1	0.315	1.575	1.89	0.03	1.1	FALSE	FALSE
4203	M29B3	4.6	4.6	1814.4	2	0.315	1.26	1.575	0.03	2	FALSE	FALSE
4206	M30A7	3.7	3.7	0	2.8	1.26	0	1.26	0.03	2.8	FALSE	FALSE
4217	M25A3	4.2	4.2	0	0.2	17.127	0	17.127	0.09	0.3	FALSE	FALSE
4239	M7C2	8.6	8.6	14580	-0.1	92.861	10.125	102.99	0.24	0.1	FALSE	FALSE
4280	M17A4	9.5	9.5	0	-6.3	608.53	0	608.53	0.79	-5.6	FALSE	FALSE
4283	M17A5	8.4	8.4	0	-5.7	608.53	0	608.53	0.69	-5	FALSE	FALSE
4314	M18D1	5.2	5.2	1360.8	3.2	0	0.945	0.945	0.03	3.2	FALSE	FALSE
4384	M32B1	6.3	6.3	13356	2	8.699	9.275	17.974	0.08	2.1	FALSE	FALSE
4416	M30A2	3.6	3.6	1814.4	-0.2	11.655	1.26	12.915	0.08	-0.1	FALSE	FALSE
4452	M38A7	6.3	6.3	0	-0.5	1.715	0	1.715	0.03	-0.5	FALSE	FALSE
4476	M4A1	7.5	7.5	17628	0.1	32.288	12.242	44.529	0.16	0.3	FALSE	FALSE

EXHIBIT F.3
FORCEMAIN DATA TABLE REPORT

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3880	O1L42FB2	PMP-42a	O1L42J1		25	6.4	2	0.013	111.61	111.61	11.4	10	114%	6.74
3494	O2L19FB2	PMP-19B	O1L34J2	Steel	342	8.2	8	0.013	1747.5	1747.5	11.15	10	112%	28.55
3495	O2L19F2	O1L34J2	O2L19J1	Steel	49	6.8	8	0.013	1747.5	1747.5	11.15	10	112%	4.09
3508	O2L19F1	O2L19J1	O2L34J2	Ductile Iron		20.7	8	0.012	1747.5	1747.5	11.15	10	112%	1.06
3489	O2L34F1	O1L34J1	O-2	Ductile Iron		17.4	12	0.012	3723.9	3723.9	10.56	10	106%	0.5
3507	O2L34F2	O2L34J2	O1L34J1	Ductile Iron		23.9	12	0.012	3552.1	3552.1	10.08	10	101%	0.63
1744	O2L31FA2	PMP-31A	O2L31J2	Steel	77	8	3	0.013	201.26	201.26	9.13	10	91%	26.91
3919	O2L45FA2	PMP-45a	O2L45J2	PVC	25	7.6	2	0.01	86.238	86.238	8.81	10	88%	4.18
3921	O2L45F2	O2L45J1	O2L45J2	PVC		39.6	2	0.01	-86.238	-86.238	8.81	10	88%	6.62
3720	O2L18A-F1	O2L18AJ1	M18C9	PVC		71.5	2	0.01	75.334	75.334	7.69	10	77%	9.31
3650	O2L36F2	O2L36J2	O2L36J1	Ductile Iron		585.8	8	0.013	1194.8	1194.8	7.63	10	76%	14.88
3652	O2L36F1	M34A1	O2L36J1	Ductile Iron		48	8	0.012	-1194.8	-1194.8	7.63	10	76%	1.22
527	O2L34FA2	PMP-34A	O2L34J6	Ductile Iron	154	11.3	8	0.012	1150.9	1150.9	7.35	10	74%	3.65
2455	O2L34F5	O2L34J5	O2L34J4	Ductile Iron		2007	8	0.012	1150.9	1150.9	7.35	10	74%	47.56
3624	O2L34F6	O2L34J6	O2L34J5	Ductile Iron		46.9	8	0.012	1150.9	1150.9	7.35	10	74%	1.11
1296	O2L26F1	O2L26J1	M22A4	PVC		142.1	3	0.01	159.28	159.28	7.23	10	72%	10.27
1792	O2L26FB2	PMP-26B	O2L26J1	Steel	79	10.1	3	0.013	159.28	159.28	7.23	10	72%	9.28
446	O2L6FA2	PMP-6A	O2L6J1		74	6.9	3	0.013	153.95	153.95	6.99	10	70%	5.02
3077	O2L16FA2	PMP-16A	O2L16J2	Ductile Iron	77	7.6	4	0.012	269.04	269.04	6.87	10	69%	10.94
3739	O2L16F2	O2L16J2	O2L16J1	PVC		363.9	4	0.01	269.04	269.04	6.87	10	69%	17.1
3811	O2L32F1	O2L32J1	M34A3	PVC		681.8	4	0.01	268.71	268.71	6.86	10	69%	31.97
474	O1L14FA1	PMP-14A	O1L14J3	Steel	134	7.5	6	0.013	547.15	547.15	6.21	10	62%	5.29
3606	O1L14FA2	W-14	PMP-14A	Ductile Iron	44	7.8	6	0.012	547.15	547.15	6.21	10	62%	1.07
4399	O2L47F2	O2L47J2	O2L47J1	PVC		13.6	2	0.01	56.842	56.842	5.8	10	58%	1.05
4410	O2L47FB1	PMP-47B	O2L47J2	PVC	40	7.3	2	0.01	56.842	56.842	5.8	10	58%	3.09
3942	O2L33F2	O2L33J2	O2L33J1	PVC		32.6	2	0.01	56.531	56.531	5.77	10	58%	2.49
3944	O2L33FA2	PMP-33A	O2L33J2	Steel	70	5.9	2	0.013	56.531	56.531	5.77	10	58%	8.7
3821	O2L7FA2	PMP-7A	O2L7J2	Ductile Iron	104	7.6	4	0.012	213.42	213.42	5.45	10	55%	3.18
3825	O2L7F2	O2L7J2	O2L7J1	PVC		31.1	4	0.01	213.42	213.42	5.45	10	55%	0.95

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3927	O2L46FA2	PMP-46a	O2L46J1	PVC	25	6.3	2	0.01	53.324	53.324	5.45	10	55%	1.72
3932	O2L46F1	O2L46J1	M18A-A8	PVC		213.3	2	0.01	53.324	53.324	5.45	10	55%	14.64
3587	O2L44F2	O1L44J2	O1L44J1	PVC		124.3	2	0.01	52.785	52.785	5.39	10	54%	8.37
3695	O2L44FA2	PMP-44a	O1L44J2	PVC	25	7.1	2	0.01	52.785	52.785	5.39	10	54%	1.68
217	O2L11F1	O2L11J1	O2L10J2	PVC		477.6	6	0.01	455.24	455.24	5.17	10	52%	8.25
477	O2L10F2	O2L10J2	O2L10J1	PVC		613.4	6	0.01	455.24	455.24	5.17	10	52%	10.59
3964	O2L10F1	O2L10J1	O2L36J3	Ductile Iron		287.1	6	0.012	455.24	455.24	5.17	10	52%	4.96
3664	O2L31F2	O2L31J2	O2L31J1	PVC		1088.2	4	0.01	201.26	201.26	5.14	10	51%	29.87
3506	O2L34F3	O2L34J3	O2L34J2	Ductile Iron		21.1	12	0.012	1804.6	1804.6	5.12	10	51%	0.16
3089	O2L29FA2	PMP-29A	O2L29J2	Steel	78	11.7	3	0.013	104.88	104.88	4.76	10	48%	7.74
3095	O2L29F2	O2L29J2	O2L29J1	PVC		12.7	3	0.01	104.88	104.88	4.76	10	48%	0.42
1691	O2L22A2	PMP-22A	O2L22J2	Steel	113	7.5	4	0.013	183.34	183.34	4.68	10	47%	4.24
3716	O2L22F1	O2L22J2	O2L22J1	PVC		973.6	4	0.013	183.34	183.34	4.68	10	47%	22.48
216	O2L12F1	O2L12J1	O2L11J1	PVC		333.4	6	0.01	409.22	409.22	4.64	10	46%	4.73
4402	O2L47F1	O2L47J1	M34A11	PVC		559.7	3	0.01	100.64	100.64	4.57	10	46%	17.28
3725	O2L18F4	O2L18J3	O2L18J2	Ductile Iron		170.7	3	0.012	97.859	97.859	4.44	10	44%	5.01
163	O2L18F1	O2L18J1	O2L36J2	Ductile Iron		130.4	8	0.012	689.45	689.45	4.4	10	44%	1.2
3730	O2L18F3	O2L18J2	O2L18J1	Cast iron		1013.7	8	0.012	689.45	689.45	4.4	10	44%	13.04
3527	O2L35FA2	PMP-35A	O2L35J2	Steel	90	6.9	4	0.013	171.8	171.8	4.39	10	44%	3
3529	O2L35F2	O2L35J2	O2L35J1	PVC		9.4	4	0.01	171.8	171.8	4.39	10	44%	0.19
3536	O2L35F1	O2L35J1	O1L34J1	PVC		2583.6	4	0.01	171.8	171.8	4.39	10	44%	52.9
3975	O1L43FA1	PMP-43a	O1L43J1	PVC	25	7.5	2	0.01	42.611	42.611	4.35	10	44%	1.13
3978	O1L43F1	O1L43J1	M37A4	PVC		533.5	2	0.01	42.611	42.611	4.35	10	44%	24.17
4470	O2L48F1	O2L48J1	M36I1	PVC		570.6	2	0.01	41.077	41.077	4.19	10	42%	24.15
1798	O1LS14F1	O1L14J1	O-1	PVC		10.5	10	0.01	1019.9	1019.9	4.17	10	42%	0.07
423	O2L2F1	O2L2J1	M3J1	Asbestos Cement		569.4	4	0.011	161.96	161.96	4.13	10	41%	12.47
3865	O2L2FA2	PMP-2A	O2L2J1	Ductile Iron	112	10.6	4	0.012	161.96	161.96	4.13	10	41%	2.06
390	O2L23FB2	PMP-23B	O2L23F1	Steel	84	8.2	3	0.013	89.097	89.097	4.04	10	40%	3.37
3979	O2L22F1	O2L22J1	O2L34J3	Ductile Iron		348.7	8	0.012	619.27	619.27	3.95	10	40%	2.62

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3830	O2L6F1	O2L6J1	M1A9	PVC		631.6	4	0.01	153.95	153.95	3.93	10	39%	10.55
464	O1L17FB2	W-17	PMP-17B	Steel	21.1	9.5	6	0.013	333.17	333.17	3.78	10	38%	0.33
3728	O2L1F1	O2L1J1	O2L18J2	Cast iron		255.1	8	0.012	591.6	591.6	3.78	10	38%	2.47
427	O2L25FA2	PMP-25A	O2L25J1	Ductile Iron	84	10.6	3	0.012	82.961	82.961	3.77	10	38%	1.81
3827	O2L25F1	O2L25J1	M7C3	PVC		626.2	3	0.01	82.961	82.961	3.77	10	38%	13.52
511	O2F32FB1	W-32	PMP-32B	Ductile Iron	16.1	9.7	4	0.012	142.69	142.69	3.64	10	36%	0.23
3913	O2L32FB2	PMP-32B	O2L32J2	Ductile Iron	101	6.8	4	0.012	142.69	142.69	3.64	10	36%	1.47
3998	O2L32F2	O2L32J2	O2L32J1	PVC		521.1	4	0.01	142.69	142.69	3.64	10	36%	7.56
2443	O1L14F2	O1L14J2	O1L14J1	PVC		1384.7	10	0.01	880.32	880.32	3.6	10	36%	6.74
3482	O1L40FA1	PMP-40a	O1L40J1	Ductile Iron	70	13.3	4	0.012	139.62	139.62	3.56	10	36%	0.98
3955	O1L40F1	O1L14J1	O1L40J1	Cast iron		1155.4	4	0.012	-139.62	-139.62	3.56	10	36%	22.6
409	O2L1FA2	PMP-1A	O2L1J2	Ductile Iron	10	6.4	4	0.012	137.79	137.79	3.52	10	35%	20.12
3873	O2L1F2	O2L1J2	O2L1J1	PVC		347.6	4	0.012	137.79	137.79	3.52	10	35%	4.73
3586	O2L38F1	O2L38J1	M35A1	PVC		1300	6	0.01	309.12	309.12	3.51	10	35%	10.96
3882	O2L38FA2	PMP-38a	O2L38J1	Steel	100	6.2	6	0.013	309.12	309.12	3.51	10	35%	1.37
3753	O1L14F3	O1L14J3	O1L14J2	Ductile Iron		14.8	8	0.012	547.15	547.15	3.49	10	35%	0.09
1669	O2L45F1	O2L45J1	O2L12J1	PVC		161.3	6	0.01	302.14	302.14	3.43	10	34%	1.3
434	O2L18A-FB2	PMP-18A-b	O2L18AJ1	Steel	66	8.2	3	0.013	75.334	75.334	3.42	10	34%	1.94
3835	O2L5F2	O2L5J2	O2L5J1	Asbestos Cement		693.6	4	0.011	132.9	132.9	3.39	10	34%	10.76
3841	O2L5F1	O2L5J1	M3F3	Asbestos Cement		90.1	4	0.011	132.9	132.9	3.39	10	34%	1.37
3747	O2L15F2	O2L15J2	O2L15J1	PVC		27.2	3	0.01	74.29	74.29	3.37	10	34%	0.48
3749	O2L15FA2	PMP-15A	O2L15J2	Ductile Iron	78	6	3	0.012	74.29	74.29	3.37	10	34%	1.37
1813	O2L34F4	O2L34J4	O2L34J3	PVC		2328.2	12	0.01	1185.3	1185.3	3.36	10	34%	8.08
3968	O2L36F3	O2L36J2	O2L36J3	Ductile Iron		1431.2	8	0.012	-505.32	-505.32	3.23	10	32%	7.39
3809	O2L9FA1	W-9	PMP-9A	Cast iron	27	8	4	0.012	126.02	126.02	3.22	10	32%	0.44
3810	O2L9FA2	PMP-9A	O2L9J1	Cast iron	76	6.1	4	0.012	126.02	126.02	3.22	10	32%	1.23
3815	O2L9F1	O2L9J1	O2L32J1	Ductile Iron		555	4	0.012	126.02	126.02	3.22	10	32%	6.4
489	O2L4F5	O2L4J5	O2L4J4	Ductile Iron		30.3	4	0.012	124.51	124.51	3.18	10	32%	0.34
3085	O2L4FA2	PMP-4A	O2L4J5	Ductile Iron	105	7.3	4	0.012	124.51	124.51	3.18	10	32%	1.18

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3851	O2L4F4	O2L4J4	O2L4J3	Asbestos Cement		752.6	4	0.011	124.51	124.51	3.18	10	32%	10.12
3854	O2L4F3	O2L4J3	O2L4J2	Asbestos Cement		1169.3	4	0.011	124.51	124.51	3.18	10	32%	15.73
3856	O2L4F2	O2L4J2	O2L4J1	Asbestos Cement		374.9	4	0.011	124.51	124.51	3.18	10	32%	5.04
3858	O2L4F1	O2L4J1	O2L5J2	Asbestos Cement		42	4	0.011	124.51	124.51	3.18	10	32%	0.57
1490	O2L39F1	O2L39J1	M35A1	PVC		751.7	2	0.01	29.869	29.869	3.05	10	31%	17.64
3890	O2L39FA2	PMP-39a	O2L39J1	Ductile Iron	25	9	2	0.012	29.869	29.869	3.05	10	31%	0.59
199	O2L7F1	O2L1J1	O2L7J1	Cast iron		671.6	8	0.012	-453.81	-453.81	2.9	10	29%	2.84
1140	O1L42F1	O1L42J1	M14C1	Ductile Iron		1075.3	4	0.012	111.61	111.61	2.85	10	29%	9.9
3603	O2L16F1	O2L16J1	O2L41J1	Ductile Iron		496.3	8	0.013	435.92	435.92	2.78	10	28%	1.95
3604	O2L41F1	O2L41J1	O2L22J1	Ductile Iron		785.4	8	0.013	435.92	435.92	2.78	10	28%	3.08
3775	O2L12FB2	PMP-12B	O2L12J2	PVC	90	7.2	4	0.01	107.08	107.08	2.73	10	27%	0.77
3778	O2L12F2	O2L12J2	O2L12J1	PVC		30.5	4	0.01	107.08	107.08	2.73	10	27%	0.26
3864	O2L24F1	O2L24J1	O2L7J1	Asbestos Cement		561.1	6	0.011	240.39	240.39	2.73	10	27%	3.54
3672	O2L29F1	O2L29J1	M34A11	Ductile Iron		604.4	4	0.012	104.88	104.88	2.68	10	27%	4.96
395	O2L3FA2	PMP-3A	O2L3J2	Ductile Iron	98	6.9	4	0.012	104.48	104.48	2.67	10	27%	1.9
4048	O2L3F2	O2L3J1	O2L3J2	Cast iron		1248	4	0.012	-104.48	-104.48	2.67	10	27%	14.27
1668	O2L33F1	O2L33J1	O2L45J1	PVC		820.9	6	0.01	215.9	215.9	2.45	10	25%	3.56
143	O2L18AFB2	PMP-18B	O2L18J3	Ductile Iron	66	10.5	3	0.01	51.242	51.242	2.33	10	23%	0.58
3711	O2L23F1	O2L23F1	O2L24J1	PVC		474	4	0.01	89.097	89.097	2.27	10	23%	2.88
3451	O1L37F1	M14D4	O1L37J1	PVC		61.8	4	0.01	-88.302	-88.302	2.25	10	23%	0.37
3452	O1L37FA1	PMP-37a	O1L37J1	Steel	78	8.8	4	0.013	88.302	88.302	2.25	10	23%	0.76
466	O1L17FB1	PMP-17B	O1L17J4		155	8.3	8	0.012	333.17	333.17	2.13	10	21%	0.37
468	O1L17F3	O1L17J4	O1L17J3	Steel		7.9	8	0.013	333.17	333.17	2.13	10	21%	0.03
2441	O1L17F1	O1L17J1	O1L14J2	Ductile Iron		255.7	8	0.012	333.17	333.17	2.13	10	21%	0.61
2460	O1L17F2	O1L17J1	O1L17J2	Ductile Iron		1095.9	8	0.012	-333.17	-333.17	2.13	10	21%	2.61
2462	O1L17F2	O1L17J2	O1L17J3	PVC		1271	8	0.01	-333.17	-333.17	2.13	10	21%	3.03
393	O2L24FA2	PMP-24A	O2L24J2	Steel	84	8.3	3	0.013	46.812	46.812	2.12	10	21%	1.02
3708	O2L24F2	O2L24J2	O2L24J1	PVC		542.3	3	0.01	46.812	46.812	2.12	10	21%	4.06
407	O2L18A-FA2	PMP-18A	O2L18J3	Steel	66	10.8	3	0.013	46.617	46.617	2.12	10	21%	0.8

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3785	O2L11FA2	PMP-11A	O2L11J1	Ductile Iron	77	5.9	3	0.012	46.023	46.023	2.09	10	21%	0.56
3788	O2L11F2	O2L11J1	O2L11J1	Ductile Iron		41.5	3	0.012	46.023	46.023	2.09	10	21%	0.3
1783	O2L30FA2	PMP-30A	O2L30J1	PVC	77	8.8	3	0.01	43.798	43.798	1.99	10	20%	1.12
3659	O2L30F1	O2L30J1	O2L47J1	PVC		413.1	3	0.01	43.798	43.798	1.99	10	20%	2.73
4472	O2L48FA2	PMP-48A	O2L48J1	PVC	70	6.2	3	0.01	41.077	41.077	1.86	10	19%	0.41
214	O2L15F1	O2L15J1	O2L33J1	PVC		1180.6	6	0.01	159.37	159.37	1.81	10	18%	2.92
3486	O2L19FB1	W-19	PMP-19B	Steel	0.1	7.7	20	0.013	1747.5	1747.5	1.78	10	18%	0
3762	O2L13FA1	W-13	PMP-13A	Ductile Iron	16	7.3	3	0.012	32.293	32.293	1.47	10	15%	0.06
517	O2L36FA2	PMP-36A	O2L36J4	Steel	90	7.2	4	0.013	50.074	50.074	1.28	10	13%	0.31
3614	O2L36F4	O2L36J4	O2L36J3	Ductile Iron		1394.3	4	0.012	50.074	50.074	1.28	10	13%	2.91
3862	O2L3F1	O2L3J1	O2L24J1	Cast iron		2688.9	6	0.012	104.48	104.48	1.19	10	12%	4.27
506	O2L34FA1	W-34	PMP-34A	Ductile Iron	0.1	10.6	20	0.012	1150.9	1150.9	1.18	10	12%	0
3663	O2L31F1	O2L31J1	O2L16J1	Ductile Iron		653.2	8	0.012	166.88	166.88	1.07	10	11%	0.43
213	O2L13F1	O2L13J1	O2L15J1			584.2	6	0.013	85.077	85.077	0.97	10	10%	0.54
3764	O2L13FA2	PMP-13A	O2L13J2	Ductile Iron	69	8.5	4	0.012	32.293	32.293	0.82	10	8%	0.06
3767	O2L13F2	O2L13J2	O2L13J1	Ductile Iron		24.7	4	0.012	32.293	32.293	0.82	10	8%	0.02
212	O2L44F1	O1L44J1	O2L13J1	PVC		1303.2	6	0.01	52.785	52.785	0.6	10	6%	0.42
3881	O2L38FA1	W-38	PMP-38a	Steel	0.1	7.5	20	0.013	309.12	309.12	0.32	10	3%	0
3081	O2L16FA1	W-16	PMP-16A	Steel	1	8	20	0.013	269.04	269.04	0.27	10	3%	0
3662	O2L19F1	O2L34J4	O2L31J1	Cast iron		48.8	8	0.013	-34.375	-34.375	0.22	10	2%	0
3819	O2L7FA1	W-7	PMP-7A	Ductile Iron	1.1	7.1	20	0.012	213.42	213.42	0.22	10	2%	0
3925	O2L46FA1	W-46	PMP-46a	PVC	0.1	7.6	10	0.01	53.324	53.324	0.22	10	2%	0
3694	O2L44FA1	W-44	PMP-44a	PVC	0.1	8.1	10	0.01	52.785	52.785	0.22	10	2%	0
3832	O2L5FA2	PMP-5A	O2L5J3	Ductile Iron	93	6.7	4	0.012	8.3964	8.3964	0.21	10	2%	0.01
3834	O2L5F3	O2L5J3	O2L5J2	Ductile Iron		16.9	4	0.012	8.3964	8.3964	0.21	10	2%	0
1743	O2L31FA1	W-31	PMP-31A	Ductile Iron	0.1	8.6	20	0.012	201.26	201.26	0.21	10	2%	0
1690	02L23FA1	W-23	PMP-22A	Ductile Iron	1	8.7	20	0.012	183.34	183.34	0.19	10	2%	0
3525	O2L35FA1	W-35	PMP-35A	Steel	0.1	7.2	20	0.013	171.8	171.8	0.18	10	2%	0
417	O2L2FA1	W-2	PMP-2A	Steel	0.1	8.7	20	0.013	161.96	161.96	0.17	10	2%	0

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
1791	O2L26FB1	W-26	PMP-26B	PVC	0.1	7.7	20	0.01	159.28	159.28	0.16	10	2%	0
445	O2L6FA1	W-6	PMP-6A	Ductile Iron	0.1	7.5	20	0.012	153.95	153.95	0.16	10	2%	0
3481	O1L40FA2	W-40	PMP-40a	PVC	0.1	9.8	20	0.01	139.62	139.62	0.14	10	1%	0
3870	O2L1FA1	W-1	PMP-1A	Steel	0.1	7.5	20	0.013	137.79	137.79	0.14	10	1%	0
3849	O2L4FA1	W-4	PMP-4A	Ductile Iron	0.1	8.2	20	0.012	124.51	124.51	0.13	10	1%	0
3879	O1L42FB1	W-42	PMP-42a		1	7	20	0.013	111.61	111.61	0.11	10	1%	0
3773	O2L12FB1	W-12	PMP-12B	Ductile Iron	0.1	9	20	0.012	107.08	107.08	0.11	10	1%	0
3090	O2L29FA1	W-29	PMP-29A	PVC	0.1	11.1	20	0.01	104.88	104.88	0.11	10	1%	0
373	O2L3FA1	W-3	PMP-3A	Ductile Iron	0.1	7.8	20	0.012	104.48	104.48	0.11	10	1%	0
389	O2L23FB1	W-23	PMP-23B	Steel	1	8.2	20	0.013	89.097	89.097	0.09	10	1%	0
3453	O1L37FA2	W-37	PMP-37a	PVC	0.1	9.7	20	0.01	88.302	88.302	0.09	10	1%	0
3918	O2L45FA1	W-45	PMP-45a	PVC	0.1	7.1	20	0.01	86.238	86.238	0.09	10	1%	0
426	O2L25FA1	W-25	PMP-25A	Ductile Iron	0.1	7.7	20	0.012	82.961	82.961	0.08	10	1%	0
432	O2L18A-FA1	W-18A	PMP-18A-b	Steel	0.1	13.2	20	0.013	75.334	75.334	0.08	10	1%	0
3961	O2L15FA1	W-15	PMP-15A	Ductile Iron		7.2	20	0.012	74.29	74.29	0.08	10	1%	0
4405	O2L47FB1	W-47	PMP-47B	PVC	0.1	9.5	20	0.01	56.842	56.842	0.06	10	1%	0
3943	O2L11FA1	W-33	PMP-33A	Ductile Iron	0.1	6.7	20	0.012	56.531	56.531	0.06	10	1%	0
149	O2L18FB1	W-18	PMP-18B	Ductile Iron	0.1	8.9	20	0.01	51.242	51.242	0.05	10	1%	0
516	O2L36FA1	W-36	PMP-36A	Steel	0.1	8.2	20	0.013	50.074	50.074	0.05	10	1%	0
392	O2L24FA1	W-24	PMP-24A	PVC	0.1	9.1	20	0.01	46.812	46.812	0.05	10	1%	0
406	O2L18FA1	W-18	PMP-18A	Steel	0.1	8.8	20	0.013	46.617	46.617	0.05	10	1%	0
3783	O2L11FA1	W-11	PMP-11A	Ductile Iron	0.1	8.4	20	0.012	46.023	46.023	0.05	10	1%	0
1782	O2L30FA1	W-30	PMP-30A	Cast iron	0.1	8	20	0.012	43.798	43.798	0.04	10	0%	0
3974	O1L43FA2	W-35	PMP-43a	PVC	0.1	7.6	20	0.01	42.611	42.611	0.04	10	0%	0
4471	O2L48FA1	W-48	PMP-48A	PVC	0.1	8.1	20	0.01	41.077	41.077	0.04	10	0%	0
3889	O2L39FA1	W-39	PMP-39a	PVC	0.1	8.2	20	0.01	29.869	29.869	0.03	10	0%	0
3831	O2L5FA1	W-5	PMP-5A	Ductile Iron	0.1	7.6	20	0.012	8.3964	8.3964	0.01	10	0%	0
3605	O2L41F2	O2L41J2	O2L41J1			192.7	1.3	0.013	-0.00012	-0.00012	0	10	0%	0
3899	O2L41FA2	PMP-41a	O2L41J2	PVC	25	7	2	0.01	-0.00012	-0.00012	0	10	0%	0

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3797	O2L10F3	O2L10J3	O2L10J2	Ductile Iron		37.5	3	0.012	-1.95E-05	-1.95E-05	0	10	0%	0
2437	NA	O2L4J4	na			163.1	4	0.011	3.19E-05	3.19E-05	0	10	0%	0
3898	O2L41FA1	W-41	PMP-41a	PVC	0.1	7.2	20	0.01	-0.00012	-0.00012	0	10	0%	0
2433	NA	M3F3	na			97.3	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
2435	NA	na	na			126.6	4	0.011	1.99E-06	1.99E-06	0	10	0%	0
3793	O2L10FA1	W-10	PMP-10A	Ductile Iron	0.1	8.3	20	0.012	-1.61E-05	-1.61E-05	0	10	0%	0
3795	O2L10FA2	PMP-10A	O2L10J3	Ductile Iron	99	6.6	3	0.012	0	0	0	10	0%	0
142	O2L24FB1	W-24	PMP-24B	Ductile Iron	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
150	O2L25FB2	PMP-25B	O2L25J1	Ductile Iron	84	9.2	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
151	O2L24FB2	PMP-24B	O2L24J2	Steel	84	7.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
152	O2L22FB1	W-23	PMP-22B	Ductile Iron	1	7.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
165	O1L17FA2	W-17	PMP-17A	Steel	21.1	6.7	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
166	O2L22FB2	PMP-22B	O2L22J2	Ductile Iron	112	7.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
168	O1L14FB2	W-14	PMP-14B	Ductile Iron	44	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
170	O2L34FC1	W-34	PMP-34C	Ductile Iron	0.1	6.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
177	O2L36FB1	W-36	PMP-36B	Ductile Iron	0.1	9.2	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
184	O2L36FB2	PMP-36B	O2L36J4	Ductile Iron	90	7.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
374	O2L3FB1	W-3	PMP-3B	Ductile Iron	0.1	8.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
386	O2L23FA1	W-23	PMP-23A	Steel	1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
387	O2L23FA2	PMP-23A	O2L23F1	Steel	84	9	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
394	O2L3FB2	PMP-3B	O2L3J2	Ductile Iron	98	8.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
401	O2L1FB2	PMP-1B	O2L1J2	Ductile Iron	10	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
413	O2L2FB1	W-2	PMP-2B	Steel	0.1	9.4	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
415	O2L2FB2	PMP-2B	O2L2J1	Ductile Iron	112	9.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
435	O2L18A-FA2	PMP-18A-a	O2L18AJ1	Steel	66	8.3	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
436	O2L18A-FA1	PMP-18A-a	W-18A	Steel	0.1	8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
443	O2L6FB2	PMP-6B	O2L6J1	PVC	74	6.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
444	O2L6FB1	W-6	PMP-6B	Ductile Iron	0.1	7	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
467	O1L17FA1	PMP-17A	O1L17J4	Steel	155	8.3	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
473	O1L14FB1	PMP-14B	O1L14J3	Steel	134	7.6	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
486	O2L4FB2	PMP4B	O2L4J5	Ductile Iron	105	6.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
487	O2L4FB1	W-4	PMP4B	Ductile Iron	0.1	8.5	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
492	O2L5FB1	W-5	PMP-5B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
494	O2L5FB2	PMP-5B	O2L5J3	Ductile Iron	93	5.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
513	O2F32FA1	W-32	PMP-32A	Ductile Iron	16.1	9.8	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
514	O2L32FA2	PMP-32A	O2L32J2	Ductile Iron	101	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
526	O2L34FC2	PMP-34C	O2L34J6	Ductile Iron	154	7.8	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1693	O2L34FB1	W-34	PMP-34B	Ductile Iron	0.1	8.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1694	O2L34FB2	PMP-34B	O2L34J6	Ductile Iron	154	9.4	8	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1745	O2L31FB2	PMP-31B	O2L31J2	Steel	77	9.6	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1746	O2L31FB1	W-31	PMP-31B	Ductile Iron	0.1	8.1	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1784	O2L30FB2	PMP-30B	O2L30J1	PVC	77	8.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1785	O2L30FB1	W-30	PMP-30B	Cast iron	0.1	7.4	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1793	O2L26FA2	PMP-26A	O2L26J1	Steel	79	6.1	3	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
1794	O2L26FA1	W-26	PMP-26A	PVC	1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2454	NA	J-97	na			612.3	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
2466	NA	na	J-97			2074.5	4	0.011	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3078	O2L16FB2	PMP-16B	O2L16J2	Ductile Iron	77	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3082	O2L16FB1	W-16	PMP-16B	Steel	1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3086	O2L29FB1	W-29	PMP-29B	PVC	0.1	10	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3088	O2L29FB2	PMP-29B	O2L29J2	PVC	78	11.7	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3454	O1L37FB1	PMP-37b	O1L37J1	Ductile Iron	78	6.4	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3455	O1L37FB2	W-37	PMP-37b		0.1	8.8	10	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3483	O1L40FB2	W-40	PMP-40b	PVC	0.1	12.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3484	O1L40FB1	PMP-40b	O1L40J1	Ductile Iron	70	10	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3487	O2L19FA1	W-19	PMP-19A	Steel	0.1	7.9	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3493	O2L19FA2	PMP-19A	O1L34J2	Steel	341	8.5	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3566	O2L38FB1	W-38	PMP-38b	Steel	0.1	8.3	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3568	O2L38FB2	PMP-38b	O2L38J1	Steel	100	7.3	6	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3651	O2L34BYEPAS	O2L36J1	O2L34J5	Ductile Iron		15.2	8	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3696	O2L44FB1	W-44	PMP-44b	PVC	0.1	8.3	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3697	O2L44FB2	PMP-44b	O1L44J2		25	6.8	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3744	O2L15FB2	PMP-15B	O2L15J2	Ductile Iron	78	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3768	O2L13FB1	W-13	PMP-13B	Ductile Iron	16	9.1	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3769	O2L13FB2	PMP-13B	O2L13J2	Ductile Iron	69	9.6	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3779	O2L12FA1	W-12	PMP-12A	Ductile Iron	0.1	8.2	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3780	O2L12FA2	PMP-12A	O2L12J2	Ductile Iron	90	7.2	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3789	O2L11FB1	W-11	PMP-11B	Ductile Iron	0.1	8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3790	O2L11FB2	PMP-11B	O2L11J1	Ductile Iron	77	6	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3799	O2L10FB1	W-10	PMP-10B	Ductile Iron	0.1	5.6	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3800	O2L10FB2	PMP-10B	O2L10J3	Ductile Iron	99	7.5	3	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3803	O2L9FB2	PMP-9B	O2L9J1	Ductile Iron	76	5.9	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3808	O2L9FB1	W-9	PMP-9B	Cast iron	27	7.7	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3817	O2L7FB1	W-7	PMP-7B	Ductile Iron	0.1	7.3	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3823	O2L7FB2	PMP-7B	O2L7J2	Ductile Iron	104	6.9	4	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3869	O2L1FB1	W-1	PMP-1B	Steel	0.1	7.2	0	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3877	O1L42FA1	W-42	PMP-42b		0.1	8.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3878	O1L42FA2	PMP-42b	O1L42J1		25	7.7	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3887	O2L39FB1	W-39	PMP-39b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3888	O2L39FB2	PMP-39b	O2L39J1	Ductile Iron	25	8.3	2	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3891	O2L35FB2	W-35	PMP-35B	Steel	0.1	7.8	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3892	O2L35FB2	PMP-35B	O2L35J2	Steel	90	6.3	4	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3896	O2L41FB1	W-41	PMP-41b	PVC	0.1	6.9	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3897	O2L41FB2	PMP-41b	O2L41J2	PVC	25	7	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3916	O2L45FB1	W-45	PMP-45b		0.1	7.1	20	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3917	O2L45FB2	PMP-45b	O2L45J2	PVC	25	7.4	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3933	O2L46FB1	W-46	PMP-46b	PVC	0.1	8.1	10	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

Model Forcemain Data Table 50 Units Per Acre Build-Out
Exhibit F3

ID	Label	Start Node	Stop Node	Material	Length (User Defined) (ft)	Length (Scaled) (ft)	Dia (in)	Manning's n	Flow (gpm)	Flow (Maximum) (gpm)	Vel (ft/s)	Max Design Vel (ft/s)	% Vel/max Vel (ft/s/ft/s)	Headloss (ft)
3934	O2L46FB2	PMP-46b	O2L46J1		25	6.2	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3937	O2L33FB1	W-33	PMP-33B	Ductile Iron	0.1	6.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3939	O2L33FB2	PMP-33B	O2L33J2	Steel	70	5.8	2	0.013	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3960	O2L15FB1	W-15	PMP-15B	Ductile Iron		7.8	20	0.012	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3972	O1L14FB2	W-35	PMP-43b	PVC	0.1	7.8	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
3973	O1L14FB1	PMP-43b	O1L43J1	PVC	25	7.3	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4408	O2L47FA1	W-47	PMP-47A	PVC	0.1	9.3	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4409	O2L47FA2	PMP-47A	O2L47J2	PVC	40	6.2	2	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4462	O2L48FB1	W-48	PMP-48B	PVC	0.1	7.5	20	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)
4464	O2L48FB2	PMP-48B	O2L48J1	PVC	70	7.1	3	0.01	(N/A)	(N/A)	(N/A)	10	#VALUE!	(N/A)

EXHIBIT F.4
PRESSURE NODE DATA TABLE REPORT

Model Pressure Node Data Table 50 Units Per Acre Build Out
Exhibit F4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
1341	O1L14J1	6.7	3.5	58.1	24	54.6		921853.18	600253.72	TRUE
2432	O1L14J2	6.4	0	64.8	28	64.8		920948.59	600723.96	TRUE
472	O1L14J3	6.4	8	64.9	25	56.9		920955.16	600715.27	TRUE
127	O1L17J1	6	5.3	65.4	26	60.2		920692.99	600715.98	TRUE
2461	O1L17J2	6.8	4	68	28	64		920723	599620.53	TRUE
87	O1L17J3	7.9	5	71.1	29	66.1		920698	598426.1	TRUE
465	O1L17J4	7	5	71.1	29	66.1		920705.89	598426.09	TRUE
2428	O1L34J1	8	5	23.5	8	18.5		927366.12	604992.24	TRUE
3492	O1L34J2	6.8	4.8	29.3	11	24.5		927390.3	604966.61	TRUE
3445	O1L37J1	6	3	3.5	0	0.5		919806.96	599800.73	TRUE
1337	O1L40J1	7.7	4	80.7	33	76.7		921532.85	599443.59	TRUE
1132	O1L42J1	5.8	3	7.6	2	4.6		919732.18	600929.27	TRUE
3588	O1L43J1	7.1	5	23.9	8	18.9		919610.41	600547.6	TRUE
116	O1L44J1	6.8	5.3	55.9	22	50.7		921909.68	600337.73	TRUE
1678	O1L44J2	6.2	0	64.3	28	64.3		921913.59	600458.39	TRUE
88	O2L10J1	8	4	23.6	8	19.6		927114.51	600739.53	TRUE
136	O2L10J2	7.8	5	34.2	13	29.2		926523.21	600750.87	TRUE
3794	O2L10J3	8.7	6.5	34.2	12	27.7		926513.68	600783.24	TRUE
135	O2L11J1	7.9	5.5	42.4	16	36.9		926045.89	600735.78	TRUE
3784	O2L11J1	10.5	8.5	42.7	15	34.2		926041.8	600777.04	TRUE
134	O2L12J1	8.1	6	47.2	18	41.2		925712.64	600726.09	TRUE
3774	O2L12J2	8.2	6.2	47.4	18	41.2		925711.36	600756.56	TRUE
131	O2L13J1	6.1	3	55.5	23	52.5		922967.26	600629.79	TRUE
3763	O2L13J2	6.2	4.2	55.5	22	51.3		922961.39	600653.77	TRUE
132	O2L15J1	6.8	4	55	22	51		923551.18	600648.88	TRUE
3743	O2L15J2	7	5	55.4	22	50.4		923546.24	600675.67	TRUE
107	O2L16J1	4.7	2.5	32	13	29.5		928422.75	604385.66	TRUE
2407	O2L16J2	6.7	4	49	19	45		928763.58	604418.47	TRUE
433	O2L18AJ1	4.7	2.5	12.9	4	10.4		928854.97	600361.74	TRUE
93	O2L18J1	7.7	4	12.5	4	8.5		928569.18	600970.36	TRUE

Model Pressure Node Data Table 50 Units Per Acre Build Out
Exhibit F4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
3726	O2L18J2	4.9	2.9	25.5	10	22.6		928608.77	599957.47	TRUE
126	O2L18J3	5.7	3	30.5	12	27.5		928767.45	599971.15	TRUE
3504	O2L19J1	8.3	7.8	25.2	8	17.4		927390.21	604973.37	TRUE
104	O2L1J1	6	4	28	10	24		928617.92	599702.49	TRUE
398	O2L1J2	6.6	4	32.7	12	28.7		928285.14	599671.66	TRUE
105	O2L22J1	6.9	4	26.9	10	22.9		927748.42	604998.77	TRUE
106	O2L22J2	5.5	3	49.4	20	46.4		927483.96	604307.21	TRUE
118	O2L23F1	4.3	1.2	37.2	16	36		929940.07	600105.19	TRUE
97	O2L24J1	6.9	4	34.4	13	30.4		929844.61	599734.74	TRUE
102	O2L24J2	5.4	3	38.4	15	35.4		929700.1	600158.28	TRUE
101	O2L25J1	4.5	2.7	14.5	5	11.8		929283.22	600655.84	TRUE
1790	O2L26J1	5.6	3.6	12.1	4	8.5		927480.33	603912.05	TRUE
2416	O2L29J1	4.5	2	6.8	2	4.8		929271.35	603049.66	TRUE
3087	O2L29J2	4.5	2	7.2	2	5.2		929284.01	603049.29	TRUE
414	O2L2J1	5.8	3.3	15.8	5	12.5		928996	598338.88	TRUE
1781	O2L30J1	3.1	1	21.8	9	20.8		929239.57	603452.81	TRUE
3661	O2L31J1	4.8	2.5	32.4	13	29.9		928446.71	603732.88	TRUE
1742	O2L31J2	6.6	4	62.3	25	58.3		929288.83	604013.67	TRUE
100	O2L32J1	5.7	4	27.9	10	23.9		928486.55	602372.06	TRUE
125	O2L32J2	5.3	4	35.5	14	31.5		927974.57	602351.14	TRUE
133	O2L33J1	8.3	6	52	20	46		924731.1	600689.88	TRUE
3938	O2L33J2	9.2	6	54.5	21	48.5		924723.91	600721.68	TRUE
3505	O2L34J2	8.1	4.6	24.1	8	19.6		927389.97	604994.04	TRUE
3498	O2L34J3	8.4	3.8	24.3	9	20.5		927411.01	604994.99	TRUE
1810	O2L34J4	4.8	4	32.4	12	28.4		928447.42	603684.11	TRUE
120	O2L34J5	5.9	2	79.9	34	77.9		928527.32	601678.68	TRUE
525	O2L34J6	5.9	10.1	81.1	31	70.9		928480.51	601676.24	TRUE
3528	O2L35J1	5.9	3	76.4	32	73.4		925402.48	604500.5	TRUE
3526	O2L35J2	0	0	76.6	33	76.6		925402.8	604509.91	TRUE
3649	O2L36J1	6	4	-3.6	-3	-7.6		928527.66	601663.48	TRUE

Model Pressure Node Data Table 50 Units Per Acre Build Out
Exhibit F4

ID	Label	Elevation (Ground) (ft)	Elevation (ft)	Hydraulic Grade (ft)	Pressure (Maximum) (psi)	Pressure Head (ft)	Notes	X (ft)	Y (ft)	Is Active?
91	O2L36J2	7.4	5	11.3	3	6.3		928541.4	601077.86	TRUE
90	O2L36J3	8.9	4	18.6	6	14.6		927111.29	601021.17	TRUE
89	O2L36J4	6.1	4	21.6	8	17.6		926952.73	602311.3	TRUE
3567	O2L38J1	6.5	3.5	10.2	3	6.7		925476.79	603270.8	TRUE
1482	O2L39J1	6.5	4	16.5	5	12.5		925456.86	603835.44	TRUE
4047	O2L3J1	6.9	5	38.6	15	33.6		929945.67	597047.95	TRUE
124	O2L3J2	6.4	5	52.9	21	47.9		928698.06	597016.74	TRUE
3602	O2L41J1	5.5	4	30	11	26		928396.68	604881.25	TRUE
1639	O2L41J2	6.4	4	30	11	26		928579.21	604893.45	TRUE
1667	O2L45J1	8.1	6	48.5	18	42.5		925551.4	600721.93	TRUE
1670	O2L45J2	9.4	7.4	55.1	21	47.7		925547.33	600761.31	TRUE
3926	O2L46J1	6.6	3	16.9	6	13.9		928915.95	600879.36	TRUE
4400	O2L47J1	2.2	1.4	19.1	8	17.7		928837.69	603432.35	TRUE
4396	O2L47J2	5	3	20.1	7	17.1		928830.59	603426.03	TRUE
4463	O2L48J1	0	0	25.8	11	25.8		926212.08	601305.88	TRUE
3855	O2L4J1	6.3	4.3	16.2	5	11.9		927327.5	597718.21	TRUE
3853	O2L4J2	6.2	4.2	21.3	7	17.1		927318.45	598092.97	TRUE
3850	O2L4J3	5.8	3.8	37	14	33.2		927280.07	599261.59	TRUE
488	O2L4J4	7	5	47.1	18	42.1		927253.84	600013.72	TRUE
484	O2L4J5	7.6	6	47.5	18	41.5		927276.73	600022.08	TRUE
3838	O2L5J1	6	4	4.9	0	0.9		927367.89	597001.13	TRUE
3857	O2L5J2	6.3	4	15.7	5	11.7		927330.85	597676.29	TRUE
493	O2L5J3	6.3	4.8	15.7	5	10.8		927336.66	597692.12	TRUE
442	O2L6J1	6.3	4	13.9	4	9.9		928475.95	600682.36	TRUE
95	O2L7J1	6.6	4	30.8	12	26.8		929283.52	599729.39	TRUE
3820	O2L7J2	6.9	4.9	31.8	12	26.9		929290.49	599699.06	TRUE
3802	O2L9J1	6.5	3.5	34.3	13	30.8		928210.32	602646.01	TRUE
2434	na	0	0	3.5	2	3.5		927359.5	596967.77	TRUE
2436	na	0	0	3.5	2	3.5		927353.71	597094.23	TRUE
2438	na	0	0	47.1	20	47.1		927262.9	599779.52	TRUE

EXHIBIT F.5
PUMP MODEL DATA TABLE REPORT

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
63	PMP-1A	TRUE	6.7	-3.8	Pump Definition - LS1	137.79	54.6	-1.8	52.8
396	PMP-1B	FALSE	6.7	-3.8	Pump Definition - LS1	(N/A)	(N/A)	(N/A)	(N/A)
412	PMP-2A	TRUE	6.3	-4.7	Pump Definition - LS2	161.96	21.5	-3.7	17.9
411	PMP-2B	FALSE	6.4	-4.7	Pump Definition - LS2	(N/A)	(N/A)	(N/A)	(N/A)
365	PMP-3A	TRUE	6.4	-2.9	Pump Definition - LS3	104.48	56.7	-1.9	54.8
62	PMP-3B	FALSE	6.4	-2.9	Pump Definition - LS3	(N/A)	(N/A)	(N/A)	(N/A)
481	PMP-4A	TRUE	7.6	-3.6	Pump Definition - LS4	124.51	50.2	-1.6	48.6
482	PMP-4B	FALSE	7.6	-3.6	Pump Definition - LS4	(N/A)	(N/A)	(N/A)	(N/A)
491	PMP-5A	TRUE	6	-6.2	Pump Definition - LS5	8.3964	19.8	-4.2	15.7
490	PMP-5B	FALSE	6	-6.2	Pump Definition - LS5	(N/A)	(N/A)	(N/A)	(N/A)
440	PMP-6A	TRUE	6.5	-2.9	Pump Definition - LS6	153.95	20.3	-1.4	18.9
441	PMP-6B	FALSE	6.5	-2.9	Pump Definition - LS6	(N/A)	(N/A)	(N/A)	(N/A)
453	PMP-7A	TRUE	6.8	-5.4	Pump Definition - LS7	213.42	38.3	-3.4	34.9
60	PMP-7B	FALSE	6.8	-5.4	Pump Definition - LS7	(N/A)	(N/A)	(N/A)	(N/A)
3801	PMP-9A	TRUE	6	3.5	Pump Definition - LS9	126.02	37	-1.4	35.6
51	PMP-9B	FALSE	6	3.5	Pump Definition - LS9	(N/A)	(N/A)	(N/A)	(N/A)
3791	PMP-10A	TRUE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	-1.93E-05	26	3.9	29.9
3792	PMP-10B	FALSE	9	-0.1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3781	PMP-11A	TRUE	10.5	3	Pump Definition - LS11	46.023	33.8	9.5	43.3
3782	PMP-11B	FALSE	10.5	3	Pump Definition - LS11	(N/A)	(N/A)	(N/A)	(N/A)
3772	PMP-12A	FALSE	8.7	2.5	Pump Definition - LS12	(N/A)	(N/A)	(N/A)	(N/A)
3771	PMP-12B	TRUE	8.7	2.5	Pump Definition - LS12	107.08	40.2	8	48.2
3760	PMP-13A	TRUE	6.7	4.7	Pump Definition - LS13	32.293	53.4	2.1	55.6
3761	PMP-13B	FALSE	6.7	4.7	Pump Definition - LS13	(N/A)	(N/A)	(N/A)	(N/A)
469	PMP-14A	TRUE	6.4	8	Pump Definition - LS14	547.15	74.8	-4.7	70.2
48	PMP-14B	FALSE	6.4	8	Pump Definition - LS14	(N/A)	(N/A)	(N/A)	(N/A)
3741	PMP-15A	TRUE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	74.29	54.3	2.5	56.8
3740	PMP-15B	FALSE	7	-0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
2476	PMP-16A	TRUE	5.9	-6.3	Pump Definition - LS16	269.04	64.3	-4.3	60

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
2481	PMP-16B	FALSE	5.9	-6.3	Pump Definition - LS16	(N/A)	(N/A)	(N/A)	(N/A)
49	PMP-17A	FALSE	7	9	Pump Definition - LS17	(N/A)	(N/A)	(N/A)	(N/A)
463	PMP-17B	TRUE	7.5	9	Pump Definition - LS17	333.17	82.8	-11.3	71.5
405	PMP-18A	TRUE	5.7	-5	Pump Definition - LS18	46.617	30.3	1	31.3
431	PMP-18A-a	FALSE	6.1	-3.5	Pump Definition - LS18a	(N/A)	(N/A)	(N/A)	(N/A)
430	PMP-18A-b	TRUE	6.1	-3.5	Pump Definition - LS18a	75.334	15.8	-1	14.8
61	PMP-18B	TRUE	5.7	-5	Pump Definition - LS18	51.242	30.1	1	31.1
539	PMP-19A	FALSE	6.8	-4.1	Pump Definition - LS19	(N/A)	(N/A)	(N/A)	(N/A)
53	PMP-19B	TRUE	6.8	-2.5	Pump Definition - LS19	1747.5	59.9	-2.1	57.8
1689	PMP-22A	TRUE	5.4	-9.7	Pump Definition - LS22	183.34	60.8	-7.2	53.6
52	PMP-22B	FALSE	5.9	-9.7	Pump Definition - LS22	(N/A)	(N/A)	(N/A)	(N/A)
59	PMP-23A	FALSE	4.5	-5.9	Pump Definition - LS23	(N/A)	(N/A)	(N/A)	(N/A)
388	PMP-23B	TRUE	-5.9	-5.9	Pump Definition - LS23	89.097	44	-3.4	40.6
391	PMP-24A	TRUE	5.6	-3.4	Pump Definition - LS24	46.812	40.3	-0.9	39.4
58	PMP-24B	FALSE	5.6	-3.4	Pump Definition - LS24	(N/A)	(N/A)	(N/A)	(N/A)
425	PMP-25A	TRUE	5.1	-5.4	Pump Definition - LS24-LS25	82.961	19.2	-2.9	16.3
57	PMP-25B	FALSE	5.1	-5.4	Pump Definition - LS24-LS25	(N/A)	(N/A)	(N/A)	(N/A)
1788	PMP-26A	FALSE	5.6	-4.2	Pump Definition - LS26	(N/A)	(N/A)	(N/A)	(N/A)
1789	PMP-26B	TRUE	5.6	-4.2	Pump Definition - LS26	159.28	25.2	-3.8	21.4
2479	PMP-29A	TRUE	4.4	-4.9	Pump Definition - LS29	104.88	18.9	-3.9	15
2480	PMP-29B	FALSE	3.5	-4.9	Pump Definition - LS29	(N/A)	(N/A)	(N/A)	(N/A)
1779	PMP-30A	TRUE	4.1	-5	Pump Definition - LS30	43.798	25.4	-2.5	22.9
1780	PMP-30B	FALSE	4.1	-5	Pump Definition - LS30	(N/A)	(N/A)	(N/A)	(N/A)
1740	PMP-31A	TRUE	6.2	-8	Pump Definition - LS31	201.26	95.7	-6.6	89.2
1741	PMP-31B	FALSE	6.2	-8	Pump Definition - LS31	(N/A)	(N/A)	(N/A)	(N/A)
508	PMP-32A	FALSE	8	10	Pump Definition - LS32	(N/A)	(N/A)	(N/A)	(N/A)
50	PMP-32B	TRUE	8	10	Pump Definition - LS32	142.69	42.3	-5.3	37
3935	PMP-33A	TRUE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	56.531	60.2	3	63.2
3936	PMP-33B	FALSE	9.2	1.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
505	PMP-34A	TRUE	6.9	-10.5	Pump Definition - LS34	1150.9	90.7	-6	84.7
1692	PMP-34B	FALSE	6.9	-10.5	Pump Definition - LS34	(N/A)	(N/A)	(N/A)	(N/A)
56	PMP-34C	FALSE	6.9	-10.5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
3522	PMP-35A	TRUE	6	-5	Pump Definition - LS35	171.8	81	-1.4	79.6
3521	PMP-35B	FALSE	6	-5	Pump Definition - LS35	(N/A)	(N/A)	(N/A)	(N/A)
515	PMP-36A	TRUE	6.7	-8.5	Pump Definition - LS36	50.074	27.4	-5.5	21.9
64	PMP-36B	FALSE	7.5	-8.5	Pump Definition - LS36	(N/A)	(N/A)	(N/A)	(N/A)
3443	PMP-37a	TRUE	6.3	-7	Pump Definition - LS37	88.302	8.9	-4.7	4.3
3444	PMP-37b	FALSE	6.5	-7	Pump Definition - LS37	(N/A)	(N/A)	(N/A)	(N/A)
3565	PMP-38a	TRUE	6.5	-15.4	Pump Definition - LS38	309.12	21.7	-10.2	11.5
3564	PMP-38b	FALSE	6.5	-15.4	Pump Definition - LS38	(N/A)	(N/A)	(N/A)	(N/A)
3886	PMP-39a	TRUE	6	-5	Pump Definition - LS39	29.869	15.1	2	17.1
3885	PMP-39b	FALSE	6	-5	Pump Definition - LS39	(N/A)	(N/A)	(N/A)	(N/A)
3479	PMP-40a	TRUE	8	5	Pump Definition - LS40	139.62	86.6	-5	81.6
3480	PMP-40b	FALSE	8	5	Pump Definition - LS40	(N/A)	(N/A)	(N/A)	(N/A)
3895	PMP-41a	TRUE	6.5	0	Pump Definition - LS10-LS42-LS43 Privite	0	0	4	30
3894	PMP-41b	FALSE	0	6.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3875	PMP-42a	TRUE	5	0	Pump Definition - LS10-LS42-LS43 Privite	111.61	11.8	2.5	14.3
3876	PMP-42b	FALSE	5	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3970	PMP-43a	TRUE	9.4	1	Pump Definition - LS10-LS42-LS43 Privite	42.611	21	4	25
3971	PMP-43b	FALSE	7.4	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3693	PMP-44a	TRUE	6.8	0.5	Pump Definition - LS15-LS33-LS44-LS45	52.785	61.5	4.5	66
3692	PMP-44b	FALSE	6.7	0.5	Pump Definition - LS15-LS33-LS44-LS45	(N/A)	(N/A)	(N/A)	(N/A)
3915	PMP-45a	TRUE	9.3	3.5	Pump Definition - LS15-LS33-LS44-LS45	86.238	50.3	9	59.3
3914	PMP-45b	FALSE	9.3	3.5	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
3923	PMP-46a	TRUE	6.5	-3	Pump Definition - LS10-LS42-LS43 Privite	53.324	19.7	-1	18.7
3924	PMP-46b	FALSE	6.3	-3	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4407	PMP-47A	FALSE	5	1	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)
4404	PMP-47B	TRUE	5	1	Pump Definition - LS10-LS42-LS43 Privite	56.842	19.2	4	23.2

Model Pump Data Tabe 50 Unit Per Acre Build-Out
Exhibit F5

ID	Label	Is Active?	Elevation (Ground) (ft)	Elevation (Invert) (ft)	Pump Definition	Flow (Pump) (gpm)	Head (Pump) (ft)	Hydraulic Grade (Upstream) (ft)	Hydraulic Grade (Downstream) (ft)
4460	PMP-48A	TRUE	0	0	Pump Definition - LS10-LS42-LS43 Privite	41.077	21.2	5	26.2
4461	PMP-48B	FALSE	0	0	Pump Definition - LS10-LS42-LS43 Privite	(N/A)	(N/A)	(N/A)	(N/A)

EXHIBIT F.6
OUTFALL DATA TABLE REPORT

Model Outfall Data Table 50 Units Per Acre
Exhibit F6

ID	Label	Elev (Grd) (ft)	Elev (Invt) (ft)	Boundary Condition Type	Elev (User Defined Tailwater) (ft)	Hydraulic Grade (ft)	Flow (Total Out) (gpm)	Notes
1797	O-1	6.8	3.5	User Defined Tailwater	58	58	1019.9	Measured 58 ft of Head or 25 psi at 12:00 PM Tuesday August 2023
3488	O-2	6.5	3.5	User Defined Tailwater	23	23	3723.9	Measured 10 psi or 23 feet of Head on monday 6/12/2023

EXHIBIT G
PUMP INVENTORY TABLE

Pump Inventory Table

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Park Lake Estates	Lake Shore Drive	Pub	**LS #1**	1	Sulzer	xfp100E-CB1.5-PE56/4-E-60FM	0016055 42/2012	3	230	7.5	19.8	1757	713	65.6	2022	7.68	262	42	BPI Unitron Controls	Pump Definition - 32 (PMP-45)LS1
Park Lake Estates	Lake Shore Drive	Pub	**LS #1**	2	Sulzer	xfp100E-CB1.5-PE56/4-E-60FM	0016055 42/2012	3	230	7.5	19.8	1757	713	65.6	2022	7.68	262	42	BPI Unitron Controls	Pump Definition - 32 (PMP-45)LS1
Park Lake Estates	Marine Circle	Pub	**LS#2**	1	Sulzer	XFP80C-CB1.2-PE20/6-C-60FM	0023652 40/2013	3	230	2.7	8.4	1150	500	9	2013	7.68	140	18	Champion	Pump Definition - 6 (PMP-32)LS2
Park Lake Estates	Marine Circle	Pub	**LS#2**	2	Sulzer	XFP80C-CB1.2-PE20/6-C-60FM	0021027 40/2013	3	230	2.7	8.4	1150	500	9	2013	7.68	140	18	Champion	Pump Definition - 6 (PMP-32)LS2
Park Lake Estates	West Lake Shore Dr	Pub	**LS#3**	1	Sulzer	ABSXFP-PE2	300698673	3	230	7.5		1757 MAX	713	66	2022	0.195	275	40	UNITRON	Pump Definition - 6 (PMP-32)LS2
Park Lake Estates	West Lake Shore Dr	Pub	**LS#3**	2	ABS	XFP-PE2-100E-CB1.5-PE56_4EFM	300688962	3	230	7.5			713	66	2021	0.195	275	40	UNITRON	Pump Definition - 6 (PMP-32)LS2
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#4**	1	ABS	AFPK1041M46/4EX	6980	3	230	6.2	17.1	1750	780	59		0.2	132	46	Champion	Pump Definition - 16 (PMP-46)LS4
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#4**	2	ABS	AFPK1041 M46/4EX	69803	3	230	6.2	17.1		780	59			132	46	Champion	Pump Definition - 16 (PMP-46)LS5
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#5**	1	ABS	AFPK0841.4-M18/4FW	0091195	1	230	2.7	12	1146	305	20	2007	152mm	95	12	Champion	Pump Definition - 18 (PMP-38)LS5
Pembroke Park Lake	West Lake Shore Dr	Pub	**LS#5**	2	Liberty	XFP80CB1.4PE 20/6 LSG202M-C	124QWC	1	230	2.4	12.1	1750	305	20	2019	152mm	95	12	Champion	Pump Definition - 18 (PMP-38)LS6

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
La Siesta	Lake Shore Drive	Pub	**LS#6**	1	ABS	20-35 MOBILE HOME / AFPK0841.3M18/4EX		3			1		410	28			92	20	Champion	Pump Definition-4-LS6
La Siesta	Lake Shore Drive	Pub	**LS#6**	2	ABS	20-35 MOBILE HOME / AFPK0841.3M18/4EX		3		2.4			410	28			92	20	Champion	Pump Definition-4-LS6
Lone Pine	10th St.	Pub	**LS#7**	1	Sulzer	XFP100C-CB1_4-pe35/4-60HZ		3	230		13.7		635	49			210	28	Champion	Definition - 26 (PMP-42)LS7
Lone Pine	10th St.	Pub	**LS#7**	2	Sulzer	XFP100C-CB1_4-pe35/4-60HZ		3	230	4.7			635	49			210	28	Champion	Definition - 26 (PMP-42)LS7
removed	removed	Pub	**LS#8**	1																
removed	removed	Pub	**LS#8**	2																
ParkRD	Park Rd	Private	**LS#9**	1	Gorman-Rupp	T3A-B		3	240	5		1250	418	45			150	37	Gorman-Rupp	Pump Definition-5-LS-9
Park RD	Park Rd	Private	**LS#9**	2	Gorman-Rupp	T3A-B		3	240	5		1250	418	25			150	37	Gorman-Rupp	Pump Definition-5-LS-9
SW 30th Street	SW 30th St	Private	**LS#10**	1	Goulds	WS0512BF	WS0512BF	1	230	0.5	7.3	1750	160	25		5	25	23		Pump Definition - 10 (PMP-34)
SW 30th Street	SW 30th St	Private	**LS#10**	2	Goulds	WS0512BF	WS0512BF	1	230	0.5	7.3	1750	160	25		5	25	23		Pump Definition - 10 (PMP-34)
SW 30th Street	SW 30th St	Private	**LS#11**	1	HYDromatic	30 MP	2248-569	NA	NA	NA	NA	1800	NA	NA	NA	NA	NA	NA	NA	PMP11A
SW 30th Street	SW 30th St	Private	**LS#11**	2	HYDromatic	31 MP	2248-570	NA	NA	NA	NA	1800	NA	NA	NA	NA	NA	NA	NA	PMP11B
SW 30th Street	SW 30th St	Private	**LS#12**	1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP12A
SW 30th Street	SW 30th St	Private	**LS#12**	2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP12B
SW 30th Street	SW 30th St	Pub	**LS#13**	1	Gorman-Rupp	T4A3-B	1561914	3	230	10	24.4	1760	NA	60	NA	NA	NA	NA	Fair	PMP13A
SW 30th Street	SW 30th St	Pub	**LS#13**	2	Gorman-Rupp	T4A3-B	1561914	3	230	10	24.4	1760	NA	60	NA	NA	NA	NA	Fair	PMP13B
Peninsula	Hallandale Beach Blvd	Pub	**LS#14**	1	Gorman-Rupp	T6A60SB	1753320	3	240	30	125	1350	540	75	NA	NA	NA	NA	NA	PMP14A

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Peninsula	Hallandale Beach Blvd	Pub	**LS#14**	2	Gorman-Rupp	T6A60SB	1753320	3	240	30	125	1350	540	75	NA	NA	NA	NA	NA	PMP14B
SW 30th Street	SW 30th St	Pub	**LS#15**	1	Goulds	WS0712BHF	520150	3	230	0.75	12.6	Na	200	80	NA	NA	74	54	NA	PMP15A
No Second pump			**LS#15**																	
Alabama Street	Alabama St	Pub	**LS#16**	1	ABS	AFPK1049 M75/4	M75/4	3	230	10.1	26.1	1750	850	90	NA	NA	NA	NA	NA	PMP16A
Alabama Street	Alabama St	Pub	**LS#16**	2	Sulzer	AFPK1049 M75/4	M75/5	3	230	10	26.1	1750	850	90	NA	NA	NA	NA	NA	PMP16B
SW 52nd Ave.	52nd Ave	Pub	**LS#17**	1	Gorman-Rupp	T6A3S-B/F	1760411	3	230	30	125	1350	1400	90	NA	NA	NA	NA	NA	PMP17A
SW 52nd Ave.	52rd Ave	Pub	**LS#17**	2	Gorman-Rupp	T6A3S-B/F	1760411	3	230	30	125	1350	1400	90	NA	NA	NA	NA	NA	PMP17B
Holiday RV Park	Holliday Park Ave	Pub	**LS#18**	1	ABS	S10/4W.02 06087144	00318852	1	230	1.3	6.5	1700	36	32	NA	NA	NA	NA	NA	PMP18A
Holiday RV Park	Holliday Park Ave	Pub	**LS#18**	2	ABS	S10/4W.02 06087144	00318852	1	230	1.3	6.5	1700	36	32	NA	NA	NA	NA	NA	PMP18B
Holiday RV Park	SW 6th St	Pub	**LS#18 A**	1	Hydromatic	S3HRC300M2-2	S00742073	1	230	3	17.9	3450	200	24	NA	4	85	9	UNITRON	PMP18A-A
Holiday RV Park	SW 6th St	Pub	**LS#18 A**	2	Hydromatic	S3HRC300M2-2	S00742074	1	230	3	17.9	3450	200	24	NA	4	85	9	UNITRON	PMP18A-A
Coca Cola	Pembroke Rd	Pub	**LS#19**	1	Sulzer	XFP15OG-CB1.7-PE185/4	2773859	3	460	24.8	32.7	1750	1500	95	NA	NA	880	58	SULZER	PMP-19A
Coca Cola	Pembroke Rd	Pub	**LS#19**	2	ABS	AFPK1547 ME185/4	22166	3	460	24.8	32.7	1750	1500	95	NA	NA	880	58	SULZER	PMP-19B
removed	removed		**LS#20**	1		Does not exist														
removed	removed		**LS#20**	2		Does not exist														
removed	removed		**LS#21**	1		Old Master LS DOES NOT EXIST														
removed	removed		**LS#21**	2		Old Master LS DOES NOT EXIST														
Lakeview Park	1st St.	Pub	**LS#22**	1	Sulzer	XFP-PE2-100E-CB1.4-PE75_4E-FM	300357575	3	230	10	20	1762	450	85	NA	0.217	175	60	SULZER	PMP-22A
Lakeview Park	1st St.	Pub	**LS#22**	2	Sulzer	XFP-P2-100E-CB1.4-PE75_4E-FM	300698704	3	230	10	20	1762	450	85	NA	0.217	175	60	SULZER	PMP-22B
SW 30th Ave	SW 30th AVE	Pub	**LS#23**	1	ABS	AFPK1041.3M35/4e	92942	3	230	4.7	13.8	1780	700	44	NA	0.3	78	41	CHAMPION	PMP-23A
SW 30th Ave	SW 30th AVE	Pub	**LS#23**	2	ABS	AFPK1041.8M 35/4E	92942	3	230	4.7	13.8	1780	700	44	NA	0.3	78	41	CHAMPION	PMP-23B
Green Acres	7th St	Pub	**LS#24**	1	ABS	AFPK0841 M1.5/6EX	91275	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-24A
Green Acres	7th St	Pub	**LS#24**	2	ABS	AFPK0841M1.5/6EX	91276	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-24B

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Green Acres	4th St	Pub	**LS#25**	1	ABS	AFPK0841 M1.5/6	0891283	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-25A
Green Acres	4th St	Pub	**LS#25**	2	ABS	AFPK0841 M1.5/6	0891282	3	230	2	7.4	1180	360	40		0.2	78	41	CHAMPION	PMP-25B
Lakeview Park	5th St	Pub	**LS#26**	1	ABS	AFPK0841 M1.8/4EX	300466132	1	230	2.4	12.1	1750	560	28	8/17/2022	NA	63	12	CHAMPION	PMP-26A
Lakeview Park	6th St	Pub	**LS#26**	2	Sulzer	XFP-PE1-100C-C1.4-PE20-6C-FM	3055801	1	230	2.4	12.1	1750	560	23	8/18/2022	NA	63	12	CHAMPION	PMP-26B
removed	removed	NA	**LS#27**	1	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-27A
removed	removed	NA	**LS#27**	2	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-27B
removed	removed	NA	**LS#28**	1	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-28A
removed	removed	NA	**LS#28**	2	NA	Does Not Exist	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-28B
Bamboo Park	24th St	Pub	**LS#29**	1	Sulzer	XFP-PE1-100C-CB1.4-PE20_6WC-FM	3135037	1	230	2.4	12	1146	471	23	2/27/2023	7.09	137	17	CHAMPION	PMP-29A
Bamboo Park	25th St	Pub	**LS#29**	2	Sulzer	XFP100C-1-CB1.4-PE20/6W.C.60FM	0030673	1	230	2.68	12	1146	471	23	NA	7.09	137	17	CHAMPION	PMP-29A
Bamboo Park	SW 30th CT	Pub	**LS#30**	1	ABS	AFP0831 M28/4W 60HZ	NA	3	240	2	9	NA	240	28	NA	NA	52	25	CHAMPION	PMP-30A
Bamboo Park	SW 30th Ct	Pub	**LS#30**	2	ABS	AFP0831 M28/4W 60HZ	NA	3	240	2	9	NA	240	28	NA	NA	52	25	CHAMPION	PMP-30B
SW 31st Ave	SW 31 St.	Pub	**LS#31**	1	ABS	AFPK1049.4-M75/IMP 228 mm	069195	3	480	10	26.1	NA	850	90	NA	NA	220	87	CHAMPION	PMP-30
SW 31st Ave	SW 31 St.	Pub	**LS#31**	2	SULZER	XFP100E-CB1-4a-PE75	NA	3	480	10	26.1	NA	700	120	NA	NA	325	87	CHAMPION	PMP-40B
John P Curcie	Irwin Lehmann Dr	Pub	**LS#32**	1	ABS	M35/4-12.60.03214991	0091247	3	208	4.7	15.1	1750	501	42.8	NA	NA	145	32	CHAMPION	PMP-26B
John P Curcie	Irwin Lehmann Dr	Pub	**LS#32**	2	ABS	M35/4-12.60.03214992	0091248	3	208	4.7	15.1	1750	501	42.8	NA	NA	145	32	CHAMPION	PMP-26B
SW 30th St.	SW 30th St.	Private	**LS#33**	1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-26B
SW 30th St.	SW 30th St.	Private	**LS#33**	2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	PMP-26B
Master Station 2800 Park Rd	Park Rd	Pub	**LS#34**	1	ABS	AFP1002ME350/4D	03574	3	480	41.5	55	1760	1500	190			975	106	CHAMPION	PMP-33A
Master Station 2800 Park Rd	Park Rd	Pub	**LS$34**	2	Sulzer	XFP-PE4-100J-CH1-PE350_4J-FM	300661886	3	460	46.9	55	1783	850	110			975	106	CHAMPION	PMP-34B

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Master Station 2800 Park Rd	Park Rd	Pub	**LS#34**	3	ABS	AFP1002ME350/4D	037575	3	480	41.5	55	1760	1500	190			975	106	CHAMPION	PMP-35C
PEMBROKE COMMERCE CENTER	PRIVATE	PUB	**LS#35**	3	EMU	FA10.33 238T 172-4/16	491894	3	230	10	28	1740	460	100			171	81	CC CONTROL	PMP-35A
PEMBROKE COMMERCE CENTER	PRIVATE	PUB	**LS#35**	3	EMU	FA10.33 238T 172-4/17	NA	3	230	10	28	1740	460	100			171	81	CC CONTROL	PMP-35B
Seneca	Senic Phase 3	Private	**LS#36**	1	WILO	FA10.51E	NA	3	230	8.5	18.7	1740	725	30			50	27	NA	PMP-36A
Seneca	Senic Phase 4	Private	**LS#36**	2	WILO	FA10.51E	NA	3	230	8.5	18.7	1740	725	30			50	27	NA	PMP-36B
SW 55th Ave	SW 55th St	Pub	**LS#37**	1	Sulzer	ABS PIRANHA S20/2	0400497	1	240	2	11.5	3400	43	109			50	27	CHAMPION	PMP-37A
SW 55th Ave	SW 55th St	Pub	**LS#37**	2	HOMA	GRP16/1	NA	1	230	1.6	8	3450	85	83			50	27	CHAMPION	PMP-37B
Senica Commerce Park	Senica Commerce Park	Pub	**LS#38**	1	FLYGT	FP 3085.183	NA	3	480	3	NA	1710	225	24			200	21	NA	PMP-38A
Senica Commerce Park	Senica Commerce Park	Pub	**LS#38**	2	FLYGT	FP 3085.184	NA	3	480	3	NA	1710	225	24			200	21	NA	PMP-38B
West Wind	SW 20th St	Private	**LS#39**	1	MYERS	WGX20-03	NA	1	220	2	NA	3450	70	130			28	26	NA	PMP-39A
West Wind	SW 20th St	Private	**LS#39**	2	MYERS	WGX20-03	NA	1	220	2	NA	3450	70	130			28	26	NA	PMP-39B
School	48th Street	Private	**LS#40**	1	EMU	FA-104	NA	3	230	7.5	NA	1740	600	100		238	139	86	NA	
School	49th Street	Private	**LS#40**	2	EMU	FA-105	NA	3	230	7.5	NA	1740	600	100		238	139	86	NA	
Service Station	SW 33 AVE	Private	**LS#41**	1	HYDromatic	SPGA GRINDER	NA	1	230	2		3500	105	135			50	105	NA	
Service Station	SW 33 AVE	Private	**LS#41**	2	HYDromatic	SPGA GRINDER	NA	1	230	2		3500	105	135			50	105	NA	
Marathon	55th AVE	Private	**LS#42**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Marathon	56th AVE	Private	**LS#42**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Bar-Club	SE56th/Hallendale Bch BLVD	Private	**LS#43**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Bar-Club	SE56th/Hallendale Bch BLVD	Private	**LS#43**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	

Location	Street	Public/ Privite	Lift Sta. #	Pump #	Manufacturer	Model	Serial #	# of Phase	Volts	HP	Amps	RPM	GPM (max)	TDH (max)	Date Installed	Impellor ϕ	Design Flow GPM	Design Head FT	Controls	Sewer CAD ID
Dollar General	SW48th St Int Hallandale	Private	**LS#44**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Dollar General	SW48th St Int Hallandale	Private	**LS#44**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
APARTMENTS	3740 HALLANDALE BLVD	Private	**LS#45**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
APARTMENTS	3741 HALLANDALE BLVD	Private	**LS#46**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
TOWN REC CENTER	31ST PLACE	Private	**LS#47**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
TOWN REC CENTER	32nd PLACE	Private	**LS#48**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Dollar General	SW48th St Int Hallandale	Private	**LS#48**	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	

EXHIBIT H
LETTER REQUEST FOR ADDITIONAL SEWER ALLOCATION

CRAIG A. SMITH & ASSOCIATES
A SMART-INFRASTRUCTURE COMPANY

December 11, 2023

The Town of Pembroke Park

Future Sewage Use Treatment Capacity Allocation

The Town of Pembroke Park has experienced significant growth in the last decade. Due to this growth, and projected future growth, it is in the best interest of the Town to seek additional sewage allocation above the existing allocation of 1.11 Million gallons per day as per the Large Users Agreement with the City of Hollywood. The current and projected flows are computed utilizing an analysis of the town code 13.5-52 wastewater treatment loads and the current Official Zoning Map in conjunction with the Southern Regional Wastewater Treatment Plant Large User Capacity Report.

Current Flow Projections as per Zoning:

- T-1 Trailer Park (16 units/acre) (313acres) (90 Gal/Acre) : 450,720 GPD
- RM-25 Medium High Density Multiple-Family Residential (5 Acres) (25 units/acre) (225 Gal/unit) : 28,125 GPD
- RM-16 Medium Density Multiple-Family Residential (107 Acres) (16 units/acre) (225 Gal/unit): 385,200 GPD
- Industrial (40% lot occupation) (0.1 Gal/SF) (6,324,910 SF): 632,491 GPD
- Restaurants (500 seats)(33 Gal/seat): 16,500 GPD
- Clubs (300 seats)(18 Gal/seat): 5,400 GPD
- Service Stations (94 Pumps) (90 Gal/pump): 8,460 GPD
- Laundry Mats (48 washing machines) (360 Gal per Machine): 17,280 GPD
- Churches (300 seats) (3 Gal/seat): 3,000 GPD
- Schools (2000 Students) (18/student): 36,000 GPD
- Senior Facility (300 Beds) (90 Gal/bed): 27,000 GPD
- Retail (140 acres of which 100 acres General Retail is utilized not including prior listed Retail i.e. clubs, restaurants..) (0.1 Gal/SF): 175,000 Gal/Day

The current total wastewater usage based on said analysis: 1,785,176 GPD

Future Projections:

- If half the T-1 units were to rezone from T-1 to RM-25 and additional 550,000 Gal/Day will need to be allocated to the town to service this growth.

Future Wastewater Usage based on said analysis: 2335176 GPD.

Based on this analysis the Town of Pembroke Park should seek additional Sewage Treatment Capacity Allocations.

Sincerely,

Daniel E. Shonk

Daniel Eugene Shonk P.E.




954. 782.8222
1425 E. Newport Center Drive
Deerfield Beach, FL: 33442

EXHIBIT I
2025 TOWN ATLAS

UPDATED WASTEWATER MASTER PLAN ATLAS

LOCATION MAP

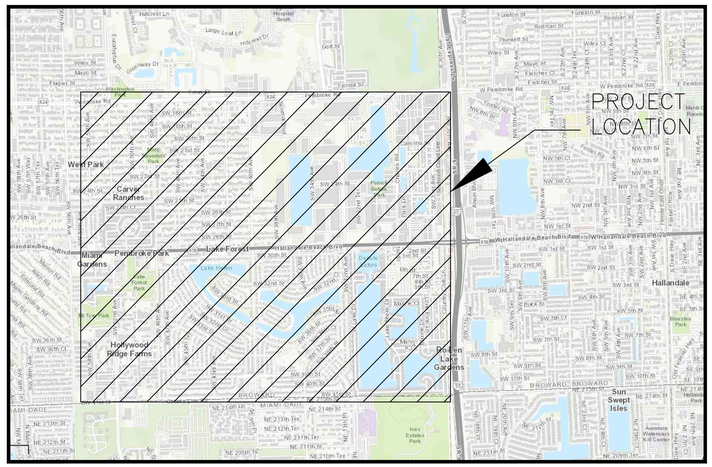

SHEET INDEX

NUMBER / SHEET		DESCRIPTION
01	C-01	COVER SHEET
02	C-02	KEY SHEET & SITE PLAN
03 – 14	C-03 – C-14	MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK
FLORIDA
The Small Town that Means Big Business

BOARD OF COMMISSIONERS

MAYOR	MAYOR ASHIRA MOHAMMED, DISTRICT 5
VICE MAYOR	ERIK MORRISSETTE, DISTRICT 1
CLERK COMMISSIONER	WILLIAM R. HODGKINS, DISTRICT 2
ACTING CLERK COMMISSIONER	MUSFIKA KASHEM, DISTRICT 4
COMMISSIONER	GEOFFREY JACOBS, DISTRICT 3

PREPARED FOR:


TOWN OF PEMBROKE PARK

PROJECT No. 08-22-025

CRAIG A. SMITH & ASSOCIATES
CONSULTING ENGINEERS-PLANNERS-SURVEYORS
21045 COMMERCIAL TRAIL - BOCA RATON, FLORIDA 33486
(561) 314-4445 WWW.CRAIGASMITH.COM
CERTIFICATE OF AUTHORIZATION NUMBER: LB0003110

FILE NAME: 08-22-025-C-01-COVER.dwg

P:\Jobs_Misc_Town_Projects_Fun\08-22-025\Sheets\Master Plan\08-22-025-C-01-COVER.dwg, 12/10/2024 8:52:45 AM, steve_li

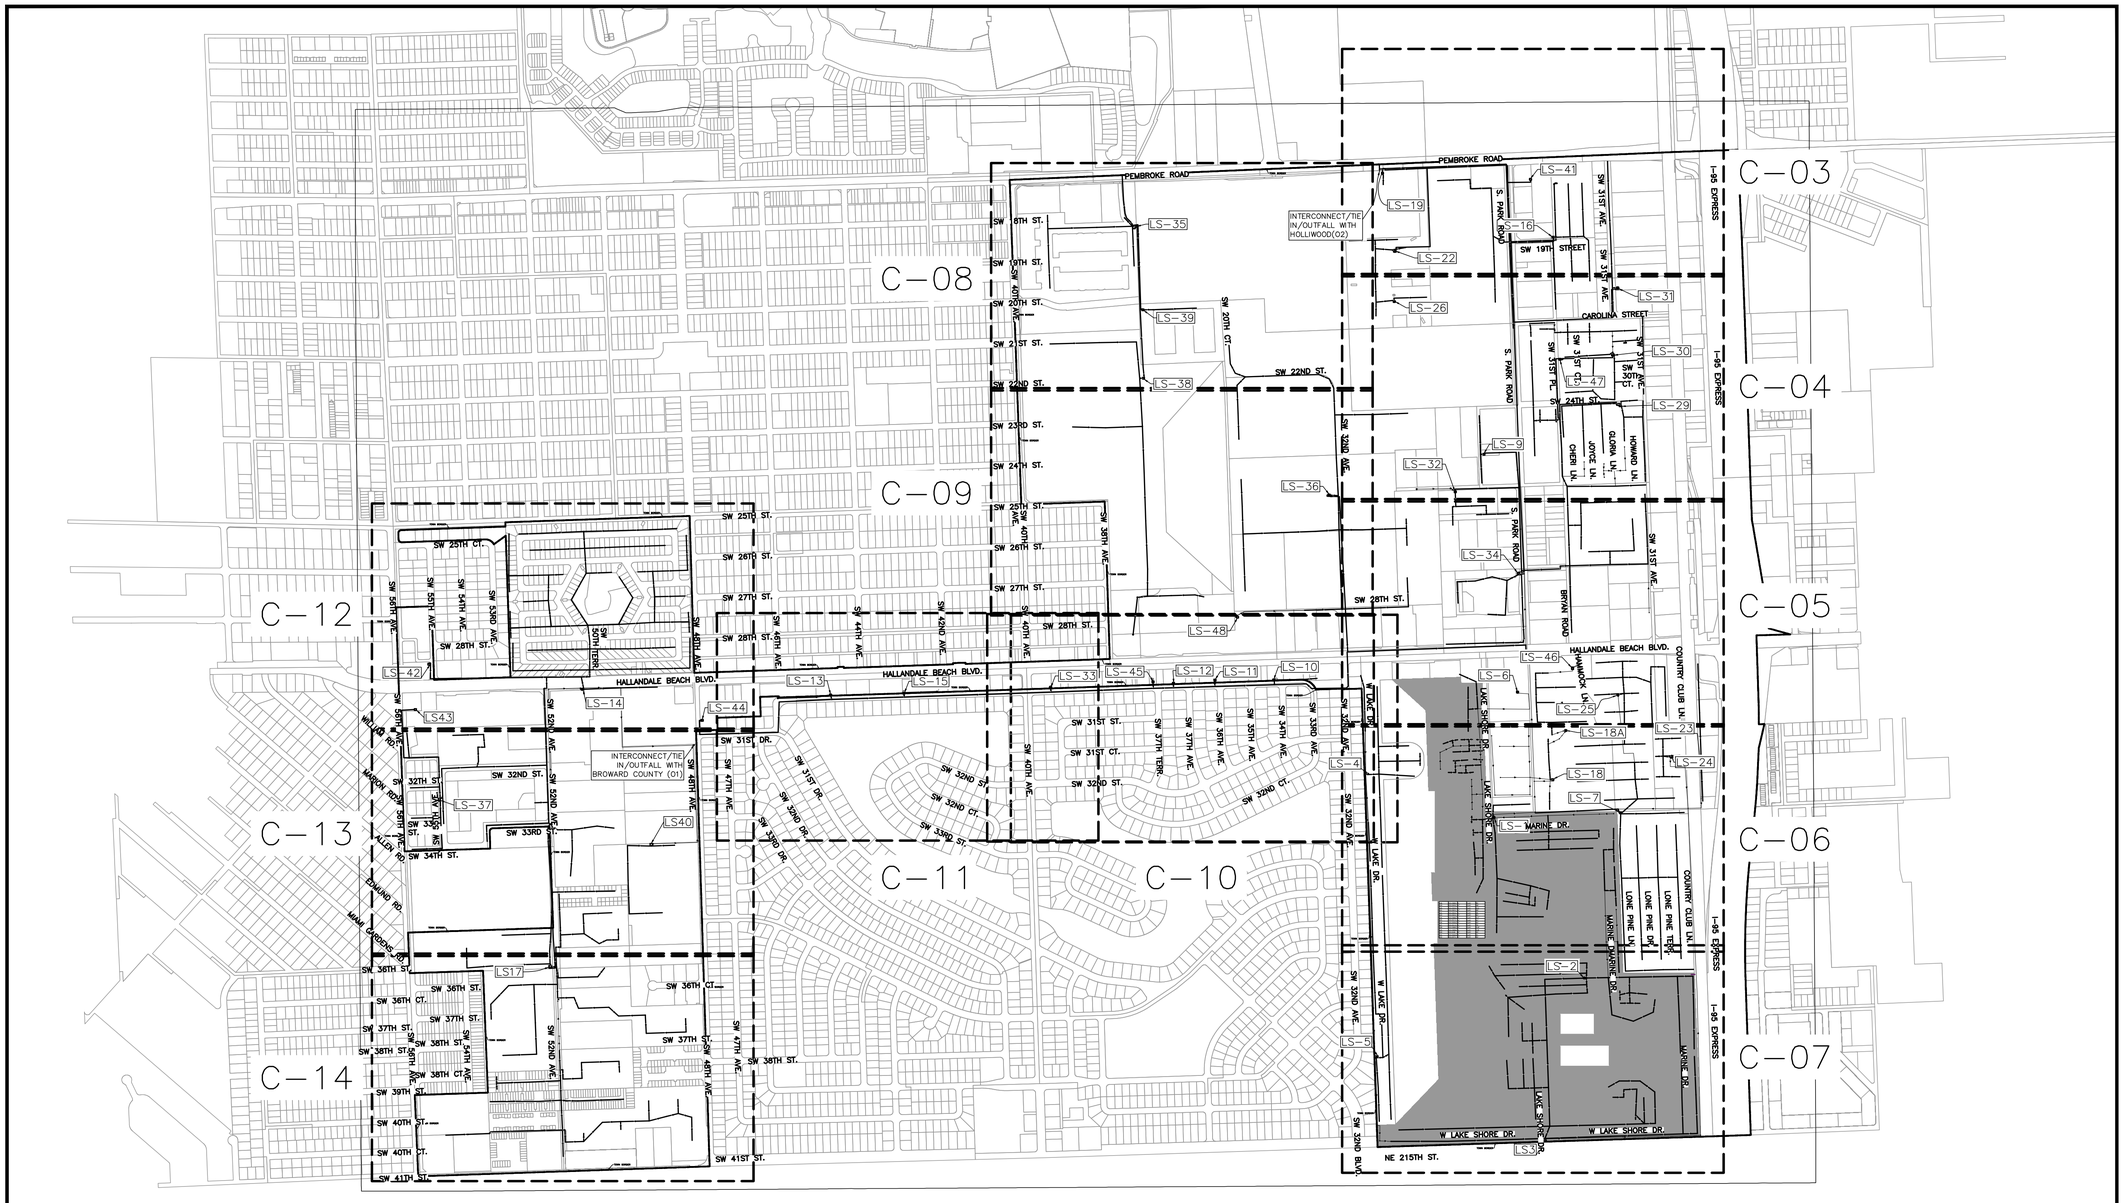

P:\Jobs_Miami_Dade\Pembroke_Park\08-22-025-WWSewerMasterPlan\PLANS\08-22-025-C02-KEYSheet.dwg 12/10/2024 9:33:55 AM, steve.li

CAS

PROJECT NUMBER
08-22-025
02 OF 14

NOTE: OBJECTS IN THIS ATLAS WERE POSITIONED HORIZONTAL AND VERTICALLY REFERENCING: LABINS AERIAL, ASBUILT PLANS, CONSTRUCTION PLANS, COPIES OF PROPOSED PLANS, NOAA & LABINS LIDAR, PRIOR TOWN ATLAS, LINEAR INTERPOLATION, AND COUNTY PROPERTY APPRAISER SHAPE FILES.

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

KEY SHEET

N

0 250 500 1000
HORIZONTAL GRAPHIC SCALE



BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88

ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
03 OF 14

LEGEND:

-1.7 ———	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1


UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

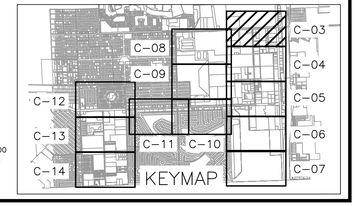

SEE SHEET C-03 FOR CONTINUATION

SEE SHEET C-08 FOR CONTINUATION

SEE SHEET C-09 FOR CONTINUATION

SEE SHEET C-05 FOR CONTINUATION

LS-26

LS-31

LS-30

LS-47

LS-29

LS-9

LS-32

CAROLINA STREET

S. PARK ROAD

SW 31ST CT.

SW 31ST PL.

SW 31ST AVE.

SW 30TH CT.

SW 24TH ST.

SW 25TH ST.

SW 32ND AVE.

I-95 EXPRESS

CHERI LN.

JOYCE LN.

GLORIA LN.

HOWARD LN.

OWNER REPLACED ALL 4"&6" VCP WITH 8" PVC IN BAMBOO PARADISE

SEE TABLE FOR INFO

GRAVITY PIPE TABLE

NUMBER	NAME	PIPE SIZE	MATERIAL	PIPE LENGTH
S1	02L34SA12	8"	CLAY	39'
S2	02L34SQ1	4"	CLAY	89'
S3	02L34SP1	4"	CLAY	14'
S4	02L34SA13	8"	CLAY	126'
S5	02L34SS1	4"	CLAY	86'
S6	02L34SR1	4"	CLAY	16'
S7	02L34SA14	8"	CLAY	50'

SEWER MANHOLE TABLE

NUMBER	NAME	INVERT ELEVATION
M1	M34A11	1.5'
M2	M34A12	1.7'
M3	M34Q1	3.8'
M4	M34P1	4.0'
M5	M34A13	2.1'
M6	M34S1	3.8'
M7	M34R1	3.0'
M8	M34A14	2.3'

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88

ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
04 OF 14

LEGEND:

-1.7 —— INVERT ELEVATION NAVD88

M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH

01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2

01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2

02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

FORCE MAIN PIPE

GRAVITY SEWER PIPE

GRAVITY SEWER MANHOLE

LIFT STATION WETWELL

PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP: C-03, C-04, C-05, C-06, C-07, C-08, C-09, C-10, C-11, C-12, C-13, C-14

SEE SHEET C-04 FOR CONTINUATION

SEE SHEET C-09 FOR CONTINUATION

SEE SHEET C-10 FOR CONTINUATION

SEE SHEET C-05 FOR CONTINUATION

LS-34

LS-46

LS-6

LS-25

SW 32ND AVE.

SW 28TH ST.

SW 27TH ST.

SW 31ST AVE.

S. PARK ROAD

BRYAN ROAD

HAMMOCK LN.

LAKE SHORE DR.

W LAKE DR.

COUNTRY CLUB LN.

HALLANDALE BEACH BLVD.

TOWN BORDER

02L34BYEPASS
15 LF INACTIVE
BYE-PASS 8" DIP
02L36J1

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
05 OF 14

LEGEND:

-1.7 INVERT ELEVATION NAVD88
M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP: C-03, C-04, C-05, C-06, C-07, C-08, C-09, C-10, C-11, C-12, C-13, C-14

SEE SHEET C-05 FOR CONTINUATION

SEE SHEET C-10 FOR CONTINUATION



GRAVITY PIPE TABLE

NUMBER	NAME	INVERT EL.
M1	M1A4	1.0'
M2	M1S1	1.8'
M3	M1S2	2.5'
M4	M1S3	4.0'
M5	M1T1	4.0'
M6	M1U1	2.6'
M7	M1U2	3.6'
M8	M1U3	4.5'
M9	M1VI	3.0'
M10	M1V2	4.0'
M11	M1X1	4.0'
M12	M1A5	1.1'
M13	M1Y1	0.0'
M14	M1W1	4.0'
M15	M1A6	1.4'
M16	M1Z1	4.0'
M17	M1AA1	4.0'
M18	M1A7	1.7'
M19	M1BB1	2.4'
M20	M1KK1	3.5'
M21	M1KK2	4.5'
M22	M1EE1	2.9'
M23	M1EE3	4.0'
M24	M1EE2	4.0'
M25	M1BB2	3.0'
M26	M1CC1	3.5'
M27	M1DD1	4.0'
M28	M1CC2	4.0'
M29	M1BB3	3.9'
M30	M1BB4	5.1'
M31	M1A8	1.9'
M32	M1GG1	4.0'
M33	M1FF1	4.0'

GRAVITY PIPE TABLE

NUMBER	NAME	PIPE SIZE	MATERIAL	PIPE LENGTH
S1	02L1SS1	6"	CLAY	121'
S2	02L1SS2	4"	CLAY	60'
S3	02L1SS3	4"	CLAY	58'
S4	02L1ST1	4"	CLAY	60'
S5	02L1SU1	6"	CLAY	84'
S6	02L1SU2	4"	CLAY	53'
S7	02L1SU3	4"	CLAY	58'
S8	02L1SV1	4"	CLAY	43'
S9	02L1SV2	4"	CLAY	15'
S10	02L1SW1	4"	CLAY	99'
S11	02L1SA5	8"	CLAY	43'
S12	02L1SY1	4"	CLAY	15'
S13	02L1SX1	4"	CLAY	57'
S14	02L1SA6	8"	CLAY	73'
S15	02L1SZ1	4"	CLAY	14'
S16	02L1SAA1	4"	CLAY	65'
S17	02L1SA7	8"	CLAY	47'

GRAVITY PIPE TABLE

NUMBER	NAME	PIPE SIZE	MATERIAL	PIPE LENGTH
S18	02L1SBB1	6"	CLAY	90'
S19	02L1SKK1	4"	CLAY	48'
S20	02L1SKK2	4"	CLAY	131'
S21	02L1SEE1	4"	CLAY	49'
S22	02L1SEE3	4"	CLAY	28'
S23	02L1SEE2	4"	CLAY	63'
S24	02L1SBB2	6"	CLAY	127'
S25	02L1SCC1	4"	CLAY	47'
S26	02L1SDD1	4"	CLAY	42'
S27	02L1SCC2	4"	CLAY	78'
S28	02L1SBB3	4"	CLAY	118'
S29	02L1SBB4	4"	CLAY	138'
S30	02L1SA8	8"	CLAY	45'
S31	02L1SGG1	4"	CLAY	15'
S32	02L1SFF1	4"	CLAY	26'

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88

ALL ELEVATIONS ARE IN NAVD 88

CAS

PROJECT NUMBER
08-22-025
06 OF 14

LEGEND:

-1.7 —— INVERT ELEVATION NAVD88

M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH

01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2

01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2

02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

SEE SHEET C-07 FOR CONTINUATION

UPDATED WASTEWATER MASTER PLAN ATLAS


TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

N

0 50 100 200
HORIZONTAL GRAPHIC SCALE

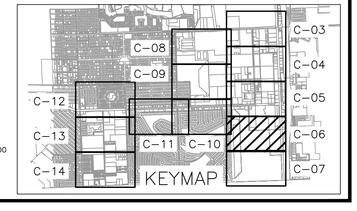

SEE SHEET C-06 FOR CONTINUATION


SW 32ND AVE.
W LAKE DR.
SW 32ND BLVD.
W LAKE SHORE DR.
LAKE SHORE DR.
MARINE DR.
I-95 EXPRESS
NE 215TH ST.
TOWN BORDER
LS-2
LS-3
LS-5
LS3
SEE TABLE FOR INFO
569 LF 4" ACP
02L2F1
1169 LF 4" ACP
02L5F1
574 LF 4" ACP
02L4F2
693' LF 4" ACP
02L5J1
181 LF 4" ACP
02L4J1
17 LF 4" DIP
02L5J2
43 LF 6" PVC
02L5SD2
315 LF 6" CLAY
02L5SD4
341 LF 6" CLAY
02L5SD3
282 LF 6" CLAY
02L5S7
280 LF 6" CLAY
02L5S6
360 LF 8" PVC
02L5S5
308 LF 6" CLAY
02L5S4
28 LF 12" N/A
02L5SA2
30 LF 8" CLAY
02L5SA3
287 LF 6" CLAY
02L5S8
250 LF 6" CLAY
02L5SC1
273 LF 6" CLAY
02L5SC2
247 LF 6" CLAY
02L5SB2
40 LF 6" CLAY
02L2SC1
16 LF 6" CLAY
02L2SA1
221 LF 6" CLAY
02L2SC4
422 LF 6" CLAY
02L2SC3
33 LF 6" CLAY
02L2SB2
39 LF 4" CLAY
02L2SF3
318 LF 6" CLAY
02L2SE2
421 LF 6" CLAY
02L2SE1
135 LF 4" CLAY
02L2SG1
126 LF 6" CLAY
02L2SE3
55 LF 6" CLAY
02L2SD1
569 LF 4" ACP
02L2SH1
415 LF 6" CLAY
02L2SD3
256 LF 6" CLAY
02L2SD3
68 LF 6" CLAY
02L2SD2
25 LF 4" CLAY
02L2SH1
348 LF 6" CLAY
02L2SD4
147 LF 4" CLAY
02L2SJ1
322 LF 6" CLAY
02L2SD5
293 LF 8" CLAY
02L2SB1
262 LF 4" CLAY
02L2SJ1
398 LF 6" PVC
02L7SA6
305 LF 6" PVC
02L7SA6
240 LF 6" PVC
02L7SA7
385 LF 8" CLAY
02L2SA4
125 LF 8" CLAY
02L2SA5
315 LF 8" CLAY
02L2SA1
297 LF 8" CLAY
02L2SA6
316 LF 8" CLAY
02L2SA2
300 LF 8" CLAY
02L2SA7
314 LF 8" CLAY
02L2SA8
2688 LF 6" CIP
02L3J1
02L3P230
795 LF 6" CLAY
02L2SB2
176 LF 4" CLAY
02L2SB3
120 LF 4" CLAY
02L2SB4
308 LF 8" CLAY
02L2SB1
235 LF 8" CLAY
02L3S1
144 LF 4" CLAY
02L3SJ1
150 LF 4" CLAY
02L3SH5
81 LF 4" CLAY
02L3SH4
115 LF 6" CLAY
02L3SH3
103 LF 4" CLAY
02L3SK3
36 LF 8" CLAY
02L3SH2
252 LF 6" CLAY
02L3SK4
238 LF 6" CLAY
02L3SN1
241 LF 6" CLAY
02L3SN2
255 LF 6" CLAY
02L3SK1
318 LF 8" CLAY
02L3S1
125 LF 6" CLAY
02L3SL3
83 LF 6" CLAY
02L3SL2
114 LF 6" CLAY
02L3SL1
99 LF 4" CLAY
02L3SA6
167 LF 6" CLAY
02L3SA5
149 LF 6" CLAY
02L3SA7
104 LF 6" CLAY
02L3SB3
62 LF 6" CLAY
02L3SB4
35 LF 4" CLAY
02L3SB5
214 LF 6" PVC
02L3SB2
213 LF 6" CLAY
02L3SB1
259.6 LF 6" CLAY
02L3SC1
35 LF 4" CLAY
02L3SC4
100 LF 6" CLAY
02L3SB1
394 LF 8" CLAY
02L3SG3
419 LF 8" CLAY
02L3SG2
399 LF 8" CLAY
02L3SG1
475 LF 8" CLAY
02L3SA3
285 LF 8" CLAY
02L3SA4
298 LF 8" CLAY
02L3SD3
459 LF 8" CLAY
02L3SF3
437 LF 8" CLAY
02L3SF2
380 LF 8" CLAY
02L3SF1
115 LF 8" CLAY
02L3SA2
487 LF 8" CLAY
02L3SD1
281 LF 8" CLAY
02L3SD2
1248 LF 4" CIP
02L3F2
88 LF 8" CLAY
02L3SA5
115 LF 8" CLAY
02L3SD4
18 LF 8" UNK
02L3SA1
02L3U2
02L3U1
M1
M2
M3
M4
M5
M7
M8
M2J1
M2N1
M2J2
M2K1
M2J3
M2L1
M2M1
M2L2
M2J4
M2K2
M2L3
M2K3
M2J5
M2L4
M2K4
M2J6
M2K5
M2L5
M2K6
M2J7
M2L6
M2K7
M2J8
M2L7
M2K8
M2J9
M2L8
M2K9
M2J10
M2L9
M2K10
M2J11
M2L10
M2K11
M2J12
M2L11
M2K12
M2J13
M2L12
M2K13
M2J14
M2L13
M2K14
M2J15
M2L14
M2K15
M2J16
M2L15
M2K16
M2J17
M2L16
M2K17
M2J18
M2L17
M2K18
M2J19
M2L18
M2K19
M2J20
M2L19
M2K20
M2J21
M2L20
M2K21
M2J22
M2L21
M2K22
M2J23
M2L22
M2K23
M2J24
M2L23
M2K24
M2J25
M2L24
M2K25
M2J26
M2L25
M2K26
M2J27
M2L26
M2K27
M2J28
M2L27
M2K28
M2J29
M2L28
M2K29
M2J30
M2L29
M2K30
M2J31
M2L30
M2K31
M2J32
M2L31
M2K32
M2J33
M2L32
M2K33
M2J34
M2L33
M2K34
M2J35
M2L34
M2K35
M2J36
M2L35
M2K36
M2J37
M2L36
M2K37
M2J38
M2L37
M2K38
M2J39
M2L38
M2K39
M2J40
M2L39
M2K40
M2J41
M2L40
M2K41
M2J42
M2L41
M2K42
M2J43
M2L42
M2K43
M2J44
M2L43
M2K44
M2J45
M2L44
M2K45
M2J46
M2L45
M2K46
M2J47
M2L46
M2K47
M2J48
M2L47
M2K48
M2J49
M2L48
M2K49
M2J50
M2L49
M2K50
M2J51
M2L50
M2K51
M2J52
M2L51
M2K52
M2J53
M2L52
M2K53
M2J54
M2L53
M2K54
M2J55
M2L54
M2K55
M2J56
M2L55
M2K56
M2J57
M2L56
M2K57
M2J58
M2L57
M2K58
M2J59
M2L58
M2K59
M2J60
M2L59
M2K60
M2J61
M2L60
M2K61
M2J62
M2L61
M2K62
M2J63
M2L62
M2K63
M2J64
M2L63
M2K64
M2J65
M2L64
M2K65
M2J66
M2L65
M2K66
M2J67
M2L66
M2K67
M2J68
M2L67
M2K68
M2J69
M2L68
M2K69
M2J70
M2L69
M2K70
M2J71
M2L70
M2K71
M2J72
M2L71
M2K72
M2J73
M2L72
M2K73
M2J74
M2L73
M2K74
M2J75
M2L74
M2K75
M2J76
M2L75
M2K76
M2J77
M2L76
M2K77
M2J78
M2L77
M2K78
M2J79
M2L78
M2K79
M2J80
M2L79
M2K80
M2J81
M2L80
M2K81
M2J82
M2L81
M2K82
M2J83
M2L82
M2K83
M2J84
M2L83
M2K84
M2J85
M2L84
M2K85
M2J86
M2L85
M2K86
M2J87
M2L86
M2K87
M2J88
M2L87
M2K88
M2J89
M2L88
M2K89
M2J90
M2L89
M2K90
M2J91
M2L90
M2K91
M2J92
M2L91
M2K92
M2J93
M2L92
M2K93
M2J94
M2L93
M2K94
M2J95
M2L94
M2K95
M2J96
M2L95
M2K96
M2J97
M2L96
M2K97
M2J98
M2L97
M2K98
M2J99
M2L98
M2K99
M2J100
M2L99
M2K100
M2J101
M2L100
M2K101
M2J102
M2L101
M2K102
M2J103
M2L102
M2K103
M2J104
M2L103
M2K104
M2J105
M2L104
M2K105
M2J106
M2L105
M2K106
M2J107
M2L106
M2K107
M2J108
M2L107
M2K108
M2J109
M2L108
M2K109
M2J110
M2L109
M2K110
M2J111
M2L110
M2K111
M2J112
M2L111
M2K112
M2J113
M2L112
M2K113
M2J114
M2L113
M2K114
M2J115
M2L114
M2K115
M2J116
M2L115
M2K116
M2J117
M2L116
M2K117
M2J118
M2L117
M2K118
M2J119
M2L118
M2K119
M2J120
M2L119
M2K120
M2J121
M2L120
M2K121
M2J122
M2L121
M2K122
M2J123
M2L122
M2K123
M2J124
M2L123
M2K124
M2J125
M2L124
M2K125
M2J126
M2L125
M2K126
M2J127
M2L126
M2K127
M2J128
M2L127
M2K128
M2J129
M2L128
M2K129
M2J130
M2L129
M2K130
M2J131
M2L130
M2K131
M2J132
M2L131
M2K132
M2J133
M2L132
M2K133
M2J134
M2L133
M2K134
M2J135
M2L134
M2K135
M2J136
M2L135
M2K136
M2J137
M2L136
M2K137
M2J138
M2L137
M2K138
M2J139
M2L138
M2K139
M2J140
M2L139
M2K140
M2J141
M2L140
M2K141
M2J142
M2L141
M2K142
M2J143
M2L142
M2K143
M2J144
M2L143
M2K144
M2J145
M2L144
M2K145
M2J146
M2L145
M2K146
M2J147
M2L146
M2K147
M2J148
M2L147
M2K148
M2J149
M2L148
M2K149
M2J150
M2L149
M2K150
M2J151
M2L150
M2K151
M2J152
M2L151
M2K152
M2J153
M2L152
M2K153
M2J154
M2L153
M2K154
M2J155
M2L154
M2K155
M2J156
M2L155
M2K156
M2J157
M2L156
M2K157
M2J158
M2L157
M2K158
M2J159
M2L158
M2K159
M2J160
M2L159
M2K160
M2J161
M2L160
M2K161
M2J162
M2L161
M2K162
M2J163
M2L162
M2K163
M2J164
M2L163
M2K164
M2J165
M2L164
M2K165
M2J166
M2L165
M2K166
M2J167
M2L166
M2K167
M2J168
M2L167
M2K168
M2J169
M2L168
M2K169
M2J170
M2L169
M2K170
M2J171
M2L170
M2K171
M2J172
M2L171
M2K172
M2J173
M2L172
M2K173
M2J174
M2L173
M2K174
M2J175
M2L174
M2K175
M2J176
M2L175
M2K176
M2J177
M2L176
M2K177
M2J178
M2L177
M2K178
M2J179
M2L178
M2K179
M2J180
M2L179
M2K180
M2J181
M2L180
M2K181
M2J182
M2L181
M2K182
M2J183
M2L182
M2K183
M2J184
M2L183
M2K184
M2J185
M2L184
M2K185
M2J186
M2L185
M2K186
M2J187
M2L186
M2K187
M2J188
M2L187
M2K188
M2J189
M2L188
M2K189
M2J190
M2L189
M2K190
M2J191
M2L190
M2K191
M2J192
M2L191
M2K192
M2J193
M2L192
M2K193
M2J194
M2L193
M2K194
M2J195
M2L194
M2K195
M2J196
M2L195
M2K196
M2J197
M2L196
M2K197
M2J198
M2L197
M2K198
M2J199
M2L198
M2K199
M2J200
M2L199
M2K200
M2J201
M2L200
M2K201
M2J202
M2L201
M2K202
M2J203
M2L202
M2K203
M2J204
M2L203
M2K204
M2J205
M2L204
M2K205
M2J206
M2L205
M2K206
M2J207
M2L206
M2K207
M2J208
M2L207
M2K208
M2J209
M2L208
M2K209
M2J210
M2L209
M2K210
M2J211
M2L210
M2K211
M2J212
M2L211
M2K212
M2J213
M2L212
M2K213
M2J214
M2L213
M2K214
M2J215
M2L214
M2K215
M2J216
M2L215
M2K216
M2J217
M2L216
M2K217
M2J218
M2L217
M2K218
M2J219
M2L218
M2K219
M2J220
M2L219
M2K220
M2J221
M2L220
M2K221
M2J222
M2L221
M2K222
M2J223
M2L222
M2K223
M2J224
M2L223
M2K224
M2J225
M2L224
M2K225
M2J226
M2L225
M2K226
M2J227
M2L226
M2K227
M2J228
M2L227
M2K228
M2J229
M2L228
M2K229
M2J230
M2L229
M2K230
M2J231
M2L230
M2K231
M2J232
M2L231
M2K232
M2J233
M2L232
M2K233
M2J234
M2L233
M2K234
M2J235
M2L234
M2K235
M2J236
M2L235
M2K236
M2J237
M2L236
M2K237
M2J238
M2L237
M2K238
M2J239
M2L238
M2K239
M2J240
M2L239
M2K240
M2J241
M2L240
M2K241
M2J242
M2L241
M2K242
M2J243
M2L242
M2K243
M2J244
M2L243
M2K244
M2J245
M2L244
M2K245
M2J246
M2L245
M2K246
M2J247
M2L246
M2K247
M2J248
M2L247
M2K248
M2J249
M2L248
M2K249
M2J250
M2L249
M2K250
M2J251
M2L250
M2K251
M2J252
M2L251
M2K252
M2J253
M2L252
M2K253
M2J254
M2L253
M2K254
M2J255
M2L254
M2K255
M2J256
M2L255
M2K256
M2J257
M2L256
M2K257
M2J258
M2L257
M2K258
M2J259
M2L258
M2K259
M2J260
M2L259
M2K260
M2J261
M2L260
M2K261
M2J262
M2L261
M2K262
M2J263
M2L262
M2K263
M2J264
M2L263
M2K264
M2J265
M2L264
M2K265
M2J266
M2L265
M2K266
M2J267
M2L266
M2K267
M2J268
M2L267
M2K268
M2J269
M2L268
M2K269
M2J270
M2L269
M2K270
M2J271
M2L270
M2K271
M2J272
M2L271
M2K272
M2J273
M2L272
M2K273
M2J274
M2L273
M2K274
M2J275
M2L274
M2K275
M2J276
M2L275
M2K276
M2J277
M2L276
M2K277
M2J278
M2L277
M2K278
M2J279
M2L278
M2K279
M2J280
M2L279
M2K280
M2J281
M2L280
M2K281
M2J282
M2L281
M2K282
M2J283
M2L282
M2K283
M2J284
M2L283
M2K284
M2J285
M2L284
M2K285
M2J286
M2L285
M2K286
M2J287
M2L286
M2K287
M2J288
M2L287
M2K288
M2J289
M2L288
M2K289
M2J290
M2L289
M2K290
M2J291
M2L290
M2K291
M2J292
M2L291
M2K292
M2J293
M2L292
M2K293
M2J294
M2L293
M2K294
M2J295
M2L294
M2K295
M2J296
M2L295
M2K296
M2J297
M2L296
M2K297
M2J298
M2L297
M2K298
M2J299
M2L298
M2K299
M2J300
M2L299
M2K300
M2J301
M2L300
M2K301
M2J302
M2L301
M2K302
M2J303
M2L302
M2K303
M2J304
M2L303
M2K304
M2J305
M2L304
M2K305
M2J306
M2L305
M2K306
M2J307
M2L306
M2K307
M2J308
M2L307
M2K308
M2J309
M2L308
M2K309
M2J310
M2L309
M2K310
M2J311
M2L310
M2K311
M2J312
M2L311
M2K312
M2J313
M2L312
M2K313
M2J314
M2L313
M2K314
M2J315
M2L314
M2K315
M2J316
M2L315
M2K316
M2J317
M2L316
M2K317
M2J318
M2L317
M2K318
M2J319
M2L318
M2K319
M2J320
M2L319
M2K320
M2J321
M2L320
M2K321
M2J322
M2L321
M2K322
M2J323
M2L322
M2K323
M2J324
M2L323
M2K324
M2J325
M2L324
M2K325
M2J326
M2L325
M2K326
M2J327
M2L326
M2K327
M2J328
M2L327
M2K328
M2J329
M2L328
M2K329
M2J330
M2L329
M2K330
M2J331
M2L330
M2K331
M2J332
M2L331
M2K332
M2J333
M2L332
M2K333
M2J334
M2L333
M2K334
M2J335
M2L334
M2K335
M2J336
M2L335
M2K336
M2J337
M2L336
M2K337
M2J338
M2L337
M2K338
M2J339
M2L338
M2K339
M2J340
M2L339
M2K340
M2J341
M2L340
M2K341
M2J342
M2L341
M2K342
M2J343
M2L342
M2K343
M2J344
M2L343
M2K344
M2J345
M2L344
M2K345
M2J346
M2L345
M2K346
M2J347
M2L346
M2K347
M2J348
M2L347
M2K348
M2J349
M2L348
M2K349
M2J350
M2L349
M2K350
M2J351
M2L350
M2K351
M2J352
M2L351
M2K352
M2J353
M2L352
M2K353
M2J354
M2L353
M2K354
M2J355
M2L354
M2K355
M2J356
M2L355
M2K356
M2J357
M2L356
M2K357
M2J358
M2L357
M2K358
M2J359
M2L358
M2K359
M2J360
M2L359
M2K360
M2J361
M2L360
M2K361
M2J362
M2L361
M2K362
M2J363
M2L362
M2K363
M2J364
M2L363
M2K364
M2J365
M2L364
M2K365
M2J366
M2L365
M2K366
M2J367
M2L366
M2K367
M2J368
M2L367
M2K368
M2J369
M2L368
M2K369
M2J370
M2L369
M2K370
M2J371
M2L370
M2K371
M2J372
M2L371
M2K372
M2J373
M2L372
M2K373
M2J374
M2L373
M2K374
M2J375
M2L374
M2K375
M2J376
M2L375
M2K376
M2J377
M2L376
M2K377
M2J378
M2L377
M2K378
M2J379
M2L378
M2K379
M2J380
M2L379
M2K380
M2J381
M2L380
M2K381
M2J382
M2L381
M2K382
M2J383
M2L382
M2K383
M2J384
M2L383
M2K384
M2J385
M2L384
M2K385
M2J386
M2L385
M2K386
M2J387
M2L386
M2K387
M2J388
M2L387
M2K388
M2J389
M2L388
M2K389
M2J390
M2L389
M2K390
M2J391
M2L390
M2K391
M2J392
M2L391
M2K392
M2J393
M2L392
M2K393
M2J394
M2L393
M2K394
M2J395
M2L394
M2K395
M2J396
M2L395
M2K396
M2J397
M2L396
M2K397
M2J398
M2L397
M2K398
M2J399
M2L398
M2K399
M2J400
M2L399
M2K400
M2J401
M2L400
M2K401
M2J402
M2L401
M2K402
M2J403
M2L402
M2K403
M2J404
M2L403
M2K404
M2J405
M2L404
M2K405
M2J406
M2L405
M2K406
M2J407
M2L406
M2K407
M2J408
M2L407
M2K408
M2J409
M2L408
M2K409
M2J410
M2L409
M2K410
M2J411
M2L410
M2K411
M2J412
M2L411
M2K412
M2J413
M2L412
M2K413
M2J414
M2L413
M2K414
M2J415
M2L414
M2K415
M2J416
M2L415
M2K416
M2J417
M2L416
M2K417
M2J418
M2L417
M2K418
M2J419
M2L418
M2K419
M2J420
M2L419
M2K420
M2J421
M2L420
M2K421
M2J422
M2L421
M2K422
M2J423
M2L422
M2K423
M2J424
M2L423
M2K424
M2J425
M2L424
M2K425
M2J426
M2L425
M2K426
M2J427
M2L426
M2K427
M2J428
M2L427
M2K428
M2J429
M2L428
M2K429
M2J430
M2L429
M2K430
M2J431
M2L430
M2K431
M2J432
M2L431
M2K432
M2J433
M2L432
M2K433
M2J434
M2L433
M2K434
M2J435
M2L434
M2K435
M2J436
M2L435
M2K436
M2J437
M2L436
M2K437
M2J438
M2L437
M2K438
M2J439
M2L438
M2K439
M2J440
M2L439
M2K440
M2J441
M2L440
M2K441
M2J442
M2L441
M2K442
M2J443
M2L442
M2K443
M2J444
M2L443
M2K444
M2J445
M2L444
M2K445
M2J446
M2L445
M2K446
M2J447
M2L446
M2K447
M2J448
M2L447
M2K448
M2J449
M2L448
M2K449
M2J450
M2L449
M2K450
M2J451
M2L450
M2K451
M2J452
M2L451
M2K452
M2J453
M2L452
M2K453
M2J454
M2L453
M2K454
M2J455
M2L454
M2K455
M2J456
M2L455
M2K456
M2J457
M2L456
M2K457
M2J458
M2L457
M2K458
M2J459
M2L458
M2K459
M2J460
M2L459
M2K460
M2J461
M2L460
M2K461
M2J462
M2L461
M2K462
M2J463
M2L462
M2K463
M2J464
M2L463
M2K464
M2J465
M2L464
M2K465
M2J466
M2L465
M2K466
M2J467
M2L466
M2K467
M2J468
M2L467
M2K468
M2J469
M2L468
M2K469
M2J470
M2L469
M2K470
M2J471
M2L470
M2K471
M2J472
M2L471
M2K472
M2J473
M2L472
M2K473
M2J474
M2L473
M2K474
M2J475
M2L474
M2K475
M2J476
M2L475
M2K476
M2J477
M2L476
M2K477
M2J478
M2L477
M2K478
M2J479
M2L478
M2K479
M2J480
M2L479
M2K480
M2J481
M2L480
M2K481
M2J482
M2L481
M2K482
M2J483
M2L482
M2K483
M2J484
M2L483
M2K484
M2J485
M2L484
M2K485
M2J486
M2L485
M2K486
M2J487
M2L486
M2K487
M2J488
M2L487
M2K488
M2J489
M2L488
M2K489
M2J490
M2L489
M2K490
M2J491
M2L490
M2K491
M2J492
M2L491
M2K492
M2J493
M2L492
M2K493
M2J494
M2L493
M2K494
M2J495
M2L494
M2K495
M2J496
M2L495
M2K496
M2J497
M2L496
M2K497
M2J498
M2L497
M2K498
M2J499
M2L498
M2K499
M2J500
M2L499
M2K500
M2J501
M2L500
M2K501
M2J502
M2L501
M2K502
M2J503
M2L502
M2K503
M2J504
M2L503
M2K504
M2J505
M2L504
M2K505
M2J506
M2L505
M2K506
M2J507
M2L506
M2K507
M2J508
M2L507
M2K508
M2J509
M2L508
M2K509
M2J510
M2L509
M2K510
M2J511
M2L510
M2K511
M2J512
M2L511
M2K512
M2J513
M2L512
M2K513
M2J514
M2L513
M2K514
M2J515
M2L514
M2K515
M2J516
M2L515
M2K516
M2J517
M2L516
M2K517
M2J518
M2L517
M2K518
M2J519
M2L518
M2K519
M2J520
M2L519
M2K520
M2J521
M2L520
M2K521
M2J522
M2L521
M2K522
M2J523
M2L522
M2K523
M2J524
M2L523
M2K524
M2J525
M2L524
M2K525
M2J526
M2L525
M2K526
M2J527
M2L526
M2K527
M2J528
M2L527
M2K528
M2J529
M2L528
M2K529
M2J530
M2L529
M2K530
M2J531
M2L530
M2K531
M2J532
M2L531
M2K532
M2J533
M2L532
M2K533
M2J534
M2L533
M2K534
M2J535
M2L534
M2K535
M2J536
M2L535
M2K536
M2J537
M2L536
M2K537
M2J538
M2L537
M2K538
M2J539
M2L538
M2K539
M2J540
M2L539
M2K540
M2J541
M2L540
M2K541
M2J542
M2L541
M2K542
M2J543
M2L542
M2K543
M2J544
M2L543
M2K544
M2J545
M2L544
M2K545
M2J546
M2L545
M2K546
M2J547
M2L546
M2K547
M2J548
M2L547
M2K548
M2J549
M2L548
M2K549
M2J550
M2L549
M2K550
M2J551
M2L550
M2K551
M2J552
M2L551
M2K552
M2J553
M2L552
M2K553
M2J554
M2L553
M2K554
M2J555
M2L554
M2K555
M2J556
M2L555
M2K556
M2J557
M2L556
M2K557
M2J558
M2L557
M2K558
M2J559
M2L558
M2K559
M2J560
M2L559
M2K560
M2J561
M2L560
M2K561
M2J562
M2L561
M2K562
M2J563
M2L562
M2K563
M2J564
M2L563
M2K564
M2J565
M2L564
M2K565
M2J566
M2L565
M2K566
M2J567
M2L566
M2K567
M2J568
M2L567
M2K568
M2J569
M2L568
M2K569
M2J570
M2L569
M2K570
M2J571
M2L570
M2K571
M2J572
M2L571
M2K572
M2J573
M2L572
M2K573
M2J574
M2L573
M2K574
M2J575
M2L574
M2K575
M2J576
M2L575
M2K576
M2J577
M2L576
M2K577
M2J578
M2L577
M2K578
M2J579
M2L578
M2K579
M2J580
M2L579
M2K580
M2J581
M2L580
M2K581
M2J582
M2L581
M2K582
M2J583
M2L582
M2K583
M2J584
M2L583
M2K584
M2J585
M2L584
M2K585
M2J586
M2L585
M2K586
M2J587
M2L586
M2K587
M2J588
M2L587
M2K588
M2J589
M2L588
M2K589
M2J590
M2L589
M2K590
M2J591
M2L590
M2K591
M2J592
M2L591
M2K592
M2J593
M2L592
M2K593
M2J594
M2L593
M2K594
M2J595
M2L594
M2K595
M2J596
M2L595
M2K596
M2J597
M2L596
M2K597
M2J598
M2L597
M2K598
M2J599
M2L598
M2K599
M2J600
M2L599
M2K600
M2J601
M2L600
M2K601
M2J602
M2L601
M2K602
M2J603
M2L602
M2K603
M2J604
M2L603
M2K604
M2J605
M2L604
M2K605
M2J606
M2L605
M2K606
M2J607
M2L606
M2K607
M2J608
M2L607
M2K608
M2J609
M2L608
M2K609
M2J610
M2L609
M2K610
M2J611
M2L610
M2K611
M2J612
M2L611
M2K612
M2J613
M2L612
M2K613
M2J614
M2L613
M2K614
M2J615
M2L614
M2K615
M2J616
M2L615
M2K616
M2J617
M2L616
M2K617
M2J618
M2L617
M2K618
M2J619
M2L618
M2K619
M2J620
M2L619
M2K620
M2J621
M2L620
M2K621
M2J622
M2L621
M2K622
M2J623
M2L622
M2K623
M2J624
M2L623
M2K624
M2J625
M2L624
M2K625
M2J626
M2L625
M2K626
M2J627
M2L626
M2K627
M2J628
M2L627
M2K628
M2J629
M2L628
M2K629
M2J630
M2L629
M2K630
M2J631
M2L630
M2K631
M2J632
M2L631
M2K632
M2J633
M2L632
M2K633
M2J634
M2L633
M2K634
M2J635
M2L634
M2K635
M2J636
M2L635
M2K636
M2J637
M2L636
M2K637
M2J638
M2L637
M2K638
M2J639
M2L638
M2K639
M2J640
M2L639
M2K640
M2J641
M2L640
M2K641
M2J642
M2L641
M2K642
M2J643
M2L642
M2K643
M2J644
M2L643
M2K644
M2J645
M2L644
M2K645
M2J646
M2L645
M2K646
M2J647
M2L646
M2K647
M2J648
M2L647
M2K648
M2J649
M2L648
M2K649
M2J650
M2L649
M2K650
M2J651
M2L650
M2K651
M2J652
M2L651
M2K652
M2J653
M2L652
M2K653
M2J654
M2L653
M2K654
M2J655
M2L654
M2K655
M2J656
M2L655
M2K656
M2J657
M2L656
M2K657
M2J658
M2L657
M2K658
M2J659
M2L658
M2K659
M2J660
M2L659
M2K660
M2J661
M2L660
M2K661
M2J662
M2L661
M2K662
M2J663
M2L662
M2K663
M2J664
M2L663
M2K664
M2J665
M2L664
M2K665
M2J666
M2L665
M2K666
M2J667
M2L666
M2K667
M2J668
M2L667
M2K668
M2J669
M2L668
M2K669
M2J670
M2L669
M2K670
M2J671
M2L670
M2K671
M2J672
M2L671
M2K672
M2J673
M2L672
M2K673
M2J674
M2L673
M2K674
M2J675
M2L674
M2K675
M2J676
M2L675
M2K676
M2J677
M2L676
M2K677
M2J678
M2L677
M2K678
M2J679
M2L678
M2K679
M2J680
M2L679
M2K680
M2J681
M2L680
M2K681
M2J682
M2L681
M2K682
M2J683
M2L682
M2K683
M2J684
M2L683
M2K684
M2J685
M2L684
M2K685
M2J686
M2L685
M2K686
M2J687
M2L686
M2K687
M2J688
M2L687
M2K688
M2J689
M2L688
M2K689
M2J690
M2L689
M2K690
M2J691
M2L690
M2K691
M2J692
M2L691
M2K692
M2J693
M2L692
M2K693
M2J694
M2L693
M2K694
M2J695
M2L694
M2K695
M2J696
M2L695
M2K696
M2J697
M2L696
M2K697
M2J698
M2L697
M2K698
M2J699
M2L698
M2K699
M2J700
M2L699
M2K700
M2J701
M2L700
M2K701
M2J702
M2L701
M2K702
M2J703
M2L702
M2K703
M2J704
M2L703
M2K704
M2J705
M2L704
M2K705
M2J706
M2L705
M2K706
M2J707
M2L706
M2K707
M2J708
M2L707
M2K708
M2J709
M2L708
M2K709
M2J710
M2L709
M2K710
M2J711
M2L710
M2K711
M2J712
M2L711
M2K712
M2J713
M2L712
M2K713
M2J714
M2L713
M2K714
M2J715
M2L714
M2K715
M2J716
M2L715
M2K716
M2J717
M2L716
M2K717
M2J718
M2L717
M2K718
M2J719
M2L718
M2K719
M2J720
M2L719
M2K720
M2J721
M2L720
M2K721
M2J722
M2L721
M2K722
M2J723
M2L722
M2K723
M2J724
M2L723
M2K724
M2J725
M2L724
M2K725
M2J726
M2L725
M2K726
M2J727
M2L726
M2K727
M2J728
M2L727
M2K728
M2J729
M2L728
M2K729
M2J730
M2L729
M2K730
M2J731
M2L730
M2K731
M2J732
M2L731
M2K732
M2J733
M2L732
M2K733
M2J734
M2L733
M2K734
M2J735
M2L734
M2K735
M2J736
M2L735
M2K736
M2J737
M2L736
M2K737
M2J738
M2L737
M2K738
M2J739
M2L738
M2K739
M2J740
M2L739
M2K740
M2J741
M2L740
M2K741
M2J742
M2L741
M2K742
M2J743
M2L742
M2K743
M2J744
M2L743
M2K744
M2J745
M2L744
M2K745
M2J746
M2L745
M2K746
M2J747
M2L746
M2K747
M2J748
M2L747
M2K748
M2J749
M2L748
M2K749
M2J750
M2L749
M2K750
M2J751
M2L750
M2K751
M2J752
M2L751
M2K752
M2J753
M2L752
M2K753
M2J754
M2L753
M2K754
M2J755
M2L754
M2K755
M2J756
M2L755
M2K756
M2J757
M2L756
M2K757
M2J758
M2L757
M2K758
M2J759
M2L758
M2K759
M2J760
M2L759
M2K760
M2J761
M2L760
M2K761
M2J762
M2L761
M2K762
M2J763
M2L762
M2K763
M2J764
M2L763
M2K764
M2J765
M2L764
M2K765
M2J766
M2L765
M2K766
M2J767
M2L766
M2K767
M2J768
M2L767
M2K768
M2J769
M2L768
M2K769
M2J770
M2L769
M2K770
M2J771
M2L770
M2K771
M2J772
M2L771
M2K772
M2J773
M2L772
M2K773
M2J774
M2L773
M2K774
M2J775
M2L774
M2K775
M2J776
M2L775
M2K776
M2J777
M2L776
M2K777
M2J778
M2L777
M2K778
M2J779
M2L778
M2K779
M2J780
M2L779
M2K780
M2J781
M2L780
M2K781
M2J782
M2L781
M2K782
M2J783
M2L782
M2K783
M2J784
M2L783
M2K784
M2J785
M2L784
M2K785
M2J786
M2L785
M2K786
M2J787
M2L786
M2K787
M2J788
M2L787
M2K788
M2J789
M2L788
M2K789
M2J790
M2L789
M2K790
M2J791
M2L790
M2K791
M2J792
M2L791
M2K792
M2J793
M2L792
M2K793
M2J794
M2L793
M2K794
M2J795
M2L794
M2K795
M2J796
M2L795
M2K796
M2J797
M2L796
M2K797
M2J798
M2L797
M2K798
M2J799
M2L798
M2K799
M2J800
M2L799
M2K800
M2J801
M2L800
M2K801
M2J802
M2L801
M2K802
M2J803
M2L802
M2K803
M2J804
M2L803
M2K804
M2J805
M2L804
M2K805
M2J806
M2L805
M2K806
M2J807
M2L806
M2K807
M2J808
M2L807
M2K808
M2J809
M2L808
M2K809
M2J810
M2L809
M2K810
M2J811
M2L810
M2K811
M2J812
M2L811
M2K812
M2J813
M2L812
M2K813
M2J814
M2L813
M2K814
M2J815
M2L814
M2K815
M2J816
M2L815
M2K816
M2J817
M2L816
M2K817
M2J818
M2L817
M2K818
M2J819
M2L818
M2K819
M2J820
M2L819
M2K820
M2J821
M2L820
M2K821
M2J822
M2L821
M2K822
M2J823
M2L822
M2K823
M2J824
M2L823
M2K824
M2J825
M2L824
M2K825
M2J826
M2L825
M2K826
M2J827
M2L826
M2K827
M2J828
M2L827
M2K828
M2J829
M2L828
M2K829
M2J830
M2L829
M2K830
M2J831
M2L830
M2K831
M2J832
M2L831
M2K832
M2J833
M2L832
M2K833
M2J834
M2L833
M2K834
M2J835
M2L834
M2K835
M2J836
M2L835
M2K836
M2J837
M2L836
M2K837
M2J838
M2L837
M2K838
M2J839
M2L838
M2K839
M2J840
M2L839
M2K840
M2J841
M2L840
M2K841
M2J842
M2L841
M2K842
M2J843
M2L842
M2K843
M2J844
M2L843
M2K844
M2J845
M2L844
M2K845
M2J846
M2L845
M2K846
M2J847
M2L846
M2K847
M2J848
M2L847
M2K848
M2J849
M2L848
M2K849
M2J850
M2L849
M2K850
M2J851
M2L850
M2K851
M2J852
M2L851
M2K852
M2J853
M2L852
M2K853
M2J854
M2L853
M2K854
M2J855
M2L854
M2K855
M2J856
M2L855
M2K856
M2J857
M2L856
M2K857
M2J858
M2L857
M2K858
M2J859
M2L858
M2K859
M2J860
M2L859
M2K860
M2J861
M2L860
M2K861
M2J862
M2L861
M2K862
M2J863
M2L862
M2K863
M2J864
M2L863
M2K864
M2J865
M2L864
M2K865
M2J866
M2L865
M2K866
M2J867
M2L866
M2K867
M2J868
M2L867
M2K868
M2J869
M2L868
M2K869
M2J870
M2L869
M2K870
M2J871
M2L870
M2K871
M2J872
M2L871
M2K872
M2J873
M2L872
M2K873
M2J874
M2L873
M2K874
M2J875
M2L874
M2K875
M2J876
M2L875
M2K876
M2J877
M2L876
M2K877
M2J878
M2L877
M2K878
M2J879
M2L878
M2K879
M2J880
M2L879
M2K880
M2J881
M2L880
M2K881
M2J882
M2L881
M2K882
M2J883
M2L882
M2K883
M2J884
M2L883
M2K884
M2J885
M2L884
M2K885
M2J886
M2L885
M2K886
M2J887
M2L886
M2K887
M2J888
M2L887
M2K888
M2J889
M2L888
M2K889
M2J890
M2L889
M2K890
M2J891
M2L890
M2K891
M2J892
M2L891
M2K892
M2J893
M2L892
M2K893
M2J894
M2L893
M2K894
M2J895
M2L894
M2K895
M2J896
M2L895
M2K896
M2J897
M2L896
M2K897
M2J898
M2L897
M2K898
M2J899
M2L898
M2K899
M2J900
M2L899
M2K900
M2J901
M2L900
M2K901
M2J902
M2L901
M2K902
M2J903
M2L902
M2K903
M2J904
M2L903
M2K904
M2J905
M2L904
M2K905
M2J906
M2L905
M2K906
M2J907
M2L906
M2K907
M2J908
M2L907
M2K908
M2J909
M2L908
M2K909
M2J910
M2L909
M2K910
M2J911
M2L910
M2K911
M2J912
M2L911
M2K912
M2J913
M2L912
M2K913
M2J914
M2L913
M2K914
M2J915
M2L914
M2K915
M2J916
M2L915
M2K916
M2J917
M2L916
M2K917
M2J918
M2L917
M2K918
M2J919
M2L918
M2K919
M2J920
M2L919
M2K920
M2J921
M2L920
M2K921
M2J922
M2L921
M2K922
M2J923
M2L922
M2K923
M2J924
M2L923
M2K924
M2J925
M2L924
M

PEMBROKE ROAD
SW 18TH ST.
SW 19TH ST.
SW 20TH ST.
SW 21ST ST.
SW 22ND ST.
SW 40TH AVE.
SW 20TH CT.
TOWN BORDER
2583 LF 4" HDPE 02L35F1
2583 LF 4" HDPE 02L35F1
2583 LF 4" HDPE 02L35F1
LS-35
LS-39
LS-39 PRIVITE
LS-38
LS-38 SENECA
W-23
M35D1
110 LF 8" PVC 02L35D1
M35A3
394 LF 8" PVC 02L35SA3
M35A2
95 LF 8" PVC 02L35SC1
286 LF 8" PVC 02L35SA2
M35C1
M35A1
20 LF 8" PVC 02L35SA1
02L35J2
9 LF 4" PVC 02L35F2
02L35J1
270 LF 8" PVC 02L35SA4
M35A4
219 LF 8" PVC 02L35SA5
M35A5
326 LF 8" PVC 02L35SB1
M35B1
749 LF 2" PVC 02L39F1
1,100 LF 2" PVC 02L38F1
02L39J1
76 LF 8" PVC 02L39SA1
M39A1
346 LF 8" PVC 02L39SA2
M39A2
M38B3
395 LF 8" PVC 02L38SB3
M38B2
300 LF 8" PVC 02L38SB2
M38B1
300 LF 8" PVC 02L38SB1
24 LF 8" PVC 02L38SA1
02L38J1
M38A1
M36A11
339 LF 8" PVC 02L36SA11
M36A10
88 LF 8" PVC 02L36SA10
M36A9
87 LF 8" PVC 02L36SA9
M36A8
292 LF 8" PVC 02L36SA8
96 LF 8" PVC 02L36SH1
M36H1
M36A7
299 LF 8" PVC 02L36SA7
M36A6
90 LF 8" PVC 02L36SA6
M36A5
84 LF 8" PVC 02L36SA5
M22E1
208 LF 6" PVC 02L22SE1
70 LF 8" PVC 02L22SB1
M22A1

SEE SHEET C-03 FOR CONTINUATION
SEE SHEET C-04 FOR CONTINUATION
SEE SHEET C-09 FOR CONTINUATION

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
08 OF 14

LEGEND:
-1.7 INVERT ELEVATION NAVD88
M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:
FORCE MAIN PIPE
GRAVITY SEWER PIPE
GRAVITY SEWER MANHOLE
LIFT STATION WETWELL
PRESSURE JUNCTION

N
0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP
C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

P:\Civil_Projects\Town_Of_Pembroke_Park\08-22-025-19\Sheet Files\SHEETS\08-22-025-C-08-MUSA.dwg, 12/10/2024 1:55:57 PM, Josh.Yi

SEE SHEET C-08 FOR CONTINUATION

SEE SHEET C-04 FOR CONTINUATION

SEE SHEET C-05 FOR CONTINUATION

SEE SHEET C-10 FOR CONTINUATION

SW 23RD ST.
SW 24TH ST.
SW 25TH ST.
SW 26TH ST.
SW 27TH ST.
SW 40TH AVE.
SW 38TH AVE.
SW 32ND AVE.
TOWN BORDER
TOWN BORDER
M38C2
395 LF 8" PVC
02L38SC2
M38C1
300 LF 8" PVC
02L38SC1
M38A2
395 LF 8" PVC
02L38SA2
382 LF 8" PVC
02L38SA3
M38A3
396 LF 8" PVC
02L38SA4
M38A4
395 LF 8" PVC
02L38SA5
M38A5
225 LF 8" PVC
02L38SA6
81 LF 8" PVC
02L38SA7
M38A7
308 LF 8" PVC
02L38SA8
M38A6
191 LF 8" PVC
02L38SD1
M38D1
184 LF 8" PVC
02L38SD2
M38D2
M38D3
75 LF 8" PVC
02L38SD3
229 LF 8" PVC
02L36SI2
M36H2
213 LF 8" PVC
02L36SI3
M36H3
220 LF 8" PVC
02L36SA4
M36A3
305 LF 8" PVC
02L36SE1
354 LF 8" PVC
02L36SA3
M36A2
310 LF 8" PVC
02L36SA2
M36C5
220 LF 8" PVC
02L36SC5
M36C4
227 LF 8" PVC
02L36SC4
LS-36
SENEGA LS
LS-36
02L36J4
M36A1
76 LF 12"
02L36SA1
304 LF 4"
02L36SB1
279 LF 8" PVC
02L36SB1
M36C3
310 LF 8" PVC
02L36SC3
M36C2
271 LF 8" PVC
02L36SC2
M36C1
190 LF 8" PVC
02L36SC1
M36B1
188 LF 8" PVC
02L36SD1
M36D1
SENEGA LS
232 LF 8" N/A
02L36S01
M36G1
235 LF 8" PVC
02L36S02
M36G2
327 LF 8" PVC
02L36SB2
M36B2
325 LF 8" PVC
02L36SB3
M36B3
DIP 4" 02L0
194 LF 4"
SW 32ND AVE.
570 LF 2"
02L48F1
M36I1
300 LF 8" PVC
02L36SI1
188 LF 8" PVC
02L36SB4
M36B4

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
09 OF 14

LEGEND:
-1.7 INVERT ELEVATION NAVD88
M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:
FORCE MAIN PIPE
GRAVITY SEWER PIPE
GRAVITY SEWER MANHOLE
LIFT STATION WETWELL
PRESSURE JUNCTION

N

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP
C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

SEE SHEET C-09 FOR CONTINUATION

SEE SHEET C-05 FOR CONTINUATION

SEE SHEET C-06 FOR CONTINUATION

SW 28TH ST.

SW 40TH AVE.

TOWN BORDER

HALLANDALE BEACH BLVD.

308 LF 8" PVC
02L38J48
7.0
M38A8

02L48J1

LS-48

LS-33

LS-45

LS-12

LS-11

LS-10

LS-4

32 LF
2" PVC
02L33F2
02L33J2
02L33J1

821 LF1 8" ACP
02L33F1

02L45F2
39 LF
2" PVC
LS-45
02L12J2
02L45J2
02L45F1
118 LF 8" ACP
02L45J1
30 LF
4" PVC
02L12J1

02L12F2
02L11J1
02L11F2
41 LF
3" DIP
02L12F1
3764 LF 8" ACP
02L11J1
494 LF4 8" ACP
02L10J2

02L10J3
02L10F3
238 LF 6" PVC
5.5
104 LF
6" N/A
6.0
M10A2
M10A1
02L10SA1
02L10SA2
37 LF
3" DIP
TOWN BORDER
598 LF 8" ACP
02L10F2
02L10J1

SW 30TH ST.

1394 LF 4" DIP
02L36F41
02L36J3

1401 LF 8" DIP
02L36F1

M4G3
6.2
100 LF
6" CLAY
02L45G3
W LAKE DR.
M4G2
5.4

SW 31ST ST.

SW 37TH TERR.

SW 37TH AVE.

SW 36TH AVE.

SW 35TH AVE.

SW 34TH AVE.

SW 33RD AVE.

SW 32ND AVE.

359 LF 6" CLAY
02L45G2
TOWN BORDER
M4G1
3.0

SW 31ST CT.

SW 40TH AVE.

345 LF 6" CLAY
02L45G1
M4F1
02L4J5
M4A
0.1
18 LF 6" CLAY
02L45A2
M4A2
0.3
02L4J4
02L4F5
30 LF
4" DIP
400 LF 6" CLAY
02L45H1
753 LF 4" ACP
02L4F4
2.5
M4H1

SW 32ND ST.

SW 32ND CT.

SW 32ND AVE.

TOWN BORDER

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
10 OF 14

LEGEND:

-1.7-	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK


LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

N

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP
C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

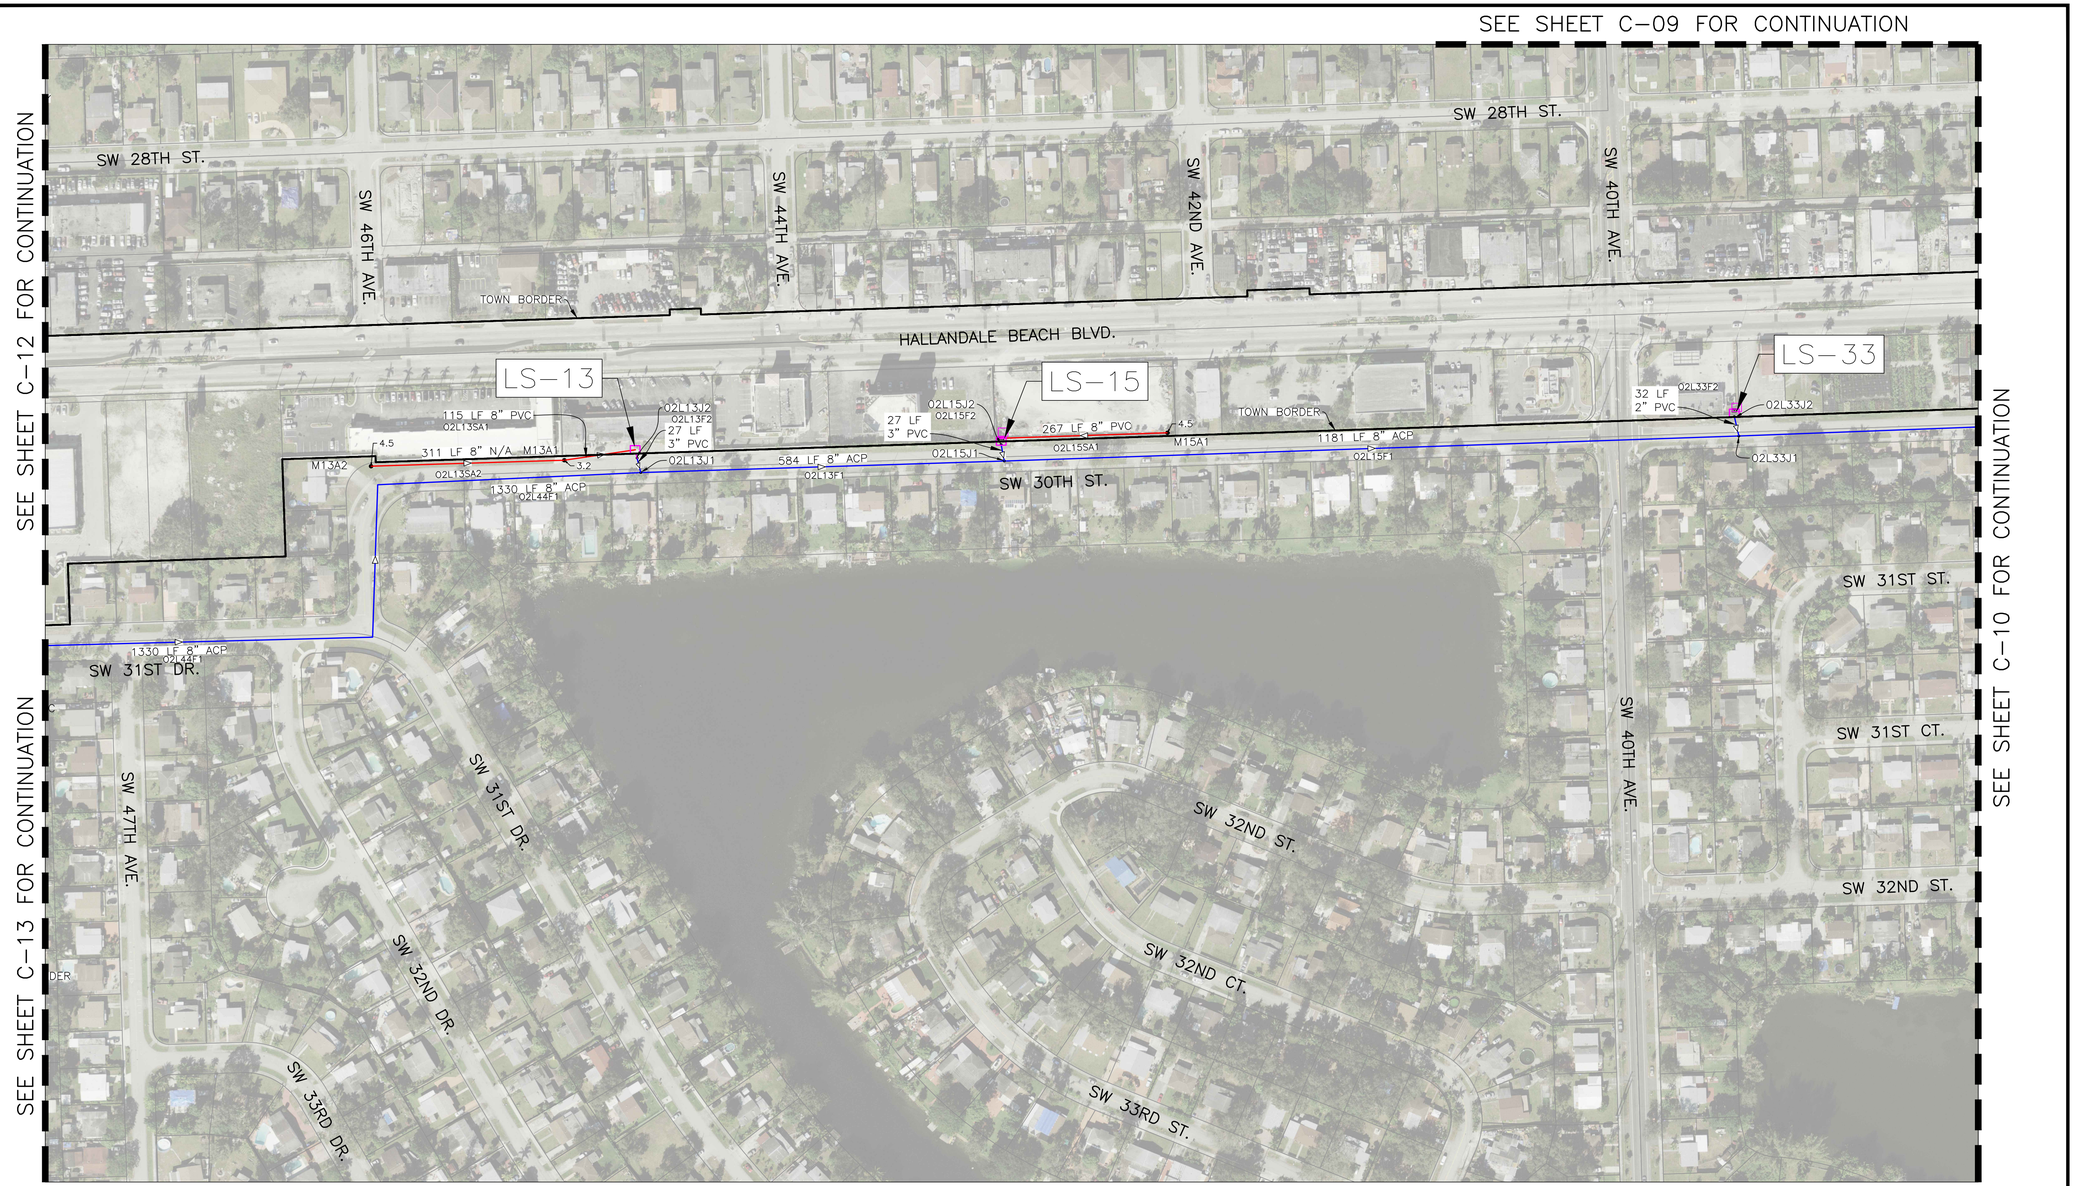

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
11 OF 14

LEGEND:

-1.7-	INVERT ELEVATION NAVD88
M14M4	MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2	GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2	FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1	PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1


UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:

- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

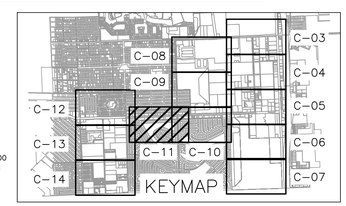

TOWN BORDER
SEPTIC TANK
SEPTIC TANK
SEPTIC TANK
SEPTIC TANK
SW 25TH CT.
SW 25TH ST.
SW 26TH ST.
SW 27TH ST.
SW 28TH ST.
SW 28TH ST.
SW 56TH AVE.
SW 55TH AVE.
SW 54TH AVE.
SW 53RD AVE.
SW 50TH TERR.
SW 48TH AVE.
SW 52ND AVE.
HALLANDALE BEACH BLVD.
M14M5
5.0 145 LF 6" CLAY 3.5 M14A13 01L14SA13 M14A12
375 LF 8" CLAY 01L14SA12
2.0 M14A11
308 LF 8" CLAY 01L14SBB1
3.3 M14BB1
246 LF 8" CLAY 01L14SBB2
4.2 M14BB2
191 LF 6" CLAY 01L14SBB3 5.2 M14BB3
M14S6 5.8
138 LF 8" CLAY 01L14SA10
1.2
4.8 190 LF 8" CLAY M14AA2 01L14SAA2 3.9 248 LF 8" CLAY M14AA1 01L14SAA2
M14A10
321 LF 8" CLAY 01L14SZ1
4.2 M14Z1
324 LF 8" CLAY 01L14SZ2
5.5 M14Z2
286 LF 8" 01L14SS6
345 LF 8" CLAY 01L14SM5
205 LF 8" 01L14SY10
4.7
M14M4 319 LF 8" CLAY 3.0 115 LF 6" CLAY M14M3 01L14SM4 01L14SQ1 M14Q1
M14A9
0.4 202 LF 8" CLAY 4.8 M14Y1 01L14SY1
M14X2 3.3
118 LF 6" CLAY 3.7 M14W1 01L14SW1 4.2
280 LF 8" CLAY M14S4 01L14SS5 M14S5
130 LF 6" CLAY 01L14SR1
4.3
4.3
M14R1 4.4
209 LF 8" CLAY 01L14SS4
249 LF 8" CLAY 01L14SG
203 LF 8" CLAY 01L14SV2
209 LF 8" CLAY 01L14SK7
M14X1 2.0
2.9 244 LF 8" CLAY 3.9 M14S3 01L14SV1 M14V1
3.8 199 LF 8" CLAY 2.2 M14P1 01L14SP1 M14M2
M14A8
-0.6
247 LF 8" CLAY 01L14SK8
246 LF 8" CLAY 01L14SK1
211 LF 8" CLAY 01L14SS3
216 LF 8" CLAY 01L14SW2
M14T2 3.3
76 LF 6" CLAY 01L14ST2
2.5 M14O1
135 LF 6" CLAY 01L14SO1
0.9 M14N1 327 LF 8" CLAY 01L14SN1 -0.4 M14M1 294 LF 8" CLAY 01L14SM1 -1.6 M14A7 248 LF 8" CLAY 01L14SS1 -1.0 M14S1 288 LF 8" CLAY 01L14SS2 M14S2 2.1 276 LF 8" CLAY 01L14ST1 3.1 M14T1
85 LF 6" CLAY 01L14SU1
79 LF 6" CLAY 01L14SN2
131 LF 8" CLAY 01L14SA7
M14U1 3.5
2.5 M14N2
1.5 M14I3
64 LF 8" CLAY 01L14SA6 M14A6 -0.5
M14J4 1.4
1.5 234 LF 8" PVC M14K2 01L14SK2 0.6 M14K1 261 LF 8" PVC 01L14SK1 -2.4 M14A5 327 LF 8" PVC 01L14SL1 -0.1 M14L1 355 LF 8" PVC 01L14SL2 M14L2 -1.5
227 LF 8" PVC 01L14SI3
58 LF 8" PVC 01L14SA4
172 LF 8" CLAY 01L14SA5
245 LF 8" PVC 01L14SJ4
68 LF 8" PVC 01L14SA3
0.3
LS-42
01L42J1
TOWN BORDER
0.5 M14I2 310 LF 8" PVC 01L14SI2 01L42F1 -0.8 306 LF 8" PVC M14I1 01L14SI1 -3.1 M14A4 255 LF 8" PVC 01L14SJ1 -1.9 M14J1 303 LF 8" PVC 01L14SJ2 -0.7 247 LF 8" PVC M14J2 01L14SJ3 M14J3
1075 LF 4" DIP 01L42F1
290 LF 8" CLAY
93 LF 8" CLAY 01L14SC2 -2.7 M14C1 01L14SC1 M14A2 -3.6 M14A3
102 LF 8" CLAY 01L14SA2
LS-42
-2.4 M14C2
-2.3 M14C3
23 LF 8" CLAY 01L14SC3
01L17F1
296 LF 8" DIP
-4.0 01L14F2
-1.7 M14B1 286 LF 8" CLAY 01L14SB2 -1.4 M14B2
01L14J2
01L14J3
15 LF 8" DIP 01L14J3
M14A1
307 LF 10" CLAY 01L14SB1
3 LF 10" 01L14SA1
LS-14
01L40F2
01L43J1
LS43
533 LF 2" PVC 01L43F1
315 LF 8" CLAY 01L14SC1
SW 52ND AVE.
01L14F2
LS-44
01L44J2
124 LF 2" PVC 02L44F2
-1.4 M14C4
SEE SHEET C-11 FOR CONTINUATION
SEE SHEET C-13 FOR CONTINUATION

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

LEGEND:
-1.7 INVERT ELEVATION NAVD88
M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

LEGEND:
FORCE MAIN PIPE
GRAVITY SEWER PIPE
GRAVITY SEWER MANHOLE
LIFT STATION WETWELL
PRESSURE JUNCTION

N
0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP
C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

PROJECT NUMBER
08-22-025
12 OF 14

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

P:\Civil_Projects\Town Of Pembroke Park\08-22-025 - PEMBROKE PARK WATER & SEWER\Drawings\Working\08-22-025-C-12 ATLAS.dwg, 12/19/2024 9:01:25 AM, Jack.H

SEE SHEET C-12 FOR CONTINUATION

SEE SHEET C-11 FOR CONTINUATION

WILLIAM RD.
MARION RD.
ALLEN RD.
EDMUND RD.
MIAMI GARDENS RD.
SW 56TH AVE.
SW 55TH AVE.
SW 52ND AVE.
SW 48TH AVE.
SW 47TH AVE.
SW 32ND ST.
SW 32TH ST.
SW 33TH ST.
SW 33RD ST.
SW 34TH ST.
SW 31ST DR.
SW 36TH ST.
TOWN BORDER

LS-37
LS40

INTERCONNECT/TIE IN/OUTFALL WITH BROWARD COUNTY (01)

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
13 OF 14

LEGEND:
-1.7 —— INVERT ELEVATION NAVD88
M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1-LS14-SEWER BRANCH A-PIPE 2
01L14F2 FORCE MAIN: OUTFALL1-LS14-FORCEMAIN 2
02L15J1 PRESSURE JUNCTION: OUTFALL1-LS15-JUNCTION1

SEE SHEET C-14 FOR CONTINUATION

UPDATED WASTEWATER MASTER PLAN ATLAS


TOWN OF PEMBROKE PARK

LEGEND:
FORCE MAIN PIPE
GRAVITY SEWER PIPE
GRAVITY SEWER MANHOLE
LIFT STATION WETWELL
PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

KEYMAP
C-03 C-04 C-05 C-06 C-07 C-08 C-09 C-10 C-11 C-12 C-13 C-14

SEE SHEET C-13 FOR CONTINUATION

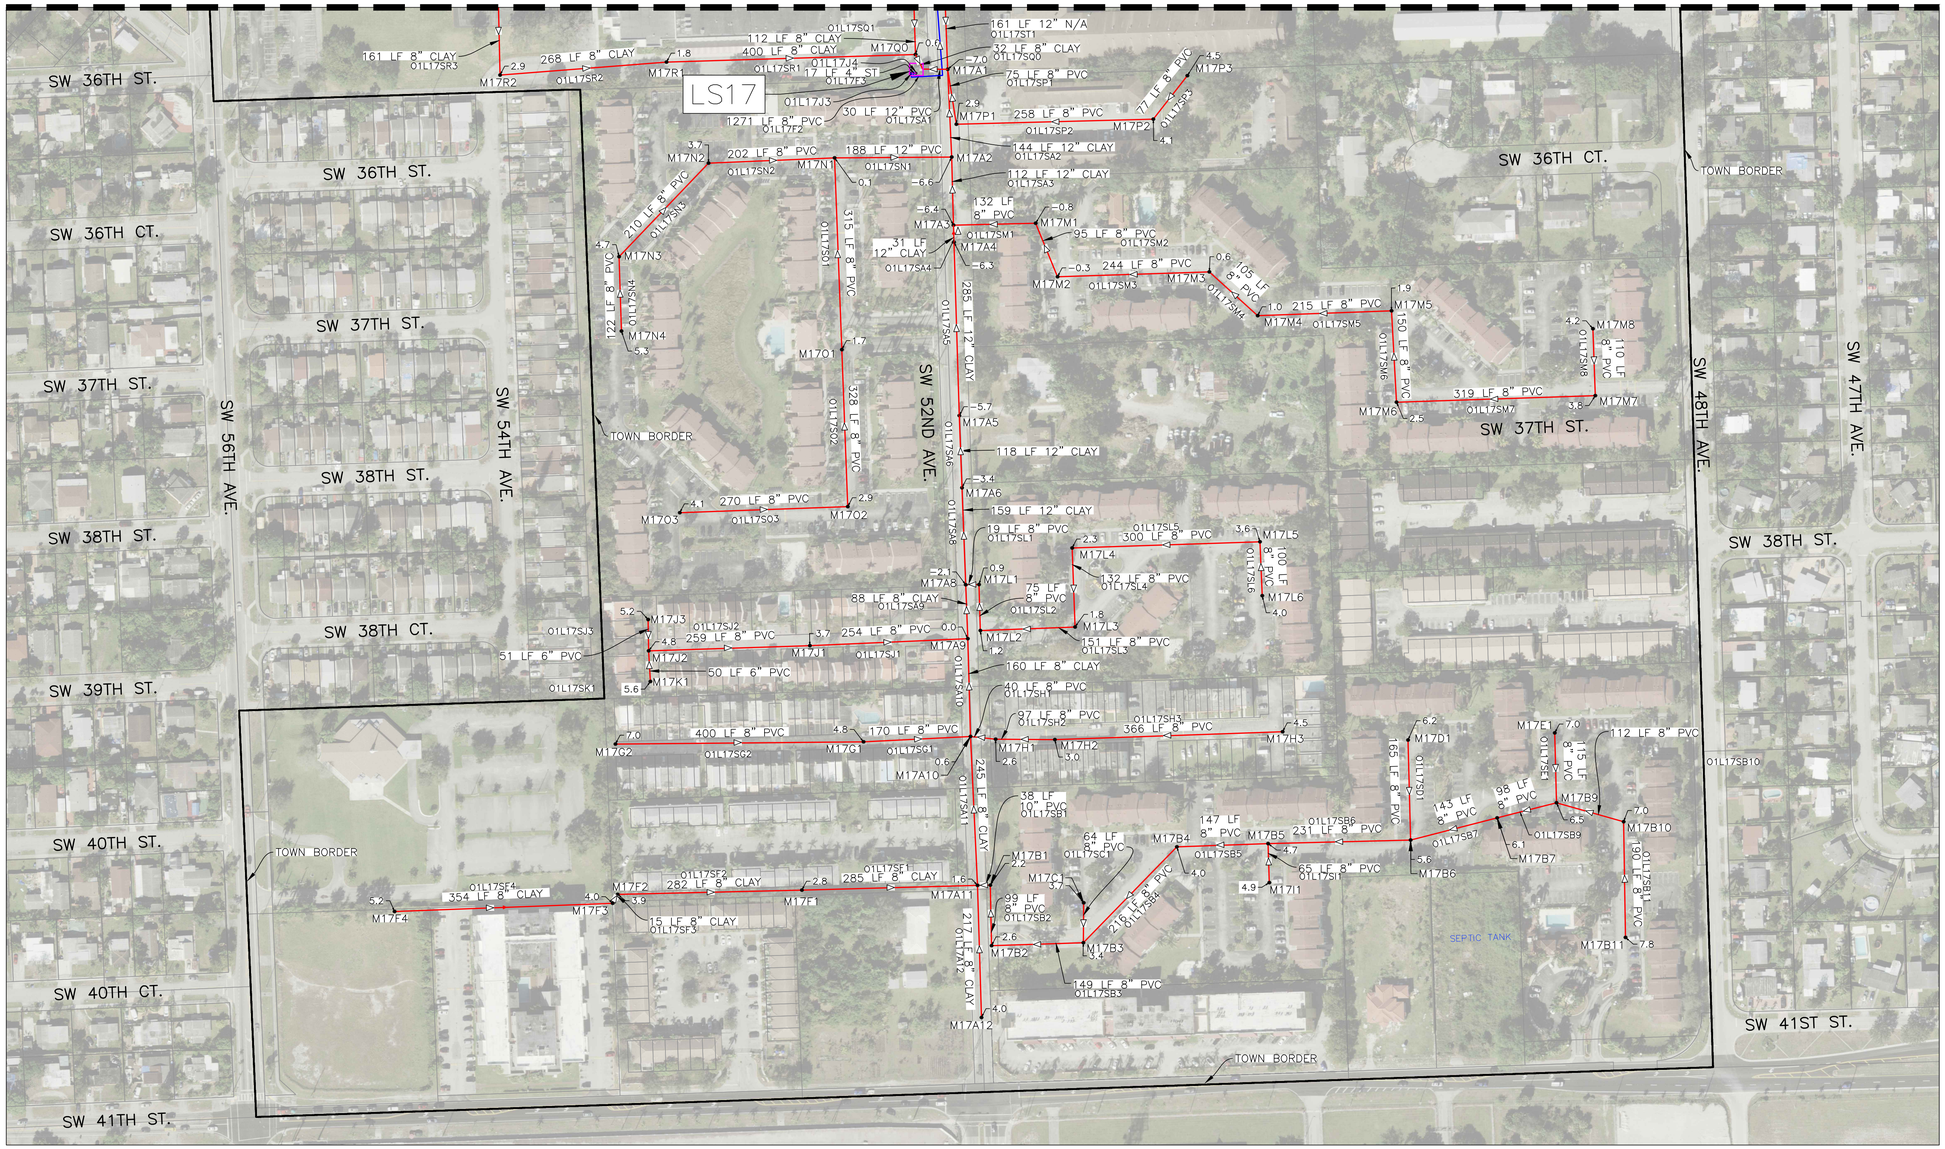

BROWARD COUNTY FUTURE CONDITIONS AVERAGE WET SEASON GROUND WATER ELEVATION MAP: 1FT NAVD88
ALL ELEVATIONS ARE IN NAVD 88

PROJECT NUMBER
08-22-025
14 OF 14


LEGEND:
- –1.7 —— INVERT ELEVATION NAVD88
- M14M4 MH LABEL: LS 14; BRANCH "M"; 4TH BRANCH MH
- 01L14SA2 GRAVITY SEWER LABEL: OUTFALL 1–LS14–SEWER BRANCH A–PIPE 2
- 01L14F2 FORCE MAIN: OUTFALL1–LS14–FORCEMAIN 2
- 02L15J1 PRESSURE JUNCTION: OUTFALL1–LS15–JUNCTION1

UPDATED WASTEWATER MASTER PLAN ATLAS

TOWN OF PEMBROKE PARK

LEGEND:
- FORCE MAIN PIPE
- GRAVITY SEWER PIPE
- GRAVITY SEWER MANHOLE
- LIFT STATION WETWELL
- PRESSURE JUNCTION

0 50 100 200
HORIZONTAL GRAPHIC SCALE

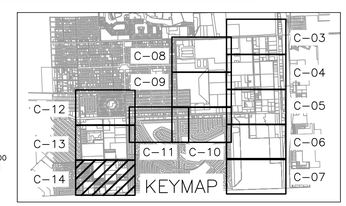

Agenda Item Report

Subject:	Stormwater Master Plan - Kimley-Horn and Associates, Inc.
Meeting Date:	Agenda for Special Commission Meeting - February 1, 2025
Prepared For:	Town Commission
Staff Contact:	Stanley Merantus, Public Services Director
Dept/Group:	Public Works
Recommendation for Counsel to consider:	
Background Information:	Presentation of the Stormwater Master Plan
Staff Recommendations:	
Financial Implications:	There is no financial impact.
Alternatives:	

ATTACHMENTS:

Pembroke Park SWMP Update

TOWN OF PEMBROKE PARK

STORMWATER MASTER PLAN



Kimley»Horn

EXECUTIVE SUMMARY

The Town of Pembroke Park (Town) is located in southeast Broward County, Florida and was defined by charter in 1959. In July of 2001, Craig A. Smith & Associates completed a Storm Water Master Plan for the Town to identify corrective actions required to resolve existing flooding conditions in the Town as well as to address any poor water quality conditions. In 2024, the Town had retained Kimley-Horn and Associates, Inc. to prepare this update to the 2001 Stormwater Master Plan to identify additional areas of concern.

Stormwater management and operations within the vicinity of the Town are separated into a three-tiered system, in which the South Florida Water Management District (SFWMD), Broward County, and the Town all play a part in maintaining water quality, limiting discharge, and mitigating flooding.

The purpose of creating this plan is to identify opportunities to protect surface water quality and reduce flooding within the limits of the Town as well as increment the resiliency and prioritize the parts of the project that will have the greatest impacts to the Town.

This Stormwater Master Plan includes the following components:

- An updated review of existing stormwater and drainage data, reports, plans, and regulations available through the Broward County, SFWMD and Town sources.
- An updated drainage atlas of existing drainage structures and their conditions as provided by the Town.
- An updated existing conditions baseline level of service performance in identified priority areas.
- Hydrologic and hydraulic modeling analysis of the existing systems and their capacity to handle the 10-year/3-day, 25-year/3-day and 100-year/3-day storm events.
- Identification and analysis of alternatives for improvements needed to alleviate deficiencies identified in the hydrologic and hydraulic modeling process.
- An optional Capital Improvement Plan to implement improvements in areas identified as priorities.
- Identification and prioritization of stormwater infrastructure improvements that serve as the basis for flood mitigation and increase in resiliency.
- Model of the increase control elevations to emulate future conditions and project resiliency.

Based on a review of the drainage deficiencies identified, input from Town staff, and Town residents, nine (9) project areas were selected as a priority for detailed analysis through hydrologic and hydraulic modeling. Prior to modeling and evaluating the priority projects, minimum performance goals were identified to be as follows:

- During the 10-year return design storm event, flooding in roadway travel lanes should be below the crown of the roadway.
- During the 100-year return storm event, flooding should be below the building finish floor elevations.
- During the 25-year return storm event, discharge to outfalls should be at or below the limits set by the SFWMD.
- During the 25-year return storm event, offsite discharge rates are not to cause adverse impacts to offsite properties, not exceed historic rates, not exceed rates determined by previous permits, nor rates specified by SFWMD's criteria.
- There should be no net encroachment into floodplains at the base flood elevation of the Broward County 100-year storm event.
- Storage upstream of outfalls should allow for the greater value of water quality volume between the first one inch of runoff over the basin area or 2.5 inches times the percent impervious area. Water quality pre-treatment is required for the first one inch of runoff.

Projects to bring each of the priority areas into compliance with the performance goals were identified and all were ranked from worst to best according to current performance against goals to help determine which ones should be constructed sooner.

The ranking and budgets for improvements for each basin were used to develop a 10-year Capital Improvement Plan. The average annual budget for the 10-year CIP is $11,627,923. The CIP includes an annual budget of $200,000+ for operations and maintenance costs such as cleaning catch basins, pipes and exfiltration trench, swale maintenance, street sweeping, participation in federally mandated programs, minor repairs, and administration.

TABLE OF CONTENTS

Executive Summary i
Table of Contents iii
List of Tables v
list of Figures vi
List of Abbreviations vii
Introduction 1
I. Stormwater Management Background 1
II. Stormwater Master Plan Goals 2
Data Review 3
I. Review of Available Data and Existing Conditions 3
A. Town of Pembroke Park Stormwater Master Plan (2001) 3
B. Broward County Resilience Plan (Ongoing) 4
C. Existing Stormwater Regulation 4
D. Environmental Clean Up 5
E. Wellfields 5
F. Soils 5
G. Land Use Break Down 6
H. Groundwater 7
II. Existing Stormwater Management System Data Review 7
A. Town Geographic Information System (GIS) Data 7
B. As-Built Plans and Completed Projects 7
C. Existing Permits 7
D. Townwide Pump System 8
E. Summary of Completed Stormwater Projects 10
F. Identification of Drainage Deficiency Areas 10
Drainage Analysis 14
A. Methodology 14
B. Water Quality Treatment Performance Goals 14
C. Water Quantity Performance Goals 15
D. Sub-Basins 15
E. Model Assumptions 16
III. Project Area Analysis 17
A. Infinity Azure 20
B. Park Road – North Part I 22
C. Park Road – North Part II 25
D. Park Road – South 28
E. SW 55th Avenue 31
F. SW 36th Court 33
G. SW 52nd Avenue 36
H. SW 31st Avenue – North 39
I. SW 31st Avenue - South 42
Capital Improvement Program 45
I. Background 45
II. Operation and Maintenance Plan 45
A. Street Sweeping 45
B. Catch Basin Maintenance 45
C. Pipe Flushing and Exfiltration Trench Cleaning 46
D. Swale Inspection, Maintenance, and Restoration 46
E. Lake Inspection and Water Quality Monitoring 46
F. Minor Repairs and Improvements 46

G. Stormwater Pump Maintenance 46
III. MS4 Compliance 46
IV. Operation and Maintenance Cost 47
A. Utility Fee Collection 47
V. Green Initiatives 48
VI. Drainage Capital Projects 48
A. Priority Ranking 49
B. Stormwater Capital Improvement Summary 50
Appendix A – Townwide Exhibits 1
Appendix B – Proposed Improvements Exhibits ..... B
Appendix C – Pollutant Reduction Summaries C
Appendix D – Hydrologic and Hydraulic Model Inputs ..... D

LIST OF TABLES

Table 1. Town Drainage Improvement Projects 8
Table 2. KHA Observed Flooding 13
Table 3. Rainfall Depths per Storm Event 18
Table 4. Infinity Azure Performance Goal Analysis 21
Table 5. Infinity Azure Pollutant Loading Analysis 21
Table 6. Infinity Azure Capital Improvement Costs 21
Table 7. Park Road – North Part I - Performance Goal Analysis 23
Table 8. Park Road – North Part I - Pollutant Loading Analysis 23
Table 9. Park Road – North Part I - Capital Improvement Costs 24
Table 10. Park Road – North Part II Performance Goal Analysis 26
Table 11. Park Road – North Part II Pollutant Loading Analysis 26
Table 12. Park Road – North Part II Capital Improvement Costs 27
Table 13. Park Road – South Performance Goal Analysis 29
Table 14. Park Road – South Pollutant Loading Analysis 29
Table 15. Park Road – South Capital Improvement Costs 30
Table 16. SW 55th Avenue Performance Goal Analysis 32
Table 17. SW 55th Avenue Pollutant Loading Analysis 32
Table 18. SW 55th Avenue Capital Improvement Costs 32
Table 19. SW 36th Court Performance Goal Analysis 34
Table 20. SW 36th Court Pollutant Loading Analysis 34
Table 21. SW 36th Court Capital Improvement Costs 35
Table 22. SW 52nd Avenue – Performance Goal Analysis 37
Table 23. SW 52nd Avenue Pollutant Loading Analysis 37
Table 24. SW 52nd Avenue Capital Improvement Costs 38
Table 25. SW 31st Avenue – North Performance Goal Analysis 40
Table 26. SW 31st Avenue – North Pollutant Loading Analysis 40
Table 27. SW 31st Avenue – North Capital Improvement Costs 41
Table 28. SW 31st Avenue – South Performance Goal Analysis 43
Table 29. SW 31st Avenue – South Pollutant Loading Analysis 43
Table 30. SW 31st Avenue – South Capital Improvement Costs 44
Table 31. Project Prioritization Matrix 49
Table 32. Proposed CIP Budgets & Schedule 51

LIST OF FIGURES

Figure 1. Town Boundary Map 2
Figure 2. Wellfield Protection Zone Map 5
Figure 3. NRCS Soil Survey 6
Figure 4. Future Land Use Map 6
Figure 5. Existing Stormwater Pump Location Map 9
Figure 6. Proposed Stormwater Pump Location Map 10
Figure 7. Field Visit Locations 11
Figure 8. Sub-Basin Map 16
Figure 9. 10-Year/24-Hour Flooding Heat Map 17
Figure 10. Infinity Azure Project Location 20
Figure 11. Park Road – North Part I - Project Location 22
Figure 12. Park Road – North Part II Project Location 25
Figure 13. Park Road – South Project Location 28
Figure 14. SW 55th Avenue Project Location 31
Figure 15. SW 36th Court Project Location 33
Figure 16. SW 52nd Avenue Project Location 36
Figure 17. SW 31st Avenue – North Project Location 39
Figure 18. SW 31st Avenue - South Project Location 42

LIST OF ABBREVIATIONS

BCWPA	Broward County Water Preserve Area
BMP	Best Management Practice
CERP	Comprehensive Everglades Restoration Plan
CFS	Cubic Feet per Second
CIP	Capital Improvement Plan
CRS	Community Rating System
FDEP	Florida Department of Environmental Protection
FDOT	Florida Department of Transportation
FFE	Finished Floor Elevation
EFA	Everglades Forever Act
EPA	U.S. Environmental Protection Agency
GIS	Geographic Information System
HDPE	High Density Polyethylene
ICS	Intermediate Control Structure
KHA	Kimley-Horn and Associates, Inc.
LOS	Level of Service
MS4	Municipal Separate Storm Sewer System
NFIP	National Flood Insurance Program
NOAA	National Oceanic and Atmospheric Administration
NPDES	National Pollutant Discharge Elimination System
O&M	Operation and Maintenance
OFW	Outstanding Florida Waters
OPC	Opinion of Probable Cost
SWMP	Stormwater Master Plan
SFWMD	South Florida Water Management District
USGS	United States Geological Survey
WCA	Water Conservation Area
WPA	Water Preserve Area
WQBEL	Water Quality-Based Effluent Limit

INTRODUCTION

The Town of Pembroke Park (Town) is approximately 1.6 square miles in area and located in southeast Broward County, Florida. Refer to Figure 1 for a map of the Town limits. The Town was incorporated in 1959, and currently has a population of approximately 6,300 residents. Pembroke Park was once an area filled with nurseries, quarries, and mobile home parks. While there are still remnants of the old land uses still present, for example the old rock quarries have been converted to scenic lakes, the Town today consist mostly of commercial use properties to the northeast and residential properties to the southeast and west. Pembroke Park is bordered by Dade County to the south, Hallandale Beach to the east, Miramar to the west, and Hollywood to the north. The position of the Town grants the residents convenient access to I-95 and the Florida Turnpike and has allowed the Town to attract modern warehouses and businesses to its industrial areas.

This growth did not happen all at once. The adoption of a "Comprehensive Land Use Plan" in 1989 by the Town commission has guided the structured growth and development of Pembroke Park. The Town hosts 17 mobile home parks, including four recreational vehicle camping parks, maintaining a stable number of mobile homes annually. New apartments, villas, and townhomes have been developed on the town's western edge. Four passive parks have been recently created at both ends of the town, providing recreational space for all nearby residents.

Looking ahead, Pembroke Park is optimistic about its future, attributed to strategic planning and sound financial management. Town leaders, along with planning consultants and the Planning and Zoning Board, ensure that building standards and the quality of life are maintained, specifically those pertaining to stormwater. The Mayor, Town Commission, Town Manager, and other development professionals are dedicated to making Pembroke Park a vibrant and beautiful community within South Broward. The town aims to continue improving human and social services well into the future.

I. Stormwater Management Background

The Town of Pembroke Park is committed to effective stormwater management and has consistently maintained its stormwater flows to the C-10 canal to prevent overburdening the SFWMD system. This dedication ensures that the regional water management infrastructure operates efficiently, demonstrating the Town's proactive approach to mitigating flooding and its responsible stewardship of local water resources.

Stormwater management and operations within the vicinity of the Town are separated into a three-tiered system. The first tier encompasses SFWMD and its management and operation of the regional drainage canals. The second tier consists of Broward County management and operation. And its third tier is comprised of drainage infrastructure through the roadways managed and operated by the Town of Pembroke Park and private landowners.

The Town of Pembroke Park sits within SFWMD's C-9 East Basin, meaning that its stormwater is conveyed to the C-10 Canal operated by SFWMD, by way of stormwater pumps that lead to an FDOT inlet and stormwater pump station which eventually reaches the C-10 Canal. The Town manages the stormwater system upstream of these canals.

The Town experiences challenges mitigating flooding primarily due to several factors: the absence of canals within the town limits for specific site discharge, the lack of drainage easements or public rights-of-way for adding exfiltration trenches, and the relatively low roadway elevations compared to the seasonal high water table, which hampers the effectiveness of underground storage options such as exfiltration trenches. Despite these challenges, the Town remains a good regional partner, working collaboratively with neighboring towns to address and mitigate flooding issues in the broader area.

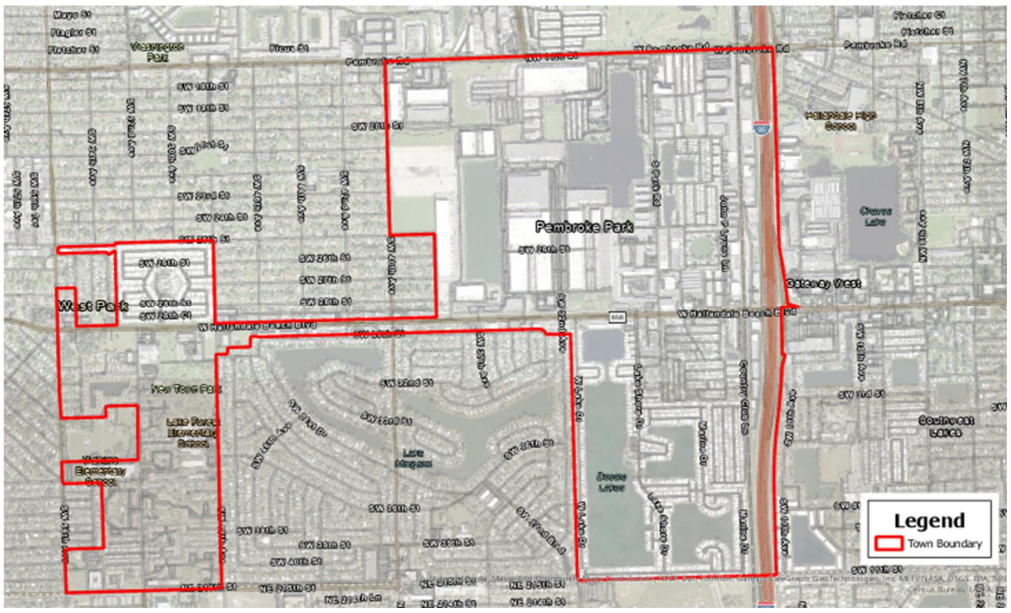


Figure 1. Town Boundary Map

II. Stormwater Master Plan Goals

The purpose of this Stormwater Master Plan is to identify opportunities to protect surface water quality and reduce flooding within the limits of the Town of Pembroke Park, Florida.

The Stormwater Master Plan includes the following components:

- An updated review of existing stormwater and drainage data, reports, plans, and regulations available through SFWMD, BCSWM, and Town sources.
- An updated drainage atlas of existing drainage structures and their conditions.
- An updated existing conditions baseline of the level of service performance in identified priority project areas.
- Hydrologic and hydraulic modeling analysis of the existing systems and their capacity to handle the 10-year/24-hour, 25-year/3-day and 100-year/3-day storm events.
- Identification and analysis of alternatives for improvements needed to alleviate deficiencies identified in the hydrologic and hydraulic modeling process.
- An optional CIP to implement improvements in areas identified as priorities.


DATA REVIEW

I. Review of Available Data and Existing Conditions

KHA collected available data on the existing stormwater management system within and connected to the Town of Pembroke Park as the first step in developing the SWMP. In-depth research was integral to the development of this report with information collected from local, regional, State, and national sources. Information was sourced from Broward County, the SFWMD, FDEP, United States Geological Survey (USGS), in-person site visits, and the Town of Pembroke Park.

A. Town of Pembroke Park Stormwater Master Plan (2001)

The original SWMP document was developed in July of 2001 by Craig A. Smith & Associates. The purpose was to provide the Town with a comprehensive stormwater master plan and identify corrective actions to address flood conditions while looking at water quality. Utilizing this information, a Comprehensive Storm Water Conveyance Plan was developed, and deficient storm water areas were evaluated for future development into the Town's overall infrastructure. The Town had already undertaken efforts to relieve areas inundated with flooding by retrofitting existing storm water systems and installing storm water pump stations.

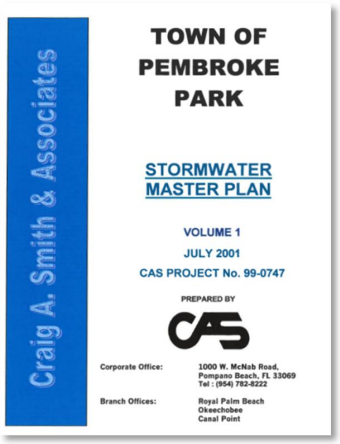

Through the application of Federal, State, County, and Local guidelines and the adoption of the Storm Water Ordinance, the Storm Water Master Plan was intended to serve as a systematic approach to decrease storm water runoff, increase water quality, maximize the efficiency of the existing storm water system through Best Management Practices, and reduce and enhance areas within the Town prone to flooding.

The collection of these storm water management utility fees, along with other financial resources, was necessary to offset the costs of storm water capital improvements within the Town. The Town was engaged in ongoing negotiations with the Florida Department of Transportation for necessary discharge rates and local landowners for waterway conveyance rights, which continued to affect the Town's current storm water conditions.

The following is the list of identified projects from the previous Stormwater Master Plan:

- Television Park Development
- SW 48th Avenue (North)
- SW 48th Avenue (South)
- Town Lake Homes Subdivision
- Pembroke Park Preserve
- SW 52nd Avenue (North)
- SW 52nd Avenue (South)
- SW 40th Avenue
- County Line Road
- Meekins Lake Pump Station
- SW 19th Street
- Carolina Street
- Park Road (South)
- SW 31st Avenue (North)
- SW 31st Avenue (South)
- Behan Lake Pump Station

- Lake Shore Manor Pump Station
- Green Acres Pump Station
- SW 10th Street Pump Station
- SW 30th Avenue (North)
- SW 30th Avenue (South)
- SW 30th Avenue (Pump Station Improvements)

Information from the past SWMP was utilized in conjunction with the previously mentioned entities in the effort of completing this update of the Town's SWMP.

B. Broward County Resilience Plan (Ongoing)

Broward County is currently compiling information for a Resilience Plan to be published by the end of 2024. According to the Broward County website, the objective of this Resilience Plan is to provide a risk and economic analysis, an infrastructure improvement and adaptation plan, a platform to track these improvement projects, and a way to collectively mitigate flooding. As of their most recent report (May 2024), Broward County has the final model results, which shows a reduction in flooding by half after the implementation of elevated seawalls, groundwater and surface storage, and conveyance improvements via pumps and culverts. The next steps would be to finish the economic modeling as well as estimated costs for the suggested improvements.

C. Existing Stormwater Regulation

Stormwater management in Florida is subject to State and federal regulations. Two programs regulated by the state and federal governments are the NFIP and the NPDES. The NFIP is managed by FEMA and the Florida Department of Community Affairs (DCA). The NPDES is managed by the EPA and FDEP. KHA collected information on stormwater management requirements from each of these agencies. In addition to federal and State regulations, the Town has adopted their own stormwater codes.

NPDES Permit (2021)

The Town is a co-permittee on the Broward County MS4 Permit through the EPA's NPDES program. The permit is administered by the FDEP. Each year, the co-permittees are required to submit an annual report to FDEP detailing progress on permit mandated activities. These activities range from inspecting storm water treatment facilities to conducting public awareness events to publicize the environmental consequences of illegal dumping.

FEMA and CRS Rating (2018)

The Federal Emergency Management Agency (FEMA) was established in 1979. The purpose of this agency is to work with the federal government to ensure America is prepared to respond to disasters. The Town entered the NFIP Community Rating System (CRS) program in October of 2018 and has a class rating of 9 as of April 2024. The CRS program has a class rating system that ranges from a best rating of 1 and ranges to a lower-class rating of 10. Maintaining or improving the Town's CRS rating requires inter-departmental teamwork. A CRS rating score of 9 offers the Town's residents a 5% discount in the cost of homeowner's flood insurance premiums. The Town can earn credits towards improving their CRS score by increasing public information, developing mapping and regulations, reducing flood damages by various activities, and having a warning and response system in place for flood warnings or threats. Subsequently, CRS activities such as public outreach, flood information website, flood protection assistance, flood data maintenance, and drainage system maintenance should be included in the Town's Storm Water Utility Operation and Maintenance Budget.

County and Town Code of Ordinances (2024)

The Town's Code of Ordinances, published on Town's Municode website, was last updated in 2024. According to the Town's Municode, the Town adopts section 27-196, section 27-197, and section 27-198 of the Code of Ordinances, Broward County. The minimum surface water criteria, licensing requirements, and effluent standard are set by the code of ordinance of Broward County.

Ultimately, the Town of Pembroke Park needs to meet the general stormwater criteria for Broward County, FDEP, as well as SFWMD.

In addition to meeting the County's Code of Ordinance, the Town has also incorporated stormwater provisions for private development in the form of impact fees as outlined in the Town's Municode Article VIII Sections 5-150 to 5-153. Any kind of private development should not impact the Town's stormwater equipment or infrastructure. The Town should review any private development and determine if any of the Town's stormwater infrastructure is impacted. Additional analysis is recommended for any private development that impacts the Town's infrastructure and equipment. In addition to the existing stormwater facilities impact fees, it is recommended that any development that directly and/or indirectly impacts the Town's equipment, such as stormwater pumps, should have impact fees imposed.

D. Environmental Clean Up

During a review of EPA, FDEP, and Broward County records, site with known historically contaminated areas found throughout the Town with such pollutants as gasoline, petroleum, or metals in landfills. There are multiple contaminated sites on the east side of the town, concentrating mainly in the northeast corner. The EPA and FDEP identified and listed one site, EPA ID: FLD980798698, for cleanup which was contaminated with petroleum in the northeast portion of the town. This site currently has a remediation plan developed and underway. A map showing all the listed contaminated sites can be found within Appendix A, Exhibit A-6.

E. Wellfields

The below Wellfield map, Figure 2, was taken from the Wellfield Protection Zones and Contaminated Sites map provided by the Broward County Florida website. Per the provided map, there are no wellfield locations in the Town of Pembroke Park.

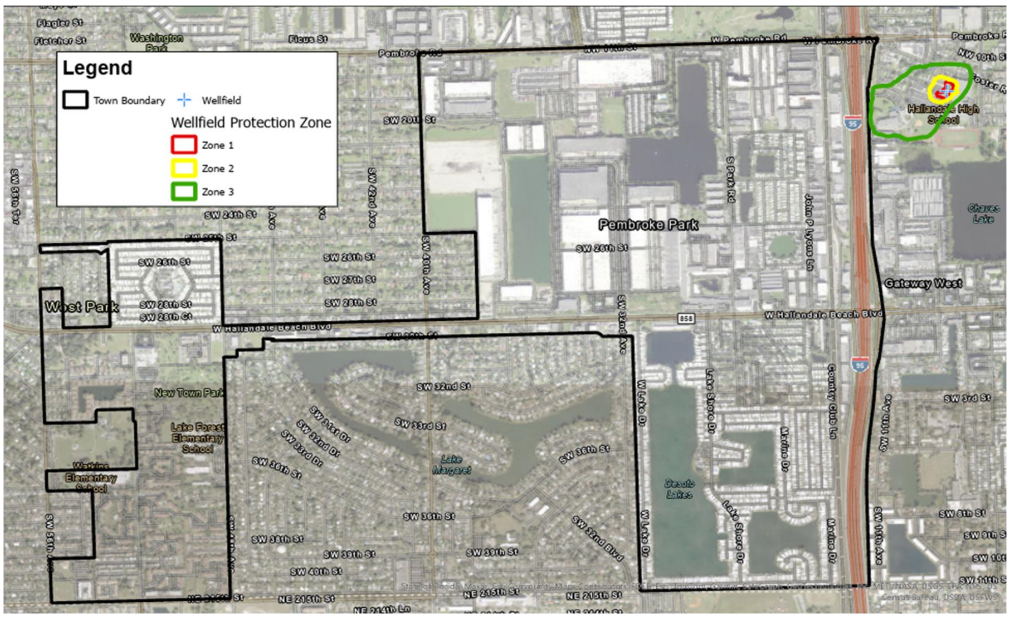


Figure 2. Wellfield Protection Zone Map

F. Soils

The below soil map was taken from the Web Soil Survey site of the United States Department of Agriculture. In Broward County the Dade-Urban land complex contains the highest percent of soil followed by Urban land, 0 to 2 percent slopes, Arents-Urban land complex and Udorthents.

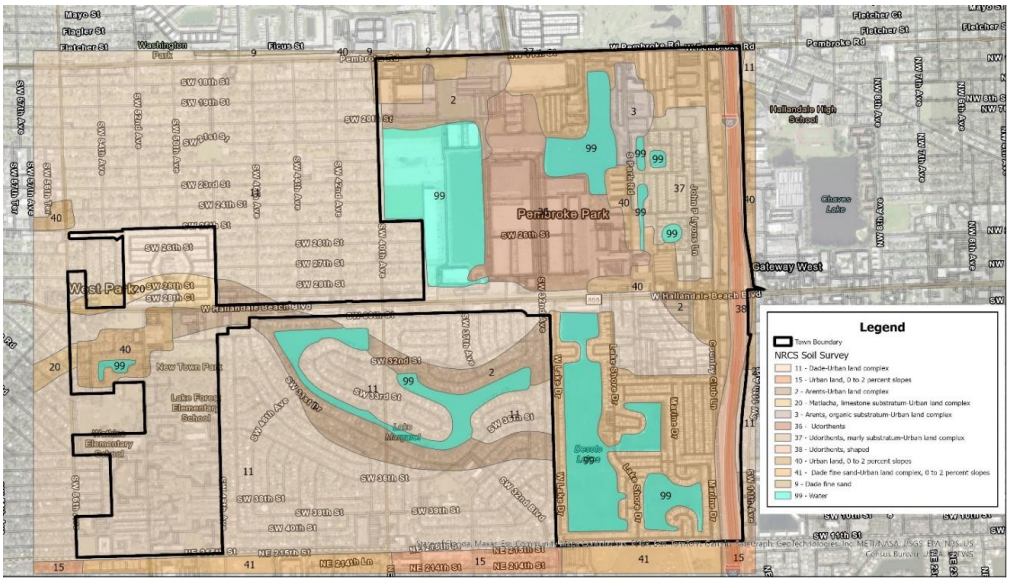


Figure 3. NRCS Soil Survey

G. Land Use Break Down

As per the Town's GIS records, the future land use mostly consists of industrial with the remaining mostly commercial and residential use. See Table 4 below.

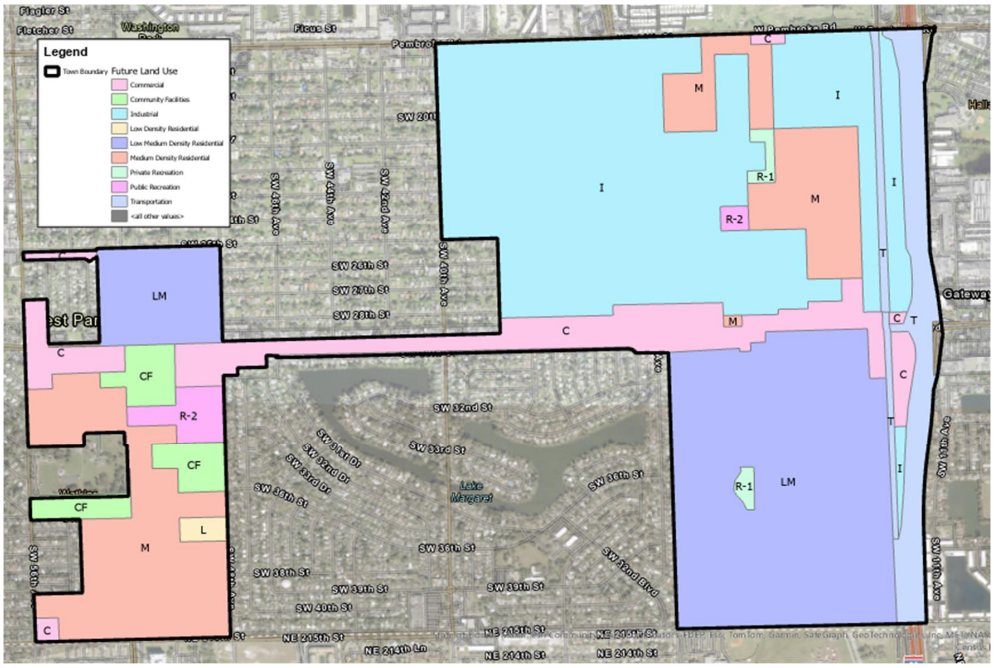


Figure 4. Future Land Use Map

H. Groundwater

Per the Broward County's Conditional Water Table maps, for the Town of Pembroke Park's seasonal high water table (SHWT) is located between the 0.5' NAVD and 1.5' NAVD equipotential lines, highlighted in yellow. Therefore, KHA utilized for the purposes of modelling a 1.0' NAVD SHWT.

II. Existing Stormwater Management System Data Review

A. Town Geographic Information System (GIS) Data

The Town of Pembroke Park maintains its own database of GIS maps and exhibits. Among these maps are Flood Zone Maps (See Appendix A), a Land Use Map, a Stormwater System Map, a Town Atlas, a Map of Water Bodies and Wetland Maps. Some of these maps require ongoing updates and revisions to show accurate information.

Types of Systems

Based on a review of the data included in the GIS obtained from Broward County Data Hub, SFWMD, and Town of Pembroke Park, KHA categorized the existing sub-basin drainage systems into types. The drainage systems were classified into the following four categories:

- Outfall systems – systems with no exfiltration trench. Pipe connections are made to lakes within the Town.
- Closed systems – systems that do not have pipe connections to a lake system and rely solely on exfiltration trenches and/or swales for drainage.
- Combination systems – systems that have both exfiltration trench and outfall pipe connections to the lakes within the Town.
- Undeveloped or unknown – systems located in areas where GIS information is not available or areas that are undeveloped.

Based on the area served, the majority of the Town of Pembroke Park currently relies on either closed systems or lake outfall systems for their drainage needs.

B. As-Built Plans and Completed Projects

The Town, FDOT, SFWMD, and BCSWM provided as-built plans and information of previously implemented stormwater projects. These completed projects were reviewed and used to identify model revisions.

C. Existing Permits

KHA has reviewed and compiled all permits and plans submitted to SFWMD, BCSWM, as well as the Town to accurately construct our model of the entire Town in stormwater flood modeling software (ICPR4). Although not an exhaustive list, the table below shows Town projects that have either already been constructed or are permitted to be built in the near future that interact directly with proposed improvements in this update of the Town's SWMP.

Table 1. Town Drainage Improvement Projects

SFWMD Environmental Resource Permit	Project Name	Status
SFWMD 06-03080-P	Town of Pembroke Park SW 25 Street Stormwater Improvements Project	Construction to begin 2024
In Process	John P. Lyons Lane Drainage Improvements	Construction to begin 2025
Self-Certification	SW 31st Avenue (John P. Lyons Lane) Stormwater Improvements (Phase I)	Completed
SFWMD 06-03080-P	Stormwater Pump Station - Park Road & SW 24th Street	Completed
SFWMD 06-01979-S	SW 52nd Avenue (North)	Completed

Additionally, Exhibit A-4 in Appendix A depicts Environmental Resource Permits (ERP) that have been recorded with SFWMD used to develop the modeling for this SWMP.

D. Townwide Pump System

Existing Stormwater Pump Configuration

Currently the Town has a system of stormwater pumping stations throughout the northeastern portion of the Town. These pumps facilitate the conveyance of stormwater from the existing gravity network to two existing discharge points. Pump 1 currently collects water from Behan Lake and discharges to FDOT's system along Pembroke Road which then discharges to the Orangebrook Golf Course and Country Club through a control structure to the north. Pump 2 and Pump 3 pump stormwater from the adjacent lakes to an FDOT swale alongside I-95 which ultimately leads to an FDOT pump just north of West Hallandale Beach Boulevard. Pump 4 and Pump 5 currently convey the water from the connected gravity system as well as Behan Lake to Meekins Lake to the west.

According to permit documents and information provided by Town staff, each pump station has the following restrictions:

- Pump 1-Permit documents show that Pump 1 conveys stormwater at a maximum flow of 7 CFS towards the FDOT Pembroke Road conveyance system. For the purposes of modelling and in accordance with permit documents, the pumps were set to turn on and off via float switches upstream set to activate at 1.0 feet NAVD and shut off at 0.5 feet NAVD with an emergency off set at -0.5 NAVD.
- Pump 2-As per the previous stormwater master plan, Pump 2 pumps at a rate of 40 CFS, however, correspondence with the Town has clarified that the pump is capable of pumping at a rate of 80 CFS and is manually activated during emergency storm events. The Town does not operate Pump 2 when Pump 3 is running.
- Pump 3- Located within a manufactured homes development and pumps stormwater at a rate of 3 CFS towards the FDOT swale along I-95. For the purposes of modelling and in accordance with permit documents, the pumps were set to turn on and off via float switches upstream set to activate at 1.0 feet NAVD and shut off at 0.5 feet NAVD with an emergency off set at -0.5 NAVD. The Town does not run Pump 3 while Pump 2 is running to avoid overloading the FDOT system.
- Pump 4- Set to pump at 5.6 CFS and limited to running for a maximum of 27 hours. For the purposes of modelling and in accordance with permit documents, the pumps were set to turn on and off via float switches upstream set to activate at 1.0 feet NAVD and shut off at 0.5 feet NAVD.
- Pump 5- Draws runoff from Behan Lake and leads to Meekins Lake to the west at a rate of 3.0 CFS. For the purposes of modelling and in accordance with permit documents, the pumps were set to turn on and off via float switches upstream set to activate at 1.0 feet NAVD and shut off at 0.5 feet NAVD.

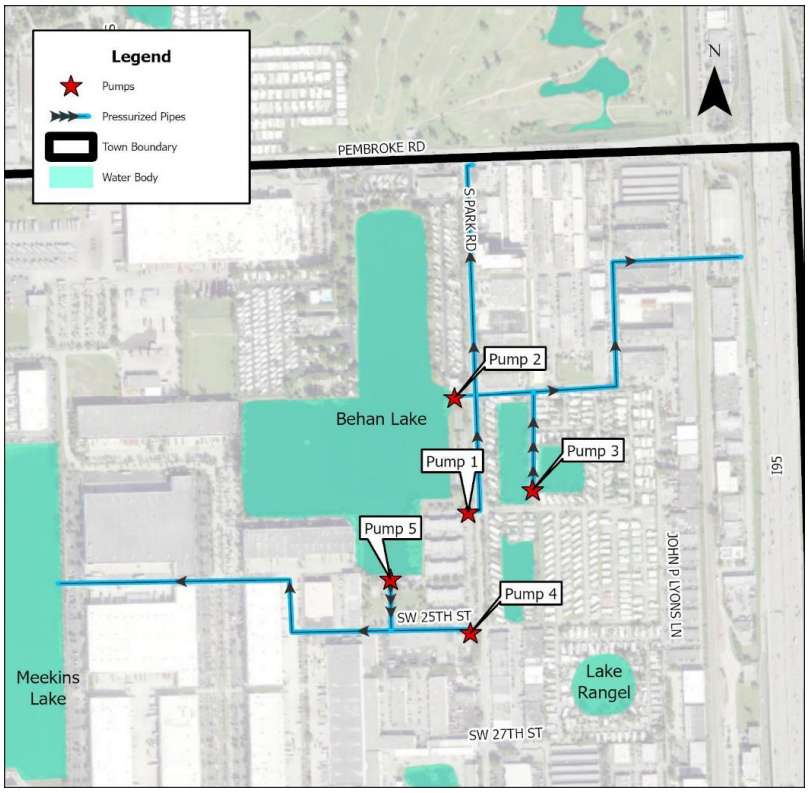


Figure 5. Existing Stormwater Pump Location Map

Proposed Stormwater Pump Configuration

The Town currently has proposed plans that include the addition of two new stormwater pumps to their existing system. The figure below, Figure 7, shows the locations at which these new pumps are being placed and the direction in which they are conveying stormwater. The pump station at John P. Lyons Lane will move the stormwater from the main trunkline down John P. Lyons Lane to Behan Lake by force main under Carolina Street; correspondence with the Town indicated that construction should begin in 2025. The proposed pump station located along 25th Street will move the water stored in the exfiltration trench to the southern portion of Behan Lake; correspondence with the Town indicated that construction should begin by the end of 2024.

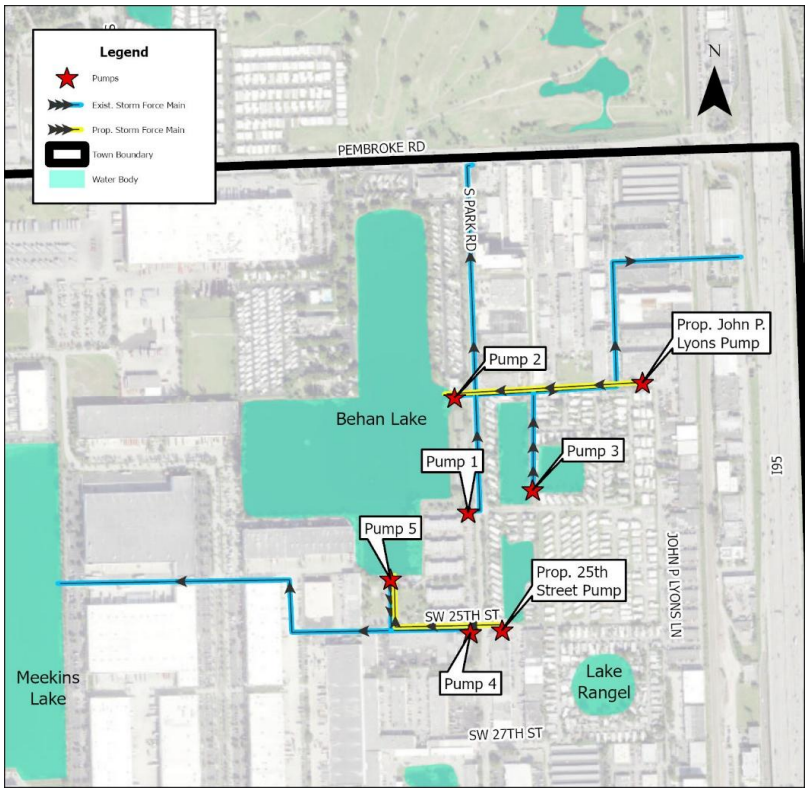


Figure 6. Proposed Stormwater Pump Location Map

E. Summary of Completed Stormwater Projects

KHA collected and reviewed available data on the completed stormwater projects within the Town of Pembroke Park in order to prepare this Stormwater Master Plan.

- SW 31st Avenue (John P. Lyons Lane) Stormwater Improvements (Phase I)
- Stormwater Pump Station - Park Road & SW 24th Street
- SW 52nd Avenue (North)

F. Identification of Drainage Deficiency Areas

The Town has provided KHA complaints from the residents and observed flooding by Town officials. In conjunction with the complaints received, KHA visually observed flooding on numerous occasions after storm events.

Visual Assessment of Existing Conditions

KHA visually assessed roadway flooding conditions during and after rainfall events lasting one hour or more. KHA also evaluated the condition of existing drainage structures within the Town.

See Figure 8 for a visual of the spatial distribution of problem areas and field data collection locations.

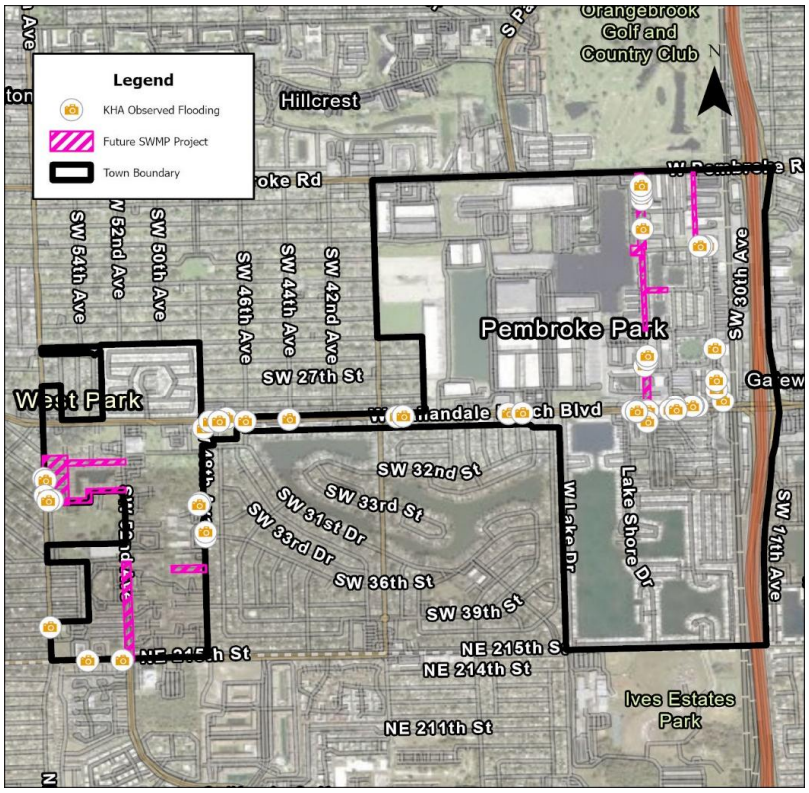



Figure 7. Field Visit Locations

KHA performed field visits to the Town shortly after rain events lasting longer than one hour.

Table 2 shows a few of the many photographs taken during KHA observations.

Table 2. KHA Observed Flooding

		Flooding at the intersection of Carolina Street and SW 31st Avenue
		Flooding along the north end of South Park Road.
		Flooding along the north end of South Park Road.
		John P. Lyons Lane, another example of the flooding observed

DRAINAGE ANALYSIS

A. Methodology

The approach for this SWMP analysis was to determine the water quality and quantity performance goals for the Town, based on requirements as well as best management practices, for public right-of-way spaces. The Town is not responsible for drainage infrastructure on private property, however private property infrastructure is required to meet permitting requirements specified by SFWMD, Broward County, and the Town when obtaining licensing and permitting. Once performance goals were determined KHA developed a townwide flooding model that depicts the existing conditions and then compared and verified the findings with resident complaints, Town observations, and KHA observation. The existing model was then calibrated to closer represent the observed conditions so that the model reflected true results to the extent possible. Rainfall events determined by performance goals were then built into the model to see the effects and determine deficiencies throughout the Town. Model results for the selected rainfall events were reported in flooding elevations and then compared to the natural grade elevations to compare possible flooding above natural grade.

B. Water Quality Treatment Performance Goals

Prior to modeling and evaluating the priority drainage project areas, performance goals were identified based on FDEP and SFWMD requirements. These performance goals represent the minimum water quality treatment standards for future development.

Volumetric Requirements

The Town's Code of Ordinances, as discussed in Chapter 13.5, Article V, Section 13.5-54 states that all proposed development should meet a criterion of providing volumetric treatment for the first 1 inch of runoff. Additionally, SFWMD advises, in their Environmental Resource Permit Applicant's Handbook Volume II Section 4.2.1, that volumetric water quality treatment provided for a development be the greater of either the first 1 inch of rainfall across the site or 2.5" times the total percent impervious. For pre-treatment requirements, Section 4.2.2 of the SFWMD ERP Applicant's Handbook Volume II states that commercial or industrial projects must include at least one-half inch of dry detention or retention pretreatment in their required retention/detention systems, unless they can guarantee that hazardous materials will not enter the surface water management system. Or projects with more than 40% impervious area that discharge directly into specified receiving waters must provide at least one-half inch of dry detention or retention pretreatment as part of the required retention/detention.

For projects discharging to an OFW or impaired water, additional water quality treatment may be needed. The Town does not discharge to an OFW, however it is within the Snake Creek Canal (East) basin which is listed by FDEP as an impaired waterbody. Additionally, water quality measures may be required for a net improvement as per Appendix E of SFWMD's ERP Applicant's Handbook Volume II.

Nutrient Reduction Requirements

The Town does not set its own limits but has partnered with the SFWMD and the County to implement non-structural and structural BMPs to limit nutrient loadings from the source. Ongoing State research of stormwater runoff pollutants and efforts to enforce consistency between the water management districts will impact future requirements, including a move towards nutrient loading analyses rather than volumetric requirements. HB-7053 in March of 2024 was Laid on Table to become law in the House and there is a companion bill that mirrors the proposed legislation by the Senate called SB-7040. And are expected to take effect in the Summer of 2024.

These Bills will require the following alternate levels of sufficient treatment:

- An 80 percent reduction of the post-development average annual loading of total phosphorus (TP) and a 45 percent reduction of the post-development average annual loading of total nitrogen (TN) from the project area or post-development levels lower than pre-development levels, whichever is greater.
- For stormwater systems located within a sub watershed containing an Outstanding Florida Water (OFW) and located upstream of that OFW, a stricter requirement of a 90 percent reduction of the post-

development average annual loading of TP and a 80 percent reduction of the post-development average annual loading of TN from the project area or post-development levels lower than pre-development levels, whichever is greater.

- For stormwater treatment systems located within a sub watershed containing an impaired water body and located upstream of that impaired water, a stricter requirement of a 80 percent reduction of the post-development average annual loading of TP and TN if not within and OFW, a 95 percent reduction of the post-development average annual loading of TP and TN if in an OFW, a no net improvement for pollutants not meeting standards, or post-development levels lower than pre-development levels, whichever is greater.

In the efforts of planning ahead, this SWMP addresses water quality treatment by recommending stormwater conveyance improvements that result in a net reduction of nutrient loading as compared to existing conditions as well volumetric requirements currently set by SFWMD. Nevertheless, KHA recommends that water quality calculations be reevaluated when recommended improvements in this SWMP move into the design phase, and eventually construction/operation.

C. Water Quantity Performance Goals

The level of service adapted by the Town is captured in its Code of Ordinances, discussed in Chapter 13.5, Article V, Section 13.5-54, which states that all proposed development should meet a criterion of 1 inch in a 25 year/24-hour storm event. KHA recommends that the town adopts the standards set forth by SFWMD which has been the minimum standard adopted by BCSWM. The following requirements were set as the goals for the project improvements in this SWMP based on the applicable requirements as well as best management practices for stormwater infrastructure:

- During the 10-year/24-hour storm event, flooding in roadway travel lanes should be below the crown of the roadway. This standard is the same as the current Broward County standard for arterial roadways.
- During the 25-year/3-day storm event, offsite discharge rates are not to cause adverse impacts to offsite properties, not to exceed historic rates, not to exceed rates determined by previous permits, nor rates specified by SFWMD's criteria.
- During the 100-year/3-day storm event, flooding should be below the building finish floor elevations. This standard is the same as the current Broward County standard.
- No net encroachment into the floodplain, between the average wet season water table and that encompassed by the 100-year event, which will adversely affect the existing rights of others, will be allowed.

D. Sub-Basins

For the purposes of our modelling and analysis, the Town was delineated into sub-basins by utilizing the project boundaries of existing SFWMD permits and the corresponding data within these permits. The figure below demonstrates the sub-basin boundaries utilized for modelling purposes.

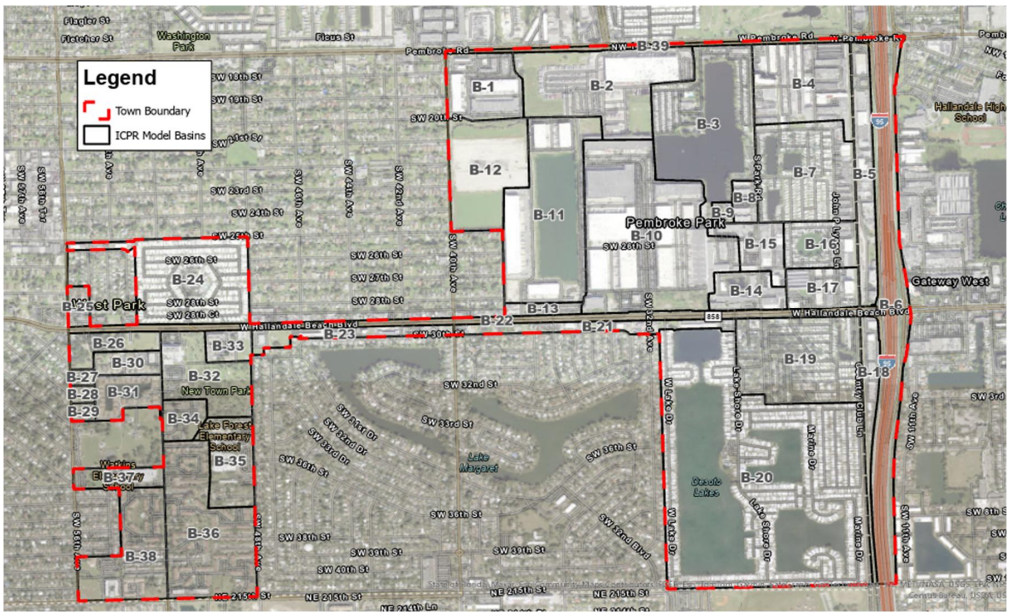


Figure 8. Sub-Basin Map

E. Model Assumptions

Various assumptions were made for developing the computer model as well as for the drainage calculations as follows:

- All elevations shown are in reference to the National American Vertical Datum of 1988 (NAVD).
- It was assumed that in residential areas, all private property contributed stormwater runoff to the right-of-way.
- Hydraulic conductivities for the purpose of exfiltration trench calculations were taken from SFWMD's permit portal for projects near or adjacent to the proposed projects modelled in this SWMP.
- Exfiltration trenches were modelled to be 6 feet wide and set 0.5 feet to 1 foot below the seasonal high groundwater table.
- It was assumed that the seasonal high groundwater table throughout all sub-basins to be at an elevation of 1.0 feet-NAVD as per Broward County's Future Conditional Groundwater.
- Elevation data was taken from LiDAR provided from Broward County Data Hub and the accuracy confirmed with permitted plans that include surveys.
- Connections among project sub-basins were confirmed by cross referencing the existing structure/pipe GIS shapefiles developed by the Town and permitted plans found on BCSWM and SFWMD permit portal.

The model was broken up into three scenarios: the first scenario is the existing conditions as the town functions at the time of this master plan update. The second scenario is the proposed condition which includes the proposed improvements of John P. Lyons and SW 25th St since the Town is in the process of design and permitting at the time of our analysis. The third and final scenario is the future condition which included the Town's proposed improvements as well as the future project improvements proposed in this SWMP.

Data Collection Findings

The Town and KHA observed flooding, KHA developed flooding level maps created through modeling to better analyze the Town's deficiencies and areas that need attention. The figure below, Figure 10, is a flooding level map showing the max storm stages relative to the natural grade elevations for a 10-year/24-hour storm of the existing

conditions model. Areas with blue will experience flooding, with deeper flooding represented by darker blues. Note that lake water elevations are lower than natural grade and therefore will show higher water levels during storm events.

Upon review and analysis of the data collected for the purpose of the update to the SWMP, KHA has found that due to lack of connectivity among existing stormwater infrastructure, poorly placed storm structures, poorly graded asphalt, and/or lack of drainage infrastructure in general is causing areas across the Town to flood.

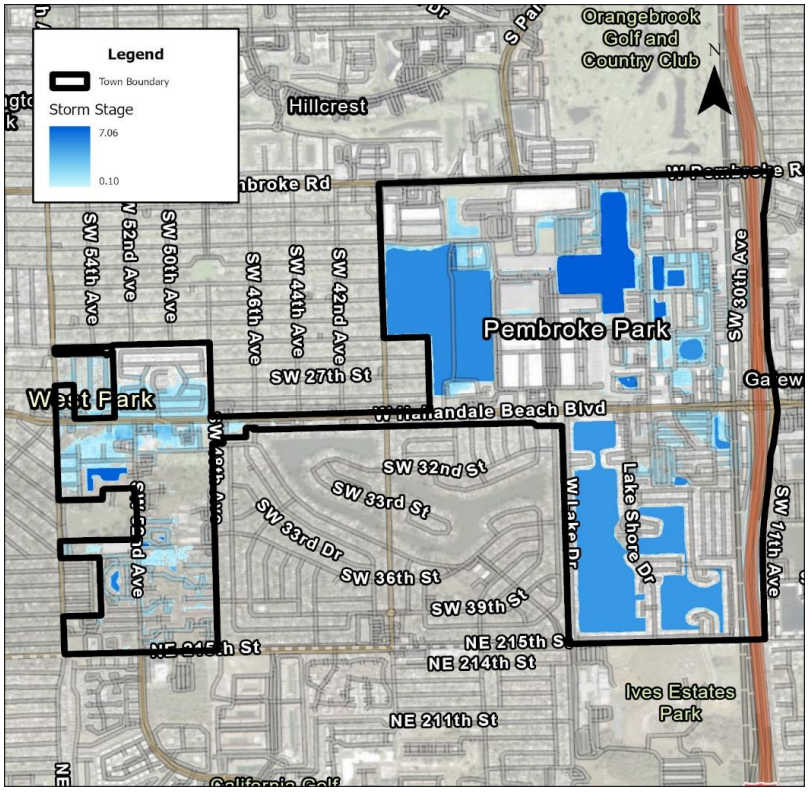


Figure 9. 10-Year/24-Hour Flooding Heat Map

III. Project Area Analysis

The hydrologic and hydraulic modeling utilized to evaluate whether each priority project area meets the performance goals is based on the data collected and described in previous sections of this report. The following sections of this report describe the hydrologic and hydraulic modeling results, potential storm drainage deficiencies, and recommended drainage infrastructure improvements within the tertiary drainage system for each of the priority project areas.

A separate 1D hydrologic and hydraulic model was prepared using ICPR v. 4.07 modeling software for each location with hydrologic parameters and inputs based on the Townwide existing model prepared by KHA. Each project area was analyzed using three (3) storm events associated with the Town's level of service for it's stormwater systems. KHA researched typical rainfall depths for each storm event using NOAA Atlas 14, which estimates an area's rainfall depth per storm event based on historical data collected by NOAA (see Table 3).

Table 3. Rainfall Depths per Storm Event

Storm Event	Rainfall Depth (inches)
10-year/24-hour	8.85
25-year/72-hour	13.3
100-year/72-hour	18

- The Curve Number Method was used to estimate rainfall losses and runoff.

Performance analysis of each proposed project area was completed through the following steps:

- Gathering data on each basin including percent impervious, total contributing area, water table elevation, control water elevation, soil type, the roadway low centerline elevation and the assumed building elevation (FFE elevations taken from LiDAR).
- Level of Service
  - Modeling the 10-year storm event to determine the existing peak stage as compared to the crown of road elevation.
  - Modeling the 100-year/3-day storm event to determine the existing peak stage as compared to building finished floor elevations (FFE).[1]
  - Modeling three scenarios, per project. The existing conditions, then to account for projects that are already permitted and nearly ready for construction, and future improvements outlined in this SWMP.
- Water Quantity
  - Modeling the 25-year/3-day storm event to determine the existing peak discharge and stages to compare and ensure the proposed projects improve upon historic rates.
- Water Quality
  - Calculating the required water quality volume based on the greater value of the first 1 inch of runoff over the basin area or 2.5 inches times the percent impervious area. The calculated water quality volume was then compared to the existing detention volume (e.g. existing swale detention volume) to determine whether the drainage system is meeting the requirement.
  - Calculate nutrient loading removal.

Nutrient loading analysis was completed using BMP Trains, simultaneous with the modeling effort, to ensure that the proposed project would reduce nutrient loading to the lake outfalls as compared to existing conditions.

Recommended improvements for the priority areas consist of one or more of the following:

- Constructing additional catch basins, or other drainage system connectors for low points without positive drainage. This could be applicable for areas that note discontinuous flows adjacent and/or between swales.
- Increased maintenance within the sub-basin. This is a common recommendation for all areas, but especially those where grates were observed to be covered with leaves, catch basins were full of debris, swales were overgrown, or damage to pipes or exfiltration trench was observed.
- Increasing swale capacity within the right-of-way where possible. Swales are low pervious areas located outside of the roadway travel lanes but still within the right-of-way. Swales store runoff from the roadway and allow it to percolate into the soil over time. Swale storage capacity can be expanded by increasing the slope of the sides of the swale or making the swale.
- Adding stormwater system trunklines and additional exfiltration trench to collect runoff from existing and additional catch basins as well as driveway culverts to better connect the existing systems.
- Re-grading of roadways to promote flow to existing drainage structures. This would apply to areas where the roadway has deteriorated or where “birdbaths” (minor low elevations) have occurred. The roadway

[1] The calculations in Appendix B also include a column comparing peak stages during the 100-year, 3-day storm event in existing conditions with peak stages in proposed conditions, rather than just comparing to FFE.

would be “leveled out” to eliminate these areas because they are susceptible to ponding. In addition, elevating roadways to ensure that the crown of road elevation complies with the level of service without affecting flood stages in adjacent buildings.

A. Infinity Azure

Project Location

The Infinity Azure project sub-basin falls along SW 32nd Street as well as SW 34th Street, just south of West Hallandale Beach Boulevard and north of McTyre Park. The project location is outlined in the figure below, Figure 11.

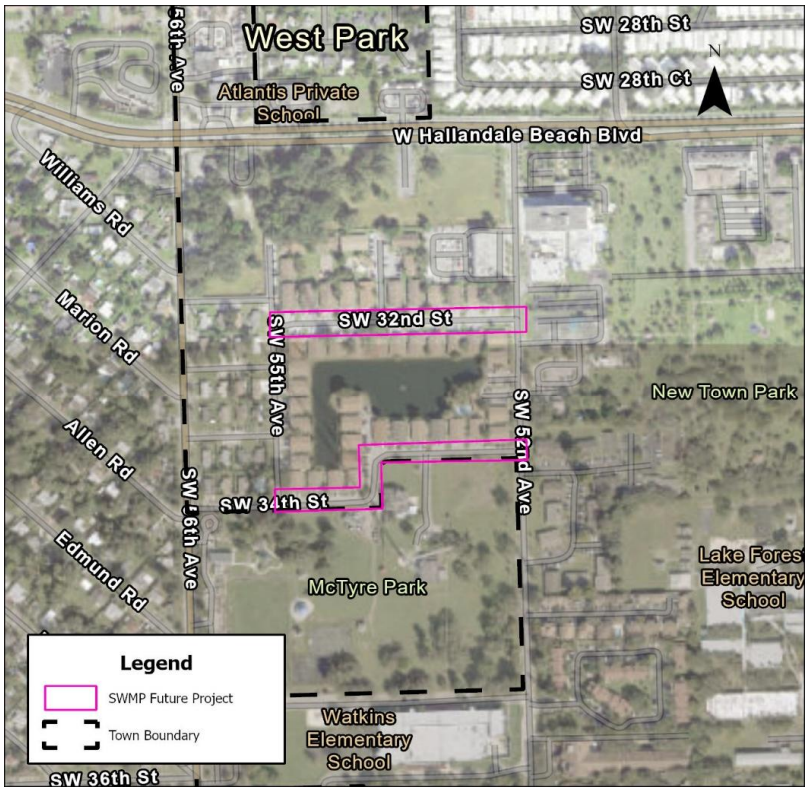


Figure 10. Infinity Azure Project Location

Existing and Future Conditions

This sub-basin consists of approximately 4.57 acres of existing multi-family development with approximately 2,100 LF of roadway. The current stormwater system consists of a few drainage inlets and underground pipes used to convey water that ultimately outfalls to a lake that is on site. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models, KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the basin versus performance goals. "Yes" means the given drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 4. Infinity Azure Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
Infinity Azure	No	No	No	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure is inadequately interconnected and does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: KHA recommends adding exfiltration trench and catch basins throughout the project area. The overall flow of water to the existing outfall is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently disrupts uninterrupted flow to the outfall resulting in ponding or flooding. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in a significant reduction in the pollutant load contribution from this project area to the lake for two major pollutants.

Table 5. Infinity Azure Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction	Mass Reduction (kg/yr)
Total Nitrogen	51.05	95%	48.4
Total Phosphorous	11.443	95%	10.848

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 6. Infinity Azure Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization	1	LS	$80,900	$81,000
2	Stormwater Pollution Prevention Plan	1	LS	$8,090	$9,000
3	Inlet Apron	18	EA	$500	$9,000
4	Drainage Pipe (36" HDPE) w/ Trench Restoration	360	LF	$200	$72,000
5	Exfiltration Trench w/ Trench Restoration	1,965	LF	$230	$452,000
6	Pollution Retardant Baffle	23	EA	$600	$14,000
7	Catch Basin	18	EA	$7,000	$126,000
8	Manhole	15	EA	$8,000	$120,000
9	Utility Sleeves and Adjustments	1	LS	$15,900	$16,000
10	Professional Services	1	LS	$121,350	$122,000
11	Contingency	1	LS	$202,250	$203,000
				TOTAL	$1,224,000

B. Park Road – North Part I

Project Location

The Park Road – North Part I project sub-basin falls along S Park Road, just south of West Pembroke Road and east of Lakeside Park Estates residential development. The project location is outlined in the figure below, Figure 12.

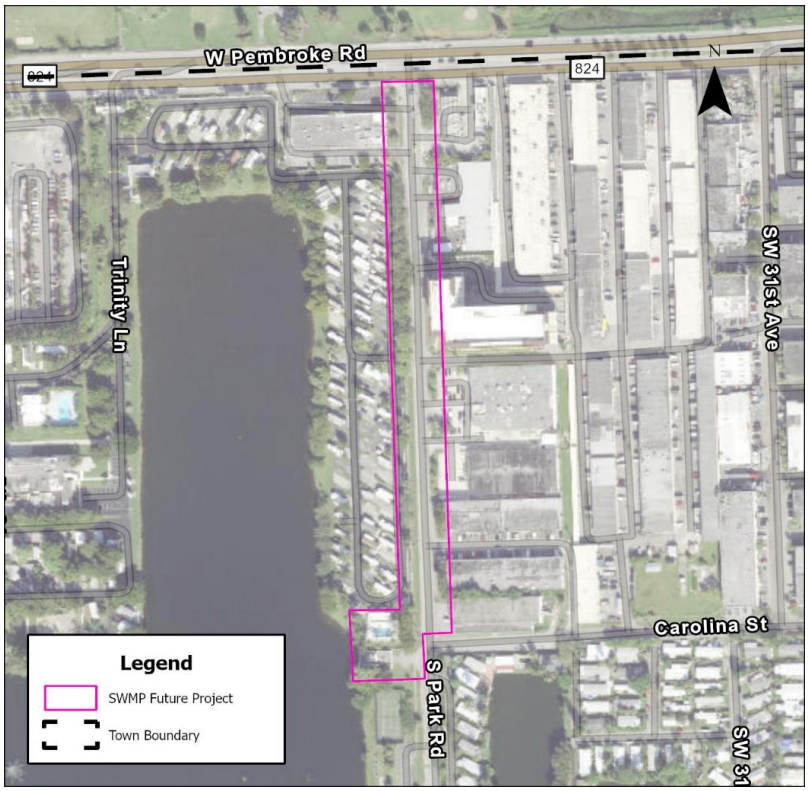


Figure 11. Park Road – North Part I - Project Location

Existing and Future Conditions

This sub-basin consists of approximately 4.92 acres of existing industrial development adjacent to manufactured home developments with approximately 1,420 LF of roadway within the project limits. The current stormwater system consists of sparsely scattered drainage inlets and some swale. The existing storm trunkline that exists under S Park Road, originally used to convey stormwater, has a stormwater force main coming from the stormwater pump station just southeast of Behan Lake. The stormwater force main travels through the existing storm gravity main and ultimately outfalls to an FDOT inlet that is on the north end of the project limits along Pembroke Road. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the basin versus performance goals. "Yes" means the given

drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 7. Park Road – North Part I - Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
Park Road – North Part I	No	No	Yes	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure is inadequately interconnected and does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: It is KHA's recommendation that most of the existing swales be regraded and that new swales be constructed in flatter areas more susceptible to flooding. The cumulative length of the proposed swales is approximately 650 LF. The swales are to be designed with a minimum width of 4 feet and a minimum depth of 0.5 feet.

KHA recommends the addition of exfiltration trench as well as addition of catch basins throughout the project area. The overall flow of water to the existing outfall is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently disrupts uninterrupted flow to the outfall at Behan Lake resulting in ponding or flooding. The proposed improvements will connect the stormwater system to Behan Lake as well at the stormwater pump station southeast of Behan Lake. This project was designed to connect and compliment the plans completed by Keith Engineers for the north portion of John P. Lyons Lane along Carolina Street set to be constructed in 2025. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area to the lake for two major pollutants.

Table 8. Park Road – North Part I - Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction	Mass Reduction (kg/yr)
Total Nitrogen	28.43	95%	26.95
Total Phosphorous	6.16	95%	5.839

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 9. Park Road – North Part I - Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization	1	LS	$67,900	$68,000
2	Stormwater Pollution Prevention Plan	1	LS	$6,790	$7,000
3	Curbing Restoration	550	LF	$40	$22,000
4	Driveway/Sidewalk Restoration	320	SY	$50	$16,000
5	Inlet Apron	8	EA.	$500	$4,000
6	Drainage Pipe (36" HDPE) w/ Trench Restoration	635	LF	$200	$127,000
7	Exfiltration Trench w/ Trench Restoration	1,350	LF	$230	$311,000
8	Pollution Retardant Baffle	10	EA	$600	$6,000
9	Catch Basin	6	EA	$7,000	$42,000
10	Curb Inlet Catch Basin	2	EA	$10,000	$20,000
11	Manhole	10	EA	$8,000	$80,000
12	Swale Restoration	150	SY	$3	$1,000
13	Core Drill Existing Structure	9	EA	$1,000	$9,000
14	Utility Sleeves and Adjustments (15%)	1	LS	$40,350	$41,000
15	Professional Services	1	LS	$101,850	$102,000
16	Contingency	1	LS	$169,750	$170,000
				TOTAL	$1,026,000

C. Park Road – North Part II

Project Location

The Park Road – North Part II project sub-basin falls along S Park Road, just south of Carolina Street and east of Lakeside Park Estates residential development. The project location is outlined in the figure below, Figure 13.

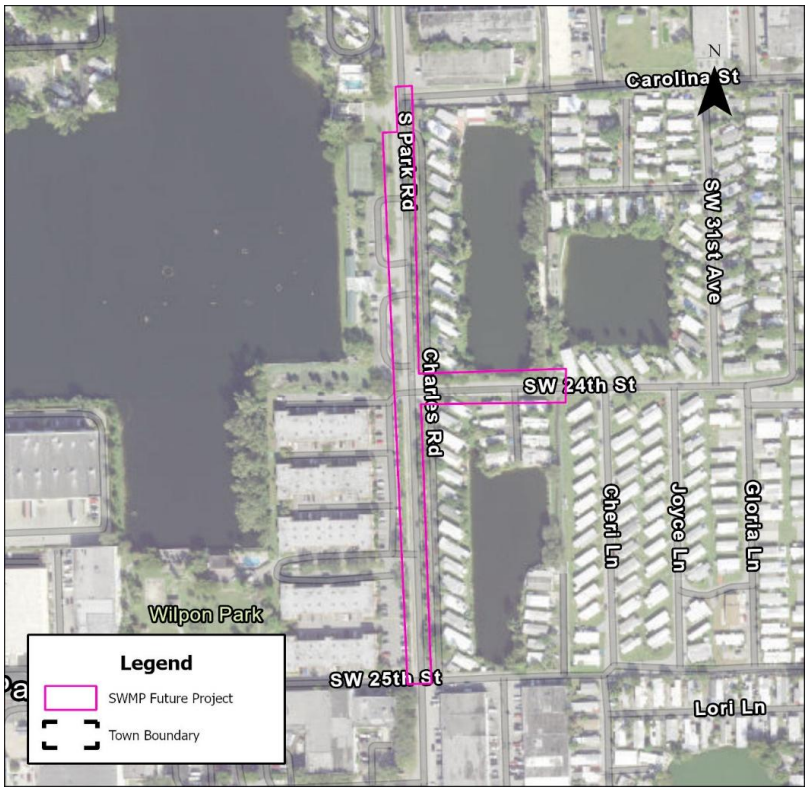


Figure 12. Park Road – North Part II Project Location

Existing and Future Conditions

This sub-basin consists of approximately 3 acres of existing industrial development adjacent to manufactured home developments with approximately 1,900 LF of roadway. The current stormwater system consists of sparsely scattered drainage inlets. As mentioned in the previous section, the existing storm trunkline that exists under Park Road has a stormwater force main coming from the stormwater pump station just southeast of Behan Lake, west of the intersection of Park Road and SW 24th Street. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the basin versus performance goals. "Yes" means the given

drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 10. Park Road – North Part II Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
Park Road – North Part II	No	No	Yes	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure is inadequately interconnected and does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: KHA recommends the addition of exfiltration trench as well as addition of catch basins throughout the project area. The overall flow of water to the existing outfall is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently disrupts uninterrupted flow to the outfall at Behan Lake resulting in ponding or flooding. The proposed improvements will connect the stormwater system to Behan Lake as well at the stormwater pump station southeast of Behan Lake. The project was designed to connect and compliment the SW 25th Street permitted plans prepared by Craig A. Smith Engineers anticipated to start construction by the end of 2024. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area to the lake for two major pollutants.

Table 11. Park Road – North Part II Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction (kg/yr)	Mass Reduction (kg/yr)
Total Nitrogen	23.76	95%	22.53
Total Phosphorous	3.9	95%	3.698

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 12. Park Road – North Part II Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization/ MOT/ Clearing & Grubbing	1	LS	$67,200	$68,000
2	Stormwater Pollution Prevention	1	LS	$6,720	$7,000
3	Driveway/Sidewalk Restoration	30	SY	$50	$2,000
4	Inlet Apron	13	EA	$500	$7,000
5	Drainage Pipe (36" HDPE) w/ Trench Restoration	600	LF	$200	$120,000
6	Exfiltration Trench w/ Trench Restoration	1,550	LF	$230	$357,000
7	Pollution Retardant Baffle	15	EA	$600	$9,000
8	Catch Basin	10	EA	$7,000	$70,000
9	Manhole	8	EA	$8,000	$64,000
10	Core Drill Existing Structure	4	EA	$1,000	$4,000
11	Utility Sleeves and Adjustments (15%)	1	LS	$38,100	$39,000
12	Professional Services	1	LS	$100,800	$101,000
13	Contingency	1	LS	$168,000	$168,000
				TOTAL	$1,016,000

D. Park Road – South

Project Location

The Park Road – South project sub-basin falls along S Park Road, just north of W Hallandale Beach Boulevard. The project location is outlined in the figure below, Figure 14.

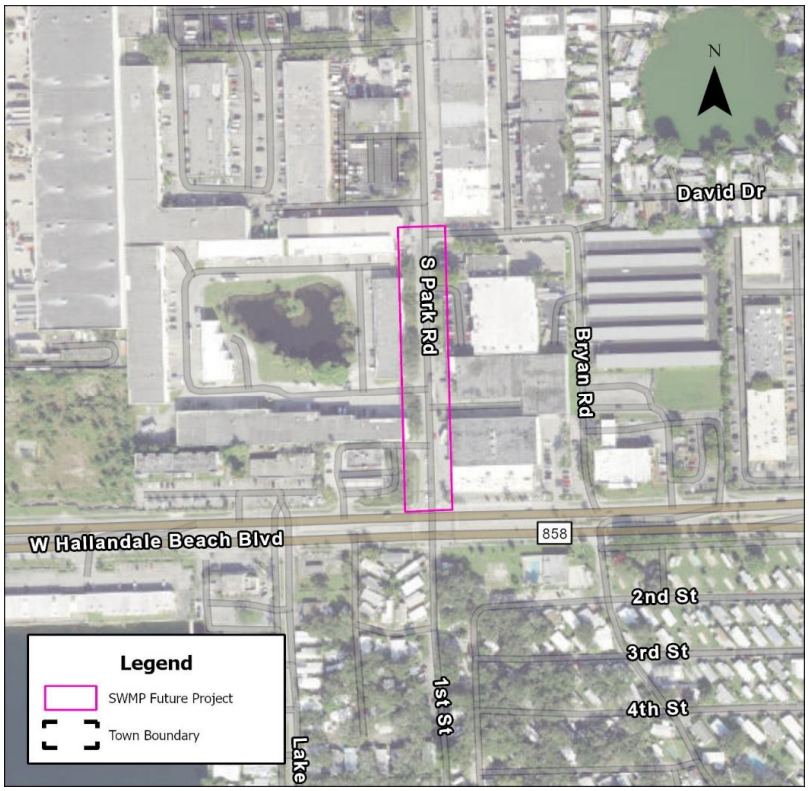


Figure 13. Park Road – South Project Location

Existing and Future Conditions

This sub-basin consists of approximately 2 acres of existing industrial development adjacent to manufactured home developments with approximately 700 LF of roadway. The current stormwater system consists of drainage inlets. Some of the inlets along this portion of road fall behind curbing which inhibits the flows to the structures causing further flooding. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the project versus performance goals. "Yes" means the given drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 13. Park Road – South Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
Park Road - South	No	Yes	Yes	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: KHA recommends the addition of exfiltration trench as well as addition of catch basins throughout the project area. The overall flow of water to the existing outfall is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently disrupts uninterrupted flow to the outfall at Behan Lake resulting in ponding or flooding. The proposed improvements will connect the stormwater system to Behan Lake as well at the stormwater pump station southeast of Behan Lake. This project was designed to begin on the south end of the SW 25th Street permitted plans completed by Craig A. Smith Engineers which has anticipated to start construction by the end of 2024. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area for two major pollutants.

Table 14. Park Road – South Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction (kg/yr)	Mass Reduction (kg/yr)
Total Nitrogen	10.88	95%	10.32
Total Phosphorous	1.811	95%	1.716

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 15. Park Road – South Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization/ MOT/ Clearing & Grubbing	1	LS	$33,900	$34,000
2	Stormwater Pollution Prevention	1	LS	$3,390	$4,000
3	Curbing Restoration	310	LF	$40	$13,000
4	Driveway/Sidewalk Restoration	10	SY	$50	$1,000
5	Inlet Apron	8	EA	$500	$4,000
6	Drainage Pipe (36" HDPE) w/ Trench Restoration	220	LF	$200	$44,000
7	Exfiltration Trench w/ Trench Restoration	670	LF	$230	$155,000
8	Pollution Retardant Baffle	8	EA	$600	$5,000
9	Catch Basin	2	EA	$7,000	$14,000
10	Curb Inlet Catch Basin	4	EA	$10,000	$40,000
11	Manhole	5	EA	$8,000	$40,000
12	Core Drill Existing Structure	2	EA	$1,000	$2,000
13	Utility Sleeves and Adjustments (15%)	1	LS	$20,700	$21,000
14	Professional Services	1	LS	$50,850	$51,000
15	Contingency	1	LS	$84,750	$85,000
				TOTAL	$513,000

E. SW 55th Avenue

Project Location

The SW 55th Avenue project sub-basin falls along SW 55th Avenue, just north of McTyre Park and east of Infinity Azure Villas residential development. The project location is outlined in the figure below, Figure 15.

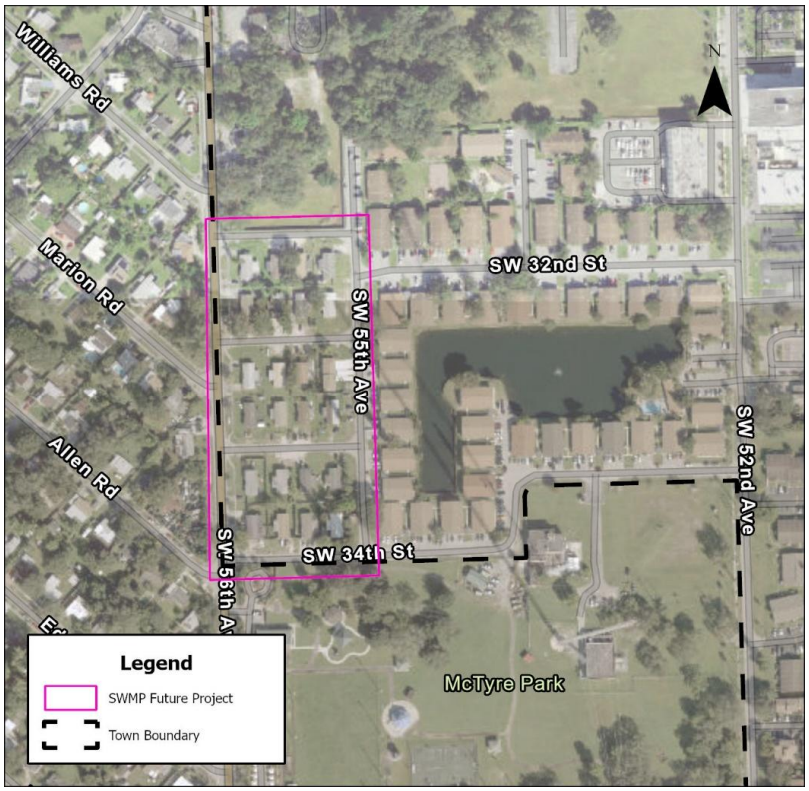


Figure 14. SW 55th Avenue Project Location

Existing and Future Conditions

This sub-basin consists of approximately 8.95 acres of an existing single-family development with approximately 1,900 LF of roadway. The current stormwater system consists of drainage inlets in an isolated system. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the project versus performance goals. "Yes" means the given drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 16. SW 55th Avenue Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
SW 55th Avenue	No	No	No	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: KHA recommends the addition of an exfiltration trench as well as the addition of catch basins throughout the project area. The overall flow of water to the existing outfall to the east of the development is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently disrupts uninterrupted flow to the outfall resulting in ponding or flooding. The proposed improvements will connect and compliment the stormwater system at Infinity Azure home development, eventually reaching an outfall into the lake on site. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area to the lake for two major pollutants.

Table 17. SW 55th Avenue Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction	Mass Reduction (kg/yr)
Total Nitrogen	62.86	97%	60.85
Total Phosphorous	14.09	97%	13.639

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 18. SW 55th Avenue Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization/ MOT/ Clearing & Grubbing	1	LS	$68,500	$69,000
2	Stormwater Pollution Prevention	1	LS	$6,850	$7,000
3	Inlet Apron	5	EA	$500	$3,000
4	Drainage Pipe (36" HDPE) w/ Trench Restoration	300	LF	$200	$60,000
5	Exfiltration Trench w/ Trench Restoration	2,075	LF	$230	$478,000
6	Pollution Retardant Baffle	16	EA	$600	$10,000
7	Catch Basin	1	EA	$7,000	$7,000
8	Manhole	13	EA	$8,000	$104,000
9	Core Drill Existing Structure	14	EA	$1,000	$14,000
10	Utility Sleeves and Adjustments	1	LS	$8,550	$9,000
11	Professional Services	1	LS	$102,750	$103,000
12	Contingency	1	LS	$171,250	$172,000
				TOTAL	$1,036,000

F. SW 36th Court

Project Location

The SW 36th Court project sub-basin falls along SW 36th Court, just west of SW 48th Avenue and south of Lake Forest Elementary School. The project location is outlined in the figure below, Figure 16.

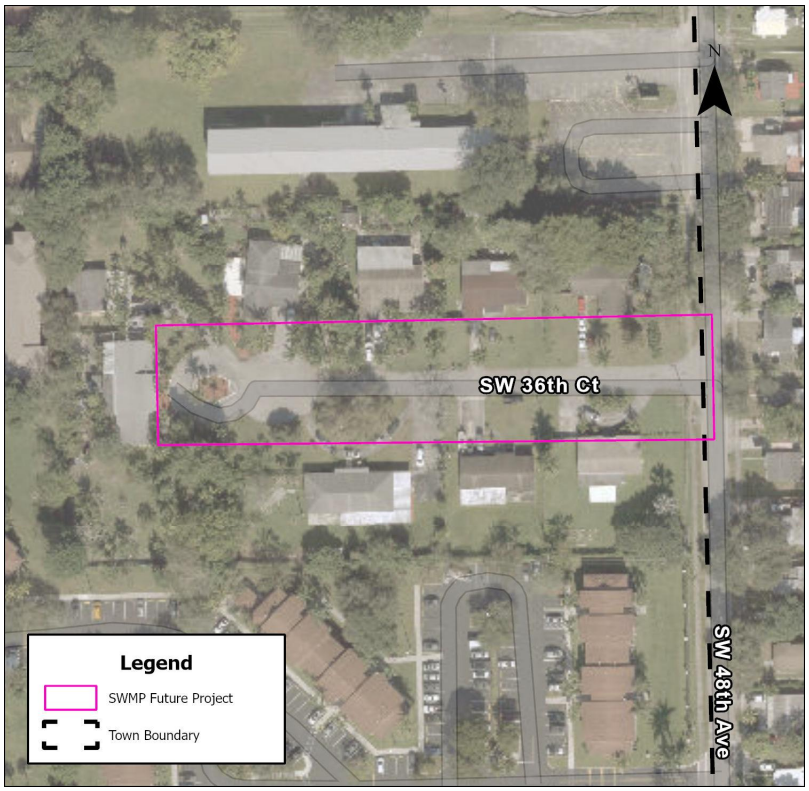


Figure 15. SW 36th Court Project Location

Existing and Future Conditions

This sub-basin consists of approximately 1.69 acres of an existing detached single-family development with approximately 500 LF of roadway. There is currently an absence of any stormwater infrastructure along this portion of road. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the project versus performance goals. "Yes" means the given drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 19. SW 36th Court Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
SW 36th Court	No	No	Yes	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the lack of existing drainage infrastructure is the cause for not meeting the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: It is KHA's recommendation that most of the existing swales be regraded and that new swales be constructed in flatter areas more susceptible to flooding. The cumulative length of the proposed swales is approximately 600 LF. The swales are to be designed with a minimum width of 4 feet and a minimum depth of 0.5 feet.

KHA recommends the addition of exfiltration trench as well as the addition of catch basins throughout the project area. The overall flow of water is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets and connected to the existing system along SW 48th Avenue. The lack of existing stormwater infrastructure and connectivity results in flooding and ponding. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area for two major pollutants.

Table 20. SW 36th Court Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction	Mass Reduction (kg/yr)
Total Nitrogen	9.03	97%	8.77
Total Phosphorous	1.426	97%	1.385

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 21. SW 36th Court Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization/ MOT/ Clearing & Grubbing	1	LS	$29,300	$30,000
2	Stormwater Pollution Prevention	1	LS	$2,930	$3,000
3	Driveway/Sidewalk Restoration	100	SY	$50	$5,000
4	Inlet Apron	9	EA	$500	$5,000
5	Drainage Pipe (36" HDPE) w/ Trench Restoration	180	LF	$200	$36,000
6	Exfiltration Trench w/ Trench Restoration	455	LF	$230	$105,000
7	Pollution Retardant Baffle	10	EA	$600	$6,000
8	Catch Basin	9	EA	$7,000	$63,000
9	Manhole	6	EA	$8,000	$48,000
10	Core Drill Existing Structure	1	EA	$1,000	$1,000
11	Swale Restoration	300	SY	$3	$1,000
12	Utility Sleeves and Adjustments	1	LS	$22,050	$23,000
13	Professional Services	1	LS	$43,950	$44,000
14	Contingency	1	LS	$73,250	$74,000
				TOTAL	$444,000

G. SW 52nd Avenue

Project Location

The SW 52nd Avenue project sub-basin falls along SW 52nd Avenue, just south of Watkins Elementary School, east of Pembroke Park Apartments, and north of NE 215th Street. The project location is outlined in the figure below, Figure 17.

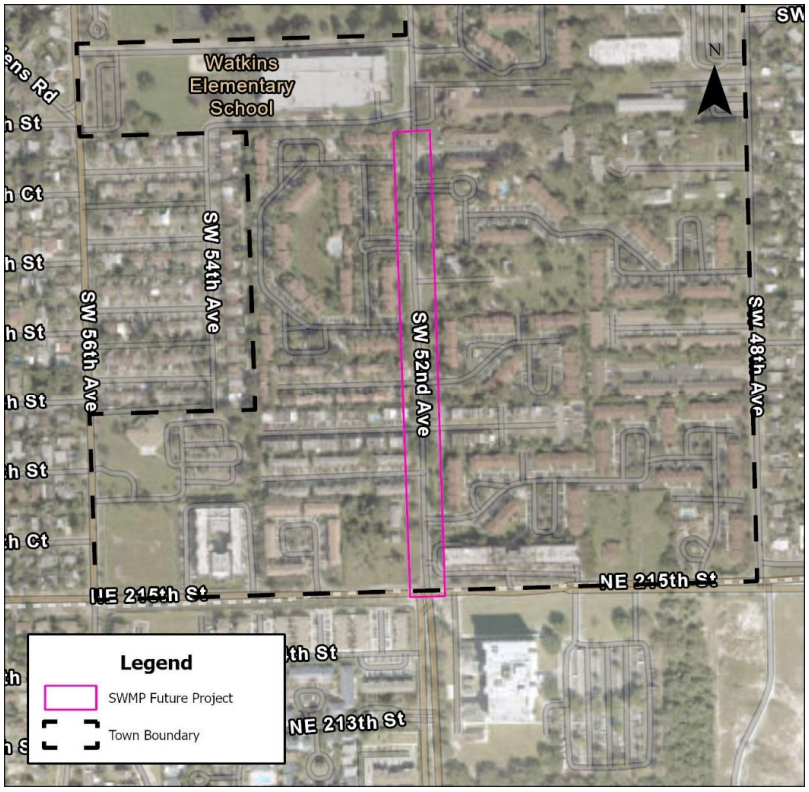


Figure 16. SW 52nd Avenue Project Location

Existing and Future Conditions

This sub-basin consists of approximately 6.06 acres of existing roadway adjacent to multi-family home developments with approximately 1,800 LF of roadway. The current stormwater system consists of some drainage inlets. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the project versus performance goals. "Yes" means the given drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 22. SW 52nd Avenue – Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
SW 52nd Avenue	No	No	Yes	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: It is KHA's recommendation that most of the existing swales be regraded and that new swales be constructed in flatter areas more susceptible to flooding. The cumulative length of the proposed swales is approximately 1,500 LF. The swales are to be designed with a minimum width of 4 feet and a minimum depth of 0.5 feet.

KHA recommends the addition of an exfiltration trench as well as the addition of catch basins throughout the project area. The overall flow of water to the existing outfall is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets, curb inlets, as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently results in ponding or flooding. The proposed improvements will connect the stormwater system to the system that exists along SW 52nd Avenue. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area for two major pollutants.

Table 23. SW 52nd Avenue Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction	Mass Reduction (kg/yr)
Total Nitrogen	67.7	95%	64.18
Total Phosphorous	15.174	95%	14.385

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 24. SW 52nd Avenue Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization/ MOT/ Clearing & Grubbing	1	LS	$67,200	$68,000
2	Stormwater Pollution Prevention	1	LS	$6,720	$7,000
3	Driveway/Sidewalk Restoration	70	SY	$50	$4,000
4	Inlet Apron	19	EA	$500	$10,000
5	Drainage Pipe (36" HDPE) w/ Trench Restoration	380	LF	$200	$76,000
6	Exfiltration Trench w/ Trench Restoration	1,780	LF	$230	$410,000
7	Pollution Retardant Baffle	18	EA	$600	$11,000
8	Catch Basin	8	EA	$7,000	$56,000
9	Curb Inlet Catch Basin	2	EA	$10,000	$20,000
10	Manhole	7	EA	$8,000	$56,000
11	Core Drill Existing Structure	17	EA	$1,000	$17,000
12	Swale Restoration	330	SY	$3	$1,000
13	Utility Sleeves and Adjustments	1	LS	$10,400	$11,000
14	Professional Services	1	LS	$100,800	$101,000
15	Contingency	1	LS	$168,000	$168,000
				TOTAL	$1,016,000

H. SW 31st Avenue – North

Project Location

The SW 31st Avenue – North project sub-basin falls along SW 31st Avenue, just south of West Pembroke Road. The project location is outlined in the figure below, Figure 18.

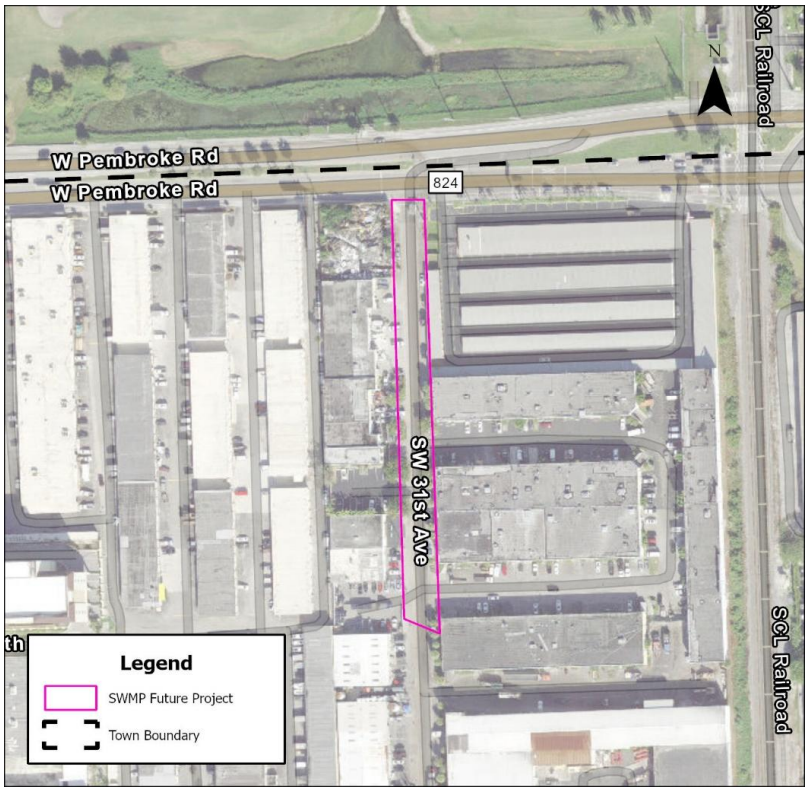


Figure 17. SW 31st Avenue – North Project Location

Existing and Future Conditions

This sub-basin consists of approximately 0.88 acres of existing industrial development adjacent with approximately 700 LF of roadway. The current stormwater system consists of a sparsely scattered drainage inlets. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the project versus performance goals. "Yes" means the given drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 25. SW 31st Avenue – North Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
SW 31st Avenue	No	Yes	Yes	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: KHA recommends the addition of an exfiltration trench as well as the addition of catch basins throughout the project area. The overall flow of water is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently results in ponding or flooding. The proposed improvements will connect to the southern phase of this project, described in the next section, to promote connectivity throughout the project area along SW 31st Avenue. Unique to this project, we propose full asphalt restoration due to the poor condition of the road and to adjust elevations to better facilitate stormwater conveyance to the proposed inlets. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area for two major pollutants.

Table 26. SW 31st Avenue – North Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction	Mass Reduction (kg/yr)
Total Nitrogen	5.08	95%	4.82
Total Phosphorous	1.102	95%	1.044

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 27. SW 31st Avenue – North Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization/ MOT/ Clearing & Grubbing	1	LS	$45,800	$46,000
2	Stormwater Pollution Prevention	1	LS	$4,580	$5,000
3	Curbing Restoration	25	LF	$40	$1,000
4	Asphalt Restoration	1,700	SY	$70	$119,000
5	Inlet Apron	4	EA	$500	$2,000
6	Drainage Pipe (36" HDPE) w/ Trench Restoration	250	LF	$200	$50,000
7	Exfiltration Trench w/ Trench Restoration	710	LF	$230	$164,000
8	Pollution Retardant Baffle	17	EA	$600	$11,000
9	Catch Basin	4	EA	$7,000	$28,000
10	Curb Inlet Catch Basin	2	EA	$10,000	$20,000
11	Manhole	6	EA	$8,000	$48,000
12	Core Drill Existing Structure	7	EA	$1,000	$7,000
13	Utility Sleeves and Adjustments	1	LS	$7,300	$8,000
14	Professional Services	1	LS	$68,700	$69,000
15	Contingency	1	LS	$114,500	$115,000
				TOTAL	$693,000

I. SW 31st Avenue - South

Project Location

The SW 31st Avenue – South Part I project sub-basin falls along SW 31st Avenue, just north of Carolina Street. The project location is outlined in the figure below, Figure 19.

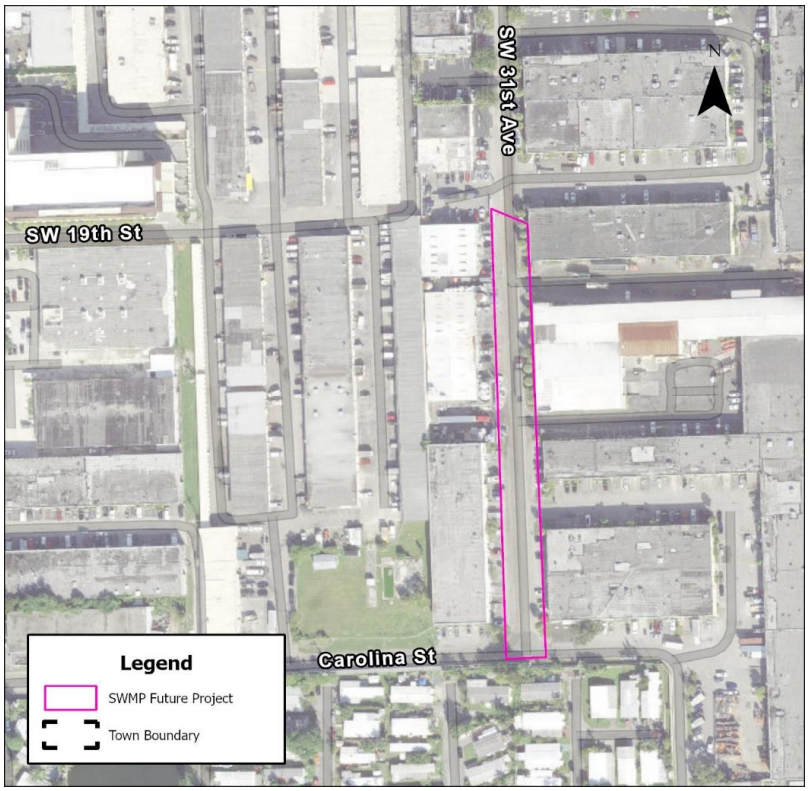


Figure 18. SW 31st Avenue - South Project Location

Existing and Future Conditions

This sub-basin consists of approximately 1.02 acres of existing industrial development adjacent to manufactured home developments with approximately 720 LF of roadway. The current stormwater system consists of sparsely scattered drainage inlets. Some of the inlets along this portion of road fall behind curbing which inhibits the flows to the structures causing further flooding. Since the site is already developed, it is anticipated that future development conditions will not vary significantly from the existing conditions.

Using the data taken from GIS, LiDAR, as-built drawings, site visits and ICPR models KHA determined that the current stormwater system fails largely due to the absence of connectivity and drainage structures.

Performance Goal Analysis

Based on the detailed hydrologic and hydraulic calculations for this project area (Appendix B), the majority of the modeled drainage areas within the project area do not currently meet the Town of Pembroke Park's performance goals. The table below shows the performance of the project versus performance goals. "Yes" means the given drainage area within the sub-basin meets the performance goal, and "No" means that the given drainage area within the sub-basin does not meet the performance goal.

Table 28. SW 31st Avenue – South Performance Goal Analysis

Project/Basin	Water Quality (Volume)	10-Year Storm	100-Year Storm	Observed Flooding or Complaints
SW 31st Avenue	No	Yes	Yes	Yes

Storm Drainage Deficiencies

Inadequate Drainage Infrastructure: Based on the hydrologic and hydraulic calculations for this project area, the existing drainage infrastructure does not discharge quickly enough to meet the desired performance criteria. Improvements to drainage infrastructure will be needed to address these inadequacies.

Recommended Drainage Improvements

Capital Improvements: KHA recommends the addition of an exfiltration trench as well as the addition of catch basins throughout the project area. The overall flow of water is to be facilitated through the proposed main trunk line exfiltration trench system that is fully connected with pipes. These pipes will be connected to the proposed catch basin inlets as well as core drilled into the existing inlets. The lack of existing connectivity and underground storage currently results in ponding or flooding. The proposed improvements will connect the stormwater system to the system that is along Carolina Street and was designed to complement the permitted plans for John P. Lyons by Keith Engineers which is anticipated to start construction by 2025. As referenced in the previous section outlining the northern portion of SW 31st Avenue, we propose full asphalt restoration due to the poor condition of the road and adjust elevations to better facilitate stormwater conveyance to the proposed inlets. Any driveways impacted are to be reconstructed at elevations that match the existing conditions. Concrete aprons on both existing and proposed catch basin inlets are to be renewed or designed to mitigate the surrounding landscaped area's impedance of roadway runoff flow.

Refer to Appendix A for a map series depicting proposed improvements.

Environmental Impact of Proposed Improvements

A full analysis of the estimated pollutant loading for existing and proposed conditions was prepared for the project area and can be found in Appendix C. The table below shows how the proposed improvements will result in significant reduction in the pollutant load contribution from this project area for two major pollutants.

Table 29. SW 31st Avenue – South Pollutant Loading Analysis

Pollutant	Existing Load (kg/yr)	Reduction	Mass Reduction (kg/yr)
Total Nitrogen	5.89	95%	5.59
Total Phosphorous	1.277	95%	1.211

Capital Improvement Budget

The following cost estimates were developed for the proposed stormwater capital improvements.

Table 30. SW 31st Avenue – South Capital Improvement Costs

Item	Description	Qty.	Units	Unit Price	Sub-total
1	Mobilization/ MOT/ Clearing & Grubbing	1	LS	$49,200	$50,000
2	Stormwater Pollution Prevention	1	LS	$4,920	$5,000
3	Curbing Restoration	25	LF	$40	$1,000
4	Asphalt Restoration	1,700	SY	$70	$119,000
5	Inlet Apron	9	EA	$500	$5,000
6	Drainage Pipe (36" HDPE) w/ Trench Restoration	200	LF	$200	$40,000
7	Exfiltration Trench w/ Trench Restoration	700	LF	$230	$161,000
8	Pollution Retardant Baffle	12	EA	$600	$8,000
9	Catch Basin	9	EA	$7,000	$63,000
10	Curb Inlet Catch Basin	2	EA	$10,000	$20,000
11	Manhole	8	EA	$8,000	$64,000
12	Core Drill Existing Structure	3	EA.	$1,000	$3,000
13	Utility Sleeves and Adjustments	1	LS	$7,750	$8,000
14	Professional Services	1	LS	$73,800	$74,000
15	Contingency	1	LS	$123,000	$123,000
				TOTAL	$744,000

CAPITAL IMPROVEMENT PROGRAM

I. Background

Kimley-Horn prepared this Capital Improvement Program (CIP) to prioritize and set budgets required to plan, construct, operate and maintain the Town's Storm Water Management Program. The CIP is a tool intended to provide an order of magnitude for the Town's yearly funding for the implementation of the recommended projects in this Stormwater Master Plan.

The proposed CIP is based on the findings of the assessment of existing drainage improvements in each of the priority project areas. Detailed analysis of nine drainage projects were conducted and Kimley-Horn has validated the recommended order of prioritization to assist the Town in prioritizing and setting budget conditions. The two major components of the CIP are: the Operation and Maintenance Plan and the Budget and Prioritization breakdown.

The Operation and Maintenance Plan is based on the general assessment of the existing drainage conditions within the Town's border and the existing system's limitations. The recommended operation and maintenance procedures are identified below, along with the preliminary budget estimates based on the annual implementation of these procedures.

The Budget and Prioritization component is based on the findings found during the analysis of the nine priority project areas. Preliminary opinions of probable costs (budgets) were prepared for each project area. Based on these preliminary budgets, the priority project area improvements were grouped and phased to provide flexibility with the Town's budget. The following is a detailed explanation and summary of each component of the CIP.

II. Operation and Maintenance Plan

The implementation and continued updates to the Operation and Maintenance Plan (O&M Plan) will allow the Town to maintain the integrity of its stormwater management system and ensure that it continues to operate at design capacity. An O&M Plan will also prepare the Town to comply with the MS4 requirements as required by State and Federal NPDES regulations. The Town is a co-permittee under the MS4 for Broward County. The majority of the MS4 permit requirements are directly related to operation and maintenance of the stormwater infrastructure with particular emphasis on water quality pre-treatment. Periodic observations, routine maintenance, and general improvements are also required. This section of the Stormwater Master Plan is not intended to serve as a complete operation and maintenance manual, but to provide enough information and guidance to allocate sufficient budget to stormwater infrastructure operations and maintenance costs.

A. Street Sweeping

The Town should continue to invest resources in street sweeping. This activity cleans intake structures, reduces debris deposition within the pipe network, and contributes to the aesthetics of the Town. Generally, street sweeping is a positive maintenance activity that provides measurable benefits. Since pollutants, such as hydrocarbons and metals adhere to dirt particles, removing this dirt from the street system will remove the pollutants before they are allowed to discharge into the Town's exfiltration trenches and lakes.

B. Catch Basin Maintenance

Catch basin maintenance is a two-step process. This task includes cleaning the external grate to allow storm water to enter the system and removing sand, silt and debris from the sedimentation chamber of the intake structure. The catch basins should be cleaned using mechanical and manual methods. In the majority of cases, catch basins will be cleaned and maintained in response to observations following significant rain events. Upon making such observations, the Town should evaluate the general area and perform the required maintenance on the inlets and pipes within a sub-basin. Under normal conditions, catch basin maintenance is recommended every 12 months. However, because of foliage and other debris entering the system, the Town should consider conducting catch basin maintenance more frequently in some areas.

C. Pipe Flushing and Exfiltration Trench Cleaning

Exfiltration trench (French drain) is important in the storage, disposal, and water quality treatment of stormwater runoff. Maintenance of the exfiltration trench includes removing the sediment, oil, and grease that accumulate in the bottom of the catch basins attached to the exfiltration trench and pipes to reduce the amount of these pollutants entering the pipe system and adversely impacting the exfiltration or outfall rate. Even with removal of sediment from the catch basins, sediment will build up over time in drainage pipes. Therefore, the pipes should be cleaned and flushed on a regular basis. Pipe flushing is typically performed in conjunction with catch basin cleaning and can be contracted out on an as-needed basis. During this activity, a high-pressure water hose is inserted into the pipe network. This process flushes debris into the catch basin where it can then be removed. Under the MS4 permit, the Town is required to inspect all exfiltration trenches operated by the Town twice per year. If inspections yield unsatisfactory results, maintenance activities such as sediment removal from catch basins and pipe flushing will be required. It is anticipated that sediment will need to be removed from the Town catch basins once year and drainage pipes will need to be cleaned and flushed once every five years.

D. Swale Inspection, Maintenance, and Restoration

Grassed swales and landscaped medians play an important role in storm water disposal. Consistent mowing, inspection and restoration of such features promote storm water retention and efficient percolation. The Town maintains swales and medians within public roadways and individual business owners and residents are mandated through local codes to maintain their facilities. This activity should continue on a scheduled basis.

E. Lake Inspection and Water Quality Monitoring

The Town has many lakes. Consistent inspection and water quality monitoring procedures for the lakes should be established to ensure that they continue to provide both the flood protection and water quality treatment for which they were designed and to ensure the continued enjoyment of the lakes by Town residents.

It is also recommended that the Town further evaluate the pump stations connected to the lakes should the lake geometries change due to development. A reduction in lake capacity could result in additional wear on the Town's equipment caused by a change in cycle times. Adjustments or reconfigurations may be needed to accommodate the new lake geometry.

F. Minor Repairs and Improvements

Maintaining the storm water collection system requires routine improvements and repairs. This task covers a significant spectrum of activities ranging from the repair of collapsed pipes and manholes to the replacements of catch basin grates. Maintenance activities are performed in response to an immediate problem using the best methods available. These tasks often cannot be foreseen or scheduled.

G. Stormwater Pump Maintenance

Stormwater pump maintenance requires scheduling a maintenance plan every year for pump-reconditioning. This reconditioning includes changing the bearings and the mechanical seals as well as making sure that the electrical cables are not damaged in anyway. Included in the maintenance is running the pump a few cycles with clean water to help prevent the formation of deposits as well as monitor the float switches to ensure that they start and stop. During this time, also verify no sediment has formed, that every part of the pump is running smoothly and that the oil levels are appropriate.

III. MS4 Compliance

Under the MS4 permit, the Town is required to conduct inspections of the following activities:

- Evaluating, monitoring, and inspecting waste treatment, storage, and disposal facilities.

- Implementing an inspection program to detect illicit discharges and illegal connections to the stormwater management system.
- Maintaining a citizen complaint log documenting illicit discharges.
- Identifying and maintaining a GIS database of areas served by septic systems and advising the local health department of potential violations if constituents common to wastewater contamination due to malfunctioning septic tank systems are discovered.
- Advising the appropriate utility owner of potential violation if constituents common to wastewater contamination are found in areas served by sanitary sewer systems.
- Inspecting industrial and high-risk facilities for illegal discharges into the MS4.
- Requiring new construction sites to obtain NPDES permits from the FDEP prior to land clearing.
- Monitoring water quality in the canals.

It will be the Town's responsibility to show that inspections and appropriate monitoring have been conducted. It is recommended that the Town continues to coordinate in becoming a co-permittee on the Broward County MS4 permit and enter into an agreement with Broward County to provide water quality monitoring in the canals. The County charges municipalities an annual fee for this service based on the number of outfalls located within the municipal boundaries. However, the Town of Pembroke Park does not have any outfalls leading to monitored canals.

In addition to the above-mentioned inspection activities, public outreach activities and education required under the MS4 permit include:

- Providing education related to the application of pesticides, fertilizers, and herbicides.
- Publicizing the Broward County pollution complaint hotline.
- Instructing the public on the proper disposal of used motor oil, leftover hazardous household products, and lead acid batteries.
- Conducting erosion control training for construction site inspectors and contractors.

The Town is currently a member of the National Flood Insurance Program Community Rating System (CRS), the Town receives credit for public outreach programs dedicated to informing the public about the risks of flooding and steps people can take to protect themselves and their property. It is recommended that the Town conducts public outreach to comply with their MS4 permitting which can also help reduce the Town's CRS score. A lower CRS score will provide a higher discount on flood insurance for property owners.

IV. Operation and Maintenance Cost

It is assumed that the Town currently spends $200,000 per year on their operations and maintenance cost as well as $100,000 every three years to account for replacement of stormwater pumps, based on prior correspondence and previous fiscal reports. Using this estimation, KHA has created a cumulative operations and maintenance cost, seen in Table 32. This includes the Town's current structures as well as any additional structures that are currently planned. KHA has also included a 3% annual increase that has been projected throughout the 10-year CIP.

As the maintenance activities are initiated, we recommend utilizing the database of GIS information to track and schedule the maintenance and inspection activities. This process will identify the date and time that a system was last maintained and will also provide a tool to identify the next scheduled maintenance.

A. Utility Fee Collection

The Town of Pembroke Park adheres to Generally Accepted Accounting Principles (GAAP) for its budgeting and financial operations. According to these principles, the Town must use distinct accounting entities called funds to manage resources for various purposes. The Town employs two types of funds: Governmental Funds and Enterprise (or Proprietary) Funds.

Governmental Funds are used to finance most governmental functions and include the General Fund, Debt Service Fund, and General Capital Projects Fund.

Enterprise Funds account for continuous activities similar to those in the private sector, such as the Sewer Utility Fund and Storm Water Utility Fund.

V. Green Initiatives

The development of this SWMP sets the Town on a path towards identification and prioritization of stormwater infrastructure improvements that serve as the basis for flood mitigation. However, it is also an important step in jump starting the Town's evaluation of future vulnerabilities and planning for resiliency.

Future condition flooding scenarios are being studied by Broward County as mentioned in previous sections, and by the State through The Resilient Florida Program (§ 380.093, Fla. Stat.). The latter includes a grant mechanism for eligible municipalities to receive funding for resiliency planning of their critical infrastructure, including stormwater systems. The grants are geared towards both planning and implementation but require a Vulnerability Assessment (VA) as the first step since the completion of a VA renders the Town eligible for additional State funding to implement identified projects. The requirements for the VA are laid out by the same Statute and offer a sequential process to identify areas and assets of the town that are impacted by five different types of flooding, as applicable. The VA may also include other non-flooding related threats chosen for evaluation by the Town.

In addition to the benefit of eligibility for additional funding, a VA would expand on the findings of this SWMP to include additional flooding scenarios and vulnerable critical infrastructure. Likewise, the development of this SWMP supports the VA by providing priority areas, vulnerable to flooding in future conditions as they are in existing conditions, as well as localized models capable of addressing rainfall-induced flooding, one of the required analyses of the VA. With completion of the SWMP and VA the Town will have a robust list of threats, vulnerabilities, and most importantly resiliency solutions that will benefit the community for years to come.

At the time of this report, a VA is being prepared for the Town.

VI. Drainage Capital Projects

The Capital Improvement Program (CIP) is based on the results of the analysis of the nine (9) priority projects. Recommended improvements to achieve the stated performance goals were identified for each project area. The recommended improvements were quantified based on the available data and preliminary opinions of probable costs (preliminary budgets) were prepared for each project area. Prior to each individual project being implemented, professional services such as surveying, engineering, and permitting will be required and are included within the budgets. The budget figures were developed by reviewing recent costs from similar projects. The CIP budgets are based on 2024 market conditions.

The following assumptions have been made in the formulation of the budgets for the drainage improvements:

- The budgets include the recommended improvements identified in the analysis of the nine (9) priority sub-basin projects.
- Projects were separated by sub-basin and/or section of identified roadway.
- The budgets include restoration of the roadway impacted by the proposed trenching, but do not include any additional roadway resurfacing; with the exception of SW 31st Avenue North and South. It is assumed that roadway resurfacing will be completed concurrently with the proposed drainage projects, but that the Town will have a separate roadway resurfacing budget.
- The budgets do not include any costs of obtaining construction easements. A budget of $30,000 is included for obtaining easements when a new outfall is proposed although no new outfall has been proposed in this update of the Stormwater Master Plan.
- The budgets include a 10% allowance for mobilization and maintenance of traffic.
- The budgets include a 5% allowance for utility adjustments; however, some projects have many existing underground utilities, therefore, a 15% budget for adjustments was utilized.
- The budgets include a 25% contingency for each project. A relatively high contingency value is used, due to the age and level of coverage of the survey and geotechnical data available to prepare the conceptual design for the projects.

- The budgets include a minimum of $60,000 or 15% of construction cost, listed as professional services, allowance for surveying, engineering, permitting, and construction phase assistance (site observations during construction).
- The budgets include swale restoration costs to replace sod only. No budget for additional landscape improvements or restoration is included.

The budgetary numbers are an opinion of probable construction costs in the current marketplace. Unit pricing for similar projects constructed in Broward County was used as the basis for the construction budget. Based on the preliminary budgets, the proposed priority sub-basin improvements were grouped and phased to provide the ten-year capital improvement program.

A. Priority Ranking

Table 31 shows the priority ranking for the capital improvement projects. Scores were assigned and/or calculated for the categories of Hydraulic Analysis, Water Quality Treatment, Observed Flooding, Complaints, and Traffic Volumes. The basis for the calculated category scores is detailed below. The scores were then totaled, and the projects were ranked from highest to lowest.

Table 31. Project Prioritization Matrix

Priority Ranking	Project Name	Hydraulic Analysis	Water Quality Treatment	Observed Flooding	Complaints	Traffic Volumes	Total Score
1	Park Road - North - Part I	5	5	5	4	5	24
2	Park Road - North - Part II	5	5	4	4	5	23
3	Park Road - South	5	5	4	3	5	22
4	SW 31st Ave - South	5	5	5	4	1	20
7	SW 31st Ave - North	4	5	5	4	1	19
6	SW 55th Ave Homes	5	5	4	4	1	19
5	Infinity Azure	5	5	4	3	1	18
8	SW 52nd Ave - South	5	5	2	2	3	17
9	SW 36th Ct	5	5	3	2	1	16

Hydrologic and Hydraulic Analysis

1 = All water quantity performance goals met in future condition analysis.

2 = Future condition water quantity performance goals failed in less than 1/3 of drainage areas.

3 = Future condition water quantity performance goals failed in 1/3 to 1/2 of drainage areas.

4 = Future condition water quantity performance goals failed in 1/2 to all but one drainage area.

5 = Future condition water quantity performance goals failed in all of the drainage areas.

Water Quality Treatment

1 = All water quality performance goals met in future condition analysis.

2 = Future condition water quality performance goals failed in less than 1/3 of drainage areas.

3 = Future condition water quality performance goals failed in 1/3 to 1/2 of drainage areas.

4 = Future condition water quality performance goals failed in 1/2 to all but one drainage area.

5 = Future condition water quality performance goals failed in all of the drainage areas.

Complaints Scoring

1 = No complaints were reported by the Town of Pembroke Park.

2 = One complaint was reported by the Town of Pembroke Park.

3 = Two complaints were reported by the Town of Pembroke Park.

4 = Three complaints were reported by the Town of Pembroke Park.

5 = More than three complaints were reported by the Town of Pembroke Park.

Observed Flooding Scoring

1 = KHA did not observe flooding across the roadway in the sub-basin.

2 = KHA observed flooding across the roadway at one location in the sub-basin.

3 = KHA observed flooding across the roadway at two locations in the sub-basin.

4 = KHA observed flooding across the roadway at three locations in the sub-basin.

5 = KHA observed flooding across the roadway at more than three locations in the sub-basin.

Traffic Volumes

The ratings for this category are based on percentage of roadway length classified as local, collector, or arterial roadways according to the Town's Growth Management Plan.

1 = The majority of roadways in sub-basin are local roadways.

3 = The majority of roadways in sub-basin are collector roadways.

5 = The majority of roadways in sub-basin are arterial roadways.

B. Stormwater Capital Improvement Summary

The updated ten-year CIP summary is contained in Table 32. Note that the Park Road – North Part I project and the Park Road – North Part II project have the highest priority ranking scores due to a high number of citizen and town complaints and poor performance of hydraulic analyses and are projected to be implemented in the 1st and 2nd years of the CIP due to the score they received from the prioritization matrix analysis. The CIP schedule is KHA's recommendation based on the prioritization matrix and should be re-evaluated to fit the needs of the Town. The improvements proposed along Park Road should take into account the SW 25th Street project as well as the second phase of John P. Lyons Lane when the Town decides to plan for the Park Road projects. Table 32 also includes the updated operations and maintenance budget considering a 3% increase per year. The projects are recommended to be coordinated with any roadway CIP project scheduling to ensure that the drainage improvements are complete before or at the same time as the roadway improvements in the same area to ensure the road does not need to be restored twice. This may require some adjustment to the roadway CIP schedule. Additionally, the cost estimates for these projects were carried out relative to the 2024 market and dollar value. At the time of each project undertaking, these values should be adjusted to reflect and account for future inflation.

Table 32. Proposed CIP Budgets & Schedule

Proposed Project	FY 25-26	FY 26-27	FY 27-28	FY 28-29	FY 29-30	FY 30-31	FY 31-32	FY 32-33	FY 33-34	FY 34-35	TOTALS
Park Road - North - Part I	$1,026,000	$0	$0	$0	$0	$0	$0	$0	$0	$0	$1,026,000
Park Road - North - Part II	$0	$1,016,000	$0	$0	$0	$0	$0	$0	$0	$0	$1,016,000
Park Road - South	$0	$0	$513,000	$0	$0	$0	$0	$0	$0	$0	$513,000
SW 31st Ave - South	$0	$0	$0	$744,000	$0	$0	$0	$0	$0	$0	$744,000
SW 31st Ave - North	$0	$0	$0	$0	$693,000	$0	$0	$0	$0	$0	$693,000
SW 55th Ave Homes	$0	$0	$0	$0	$0	$1,036,000	$0	$0	$0	$0	$1,036,000
Infinity Azure – Part I	$0	$0	$0	$0	$0	$0	$816,000	$0	$0	$0	$816,000
Infinity Azure – Part II	$0	$0	$0	$0	$0	$0	$0	$408,000	$0	$0	$408,000
SW 52nd Ave - South	$0	$0	$0	$0	$0	$0	$0	$0	$1,016,000	$0	$1,016,000
SW 36th Ct	$0	$0	$0	$0	$0	$0	$0	$0	$0	$444,000	$444,000
Operations and Maintenance	$200,000	$206,000	$312,180	$321,545	$331,192	$441,128	$454,361	$467,992	$582,032	$599,493	$3,915,923
TOTALS	$1,226,000	$1,222,000	$825,180	$1,065,545	$1,024,192	$1,477,128	$1,270,361	$875,992	$1,598,032	$1,043,493	$11,627,923

APPENDIX A – TOWNWIDE EXHIBITS

Legend

- Town Boundary
- Lake

0 450 900 1,800 Feet

Mayo St
Washington Park
Pembroke Rd
W Pembroke Rd
SW 18th St
SW 19th St
SW 20th St
SW 21st St
SW 23rd St
SW 24th St
SW 25th St
SW 26th St
SW 27th St
SW 28th St
SW 28th Ct
SW 25th Ct
SW 52nd Ave
SW 50th Ave
SW 54th Ave
SW 57th Ter
SW 57th Ave
SW 56th Ter
SW 56th Ave
SW 46th Ave
SW 44th Ave
SW 42nd Ave
SW 40th Ave
SW 32nd Ave
SW 47th Ave
SW 11th Ave
S Park Rd
John P Lyons Ln
Country Club Ln
Lake Shore Dr
Marine Dr
W Lake Dr
SW 31st Dr
SW 32nd Dr
SW 33rd Dr
SW 32nd St
SW 33rd St
SW 36th St
SW 38th St
SW 39th St
SW 40th St
SW 32nd Blvd
NE 215th St
NE 214th Ln
NE 214th St
NE 213th Ter
W Hallandale Beach Blvd
Behan Lake
Meekins Lake
Lake Rangel
Lake Helen
Lake Margaret
Desoto Lakes
Pembroke Park
West Park
New Town Park
McTyre Park
Lake Forest Elementary School
Watkins Elementary School
Hallandale School
Gateway West
824
858
95

State of Florida, Maxar, Esri Community Maps Contributors, FDEP, Esri, TomTom, Garmin, SafeGraph, GeoTechnologies, Inc, METI/NASA, USGS, EPA, NPS, US Census Bureau, USDA, USFWS

Kimley»Horn
8201 Peters Road, Suite 2200
Plantation, Florida 33324
(954) 535-5100 Phone
(954) 535-5179 Fax
www.kimley-horn.com

TOWN OF PEMBROKE PARK STORMWATER MASTER PLAN UPDATE #1

TOWN BOUNDARY MAP

DATE:	MAY 2024
DESIGN:	TS
DRAWN:	EL
CHECKED:	TS
KH NO.:	143586100

Exhibit
A-1

K:\FTL_GIS\00_Project_Files\Civ_Pembroke Park\143586100 Pembroke Pk Stormwater MP Update\143586100 Pembroke Pk Stormwater MP Update.aprx

Legend

- Town Boundary

Flood Zone

- Zone A
- Zone AE
- Zone AH
- Zone D
- Zone VE
- Zone X

0 450 900 1,800 Feet

Mayo St
Washington Park
Pembroke Rd
W Pembroke Rd
SW 18th St
SW 19th St
SW 20th St
SW 21st St
SW 23rd St
SW 24th St
SW 25th St
SW 25th Ct
SW 26th St
SW 27th St
SW 28th St
SW 28th Ct
SW 51st Ave
SW 50th Ave
SW 46th Ave
SW 44th Ave
SW 42nd Ave
SW 40th Ave
SW 32nd Ave
SW 57th Ter
SW 56th Ave
Meekins Lake
Behan Lake
Pembroke Park
S Park Rd
John Piccolo Ln
Lake Ranger
Hallandale School
Gateway West
W Hallandale Beach Blvd
West Park
New Town Park
McTyre Park
Lake Forest Elementary School
Westlake Elementary School
Lake Helen
Lake Margaret
SW 32nd St
SW 33rd St
SW 36th St
SW 38th St
SW 39th St
SW 40th St
SW 31st Dr
SW 32nd Dr
SW 33rd Dr
SW 47th Ave
SW 56th Ave
W Lake Dr
Lake Shore Dr
Marina Dr
Country Club Ln
SW 32nd Blvd
SW 41th Ave
Desoto Lakes
NE 215th St
NE 214th Ln
NE 214th St
NE 213th Ter
95
858
824

State of Florida, Major Participating Urban Units, FDEP, Esri, TomTom, Garmin, SafeGraph, GeoTechnologies, Inc, METI/NASA, USGS, Esri, HERE, USDA, USFWS, Esri Community Maps Contributors, Esri, HERE, Garmin, SafeGraph, GeoTechnologies, Inc, METI/NASA, USGS, Esri, HERE, USDA, USFWS

Kimley»Horn
8201 Peters Road, Suite 2200
Plantation, Florida 33324
(954) 535-5100 Phone
(954) 535-5101 Fax
www.kimley-horn.com


TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

FEMA FLOOD ZONE MAP

DATE:	MAY 2024
DESIGN:	TS
DRAWN:	EL
CHECKED:	TS
KH NO.:	143586100

Exhibit
A-2

K:\FTL_GIS\00_Project_Files\Civ_Pembroke Park\143586100 Pembroke Pk Stormwater MP Update\143586100 Pembroke Pk Stormwater MP Update.aprx

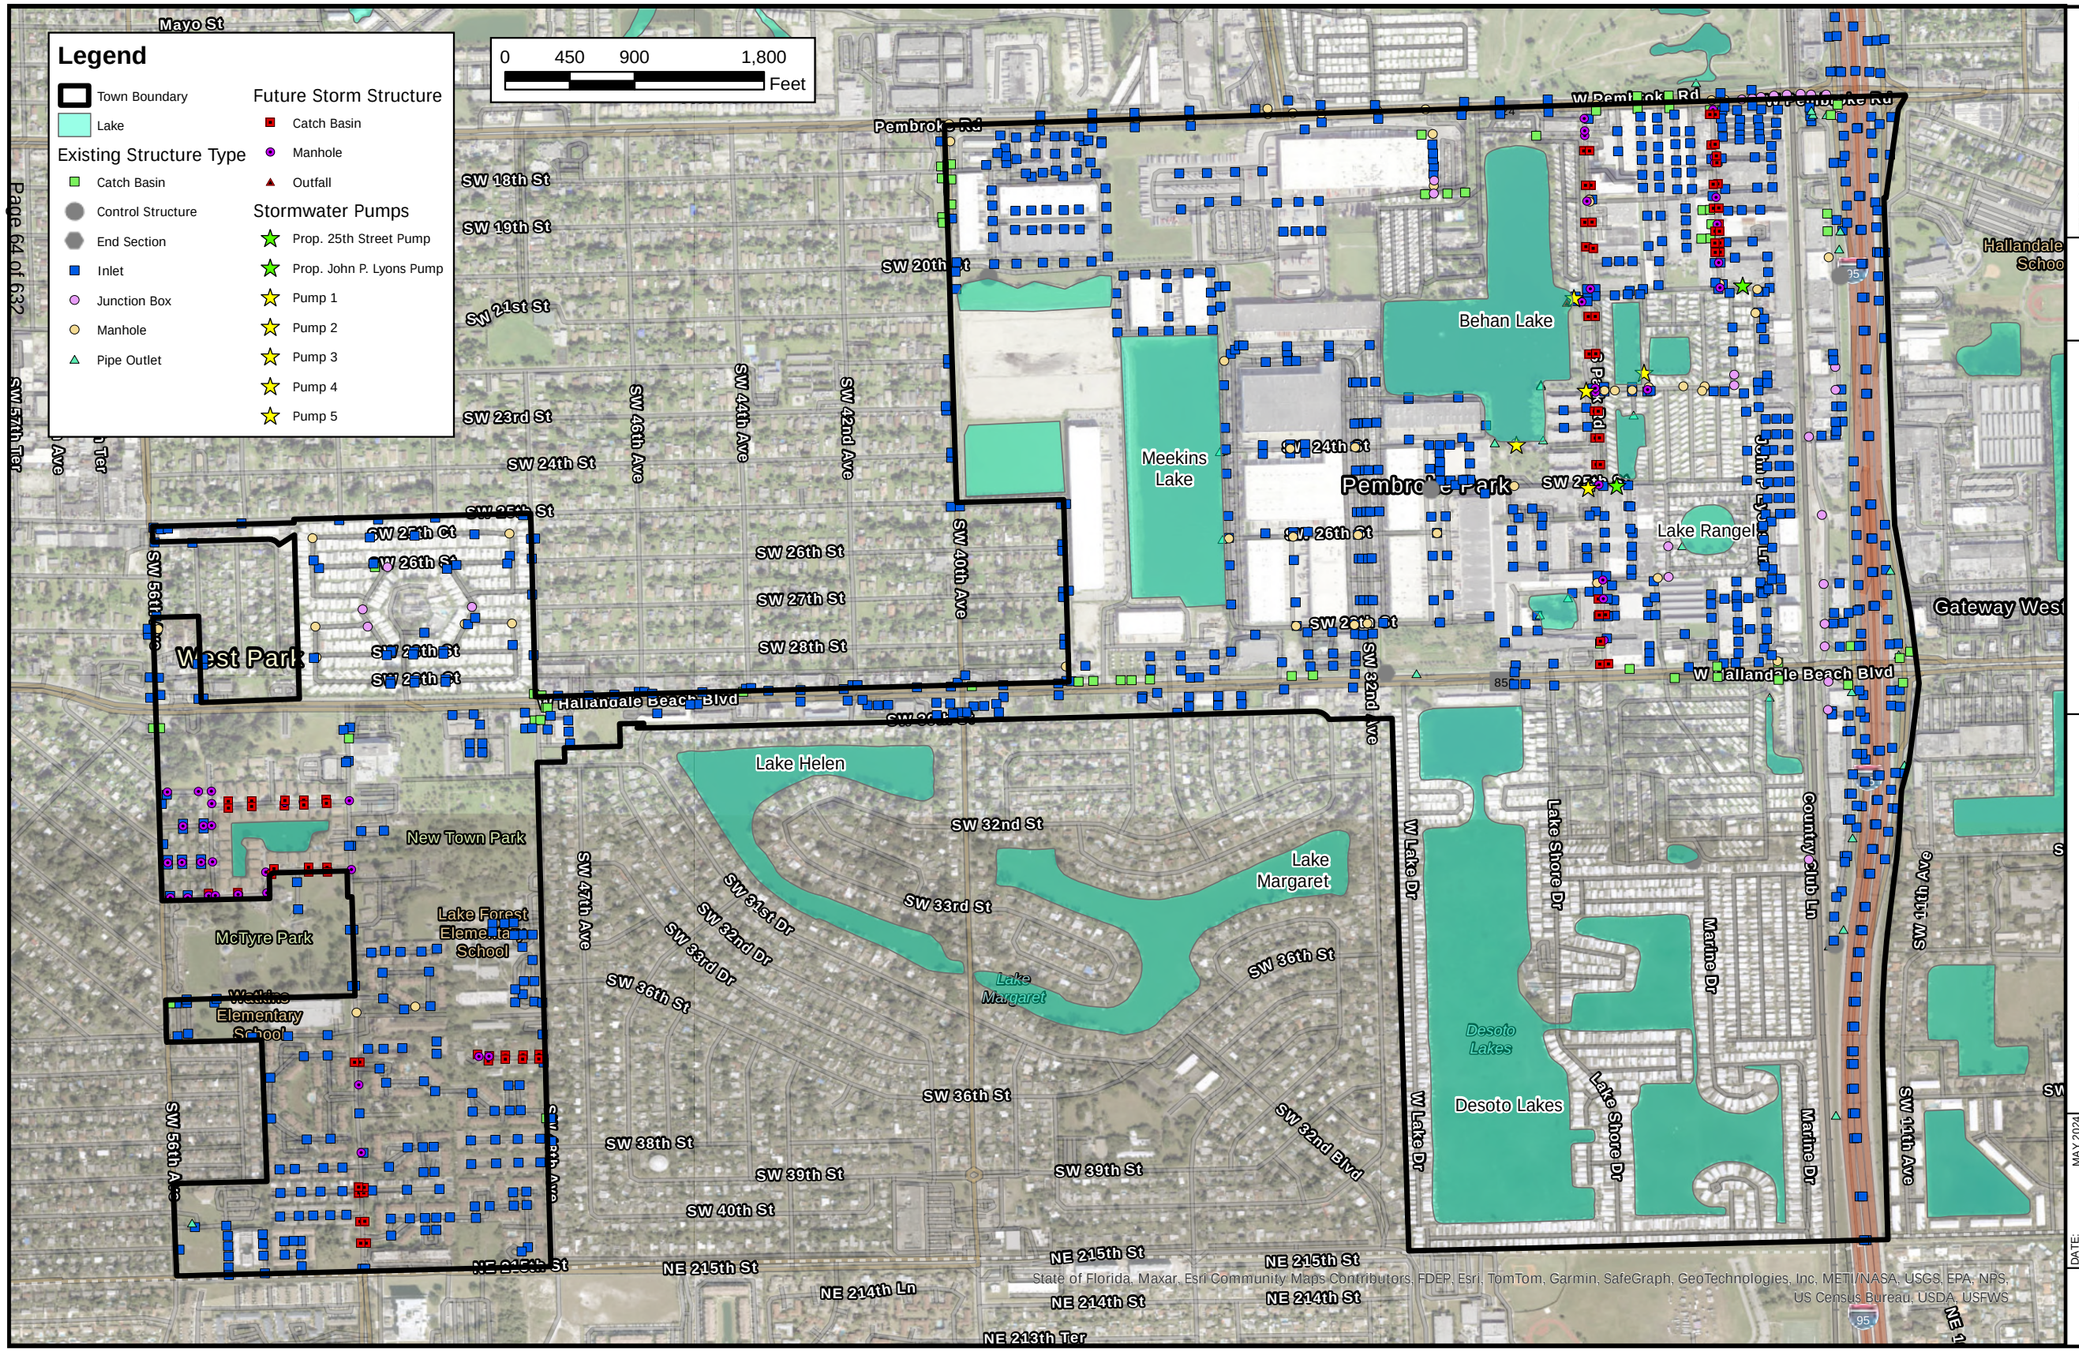

Kimley»Horn
8201 Peters Road, Suite 2200
Plantation, Florida 33324
(954) 535-5100 Phone
(954) 535-5179 Fax
www.kimley-horn.com


TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

EXISTING / PROPOSED
STORM STRUCTURE MAP

DATE:	MAY 2024
DESIGN:	TS
DRAWN:	EL
CHECKED:	TS
KH NO.:	143586100

Exhibit
A-3

K:\FTL_GIS\00_Project_Files\CIV_Pembroke Park\143586100 Pembroke Pk Stormwater MP Update\143586100 Pembroke Pk Stormwater MP Update.aprx

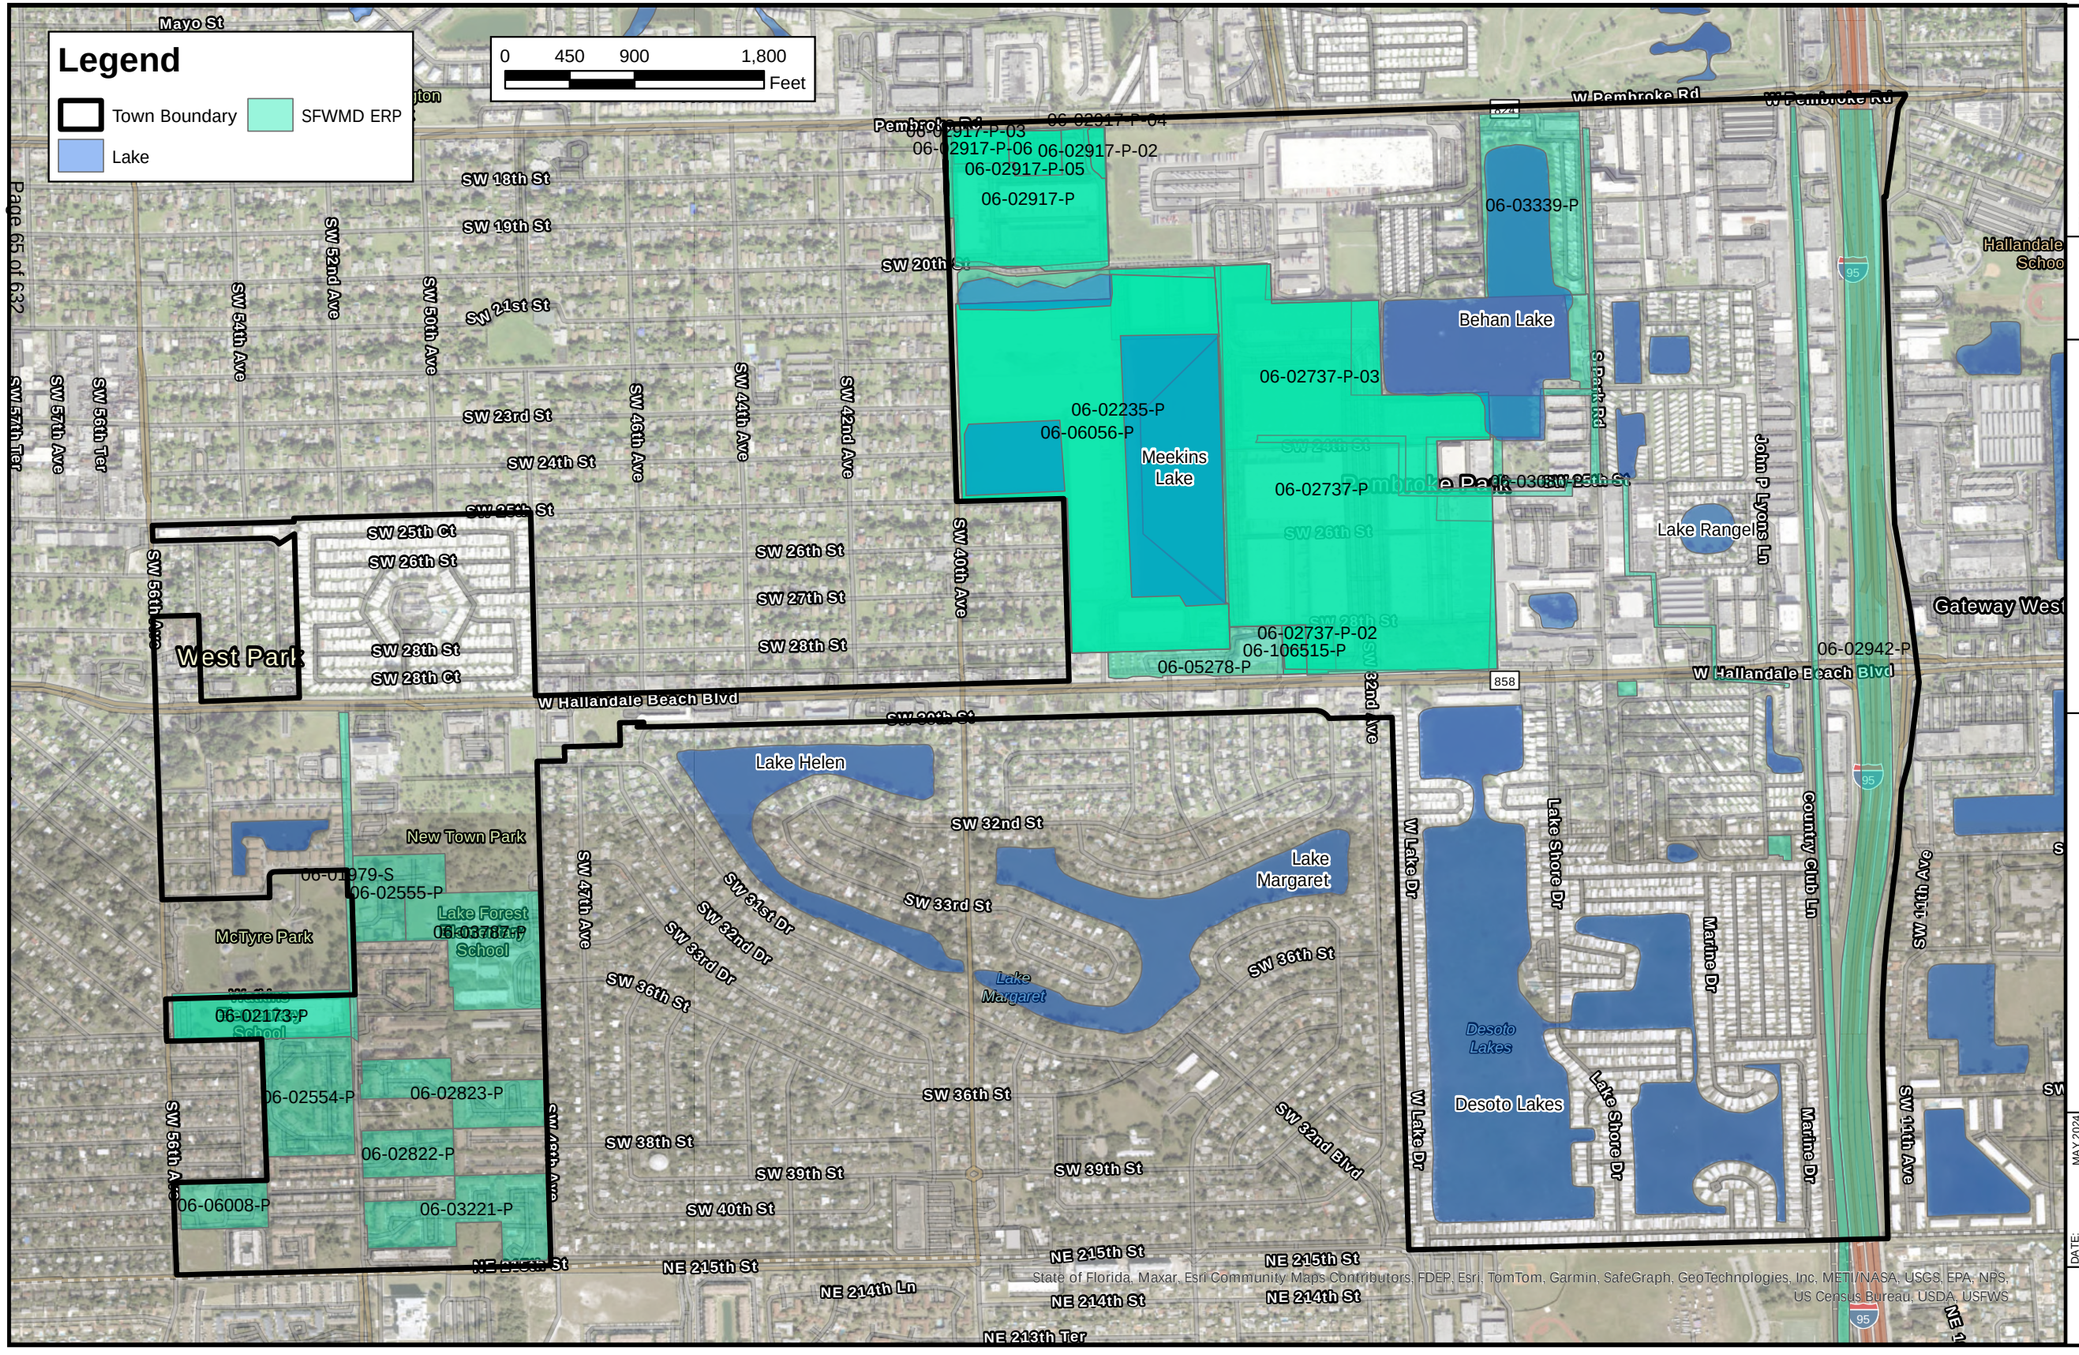

Kimley»Horn
8201 Peters Road, Suite 2200
Plantation, Florida 33324
(954) 535-5100 Phone
(954) 535-5179 Fax
www.kimley-horn.com

TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

SFWMD ENVIRONMENTAL
RESOURCE PERMIT MAP

DATE:	MAY 2024
DESIGN:	TS
DRAWN:	EL
CHECKED:	TS
KH NO.:	143586100

Exhibit
A-4

K:\FTL_GIS\00_Project_Files\Civ_Pembroke Park\143586100 Pembroke Pk Stormwater MP Update\143586100 Pembroke Pk Stormwater MP Update.aprx

Legend

- Town Boundary
- Permit Delineated Basins

0 450 900 1,800 Feet

B-1 B-2 B-3 B-4 B-5 B-6 B-7 B-8 B-9 B-10 B-11 B-12 B-13 B-14 B-15 B-16 B-17 B-18 B-19 B-20 B-21 B-22 B-23 B-24 B-25 B-26 B-27 B-28 B-29 B-30 B-31 B-32 B-33 B-34 B-35 B-36 B-37 B-38 B-39

Behan Lake
Meekins Lake
Lake Rangel
Lake Helen
Lake Margaret
Desoto Lakes

Pembroke Park
West Park
New Town Park
McTyre Park
Lake Forest Elementary School
Hallandale School
Gateway West

Mayo St
Washington Park
Pembroke Rd
W Pembroke Rd
SW 18th St
SW 19th St
SW 20th St
SW 21st St
SW 23rd St
SW 24th St
SW 25th St
SW 25th Ct
SW 26th St
SW 26th Ct
SW 27th St
SW 28th St
SW 28th Ct
SW 29th St
SW 30th St
SW 32nd St
SW 33rd St
SW 36th St
SW 38th St
SW 39th St
SW 40th St
NE 213th Ter
NE 214th Ln
NE 214th St
NE 215th St
W Hallandale Beach Blvd
SW 52nd Ave
SW 54th Ave
SW 50th Ave
SW 46th Ave
SW 44th Ave
SW 42nd Ave
SW 40th Ave
SW 57th Ter
SW 57th Ave
SW 56th Ter
SW 56th Ave
SW 47th Ave
SW 32nd Ave
SW 31st Dr
SW 32nd Dr
SW 33rd Dr
SW 32nd Blvd
S Park Rd
John P Lyons Ln
Country Club Ln
Marine Dr
Lake Shore Dr
W Lake Dr
SW 11th Ave
NE 1
95
858
824

State of Florida, Maxar, Esri Community Maps Contributors, FDEP, Esri, TomTom, Garmin, SafeGraph, GeoTechnologies, Inc, METI/NASA, USGS, EPA, NPS, US Census Bureau, USDA, USFWS

Kimley»Horn
8201 Peters Road, Suite 2200
Plantation, Florida 33324
(954) 535-5100 Phone
(954) 535-5179 Fax
www.kimley-horn.com


TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

PERMIT DELINEATED
BASIN MAP

DATE:	MAY 2024
DESIGN:	TS
DRAWN:	EL
CHECKED:	TS
KH NO.:	143586100

Exhibit
A-5

K:\FTL_GIS\00_Project_Files\Civ_Pembroke Park\143586100 Pembroke Pk Stormwater MP Update\143586100 Pembroke Pk Stormwater MP Update.aprx

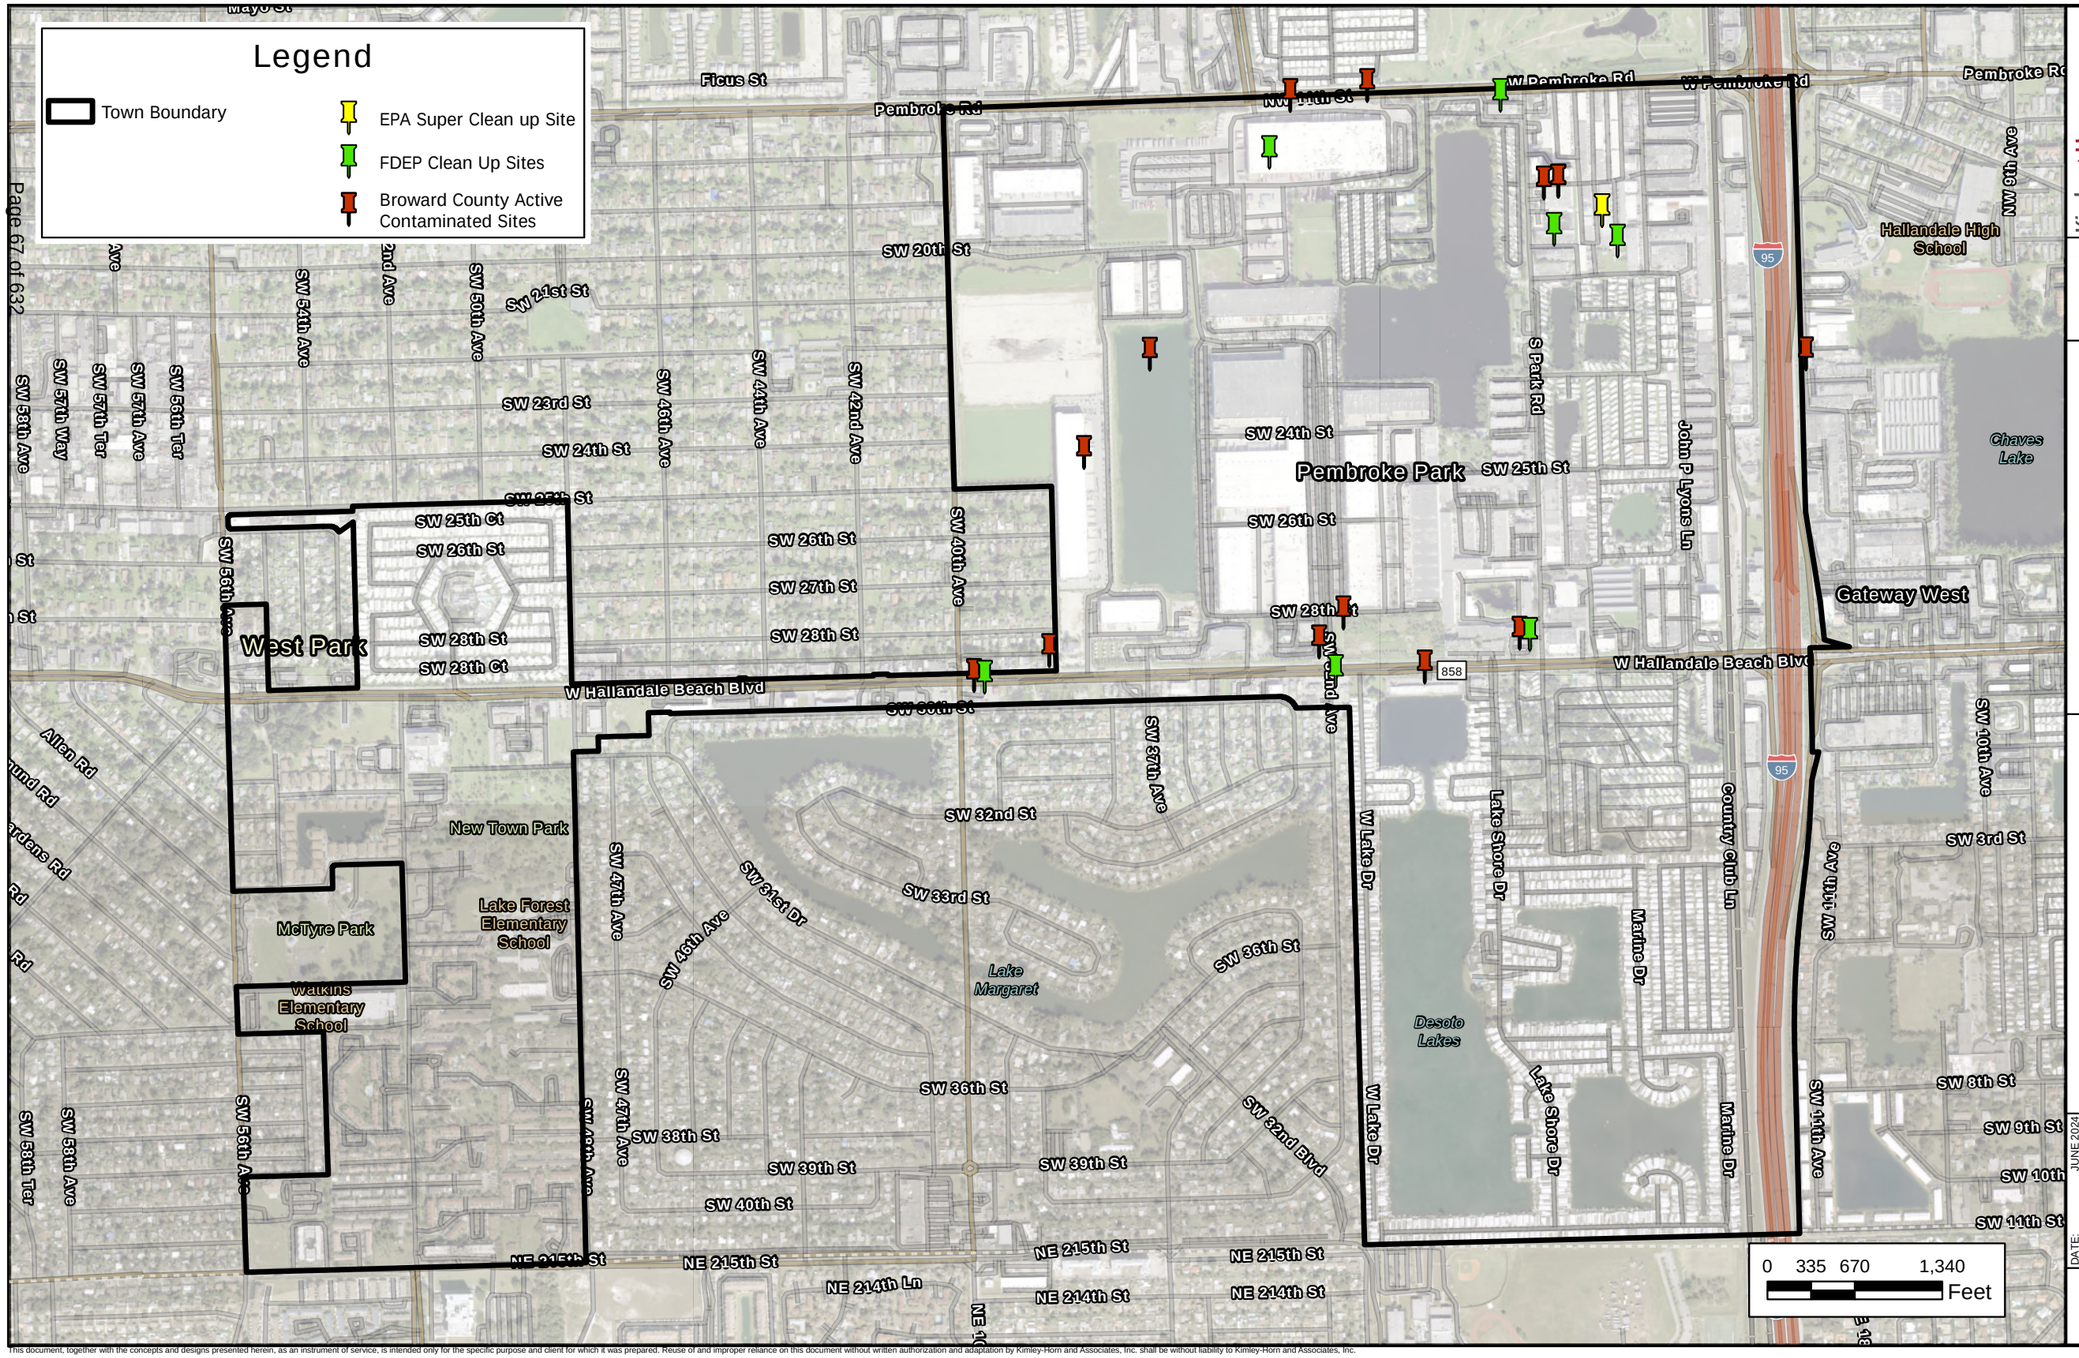

Kimley»Horn
8201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone

TOWN OF PEMBROKE PARK STORMWATER MASTER PLAN UPDATE #1

EPA, FDEP, & BROWARD COUNTY CONTAMINATED SITE MAP

DATE:	JUNE 2024
DESIGN:	DIM
DRAWN:	DIM
CHECKED:	TS
KH NO.:	143586100

SHEET
A-6

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Kimley»Horn
2201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone


TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

INFINITY AZURE HOMES
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DIM
DRAWN:	DIM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

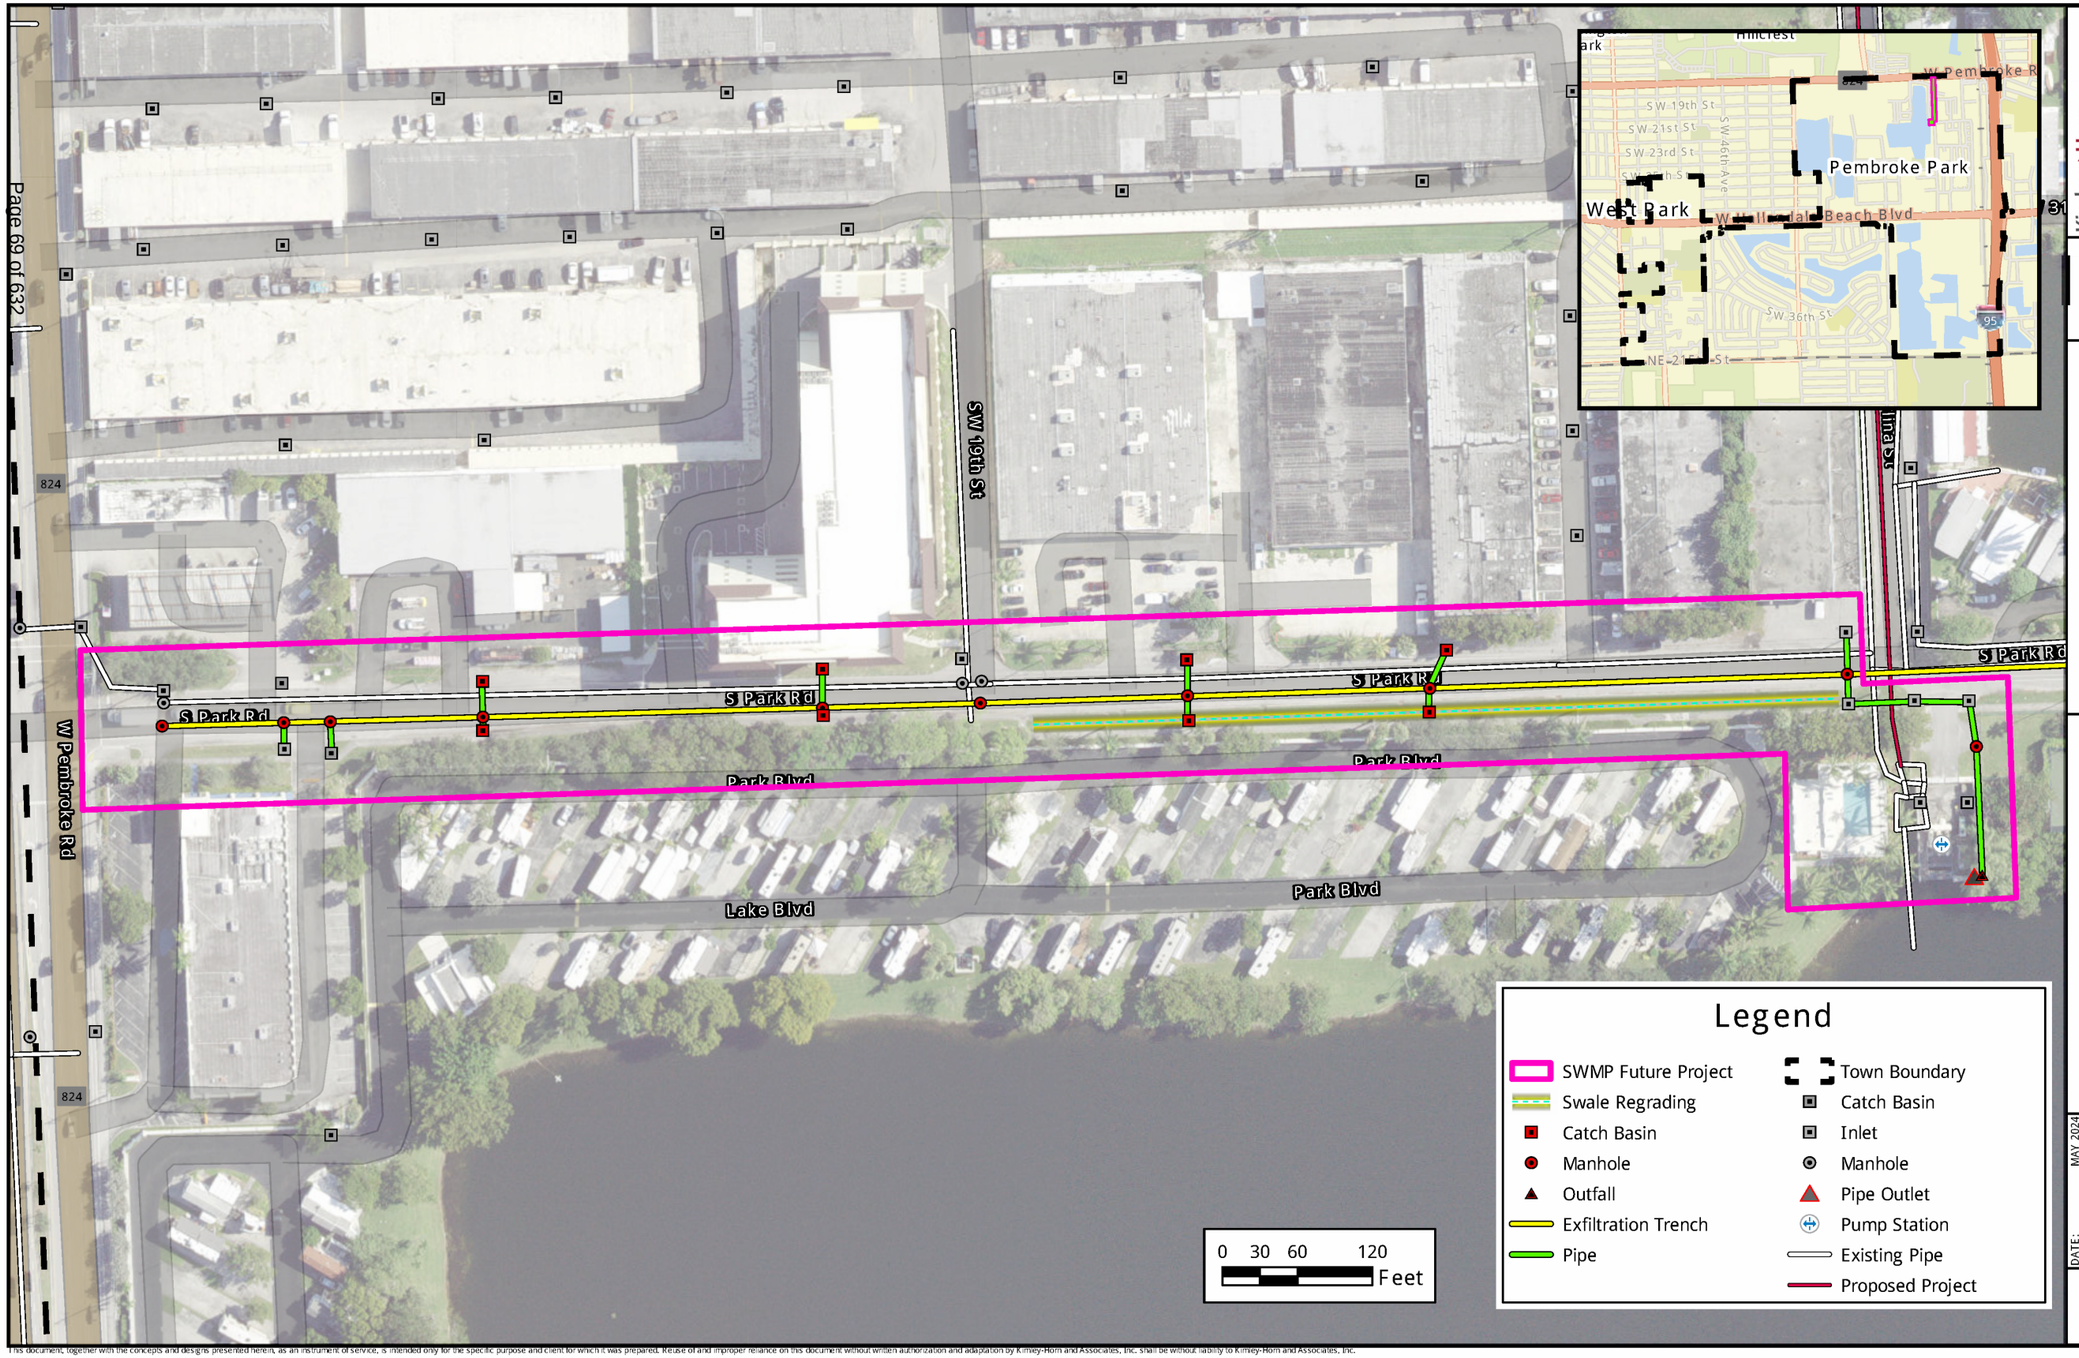

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.


Kimley»Horn
8201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone

TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

PARK ROAD - NORTH PART 1
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DJM
DRAWN:	DJM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

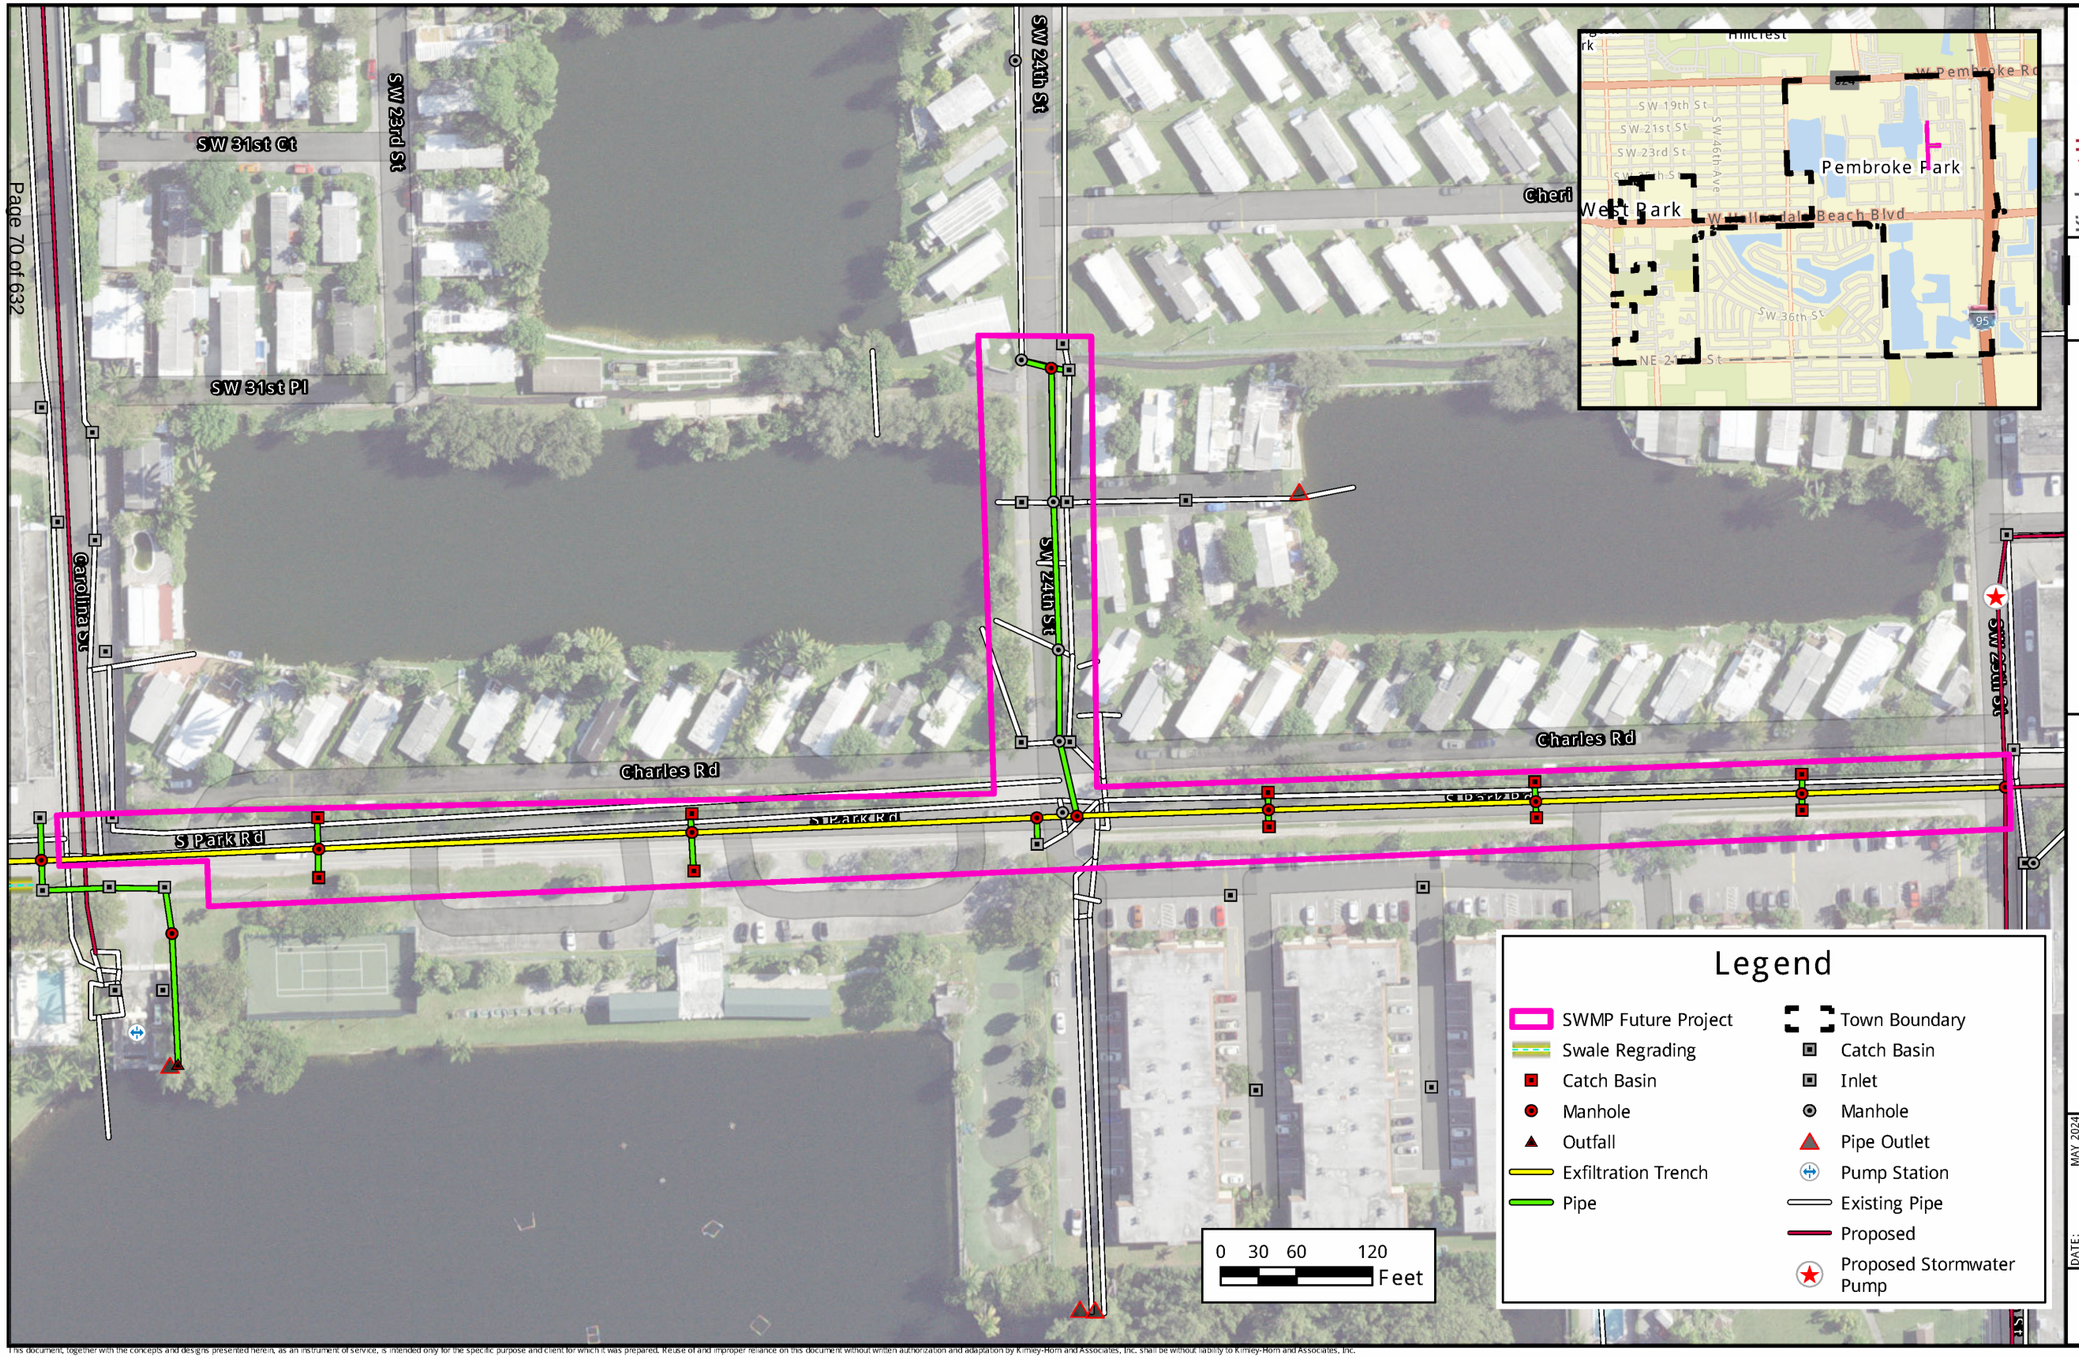

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Kimley»Horn
8201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone

TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

PARK ROAD - NORTH PART 2
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DJM
DRAWN:	DJM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

Legend

- SWMP Future Project
- Catch Basin
- Manhole
- Exfiltration Trench
- Pipe
- Town Boundary
- Catch Basin
- Inlet
- Manhole
- Pipe Outlet
- Existing Pipe
- Proposed Project

Kimley»Horn
8201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone

TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

PARK ROAD - SOUTH
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DIM
DRAWN:	DIM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Kimley»Horn
8201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone

TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

SW 31ST AVE - NORTH
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DIM
DRAWN:	DIM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Kimley»Horn
2201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone


TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

SW 36TH CT
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DIM
DRAWN:	DIM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

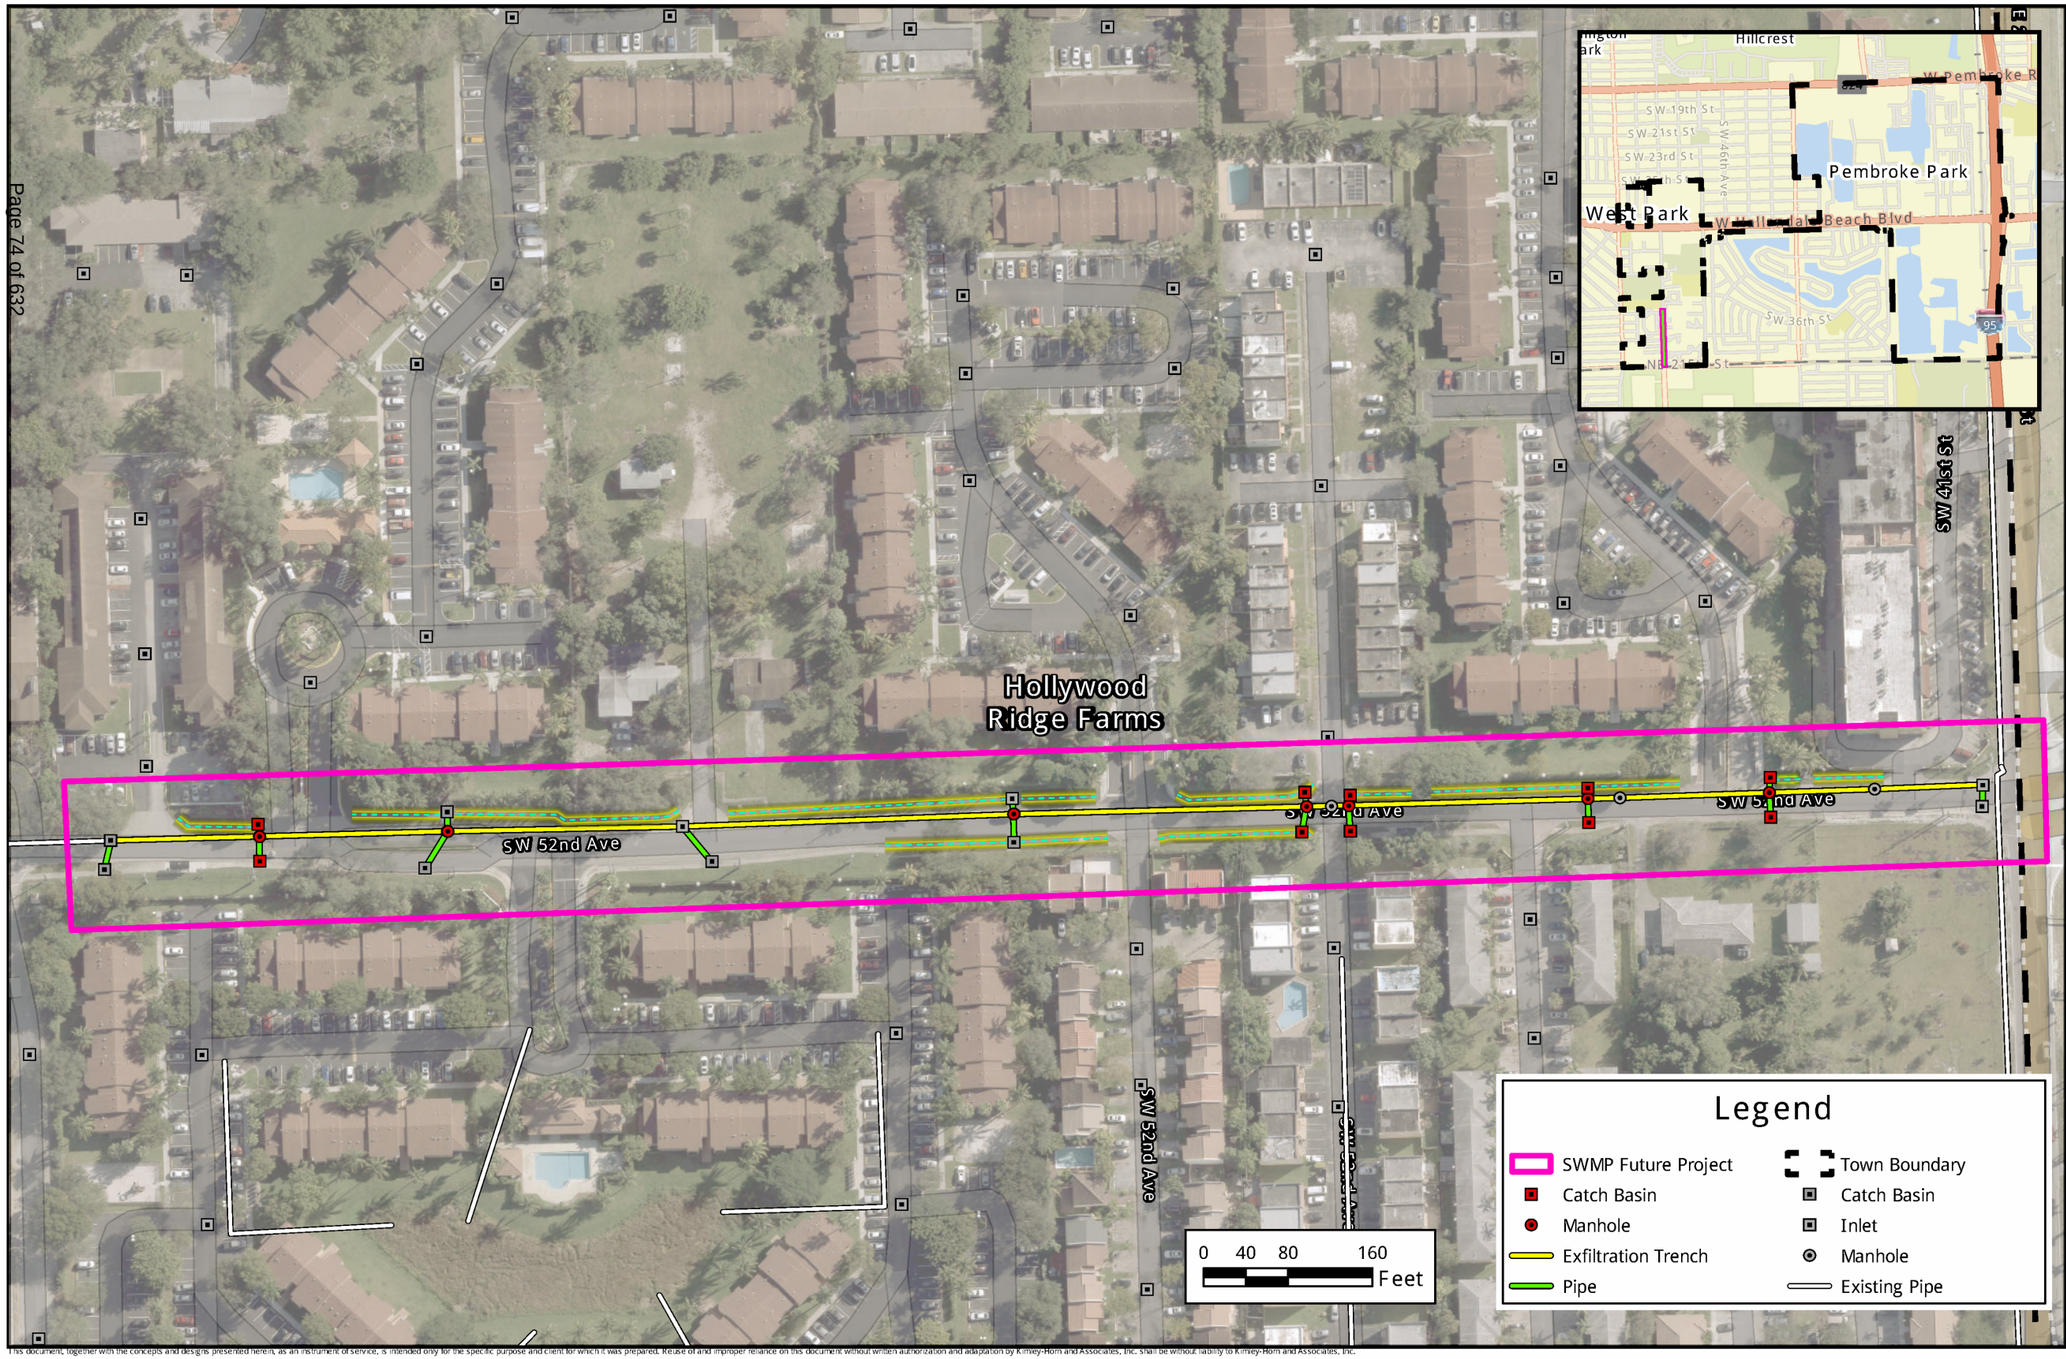

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Kimley»Horn
8201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone

TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

SW 52ND AVE
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DIM
DRAWN:	DIM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

Kimley»Horn
2201 Peters Road
Suite 2200
Plantation, FL 33324
(954) 535-5100 Phone

TOWN OF PEMBROKE PARK
STORMWATER MASTER PLAN
UPDATE #1

SW 55TH AVE HOMES
DRAINAGE IMPROVEMENTS

DATE:	MAY 2024
DESIGN:	DJM
DRAWN:	DJM
CHECKED:	TS
KH NO.:	143586100

SHEET
1

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

APPENDIX B – PROPOSED IMPROVEMENTS EXHIBITS

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)	1.70E-04	cfs/ft^2-ft
Pavement Section Thickness	1.7	ft
Factor of Safety (FS)	2.0	
Proposed Exfiltration Trench		
Length of Trench for Water Quality (Lwq)	1,965.0	ft
Additional Length of Trench (Ladd)		ft
Control Elevation (CE)	1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a	ft-NAVD
Lowest Rim Elevation	4.80	ft-NAVD
Trench Width (W)	6.00	ft
Depth of Trench (D)	4.00	ft
Top of Trench Elevation	3.13	ft-NAVD
Bottom of Trench Elevation	-0.87	ft-NAVD
Distance from EL_{inv} and CE (H_2)	3.80	ft
Unsaturated Trench Depth (Du)	2.13	ft
Saturated Trench Depth (Ds)	1.87	ft
Formula Used	Regular	
Volume Provided for Water Quality* (Vwq)	0.823	ac-ft
Additional Volume Provided (Vadd)	0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)	5.35E-05	cfs/ft^2-ft
Pavement Section Thickness	1.7	ft
Factor of Safety (FS)	2.0	
Proposed Exfiltration Trench		
Length of Trench for Water Quality (Lwq)	1,350.0	ft
Additional Length of Trench (Ladd)		ft
Control Elevation (CE)	1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a	ft-NAVD
Lowest Rim Elevation	4.80	ft-NAVD
Trench Width (W)	6.00	ft
Depth of Trench (D)	4.00	ft
Top of Trench Elevation	3.13	ft-NAVD
Bottom of Trench Elevation	-0.87	ft-NAVD
Distance from EL_{inv} and CE (H_2)	3.80	ft
Unsaturated Trench Depth (Du)	2.13	ft
Saturated Trench Depth (Ds)	1.87	ft
Formula Used	Regular	
Volume Provided for Water Quality* (Vwq)	0.246	ac-ft
Additional Volume Provided (Vadd)	0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)		5.35E-05	cfs/ft^2-ft
Pavement Section Thickness		1.7	ft
Factor of Safety (FS)		2.0	
Proposed Exfiltration Trench			
Length of Trench for Water Quality (Lwq)		1,550.0	ft
Additional Length of Trench (Ladd)			ft
Control Elevation (CE)		1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a		ft-NAVD
Lowest Rim Elevation		4.80	ft-NAVD
Trench Width (W)		6.00	ft
Depth of Trench (D)		4.00	ft
Top of Trench Elevation		3.13	ft-NAVD
Bottom of Trench Elevation		-0.87	ft-NAVD
Distance from EL_{inv} and CE (H_2)		3.80	ft
Unsaturated Trench Depth (Du)		2.13	ft
Saturated Trench Depth (Ds)		1.87	ft
Formula Used	Regular		
Volume Provided for Water Quality* (Vwq)		0.283	ac-ft
Additional Volume Provided (Vadd)		0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)		3.52E-05	cfs/ft^2-ft
Pavement Section Thickness		1.7	ft
Factor of Safety (FS)		2.0	
Proposed Exfiltration Trench			
Length of Trench for Water Quality (Lwq)		665.0	ft
Additional Length of Trench (Ladd)			ft
Control Elevation (CE)		1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a		ft-NAVD
Lowest Rim Elevation		5.90	ft-NAVD
Trench Width (W)		6.00	ft
Depth of Trench (D)		5.00	ft
Top of Trench Elevation		4.23	ft-NAVD
Bottom of Trench Elevation		-0.77	ft-NAVD
Distance from EL_{inv} and CE (H_2)		4.90	ft
Unsaturated Trench Depth (Du)		3.23	ft
Saturated Trench Depth (Ds)		1.77	ft
Formula Used	Regular		
Volume Provided for Water Quality* (Vwq)		0.141	ac-ft
Additional Volume Provided (Vadd)		0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)		3.31E-04	cfs/ft^2-ft
Pavement Section Thickness		1.7	ft
Factor of Safety (FS)		2.0	
Proposed Exfiltration Trench			
Length of Trench for Water Quality (Lwq)		710.0	ft
Additional Length of Trench (Ladd)			ft
Control Elevation (CE)		1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a		ft-NAVD
Lowest Rim Elevation		5.20	ft-NAVD
Trench Width (W)		6.00	ft
Depth of Trench (D)		5.00	ft
Top of Trench Elevation		3.53	ft-NAVD
Bottom of Trench Elevation		-1.47	ft-NAVD
Distance from EL_{inv} and CE (H_2)		4.20	ft
Unsaturated Trench Depth (Du)		2.53	ft
Saturated Trench Depth (Ds)		2.47	ft
Formula Used	Regular		
Volume Provided for Water Quality* (Vwq)		0.658	ac-ft
Additional Volume Provided (Vadd)		0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)		3.10E-04	cfs/ft^2-ft
Pavement Section Thickness		1.7	ft
Factor of Safety (FS)		2.0	
Proposed Exfiltration Trench			
Length of Trench for Water Quality (Lwq)		700.0	ft
Additional Length of Trench (Ladd)			ft
Control Elevation (CE)		1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a		ft-NAVD
Lowest Rim Elevation		5.80	ft-NAVD
Trench Width (W)		6.00	ft
Depth of Trench (D)		5.00	ft
Top of Trench Elevation		4.13	ft-NAVD
Bottom of Trench Elevation		-0.87	ft-NAVD
Distance from EL_{inv} and CE (H_2)		4.80	ft
Unsaturated Trench Depth (Du)		3.13	ft
Saturated Trench Depth (Ds)		1.87	ft
Formula Used	Regular		
Volume Provided for Water Quality* (Vwq)		0.682	ac-ft
Additional Volume Provided (Vadd)		0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)	1.03E-04	cfs/ft^2-ft
Pavement Section Thickness	1.7	ft
Factor of Safety (FS)	2.0	
Proposed Exfiltration Trench		
Length of Trench for Water Quality (Lwq)	451.0	ft
Additional Length of Trench (Ladd)		ft
Control Elevation (CE)	1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a	ft-NAVD
Lowest Rim Elevation	7.00	ft-NAVD
Trench Width (W)	6.00	ft
Depth of Trench (D)	6.00	ft
Top of Trench Elevation	5.33	ft-NAVD
Bottom of Trench Elevation	-0.67	ft-NAVD
Distance from EL_{inv} and CE (H_2)	6.00	ft
Unsaturated Trench Depth (Du)	4.33	ft
Saturated Trench Depth (Ds)	1.67	ft
Formula Used	Regular	
Volume Provided for Water Quality* (Vwq)	0.241	ac-ft
Additional Volume Provided (Vadd)	0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)	1.70E-04	cfs/ft^2-ft
Pavement Section Thickness	1.7	ft
Factor of Safety (FS)	2.0	
Proposed Exfiltration Trench		
Length of Trench for Water Quality (Lwq)	1,780.0	ft
Additional Length of Trench (Ladd)		ft
Control Elevation (CE)	1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a	ft-NAVD
Lowest Rim Elevation	8.20	ft-NAVD
Trench Width (W)	6.00	ft
Depth of Trench (D)	7.00	ft
Top of Trench Elevation	6.53	ft-NAVD
Bottom of Trench Elevation	-0.47	ft-NAVD
Distance from EL_{inv} and CE (H_2)	7.20	ft
Unsaturated Trench Depth (Du)	5.53	ft
Saturated Trench Depth (Ds)	1.47	ft
Formula Used	Regular	
Volume Provided for Water Quality* (Vwq)	1.772	ac-ft
Additional Volume Provided (Vadd)	0.000	ac-ft

**Does not include credit*

Basin #1

Exfiltration Trench Inputs

Hydraulic Conductivity (K)	1.70E-04	cfs/ft^2-ft
Pavement Section Thickness	1.7	ft
Factor of Safety (FS)	2.0	
Proposed Exfiltration Trench		
Length of Trench for Water Quality (Lwq)	2,075.0	ft
Additional Length of Trench (Ladd)		ft
Control Elevation (CE)	1.00	ft-NAVD
Lowest Weir/Bleeder Elevations (EL_{inv})	N/a	ft-NAVD
Lowest Rim Elevation	4.80	ft-NAVD
Trench Width (W)	6.00	ft
Depth of Trench (D)	4.00	ft
Top of Trench Elevation	3.13	ft-NAVD
Bottom of Trench Elevation	-0.87	ft-NAVD
Distance from EL_{inv} and CE (H_2)	3.80	ft
Unsaturated Trench Depth (Du)	2.13	ft
Saturated Trench Depth (Ds)	1.87	ft
Formula Used	Regular	
Volume Provided for Water Quality* (Vwq)	0.869	ac-ft
Additional Volume Provided (Vadd)	0.000	ac-ft

**Does not include credit*

Permit Delineated Basin Flood Durations (Hr)

Basin	Existing			Proposed			Future			*Proposed subtracted from Future* Reduction in Flood Time (Hr)		
	10 yr 24 hr	25 yr 72 hr	100 yr 72 hr	10 yr 24 hr	25 yr 72 hr	100 yr 72 hr	10 yr 24 hr	25 yr 72 hr	100 yr 72 hr	10 yr 24 hr	25 yr 72 hr	100 yr 72 hr
B-1	0	0	0	0	0	0	0	0	0	0	0	0
B-2	0	0	0	0	0	0	0	0	0	0	0	0
B-3	2.25	13.5	36	0	18.75	36	0	17.25	36	0	-1.5	0
B-4	0	0	0	0	0	0	0	0	0	0	0	0
B-5	0	0	27.75	0	0	28.75	0	0	27.25	0	0	-1.5
B-6	0	0	0	0	0	0	0	0	0	0	0	0
B-7	0	0	30.25	0	7	31.25	0	0	30.25	0	-7	-1
B-8	0	0	5	0	0	8.5	0	0	0	0	0	-8.5
B-9	4.25	14.75	36	0	18.5	35.75	0	17.25	35.5	0	-1.25	-0.25
B-10	0	0	5.5	0	0	8.75	0	0	1	0	0	-7.75
B-11	0	0	18	0	0	19.25	0	0	17.75	0	0	-1.5
B-12	0	9.5	36	0	16.25	36.25	0	14.75	35.5	0	-1.5	-0.75
B-13	0	0	0	0	0	0	0	0	0	0	0	0
B-14	0	0	0	0	0	0	0	0	0	0	0	0
B-15	0	0	5.75	0	0	8.75	0	0	1.5	0	0	-7.25
B-16	4.25	14.75	36	0	20	36.25	0	18.5	36.25	0	-1.5	0
B-17	10.75	21	36.5	7.75	25	36.25	6.25	23.75	36.25	-1.5	-1.25	0
B-18	6.75	17	36.25	4.25	21.75	36.25	1.25	20.5	36.25	-3	-1.25	0
B-19	12.5	36	36.5	12.5	36	36.5	12.5	36	36.5	0	0	0
B-20	0	29.25	35.75	0	29.25	35.75	0	26.25	35.5	0	-3	-0.25
B-21	0	0	0	0	0	0	0	0	0	0	0	0
B-22	0	0	0	0	0	0	0	0	0	0	0	0
B-23	20.25	62.25	69	20.25	62.25	69	20.25	62.25	69	0	0	0
B-24	16	37.25	40	16	37.25	40	16	37.25	40	0	0	0
B-25	15	36	36.75	15	36	36.75	0	36	36.25	-15	0	-0.5
B-26	16.25	40.25	47.75	16.25	40.25	47.75	16.25	39.5	44.5	0	-0.75	-3.25
B-27	17.75	53.25	62.25	17.75	53.25	62.25	17.75	53.25	62.25	0	0	0
B-28	17.5	51.75	61	17.5	51.75	61	17.5	51.75	61	0	0	0
B-29	16.5	48.25	58.25	16.5	48.25	58.25	15.5	36.5	40.75	-1	-11.75	-17.5
B-30	16.75	49.5	59.75	16.75	49.5	59.75	16.75	49.5	59.75	0	0	0
B-31	13.75	36	36.5	13.75	36	36.5	0	35.75	36.25	-13.75	-0.25	-0.25
B-32	0	20.75	36.25	0	20.75	36.25	0	20	36	0	-0.75	-0.25
B-33	16.25	40.25	47	16.25	40.25	47	16.25	40	46	0	-0.25	-1
B-34	0	21.5	36.25	0	21.5	36.25	0	20.75	36	0	-0.75	-0.25
B-35	17	41.25	46.75	17	41.25	46.75	15.75	36.25	38	-1.25	-5	-8.75
B-36	16	39.25	44.25	16	39.25	44.25	16	39.25	44.25	0	0	0
B-37	16	39.25	44.25	16	39.25	44.25	16	39.25	44	0	0	-0.25
B-38	0.75	2.5	5	0.75	2.5	5	0.75	2.5	5	0	0	0
B-39	0	0	0	0	0	0	0	0	0	0	0	0

Criteria	Basin	**Required Elevation (ft-NAVD)**	Existing Stage (ft-NAVD)	Proposed Stage (ft-NAVD)	Future Stage (ft-NAVD)
Staging of 10-year, 24-hour storm to be below Crown of Roadway	B-1	6.40	4.69	4.65	4.65
	B-2	6.50	4.69	4.65	4.64
	B-3	4.20	5.23	4.49	4.45
	B-4	5.50	5.28	5.28	5.21
	B-5	4.50	4.60	4.50	4.46
	B-6	7.00	4.60	4.50	4.46
	B-7	4.45	4.59	4.49	4.45
	B-8	6.00	5.22	4.49	4.45
	B-9	4.30	4.59	4.49	4.45
	B-10	5.30	4.87	4.49	4.45
	B-11	5.00	4.69	4.65	4.65
	B-12	5.00	4.69	4.65	4.65
	B-13	8.70	6.87	6.87	6.87
	B-14	7.10	4.71	4.54	4.49
	B-15	5.40	4.76	4.49	4.46
	B-16	4.20	4.59	4.50	4.46
	B-17	3.80	4.70	4.49	4.46
	B-18	5.10	4.60	4.51	4.47
	B-19	4.00	5.53	5.53	5.53
	B-20	5.20	4.35	4.35	4.35
	B-21	8.20	4.35	4.35	4.35
	B-22	6.80	6.71	6.71	6.64
	B-23	6.00	6.85	6.85	6.85
	B-24	5.20	6.71	6.71	6.64
	B-25	6.75	6.70	6.70	6.64
	B-26	5.60	6.71	6.71	6.64
	B-27	4.50	6.71	6.71	6.64
	B-28	4.50	6.71	6.71	6.64
	B-29	4.50	6.70	6.70	6.64
	B-30	5.00	6.71	6.71	6.64
	B-31	5.00	6.70	6.70	6.64
	B-32	7.60	6.71	6.71	6.65
	B-33	5.50	6.71	6.71	6.65
	B-34	8.20	6.71	6.71	6.65
	B-35	8.00	7.49	7.49	7.48
	B-36	7.50	8.01	8.01	8.01
	B-37	6.80	8.01	8.01	8.01
	B-38	8.11	8.01	8.01	8.01
	B-39	4.90	4.69	4.65	4.65

Criteria	Basin	**Required Elevation (ft-NAVD)**	Existing Stage (ft-NAVD)	Proposed Stage (ft-NAVD)	Future Stage (ft-NAVD)
Staging of 25-year, 72-hour storm, stages shall be improved upon	B-1	7.40	4.81	4.94	4.91
	B-2	7.50	4.81	4.94	4.91
	B-3	5.20	5.23	4.93	4.90
	B-4	6.50	5.31	5.31	5.21
	B-5	5.50	4.75	4.94	4.91
	B-6	8.00	4.75	4.95	4.92
	B-7	5.45	4.74	4.94	4.91
	B-8	7.00	5.22	4.94	4.90
	B-9	5.30	4.74	4.94	4.90
	B-10	6.30	4.87	4.94	4.91
	B-11	6.00	4.81	4.95	4.91
	B-12	6.00	4.81	4.95	4.91
	B-13	9.70	6.90	6.90	6.90
	B-14	8.10	5.18	5.09	5.13
	B-15	6.40	4.76	4.94	4.91
	B-16	5.20	4.74	4.94	4.91
	B-17	4.80	4.74	4.94	4.91
	B-18	6.10	4.75	4.95	4.92
	B-19	5.00	6.14	6.14	6.14
	B-20	6.20	5.70	5.70	5.65
	B-21	9.20	5.70	5.70	5.65
	B-22	7.80	7.14	7.14	7.13
	B-23	7.00	7.14	7.14	7.13
	B-24	6.20	7.15	7.15	7.13
	B-25	7.75	7.14	7.14	7.13
	B-26	6.60	7.15	7.15	7.13
	B-27	5.50	7.15	7.15	7.14
	B-28	5.50	7.15	7.15	7.14
	B-29	5.50	7.15	7.15	7.14
	B-30	6.00	7.15	7.15	7.13
	B-31	6.00	7.15	7.15	7.14
	B-32	8.60	7.15	7.15	7.14
	B-33	6.50	7.15	7.15	7.13
	B-34	9.20	7.15	7.15	7.14
	B-35	9.00	7.65	7.65	7.65
	B-36	8.50	8.11	8.11	8.11
	B-37	7.80	8.12	8.12	8.12
	B-38	9.11	8.12	8.12	8.12
	B-39	5.90	4.81	4.94	4.91

Criteria	Basin	**Required Elevation (ft-NAVD)**	Existing Stage (ft-NAVD)	Proposed Stage (ft-NAVD)	Future Stage (ft-NAVD)
Staging of 100-year, 72-hour storm to be below FFE and/or improved	B-1	7.40	5.52	5.54	5.53
	B-2	7.50	5.52	5.54	5.53
	B-3	5.20	5.52	5.54	5.52
	B-4	6.50	5.52	5.54	5.53
	B-5	5.50	5.52	5.54	5.53
	B-6	8.00	5.53	5.55	5.53
	B-7	5.45	5.52	5.54	5.53
	B-8	7.00	5.52	5.54	5.52
	B-9	5.30	5.52	5.54	5.52
	B-10	6.30	5.52	5.54	5.53
	B-11	6.00	5.52	5.54	5.53
	B-12	6.00	5.52	5.54	5.53
	B-13	9.70	6.92	6.92	6.92
	B-14	8.10	6.13	6.05	5.71
	B-15	6.40	5.52	5.54	5.53
	B-16	5.20	5.52	5.54	5.53
	B-17	4.80	5.52	5.54	5.53
	B-18	6.10	5.53	5.55	5.54
	B-19	5.00	6.72	6.72	6.72
	B-20	6.20	6.91	6.91	6.88
	B-21	9.20	6.91	6.91	6.88
	B-22	7.80	7.37	7.37	7.36
	B-23	7.00	7.36	7.36	7.35
	B-24	6.20	7.37	7.37	7.36
	B-25	7.75	7.37	7.37	7.36
	B-26	6.60	7.38	7.38	7.36
	B-27	5.50	7.38	7.38	7.37
	B-28	5.50	7.38	7.38	7.37
	B-29	5.50	7.39	7.39	7.37
	B-30	6.00	7.38	7.38	7.37
	B-31	6.00	7.38	7.38	7.37
	B-32	8.60	7.38	7.38	7.37
	B-33	6.50	7.37	7.37	7.36
	B-34	9.20	7.39	7.39	7.37
	B-35	9.00	7.78	7.78	7.78
	B-36	8.50	8.17	8.17	8.17
	B-37	7.80	8.17	8.17	8.17
	B-38	9.11	8.18	8.18	8.18
	B-39	5.90	5.52	5.54	5.53

APPENDIX C – POLLUTANT REDUCTION SUMMARIES

Summary Treatment Report Version: 4.3.5

Project: Infinity Azure
Drainage Improvements

Analysis Type: Net Improvement

Date:5/9/2024

BMP Types:

Catchment 1 - (Basin 1)
Exfiltration Trench
Based on % removal values to the nearest percent

Routing Summary
Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**
Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge		
Total N pre load	51.05 kg/yr	
Total N post load	51.05 kg/yr	
Target N load reduction	%	
Target N discharge load	51.05 kg/yr	
Percent N load reduction	95 %	
Provided N discharge load	2.65 kg/yr	5.85 lb/yr
Provided N load removed	48.4 kg/yr	106.72 lb/yr

Phosphorus

Surface Water Discharge		
Total P pre load	11.443 kg/yr	
Total P post load	11.443 kg/yr	
Target P load reduction	%	
Target P discharge load	11.443 kg/yr	
Percent P load reduction	95 %	
Provided P discharge load	.595 kg/yr	1.31 lb/yr
Provided P load removed	10.848 kg/yr	23.92 lb/yr

Summary Treatment Report Version: 4.3.5

Project: Park Road North Part 1

Analysis Type: Net Improvement

Date:5/9/2024

BMP Types:

Catchment 1 - (Basin 1)

Multiple BMP

Based on % removal values to the nearest percent

Routing Summary

Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**

Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge

Total N pre load	28.43 kg/yr	
Total N post load	28.43 kg/yr	
Target N load reduction	%	
Target N discharge load	28.43 kg/yr	
Percent N load reduction	95 %	
Provided N discharge load	1.48 kg/yr	3.26 lb/yr
Provided N load removed	26.95 kg/yr	59.43 lb/yr

Phosphorus

Surface Water Discharge

Total P pre load	6.16 kg/yr	
Total P post load	6.16 kg/yr	
Target P load reduction	%	
Target P discharge load	6.16 kg/yr	
Percent P load reduction	95 %	
Provided P discharge load	.32 kg/yr	.71 lb/yr
Provided P load removed	5.839 kg/yr	12.876 lb/yr

Summary Treatment Report Version: 4.3.5

Project: Park Road North Part 2

Analysis Type: Net Improvement

Date:5/9/2024

BMP Types:

Catchment 1 - (Basin 1)

Exfiltration Trench

Based on % removal values to the nearest percent

Routing Summary

Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**

Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge

Total N pre load	23.76 kg/yr	
Total N post load	23.76 kg/yr	
Target N load reduction	%	
Target N discharge load	23.76 kg/yr	
Percent N load reduction	95 %	
Provided N discharge load	1.24 kg/yr	2.72 lb/yr
Provided N load removed	22.53 kg/yr	49.67 lb/yr

Phosphorus

Surface Water Discharge

Total P pre load	3.9 kg/yr	
Total P post load	3.9 kg/yr	
Target P load reduction	%	
Target P discharge load	3.9 kg/yr	
Percent P load reduction	95 %	
Provided P discharge load	.203 kg/yr	.45 lb/yr
Provided P load removed	3.698 kg/yr	8.153 lb/yr

Summary Treatment Report Version: 4.3.5

Project: Park Road - South

Analysis Type: Net Improvement

Date:5/9/2024

BMP Types:

Catchment 1 - (Basin 1)
Exfiltration Trench
Based on % removal values to the nearest percent

Routing Summary
Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**
Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge

Total N pre load	10.88 kg/yr	
Total N post load	10.88 kg/yr	
Target N load reduction	%	
Target N discharge load	10.88 kg/yr	
Percent N load reduction	95 %	
Provided N discharge load	.57 kg/yr	1.25 lb/yr
Provided N load removed	10.32 kg/yr	22.75 lb/yr

Phosphorus

Surface Water Discharge

Total P pre load	1.811 kg/yr	
Total P post load	1.811 kg/yr	
Target P load reduction	%	
Target P discharge load	1.811 kg/yr	
Percent P load reduction	95 %	
Provided P discharge load	.094 kg/yr	.21 lb/yr
Provided P load removed	1.716 kg/yr	3.785 lb/yr

Summary Treatment Report Version: 4.3.5

Project: SW 31st Ave North

Analysis Type: Net Improvement

Date:5/10/2024

BMP Types:

Catchment 1 - (Basin 1)
Exfiltration Trench
Based on % removal values to the nearest percent

Routing Summary
Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**
Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge

Total N pre load	5.08 kg/yr	
Total N post load	5.08 kg/yr	
Target N load reduction	%	
Target N discharge load	5.08 kg/yr	
Percent N load reduction	95 %	
Provided N discharge load	.26 kg/yr	.58 lb/yr
Provided N load removed	4.82 kg/yr	10.63 lb/yr

Phosphorus

Surface Water Discharge

Total P pre load	1.102 kg/yr	
Total P post load	1.102 kg/yr	
Target P load reduction	%	
Target P discharge load	1.102 kg/yr	
Percent P load reduction	95 %	
Provided P discharge load	.057 kg/yr	.13 lb/yr
Provided P load removed	1.044 kg/yr	2.303 lb/yr

Summary Treatment Report Version: 4.3.5

Project: SW 31st Ave South Drainage Improvements

Analysis Type: Net Improvement

Date:5/10/2024

BMP Types:

Catchment 1 - (Basin 1)
Exfiltration Trench
Based on % removal values to the nearest percent

Routing Summary
Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**
Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge		
Total N pre load	5.89 kg/yr	
Total N post load	5.89 kg/yr	
Target N load reduction	%	
Target N discharge load	5.89 kg/yr	
Percent N load reduction	95 %	
Provided N discharge load	.31 kg/yr	.68 lb/yr
Provided N load removed	5.59 kg/yr	12.32 lb/yr

Phosphorus

Surface Water Discharge		
Total P pre load	1.277 kg/yr	
Total P post load	1.277 kg/yr	
Target P load reduction	%	
Target P discharge load	1.277 kg/yr	
Percent P load reduction	95 %	
Provided P discharge load	.066 kg/yr	.15 lb/yr
Provided P load removed	1.211 kg/yr	2.669 lb/yr

Summary Treatment Report Version: 4.3.5

Project: SW 36th Ct Drainage Improvements

Analysis Type: Net Improvement

Date:5/9/2024

BMP Types:

Catchment 1 - (Basin 1)

Multiple BMP

Based on % removal values to the nearest percent

Routing Summary

Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**

Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge

Total N pre load	9.03 kg/yr	
Total N post load	9.03 kg/yr	
Target N load reduction	%	
Target N discharge load	9.03 kg/yr	
Percent N load reduction	97 %	
Provided N discharge load	.26 kg/yr	.58 lb/yr
Provided N load removed	8.77 kg/yr	19.33 lb/yr

Phosphorus

Surface Water Discharge

Total P pre load	1.426 kg/yr	
Total P post load	1.426 kg/yr	
Target P load reduction	%	
Target P discharge load	1.426 kg/yr	
Percent P load reduction	97 %	
Provided P discharge load	.041 kg/yr	.09 lb/yr
Provided P load removed	1.385 kg/yr	3.053 lb/yr

Summary Treatment Report Version: 4.3.5

Project: SW 52nd Ave
Drainage Improvements

Analysis Type: Net Improvement

Date:5/10/2024

BMP Types:

Catchment 1 - (Basin 1)
Multiple BMP
Based on % removal values to the nearest percent

Routing Summary
Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**
Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge		
Total N pre load	67.7 kg/yr	
Total N post load	67.7 kg/yr	
Target N load reduction	%	
Target N discharge load	67.7 kg/yr	
Percent N load reduction	95 %	
Provided N discharge load	3.52 kg/yr	7.76 lb/yr
Provided N load removed	64.18 kg/yr	141.51 lb/yr

Phosphorus

Surface Water Discharge		
Total P pre load	15.174 kg/yr	
Total P post load	15.174 kg/yr	
Target P load reduction	%	
Target P discharge load	15.174 kg/yr	
Percent P load reduction	95 %	
Provided P discharge load	.789 kg/yr	1.74 lb/yr
Provided P load removed	14.385 kg/yr	31.719 lb/yr

Summary Treatment Report Version: 4.3.5

Project: SW 55th Ave Homes

Analysis Type: Net Improvement

Date:5/9/2024

BMP Types:

Catchment 1 - (Basin 1) Exfiltration Trench

Based on % removal values to the nearest percent

Routing Summary
Catchment 1 Routed to Outlet

Total nitrogen target removal met? **Yes**
Total phosphorus target removal met? **Yes**

Summary Report

Nitrogen

Surface Water Discharge

Total N pre load	62.86 kg/yr	
Total N post load	62.86 kg/yr	
Target N load reduction	%	
Target N discharge load	62.86 kg/yr	
Percent N load reduction	97 %	
Provided N discharge load	2.01 kg/yr	4.44 lb/yr
Provided N load removed	60.85 kg/yr	134.17 lb/yr

Phosphorus

Surface Water Discharge

Total P pre load	14.09 kg/yr	
Total P post load	14.09 kg/yr	
Target P load reduction	%	
Target P discharge load	14.09 kg/yr	
Percent P load reduction	97 %	
Provided P discharge load	.451 kg/yr	.99 lb/yr
Provided P load removed	13.639 kg/yr	30.073 lb/yr

APPENDIX D – HYDROLOGIC AND HYDRAULIC MODEL INPUTS

Manual Basin: B-1

Scenario: Existing
Node: B-1
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 21.6480 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
21.6371	Commerce	Commerce	Soil/Rain		
0.0110	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-10

Scenario: Existing
Node: B-10
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 89.6946 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
89.6896	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		
0.0050	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-11

Scenario: Existing
Node: B-11
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr

Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 61.0257 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
35.1888	Commerce	Commerce	Soil/Rain		
0.0099	Lake	Water	Soil/Rain		
25.8270	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-12

Scenario: Existing
Node: B-12
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 34.5199 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
34.5199	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-13

Scenario: Existing
Node: B-13
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.5566 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.5547	Commerce	Commerce	Soil/Rain		
0.0019	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-14

Scenario: Existing
Node: B-14
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 12.0794 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
10.6704	Commerce	Commerce	Soil/Rain		
0.0000	Medium High 25 Residential	Medium High 25 Residential	Soil/Rain		
1.4089	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-15

Scenario: Existing
Node: B-15
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 12.6139 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
12.6139	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-16

Scenario: Existing
Node: B-16
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr

Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 15.3168 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
12.9581	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
2.3587	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-17

Scenario: Existing
Node: B-17
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 13.1502 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
13.1502	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-18

Scenario: Existing
Node: B-18
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 40.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.7465 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
11.7465	Commerce	Commerce	Soil/Rain		
0.0000	Transportation	Transportation	Soil/Rain		

Comment:

Manual Basin: B-19

Scenario: Existing
Node: B-19
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 13.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 46.5822 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
45.1046	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
1.4776	Lake	Water	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-2

Scenario: Existing
Node: B-2
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 50.6084 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
50.6084	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-20

Scenario: Existing
Node: B-20

Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 191.3347 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0659	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
109.4423	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
81.8265	Lake	Water	Soil/Rain		
0.0000	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-21

Scenario: Existing
Node: B-21
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 13.1258 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0385	Transportation	Transportation	Soil/Rain		
13.0769	Transportation	Transportation	Soil/Rain		
0.0028	Commerce	Commerce	Soil/Rain		
0.0076	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-22

Scenario: Existing
Node: B-22
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number

Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 26.5697 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
18.7046	Transportation	Transportation	Soil/Rain		
3.5591	Commerce	Commerce	Soil/Rain		
4.3060	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-23

Scenario: Existing
Node: B-23
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.0465 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.4151	Commerce	Commerce	Soil/Rain		
10.5225	Commerce	Commerce	Soil/Rain		
0.1090	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-24

Scenario: Existing
Node: B-24
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 45.9632 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient	Reference ET

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
45.9160	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
0.0472	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
0.0000	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-25

Scenario: Existing
Node: B-25
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.0323 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.0309	Commerce	Commerce	Soil/Rain		
0.0014	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-26

Scenario: Existing
Node: B-26
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 36.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 9.7984 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
9.7981	Commerce	Commerce	Soil/Rain		
0.0003	Community	Community	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-27

Scenario: Existing
Node: B-27
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.7532 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.7532	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-28

Scenario: Existing
Node: B-28
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.8768 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.8768	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-29

Scenario: Existing
Node: B-29
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.9252 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.9252	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-3

Scenario: Existing
Node: B-3
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 57.8959 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
27.0678	Commerce	Commerce	Soil/Rain		
30.2166	Lake	Water	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.6115	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-30

Scenario: Existing
Node: B-30
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs

Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.0533 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
7.0533	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-31

Scenario: Existing
Node: B-31
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.5073 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
8.7757	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
2.6309	Lake	Water	Soil/Rain		
0.1007	Commerce	Commerce	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-32

Scenario: Existing
Node: B-32
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 60.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 24.6536 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient	Reference ET

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
14.5636	Commerce	Commerce	Soil/Rain		
0.0331	Community	Community	Soil/Rain		
10.0569	Recreation and Open Space	Recreation and Open Space	Soil/Rain		
0.0000	Community	Community	Soil/Rain		
0.0000	Recreation and Open Space	Recreation and Open Space	Soil/Rain		

Comment:

Manual Basin: B-33

Scenario: Existing
Node: B-33
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 6.4716 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
6.4143	Commerce	Commerce	Soil/Rain		
0.0039	Commerce	Commerce	Soil/Rain		
0.0534	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-34

Scenario: Existing
Node: B-34
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.4320 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
7.3778	Commerce	Commerce	Soil/Rain		

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0542	Community	Community	Soil/Rain		

Comment:

Manual Basin: B-35

Scenario: Existing
Node: B-35
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 18.7257 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
18.6051	Community	Community	Soil/Rain		
0.0468	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0738	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-36

Scenario: Existing
Node: B-36
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 49.5271 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
49.5127	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0143	Community	Community	Soil/Rain		

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-37

Scenario: Existing
Node: B-37
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 8.1651 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
8.1650	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0001	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-38

Scenario: Existing
Node: B-38
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 31.1526 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0051	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
31.1475	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-39

Scenario: Existing
Node: B-39
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.2268 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
6.9159	Transportation	Transportation	Soil/Rain		
0.3110	Transportation	Transportation	Soil/Rain		

Comment:

Manual Basin: B-4

Scenario: Existing
Node: B-4
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 35.5623 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
35.5623	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-40

Scenario: Existing
Node: B-40
Hydrograph Method: NRCS Unit Hydrograph

Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 19.4365 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.1153	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
19.3212	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-5

Scenario: Existing
Node: B-5
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 21.7738 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
21.7738	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-6

Scenario: Existing
Node: B-6
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 60.2765 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient	Reference ET

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
60.2046	Transportation	Transportation	Soil/Rain		
0.0718	Transportation	Transportation	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-7

Scenario: Existing
Node: B-7
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 42.5912 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
37.2826	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
5.3086	Lake	Water	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-8

Scenario: Existing
Node: B-8
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.6433 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.6433	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-9

Scenario: Existing
Node: B-9
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.9658 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.9658	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-1

Scenario: Future
Node: B-1
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 21.6480 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
21.6371	Commerce	Commerce	Soil/Rain		
0.0110	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-10

Scenario: Future
Node: B-10
Hydrograph Method: NRCS Unit Hydrograph

Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 89.6946 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
89.6896	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		
0.0050	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-11

Scenario: Future
Node: B-11
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 61.0257 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
35.1888	Commerce	Commerce	Soil/Rain		
0.0099	Lake	Water	Soil/Rain		
25.8270	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-12

Scenario: Future
Node: B-12
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 34.5199 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
34.5199	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-13

Scenario: Future
Node: B-13
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.5566 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.5547	Commerce	Commerce	Soil/Rain		
0.0019	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-14

Scenario: Future
Node: B-14
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 12.0794 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
10.6704	Commerce	Commerce	Soil/Rain		
0.0000	Medium High 25 Residential	Medium High 25 Residential	Soil/Rain		
1.4089	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-15

Scenario: Future
Node: B-15
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 12.6139 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
12.6139	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-16

Scenario: Future
Node: B-16
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 15.3168 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
12.9581	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
2.3587	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-17

Scenario: Future
Node: B-17
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256

Peaking Factor: 256.0
Area: 13.1502 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
13.1502	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-18

Scenario: Future
Node: B-18
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 40.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.7465 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
11.7465	Commerce	Commerce	Soil/Rain		
0.0000	Transportation	Transportation	Soil/Rain		

Comment:

Manual Basin: B-19

Scenario: Future
Node: B-19
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 13.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 46.5822 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
45.1046	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
1.4776	Lake	Water	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-2

Scenario: Future
Node: B-2
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 50.6084 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
50.6084	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-20

Scenario: Future
Node: B-20
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 191.3347 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0659	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
109.4423	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
81.8265	Lake	Water	Soil/Rain		
0.0000	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-21

Scenario: Future
Node: B-21
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 13.1258 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0385	Transportation	Transportation	Soil/Rain		
13.0769	Transportation	Transportation	Soil/Rain		
0.0028	Commerce	Commerce	Soil/Rain		
0.0076	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-22

Scenario: Future
Node: B-22
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 26.5697 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
18.7046	Transportation	Transportation	Soil/Rain		
3.5591	Commerce	Commerce	Soil/Rain		
4.3060	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-23

Scenario: Future
Node: B-23
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min

Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.0465 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.4151	Commerce	Commerce	Soil/Rain		
10.5225	Commerce	Commerce	Soil/Rain		
0.1090	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-24

Scenario: Future
Node: B-24
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 45.9632 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
45.9160	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
0.0472	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
0.0000	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-25

Scenario: Future
Node: B-25
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0

Area: 4.0323 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.0309	Commerce	Commerce	Soil/Rain		
0.0014	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-26

Scenario: Future
Node: B-26
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 36.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 9.7984 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
9.7981	Commerce	Commerce	Soil/Rain		
0.0003	Community	Community	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-27

Scenario: Future
Node: B-27
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.7532 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.7532	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-28

Scenario: Future
Node: B-28
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.8768 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.8768	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-29

Scenario: Future
Node: B-29
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.9252 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.9252	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-3

Scenario: Future
Node: B-3
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs

Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 57.8959 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
27.0678	Commerce	Commerce	Soil/Rain		
30.2166	Lake	Water	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.6115	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-30

Scenario: Future
Node: B-30
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.0533 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
7.0533	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-31

Scenario: Future
Node: B-31
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.5073 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
8.7757	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
2.6309	Lake	Water	Soil/Rain		
0.1007	Commerce	Commerce	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-32

Scenario: Future
Node: B-32
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 60.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 24.6536 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
14.5636	Commerce	Commerce	Soil/Rain		
0.0331	Community	Community	Soil/Rain		
10.0569	Recreation and Open Space	Recreation and Open Space	Soil/Rain		
0.0000	Community	Community	Soil/Rain		
0.0000	Recreation and Open Space	Recreation and Open Space	Soil/Rain		

Comment:

Manual Basin: B-33

Scenario: Future
Node: B-33
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 6.4716 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
6.4143	Commerce	Commerce	Soil/Rain		
0.0039	Commerce	Commerce	Soil/Rain		
0.0534	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-34

Scenario: Future
Node: B-34
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.4320 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
7.3778	Commerce	Commerce	Soil/Rain		
0.0542	Community	Community	Soil/Rain		

Comment:

Manual Basin: B-35

Scenario: Future
Node: B-35
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 18.7257 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
18.6051	Community	Community	Soil/Rain		
0.0468	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0738	Medium 16	Medium 16	Soil/Rain		

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
	Residential	Residential			

Comment:

Manual Basin: B-36

Scenario: Future
Node: B-36
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 49.5271 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
49.5127	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0143	Community	Community	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-37

Scenario: Future
Node: B-37
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 8.1651 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
8.1650	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0001	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-38

Scenario: Future
Node: B-38
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 31.1526 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0051	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
31.1475	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-39

Scenario: Future
Node: B-39
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.2268 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
6.9159	Transportation	Transportation	Soil/Rain		
0.3110	Transportation	Transportation	Soil/Rain		

Comment:

Manual Basin: B-4

Scenario: Future

Node: B-4
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 35.5623 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
35.5623	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-40

Scenario: Future
Node: B-40
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 19.4365 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.1153	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
19.3212	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-5

Scenario: Future
Node: B-5
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256

Peaking Factor: 256.0
Area: 21.7738 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
21.7738	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-6

Scenario: Future
Node: B-6
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 60.2765 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
60.2046	Transportation	Transportation	Soil/Rain		
0.0718	Transportation	Transportation	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-7

Scenario: Future
Node: B-7
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 42.5912 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
37.2826	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
5.3086	Lake	Water	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-8

Scenario: Future
Node: B-8
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.6433 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.6433	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-9

Scenario: Future
Node: B-9
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.9658 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.9658	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-1

Scenario: Proposed
Node: B-1

Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 21.6480 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
21.6371	Commerce	Commerce	Soil/Rain		
0.0110	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-10

Scenario: Proposed
Node: B-10
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 89.6946 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
89.6896	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		
0.0050	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-11

Scenario: Proposed
Node: B-11
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 61.0257 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
35.1888	Commerce	Commerce	Soil/Rain		
0.0099	Lake	Water	Soil/Rain		
25.8270	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-12

Scenario: Proposed
Node: B-12
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 34.5199 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
34.5199	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-13

Scenario: Proposed
Node: B-13
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.5566 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.5547	Commerce	Commerce	Soil/Rain		
0.0019	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-14

Scenario: Proposed
Node: B-14
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 12.0794 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
10.6704	Commerce	Commerce	Soil/Rain		
0.0000	Medium High 25 Residential	Medium High 25 Residential	Soil/Rain		
1.4089	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-15

Scenario: Proposed
Node: B-15
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 12.6139 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
12.6139	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-16

Scenario: Proposed
Node: B-16
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr

Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 15.3168 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
12.9581	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
2.3587	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-17

Scenario: Proposed
Node: B-17
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 13.1502 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
13.1502	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-18

Scenario: Proposed
Node: B-18
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 40.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.7465 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
11.7465	Commerce	Commerce	Soil/Rain		
0.0000	Transportation	Transportation	Soil/Rain		

Comment:

Manual Basin: B-19

Scenario: Proposed
Node: B-19
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 13.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 46.5822 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
45.1046	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
1.4776	Lake	Water	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-2

Scenario: Proposed
Node: B-2
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 50.6084 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
50.6084	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-20

Scenario: Proposed
Node: B-20

Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 191.3347 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0659	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
109.4423	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
81.8265	Lake	Water	Soil/Rain		
0.0000	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-21

Scenario: Proposed
Node: B-21
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 13.1258 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0385	Transportation	Transportation	Soil/Rain		
13.0769	Transportation	Transportation	Soil/Rain		
0.0028	Commerce	Commerce	Soil/Rain		
0.0076	Lake	Water	Soil/Rain		

Comment:

Manual Basin: B-22

Scenario: Proposed
Node: B-22
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number

Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 26.5697 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
18.7046	Transportation	Transportation	Soil/Rain		
3.5591	Commerce	Commerce	Soil/Rain		
4.3060	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-23

Scenario: Proposed
Node: B-23
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.0465 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.4151	Commerce	Commerce	Soil/Rain		
10.5225	Commerce	Commerce	Soil/Rain		
0.1090	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-24

Scenario: Proposed
Node: B-24
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 45.9632 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient	Reference ET

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
45.9160	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
0.0472	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
0.0000	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-25

Scenario: Proposed
Node: B-25
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.0323 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.0309	Commerce	Commerce	Soil/Rain		
0.0014	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-26

Scenario: Proposed
Node: B-26
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 36.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 9.7984 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
9.7981	Commerce	Commerce	Soil/Rain		
0.0003	Community	Community	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-27

Scenario: Proposed
Node: B-27
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.7532 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.7532	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-28

Scenario: Proposed
Node: B-28
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.8768 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.8768	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-29

Scenario: Proposed
Node: B-29
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.9252 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.9252	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-3

Scenario: Proposed
Node: B-3
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 57.8959 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
27.0678	Commerce	Commerce	Soil/Rain		
30.2166	Lake	Water	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.6115	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-30

Scenario: Proposed
Node: B-30
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs

Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.0533 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
7.0533	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-31

Scenario: Proposed
Node: B-31
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 11.5073 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
8.7757	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
2.6309	Lake	Water	Soil/Rain		
0.1007	Commerce	Commerce	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-32

Scenario: Proposed
Node: B-32
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 60.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 24.6536 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient	Reference ET

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
14.5636	Commerce	Commerce	Soil/Rain		
0.0331	Community	Community	Soil/Rain		
10.0569	Recreation and Open Space	Recreation and Open Space	Soil/Rain		
0.0000	Community	Community	Soil/Rain		
0.0000	Recreation and Open Space	Recreation and Open Space	Soil/Rain		

Comment:

Manual Basin: B-33

Scenario: Proposed
Node: B-33
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 6.4716 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
6.4143	Commerce	Commerce	Soil/Rain		
0.0039	Commerce	Commerce	Soil/Rain		
0.0534	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-34

Scenario: Proposed
Node: B-34
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.4320 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
7.3778	Commerce	Commerce	Soil/Rain		

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0542	Community	Community	Soil/Rain		

Comment:

Manual Basin: B-35

Scenario: Proposed
Node: B-35
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 18.7257 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
18.6051	Community	Community	Soil/Rain		
0.0468	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0738	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-36

Scenario: Proposed
Node: B-36
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 49.5271 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
49.5127	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0143	Community	Community	Soil/Rain		

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-37

Scenario: Proposed
Node: B-37
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 8.1651 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
8.1650	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
0.0001	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-38

Scenario: Proposed
Node: B-38
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 31.1526 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.0051	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
31.1475	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-39

Scenario: Proposed
Node: B-39
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 7.2268 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
6.9159	Transportation	Transportation	Soil/Rain		
0.3110	Transportation	Transportation	Soil/Rain		

Comment:

Manual Basin: B-4

Scenario: Proposed
Node: B-4
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 35.5623 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
35.5623	Commerce	Commerce	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-40

Scenario: Proposed
Node: B-40
Hydrograph Method: NRCS Unit Hydrograph

Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 19.4365 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
0.1153	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		
19.3212	Low Medium 10 Residential	Low Medium 10 Residential	Soil/Rain		

Comment:

Manual Basin: B-5

Scenario: Proposed
Node: B-5
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 21.7738 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
21.7738	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-6

Scenario: Proposed
Node: B-6
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 60.2765 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient	Reference ET

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
60.2046	Transportation	Transportation	Soil/Rain		
0.0718	Transportation	Transportation	Soil/Rain		
0.0000	Commerce	Commerce	Soil/Rain		

Comment:

Manual Basin: B-7

Scenario: Proposed
Node: B-7
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 42.5912 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
37.2826	Medium 16 Residential	Medium 16 Residential	Soil/Rain		
5.3086	Lake	Water	Soil/Rain		
0.0000	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-8

Scenario: Proposed
Node: B-8
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 4.6433 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
4.6433	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Manual Basin: B-9

Scenario: Proposed
Node: B-9
Hydrograph Method: NRCS Unit Hydrograph
Infiltration Method: Curve Number
Time of Concentration: 10.0000 min
Max Allowable Q: 0.00 cfs
Time Shift: 0.0000 hr
Unit Hydrograph: UH256
Peaking Factor: 256.0
Area: 1.9658 ac

Area [ac]	Land Cover Zone	Soil Zone	Rainfall Name	Crop Coefficient Zone	Reference ET Station
1.9658	Medium 16 Residential	Medium 16 Residential	Soil/Rain		

Comment:

Node: B-1

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.60 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.60	0.0006	25
3.70	0.0024	104
3.80	0.0031	137
3.90	0.0042	183
4.00	0.0058	254
4.10	0.0075	325
4.20	0.0115	500
4.30	0.0172	750
4.40	0.0316	1375
4.50	0.0545	2375
4.60	0.1354	5899
4.70	0.3018	13148
4.80	0.4883	21272
4.90	0.7213	31421
5.00	0.9899	43119
5.10	1.2516	54518
5.20	1.5149	65991

Stage [ft]	Area [ac]	Area [ft2]
5.30	1.8042	78590
5.40	2.0871	90913
5.50	2.3987	104486
5.60	2.7533	119934
5.70	3.1527	137332
5.80	3.6445	158754
5.90	4.0726	177401
6.00	4.4542	194024
6.10	4.8387	210772
6.20	5.2306	227845
6.30	5.6145	244567
6.40	6.1080	266064
6.50	6.6537	289836
6.60	7.2936	317708
6.70	8.0069	348778
6.80	8.7649	381799
6.90	9.5631	416569
7.00	10.3171	449415
7.10	11.1240	484560
7.20	11.9618	521055
7.30	12.7353	554751
7.40	13.5094	588471
7.50	14.1877	618017
7.60	14.7673	643264
7.70	15.2947	666236
7.80	15.8226	689233
7.90	16.3861	713780
8.00	16.9628	738901
8.10	17.5223	763273
8.20	18.0818	787645
8.30	18.6580	812741
8.40	19.2341	837838
8.50	19.7890	862010
8.60	20.3325	885682
8.70	20.7846	905379
8.80	21.1571	921602
8.90	21.3705	930901
9.00	21.5157	937225
9.10	21.5978	940801
9.20	21.5978	940801

Comment:

Node: B-10

Scenario: Existing
Type: Stage/Area

Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.33	0.0184	800
-1.30	0.0196	852
-1.20	0.0203	883
-1.10	0.0224	975
-1.00	0.0230	1000
-0.90	0.0249	1083
-0.80	0.0266	1158
-0.70	0.0277	1207
-0.60	0.0285	1244
-0.50	0.0302	1315
-0.40	0.0311	1355
-0.30	0.0326	1420
-0.20	0.0359	1565
-0.10	0.0413	1800
0.00	0.0494	2150
0.09	0.0545	2375
0.20	0.0625	2725
0.30	0.0660	2875
0.40	0.0708	3083
0.50	0.0729	3175
0.60	0.0760	3312
0.70	0.0792	3450
0.80	0.0834	3633
0.90	0.0867	3775
0.99	0.0895	3899
1.09	0.0941	4099
1.20	0.1012	4408
1.30	0.1062	4624
1.40	0.1106	4816
1.50	0.1159	5049
1.60	0.1217	5299
1.70	0.1261	5493
1.80	0.1314	5724
1.90	0.1343	5849
2.00	0.1400	6099
2.10	0.1458	6349
2.20	0.1538	6699
2.30	0.1618	7049
2.40	0.1681	7324
2.50	0.1762	7674
2.60	0.1854	8074
2.70	0.1917	8349
2.80	0.2014	8774
2.90	0.2129	9274
3.00	0.2196	9565

Stage [ft]	Area [ac]	Area [ft2]
3.10	0.2304	10036
3.20	0.2381	10374
3.30	0.2479	10799
3.40	0.2663	11598
3.50	0.2863	12473
3.60	0.3162	13773
3.70	0.3483	15173
3.80	0.3954	17223
3.90	0.4470	19472
4.00	0.5050	21997
4.10	0.5779	25172
4.20	0.7282	31721
4.30	0.9486	41319
4.40	1.2716	55393
4.50	1.6590	72265
4.59	2.0549	89513
4.69	2.5243	109960
4.79	3.0511	132907
4.89	3.6772	160179
4.99	4.4163	192374
5.09	5.2897	230419
5.19	6.4810	282312
5.29	8.2025	357302
5.39	10.4847	456714
5.49	13.2650	577823
5.59	16.6685	726078
5.69	20.1775	878933
5.79	23.9161	1041786
5.89	27.6937	1206339
5.99	31.1075	1355044
6.09	33.9590	1479252
6.19	36.3571	1583714
6.29	38.2680	1666952
6.39	39.9046	1738243
6.49	41.5337	1809208
6.59	43.1399	1879174
6.69	44.8040	1951664
6.79	46.2932	2016531
6.89	47.7347	2079322
6.99	49.1067	2139089
7.09	50.4145	2196057
7.19	51.7722	2255199
7.29	53.1483	2315141
7.39	54.5313	2375383
7.49	55.9372	2436625
7.59	57.3443	2497916
7.69	58.8093	2561733
7.79	60.2996	2626649
7.89	61.8369	2693615

Stage [ft]	Area [ac]	Area [ft2]
7.99	63.3283	2758582
8.09	64.9689	2830047
8.19	66.5579	2899263
8.29	68.0063	2962354
8.39	69.3657	3021572
8.49	70.6494	3077489
8.59	71.7633	3126008
8.69	72.7376	3168452
8.79	73.6638	3208797
8.89	74.5108	3245692
8.99	75.3630	3282812
9.09	76.1153	3315582
9.19	76.8624	3348128
9.29	77.6216	3381199
9.39	78.3263	3411894
9.49	79.0918	3445240
9.59	79.8315	3477461
9.69	80.5442	3508506
9.79	81.2965	3541277
9.89	82.0563	3574373
9.99	82.8276	3607968
10.09	83.6843	3645288
10.19	84.6484	3687283
10.29	85.9659	3744675
10.39	87.2536	3800767
10.49	87.7689	3823214
10.59	88.0260	3834413
10.69	88.2165	3842712
10.79	88.3634	3849111
10.89	88.5121	3855585
10.99	88.6383	3861084
11.09	88.8173	3868883
11.19	88.9614	3875158
11.29	89.0526	3879132
11.39	89.1548	3883581
11.49	89.2558	3887981
11.59	89.3459	3891905
11.69	89.4268	3895430
11.79	89.5025	3898729
11.89	89.5559	3901054
11.99	89.5903	3902554
12.09	89.6127	3903529
12.19	89.6270	3904154
12.29	89.6385	3904654
12.39	89.6431	3904854
12.50	89.6444	3904910
12.60	89.6457	3904969
12.70	89.6484	3905083
12.80	89.6488	3905104

Stage [ft]	Area [ac]	Area [ft2]
12.90	89.6530	3905286
13.00	89.6543	3905343
13.09	89.6569	3905453
13.20	89.6589	3905540
13.29	89.6597	3905578
13.40	89.6602	3905600
13.50	89.6615	3905653
13.60	89.6619	3905671
13.70	89.6625	3905697
13.80	89.6635	3905741
13.90	89.6651	3905813
14.00	89.6663	3905863
14.09	89.6672	3905903
14.20	89.6680	3905937
14.29	89.6689	3905978
14.40	89.6706	3906053
14.49	89.6729	3906153
14.60	89.6741	3906203
14.70	89.6759	3906284
14.80	89.6763	3906298
14.90	89.6774	3906347
15.00	89.6779	3906367
15.10	89.6785	3906397
15.20	89.6796	3906444
15.30	89.6816	3906531
15.40	89.6820	3906546
15.50	89.6824	3906566
15.60	89.6831	3906596
15.70	89.6838	3906628
15.80	89.6848	3906669
15.90	89.6861	3906728
16.00	89.6872	3906773
16.10	89.6883	3906823
16.20	89.6894	3906871
16.30	89.6903	3906908
16.39	89.6907	3906928
16.50	89.6909	3906937
16.60	89.6911	3906945
16.70	89.6913	3906953
16.80	89.6916	3906965
16.90	89.6918	3906976
17.00	89.6924	3907001
17.10	89.6927	3907012
17.20	89.6929	3907022
17.30	89.6934	3907043
17.40	89.6942	3907080
17.50	89.6942	3907080

Comment:

Node: B-11

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.58	19.8875	866300
4.00	23.2501	1012775
4.50	25.9642	1131002
5.00	41.6244	1813161
5.50	53.9220	2348844
6.00	58.6297	2553910
6.50	61.0130	2657725
7.00	61.0130	2657725

Comment:

Node: B-12

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.58	5.3562	233315
4.00	19.3591	843282
4.50	25.7000	1119494
5.00	29.3028	1276432
5.50	31.4405	1369549
6.00	33.8904	1476267
6.50	34.3276	1495309
7.00	34.4913	1502439
7.50	34.4913	1502439

Comment:

Node: B-13

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.66 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.66	0.0006	25
5.70	0.0008	33
5.80	0.0012	52
5.90	0.0017	76
6.00	0.0020	86
6.10	0.0022	95
6.20	0.0027	116
6.30	0.0030	130
6.40	0.0032	138
6.50	0.0034	146
6.60	0.0038	166
6.69	0.0046	200
6.80	0.0054	233
6.89	0.0063	275
6.99	0.0069	300
7.10	0.0071	311
7.20	0.0074	321
7.30	0.0083	362
7.40	0.0090	393
7.50	0.0096	417
7.59	0.0109	475
7.70	0.0113	491
7.80	0.0119	520
7.90	0.0141	615
8.00	0.0149	650
8.10	0.0160	697
8.20	0.0189	825
8.29	0.0252	1100
8.39	0.0367	1600
8.49	0.0625	2725
8.59	0.1010	4399
8.69	0.1475	6424
8.79	0.1865	8124
8.89	0.2416	10524
8.99	0.2772	12073
9.09	0.3127	13623
9.19	0.3558	15498
9.29	0.3954	17223
9.39	0.4292	18698
9.49	0.4654	20272
9.59	0.5182	22572
9.69	0.5802	25272
9.79	0.6611	28796
9.89	0.7420	32321
9.99	0.8315	36220
10.09	0.9342	40695
10.19	1.0530	45869
10.29	1.2108	52743

Stage [ft]	Area [ac]	Area [ft2]
10.39	1.3394	58342
10.49	1.4794	64441
10.59	1.6400	71440
10.69	1.8036	78565
10.79	1.9901	86688
10.89	2.2018	95912
10.99	2.4211	105461
11.09	2.6948	117384
11.19	2.9955	130483
11.29	3.2617	142081
11.39	3.5435	154354
11.49	3.7713	164278
11.59	3.9383	171552
11.69	4.0617	176926
11.79	4.1650	181426
11.89	4.2533	185275
11.99	4.3239	188350
12.09	4.3911	191274
12.19	4.4484	193774
12.29	4.4840	195324
12.39	4.5173	196774
12.49	4.5305	197349
12.59	4.5437	197924
12.69	4.5489	198149
12.80	4.5525	198306
12.90	4.5540	198374
13.00	4.5540	198374

Comment:

Node: B-14

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.21	0.7816	34045
-0.20	0.7822	34070
-0.10	0.7896	34395
0.00	0.7936	34570
0.10	0.7997	34837
0.20	0.8019	34931
0.30	0.8078	35187
0.40	0.8120	35370

Stage [ft]	Area [ac]	Area [ft2]
0.50	0.8160	35545
0.60	0.8200	35720
0.70	0.8223	35820
0.80	0.8292	36120
0.89	0.8326	36270
1.00	0.8362	36425
1.09	0.8401	36595
1.20	0.8481	36945
1.30	0.8530	37158
1.40	0.8585	37395
1.50	0.8648	37670
1.60	0.8699	37895
1.70	0.8763	38170
1.80	0.8814	38395
1.90	0.8875	38657
2.00	0.8921	38861
2.10	0.8986	39145
2.20	0.9035	39355
2.30	0.9061	39470
2.40	0.9136	39795
2.50	0.9191	40036
2.60	0.9241	40253
2.70	0.9308	40545
2.80	0.9411	40995
2.90	0.9514	41444
3.00	0.9576	41714
3.10	0.9623	41919
3.20	0.9709	42294
3.30	0.9801	42694
3.40	0.9859	42944
3.50	0.9933	43269
3.60	0.9996	43544
3.70	1.0024	43663
3.80	1.0074	43882
3.90	1.0137	44157
4.00	1.0220	44519
4.10	1.0358	45119
4.20	1.0530	45869
4.30	1.0714	46669
4.40	1.0915	47544
4.50	1.1133	48494
4.59	1.1420	49743
4.69	1.1810	51443
4.79	1.2275	53468
4.89	1.2923	56293
4.99	1.3669	59542
5.09	1.4581	63517
5.19	1.5574	67841
5.29	1.6636	72465

Stage [ft]	Area [ac]	Area [ft2]
5.39	1.7887	77915
5.49	1.9379	84414
5.59	2.1095	91888
5.69	2.3040	100362
5.79	2.5163	109610
5.89	2.7659	120484
5.99	3.0483	132782
6.09	3.3065	144031
6.19	3.5969	156679
6.29	3.8614	168203
6.39	4.1007	178626
6.49	4.3383	188975
6.59	4.5730	199198
6.69	4.8094	209497
6.79	5.0734	220995
6.89	5.3763	234194
6.99	5.6679	246892
7.09	6.0225	262340
7.19	6.3203	275313
7.29	6.6118	288012
7.39	6.9051	300785
7.49	7.2058	313883
7.59	7.5065	326981
7.69	7.7991	339730
7.79	8.1159	353528
7.89	8.4309	367251
7.99	8.7615	381649
8.09	9.0931	396097
8.19	9.3519	407371
8.29	9.6194	419019
8.39	9.8581	429418
8.49	10.1186	440766
8.59	10.4313	454389
8.69	10.6712	464838
8.79	10.8371	472062
8.89	10.9530	477111
8.99	11.0637	481936
9.09	11.1716	486635
9.19	11.2984	492159
9.29	11.4367	498183
9.39	11.5475	503008
9.49	11.6152	505957
9.59	11.6927	509332
9.69	11.7598	512257
9.79	11.8332	515456
9.89	11.8860	517756
9.99	11.9406	520131
10.09	11.9945	522480
10.19	12.0318	524105

Stage [ft]	Area [ac]	Area [ft2]
10.29	12.0593	525305
10.39	12.0731	525905
10.50	12.0770	526074
10.60	12.0792	526169
10.70	12.0792	526169

Comment:

Node: B-15

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.87	0.0006	25
1.90	0.0006	28
2.00	0.0009	39
2.10	0.0011	49
2.20	0.0021	90
2.30	0.0025	110
2.40	0.0031	135
2.50	0.0039	172
2.60	0.0062	271
2.70	0.0092	400
2.80	0.0207	900
2.90	0.0304	1325
3.00	0.0574	2500
3.10	0.1211	5274
3.20	0.1767	7699
3.30	0.2416	10524
3.40	0.3300	14373
3.50	0.4361	18997
3.60	0.5601	24397
3.70	0.6886	29996
3.80	0.8206	35745
3.90	0.9859	42944
4.00	1.1431	49793
4.10	1.3256	57742
4.20	1.5706	68416
4.30	1.8375	80039
4.40	2.1663	94362
4.50	2.4635	107311
4.59	2.7470	119659
4.69	3.1229	136032

Stage [ft]	Area [ac]	Area [ft2]
4.79	3.5355	154004
4.89	3.9985	174177
4.99	4.5994	200348
5.09	5.2036	226670
5.19	5.8567	255116
5.29	6.5229	284137
5.39	7.1381	310934
5.49	7.7125	335955
5.59	8.1911	356802
5.69	8.6519	376875
5.79	9.0679	394997
5.89	9.4656	412320
5.99	9.7927	426568
6.09	10.0469	437642
6.19	10.2500	446490
6.29	10.4319	454414
6.39	10.6259	462863
6.49	10.7952	470237
6.59	10.9610	477461
6.69	11.1263	484660
6.79	11.2904	491809
6.89	11.4643	499383
6.99	11.6158	505982
7.09	11.7638	512432
7.19	11.8975	518256
7.29	12.0381	524380
7.39	12.1385	528754
7.49	12.2252	532529
7.59	12.2940	535528
7.69	12.3474	537853
7.79	12.3910	539753
7.89	12.4323	541553
7.99	12.4708	543227
8.09	12.4995	544477
8.19	12.5236	545527
8.29	12.5465	546527
8.39	12.5683	547477
8.49	12.5781	547902
8.59	12.5884	548352
8.69	12.5924	548527
8.80	12.5976	548752
8.89	12.6022	548952
9.00	12.6051	549077
9.10	12.6062	549127
9.20	12.6068	549152
9.30	12.6139	549462
9.40	12.6139	549462

Comment:

Node: B-16

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.28	2.2426	97687
-0.20	2.2489	97962
-0.10	2.2564	98287
0.00	2.2638	98612
0.10	2.2741	99062
0.20	2.2799	99312
0.30	2.2856	99562
0.40	2.2931	99887
0.50	2.3009	100228
0.60	2.3109	100662
0.70	2.3180	100974
0.80	2.3252	101286
0.89	2.3350	101711
0.99	2.3419	102011
1.09	2.3499	102361
1.20	2.3614	102861
1.30	2.3717	103311
1.40	2.3780	103586
1.50	2.3901	104111
1.60	2.4021	104636
1.70	2.4159	105236
1.80	2.4291	105811
1.90	2.4492	106686
2.00	2.4675	107486
2.10	2.4847	108236
2.20	2.5134	109485
2.30	2.5519	111160
2.40	2.5944	113010
2.50	2.6420	115085
2.60	2.7051	117834
2.70	2.7831	121234
2.80	2.8732	125158
2.90	2.9381	127983
3.00	3.0356	132232
3.10	3.1412	136832
3.20	3.2359	140956
3.30	3.3363	145331
3.40	3.4505	150305
3.50	3.5619	155154
3.60	3.7088	161553
3.70	3.8723	168677
3.80	4.0777	177626

Stage [ft]	Area [ac]	Area [ft2]
3.90	4.3394	189025
4.00	4.7072	205048
4.10	5.1520	224420
4.20	5.7235	249317
4.30	6.5034	283287
4.40	7.4577	324857
4.50	8.5227	371250
4.59	9.3824	408695
4.69	10.2213	445241
4.79	10.8979	474712
4.89	11.4052	496809
4.99	11.8028	514131
5.09	12.1644	529879
5.19	12.5253	545602
5.29	12.9264	563075
5.39	13.2874	578798
5.49	13.5737	591271
5.59	13.7493	598920
5.69	13.8847	604819
5.79	14.0047	610044
5.89	14.1177	614968
5.99	14.2365	620142
6.09	14.3507	625117
6.19	14.4729	630441
6.29	14.6112	636465
6.39	14.7771	643689
6.49	14.9102	649488
6.59	15.0296	654688
6.69	15.1334	659212
6.79	15.1839	661412
6.89	15.2097	662537
6.99	15.2402	663861
7.09	15.2826	665711
7.19	15.3166	667189
7.29	15.3166	667189

Comment: Normal water levels at 2.00 NGVD or 0.5 NAVD

Node: B-17

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.73	0.0006	25
2.80	0.0016	69
2.90	0.0063	275
3.00	0.0212	925
3.10	0.0620	2700
3.20	0.1211	5274
3.30	0.2416	10524
3.40	0.4310	18772
3.50	0.6295	27421
3.60	0.8757	38145
3.70	1.1661	50793
3.80	1.4547	63367
3.90	1.7370	75665
4.00	2.0165	87838
4.10	2.3080	100537
4.20	2.5886	112760
4.30	2.8583	124508
4.39	3.0632	133432
4.49	3.2675	142331
4.59	3.5056	152705
4.69	3.8086	165903
4.79	4.1300	179901
4.89	4.4989	195974
4.99	4.9345	214946
5.09	5.4693	238243
5.19	6.0179	262140
5.29	6.6480	289586
5.39	7.2786	317058
5.49	7.7963	339605
5.59	8.2461	359202
5.69	8.5985	374550
5.79	8.9606	390323
5.89	9.2860	404496
5.99	9.5689	416819
6.09	9.8150	427543
6.19	10.0802	439091
6.29	10.3418	450490
6.39	10.5995	461713
6.49	10.8675	473387
6.59	11.1532	485835
6.69	11.4247	497659
6.79	11.7225	510632
6.89	11.9796	521830
6.99	12.2177	532204
7.09	12.4025	540253
7.19	12.5477	546577
7.29	12.6762	552176
7.39	12.7910	557176
7.49	12.8885	561425

Stage [ft]	Area [ac]	Area [ft2]
7.59	12.9586	564475
7.69	13.0171	567024
7.79	13.0727	569449
7.89	13.1152	571299
7.99	13.1428	572499
8.09	13.1500	572814
8.19	13.1500	572814

Comment:

Node: B-18

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.46	0.0006	25
1.50	0.0007	31
1.60	0.0011	47
1.70	0.0016	70
1.80	0.0022	95
1.90	0.0032	141
2.00	0.0060	262
2.10	0.0086	375
2.20	0.0143	625
2.30	0.0186	808
2.40	0.0281	1225
2.50	0.0482	2100
2.60	0.0712	3100
2.70	0.1010	4399
2.80	0.1274	5549
2.90	0.1526	6649
3.00	0.1848	8049
3.10	0.2221	9674
3.20	0.2571	11198
3.30	0.3007	13098
3.40	0.3437	14973
3.50	0.3879	16898
3.60	0.4344	18922
3.70	0.4763	20747
3.80	0.5348	23297
3.90	0.6048	26346
4.00	0.6955	30296
4.10	0.8298	36145

Stage [ft]	Area [ac]	Area [ft2]
4.20	1.0157	44244
4.30	1.2584	54818
4.40	1.5322	66741
4.50	1.7904	77990
4.59	2.0079	87463
4.69	2.2139	96437
4.79	2.4583	107086
4.89	2.7034	117759
4.99	2.9937	130408
5.09	3.3294	145031
5.19	3.6709	159904
5.29	4.0967	178451
5.39	4.5621	198723
5.49	5.1107	222620
5.59	5.4825	238818
5.69	5.7671	251216
5.79	5.9605	259640
5.89	6.1178	266489
5.99	6.2601	272689
6.09	6.4271	279963
6.19	6.5240	284187
6.29	6.6199	288361
6.39	6.7163	292561
6.49	6.8414	298010
6.59	7.1174	310034
6.69	7.2867	317408
6.79	7.3848	321682
6.89	7.4554	324757
6.99	7.5340	328181
7.09	7.6103	331506
7.19	7.6861	334805
7.29	7.7590	337980
7.39	7.8238	340805
7.49	7.8927	343804
7.59	7.9696	347154
7.69	8.0464	350503
7.79	8.1268	354003
7.89	8.2232	358202
7.99	8.2995	361527
8.09	8.3632	364301
8.19	8.4367	367501
8.29	8.5107	370725
8.39	8.6140	375225
8.49	8.7155	379649
8.59	8.7959	383149
8.69	8.8797	386798
8.79	8.9612	390348
8.89	9.0415	393847
8.99	9.1195	397247

Stage [ft]	Area [ac]	Area [ft2]
9.09	9.1964	400596
9.19	9.2785	404171
9.29	9.3606	407746
9.39	9.4386	411145
9.49	9.5252	414920
9.59	9.6234	419194
9.69	9.7169	423268
9.79	9.8162	427593
9.89	9.8977	431142
9.99	9.9780	434642
10.09	10.0515	437842
10.19	10.1393	441666
10.29	10.2265	445466
10.39	10.3315	450040
10.49	10.4422	454864
10.59	10.5519	459639
10.69	10.6563	464188
10.79	10.7447	468038
10.89	10.8204	471337
10.99	10.8853	474162
11.09	10.9501	476986
11.19	11.0333	480611
11.29	11.1372	485135
11.39	11.2255	488985
11.49	11.2944	491984
11.59	11.3661	495109
11.69	11.4350	498108
11.79	11.4884	500433
11.89	11.5257	502058
11.99	11.5589	503508
12.09	11.5968	505158
12.19	11.6427	507157
12.29	11.6760	508607
12.39	11.7179	510432
12.49	11.7451	511618
12.59	11.7451	511618

Comment:

Node: B-19

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.20	0.4700	20472
0.30	1.2092	52673
0.40	1.3999	60979
0.50	1.4094	61392
0.60	1.4208	61892
0.70	1.4306	62317
0.80	1.4426	62842
0.90	1.4593	63566
1.00	1.4756	64279
1.10	1.4845	64666
1.20	1.4926	65016
1.30	1.5055	65579
1.40	1.5132	65916
1.50	1.5270	66516
1.60	1.5385	67016
1.70	1.5482	67441
1.80	1.5577	67853
1.90	1.5741	68566
2.00	1.5878	69166
2.10	1.6016	69766
2.20	1.6154	70366
2.30	1.6309	71041
2.40	1.6458	71690
2.50	1.6607	72340
2.60	1.6785	73115
2.70	1.7049	74265
2.80	1.7296	75340
2.90	1.7623	76765
3.00	1.8105	78864
3.10	1.8857	82139
3.20	1.9689	85764
3.30	2.0567	89588
3.40	2.1869	95262
3.50	2.3103	100637
3.60	2.4698	107586
3.70	2.6339	114735
3.80	2.8359	123534
3.90	3.0683	133657
4.00	3.3834	147380
4.10	3.7300	162478
4.20	4.1942	182701
4.30	4.7859	208472
4.40	5.5927	243617
4.50	6.6049	287712
4.60	7.7096	335830
4.70	8.9640	390473
4.80	10.2730	447490
4.90	11.6674	508232
5.00	13.2093	575398

Stage [ft]	Area [ac]	Area [ft2]
5.10	14.8126	645239
5.20	16.5416	720554
5.30	18.2936	796869
5.40	19.9640	869634
5.50	21.4497	934350
5.60	22.7822	992393
5.70	23.8977	1040986
5.80	24.9031	1084780
5.90	25.8305	1125175
6.00	26.5960	1158520
6.10	27.3006	1189216
6.20	27.9571	1217812
6.30	28.5694	1244484
6.40	29.1783	1271005
6.50	29.7458	1295727
6.60	30.3575	1322373
6.70	30.9555	1348420
6.80	31.6424	1378341
6.90	32.3166	1407712
7.00	33.0242	1438533
7.10	33.7392	1469679
7.20	34.3997	1498450
7.30	35.0607	1527246
7.40	35.7287	1556342
7.50	36.3863	1584988
7.60	37.0003	1611735
7.70	37.5868	1637281
7.80	38.1670	1662553
7.90	38.7448	1687725
8.00	39.2825	1711147
8.10	39.7617	1732019
8.20	40.1817	1750316
8.30	40.5869	1767964
8.40	40.9828	1785212
8.50	41.3753	1802309
8.60	41.8350	1822332
8.70	42.3377	1844229
8.80	42.7778	1863401
8.90	43.1749	1880699
9.00	43.4899	1894422
9.10	43.7413	1905371
9.20	43.9381	1913944
9.30	44.1212	1921918
9.40	44.3134	1930292
9.50	44.4942	1938166
9.60	44.6583	1945315
9.70	44.8253	1952589
9.80	44.9664	1958738
9.90	45.0893	1964088

Stage [ft]	Area [ac]	Area [ft2]
10.00	45.1989	1968862
10.10	45.3033	1973411
10.20	45.3756	1976561
10.30	45.4502	1979811
10.40	45.5334	1983435
10.50	45.6201	1987210
10.60	45.7136	1991284
10.70	45.7985	1994984
10.80	45.8892	1998933
10.90	45.9603	2002033
11.00	46.0464	2005782
11.10	46.1623	2010831
11.20	46.2513	2014706
11.30	46.3316	2018205
11.40	46.4183	2021980
11.50	46.5032	2025680
11.60	46.5835	2029179
11.70	46.5865	2029310
11.80	46.5865	2029310

Comment:

Node: B-2

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.66	0.0006	25
1.70	0.0014	59
1.80	0.0025	108
1.90	0.0092	400
2.00	0.0252	1100
2.10	0.0666	2900
2.20	0.1262	5499
2.30	0.2146	9349
2.40	0.3168	13798
2.50	0.4281	18648
2.60	0.5130	22347
2.70	0.5985	26072
2.80	0.7064	30771
2.90	0.8906	38795
3.00	1.2825	55868
3.10	1.7944	78165

Stage [ft]	Area [ac]	Area [ft2]
3.20	2.3780	103586
3.30	2.9955	130483
3.40	3.5515	154704
3.50	3.9222	170852
3.60	4.1317	179976
3.70	4.2975	187200
3.80	4.4249	192749
3.90	4.5276	197224
4.00	4.6447	202323
4.10	4.7354	206272
4.20	4.8335	210547
4.30	4.9729	216621
4.40	5.1761	225470
4.50	5.4263	236368
4.59	5.6977	248192
4.69	6.0609	264015
4.79	6.4799	282262
4.89	6.9332	302010
4.99	7.4439	324257
5.09	7.9850	347829
5.19	8.6128	375175
5.29	9.4311	410820
5.39	10.2523	446590
5.49	11.2278	489085
5.59	12.9104	562375
5.69	14.6583	638515
5.79	15.9070	692907
5.89	17.0443	742451
5.99	18.2689	795794
6.09	19.3495	842862
6.19	20.4788	892056
6.29	20.9861	914153
6.39	21.4532	934500
6.49	21.9719	957097
6.59	22.5573	982594
6.69	23.2149	1011240
6.79	23.9356	1042636
6.89	24.7074	1076256
6.99	25.5590	1113351
7.09	26.5357	1155896
7.19	27.5577	1200415
7.29	28.6153	1246484
7.39	29.7888	1297602
7.49	31.0111	1350845
7.59	32.0521	1396189
7.69	32.9783	1436533
7.79	33.8006	1472353
7.89	34.5391	1504524
7.99	35.2817	1536870

Stage [ft]	Area [ac]	Area [ft2]
8.09	35.9990	1568116
8.19	36.6675	1597237
8.29	37.2941	1624533
8.39	37.9254	1652029
8.49	38.5870	1680851
8.59	39.1402	1704947
8.69	39.6871	1728769
8.79	40.1450	1748717
8.89	40.5473	1766239
8.99	40.8950	1781387
9.09	41.1986	1794610
9.19	41.4339	1804859
9.29	41.6605	1814733
9.39	41.8832	1824431
9.49	42.0898	1833430
9.59	42.3107	1843054
9.69	42.5523	1853577
9.79	42.8381	1866026
9.89	43.1221	1878399
9.99	43.4481	1892597
10.09	43.7637	1906345
10.19	44.0179	1917419
10.29	44.2658	1928218
10.39	44.4993	1938391
10.49	44.6973	1947015
10.59	44.8982	1955764
10.69	45.1053	1964788
10.79	45.2924	1972937
10.89	45.4634	1980386
10.99	45.6401	1988085
11.09	45.8002	1995059
11.19	45.9718	2002533
11.29	46.1359	2009682
11.39	46.3121	2017356
11.49	46.4831	2024805
11.59	46.6449	2031854
11.69	46.8091	2039003
11.79	46.9629	2045702
11.89	47.1321	2053076
11.99	47.3100	2060825
12.09	47.4896	2068649
12.19	47.6790	2076898
12.29	47.8512	2084397
12.39	48.0113	2091371
12.49	48.1593	2097820
12.59	48.2712	2102694
12.69	48.4043	2108493
12.79	48.6058	2117267
12.89	48.7412	2123166

Stage [ft]	Area [ac]	Area [ft2]
12.99	48.8525	2128016
13.09	48.9352	2131615
13.19	48.9891	2133965
13.29	49.0390	2136140
13.39	49.0763	2137765
13.49	49.1176	2139564
13.59	49.1567	2141264
13.69	49.1894	2142689
13.79	49.2152	2143814
13.89	49.2445	2145089
13.99	49.2829	2146763
14.09	49.3208	2148413
14.19	49.3558	2149938
14.29	49.3982	2151788
14.39	49.4350	2153387
14.49	49.4769	2155212
14.59	49.5199	2157087
14.69	49.5647	2159037
14.79	49.6140	2161186
14.89	49.6875	2164386
14.99	49.8022	2169385
15.09	49.9118	2174160
15.19	50.0450	2179959
15.29	50.2011	2186758
15.39	50.3577	2193582
15.49	50.4685	2198406
15.59	50.5706	2202856
15.69	50.5792	2203230
15.79	50.5792	2203230

Comment:

Node: B-20

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.34	81.0865	3532128
-0.30	81.1043	3532903
-0.20	81.1456	3534703
-0.10	81.1927	3536753
0.00	81.2529	3539377
0.09	81.2942	3541177

Stage [ft]	Area [ac]	Area [ft2]
0.20	81.3459	3543427
0.30	81.3947	3545552
0.40	81.4366	3547376
0.50	81.4893	3549676
0.60	81.5358	3551701
0.70	81.5909	3554100
0.80	81.6489	3556625
0.89	81.7005	3558875
0.99	81.7596	3561449
1.09	81.8268	3564374
1.20	81.8928	3567249
1.30	81.9576	3570073
1.40	82.0225	3572898
1.50	82.0833	3575548
1.60	82.1435	3578172
1.70	82.2095	3581047
1.80	82.2772	3583996
1.90	82.3518	3587246
2.00	82.4379	3590995
2.10	82.5355	3595245
2.20	82.6307	3599394
2.30	82.7380	3604069
2.40	82.8408	3608543
2.50	82.9607	3613767
2.60	83.0755	3618767
2.70	83.2034	3624341
2.80	83.3274	3629740
2.90	83.4605	3635540
3.00	83.5925	3641289
3.10	83.7296	3647263
3.20	83.8565	3652787
3.30	83.9816	3658236
3.40	84.1124	3663936
3.50	84.2576	3670260
3.60	84.4045	3676659
3.70	84.5525	3683108
3.80	84.7069	3689832
3.90	84.8888	3697756
4.00	85.0661	3705480
4.10	85.2561	3713754
4.20	85.4540	3722378
4.30	85.6578	3731252
4.40	85.8902	3741375
4.50	86.1742	3753749
4.59	86.4795	3767047
4.69	86.8806	3784520
4.79	87.3517	3805042
4.89	87.9267	3830089
4.99	88.6722	3862559

Stage [ft]	Area [ac]	Area [ft2]
5.09	89.7935	3911403
5.19	91.3761	3980343
5.29	93.6744	4080455
5.39	96.5694	4206563
5.49	100.0337	4357468
5.59	104.2853	4542668
5.69	109.4511	4767688
5.79	115.8087	5044626
5.89	123.0013	5357935
5.99	130.1634	5669918
6.09	136.9451	5965328
6.19	143.2993	6242116
6.29	149.3528	6505806
6.39	154.8886	6746949
6.49	159.8621	6963595
6.59	164.3726	7160069
6.69	168.1272	7323622
6.79	171.3012	7461879
6.89	173.9678	7578038
6.99	176.4463	7685999
7.09	178.6842	7783486
7.19	180.4551	7860625
7.29	181.9620	7926267
7.39	183.2090	7980584
7.49	184.2953	8027903
7.59	185.2370	8068923
7.69	186.0668	8105068
7.79	186.7502	8134839
7.89	187.3768	8162135
7.99	187.8566	8183032
8.09	188.2129	8198555
8.19	188.4729	8209879
8.29	188.6864	8219177
8.39	188.8671	8227051
8.49	189.0014	8232901
8.59	189.0984	8237125
8.69	189.1770	8240550
8.79	189.2608	8244199
8.89	189.3210	8246824
8.99	189.3939	8249998
9.09	189.4794	8253723
9.19	189.5454	8256597
9.29	189.6194	8259822
9.39	189.7003	8263347
9.49	189.7457	8265321
9.59	189.7916	8267321
9.69	189.8495	8269846
9.79	189.9132	8272620
9.89	189.9695	8275070

Stage [ft]	Area [ac]	Area [ft2]
9.99	190.0211	8277320
10.09	190.0693	8279419
10.19	190.1187	8281569
10.29	190.1738	8283969
10.39	190.2277	8286319
10.49	190.3166	8290193
10.59	190.3976	8293718
10.69	190.4871	8297617
10.79	190.5680	8301142
10.89	190.6311	8303891
10.99	190.6983	8306816
11.09	190.7654	8309740
11.19	190.8429	8313115
11.29	190.9094	8316015
11.39	190.9892	8319489
11.49	191.0690	8322964
11.59	191.1533	8326638
11.69	191.2526	8330963
11.79	191.2583	8331212
11.89	191.2583	8331212

Comment:

Node: B-21

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.34	0.0011	50
-0.30	0.0015	67
-0.20	0.0020	88
-0.10	0.0024	103
0.00	0.0026	115
0.09	0.0029	125
0.20	0.0037	161
0.30	0.0044	191
0.40	0.0047	203
0.50	0.0048	207
0.60	0.0048	211
0.70	0.0049	215
0.80	0.0050	220
0.90	0.0051	224
1.00	0.0059	256

Stage [ft]	Area [ac]	Area [ft2]
1.10	0.0064	280
1.20	0.0068	295
1.30	0.0075	327
1.40	0.0077	335
1.50	0.0079	343
1.60	0.0080	351
1.70	0.0082	357
1.80	0.0083	363
1.90	0.0085	369
2.00	0.0086	375
2.10	0.0089	390
2.20	0.0093	404
2.30	0.0096	419
2.40	0.0108	471
2.50	0.0113	494
2.60	0.0121	527
2.70	0.0122	530
2.80	0.0123	534
2.90	0.0123	537
3.00	0.0124	541
3.10	0.0125	544
3.20	0.0126	548
3.30	0.0128	557
3.40	0.0132	575
3.50	0.0141	615
3.60	0.0147	640
3.70	0.0151	658
3.80	0.0154	672
3.90	0.0156	679
4.00	0.0157	684
4.10	0.0158	689
4.20	0.0159	694
4.30	0.0160	699
4.40	0.0165	717
4.50	0.0179	779
4.60	0.0186	809
4.69	0.0189	825
4.80	0.0194	843
4.90	0.0202	880
5.00	0.0204	889
5.10	0.0206	899
5.20	0.0216	941
5.29	0.0224	975
5.40	0.0231	1007
5.50	0.0238	1037
5.60	0.0247	1075
5.70	0.0275	1200
5.79	0.0310	1350
5.89	0.0367	1600

Stage [ft]	Area [ac]	Area [ft2]
5.99	0.0494	2150
6.09	0.0723	3150
6.19	0.0935	4074
6.29	0.1096	4774
6.39	0.1412	6149
6.49	0.1676	7299
6.59	0.2135	9299
6.69	0.2749	11973
6.79	0.3294	14348
6.89	0.4017	17498
6.99	0.4889	21297
7.09	0.6220	27096
7.19	0.7649	33321
7.29	0.9313	40570
7.39	1.1425	49768
7.49	1.4076	61317
7.59	1.7783	77465
7.69	2.2655	98687
7.79	2.7998	121959
7.89	3.2416	141206
7.99	3.6244	157879
8.09	4.0204	175127
8.19	4.6309	201723
8.29	5.0607	220446
8.39	5.5112	240068
8.49	5.9238	258041
8.59	6.3226	275413
8.69	6.7696	294886
8.79	7.2017	313708
8.89	7.6511	333280
8.99	8.1830	356452
9.09	8.7626	381699
9.19	9.3927	409145
9.29	9.9987	435542
9.39	10.5421	459214
9.49	11.0207	480061
9.59	11.4189	497409
9.69	11.7185	510457
9.79	11.9606	521005
9.89	12.1322	528479
9.99	12.2740	534654
10.09	12.4352	541678
10.19	12.5890	548377
10.29	12.7302	554526
10.39	12.8524	559850
10.49	12.9413	563725
10.59	13.0027	566399
10.69	13.0498	568449
10.79	13.0762	569599

Stage [ft]	Area [ac]	Area [ft2]
10.89	13.0871	570074
10.99	13.0916	570268
11.09	13.0916	570268

Comment:

Node: B-22

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.26 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.26	0.0006	25
3.30	0.0023	100
3.40	0.0043	187
3.50	0.0103	450
3.60	0.0241	1050
3.70	0.0637	2775
3.80	0.0987	4299
3.90	0.1199	5224
4.00	0.1475	6424
4.10	0.1716	7474
4.20	0.1934	8424
4.30	0.2117	9224
4.39	0.2267	9874
4.50	0.2389	10407
4.60	0.2445	10649
4.69	0.2525	10999
4.79	0.2617	11398
4.89	0.2686	11698
4.99	0.2732	11898
5.09	0.2800	12198
5.19	0.2875	12523
5.29	0.2944	12823
5.39	0.3036	13223
5.49	0.3214	13998
5.59	0.3449	15023
5.69	0.3873	16873
5.79	0.4660	20297
5.89	0.6031	26271
5.99	0.8355	36395
6.09	1.1936	51993
6.19	1.6429	71565
6.29	2.2064	96112

Stage [ft]	Area [ac]	Area [ft2]
6.39	2.8859	125708
6.49	3.7088	161553
6.59	4.6418	202198
6.69	5.5531	241893
6.79	6.3903	278363
6.89	7.1845	312958
6.99	7.8674	342704
7.09	8.4533	368226
7.19	9.0042	392223
7.29	9.4902	413395
7.39	9.9723	434392
7.49	10.4222	453989
7.59	10.8204	471337
7.69	11.1859	487260
7.79	11.5647	503758
7.89	11.9572	520855
7.99	12.3618	538478
8.09	12.8048	557776
8.19	13.2604	577623
8.29	13.7401	598520
8.39	14.2549	620942
8.49	14.8270	645864
8.59	15.4003	670835
8.69	16.0097	697382
8.79	16.6369	724703
8.89	17.2939	753324
8.99	18.0422	785920
9.09	18.7550	816966
9.19	19.4533	847387
9.29	20.1368	877158
9.39	20.7617	904379
9.49	21.3459	929826
9.59	21.9335	955422
9.69	22.5727	983269
9.79	23.1621	1008940
9.89	23.7331	1033812
9.99	24.2122	1054684
10.09	24.6558	1074007
10.19	25.0431	1090879
10.29	25.3897	1105977
10.39	25.6744	1118376
10.49	25.9160	1128899
10.59	26.0910	1136523
10.69	26.2321	1142672
10.79	26.3102	1146072
10.89	26.3825	1149222
10.99	26.4382	1151646
11.09	26.4829	1153596
11.19	26.5133	1154921

Stage [ft]	Area [ac]	Area [ft2]
11.29	26.5278	1155551
11.39	26.5278	1155551

Comment:

Node: B-23

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.01 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.01	0.0006	25
5.10	0.0026	112
5.20	0.0132	575
5.30	0.0390	1700
5.40	0.0666	2900
5.49	0.0970	4224
5.59	0.1360	5924
5.69	0.2026	8824
5.79	0.2932	12773
5.89	0.3845	16748
5.99	0.5021	21872
6.09	0.6840	29796
6.19	0.9675	42144
6.29	1.3009	56667
6.39	1.7313	75415
6.49	2.1295	92763
6.59	2.5111	109385
6.69	2.8755	125258
6.79	3.2032	139531
6.89	3.5091	152855
6.99	3.8379	167178
7.09	4.1988	182901
7.19	4.6298	201673
7.29	5.0854	221520
7.39	5.5284	240818
7.49	5.9479	259090
7.59	6.3358	275988
7.69	6.7077	292186
7.79	7.0824	308509
7.89	7.5013	326756
7.99	7.8554	342179
8.09	8.1905	356777
8.19	8.4619	368601

Stage [ft]	Area [ac]	Area [ft2]
8.29	8.7276	380174
8.39	8.9468	389723
8.49	9.1700	399447
8.59	9.3732	408295
8.69	9.5838	417469
8.79	9.8546	429268
8.89	10.0859	439341
8.99	10.2626	447040
9.09	10.3940	452765
9.19	10.4750	456289
9.29	10.5553	459789
9.39	10.6104	462188
9.49	10.6586	464288
9.59	10.7045	466288
9.69	10.7670	469012
9.79	10.8634	473212
9.89	10.9277	476011
9.99	10.9851	478511
10.09	11.0017	479236
10.19	11.0098	479586
10.30	11.0110	479638
10.40	11.0110	479638

Comment:

Node: B-24

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.15 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.15	0.0006	25
4.20	0.0009	39
4.30	0.0023	100
4.39	0.0052	225
4.49	0.0189	825
4.59	0.0367	1600
4.69	0.0821	3575
4.79	0.1446	6299
4.89	0.2990	13023
4.99	0.7529	32796
5.09	1.5723	68491
5.19	2.5329	110335
5.29	3.4155	148780

Stage [ft]	Area [ac]	Area [ft2]
5.39	4.2792	186400
5.49	5.3580	233394
5.59	6.7203	292736
5.69	8.5950	374400
5.79	10.9507	477011
5.89	13.4549	586097
5.99	15.5139	675785
6.09	17.0822	744101
6.19	18.2563	795244
6.29	19.0602	830264
6.39	19.7070	858435
6.49	20.2424	881757
6.59	20.7009	901730
6.69	21.1594	921702
6.79	21.6081	941249
6.89	22.2038	967196
6.99	22.9079	997867
7.09	23.6625	1030737
7.19	24.3545	1060883
7.29	25.0713	1092104
7.39	25.8569	1126325
7.49	26.7394	1164769
7.59	27.5795	1201365
7.69	28.5585	1244009
7.79	29.7269	1294902
7.89	30.9497	1348170
7.99	32.0331	1395364
8.09	33.0930	1441533
8.19	33.9762	1480002
8.29	34.9150	1520897
8.39	35.9462	1565816
8.49	37.2081	1620784
8.59	38.6157	1682100
8.69	40.1789	1750191
8.79	41.6129	1812658
8.89	42.7279	1861226
8.99	43.5404	1896622
9.09	44.0896	1920544
9.19	44.5194	1939266
9.29	44.8551	1953889
9.39	45.1288	1965812
9.49	45.3389	1974961
9.59	45.5150	1982635
9.69	45.6287	1987585
9.79	45.7526	1992984
9.89	45.8416	1996858
9.99	45.8835	1998683
10.09	45.8989	1999358
10.19	45.9133	1999983

Stage [ft]	Area [ac]	Area [ft2]
10.29	45.9183	2000199
10.39	45.9183	2000199

Comment:

Node: B-25

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.15 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.15	0.0006	25
4.20	0.0011	50
4.30	0.0040	175
4.40	0.0099	433
4.50	0.0126	550
4.59	0.0184	800
4.70	0.0218	950
4.80	0.0252	1100
4.90	0.0330	1437
4.99	0.0407	1775
5.09	0.0476	2075
5.19	0.0580	2525
5.29	0.0706	3075
5.39	0.1067	4649
5.49	0.1739	7574
5.59	0.2502	10899
5.69	0.3632	15823
5.79	0.4797	20897
5.89	0.5957	25947
5.99	0.6898	30046
6.09	0.8160	35545
6.19	0.9491	41344
6.29	1.1035	48069
6.39	1.2378	53918
6.49	1.4002	60992
6.59	1.5729	68516
6.69	1.7531	76365
6.79	1.8983	82689
6.89	2.0314	88488
6.99	2.1215	92413
7.09	2.2093	96237
7.19	2.3281	101411
7.29	2.4526	106836

Stage [ft]	Area [ac]	Area [ft2]
7.39	2.6030	113385
7.49	2.7774	120984
7.59	2.9851	130033
7.69	3.1745	138282
7.79	3.3426	145606
7.89	3.5188	153280
7.99	3.6577	159329
8.09	3.7661	164053
8.19	3.8694	168553
8.29	3.9544	172252
8.39	4.0163	174952
8.49	4.0248	175319
8.59	4.0248	175319

Comment:

Node: B-26

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.60	0.0011	50
2.70	0.0044	190
2.80	0.0080	350
2.90	0.0143	625
3.00	0.0228	994
3.10	0.0362	1575
3.20	0.0459	2000
3.30	0.0608	2650
3.40	0.0861	3750
3.50	0.1125	4899
3.60	0.1567	6824
3.70	0.2083	9074
3.80	0.2565	11173
3.90	0.3225	14048
4.00	0.4269	18598
4.10	0.5492	23922
4.20	0.6703	29196
4.30	0.8011	34895
4.40	0.9308	40545
4.50	1.0708	46644
4.60	1.1902	51843
4.70	1.3434	58517

Stage [ft]	Area [ac]	Area [ft2]
4.80	1.5413	67141
4.90	1.7629	76790
5.00	2.0056	87363
5.10	2.2655	98687
5.20	2.5226	109885
5.30	2.7728	120784
5.40	2.9846	130008
5.50	3.2095	139806
5.60	3.4614	150780
5.70	3.7036	161328
5.80	3.9664	172777
5.90	4.2516	185200
6.00	4.5167	196749
6.10	4.7715	207847
6.20	5.0085	218171
6.30	5.2501	228694
6.40	5.4750	238493
6.50	5.6948	248067
6.60	5.8779	256041
6.70	6.1160	266414
6.80	6.3553	276838
6.90	6.6296	288786
7.00	6.8620	298910
7.10	7.1271	310459
7.20	7.4020	322432
7.30	7.6304	332381
7.40	7.8548	342154
7.50	8.0585	351028
7.60	8.2720	360327
7.70	8.4631	368651
7.80	8.6323	376025
7.90	8.7867	382749
8.00	8.9187	388498
8.10	9.0421	393872
8.20	9.1442	398322
8.30	9.2395	402471
8.40	9.3301	406421
8.50	9.4065	409745
8.60	9.4707	412545
8.70	9.5207	414720
8.80	9.5723	416969
8.90	9.6308	419519
9.00	9.6779	421569
9.10	9.7261	423668
9.20	9.7577	425043
9.30	9.7918	426533
9.40	9.7918	426533

Comment:

Node: B-27

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.92 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.92	0.0006	25
4.00	0.0017	75
4.09	0.0086	375
4.19	0.0189	825
4.29	0.0362	1575
4.39	0.0677	2950
4.49	0.1085	4724
4.59	0.1555	6774
4.69	0.2049	8924
4.79	0.2519	10974
4.89	0.2944	12823
4.99	0.3391	14773
5.09	0.3793	16523
5.19	0.4390	19122
5.29	0.5170	22522
5.39	0.6261	27271
5.49	0.7494	32646
5.59	0.8545	37220
5.69	0.9796	42669
5.79	1.1190	48744
5.89	1.2550	54668
5.99	1.3767	59967
6.09	1.4725	64141
6.19	1.5586	67891
6.29	1.6596	72290
6.39	1.7227	75040
6.49	1.7505	76250
6.59	1.7505	76250

Comment:

Node: B-28

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.87 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.87	0.0006	25
3.90	0.0008	36
4.00	0.0029	125
4.09	0.0069	300
4.19	0.0235	1025
4.29	0.0534	2325
4.39	0.0809	3525
4.49	0.1222	5324
4.59	0.1481	6449
4.69	0.1888	8224
4.79	0.2238	9749
4.89	0.2622	11423
4.99	0.3082	13423
5.09	0.3472	15123
5.19	0.3937	17148
5.29	0.4321	18822
5.39	0.4740	20647
5.49	0.5182	22572
5.59	0.5538	24122
5.69	0.5997	26121
5.79	0.6576	28646
5.89	0.7368	32096
5.99	0.8568	37320
6.09	1.0323	44969
6.19	1.2458	54268
6.29	1.4455	62967
6.39	1.6263	70841
6.49	1.7583	76590
6.59	1.8529	80714
6.69	1.8736	81613
6.79	1.8736	81613

Comment:

Node: B-29

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.31 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.31	0.0006	25
4.40	0.0027	117
4.50	0.0075	325
4.60	0.0216	942

Stage [ft]	Area [ac]	Area [ft2]
4.69	0.0344	1500
4.79	0.0471	2050
4.89	0.0608	2650
4.99	0.0775	3375
5.09	0.1102	4799
5.19	0.1521	6624
5.29	0.2031	8849
5.39	0.2628	11448
5.49	0.3156	13748
5.59	0.3759	16373
5.69	0.4419	19247
5.79	0.4987	21722
5.89	0.5417	23597
5.99	0.5893	25672
6.09	0.6496	28296
6.19	0.7024	30596
6.29	0.7701	33546
6.39	0.8734	38045
6.49	0.9629	41944
6.59	1.0760	46869
6.69	1.2200	53143
6.79	1.3571	59117
6.89	1.5023	65441
6.99	1.6355	71241
7.09	1.7554	76465
7.19	1.8352	79939
7.29	1.8799	81889
7.39	1.9052	82989
7.50	1.9187	83579
7.60	1.9187	83579

Comment:

Node: B-3

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.33	29.4176	1281429
-1.30	29.4256	1281779
-1.20	29.4485	1282779
-1.09	29.4715	1283779
-0.99	29.4973	1284903

Stage [ft]	Area [ac]	Area [ft2]
-0.89	29.5168	1285753
-0.80	29.5335	1286478
-0.70	29.5518	1287278
-0.60	29.5725	1288178
-0.50	29.5926	1289053
-0.40	29.6098	1289803
-0.30	29.6270	1290553
-0.20	29.6442	1291303
-0.10	29.6683	1292352
0.00	29.6832	1293002
0.09	29.7022	1293827
0.20	29.7251	1294827
0.30	29.7452	1295702
0.40	29.7716	1296852
0.50	29.8026	1298202
0.60	29.8382	1299751
0.70	29.8697	1301126
0.80	29.8996	1302426
0.89	29.9243	1303501
0.99	29.9518	1304701
1.09	29.9771	1305801
1.20	30.0035	1306950
1.30	30.0281	1308025
1.40	30.0597	1309400
1.50	30.0907	1310750
1.60	30.1131	1311725
1.70	30.1498	1313325
1.80	30.1773	1314524
1.90	30.2095	1315924
2.00	30.2405	1317274
2.10	30.2812	1319049
2.20	30.3151	1320524
2.30	30.3432	1321748
2.40	30.3851	1323573
2.50	30.4212	1325148
2.60	30.4763	1327548
2.70	30.5285	1329822
2.80	30.5871	1332372
2.90	30.6439	1334847
3.00	30.7093	1337696
3.10	30.7965	1341496
3.20	30.8843	1345320
3.30	30.9842	1349670
3.40	31.0909	1354319
3.50	31.2372	1360693
3.60	31.4180	1368567
3.70	31.6647	1379316
3.80	31.9729	1392739
3.90	32.3780	1410387

Stage [ft]	Area [ac]	Area [ft2]
4.00	32.8601	1431384
4.10	33.4058	1455156
4.20	34.1305	1486726
4.30	34.9701	1523297
4.40	35.9118	1564316
4.50	36.9848	1611060
4.59	38.1486	1661753
4.69	39.5419	1722445
4.79	40.9449	1783562
4.89	42.2728	1841404
4.99	43.5904	1898796
5.09	44.8637	1954264
5.19	45.9862	2003158
5.29	46.9870	2046752
5.39	47.9889	2090396
5.49	48.9661	2132965
5.59	49.8763	2172610
5.69	50.6705	2207205
5.79	51.4245	2240051
5.89	52.1366	2271072
5.99	52.7570	2298093
6.09	53.3411	2323540
6.19	53.8117	2344037
6.29	54.2581	2363484
6.39	54.6512	2380607
6.49	55.0581	2398330
6.59	55.4598	2415827
6.69	55.8190	2431475
6.79	56.1771	2447073
6.89	56.5036	2461296
6.99	56.8318	2475594
7.09	57.0969	2487143
7.19	57.2915	2495617
7.29	57.4309	2501691
7.39	57.5233	2505715
7.49	57.6025	2509165
7.59	57.6639	2511840
7.69	57.7351	2514939
7.79	57.7936	2517489
7.89	57.8211	2518689
7.99	57.8389	2519464
8.09	57.8544	2520138
8.19	57.8716	2520888
8.30	57.8934	2521838
8.39	57.9072	2522438
8.49	57.9079	2522469
8.59	57.9079	2522469

Comment:

Node: B-30

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.06 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.06	0.0006	25
4.10	0.0013	57
4.20	0.0039	169
4.30	0.0063	275
4.39	0.0103	450
4.49	0.0172	750
4.60	0.0281	1225
4.69	0.0396	1725
4.79	0.0539	2350
4.89	0.0786	3425
4.99	0.1383	6024
5.09	0.2163	9424
5.19	0.3001	13073
5.29	0.4005	17448
5.39	0.5515	24022
5.49	0.7282	31721
5.59	0.9750	42469
5.69	1.2498	54443
5.79	1.6108	70166
5.89	2.0538	89463
5.99	2.6988	117559
6.09	3.3926	147780
6.19	3.9521	172152
6.29	4.4255	192774
6.39	4.8926	213122
6.49	5.3247	231944
6.59	5.6931	247992
6.69	5.9932	261065
6.79	6.2601	272689
6.89	6.4999	283137
6.99	6.6784	290911
7.09	6.8098	296635
7.19	6.9165	301285
7.29	6.9883	304409
7.39	7.0193	305759
7.50	7.0319	306309
7.59	7.0457	306909
7.69	7.0514	307159
7.80	7.0532	307238
7.90	7.0532	307238

Comment:

Node: B-31

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.05	2.5341	110385
0.10	2.5375	110535
0.20	2.5395	110623
0.30	2.5427	110760
0.40	2.5467	110935
0.50	2.5489	111030
0.60	2.5548	111285
0.70	2.5597	111502
0.80	2.5632	111653
0.90	2.5674	111835
1.00	2.5706	111977
1.10	2.5743	112135
1.20	2.5812	112435
1.30	2.5869	112685
1.40	2.5915	112885
1.50	2.5961	113085
1.60	2.6012	113310
1.70	2.6053	113485
1.80	2.6100	113693
1.90	2.6130	113820
2.00	2.6156	113935
2.10	2.6210	114172
2.20	2.6290	114518
2.30	2.6328	114685
2.40	2.6365	114847
2.50	2.6407	115028
2.60	2.6471	115310
2.70	2.6556	115676
2.80	2.6601	115872
2.90	2.6695	116284
3.00	2.6758	116559
3.10	2.6821	116834
3.20	2.6879	117084
3.30	2.6976	117509
3.40	2.7080	117959
3.50	2.7180	118397
3.60	2.7286	118859
3.70	2.7499	119784
3.80	2.7682	120584
3.90	2.7831	121234
4.00	2.8084	122334
4.10	2.8273	123159

Stage [ft]	Area [ac]	Area [ft2]
4.20	2.8457	123958
4.30	2.8732	125158
4.40	2.9002	126333
4.50	2.9306	127658
4.59	2.9668	129233
4.69	3.0201	131557
4.79	3.0706	133757
4.89	3.1424	136882
4.99	3.2428	141256
5.09	3.3358	145306
5.19	3.4362	149680
5.29	3.5492	154604
5.39	3.6801	160304
5.49	3.7960	165353
5.59	3.9297	171177
5.69	4.0525	176526
5.79	4.1896	182501
5.89	4.3526	189600
5.99	4.5500	198199
6.09	4.7377	206372
6.19	4.8995	213422
6.29	5.0693	220820
6.39	5.2403	228270
6.49	5.4234	236243
6.59	5.6007	243967
6.69	5.7717	251416
6.79	5.9290	258265
6.89	6.0931	265415
6.99	6.2515	272314
7.09	6.4041	278963
7.19	6.5487	285262
7.29	6.7197	292711
7.39	6.9079	300910
7.49	7.1644	312083
7.59	7.5036	326856
7.69	7.9225	345104
7.79	8.4040	366076
7.89	8.8762	386648
7.99	9.3278	406321
8.09	9.7100	422969
8.19	10.1031	440091
8.29	10.5002	457389
8.39	10.8537	472787
8.49	11.1676	486460
8.59	11.4052	496809
8.69	11.4924	500610
8.79	11.4924	500610

Comment:

Node: B-32

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.00	0.0006	25
3.10	0.0063	275
3.21	0.0171	746
3.31	0.0267	1164
3.40	0.0344	1500
3.50	0.0689	3000
3.60	0.1222	5324
3.70	0.2077	9049
3.80	0.3001	13073
3.90	0.4005	17448
4.00	0.4792	20872
4.10	0.5693	24797
4.20	0.6565	28596
4.30	0.7431	32371
4.40	0.8464	36870
4.50	0.9641	41994
4.60	1.0656	46419
4.70	1.1580	50443
4.80	1.2699	55318
4.90	1.3801	60117
5.00	1.5218	66291
5.10	1.6756	72990
5.20	1.8443	80339
5.30	2.0119	87638
5.40	2.1599	94087
5.50	2.3120	100712
5.60	2.4882	108386
5.70	2.7028	117734
5.80	3.0121	131207
5.90	3.4293	149380
6.00	3.8000	165528
6.10	4.1363	180176
6.20	4.4823	195249
6.30	4.8237	210122
6.40	5.1583	224695
6.50	5.5370	241193
6.60	5.9347	258515
6.70	6.4064	279063
6.80	6.9579	303085
6.90	7.6138	331656
7.00	8.3007	361577
7.10	8.9457	389673

Stage [ft]	Area [ac]	Area [ft2]
7.20	9.5660	416694
7.30	10.1938	444041
7.40	10.8399	472187
7.50	11.4998	500933
7.60	12.2774	534804
7.70	13.2030	575123
7.80	14.1567	616668
7.90	15.1449	659712
8.00	16.2082	706031
8.10	17.3410	755374
8.20	18.4428	803368
8.30	19.4126	845612
8.40	20.2768	883257
8.50	21.0733	917952
8.60	21.8107	950073
8.70	22.5377	981744
8.80	23.1162	1006941
8.90	23.5598	1026263
9.00	23.8031	1036862
9.10	23.9620	1043786
9.20	24.0515	1047685
9.30	24.1187	1050610
9.40	24.1726	1052959
9.50	24.2329	1055584
9.60	24.2834	1057784
9.70	24.3270	1059684
9.80	24.3643	1061308
9.90	24.4010	1062908
10.00	24.4412	1064658
10.10	24.4791	1066308
10.20	24.5164	1067932
10.30	24.5571	1069707
10.40	24.5915	1071207
10.50	24.6196	1072432
10.60	24.6437	1073481
10.70	24.6437	1073481

Comment:

Node: B-33

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.44 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.44	0.0006	25
4.50	0.0015	64
4.59	0.0046	200
4.69	0.0115	500
4.79	0.0218	950
4.89	0.0390	1700
4.99	0.0780	3400
5.09	0.1613	7024
5.19	0.3064	13348
5.29	0.5406	23547
5.39	0.8923	38870
5.49	1.3284	57867
5.59	1.8352	79939
5.69	2.2386	97512
5.79	2.6403	115010
5.89	3.0213	131607
5.99	3.3570	146230
6.09	3.6261	157954
6.19	3.8671	168452
6.29	4.0789	177676
6.39	4.3101	187750
6.49	4.5552	198424
6.59	4.8341	210572
6.69	5.1009	222195
6.79	5.3270	232044
6.89	5.4997	239568
6.99	5.6661	246817
7.09	5.8148	253291
7.19	5.9479	259090
7.29	6.0673	264290
7.39	6.1843	269389
7.49	6.2727	273239
7.59	6.3616	277113
7.69	6.4236	279813
7.79	6.4477	280863
7.89	6.4644	281587
8.00	6.4705	281856
8.10	6.4705	281856

Comment:

Node: B-34

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.78 ft

Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.78	0.0006	25
4.80	0.0007	31
4.90	0.0013	56
5.00	0.0019	81
5.10	0.0027	119
5.20	0.0035	154
5.30	0.0043	189
5.40	0.0055	242
5.49	0.0080	350
5.60	0.0112	487
5.70	0.0149	650
5.79	0.0207	900
5.89	0.0281	1225
5.99	0.0350	1525
6.09	0.0465	2025
6.19	0.0625	2725
6.29	0.0872	3799
6.40	0.1171	5099
6.49	0.1521	6624
6.59	0.2181	9499
6.69	0.2973	12948
6.79	0.4023	17523
6.89	0.5388	23472
6.99	0.7219	31446
7.09	0.9589	41769
7.19	1.2240	53318
7.29	1.4977	65241
7.39	1.7726	77215
7.49	2.0676	90063
7.59	2.3287	101436
7.69	2.5892	112785
7.79	2.8216	122909
7.89	3.0592	133257
7.99	3.2772	142756
8.09	3.5349	153979
8.19	3.8402	167278
8.29	4.2464	184975
8.39	4.7222	205698
8.49	5.2903	230444
8.59	5.9387	258690
8.69	6.6354	289036
8.79	6.9998	304909
8.89	7.1868	313058
8.99	7.3079	318332
9.09	7.3756	321282
9.19	7.4141	322957
9.29	7.4238	323382

Stage [ft]	Area [ac]	Area [ft2]
9.40	7.4282	323571
9.50	7.4282	323571

Comment:

Node: B-35

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.58	0.0006	25
5.60	0.0006	28
5.70	0.0010	43
5.80	0.0016	71
5.90	0.0022	94
6.00	0.0026	115
6.10	0.0036	158
6.19	0.0040	175
6.29	0.0080	350
6.39	0.0161	700
6.49	0.0344	1500
6.59	0.0666	2900
6.69	0.1027	4474
6.79	0.1704	7424
6.89	0.2743	11948
6.99	0.4539	19772
7.09	0.7024	30596
7.19	1.0610	46219
7.29	1.4742	64216
7.39	1.8966	82614
7.49	2.4193	105386
7.59	3.0764	134007
7.69	3.8792	168977
7.79	4.8702	212147
7.89	5.9944	261115
7.99	7.2689	316633
8.09	8.4281	367126
8.19	9.4879	413295
8.29	10.4233	454039
8.39	11.2049	488085
8.49	11.9142	518981
8.59	12.5351	546027
8.69	13.0762	569599

Stage [ft]	Area [ac]	Area [ft2]
8.79	13.5571	590546
8.89	14.0466	611868
8.99	14.5510	633840
9.09	15.0875	657212
9.19	15.7296	685184
9.29	16.7224	728428
9.39	17.5017	762373
9.49	17.8976	779621
9.59	18.1846	792119
9.69	18.3607	799793
9.79	18.4795	804967
9.89	18.5644	808667
9.99	18.6293	811492
10.09	18.6597	812816
10.19	18.6827	813816
10.29	18.6913	814191
10.40	18.6993	814541
10.49	18.7022	814666
10.60	18.7062	814841
10.70	18.7071	814883
10.80	18.7096	814991
10.90	18.7100	815006
11.00	18.7100	815006

Comment:

Node: B-36

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.94	0.0006	25
1.00	0.0011	50
1.10	0.0016	71
1.20	0.0041	180
1.30	0.0109	475
1.40	0.0157	683
1.50	0.0197	858
1.60	0.0250	1087
1.70	0.0293	1275
1.80	0.0339	1475
1.90	0.0407	1775
2.00	0.0488	2125

Stage [ft]	Area [ac]	Area [ft2]
2.10	0.0614	2675
2.20	0.0729	3175
2.30	0.0835	3637
2.40	0.0935	4074
2.50	0.1010	4399
2.60	0.1044	4549
2.70	0.1096	4774
2.80	0.1136	4949
2.90	0.1166	5079
3.00	0.1199	5224
3.10	0.1245	5424
3.20	0.1262	5499
3.30	0.1328	5784
3.40	0.1360	5924
3.50	0.1377	5999
3.60	0.1417	6174
3.70	0.1475	6424
3.80	0.1547	6737
3.90	0.1584	6899
4.00	0.1611	7016
4.10	0.1681	7324
4.20	0.1773	7724
4.30	0.2003	8724
4.40	0.2290	9974
4.50	0.2668	11623
4.60	0.3145	13698
4.70	0.3489	15198
4.80	0.3845	16748
4.89	0.4132	17998
4.99	0.4436	19322
5.09	0.4792	20872
5.19	0.5245	22847
5.29	0.5670	24697
5.39	0.5985	26072
5.49	0.6289	27396
5.59	0.6674	29071
5.69	0.7047	30696
5.79	0.7454	32471
5.89	0.7942	34595
5.99	0.8481	36945
6.09	0.9004	39220
6.19	0.9595	41794
6.29	1.0278	44769
6.39	1.1150	48569
6.49	1.2275	53468
6.59	1.3916	60617
6.69	1.6601	72315
6.79	2.1255	92588
6.89	2.7900	121534

Stage [ft]	Area [ac]	Area [ft2]
6.99	3.5745	155704
7.09	4.5919	200023
7.19	5.6834	247567
7.29	6.8861	299960
7.39	8.1078	353178
7.49	9.4019	409545
7.59	10.8933	474512
7.69	12.5953	548652
7.79	14.2801	622042
7.89	15.9942	696707
7.99	17.6302	767972
8.09	19.3420	842537
8.19	21.1123	919652
8.29	22.9348	999042
8.39	24.7947	1080056
8.49	26.5885	1158195
8.59	28.4328	1238535
8.69	30.5475	1330647
8.79	32.8710	1431859
8.89	35.1365	1530546
8.99	37.3722	1627933
9.09	39.3479	1713996
9.19	41.0132	1786536
9.29	42.3004	1842604
9.39	43.3212	1887073
9.49	44.1786	1924418
9.59	44.8511	1953714
9.69	45.5340	1983460
9.79	46.0900	2007682
9.89	46.5755	2028829
9.99	47.0415	2049126
10.09	47.4282	2065974
10.19	47.7295	2079097
10.29	48.0227	2091871
10.39	48.2425	2101444
10.49	48.4078	2108643
10.59	48.5782	2116067
10.69	48.7148	2122017
10.79	48.8399	2127466
10.89	48.9621	2132790
10.99	49.0511	2136665
11.09	49.1222	2139764
11.19	49.1905	2142739
11.29	49.2439	2145064
11.39	49.2772	2146513
11.49	49.3127	2148063
11.59	49.3500	2149688
11.69	49.3747	2150763
11.79	49.3879	2151338

Stage [ft]	Area [ac]	Area [ft2]
11.89	49.4040	2152038
11.99	49.4235	2152888
12.09	49.4407	2153637
12.19	49.4505	2154062
12.29	49.4574	2154362
12.39	49.4631	2154612
12.49	49.4688	2154862
12.59	49.4728	2155037
12.70	49.4750	2155131
12.80	49.4772	2155229
12.90	49.4797	2155337
12.99	49.4815	2155412
13.09	49.4832	2155487
13.20	49.4845	2155543
13.30	49.4851	2155572
13.40	49.4859	2155607
13.50	49.4870	2155654
13.60	49.4883	2155712
13.69	49.4889	2155737
13.80	49.4898	2155776
13.90	49.4904	2155802
14.00	49.4932	2155924
14.10	49.4932	2155924

Comment:

Node: B-37

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.85 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.85	0.0006	25
5.90	0.0007	29
6.00	0.0008	37
6.10	0.0010	45
6.20	0.0013	56
6.29	0.0017	75
6.39	0.0069	300
6.49	0.0344	1500
6.59	0.0763	3325
6.69	0.1343	5849
6.79	0.2186	9524
6.89	0.3701	16123

Stage [ft]	Area [ac]	Area [ft2]
6.99	0.5601	24397
7.09	0.7902	34420
7.19	1.0438	45469
7.29	1.3003	56642
7.39	1.6073	70016
7.49	1.9763	86088
7.59	2.3671	103111
7.69	2.7866	121384
7.79	3.2250	140481
7.89	3.5860	156204
7.99	3.8884	169377
8.09	4.2040	183126
8.19	4.5248	197099
8.29	4.9224	214421
8.39	5.3040	231044
8.49	5.6725	247092
8.59	6.0380	263015
8.69	6.3559	276863
8.79	7.2511	315858
8.89	7.6287	332306
8.99	7.8163	340480
9.09	7.9305	345454
9.19	8.0011	348528
9.29	8.0700	351528
9.39	8.1251	353928
9.49	8.1405	354602
9.59	8.1405	354602

Comment:

Node: B-38

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.80	0.0006	25
1.90	0.0029	125
2.00	0.0098	425
2.10	0.0321	1400
2.20	0.0947	4124
2.30	0.1785	7774
2.40	0.2720	11848
2.50	0.3449	15023

Stage [ft]	Area [ac]	Area [ft2]
2.60	0.3977	17323
2.70	0.4350	18947
2.80	0.4717	20547
2.90	0.4987	21722
3.00	0.5342	23272
3.10	0.5566	24247
3.20	0.5710	24872
3.30	0.5830	25397
3.40	0.5899	25697
3.51	0.5962	25972
3.60	0.6043	26321
3.71	0.6134	26721
3.80	0.6249	27221
3.90	0.6352	27671
4.01	0.6450	28096
4.10	0.6513	28371
4.21	0.6589	28701
4.31	0.6657	28996
4.41	0.6720	29271
4.50	0.6777	29521
4.61	0.6834	29771
4.70	0.6903	30071
4.80	0.6995	30471
4.90	0.7093	30896
5.00	0.7185	31296
5.10	0.7299	31796
5.20	0.7403	32246
5.30	0.7546	32871
5.40	0.7684	33471
5.50	0.7810	34020
5.60	0.7948	34620
5.70	0.8114	35345
5.80	0.8349	36370
5.90	0.8631	37595
6.00	0.8929	38895
6.10	0.9216	40145
6.20	0.9468	41244
6.30	0.9761	42519
6.40	0.9996	43544
6.50	1.0410	45344
6.60	1.0897	47469
6.70	1.1563	50368
6.80	1.2447	54218
6.90	1.3646	59442
7.00	1.5339	66816
7.10	1.7623	76765
7.20	2.0320	88513
7.30	2.3637	102961
7.40	2.7126	118159

Stage [ft]	Area [ac]	Area [ft2]
7.50	3.1252	136132
7.60	3.6055	157054
7.70	4.1317	179976
7.80	4.6734	203573
7.90	5.2294	227795
8.00	5.7981	252566
8.10	6.3909	278388
8.20	7.0933	308984
8.30	7.8324	341179
8.40	8.5428	372125
8.50	9.2177	401521
8.60	9.9315	432617
8.70	10.7200	466963
8.80	11.6083	505657
8.90	12.5930	548552
9.00	13.6541	594771
9.10	14.8023	644789
9.20	15.9948	696732
9.30	17.2492	751375
9.40	18.3952	801293
9.50	19.6444	855711
9.60	20.9097	910828
9.70	22.2307	968371
9.80	23.4611	1021964
9.90	24.6426	1073432
10.00	25.7949	1123625
10.10	26.7589	1165619
10.20	27.4481	1195640
10.30	28.1006	1224062
10.40	28.7169	1250908
10.50	29.3860	1280054
10.60	29.8646	1300901
10.70	30.1641	1313950
10.80	30.3793	1323323
10.90	30.5469	1330622
11.00	30.6760	1336247
11.10	30.7845	1340971
11.20	30.8711	1344745
11.30	30.9285	1347245
11.40	30.9698	1349045
11.50	31.0042	1350545
11.60	31.0306	1351695
11.70	31.0479	1352444
11.80	31.0679	1353319
11.90	31.0817	1353919
12.00	31.0915	1354344
12.11	31.0986	1354657
12.20	31.1035	1354869
12.30	31.1075	1355044

Stage [ft]	Area [ac]	Area [ft2]
12.40	31.1093	1355119
12.51	31.1098	1355142
12.61	31.1104	1355169
12.71	31.1108	1355188
12.81	31.1118	1355230
12.91	31.1118	1355230

Comment:

Node: B-39

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.94 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.94	0.0006	25
4.00	0.0010	44
4.10	0.0015	64
4.20	0.0020	86
4.29	0.0046	200
4.39	0.0184	800
4.49	0.0425	1850
4.59	0.0780	3400
4.69	0.1228	5349
4.79	0.1699	7399
4.89	0.2422	10549
4.99	0.3225	14048
5.09	0.4155	18098
5.19	0.5417	23597
5.29	0.6714	29246
5.39	0.8045	35045
5.49	0.9388	40895
5.59	1.0656	46419
5.69	1.1689	50918
5.79	1.2670	55193
5.89	1.3755	59917
5.99	1.4478	63067
6.09	1.5230	66341
6.19	1.5804	68841
6.29	1.6332	71140
6.39	1.6883	73540
6.49	1.7393	75765
6.59	1.7841	77715
6.69	1.8329	79839

Stage [ft]	Area [ac]	Area [ft2]
6.79	1.8748	81664
6.89	1.9373	84389
6.99	2.0067	87413
7.09	2.0773	90488
7.19	2.1496	93637
7.29	2.2214	96762
7.39	2.2902	99762
7.49	2.3757	103486
7.59	2.4796	108011
7.69	2.5909	112860
7.79	2.6965	117459
7.89	2.8004	121984
7.99	2.9082	126683
8.09	3.0442	132607
8.19	3.1802	138532
8.29	3.3099	144181
8.39	3.4522	150380
8.49	3.5963	156654
8.59	3.7208	162078
8.69	3.8562	167978
8.79	4.0008	174277
8.89	4.1437	180501
8.99	4.2751	186225
9.09	4.3911	191274
9.19	4.4921	195674
9.29	4.5976	200273
9.39	4.7101	205173
9.49	4.8214	210022
9.59	4.9201	214321
9.69	5.0177	218571
9.79	5.1078	222495
9.89	5.1904	226095
9.99	5.2484	228619
10.09	5.3264	232019
10.19	5.3798	234344
10.29	5.4320	236618
10.39	5.4647	238043
10.49	5.4911	239193
10.59	5.5175	240343
10.69	5.5502	241768
10.79	5.5841	243243
10.89	5.6174	244692
10.99	5.6484	246042
11.09	5.6828	247542
11.19	5.7120	248817
11.29	5.7499	250467
11.39	5.7832	251916
11.49	5.8176	253416
11.59	5.8498	254816

Stage [ft]	Area [ac]	Area [ft2]
11.69	5.8808	256166
11.79	5.9089	257391
11.89	5.9433	258890
11.99	5.9777	260390
12.09	6.0116	261865
12.19	6.0455	263340
12.29	6.0741	264590
12.39	6.1046	265915
12.49	6.1344	267214
12.59	6.1671	268639
12.69	6.1998	270064
12.79	6.2331	271514
12.89	6.2647	272889
12.99	6.2974	274313
13.09	6.3255	275538
13.19	6.3593	277013
13.29	6.3915	278413
13.39	6.4196	279638
13.49	6.4558	281212
13.59	6.4908	282737
13.69	6.5229	284137
13.79	6.5567	285612
13.89	6.5889	287012
13.99	6.6296	288786
14.09	6.6623	290211
14.19	6.7128	292411
14.29	6.7570	294336
14.39	6.7909	295811
14.49	6.8259	297335
14.59	6.8683	299185
14.69	6.9102	301010
14.79	6.9366	302160
14.89	6.9693	303584
14.99	6.9940	304659
15.09	7.0204	305809
15.19	7.0480	307009
15.29	7.0703	307984
15.39	7.0841	308584
15.49	7.0884	308772
15.59	7.0884	308772

Comment:

Node: B-4

Scenario: Existing
Type: Stage/Area

Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.24	0.0006	25
2.30	0.0012	54
2.40	0.0016	68
2.50	0.0023	100
2.60	0.0036	158
2.70	0.0051	221
2.80	0.0065	284
2.90	0.0081	354
3.00	0.0098	425
3.10	0.0138	600
3.20	0.0218	950
3.30	0.0284	1237
3.40	0.0350	1525
3.50	0.0453	1975
3.60	0.0637	2775
3.70	0.1021	4449
3.80	0.1492	6499
3.90	0.2324	10124
4.00	0.3208	13973
4.10	0.4304	18747
4.20	0.5595	24372
4.30	0.7185	31296
4.40	0.8963	39045
4.50	1.0897	47469
4.59	1.2745	55518
4.69	1.5345	66841
4.79	1.8197	79264
4.89	2.1422	93313
4.99	2.4939	108636
5.09	2.9140	126933
5.19	3.4098	148530
5.29	4.0169	174977
5.39	4.6413	202173
5.49	5.4946	239343
5.59	6.2463	272089
5.69	7.1581	311808
5.79	8.1176	353603
5.89	8.9485	389798
5.99	9.7140	423143
6.09	10.5255	458489
6.19	11.3237	493259
6.29	12.1150	527730
6.39	12.9092	562325
6.49	13.7327	598195
6.59	14.6170	636715

Stage [ft]	Area [ac]	Area [ft2]
6.69	15.6309	680884
6.79	16.6753	726378
6.89	17.7869	774797
6.99	19.1291	833264
7.09	20.4145	889256
7.19	21.5536	938875
7.29	22.5722	983244
7.39	23.6034	1028163
7.49	24.5261	1068357
7.59	25.2457	1099703
7.69	25.9303	1129524
7.79	26.6235	1159720
7.89	27.3563	1191641
7.99	28.1379	1225686
8.09	28.8271	1255707
8.19	29.3940	1280404
8.29	30.0184	1307600
8.39	30.7093	1337696
8.49	31.3572	1365918
8.59	31.9826	1393164
8.69	32.6265	1421210
8.79	33.1774	1445207
8.89	33.6479	1465704
8.99	34.0835	1484677
9.09	34.4674	1501400
9.19	34.7887	1515398
9.29	35.0980	1528871
9.39	35.3746	1540919
9.49	35.5399	1548118
9.59	35.5735	1549582
9.69	35.5735	1549582

Comment:

Node: B-40

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.90 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.90	0.0006	25
4.01	0.0007	32
4.11	0.0009	39
4.21	0.0011	46

Stage [ft]	Area [ac]	Area [ft2]
4.30	0.0023	100
4.40	0.0109	475
4.50	0.0316	1375
4.60	0.0574	2500
4.70	0.1148	4999
4.80	0.1813	7899
4.90	0.2542	11074
5.00	0.3277	14273
5.10	0.4040	17598
5.20	0.4992	21747
5.30	0.6352	27671
5.40	0.8395	36570
5.50	1.2395	53993
5.60	1.8495	80564
5.70	2.6311	114610
5.80	3.3742	146980
5.90	4.0358	175802
6.00	4.6430	202248
6.10	5.2690	229519
6.20	5.9594	259590
6.30	6.6623	290211
6.40	7.3992	322307
6.50	8.3276	362752
6.60	9.5166	414545
6.70	10.8336	471912
6.80	12.3101	536228
6.90	13.8142	601745
7.00	15.1581	660287
7.10	16.2036	705831
7.20	17.0019	740601
7.30	17.5562	764748
7.40	17.9298	781021
7.50	18.1920	792444
7.60	18.4261	802643
7.70	18.6431	812092
7.80	18.8187	819741
7.90	18.9960	827464
8.00	19.1389	833689
8.10	19.2226	837338
8.20	19.3001	840713
8.30	19.3632	843462
8.40	19.4183	845862
8.50	19.4301	846373
8.60	19.4301	846373

Comment: This basin doesn't belong in this Town's model.

Node: B-5

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.66	0.0011	50
2.70	0.0029	125
2.80	0.0075	325
2.90	0.0115	500
3.00	0.0218	950
3.10	0.0379	1650
3.20	0.0511	2225
3.30	0.0620	2700
3.40	0.0717	3125
3.50	0.0809	3525
3.60	0.0901	3924
3.70	0.0998	4349
3.80	0.1165	5074
3.90	0.1380	6012
4.00	0.1561	6799
4.10	0.1871	8149
4.20	0.2192	9549
4.30	0.2611	11373
4.39	0.3214	13998
4.49	0.3954	17223
4.59	0.4786	20847
4.69	0.5767	25122
4.79	0.6748	29396
4.89	0.7976	34745
4.99	0.9371	40820
5.09	1.0524	45844
5.19	1.1815	51468
5.29	1.3319	58017
5.39	1.5052	65566
5.49	1.6888	73565
5.59	1.8989	82714
5.69	2.1358	93038
5.79	2.4365	106136
5.89	2.7717	120734
5.99	3.1780	138432
6.09	3.7386	162853
6.19	4.3916	191299
6.29	5.0475	219871
6.39	5.8171	253391
6.49	6.5103	283587
6.59	7.2006	313658
6.69	7.8783	343179

Stage [ft]	Area [ac]	Area [ft2]
6.79	8.5153	370925
6.89	9.1253	397497
6.99	9.7100	422969
7.09	10.2282	445541
7.19	10.7297	467388
7.29	11.2261	489010
7.39	11.7793	513106
7.49	12.4077	540478
7.59	13.0934	570349
7.69	13.8010	601170
7.79	14.7289	641589
7.89	15.4158	671510
7.99	15.9420	694432
8.09	16.3833	713655
8.19	16.7718	730577
8.29	17.1229	745875
8.39	17.3909	757549
8.49	17.6681	769622
8.59	17.9338	781196
8.69	18.2041	792969
8.79	18.4795	804967
8.89	18.7653	817416
8.99	19.0918	831639
9.09	19.3982	844987
9.19	19.6909	857735
9.29	19.9554	869259
9.39	20.1752	878833
9.49	20.3887	888131
9.59	20.6842	901005
9.69	21.1295	920402
9.79	21.4784	935600
9.89	21.6529	943199
9.99	21.7028	945374
10.09	21.7344	946749
10.19	21.7539	947598
10.29	21.7705	948323
10.39	21.7741	948481
10.49	21.7741	948481

Comment:

Node: B-6

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft

Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.28	0.0006	25
0.30	0.0007	29
0.40	0.0011	49
0.50	0.0016	69
0.60	0.0033	146
0.70	0.0046	200
0.80	0.0075	325
0.89	0.0132	575
1.00	0.0207	900
1.09	0.0310	1350
1.20	0.0511	2225
1.30	0.0683	2975
1.40	0.0844	3675
1.50	0.1044	4549
1.60	0.1182	5149
1.70	0.1337	5824
1.80	0.1526	6649
1.90	0.1796	7824
2.00	0.2158	9399
2.10	0.2611	11373
2.20	0.3294	14348
2.30	0.4155	18098
2.40	0.5239	22822
2.50	0.6347	27646
2.60	0.7712	33596
2.70	0.9164	39920
2.80	1.0576	46069
2.90	1.2171	53018
3.00	1.3692	59642
3.10	1.5482	67441
3.20	1.7410	75840
3.30	1.9436	84664
3.40	2.1622	94187
3.50	2.3820	103761
3.60	2.6093	113660
3.70	2.8325	123384
3.80	3.0649	133507
3.90	3.2864	143156
4.00	3.5326	153879
4.10	3.7994	165503
4.20	4.0336	175702
4.30	4.2912	186925
4.40	4.5615	198698
4.50	4.8432	210972
4.59	5.0602	220421
4.69	5.3230	231869
4.79	5.5508	241793

Stage [ft]	Area [ac]	Area [ft2]
4.89	5.7780	251691
4.99	6.0047	261565
5.09	6.2285	271314
5.19	6.4230	279788
5.29	6.6411	289286
5.39	6.8603	298835
5.49	7.0721	308059
5.59	7.2729	316808
5.69	7.5099	327131
5.79	7.7142	336030
5.89	7.9156	344804
5.99	8.1509	355053
6.09	8.4017	365976
6.19	8.6536	376950
6.29	8.9416	389498
6.39	9.2814	404296
6.49	9.6498	420344
6.59	10.0641	438391
6.69	10.4887	456889
6.79	10.9891	478686
6.89	11.5699	503983
6.99	12.2349	532954
7.09	13.0435	568174
7.19	13.7792	600220
7.29	14.5642	634415
7.39	15.3521	668736
7.49	16.1158	702006
7.59	16.8091	732202
7.69	17.5384	763973
7.79	18.3045	797344
7.89	19.1572	834489
7.99	20.0926	875233
8.09	21.0848	918452
8.19	22.0758	961622
8.29	23.1449	1008190
8.39	24.2059	1054409
8.49	25.3955	1106227
8.59	26.5277	1155546
8.69	27.5394	1199615
8.79	28.4925	1241134
8.89	29.4399	1282404
8.99	30.5073	1328898
9.09	31.7565	1383315
9.19	32.9708	1436208
9.29	34.0565	1483502
9.39	34.9821	1523822
9.49	35.8154	1560117
9.59	36.4678	1588538
9.69	36.9935	1611435

Stage [ft]	Area [ac]	Area [ft2]
9.79	37.4393	1630857
9.89	37.7968	1646430
9.99	38.1457	1661628
10.09	38.4711	1675801
10.19	38.7523	1688050
10.29	39.0111	1699323
10.39	39.2596	1710147
10.49	39.4966	1720470
10.59	39.7209	1730244
10.69	39.9356	1739593
10.79	40.1112	1747242
10.89	40.2741	1754341
10.99	40.4434	1761715
11.09	40.6379	1770189
11.19	40.8089	1777638
11.29	40.9868	1785387
11.39	41.1670	1793236
11.49	41.3082	1799385
11.59	41.4591	1805959
11.69	41.6204	1812983
11.79	41.7506	1818657
11.89	41.8992	1825131
11.99	42.0358	1831080
12.09	42.1621	1836580
12.19	42.2963	1842429
12.29	42.4151	1847603
12.39	42.5362	1852878
12.49	42.6504	1857852
12.59	42.7749	1863276
12.69	42.9023	1868825
12.79	43.0314	1874450
12.89	43.1560	1879874
12.99	43.2684	1884773
13.09	43.4039	1890673
13.19	43.5227	1895847
13.29	43.6443	1901146
13.39	43.7597	1906170
13.49	43.8836	1911570
13.59	44.0007	1916669
13.69	44.1103	1921443
13.79	44.2227	1926343
13.89	44.3467	1931742
13.99	44.4666	1936966
14.09	44.5923	1942441
14.19	44.7157	1947815
14.29	44.8413	1953289
14.39	44.9584	1958388
14.49	45.0893	1964088
14.59	45.2057	1969162

Stage [ft]	Area [ac]	Area [ft2]
14.69	45.3291	1974536
14.79	45.4370	1979236
14.89	45.5409	1983760
14.99	45.6264	1987485
15.09	45.7182	1991484
15.19	45.8111	1995534
15.29	45.9144	2000033
15.39	46.0189	2004582
15.49	46.1118	2008632
15.59	46.2060	2012731
15.69	46.3110	2017306
15.79	46.4022	2021280
15.89	46.5055	2025779
15.99	46.6008	2029929
16.09	46.7006	2034278
16.19	46.7982	2038528
16.29	46.9003	2042977
16.39	47.0099	2047752
16.49	47.1132	2052251
16.59	47.1993	2056000
16.69	47.3008	2060425
16.79	47.3823	2063974
16.89	47.4736	2067949
16.99	47.5677	2072048
17.09	47.6566	2075923
17.19	47.7364	2079397
17.29	47.8230	2083172
17.39	47.9028	2086646
17.49	47.9831	2090146
17.59	48.0635	2093645
17.69	48.1547	2097620
17.79	48.2356	2101144
17.89	48.3217	2104894
17.99	48.3969	2108168
18.09	48.4887	2112168
18.19	48.5736	2115867
18.29	48.6454	2118992
18.39	48.7326	2122792
18.49	48.8141	2126341
18.59	48.9053	2130316
18.69	49.0281	2135665
18.79	49.1303	2140114
18.89	49.2290	2144414
19.00	49.3179	2148288
19.10	49.3891	2151388
19.20	49.4539	2154212
19.30	49.5314	2157587
19.40	49.5997	2160561
19.50	49.6685	2163561

Stage [ft]	Area [ac]	Area [ft2]
19.60	49.7288	2166186
19.70	49.7976	2169185
19.80	49.8562	2171735
19.90	49.9176	2174410
20.00	49.9801	2177134
20.10	50.0484	2180109
20.20	50.1121	2182884
20.30	50.1712	2185458
20.40	50.2384	2188383
20.50	50.2917	2190707
20.60	50.3583	2193607
20.70	50.4237	2196457
20.80	50.4880	2199256
20.90	50.5459	2201781
21.00	50.6102	2204581
21.10	50.6739	2207355
21.20	50.7456	2210480
21.30	50.8099	2213279
21.40	50.8782	2216254
21.50	50.9362	2218779
21.60	51.0159	2222253
21.70	51.0664	2224453
21.80	51.1318	2227303
21.90	51.1972	2230152
22.00	51.2764	2233602
22.10	51.3442	2236551
22.20	51.4119	2239501
22.30	51.4813	2242526
22.40	51.5439	2245250
22.50	51.6064	2247975
22.60	51.6684	2250674
22.70	51.7464	2254074
22.80	51.8107	2256874
22.90	51.8738	2259623
23.00	51.9387	2262448
23.10	52.0001	2265123
23.20	52.0672	2268047
23.30	52.1366	2271072
23.40	52.2141	2274446
23.50	52.2824	2277421
23.60	52.3581	2280720
23.70	52.4304	2283870
23.80	52.4982	2286820
23.90	52.5751	2290169
24.00	52.6491	2293394
24.10	52.7139	2296218
24.20	52.7971	2299843
24.30	52.8660	2302842
24.40	52.9394	2306042

Stage [ft]	Area [ac]	Area [ft2]
24.50	53.0152	2309342
24.60	53.0915	2312666
24.70	53.1621	2315741
24.80	53.2413	2319190
24.90	53.3176	2322515
25.00	53.3847	2325439
25.10	53.4588	2328664
25.20	53.5362	2332039
25.30	53.6137	2335413
25.40	53.6963	2339013
25.50	53.7681	2342137
25.60	53.8444	2345462
25.70	53.9201	2348761
25.80	53.9930	2351936
25.90	54.0636	2355011
26.00	54.1371	2358210
26.10	54.2111	2361435
26.20	54.2891	2364834
26.30	54.3649	2368134
26.40	54.4429	2371533
26.50	54.5187	2374833
26.60	54.5933	2378082
26.70	54.6765	2381707
26.80	54.7666	2385631
26.90	54.8440	2389006
27.00	54.9301	2392756
27.10	55.0202	2396680
27.20	55.1069	2400454
27.30	55.1883	2404004
27.40	55.2744	2407753
27.50	55.3714	2411978
27.60	55.4649	2416052
27.70	55.5562	2420027
27.80	55.6509	2424151
27.90	55.7346	2427801
28.00	55.8242	2431700
28.10	55.9252	2436100
28.20	56.0376	2440999
28.30	56.1501	2445898
28.40	56.2362	2449648
28.50	56.3469	2454472
28.60	56.4451	2458747
28.70	56.5575	2463646
28.80	56.6683	2468470
28.90	56.7676	2472795
29.00	56.8892	2478094
29.10	56.9988	2482868
29.20	57.1119	2487793
29.30	57.2295	2492917

Stage [ft]	Area [ac]	Area [ft2]
29.40	57.3477	2498066
29.50	57.4699	2503391
29.60	57.5836	2508340
29.70	57.7006	2513439
29.80	57.8229	2518764
29.90	57.9439	2524038
30.00	58.0708	2529562
30.10	58.2033	2535336
30.20	58.3301	2540861
30.30	58.4598	2546510
30.40	58.6107	2553084
30.50	58.7479	2559058
30.60	58.8724	2564483
30.70	58.9906	2569632
30.80	59.1146	2575031
30.90	59.2093	2579156
31.00	59.3108	2583580
31.10	59.3935	2587180
31.20	59.4600	2590079
31.30	59.5409	2593604
31.40	59.5932	2595878
31.50	59.6477	2598253
31.60	59.6901	2600103
31.70	59.7452	2602502
31.80	59.7877	2604352
31.90	59.8325	2606302
32.00	59.8772	2608252
32.10	59.9203	2610126
32.20	59.9507	2611451
32.30	60.0006	2613626
32.40	60.0258	2614726
32.50	60.0597	2616201
32.60	60.0924	2617625
32.70	60.1211	2618875
32.80	60.1527	2620250
32.90	60.1681	2620921
33.00	60.1681	2620921

Comment:

Node: B-7

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.83	2.0400	88863
-1.80	2.0406	88888
-1.70	2.0423	88963
-1.60	3.4543	150467
-1.49	3.4660	150980
-1.40	4.9477	215521
-1.29	4.9603	216071
-1.19	4.9672	216371
-1.09	4.9747	216696
-0.99	4.9867	217221
-0.89	4.9970	217671
-0.79	5.0108	218271
-0.69	5.0240	218846
-0.59	5.0355	219346
-0.49	5.0464	219821
-0.39	5.0596	220396
-0.29	5.0688	220796
-0.19	5.0837	221445
-0.09	5.0963	221995
0.00	5.1152	222820
0.10	5.1342	223645
0.20	5.1566	224620
0.30	5.1778	225545
0.40	5.1939	226245
0.50	5.2082	226870
0.60	5.2243	227570
0.70	5.2398	228245
0.80	5.2576	229019
0.90	5.2754	229794
1.00	5.2937	230594
1.10	5.3075	231194
1.20	5.3207	231769
1.30	5.3402	232619
1.40	5.3695	233894
1.50	5.3844	234544
1.60	5.4010	235269
1.70	5.4343	236718
1.80	5.4630	237968
1.90	5.4957	239393
2.00	5.5227	240568
2.10	5.5462	241593
2.20	5.5726	242743
2.30	5.5984	243867
2.40	5.6420	245767
2.50	5.7138	248892
2.60	5.7947	252416
2.70	5.9066	257291
2.80	6.1057	265964

Stage [ft]	Area [ac]	Area [ft2]
2.90	6.3542	276788
3.00	6.6566	289961
3.10	7.0898	308834
3.20	7.6425	332906
3.30	8.2863	360952
3.40	8.9445	389623
3.50	9.6601	420794
3.60	10.3631	451415
3.70	11.1418	485335
3.80	11.9589	520930
3.90	12.9631	564675
4.00	14.0776	613218
4.10	15.2809	665636
4.20	16.7557	729878
4.30	18.5960	810042
4.40	20.3996	888606
4.50	22.2084	967396
4.60	23.9942	1045185
4.70	25.6480	1117226
4.80	27.2806	1188341
4.89	28.6205	1246709
4.99	30.4040	1324398
5.09	32.0498	1396089
5.19	33.7248	1469054
5.29	35.3368	1539269
5.39	36.7352	1600186
5.49	37.8577	1649080
5.59	38.5520	1679326
5.69	39.0231	1699848
5.79	39.4759	1719570
5.89	39.8483	1735793
5.99	40.1863	1750516
6.09	40.4778	1763215
6.19	40.7378	1774538
6.29	40.9381	1783262
6.39	41.0901	1789886
6.49	41.2147	1795310
6.59	41.3415	1800835
6.69	41.4671	1806309
6.79	41.5986	1812033
6.89	41.7449	1818407
6.99	41.8683	1823781
7.09	41.9905	1829106
7.19	42.1213	1834805
7.29	42.2556	1840654
7.39	42.3359	1844154
7.49	42.3956	1846753
7.59	42.4433	1848828
7.69	42.4811	1850478

Stage [ft]	Area [ac]	Area [ft2]
7.79	42.5167	1852028
7.89	42.5511	1853527
7.99	42.5879	1855127
8.09	42.5933	1855365
8.19	42.5933	1855365

Comment: Normal water levels at 2.00 NGVD or 0.5 NAVD

Node: B-8

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.67 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.67	0.0006	25
3.70	0.0013	58
3.80	0.0020	87
3.90	0.0025	108
4.00	0.0034	150
4.09	0.0046	200
4.20	0.0071	308
4.30	0.0098	425
4.39	0.0121	525
4.49	0.0189	825
4.60	0.0362	1575
4.69	0.0482	2100
4.79	0.0671	2925
4.89	0.0889	3874
4.99	0.1228	5349
5.09	0.1750	7624
5.19	0.2634	11473
5.29	0.3896	16973
5.39	0.5463	23797
5.49	0.7035	30646
5.59	0.8906	38795
5.69	1.1414	49718
5.79	1.4220	61942
5.89	1.7726	77215
5.99	2.1749	94737
6.09	2.5393	110610
6.19	2.8709	125058
6.29	3.2221	140356
6.39	3.5343	153954
6.49	3.8161	166228

Stage [ft]	Area [ac]	Area [ft2]
6.59	4.0416	176051
6.69	4.2321	184350
6.79	4.3836	190949
6.89	4.4961	195849
6.99	4.5621	198723
7.09	4.5965	200223
7.19	4.6200	201248
7.30	4.6281	201598
7.40	4.6328	201806
7.50	4.6361	201948
7.60	4.6381	202036
7.70	4.6392	202083
7.80	4.6433	202263
7.90	4.6433	202263

Comment:

Node: B-9

Scenario: Existing
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.33	0.0109	475
-1.30	0.0109	476
-1.20	0.0110	479
-1.10	0.0111	483
-1.00	0.0112	486
-0.90	0.0112	489
-0.80	0.0113	493
-0.70	0.0114	496
-0.60	0.0115	500
-0.50	0.0117	508
-0.40	0.0119	516
-0.30	0.0121	525
-0.20	0.0125	544
-0.10	0.0129	562
0.00	0.0133	578
0.10	0.0137	595
0.20	0.0145	629
0.30	0.0150	652
0.40	0.0153	668
0.50	0.0159	694
0.60	0.0169	737

Stage [ft]	Area [ac]	Area [ft2]
0.70	0.0177	770
0.80	0.0181	790
0.90	0.0191	830
1.00	0.0201	875
1.09	0.0207	900
1.20	0.0230	1002
1.30	0.0232	1010
1.40	0.0234	1018
1.50	0.0237	1031
1.60	0.0243	1060
1.70	0.0247	1075
1.80	0.0249	1085
1.90	0.0252	1096
2.00	0.0253	1104
2.10	0.0255	1110
2.20	0.0256	1116
2.30	0.0258	1122
2.40	0.0265	1156
2.50	0.0269	1172
2.60	0.0277	1206
2.70	0.0279	1217
2.80	0.0298	1300
2.90	0.0303	1321
3.00	0.0308	1341
3.10	0.0311	1354
3.20	0.0312	1360
3.30	0.0314	1367
3.40	0.0315	1373
3.50	0.0321	1400
3.60	0.0333	1450
3.70	0.0362	1575
3.80	0.0390	1700
3.90	0.0499	2175
4.00	0.0648	2825
4.10	0.0821	3575
4.20	0.1079	4699
4.30	0.1343	5849
4.40	0.1773	7724
4.50	0.2163	9424
4.59	0.2473	10774
4.69	0.2875	12523
4.79	0.3311	14423
4.89	0.3644	15873
4.99	0.3937	17148
5.09	0.4310	18772
5.19	0.4608	20072
5.29	0.5079	22122
5.39	0.5647	24597
5.49	0.6255	27246

Stage [ft]	Area [ac]	Area [ft2]
5.59	0.7317	31871
5.69	0.8436	36745
5.79	1.0455	45544
5.89	1.2510	54493
5.99	1.4117	61492
6.09	1.5281	66566
6.19	1.6343	71191
6.29	1.7095	74465
6.39	1.7560	76490
6.49	1.7910	78015
6.59	1.8243	79464
6.69	1.8478	80489
6.79	1.8673	81339
6.89	1.8845	82089
7.00	1.8977	82664
7.09	1.9098	83189
7.19	1.9230	83764
7.29	1.9367	84364
7.39	1.9539	85114
7.49	1.9654	85614
7.59	1.9662	85648
7.69	1.9662	85648

Comment:

Node: DISCHARGE TO GOLF COURSE

Scenario: Existing
Type: Time/Stage
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft
Boundary Stage:

Year	Month	Day	Hour	Stage [ft]
0	0	0	0.0000	0.00
0	0	0	10.0000	0.99
0	0	0	20.0000	1.79
0	0	0	30.0000	2.15
0	0	0	40.0000	2.55
0	0	0	50.0000	2.53
0	0	0	60.0000	3.22
0	0	0	64.0000	4.81
0	0	0	70.0000	4.50
0	0	0	80.0000	3.42
0	0	0	90.0000	2.71
0	0	0	96.0000	2.50

Comment: BASED ON PREVIOUS STUDY CONDUCTED FOR THE GOLF COURSE.
USED PREVIOUS DATA AS A BASIS FOR THE TAILWATER CONDITIONS FROM HH ICPR MODEL

Node: STORAGE 52ND ST

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.62	0.86	37462
4.23	1.72	74923

Comment: Approx. 1980 LF of 5'x5' Exfil running along SW 52nd St

1.72 ac-ft

Node: STORAGE ON SITE 19

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 2.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.66	0.11	4574
3.32	0.21	9148

Comment: SW 31ST ST DRAINAGE IMPROVEMENTS

https://dpep.broward.org/Enviros/Default.aspx?PossePresentation=SurfaceWaterLicense&PosseObjectId=33557971

0.21 AC-FT
TOP OF TRENCH: 3.32 NAVD

WT:2

BOT OF TRENCH: -0.93 NAVD

Node: STORAGE ON SITE 1

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.50	2.68	116741
4.00	4.34	189050
5.00	7.80	339768
6.00	11.37	495277
7.00	16.69	727016
8.00	25.49	1110344
9.00	37.78	1645697
10.00	53.55	2332638
11.00	71.07	3095809

Comment:

Node: STORAGE ON SITE 11

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.00	0.39	16988
3.50	0.78	33977

Comment: NEED MORE INFORMATION

Node: STORAGE ON SITE 12

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
9.20	0.04	1742
9.40	0.16	6970

Stage [ft]	Volume [ac-ft]	Volume [ft3]
9.60	0.36	15682
9.80	0.61	26572
10.00	0.93	40511
10.20	1.28	55757
10.40	1.64	71438
10.60	2.00	87120
10.80	2.36	102802

Comment:

Node: STORAGE ON SITE 13

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
4.00	0.00	0
5.00	0.09	3920
6.00	0.18	7841
7.00	0.27	11761
8.00	0.36	15682
9.00	0.49	21344
10.00	0.71	30928
11.00	1.65	71874
12.00	3.20	139392

Comment: K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2004 Apartment complex discharging to onsite retention\Calculations - Revised .pdf.pdf

Node: STORAGE ON SITE 14

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.00	0.27	11761
4.50	0.54	23522

Comment:

https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=77827255&hash=1DC8E684EBA90B369411BEA9A491E7D2E453F1F2

Node: STORAGE ON SITE 15

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 2.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.50	0.16	6970
3.00	0.33	14375
3.50	0.51	22216
4.00	0.71	30928
4.50	0.93	40511
5.00	1.16	50530
5.50	1.41	61420
6.00	1.67	72745
6.50	1.72	74923
7.00	1.72	74923

Comment: STORAGE IS USED BY MULTIPLE BASINS IN THE AREA

Node: STORAGE ON SITE 17

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.00	2.52	109858
4.50	5.04	219717

Comment: USING PERMIT FROM BROWARD THAT IS FOR MUCH LARGER AREA AND ASSUMING THAT STAGE STORAGE IS 1/5 OF THAT NUMBER FOR A ROUGH ESTIMATE
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=37159263&hash=D3675B834D18CCEC4310DCD6F0656AEC0FCED9C3

Node: STORAGE ON SITE 18

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
4.50	0.00	0
5.00	3.61	157252
5.50	7.54	328442
6.00	11.79	513572
6.50	16.36	712642
7.00	21.77	948301
7.50	28.52	1242331
8.00	36.61	1594732
8.50	46.04	2005502
9.00	57.37	2499037
9.50	70.64	3077078
10.00	85.34	3717410
10.50	101.47	4420033
11.00	119.03	5184947
11.50	138.02	6012151

Comment: NEEDS MORE INFORMATION

Node: STORAGE ON SITE 2

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.50	0.02	871
4.50	0.04	1742

Comment:

Node: STORAGE ON SITE 3

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft

Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
5.00	0.00	0
5.50	0.00	0
6.00	8.92	388555
6.50	18.58	809345
7.00	28.99	1262804
7.50	40.15	1748934
8.00	52.05	2267298
8.50	64.70	2818332
9.00	77.72	3385483
9.50	90.74	3952634
10.00	103.75	4519350

Comment:

Node: STORAGE ON SITE 4

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.50	7.00	304920
3.00	14.00	609840
3.50	21.00	914760
4.00	28.00	1219680
4.50	35.00	1524600
5.00	42.00	1829520
5.50	49.00	2134440
6.00	56.00	2439360
6.50	63.00	2744280
7.00	70.00	3049200
7.50	78.31	3411184
8.00	90.57	3945229
8.50	108.08	4707965
9.00	130.85	5699826
9.50	158.87	6920377
10.00	191.51	8342176

Comment:

Node: STORAGE ON SITE 5

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.16	6970
4.00	0.32	13939
4.50	0.48	20909
5.00	0.64	27878
5.50	0.79	34412
6.00	0.95	41382
6.50	1.11	48352
7.00	1.22	53143
7.50	1.49	64904
8.00	1.86	81022
8.50	2.33	101495
9.00	2.89	125888
9.50	3.56	155074
10.00	4.32	188179
10.50	5.37	233917
11.00	6.88	299693
11.50	8.86	385942
12.00	11.19	487436

Comment:

Node: STORAGE ON SITE 6

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.63	0.36	15464
5.75	0.71	30928

Comment:
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=72592592&hash=BAF6E372B1EA46D84A6355CC91B4A7800C3A1DDA

Node: STORAGE ON SITE 8

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
6.00	0.27	11761
7.00	0.53	23087
8.00	0.66	28750

Comment:

Node: STORAGE ON SITE 9

Scenario: Existing
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.01	436
3.75	0.02	871
4.00	0.03	1307
4.25	0.06	2614
4.50	0.07	3049
4.75	0.10	4356
5.00	0.13	5663
5.25	0.16	6970
5.50	0.20	8712
5.75	0.24	10454
6.00	0.28	12197
6.25	0.33	14375
6.50	0.38	16553
6.75	0.44	19166
7.00	0.50	21780
7.25	0.59	25700
7.50	0.72	31363
7.75	0.90	39204
8.00	1.13	49223
8.25	1.40	60984
8.50	1.73	75359
8.75	2.12	92347
9.00	2.63	114563
9.25	3.23	140699
9.50	3.94	171626

Stage [ft]	Volume [ac-ft]	Volume [ft3]
9.75	4.75	206910
10.00	5.66	246550

Comment: RECREATION GREEN AREA USED AS A STORAGE SITE

Node: B-1

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.60 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.60	0.0006	25
3.70	0.0024	104
3.80	0.0031	137
3.90	0.0042	183
4.00	0.0058	254
4.10	0.0075	325
4.20	0.0115	500
4.30	0.0172	750
4.40	0.0316	1375
4.50	0.0545	2375
4.60	0.1354	5899
4.70	0.3018	13148
4.80	0.4883	21272
4.90	0.7213	31421
5.00	0.9899	43119
5.10	1.2516	54518
5.20	1.5149	65991
5.30	1.8042	78590
5.40	2.0871	90913
5.50	2.3987	104486
5.60	2.7533	119934
5.70	3.1527	137332
5.80	3.6445	158754
5.90	4.0726	177401
6.00	4.4542	194024
6.10	4.8387	210772
6.20	5.2306	227845
6.30	5.6145	244567
6.40	6.1080	266064
6.50	6.6537	289836
6.60	7.2936	317708
6.70	8.0069	348778
6.80	8.7649	381799

Stage [ft]	Area [ac]	Area [ft2]
6.90	9.5631	416569
7.00	10.3171	449415
7.10	11.1240	484560
7.20	11.9618	521055
7.30	12.7353	554751
7.40	13.5094	588471
7.50	14.1877	618017
7.60	14.7673	643264
7.70	15.2947	666236
7.80	15.8226	689233
7.90	16.3861	713780
8.00	16.9628	738901
8.10	17.5223	763273
8.20	18.0818	787645
8.30	18.6580	812741
8.40	19.2341	837838
8.50	19.7890	862010
8.60	20.3325	885682
8.70	20.7846	905379
8.80	21.1571	921602
8.90	21.3705	930901
9.00	21.5157	937225
9.10	21.5978	940801
9.20	21.5978	940801

Comment:

Node: B-10

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.33	0.0184	800
-1.30	0.0196	852
-1.20	0.0203	883
-1.10	0.0224	975
-1.00	0.0230	1000
-0.90	0.0249	1083
-0.80	0.0266	1158
-0.70	0.0277	1207
-0.60	0.0285	1244
-0.50	0.0302	1315
-0.40	0.0311	1355

Stage [ft]	Area [ac]	Area [ft2]
-0.30	0.0326	1420
-0.20	0.0359	1565
-0.10	0.0413	1800
0.00	0.0494	2150
0.09	0.0545	2375
0.20	0.0625	2725
0.30	0.0660	2875
0.40	0.0708	3083
0.50	0.0729	3175
0.60	0.0760	3312
0.70	0.0792	3450
0.80	0.0834	3633
0.90	0.0867	3775
0.99	0.0895	3899
1.09	0.0941	4099
1.20	0.1012	4408
1.30	0.1062	4624
1.40	0.1106	4816
1.50	0.1159	5049
1.60	0.1217	5299
1.70	0.1261	5493
1.80	0.1314	5724
1.90	0.1343	5849
2.00	0.1400	6099
2.10	0.1458	6349
2.20	0.1538	6699
2.30	0.1618	7049
2.40	0.1681	7324
2.50	0.1762	7674
2.60	0.1854	8074
2.70	0.1917	8349
2.80	0.2014	8774
2.90	0.2129	9274
3.00	0.2196	9565
3.10	0.2304	10036
3.20	0.2381	10374
3.30	0.2479	10799
3.40	0.2663	11598
3.50	0.2863	12473
3.60	0.3162	13773
3.70	0.3483	15173
3.80	0.3954	17223
3.90	0.4470	19472
4.00	0.5050	21997
4.10	0.5779	25172
4.20	0.7282	31721
4.30	0.9486	41319
4.40	1.2716	55393
4.50	1.6590	72265

Stage [ft]	Area [ac]	Area [ft2]
4.59	2.0549	89513
4.69	2.5243	109960
4.79	3.0511	132907
4.89	3.6772	160179
4.99	4.4163	192374
5.09	5.2897	230419
5.19	6.4810	282312
5.29	8.2025	357302
5.39	10.4847	456714
5.49	13.2650	577823
5.59	16.6685	726078
5.69	20.1775	878933
5.79	23.9161	1041786
5.89	27.6937	1206339
5.99	31.1075	1355044
6.09	33.9590	1479252
6.19	36.3571	1583714
6.29	38.2680	1666952
6.39	39.9046	1738243
6.49	41.5337	1809208
6.59	43.1399	1879174
6.69	44.8040	1951664
6.79	46.2932	2016531
6.89	47.7347	2079322
6.99	49.1067	2139089
7.09	50.4145	2196057
7.19	51.7722	2255199
7.29	53.1483	2315141
7.39	54.5313	2375383
7.49	55.9372	2436625
7.59	57.3443	2497916
7.69	58.8093	2561733
7.79	60.2996	2626649
7.89	61.8369	2693615
7.99	63.3283	2758582
8.09	64.9689	2830047
8.19	66.5579	2899263
8.29	68.0063	2962354
8.39	69.3657	3021572
8.49	70.6494	3077489
8.59	71.7633	3126008
8.69	72.7376	3168452
8.79	73.6638	3208797
8.89	74.5108	3245692
8.99	75.3630	3282812
9.09	76.1153	3315582
9.19	76.8624	3348128
9.29	77.6216	3381199
9.39	78.3263	3411894

Stage [ft]	Area [ac]	Area [ft2]
9.49	79.0918	3445240
9.59	79.8315	3477461
9.69	80.5442	3508506
9.79	81.2965	3541277
9.89	82.0563	3574373
9.99	82.8276	3607968
10.09	83.6843	3645288
10.19	84.6484	3687283
10.29	85.9659	3744675
10.39	87.2536	3800767
10.49	87.7689	3823214
10.59	88.0260	3834413
10.69	88.2165	3842712
10.79	88.3634	3849111
10.89	88.5121	3855585
10.99	88.6383	3861084
11.09	88.8173	3868883
11.19	88.9614	3875158
11.29	89.0526	3879132
11.39	89.1548	3883581
11.49	89.2558	3887981
11.59	89.3459	3891905
11.69	89.4268	3895430
11.79	89.5025	3898729
11.89	89.5559	3901054
11.99	89.5903	3902554
12.09	89.6127	3903529
12.19	89.6270	3904154
12.29	89.6385	3904654
12.39	89.6431	3904854
12.50	89.6444	3904910
12.60	89.6457	3904969
12.70	89.6484	3905083
12.80	89.6488	3905104
12.90	89.6530	3905286
13.00	89.6543	3905343
13.09	89.6569	3905453
13.20	89.6589	3905540
13.29	89.6597	3905578
13.40	89.6602	3905600
13.50	89.6615	3905653
13.60	89.6619	3905671
13.70	89.6625	3905697
13.80	89.6635	3905741
13.90	89.6651	3905813
14.00	89.6663	3905863
14.09	89.6672	3905903
14.20	89.6680	3905937
14.29	89.6689	3905978

Stage [ft]	Area [ac]	Area [ft2]
14.40	89.6706	3906053
14.49	89.6729	3906153
14.60	89.6741	3906203
14.70	89.6759	3906284
14.80	89.6763	3906298
14.90	89.6774	3906347
15.00	89.6779	3906367
15.10	89.6785	3906397
15.20	89.6796	3906444
15.30	89.6816	3906531
15.40	89.6820	3906546
15.50	89.6824	3906566
15.60	89.6831	3906596
15.70	89.6838	3906628
15.80	89.6848	3906669
15.90	89.6861	3906728
16.00	89.6872	3906773
16.10	89.6883	3906823
16.20	89.6894	3906871
16.30	89.6903	3906908
16.39	89.6907	3906928
16.50	89.6909	3906937
16.60	89.6911	3906945
16.70	89.6913	3906953
16.80	89.6916	3906965
16.90	89.6918	3906976
17.00	89.6924	3907001
17.10	89.6927	3907012
17.20	89.6929	3907022
17.30	89.6934	3907043
17.40	89.6942	3907080
17.50	89.6942	3907080

Comment:

Node: B-11

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.58	19.8875	866300
4.00	23.2501	1012775
4.50	25.9642	1131002

Stage [ft]	Area [ac]	Area [ft2]
5.00	41.6244	1813161
5.50	53.9220	2348844
6.00	58.6297	2553910
6.50	61.0130	2657725
7.00	61.0130	2657725

Comment:

Node: B-12

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.58	5.3562	233315
4.00	19.3591	843282
4.50	25.7000	1119494
5.00	29.3028	1276432
5.50	31.4405	1369549
6.00	33.8904	1476267
6.50	34.3276	1495309
7.00	34.4913	1502439
7.50	34.4913	1502439

Comment:

Node: B-13

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.66 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.66	0.0006	25
5.70	0.0008	33
5.80	0.0012	52
5.90	0.0017	76
6.00	0.0020	86
6.10	0.0022	95
6.20	0.0027	116
6.30	0.0030	130

Stage [ft]	Area [ac]	Area [ft2]
6.40	0.0032	138
6.50	0.0034	146
6.60	0.0038	166
6.69	0.0046	200
6.80	0.0054	233
6.89	0.0063	275
6.99	0.0069	300
7.10	0.0071	311
7.20	0.0074	321
7.30	0.0083	362
7.40	0.0090	393
7.50	0.0096	417
7.59	0.0109	475
7.70	0.0113	491
7.80	0.0119	520
7.90	0.0141	615
8.00	0.0149	650
8.10	0.0160	697
8.20	0.0189	825
8.29	0.0252	1100
8.39	0.0367	1600
8.49	0.0625	2725
8.59	0.1010	4399
8.69	0.1475	6424
8.79	0.1865	8124
8.89	0.2416	10524
8.99	0.2772	12073
9.09	0.3127	13623
9.19	0.3558	15498
9.29	0.3954	17223
9.39	0.4292	18698
9.49	0.4654	20272
9.59	0.5182	22572
9.69	0.5802	25272
9.79	0.6611	28796
9.89	0.7420	32321
9.99	0.8315	36220
10.09	0.9342	40695
10.19	1.0530	45869
10.29	1.2108	52743
10.39	1.3394	58342
10.49	1.4794	64441
10.59	1.6400	71440
10.69	1.8036	78565
10.79	1.9901	86688
10.89	2.2018	95912
10.99	2.4211	105461
11.09	2.6948	117384
11.19	2.9955	130483

Stage [ft]	Area [ac]	Area [ft2]
11.29	3.2617	142081
11.39	3.5435	154354
11.49	3.7713	164278
11.59	3.9383	171552
11.69	4.0617	176926
11.79	4.1650	181426
11.89	4.2533	185275
11.99	4.3239	188350
12.09	4.3911	191274
12.19	4.4484	193774
12.29	4.4840	195324
12.39	4.5173	196774
12.49	4.5305	197349
12.59	4.5437	197924
12.69	4.5489	198149
12.80	4.5525	198306
12.90	4.5540	198374
13.00	4.5540	198374

Comment:

Node: B-14

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.21	0.7816	34045
-0.20	0.7822	34070
-0.10	0.7896	34395
0.00	0.7936	34570
0.10	0.7997	34837
0.20	0.8019	34931
0.30	0.8078	35187
0.40	0.8120	35370
0.50	0.8160	35545
0.60	0.8200	35720
0.70	0.8223	35820
0.80	0.8292	36120
0.89	0.8326	36270
1.00	0.8362	36425
1.09	0.8401	36595
1.20	0.8481	36945
1.30	0.8530	37158

Stage [ft]	Area [ac]	Area [ft2]
1.40	0.8585	37395
1.50	0.8648	37670
1.60	0.8699	37895
1.70	0.8763	38170
1.80	0.8814	38395
1.90	0.8875	38657
2.00	0.8921	38861
2.10	0.8986	39145
2.20	0.9035	39355
2.30	0.9061	39470
2.40	0.9136	39795
2.50	0.9191	40036
2.60	0.9241	40253
2.70	0.9308	40545
2.80	0.9411	40995
2.90	0.9514	41444
3.00	0.9576	41714
3.10	0.9623	41919
3.20	0.9709	42294
3.30	0.9801	42694
3.40	0.9859	42944
3.50	0.9933	43269
3.60	0.9996	43544
3.70	1.0024	43663
3.80	1.0074	43882
3.90	1.0137	44157
4.00	1.0220	44519
4.10	1.0358	45119
4.20	1.0530	45869
4.30	1.0714	46669
4.40	1.0915	47544
4.50	1.1133	48494
4.59	1.1420	49743
4.69	1.1810	51443
4.79	1.2275	53468
4.89	1.2923	56293
4.99	1.3669	59542
5.09	1.4581	63517
5.19	1.5574	67841
5.29	1.6636	72465
5.39	1.7887	77915
5.49	1.9379	84414
5.59	2.1095	91888
5.69	2.3040	100362
5.79	2.5163	109610
5.89	2.7659	120484
5.99	3.0483	132782
6.09	3.3065	144031
6.19	3.5969	156679

Stage [ft]	Area [ac]	Area [ft2]
6.29	3.8614	168203
6.39	4.1007	178626
6.49	4.3383	188975
6.59	4.5730	199198
6.69	4.8094	209497
6.79	5.0734	220995
6.89	5.3763	234194
6.99	5.6679	246892
7.09	6.0225	262340
7.19	6.3203	275313
7.29	6.6118	288012
7.39	6.9051	300785
7.49	7.2058	313883
7.59	7.5065	326981
7.69	7.7991	339730
7.79	8.1159	353528
7.89	8.4309	367251
7.99	8.7615	381649
8.09	9.0931	396097
8.19	9.3519	407371
8.29	9.6194	419019
8.39	9.8581	429418
8.49	10.1186	440766
8.59	10.4313	454389
8.69	10.6712	464838
8.79	10.8371	472062
8.89	10.9530	477111
8.99	11.0637	481936
9.09	11.1716	486635
9.19	11.2984	492159
9.29	11.4367	498183
9.39	11.5475	503008
9.49	11.6152	505957
9.59	11.6927	509332
9.69	11.7598	512257
9.79	11.8332	515456
9.89	11.8860	517756
9.99	11.9406	520131
10.09	11.9945	522480
10.19	12.0318	524105
10.29	12.0593	525305
10.39	12.0731	525905
10.50	12.0770	526074
10.60	12.0792	526169
10.70	12.0792	526169

Comment:

Node: B-15

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.87	0.0006	25
1.90	0.0006	28
2.00	0.0009	39
2.10	0.0011	49
2.20	0.0021	90
2.30	0.0025	110
2.40	0.0031	135
2.50	0.0039	172
2.60	0.0062	271
2.70	0.0092	400
2.80	0.0207	900
2.90	0.0304	1325
3.00	0.0574	2500
3.10	0.1211	5274
3.20	0.1767	7699
3.30	0.2416	10524
3.40	0.3300	14373
3.50	0.4361	18997
3.60	0.5601	24397
3.70	0.6886	29996
3.80	0.8206	35745
3.90	0.9859	42944
4.00	1.1431	49793
4.10	1.3256	57742
4.20	1.5706	68416
4.30	1.8375	80039
4.40	2.1663	94362
4.50	2.4635	107311
4.59	2.7470	119659
4.69	3.1229	136032
4.79	3.5355	154004
4.89	3.9985	174177
4.99	4.5994	200348
5.09	5.2036	226670
5.19	5.8567	255116
5.29	6.5229	284137
5.39	7.1381	310934
5.49	7.7125	335955
5.59	8.1911	356802
5.69	8.6519	376875
5.79	9.0679	394997
5.89	9.4656	412320

Stage [ft]	Area [ac]	Area [ft2]
5.99	9.7927	426568
6.09	10.0469	437642
6.19	10.2500	446490
6.29	10.4319	454414
6.39	10.6259	462863
6.49	10.7952	470237
6.59	10.9610	477461
6.69	11.1263	484660
6.79	11.2904	491809
6.89	11.4643	499383
6.99	11.6158	505982
7.09	11.7638	512432
7.19	11.8975	518256
7.29	12.0381	524380
7.39	12.1385	528754
7.49	12.2252	532529
7.59	12.2940	535528
7.69	12.3474	537853
7.79	12.3910	539753
7.89	12.4323	541553
7.99	12.4708	543227
8.09	12.4995	544477
8.19	12.5236	545527
8.29	12.5465	546527
8.39	12.5683	547477
8.49	12.5781	547902
8.59	12.5884	548352
8.69	12.5924	548527
8.80	12.5976	548752
8.89	12.6022	548952
9.00	12.6051	549077
9.10	12.6062	549127
9.20	12.6068	549152
9.30	12.6139	549462
9.40	12.6139	549462

Comment:

Node: B-16

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.28	2.2426	97687
-0.20	2.2489	97962
-0.10	2.2564	98287
0.00	2.2638	98612
0.10	2.2741	99062
0.20	2.2799	99312
0.30	2.2856	99562
0.40	2.2931	99887
0.50	2.3009	100228
0.60	2.3109	100662
0.70	2.3180	100974
0.80	2.3252	101286
0.89	2.3350	101711
0.99	2.3419	102011
1.09	2.3499	102361
1.20	2.3614	102861
1.30	2.3717	103311
1.40	2.3780	103586
1.50	2.3901	104111
1.60	2.4021	104636
1.70	2.4159	105236
1.80	2.4291	105811
1.90	2.4492	106686
2.00	2.4675	107486
2.10	2.4847	108236
2.20	2.5134	109485
2.30	2.5519	111160
2.40	2.5944	113010
2.50	2.6420	115085
2.60	2.7051	117834
2.70	2.7831	121234
2.80	2.8732	125158
2.90	2.9381	127983
3.00	3.0356	132232
3.10	3.1412	136832
3.20	3.2359	140956
3.30	3.3363	145331
3.40	3.4505	150305
3.50	3.5619	155154
3.60	3.7088	161553
3.70	3.8723	168677
3.80	4.0777	177626
3.90	4.3394	189025
4.00	4.7072	205048
4.10	5.1520	224420
4.20	5.7235	249317
4.30	6.5034	283287
4.40	7.4577	324857
4.50	8.5227	371250

Stage [ft]	Area [ac]	Area [ft2]
4.59	9.3824	408695
4.69	10.2213	445241
4.79	10.8979	474712
4.89	11.4052	496809
4.99	11.8028	514131
5.09	12.1644	529879
5.19	12.5253	545602
5.29	12.9264	563075
5.39	13.2874	578798
5.49	13.5737	591271
5.59	13.7493	598920
5.69	13.8847	604819
5.79	14.0047	610044
5.89	14.1177	614968
5.99	14.2365	620142
6.09	14.3507	625117
6.19	14.4729	630441
6.29	14.6112	636465
6.39	14.7771	643689
6.49	14.9102	649488
6.59	15.0296	654688
6.69	15.1334	659212
6.79	15.1839	661412
6.89	15.2097	662537
6.99	15.2402	663861
7.09	15.2826	665711
7.19	15.3166	667189
7.29	15.3166	667189

Comment: Normal water levels at 2.00 NGVD or 0.5 NAVD

Node: B-17

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.73	0.0006	25
2.80	0.0016	69
2.90	0.0063	275
3.00	0.0212	925
3.10	0.0620	2700
3.20	0.1211	5274
3.30	0.2416	10524

Stage [ft]	Area [ac]	Area [ft2]
3.40	0.4310	18772
3.50	0.6295	27421
3.60	0.8757	38145
3.70	1.1661	50793
3.80	1.4547	63367
3.90	1.7370	75665
4.00	2.0165	87838
4.10	2.3080	100537
4.20	2.5886	112760
4.30	2.8583	124508
4.39	3.0632	133432
4.49	3.2675	142331
4.59	3.5056	152705
4.69	3.8086	165903
4.79	4.1300	179901
4.89	4.4989	195974
4.99	4.9345	214946
5.09	5.4693	238243
5.19	6.0179	262140
5.29	6.6480	289586
5.39	7.2786	317058
5.49	7.7963	339605
5.59	8.2461	359202
5.69	8.5985	374550
5.79	8.9606	390323
5.89	9.2860	404496
5.99	9.5689	416819
6.09	9.8150	427543
6.19	10.0802	439091
6.29	10.3418	450490
6.39	10.5995	461713
6.49	10.8675	473387
6.59	11.1532	485835
6.69	11.4247	497659
6.79	11.7225	510632
6.89	11.9796	521830
6.99	12.2177	532204
7.09	12.4025	540253
7.19	12.5477	546577
7.29	12.6762	552176
7.39	12.7910	557176
7.49	12.8885	561425
7.59	12.9586	564475
7.69	13.0171	567024
7.79	13.0727	569449
7.89	13.1152	571299
7.99	13.1428	572499
8.09	13.1500	572814
8.19	13.1500	572814

Comment:

Node: B-18

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.46	0.0006	25
1.50	0.0007	31
1.60	0.0011	47
1.70	0.0016	70
1.80	0.0022	95
1.90	0.0032	141
2.00	0.0060	262
2.10	0.0086	375
2.20	0.0143	625
2.30	0.0186	808
2.40	0.0281	1225
2.50	0.0482	2100
2.60	0.0712	3100
2.70	0.1010	4399
2.80	0.1274	5549
2.90	0.1526	6649
3.00	0.1848	8049
3.10	0.2221	9674
3.20	0.2571	11198
3.30	0.3007	13098
3.40	0.3437	14973
3.50	0.3879	16898
3.60	0.4344	18922
3.70	0.4763	20747
3.80	0.5348	23297
3.90	0.6048	26346
4.00	0.6955	30296
4.10	0.8298	36145
4.20	1.0157	44244
4.30	1.2584	54818
4.40	1.5322	66741
4.50	1.7904	77990
4.59	2.0079	87463
4.69	2.2139	96437
4.79	2.4583	107086
4.89	2.7034	117759

Stage [ft]	Area [ac]	Area [ft2]
4.99	2.9937	130408
5.09	3.3294	145031
5.19	3.6709	159904
5.29	4.0967	178451
5.39	4.5621	198723
5.49	5.1107	222620
5.59	5.4825	238818
5.69	5.7671	251216
5.79	5.9605	259640
5.89	6.1178	266489
5.99	6.2601	272689
6.09	6.4271	279963
6.19	6.5240	284187
6.29	6.6199	288361
6.39	6.7163	292561
6.49	6.8414	298010
6.59	7.1174	310034
6.69	7.2867	317408
6.79	7.3848	321682
6.89	7.4554	324757
6.99	7.5340	328181
7.09	7.6103	331506
7.19	7.6861	334805
7.29	7.7590	337980
7.39	7.8238	340805
7.49	7.8927	343804
7.59	7.9696	347154
7.69	8.0464	350503
7.79	8.1268	354003
7.89	8.2232	358202
7.99	8.2995	361527
8.09	8.3632	364301
8.19	8.4367	367501
8.29	8.5107	370725
8.39	8.6140	375225
8.49	8.7155	379649
8.59	8.7959	383149
8.69	8.8797	386798
8.79	8.9612	390348
8.89	9.0415	393847
8.99	9.1195	397247
9.09	9.1964	400596
9.19	9.2785	404171
9.29	9.3606	407746
9.39	9.4386	411145
9.49	9.5252	414920
9.59	9.6234	419194
9.69	9.7169	423268
9.79	9.8162	427593

Stage [ft]	Area [ac]	Area [ft2]
9.89	9.8977	431142
9.99	9.9780	434642
10.09	10.0515	437842
10.19	10.1393	441666
10.29	10.2265	445466
10.39	10.3315	450040
10.49	10.4422	454864
10.59	10.5519	459639
10.69	10.6563	464188
10.79	10.7447	468038
10.89	10.8204	471337
10.99	10.8853	474162
11.09	10.9501	476986
11.19	11.0333	480611
11.29	11.1372	485135
11.39	11.2255	488985
11.49	11.2944	491984
11.59	11.3661	495109
11.69	11.4350	498108
11.79	11.4884	500433
11.89	11.5257	502058
11.99	11.5589	503508
12.09	11.5968	505158
12.19	11.6427	507157
12.29	11.6760	508607
12.39	11.7179	510432
12.49	11.7451	511618
12.59	11.7451	511618

Comment:

Node: B-19

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.20	0.4700	20472
0.30	1.2092	52673
0.40	1.3999	60979
0.50	1.4094	61392
0.60	1.4208	61892
0.70	1.4306	62317
0.80	1.4426	62842

Stage [ft]	Area [ac]	Area [ft2]
0.90	1.4593	63566
1.00	1.4756	64279
1.10	1.4845	64666
1.20	1.4926	65016
1.30	1.5055	65579
1.40	1.5132	65916
1.50	1.5270	66516
1.60	1.5385	67016
1.70	1.5482	67441
1.80	1.5577	67853
1.90	1.5741	68566
2.00	1.5878	69166
2.10	1.6016	69766
2.20	1.6154	70366
2.30	1.6309	71041
2.40	1.6458	71690
2.50	1.6607	72340
2.60	1.6785	73115
2.70	1.7049	74265
2.80	1.7296	75340
2.90	1.7623	76765
3.00	1.8105	78864
3.10	1.8857	82139
3.20	1.9689	85764
3.30	2.0567	89588
3.40	2.1869	95262
3.50	2.3103	100637
3.60	2.4698	107586
3.70	2.6339	114735
3.80	2.8359	123534
3.90	3.0683	133657
4.00	3.3834	147380
4.10	3.7300	162478
4.20	4.1942	182701
4.30	4.7859	208472
4.40	5.5927	243617
4.50	6.6049	287712
4.60	7.7096	335830
4.70	8.9640	390473
4.80	10.2730	447490
4.90	11.6674	508232
5.00	13.2093	575398
5.10	14.8126	645239
5.20	16.5416	720554
5.30	18.2936	796869
5.40	19.9640	869634
5.50	21.4497	934350
5.60	22.7822	992393
5.70	23.8977	1040986

Stage [ft]	Area [ac]	Area [ft2]
5.80	24.9031	1084780
5.90	25.8305	1125175
6.00	26.5960	1158520
6.10	27.3006	1189216
6.20	27.9571	1217812
6.30	28.5694	1244484
6.40	29.1783	1271005
6.50	29.7458	1295727
6.60	30.3575	1322373
6.70	30.9555	1348420
6.80	31.6424	1378341
6.90	32.3166	1407712
7.00	33.0242	1438533
7.10	33.7392	1469679
7.20	34.3997	1498450
7.30	35.0607	1527246
7.40	35.7287	1556342
7.50	36.3863	1584988
7.60	37.0003	1611735
7.70	37.5868	1637281
7.80	38.1670	1662553
7.90	38.7448	1687725
8.00	39.2825	1711147
8.10	39.7617	1732019
8.20	40.1817	1750316
8.30	40.5869	1767964
8.40	40.9828	1785212
8.50	41.3753	1802309
8.60	41.8350	1822332
8.70	42.3377	1844229
8.80	42.7778	1863401
8.90	43.1749	1880699
9.00	43.4899	1894422
9.10	43.7413	1905371
9.20	43.9381	1913944
9.30	44.1212	1921918
9.40	44.3134	1930292
9.50	44.4942	1938166
9.60	44.6583	1945315
9.70	44.8253	1952589
9.80	44.9664	1958738
9.90	45.0893	1964088
10.00	45.1989	1968862
10.10	45.3033	1973411
10.20	45.3756	1976561
10.30	45.4502	1979811
10.40	45.5334	1983435
10.50	45.6201	1987210
10.60	45.7136	1991284

Stage [ft]	Area [ac]	Area [ft2]
10.70	45.7985	1994984
10.80	45.8892	1998933
10.90	45.9603	2002033
11.00	46.0464	2005782
11.10	46.1623	2010831
11.20	46.2513	2014706
11.30	46.3316	2018205
11.40	46.4183	2021980
11.50	46.5032	2025680
11.60	46.5835	2029179
11.70	46.5865	2029310
11.80	46.5865	2029310

Comment:

Node: B-2

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.66	0.0006	25
1.70	0.0014	59
1.80	0.0025	108
1.90	0.0092	400
2.00	0.0252	1100
2.10	0.0666	2900
2.20	0.1262	5499
2.30	0.2146	9349
2.40	0.3168	13798
2.50	0.4281	18648
2.60	0.5130	22347
2.70	0.5985	26072
2.80	0.7064	30771
2.90	0.8906	38795
3.00	1.2825	55868
3.10	1.7944	78165
3.20	2.3780	103586
3.30	2.9955	130483
3.40	3.5515	154704
3.50	3.9222	170852
3.60	4.1317	179976
3.70	4.2975	187200
3.80	4.4249	192749

Stage [ft]	Area [ac]	Area [ft2]
3.90	4.5276	197224
4.00	4.6447	202323
4.10	4.7354	206272
4.20	4.8335	210547
4.30	4.9729	216621
4.40	5.1761	225470
4.50	5.4263	236368
4.59	5.6977	248192
4.69	6.0609	264015
4.79	6.4799	282262
4.89	6.9332	302010
4.99	7.4439	324257
5.09	7.9850	347829
5.19	8.6128	375175
5.29	9.4311	410820
5.39	10.2523	446590
5.49	11.2278	489085
5.59	12.9104	562375
5.69	14.6583	638515
5.79	15.9070	692907
5.89	17.0443	742451
5.99	18.2689	795794
6.09	19.3495	842862
6.19	20.4788	892056
6.29	20.9861	914153
6.39	21.4532	934500
6.49	21.9719	957097
6.59	22.5573	982594
6.69	23.2149	1011240
6.79	23.9356	1042636
6.89	24.7074	1076256
6.99	25.5590	1113351
7.09	26.5357	1155896
7.19	27.5577	1200415
7.29	28.6153	1246484
7.39	29.7888	1297602
7.49	31.0111	1350845
7.59	32.0521	1396189
7.69	32.9783	1436533
7.79	33.8006	1472353
7.89	34.5391	1504524
7.99	35.2817	1536870
8.09	35.9990	1568116
8.19	36.6675	1597237
8.29	37.2941	1624533
8.39	37.9254	1652029
8.49	38.5870	1680851
8.59	39.1402	1704947
8.69	39.6871	1728769

Stage [ft]	Area [ac]	Area [ft2]
8.79	40.1450	1748717
8.89	40.5473	1766239
8.99	40.8950	1781387
9.09	41.1986	1794610
9.19	41.4339	1804859
9.29	41.6605	1814733
9.39	41.8832	1824431
9.49	42.0898	1833430
9.59	42.3107	1843054
9.69	42.5523	1853577
9.79	42.8381	1866026
9.89	43.1221	1878399
9.99	43.4481	1892597
10.09	43.7637	1906345
10.19	44.0179	1917419
10.29	44.2658	1928218
10.39	44.4993	1938391
10.49	44.6973	1947015
10.59	44.8982	1955764
10.69	45.1053	1964788
10.79	45.2924	1972937
10.89	45.4634	1980386
10.99	45.6401	1988085
11.09	45.8002	1995059
11.19	45.9718	2002533
11.29	46.1359	2009682
11.39	46.3121	2017356
11.49	46.4831	2024805
11.59	46.6449	2031854
11.69	46.8091	2039003
11.79	46.9629	2045702
11.89	47.1321	2053076
11.99	47.3100	2060825
12.09	47.4896	2068649
12.19	47.6790	2076898
12.29	47.8512	2084397
12.39	48.0113	2091371
12.49	48.1593	2097820
12.59	48.2712	2102694
12.69	48.4043	2108493
12.79	48.6058	2117267
12.89	48.7412	2123166
12.99	48.8525	2128016
13.09	48.9352	2131615
13.19	48.9891	2133965
13.29	49.0390	2136140
13.39	49.0763	2137765
13.49	49.1176	2139564
13.59	49.1567	2141264

Stage [ft]	Area [ac]	Area [ft2]
13.69	49.1894	2142689
13.79	49.2152	2143814
13.89	49.2445	2145089
13.99	49.2829	2146763
14.09	49.3208	2148413
14.19	49.3558	2149938
14.29	49.3982	2151788
14.39	49.4350	2153387
14.49	49.4769	2155212
14.59	49.5199	2157087
14.69	49.5647	2159037
14.79	49.6140	2161186
14.89	49.6875	2164386
14.99	49.8022	2169385
15.09	49.9118	2174160
15.19	50.0450	2179959
15.29	50.2011	2186758
15.39	50.3577	2193582
15.49	50.4685	2198406
15.59	50.5706	2202856
15.69	50.5792	2203230
15.79	50.5792	2203230

Comment:

Node: B-20

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.34	81.0865	3532128
-0.30	81.1043	3532903
-0.20	81.1456	3534703
-0.10	81.1927	3536753
0.00	81.2529	3539377
0.09	81.2942	3541177
0.20	81.3459	3543427
0.30	81.3947	3545552
0.40	81.4366	3547376
0.50	81.4893	3549676
0.60	81.5358	3551701
0.70	81.5909	3554100
0.80	81.6489	3556625

Stage [ft]	Area [ac]	Area [ft2]
0.89	81.7005	3558875
0.99	81.7596	3561449
1.09	81.8268	3564374
1.20	81.8928	3567249
1.30	81.9576	3570073
1.40	82.0225	3572898
1.50	82.0833	3575548
1.60	82.1435	3578172
1.70	82.2095	3581047
1.80	82.2772	3583996
1.90	82.3518	3587246
2.00	82.4379	3590995
2.10	82.5355	3595245
2.20	82.6307	3599394
2.30	82.7380	3604069
2.40	82.8408	3608543
2.50	82.9607	3613767
2.60	83.0755	3618767
2.70	83.2034	3624341
2.80	83.3274	3629740
2.90	83.4605	3635540
3.00	83.5925	3641289
3.10	83.7296	3647263
3.20	83.8565	3652787
3.30	83.9816	3658236
3.40	84.1124	3663936
3.50	84.2576	3670260
3.60	84.4045	3676659
3.70	84.5525	3683108
3.80	84.7069	3689832
3.90	84.8888	3697756
4.00	85.0661	3705480
4.10	85.2561	3713754
4.20	85.4540	3722378
4.30	85.6578	3731252
4.40	85.8902	3741375
4.50	86.1742	3753749
4.59	86.4795	3767047
4.69	86.8806	3784520
4.79	87.3517	3805042
4.89	87.9267	3830089
4.99	88.6722	3862559
5.09	89.7935	3911403
5.19	91.3761	3980343
5.29	93.6744	4080455
5.39	96.5694	4206563
5.49	100.0337	4357468
5.59	104.2853	4542668
5.69	109.4511	4767688

Stage [ft]	Area [ac]	Area [ft2]
5.79	115.8087	5044626
5.89	123.0013	5357935
5.99	130.1634	5669918
6.09	136.9451	5965328
6.19	143.2993	6242116
6.29	149.3528	6505806
6.39	154.8886	6746949
6.49	159.8621	6963595
6.59	164.3726	7160069
6.69	168.1272	7323622
6.79	171.3012	7461879
6.89	173.9678	7578038
6.99	176.4463	7685999
7.09	178.6842	7783486
7.19	180.4551	7860625
7.29	181.9620	7926267
7.39	183.2090	7980584
7.49	184.2953	8027903
7.59	185.2370	8068923
7.69	186.0668	8105068
7.79	186.7502	8134839
7.89	187.3768	8162135
7.99	187.8566	8183032
8.09	188.2129	8198555
8.19	188.4729	8209879
8.29	188.6864	8219177
8.39	188.8671	8227051
8.49	189.0014	8232901
8.59	189.0984	8237125
8.69	189.1770	8240550
8.79	189.2608	8244199
8.89	189.3210	8246824
8.99	189.3939	8249998
9.09	189.4794	8253723
9.19	189.5454	8256597
9.29	189.6194	8259822
9.39	189.7003	8263347
9.49	189.7457	8265321
9.59	189.7916	8267321
9.69	189.8495	8269846
9.79	189.9132	8272620
9.89	189.9695	8275070
9.99	190.0211	8277320
10.09	190.0693	8279419
10.19	190.1187	8281569
10.29	190.1738	8283969
10.39	190.2277	8286319
10.49	190.3166	8290193
10.59	190.3976	8293718

Stage [ft]	Area [ac]	Area [ft2]
10.69	190.4871	8297617
10.79	190.5680	8301142
10.89	190.6311	8303891
10.99	190.6983	8306816
11.09	190.7654	8309740
11.19	190.8429	8313115
11.29	190.9094	8316015
11.39	190.9892	8319489
11.49	191.0690	8322964
11.59	191.1533	8326638
11.69	191.2526	8330963
11.79	191.2583	8331212
11.89	191.2583	8331212

Comment:

Node: B-21

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.34	0.0011	50
-0.30	0.0015	67
-0.20	0.0020	88
-0.10	0.0024	103
0.00	0.0026	115
0.09	0.0029	125
0.20	0.0037	161
0.30	0.0044	191
0.40	0.0047	203
0.50	0.0048	207
0.60	0.0048	211
0.70	0.0049	215
0.80	0.0050	220
0.90	0.0051	224
1.00	0.0059	256
1.10	0.0064	280
1.20	0.0068	295
1.30	0.0075	327
1.40	0.0077	335
1.50	0.0079	343
1.60	0.0080	351
1.70	0.0082	357

Stage [ft]	Area [ac]	Area [ft2]
1.80	0.0083	363
1.90	0.0085	369
2.00	0.0086	375
2.10	0.0089	390
2.20	0.0093	404
2.30	0.0096	419
2.40	0.0108	471
2.50	0.0113	494
2.60	0.0121	527
2.70	0.0122	530
2.80	0.0123	534
2.90	0.0123	537
3.00	0.0124	541
3.10	0.0125	544
3.20	0.0126	548
3.30	0.0128	557
3.40	0.0132	575
3.50	0.0141	615
3.60	0.0147	640
3.70	0.0151	658
3.80	0.0154	672
3.90	0.0156	679
4.00	0.0157	684
4.10	0.0158	689
4.20	0.0159	694
4.30	0.0160	699
4.40	0.0165	717
4.50	0.0179	779
4.60	0.0186	809
4.69	0.0189	825
4.80	0.0194	843
4.90	0.0202	880
5.00	0.0204	889
5.10	0.0206	899
5.20	0.0216	941
5.29	0.0224	975
5.40	0.0231	1007
5.50	0.0238	1037
5.60	0.0247	1075
5.70	0.0275	1200
5.79	0.0310	1350
5.89	0.0367	1600
5.99	0.0494	2150
6.09	0.0723	3150
6.19	0.0935	4074
6.29	0.1096	4774
6.39	0.1412	6149
6.49	0.1676	7299
6.59	0.2135	9299

Stage [ft]	Area [ac]	Area [ft2]
6.69	0.2749	11973
6.79	0.3294	14348
6.89	0.4017	17498
6.99	0.4889	21297
7.09	0.6220	27096
7.19	0.7649	33321
7.29	0.9313	40570
7.39	1.1425	49768
7.49	1.4076	61317
7.59	1.7783	77465
7.69	2.2655	98687
7.79	2.7998	121959
7.89	3.2416	141206
7.99	3.6244	157879
8.09	4.0204	175127
8.19	4.6309	201723
8.29	5.0607	220446
8.39	5.5112	240068
8.49	5.9238	258041
8.59	6.3226	275413
8.69	6.7696	294886
8.79	7.2017	313708
8.89	7.6511	333280
8.99	8.1830	356452
9.09	8.7626	381699
9.19	9.3927	409145
9.29	9.9987	435542
9.39	10.5421	459214
9.49	11.0207	480061
9.59	11.4189	497409
9.69	11.7185	510457
9.79	11.9606	521005
9.89	12.1322	528479
9.99	12.2740	534654
10.09	12.4352	541678
10.19	12.5890	548377
10.29	12.7302	554526
10.39	12.8524	559850
10.49	12.9413	563725
10.59	13.0027	566399
10.69	13.0498	568449
10.79	13.0762	569599
10.89	13.0871	570074
10.99	13.0916	570268
11.09	13.0916	570268

Comment:

Node: B-22

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.26 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.26	0.0006	25
3.30	0.0023	100
3.40	0.0043	187
3.50	0.0103	450
3.60	0.0241	1050
3.70	0.0637	2775
3.80	0.0987	4299
3.90	0.1199	5224
4.00	0.1475	6424
4.10	0.1716	7474
4.20	0.1934	8424
4.30	0.2117	9224
4.39	0.2267	9874
4.50	0.2389	10407
4.60	0.2445	10649
4.69	0.2525	10999
4.79	0.2617	11398
4.89	0.2686	11698
4.99	0.2732	11898
5.09	0.2800	12198
5.19	0.2875	12523
5.29	0.2944	12823
5.39	0.3036	13223
5.49	0.3214	13998
5.59	0.3449	15023
5.69	0.3873	16873
5.79	0.4660	20297
5.89	0.6031	26271
5.99	0.8355	36395
6.09	1.1936	51993
6.19	1.6429	71565
6.29	2.2064	96112
6.39	2.8859	125708
6.49	3.7088	161553
6.59	4.6418	202198
6.69	5.5531	241893
6.79	6.3903	278363
6.89	7.1845	312958
6.99	7.8674	342704
7.09	8.4533	368226
7.19	9.0042	392223
7.29	9.4902	413395

Stage [ft]	Area [ac]	Area [ft2]
7.39	9.9723	434392
7.49	10.4222	453989
7.59	10.8204	471337
7.69	11.1859	487260
7.79	11.5647	503758
7.89	11.9572	520855
7.99	12.3618	538478
8.09	12.8048	557776
8.19	13.2604	577623
8.29	13.7401	598520
8.39	14.2549	620942
8.49	14.8270	645864
8.59	15.4003	670835
8.69	16.0097	697382
8.79	16.6369	724703
8.89	17.2939	753324
8.99	18.0422	785920
9.09	18.7550	816966
9.19	19.4533	847387
9.29	20.1368	877158
9.39	20.7617	904379
9.49	21.3459	929826
9.59	21.9335	955422
9.69	22.5727	983269
9.79	23.1621	1008940
9.89	23.7331	1033812
9.99	24.2122	1054684
10.09	24.6558	1074007
10.19	25.0431	1090879
10.29	25.3897	1105977
10.39	25.6744	1118376
10.49	25.9160	1128899
10.59	26.0910	1136523
10.69	26.2321	1142672
10.79	26.3102	1146072
10.89	26.3825	1149222
10.99	26.4382	1151646
11.09	26.4829	1153596
11.19	26.5133	1154921
11.29	26.5278	1155551
11.39	26.5278	1155551

Comment:

Node: B-23

Scenario: Future

Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.01 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.01	0.0006	25
5.10	0.0026	112
5.20	0.0132	575
5.30	0.0390	1700
5.40	0.0666	2900
5.49	0.0970	4224
5.59	0.1360	5924
5.69	0.2026	8824
5.79	0.2932	12773
5.89	0.3845	16748
5.99	0.5021	21872
6.09	0.6840	29796
6.19	0.9675	42144
6.29	1.3009	56667
6.39	1.7313	75415
6.49	2.1295	92763
6.59	2.5111	109385
6.69	2.8755	125258
6.79	3.2032	139531
6.89	3.5091	152855
6.99	3.8379	167178
7.09	4.1988	182901
7.19	4.6298	201673
7.29	5.0854	221520
7.39	5.5284	240818
7.49	5.9479	259090
7.59	6.3358	275988
7.69	6.7077	292186
7.79	7.0824	308509
7.89	7.5013	326756
7.99	7.8554	342179
8.09	8.1905	356777
8.19	8.4619	368601
8.29	8.7276	380174
8.39	8.9468	389723
8.49	9.1700	399447
8.59	9.3732	408295
8.69	9.5838	417469
8.79	9.8546	429268
8.89	10.0859	439341
8.99	10.2626	447040
9.09	10.3940	452765
9.19	10.4750	456289
9.29	10.5553	459789

Stage [ft]	Area [ac]	Area [ft2]
9.39	10.6104	462188
9.49	10.6586	464288
9.59	10.7045	466288
9.69	10.7670	469012
9.79	10.8634	473212
9.89	10.9277	476011
9.99	10.9851	478511
10.09	11.0017	479236
10.19	11.0098	479586
10.30	11.0110	479638
10.40	11.0110	479638

Comment:

Node: B-24

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.15 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.15	0.0006	25
4.20	0.0009	39
4.30	0.0023	100
4.39	0.0052	225
4.49	0.0189	825
4.59	0.0367	1600
4.69	0.0821	3575
4.79	0.1446	6299
4.89	0.2990	13023
4.99	0.7529	32796
5.09	1.5723	68491
5.19	2.5329	110335
5.29	3.4155	148780
5.39	4.2792	186400
5.49	5.3580	233394
5.59	6.7203	292736
5.69	8.5950	374400
5.79	10.9507	477011
5.89	13.4549	586097
5.99	15.5139	675785
6.09	17.0822	744101
6.19	18.2563	795244
6.29	19.0602	830264
6.39	19.7070	858435

Stage [ft]	Area [ac]	Area [ft2]
6.49	20.2424	881757
6.59	20.7009	901730
6.69	21.1594	921702
6.79	21.6081	941249
6.89	22.2038	967196
6.99	22.9079	997867
7.09	23.6625	1030737
7.19	24.3545	1060883
7.29	25.0713	1092104
7.39	25.8569	1126325
7.49	26.7394	1164769
7.59	27.5795	1201365
7.69	28.5585	1244009
7.79	29.7269	1294902
7.89	30.9497	1348170
7.99	32.0331	1395364
8.09	33.0930	1441533
8.19	33.9762	1480002
8.29	34.9150	1520897
8.39	35.9462	1565816
8.49	37.2081	1620784
8.59	38.6157	1682100
8.69	40.1789	1750191
8.79	41.6129	1812658
8.89	42.7279	1861226
8.99	43.5404	1896622
9.09	44.0896	1920544
9.19	44.5194	1939266
9.29	44.8551	1953889
9.39	45.1288	1965812
9.49	45.3389	1974961
9.59	45.5150	1982635
9.69	45.6287	1987585
9.79	45.7526	1992984
9.89	45.8416	1996858
9.99	45.8835	1998683
10.09	45.8989	1999358
10.19	45.9133	1999983
10.29	45.9183	2000199
10.39	45.9183	2000199

Comment:

Node: B-25

Scenario: Future
Type: Stage/Area

5/20/2024 15:19

Base Flow: 0.00 cfs
Initial Stage: 4.15 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.15	0.0006	25
4.20	0.0011	50
4.30	0.0040	175
4.40	0.0099	433
4.50	0.0126	550
4.59	0.0184	800
4.70	0.0218	950
4.80	0.0252	1100
4.90	0.0330	1437
4.99	0.0407	1775
5.09	0.0476	2075
5.19	0.0580	2525
5.29	0.0706	3075
5.39	0.1067	4649
5.49	0.1739	7574
5.59	0.2502	10899
5.69	0.3632	15823
5.79	0.4797	20897
5.89	0.5957	25947
5.99	0.6898	30046
6.09	0.8160	35545
6.19	0.9491	41344
6.29	1.1035	48069
6.39	1.2378	53918
6.49	1.4002	60992
6.59	1.5729	68516
6.69	1.7531	76365
6.79	1.8983	82689
6.89	2.0314	88488
6.99	2.1215	92413
7.09	2.2093	96237
7.19	2.3281	101411
7.29	2.4526	106836
7.39	2.6030	113385
7.49	2.7774	120984
7.59	2.9851	130033
7.69	3.1745	138282
7.79	3.3426	145606
7.89	3.5188	153280
7.99	3.6577	159329
8.09	3.7661	164053
8.19	3.8694	168553
8.29	3.9544	172252
8.39	4.0163	174952
8.49	4.0248	175319

Stage [ft]	Area [ac]	Area [ft2]
8.59	4.0248	175319

Comment:

Node: B-26

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.60	0.0011	50
2.70	0.0044	190
2.80	0.0080	350
2.90	0.0143	625
3.00	0.0228	994
3.10	0.0362	1575
3.20	0.0459	2000
3.30	0.0608	2650
3.40	0.0861	3750
3.50	0.1125	4899
3.60	0.1567	6824
3.70	0.2083	9074
3.80	0.2565	11173
3.90	0.3225	14048
4.00	0.4269	18598
4.10	0.5492	23922
4.20	0.6703	29196
4.30	0.8011	34895
4.40	0.9308	40545
4.50	1.0708	46644
4.60	1.1902	51843
4.70	1.3434	58517
4.80	1.5413	67141
4.90	1.7629	76790
5.00	2.0056	87363
5.10	2.2655	98687
5.20	2.5226	109885
5.30	2.7728	120784
5.40	2.9846	130008
5.50	3.2095	139806
5.60	3.4614	150780
5.70	3.7036	161328
5.80	3.9664	172777
5.90	4.2516	185200

Stage [ft]	Area [ac]	Area [ft2]
6.00	4.5167	196749
6.10	4.7715	207847
6.20	5.0085	218171
6.30	5.2501	228694
6.40	5.4750	238493
6.50	5.6948	248067
6.60	5.8779	256041
6.70	6.1160	266414
6.80	6.3553	276838
6.90	6.6296	288786
7.00	6.8620	298910
7.10	7.1271	310459
7.20	7.4020	322432
7.30	7.6304	332381
7.40	7.8548	342154
7.50	8.0585	351028
7.60	8.2720	360327
7.70	8.4631	368651
7.80	8.6323	376025
7.90	8.7867	382749
8.00	8.9187	388498
8.10	9.0421	393872
8.20	9.1442	398322
8.30	9.2395	402471
8.40	9.3301	406421
8.50	9.4065	409745
8.60	9.4707	412545
8.70	9.5207	414720
8.80	9.5723	416969
8.90	9.6308	419519
9.00	9.6779	421569
9.10	9.7261	423668
9.20	9.7577	425043
9.30	9.7918	426533
9.40	9.7918	426533

Comment:

Node: B-27

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.92 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.92	0.0006	25
4.00	0.0017	75
4.09	0.0086	375
4.19	0.0189	825
4.29	0.0362	1575
4.39	0.0677	2950
4.49	0.1085	4724
4.59	0.1555	6774
4.69	0.2049	8924
4.79	0.2519	10974
4.89	0.2944	12823
4.99	0.3391	14773
5.09	0.3793	16523
5.19	0.4390	19122
5.29	0.5170	22522
5.39	0.6261	27271
5.49	0.7494	32646
5.59	0.8545	37220
5.69	0.9796	42669
5.79	1.1190	48744
5.89	1.2550	54668
5.99	1.3767	59967
6.09	1.4725	64141
6.19	1.5586	67891
6.29	1.6596	72290
6.39	1.7227	75040
6.49	1.7505	76250
6.59	1.7505	76250

Comment:

Node: B-28

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.87 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.87	0.0006	25
3.90	0.0008	36
4.00	0.0029	125
4.09	0.0069	300
4.19	0.0235	1025
4.29	0.0534	2325
4.39	0.0809	3525

Stage [ft]	Area [ac]	Area [ft2]
4.49	0.1222	5324
4.59	0.1481	6449
4.69	0.1888	8224
4.79	0.2238	9749
4.89	0.2622	11423
4.99	0.3082	13423
5.09	0.3472	15123
5.19	0.3937	17148
5.29	0.4321	18822
5.39	0.4740	20647
5.49	0.5182	22572
5.59	0.5538	24122
5.69	0.5997	26121
5.79	0.6576	28646
5.89	0.7368	32096
5.99	0.8568	37320
6.09	1.0323	44969
6.19	1.2458	54268
6.29	1.4455	62967
6.39	1.6263	70841
6.49	1.7583	76590
6.59	1.8529	80714
6.69	1.8736	81613
6.79	1.8736	81613

Comment:

Node: B-29

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.31 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.31	0.0006	25
4.40	0.0027	117
4.50	0.0075	325
4.60	0.0216	942
4.69	0.0344	1500
4.79	0.0471	2050
4.89	0.0608	2650
4.99	0.0775	3375
5.09	0.1102	4799
5.19	0.1521	6624
5.29	0.2031	8849

Stage [ft]	Area [ac]	Area [ft2]
5.39	0.2628	11448
5.49	0.3156	13748
5.59	0.3759	16373
5.69	0.4419	19247
5.79	0.4987	21722
5.89	0.5417	23597
5.99	0.5893	25672
6.09	0.6496	28296
6.19	0.7024	30596
6.29	0.7701	33546
6.39	0.8734	38045
6.49	0.9629	41944
6.59	1.0760	46869
6.69	1.2200	53143
6.79	1.3571	59117
6.89	1.5023	65441
6.99	1.6355	71241
7.09	1.7554	76465
7.19	1.8352	79939
7.29	1.8799	81889
7.39	1.9052	82989
7.50	1.9187	83579
7.60	1.9187	83579

Comment:

Node: B-3

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.60 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.00	0.0000	0
0.50	0.0000	0
1.00	3.8700	168577
1.50	7.8300	341075
2.00	11.8700	517057
2.50	16.0000	696960
3.00	20.2200	880783
3.40	23.6600	1030630
3.90	28.0300	1220987
4.40	37.4400	1630886
4.90	52.8000	2299968
5.40	70.0800	3052685

Stage [ft]	Area [ac]	Area [ft2]
5.90	89.2800	3889037
6.40	110.3900	4808588
6.90	132.4700	5770393

Comment:

Node: B-30

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.06 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.06	0.0006	25
4.10	0.0013	57
4.20	0.0039	169
4.30	0.0063	275
4.39	0.0103	450
4.49	0.0172	750
4.60	0.0281	1225
4.69	0.0396	1725
4.79	0.0539	2350
4.89	0.0786	3425
4.99	0.1383	6024
5.09	0.2163	9424
5.19	0.3001	13073
5.29	0.4005	17448
5.39	0.5515	24022
5.49	0.7282	31721
5.59	0.9750	42469
5.69	1.2498	54443
5.79	1.6108	70166
5.89	2.0538	89463
5.99	2.6988	117559
6.09	3.3926	147780
6.19	3.9521	172152
6.29	4.4255	192774
6.39	4.8926	213122
6.49	5.3247	231944
6.59	5.6931	247992
6.69	5.9932	261065
6.79	6.2601	272689
6.89	6.4999	283137
6.99	6.6784	290911
7.09	6.8098	296635

Stage [ft]	Area [ac]	Area [ft2]
7.19	6.9165	301285
7.29	6.9883	304409
7.39	7.0193	305759
7.50	7.0319	306309
7.59	7.0457	306909
7.69	7.0514	307159
7.80	7.0532	307238
7.90	7.0532	307238

Comment:

Node: B-31

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.05	2.5341	110385
0.10	2.5375	110535
0.20	2.5395	110623
0.30	2.5427	110760
0.40	2.5467	110935
0.50	2.5489	111030
0.60	2.5548	111285
0.70	2.5597	111502
0.80	2.5632	111653
0.90	2.5674	111835
1.00	2.5706	111977
1.10	2.5743	112135
1.20	2.5812	112435
1.30	2.5869	112685
1.40	2.5915	112885
1.50	2.5961	113085
1.60	2.6012	113310
1.70	2.6053	113485
1.80	2.6100	113693
1.90	2.6130	113820
2.00	2.6156	113935
2.10	2.6210	114172
2.20	2.6290	114518
2.30	2.6328	114685
2.40	2.6365	114847
2.50	2.6407	115028
2.60	2.6471	115310

Stage [ft]	Area [ac]	Area [ft2]
2.70	2.6556	115676
2.80	2.6601	115872
2.90	2.6695	116284
3.00	2.6758	116559
3.10	2.6821	116834
3.20	2.6879	117084
3.30	2.6976	117509
3.40	2.7080	117959
3.50	2.7180	118397
3.60	2.7286	118859
3.70	2.7499	119784
3.80	2.7682	120584
3.90	2.7831	121234
4.00	2.8084	122334
4.10	2.8273	123159
4.20	2.8457	123958
4.30	2.8732	125158
4.40	2.9002	126333
4.50	2.9306	127658
4.59	2.9668	129233
4.69	3.0201	131557
4.79	3.0706	133757
4.89	3.1424	136882
4.99	3.2428	141256
5.09	3.3358	145306
5.19	3.4362	149680
5.29	3.5492	154604
5.39	3.6801	160304
5.49	3.7960	165353
5.59	3.9297	171177
5.69	4.0525	176526
5.79	4.1896	182501
5.89	4.3526	189600
5.99	4.5500	198199
6.09	4.7377	206372
6.19	4.8995	213422
6.29	5.0693	220820
6.39	5.2403	228270
6.49	5.4234	236243
6.59	5.6007	243967
6.69	5.7717	251416
6.79	5.9290	258265
6.89	6.0931	265415
6.99	6.2515	272314
7.09	6.4041	278963
7.19	6.5487	285262
7.29	6.7197	292711
7.39	6.9079	300910
7.49	7.1644	312083

Stage [ft]	Area [ac]	Area [ft2]
7.59	7.5036	326856
7.69	7.9225	345104
7.79	8.4040	366076
7.89	8.8762	386648
7.99	9.3278	406321
8.09	9.7100	422969
8.19	10.1031	440091
8.29	10.5002	457389
8.39	10.8537	472787
8.49	11.1676	486460
8.59	11.4052	496809
8.69	11.4924	500610
8.79	11.4924	500610

Comment:

Node: B-32

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.00	0.0006	25
3.10	0.0063	275
3.21	0.0171	746
3.31	0.0267	1164
3.40	0.0344	1500
3.50	0.0689	3000
3.60	0.1222	5324
3.70	0.2077	9049
3.80	0.3001	13073
3.90	0.4005	17448
4.00	0.4792	20872
4.10	0.5693	24797
4.20	0.6565	28596
4.30	0.7431	32371
4.40	0.8464	36870
4.50	0.9641	41994
4.60	1.0656	46419
4.70	1.1580	50443
4.80	1.2699	55318
4.90	1.3801	60117
5.00	1.5218	66291
5.10	1.6756	72990

Stage [ft]	Area [ac]	Area [ft2]
5.20	1.8443	80339
5.30	2.0119	87638
5.40	2.1599	94087
5.50	2.3120	100712
5.60	2.4882	108386
5.70	2.7028	117734
5.80	3.0121	131207
5.90	3.4293	149380
6.00	3.8000	165528
6.10	4.1363	180176
6.20	4.4823	195249
6.30	4.8237	210122
6.40	5.1583	224695
6.50	5.5370	241193
6.60	5.9347	258515
6.70	6.4064	279063
6.80	6.9579	303085
6.90	7.6138	331656
7.00	8.3007	361577
7.10	8.9457	389673
7.20	9.5660	416694
7.30	10.1938	444041
7.40	10.8399	472187
7.50	11.4998	500933
7.60	12.2774	534804
7.70	13.2030	575123
7.80	14.1567	616668
7.90	15.1449	659712
8.00	16.2082	706031
8.10	17.3410	755374
8.20	18.4428	803368
8.30	19.4126	845612
8.40	20.2768	883257
8.50	21.0733	917952
8.60	21.8107	950073
8.70	22.5377	981744
8.80	23.1162	1006941
8.90	23.5598	1026263
9.00	23.8031	1036862
9.10	23.9620	1043786
9.20	24.0515	1047685
9.30	24.1187	1050610
9.40	24.1726	1052959
9.50	24.2329	1055584
9.60	24.2834	1057784
9.70	24.3270	1059684
9.80	24.3643	1061308
9.90	24.4010	1062908
10.00	24.4412	1064658

Stage [ft]	Area [ac]	Area [ft2]
10.10	24.4791	1066308
10.20	24.5164	1067932
10.30	24.5571	1069707
10.40	24.5915	1071207
10.50	24.6196	1072432
10.60	24.6437	1073481
10.70	24.6437	1073481

Comment:

Node: B-33

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.44 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.44	0.0006	25
4.50	0.0015	64
4.59	0.0046	200
4.69	0.0115	500
4.79	0.0218	950
4.89	0.0390	1700
4.99	0.0780	3400
5.09	0.1613	7024
5.19	0.3064	13348
5.29	0.5406	23547
5.39	0.8923	38870
5.49	1.3284	57867
5.59	1.8352	79939
5.69	2.2386	97512
5.79	2.6403	115010
5.89	3.0213	131607
5.99	3.3570	146230
6.09	3.6261	157954
6.19	3.8671	168452
6.29	4.0789	177676
6.39	4.3101	187750
6.49	4.5552	198424
6.59	4.8341	210572
6.69	5.1009	222195
6.79	5.3270	232044
6.89	5.4997	239568
6.99	5.6661	246817
7.09	5.8148	253291

Stage [ft]	Area [ac]	Area [ft2]
7.19	5.9479	259090
7.29	6.0673	264290
7.39	6.1843	269389
7.49	6.2727	273239
7.59	6.3616	277113
7.69	6.4236	279813
7.79	6.4477	280863
7.89	6.4644	281587
8.00	6.4705	281856
8.10	6.4705	281856

Comment:

Node: B-34

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.78 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.78	0.0006	25
4.80	0.0007	31
4.90	0.0013	56
5.00	0.0019	81
5.10	0.0027	119
5.20	0.0035	154
5.30	0.0043	189
5.40	0.0055	242
5.49	0.0080	350
5.60	0.0112	487
5.70	0.0149	650
5.79	0.0207	900
5.89	0.0281	1225
5.99	0.0350	1525
6.09	0.0465	2025
6.19	0.0625	2725
6.29	0.0872	3799
6.40	0.1171	5099
6.49	0.1521	6624
6.59	0.2181	9499
6.69	0.2973	12948
6.79	0.4023	17523
6.89	0.5388	23472
6.99	0.7219	31446
7.09	0.9589	41769

Stage [ft]	Area [ac]	Area [ft2]
7.19	1.2240	53318
7.29	1.4977	65241
7.39	1.7726	77215
7.49	2.0676	90063
7.59	2.3287	101436
7.69	2.5892	112785
7.79	2.8216	122909
7.89	3.0592	133257
7.99	3.2772	142756
8.09	3.5349	153979
8.19	3.8402	167278
8.29	4.2464	184975
8.39	4.7222	205698
8.49	5.2903	230444
8.59	5.9387	258690
8.69	6.6354	289036
8.79	6.9998	304909
8.89	7.1868	313058
8.99	7.3079	318332
9.09	7.3756	321282
9.19	7.4141	322957
9.29	7.4238	323382
9.40	7.4282	323571
9.50	7.4282	323571

Comment:

Node: B-35

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.58	0.0006	25
5.60	0.0006	28
5.70	0.0010	43
5.80	0.0016	71
5.90	0.0022	94
6.00	0.0026	115
6.10	0.0036	158
6.19	0.0040	175
6.29	0.0080	350
6.39	0.0161	700
6.49	0.0344	1500

Stage [ft]	Area [ac]	Area [ft2]
6.59	0.0666	2900
6.69	0.1027	4474
6.79	0.1704	7424
6.89	0.2743	11948
6.99	0.4539	19772
7.09	0.7024	30596
7.19	1.0610	46219
7.29	1.4742	64216
7.39	1.8966	82614
7.49	2.4193	105386
7.59	3.0764	134007
7.69	3.8792	168977
7.79	4.8702	212147
7.89	5.9944	261115
7.99	7.2689	316633
8.09	8.4281	367126
8.19	9.4879	413295
8.29	10.4233	454039
8.39	11.2049	488085
8.49	11.9142	518981
8.59	12.5351	546027
8.69	13.0762	569599
8.79	13.5571	590546
8.89	14.0466	611868
8.99	14.5510	633840
9.09	15.0875	657212
9.19	15.7296	685184
9.29	16.7224	728428
9.39	17.5017	762373
9.49	17.8976	779621
9.59	18.1846	792119
9.69	18.3607	799793
9.79	18.4795	804967
9.89	18.5644	808667
9.99	18.6293	811492
10.09	18.6597	812816
10.19	18.6827	813816
10.29	18.6913	814191
10.40	18.6993	814541
10.49	18.7022	814666
10.60	18.7062	814841
10.70	18.7071	814883
10.80	18.7096	814991
10.90	18.7100	815006
11.00	18.7100	815006

Comment:

Node: B-36

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.94	0.0006	25
1.00	0.0011	50
1.10	0.0016	71
1.20	0.0041	180
1.30	0.0109	475
1.40	0.0157	683
1.50	0.0197	858
1.60	0.0250	1087
1.70	0.0293	1275
1.80	0.0339	1475
1.90	0.0407	1775
2.00	0.0488	2125
2.10	0.0614	2675
2.20	0.0729	3175
2.30	0.0835	3637
2.40	0.0935	4074
2.50	0.1010	4399
2.60	0.1044	4549
2.70	0.1096	4774
2.80	0.1136	4949
2.90	0.1166	5079
3.00	0.1199	5224
3.10	0.1245	5424
3.20	0.1262	5499
3.30	0.1328	5784
3.40	0.1360	5924
3.50	0.1377	5999
3.60	0.1417	6174
3.70	0.1475	6424
3.80	0.1547	6737
3.90	0.1584	6899
4.00	0.1611	7016
4.10	0.1681	7324
4.20	0.1773	7724
4.30	0.2003	8724
4.40	0.2290	9974
4.50	0.2668	11623
4.60	0.3145	13698
4.70	0.3489	15198
4.80	0.3845	16748
4.89	0.4132	17998
4.99	0.4436	19322

Stage [ft]	Area [ac]	Area [ft2]
5.09	0.4792	20872
5.19	0.5245	22847
5.29	0.5670	24697
5.39	0.5985	26072
5.49	0.6289	27396
5.59	0.6674	29071
5.69	0.7047	30696
5.79	0.7454	32471
5.89	0.7942	34595
5.99	0.8481	36945
6.09	0.9004	39220
6.19	0.9595	41794
6.29	1.0278	44769
6.39	1.1150	48569
6.49	1.2275	53468
6.59	1.3916	60617
6.69	1.6601	72315
6.79	2.1255	92588
6.89	2.7900	121534
6.99	3.5745	155704
7.09	4.5919	200023
7.19	5.6834	247567
7.29	6.8861	299960
7.39	8.1078	353178
7.49	9.4019	409545
7.59	10.8933	474512
7.69	12.5953	548652
7.79	14.2801	622042
7.89	15.9942	696707
7.99	17.6302	767972
8.09	19.3420	842537
8.19	21.1123	919652
8.29	22.9348	999042
8.39	24.7947	1080056
8.49	26.5885	1158195
8.59	28.4328	1238535
8.69	30.5475	1330647
8.79	32.8710	1431859
8.89	35.1365	1530546
8.99	37.3722	1627933
9.09	39.3479	1713996
9.19	41.0132	1786536
9.29	42.3004	1842604
9.39	43.3212	1887073
9.49	44.1786	1924418
9.59	44.8511	1953714
9.69	45.5340	1983460
9.79	46.0900	2007682
9.89	46.5755	2028829

Stage [ft]	Area [ac]	Area [ft2]
9.99	47.0415	2049126
10.09	47.4282	2065974
10.19	47.7295	2079097
10.29	48.0227	2091871
10.39	48.2425	2101444
10.49	48.4078	2108643
10.59	48.5782	2116067
10.69	48.7148	2122017
10.79	48.8399	2127466
10.89	48.9621	2132790
10.99	49.0511	2136665
11.09	49.1222	2139764
11.19	49.1905	2142739
11.29	49.2439	2145064
11.39	49.2772	2146513
11.49	49.3127	2148063
11.59	49.3500	2149688
11.69	49.3747	2150763
11.79	49.3879	2151338
11.89	49.4040	2152038
11.99	49.4235	2152888
12.09	49.4407	2153637
12.19	49.4505	2154062
12.29	49.4574	2154362
12.39	49.4631	2154612
12.49	49.4688	2154862
12.59	49.4728	2155037
12.70	49.4750	2155131
12.80	49.4772	2155229
12.90	49.4797	2155337
12.99	49.4815	2155412
13.09	49.4832	2155487
13.20	49.4845	2155543
13.30	49.4851	2155572
13.40	49.4859	2155607
13.50	49.4870	2155654
13.60	49.4883	2155712
13.69	49.4889	2155737
13.80	49.4898	2155776
13.90	49.4904	2155802
14.00	49.4932	2155924
14.10	49.4932	2155924

Comment:

Node: B-37

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.85 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.85	0.0006	25
5.90	0.0007	29
6.00	0.0008	37
6.10	0.0010	45
6.20	0.0013	56
6.29	0.0017	75
6.39	0.0069	300
6.49	0.0344	1500
6.59	0.0763	3325
6.69	0.1343	5849
6.79	0.2186	9524
6.89	0.3701	16123
6.99	0.5601	24397
7.09	0.7902	34420
7.19	1.0438	45469
7.29	1.3003	56642
7.39	1.6073	70016
7.49	1.9763	86088
7.59	2.3671	103111
7.69	2.7866	121384
7.79	3.2250	140481
7.89	3.5860	156204
7.99	3.8884	169377
8.09	4.2040	183126
8.19	4.5248	197099
8.29	4.9224	214421
8.39	5.3040	231044
8.49	5.6725	247092
8.59	6.0380	263015
8.69	6.3559	276863
8.79	7.2511	315858
8.89	7.6287	332306
8.99	7.8163	340480
9.09	7.9305	345454
9.19	8.0011	348528
9.29	8.0700	351528
9.39	8.1251	353928
9.49	8.1405	354602
9.59	8.1405	354602

Comment:

Node: B-38

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.80	0.0006	25
1.90	0.0029	125
2.00	0.0098	425
2.10	0.0321	1400
2.20	0.0947	4124
2.30	0.1785	7774
2.40	0.2720	11848
2.50	0.3449	15023
2.60	0.3977	17323
2.70	0.4350	18947
2.80	0.4717	20547
2.90	0.4987	21722
3.00	0.5342	23272
3.10	0.5566	24247
3.20	0.5710	24872
3.30	0.5830	25397
3.40	0.5899	25697
3.51	0.5962	25972
3.60	0.6043	26321
3.71	0.6134	26721
3.80	0.6249	27221
3.90	0.6352	27671
4.01	0.6450	28096
4.10	0.6513	28371
4.21	0.6589	28701
4.31	0.6657	28996
4.41	0.6720	29271
4.50	0.6777	29521
4.61	0.6834	29771
4.70	0.6903	30071
4.80	0.6995	30471
4.90	0.7093	30896
5.00	0.7185	31296
5.10	0.7299	31796
5.20	0.7403	32246
5.30	0.7546	32871
5.40	0.7684	33471
5.50	0.7810	34020
5.60	0.7948	34620
5.70	0.8114	35345
5.80	0.8349	36370
5.90	0.8631	37595

Stage [ft]	Area [ac]	Area [ft2]
6.00	0.8929	38895
6.10	0.9216	40145
6.20	0.9468	41244
6.30	0.9761	42519
6.40	0.9996	43544
6.50	1.0410	45344
6.60	1.0897	47469
6.70	1.1563	50368
6.80	1.2447	54218
6.90	1.3646	59442
7.00	1.5339	66816
7.10	1.7623	76765
7.20	2.0320	88513
7.30	2.3637	102961
7.40	2.7126	118159
7.50	3.1252	136132
7.60	3.6055	157054
7.70	4.1317	179976
7.80	4.6734	203573
7.90	5.2294	227795
8.00	5.7981	252566
8.10	6.3909	278388
8.20	7.0933	308984
8.30	7.8324	341179
8.40	8.5428	372125
8.50	9.2177	401521
8.60	9.9315	432617
8.70	10.7200	466963
8.80	11.6083	505657
8.90	12.5930	548552
9.00	13.6541	594771
9.10	14.8023	644789
9.20	15.9948	696732
9.30	17.2492	751375
9.40	18.3952	801293
9.50	19.6444	855711
9.60	20.9097	910828
9.70	22.2307	968371
9.80	23.4611	1021964
9.90	24.6426	1073432
10.00	25.7949	1123625
10.10	26.7589	1165619
10.20	27.4481	1195640
10.30	28.1006	1224062
10.40	28.7169	1250908
10.50	29.3860	1280054
10.60	29.8646	1300901
10.70	30.1641	1313950
10.80	30.3793	1323323

Stage [ft]	Area [ac]	Area [ft2]
10.90	30.5469	1330622
11.00	30.6760	1336247
11.10	30.7845	1340971
11.20	30.8711	1344745
11.30	30.9285	1347245
11.40	30.9698	1349045
11.50	31.0042	1350545
11.60	31.0306	1351695
11.70	31.0479	1352444
11.80	31.0679	1353319
11.90	31.0817	1353919
12.00	31.0915	1354344
12.11	31.0986	1354657
12.20	31.1035	1354869
12.30	31.1075	1355044
12.40	31.1093	1355119
12.51	31.1098	1355142
12.61	31.1104	1355169
12.71	31.1108	1355188
12.81	31.1118	1355230
12.91	31.1118	1355230

Comment:

Node: B-39

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.94 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.94	0.0006	25
4.00	0.0010	44
4.10	0.0015	64
4.20	0.0020	86
4.29	0.0046	200
4.39	0.0184	800
4.49	0.0425	1850
4.59	0.0780	3400
4.69	0.1228	5349
4.79	0.1699	7399
4.89	0.2422	10549
4.99	0.3225	14048
5.09	0.4155	18098
5.19	0.5417	23597

Stage [ft]	Area [ac]	Area [ft2]
5.29	0.6714	29246
5.39	0.8045	35045
5.49	0.9388	40895
5.59	1.0656	46419
5.69	1.1689	50918
5.79	1.2670	55193
5.89	1.3755	59917
5.99	1.4478	63067
6.09	1.5230	66341
6.19	1.5804	68841
6.29	1.6332	71140
6.39	1.6883	73540
6.49	1.7393	75765
6.59	1.7841	77715
6.69	1.8329	79839
6.79	1.8748	81664
6.89	1.9373	84389
6.99	2.0067	87413
7.09	2.0773	90488
7.19	2.1496	93637
7.29	2.2214	96762
7.39	2.2902	99762
7.49	2.3757	103486
7.59	2.4796	108011
7.69	2.5909	112860
7.79	2.6965	117459
7.89	2.8004	121984
7.99	2.9082	126683
8.09	3.0442	132607
8.19	3.1802	138532
8.29	3.3099	144181
8.39	3.4522	150380
8.49	3.5963	156654
8.59	3.7208	162078
8.69	3.8562	167978
8.79	4.0008	174277
8.89	4.1437	180501
8.99	4.2751	186225
9.09	4.3911	191274
9.19	4.4921	195674
9.29	4.5976	200273
9.39	4.7101	205173
9.49	4.8214	210022
9.59	4.9201	214321
9.69	5.0177	218571
9.79	5.1078	222495
9.89	5.1904	226095
9.99	5.2484	228619
10.09	5.3264	232019

Stage [ft]	Area [ac]	Area [ft2]
10.19	5.3798	234344
10.29	5.4320	236618
10.39	5.4647	238043
10.49	5.4911	239193
10.59	5.5175	240343
10.69	5.5502	241768
10.79	5.5841	243243
10.89	5.6174	244692
10.99	5.6484	246042
11.09	5.6828	247542
11.19	5.7120	248817
11.29	5.7499	250467
11.39	5.7832	251916
11.49	5.8176	253416
11.59	5.8498	254816
11.69	5.8808	256166
11.79	5.9089	257391
11.89	5.9433	258890
11.99	5.9777	260390
12.09	6.0116	261865
12.19	6.0455	263340
12.29	6.0741	264590
12.39	6.1046	265915
12.49	6.1344	267214
12.59	6.1671	268639
12.69	6.1998	270064
12.79	6.2331	271514
12.89	6.2647	272889
12.99	6.2974	274313
13.09	6.3255	275538
13.19	6.3593	277013
13.29	6.3915	278413
13.39	6.4196	279638
13.49	6.4558	281212
13.59	6.4908	282737
13.69	6.5229	284137
13.79	6.5567	285612
13.89	6.5889	287012
13.99	6.6296	288786
14.09	6.6623	290211
14.19	6.7128	292411
14.29	6.7570	294336
14.39	6.7909	295811
14.49	6.8259	297335
14.59	6.8683	299185
14.69	6.9102	301010
14.79	6.9366	302160
14.89	6.9693	303584
14.99	6.9940	304659

Stage [ft]	Area [ac]	Area [ft2]
15.09	7.0204	305809
15.19	7.0480	307009
15.29	7.0703	307984
15.39	7.0841	308584
15.49	7.0884	308772
15.59	7.0884	308772

Comment:

Node: B-4

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.24	0.0006	25
2.30	0.0012	54
2.40	0.0016	68
2.50	0.0023	100
2.60	0.0036	158
2.70	0.0051	221
2.80	0.0065	284
2.90	0.0081	354
3.00	0.0098	425
3.10	0.0138	600
3.20	0.0218	950
3.30	0.0284	1237
3.40	0.0350	1525
3.50	0.0453	1975
3.60	0.0637	2775
3.70	0.1021	4449
3.80	0.1492	6499
3.90	0.2324	10124
4.00	0.3208	13973
4.10	0.4304	18747
4.20	0.5595	24372
4.30	0.7185	31296
4.40	0.8963	39045
4.50	1.0897	47469
4.59	1.2745	55518
4.69	1.5345	66841
4.79	1.8197	79264
4.89	2.1422	93313
4.99	2.4939	108636

Stage [ft]	Area [ac]	Area [ft2]
5.09	2.9140	126933
5.19	3.4098	148530
5.29	4.0169	174977
5.39	4.6413	202173
5.49	5.4946	239343
5.59	6.2463	272089
5.69	7.1581	311808
5.79	8.1176	353603
5.89	8.9485	389798
5.99	9.7140	423143
6.09	10.5255	458489
6.19	11.3237	493259
6.29	12.1150	527730
6.39	12.9092	562325
6.49	13.7327	598195
6.59	14.6170	636715
6.69	15.6309	680884
6.79	16.6753	726378
6.89	17.7869	774797
6.99	19.1291	833264
7.09	20.4145	889256
7.19	21.5536	938875
7.29	22.5722	983244
7.39	23.6034	1028163
7.49	24.5261	1068357
7.59	25.2457	1099703
7.69	25.9303	1129524
7.79	26.6235	1159720
7.89	27.3563	1191641
7.99	28.1379	1225686
8.09	28.8271	1255707
8.19	29.3940	1280404
8.29	30.0184	1307600
8.39	30.7093	1337696
8.49	31.3572	1365918
8.59	31.9826	1393164
8.69	32.6265	1421210
8.79	33.1774	1445207
8.89	33.6479	1465704
8.99	34.0835	1484677
9.09	34.4674	1501400
9.19	34.7887	1515398
9.29	35.0980	1528871
9.39	35.3746	1540919
9.49	35.5399	1548118
9.59	35.5735	1549582
9.69	35.5735	1549582

Comment:

Node: B-40

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.90 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.90	0.0006	25
4.01	0.0007	32
4.11	0.0009	39
4.21	0.0011	46
4.30	0.0023	100
4.40	0.0109	475
4.50	0.0316	1375
4.60	0.0574	2500
4.70	0.1148	4999
4.80	0.1813	7899
4.90	0.2542	11074
5.00	0.3277	14273
5.10	0.4040	17598
5.20	0.4992	21747
5.30	0.6352	27671
5.40	0.8395	36570
5.50	1.2395	53993
5.60	1.8495	80564
5.70	2.6311	114610
5.80	3.3742	146980
5.90	4.0358	175802
6.00	4.6430	202248
6.10	5.2690	229519
6.20	5.9594	259590
6.30	6.6623	290211
6.40	7.3992	322307
6.50	8.3276	362752
6.60	9.5166	414545
6.70	10.8336	471912
6.80	12.3101	536228
6.90	13.8142	601745
7.00	15.1581	660287
7.10	16.2036	705831
7.20	17.0019	740601
7.30	17.5562	764748
7.40	17.9298	781021
7.50	18.1920	792444
7.60	18.4261	802643
7.70	18.6431	812092
7.80	18.8187	819741
7.90	18.9960	827464
8.00	19.1389	833689

Stage [ft]	Area [ac]	Area [ft2]
8.10	19.2226	837338
8.20	19.3001	840713
8.30	19.3632	843462
8.40	19.4183	845862
8.50	19.4301	846373
8.60	19.4301	846373

Comment: This basin doesn't belong in this Town's model.

Node: B-5

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.66	0.0011	50
2.70	0.0029	125
2.80	0.0075	325
2.90	0.0115	500
3.00	0.0218	950
3.10	0.0379	1650
3.20	0.0511	2225
3.30	0.0620	2700
3.40	0.0717	3125
3.50	0.0809	3525
3.60	0.0901	3924
3.70	0.0998	4349
3.80	0.1165	5074
3.90	0.1380	6012
4.00	0.1561	6799
4.10	0.1871	8149
4.20	0.2192	9549
4.30	0.2611	11373
4.39	0.3214	13998
4.49	0.3954	17223
4.59	0.4786	20847
4.69	0.5767	25122
4.79	0.6748	29396
4.89	0.7976	34745
4.99	0.9371	40820
5.09	1.0524	45844
5.19	1.1815	51468
5.29	1.3319	58017
5.39	1.5052	65566

Stage [ft]	Area [ac]	Area [ft2]
5.49	1.6888	73565
5.59	1.8989	82714
5.69	2.1358	93038
5.79	2.4365	106136
5.89	2.7717	120734
5.99	3.1780	138432
6.09	3.7386	162853
6.19	4.3916	191299
6.29	5.0475	219871
6.39	5.8171	253391
6.49	6.5103	283587
6.59	7.2006	313658
6.69	7.8783	343179
6.79	8.5153	370925
6.89	9.1253	397497
6.99	9.7100	422969
7.09	10.2282	445541
7.19	10.7297	467388
7.29	11.2261	489010
7.39	11.7793	513106
7.49	12.4077	540478
7.59	13.0934	570349
7.69	13.8010	601170
7.79	14.7289	641589
7.89	15.4158	671510
7.99	15.9420	694432
8.09	16.3833	713655
8.19	16.7718	730577
8.29	17.1229	745875
8.39	17.3909	757549
8.49	17.6681	769622
8.59	17.9338	781196
8.69	18.2041	792969
8.79	18.4795	804967
8.89	18.7653	817416
8.99	19.0918	831639
9.09	19.3982	844987
9.19	19.6909	857735
9.29	19.9554	869259
9.39	20.1752	878833
9.49	20.3887	888131
9.59	20.6842	901005
9.69	21.1295	920402
9.79	21.4784	935600
9.89	21.6529	943199
9.99	21.7028	945374
10.09	21.7344	946749
10.19	21.7539	947598
10.29	21.7705	948323

Stage [ft]	Area [ac]	Area [ft2]
10.39	21.7741	948481
10.49	21.7741	948481

Comment:

Node: B-6

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.28	0.0006	25
0.30	0.0007	29
0.40	0.0011	49
0.50	0.0016	69
0.60	0.0033	146
0.70	0.0046	200
0.80	0.0075	325
0.89	0.0132	575
1.00	0.0207	900
1.09	0.0310	1350
1.20	0.0511	2225
1.30	0.0683	2975
1.40	0.0844	3675
1.50	0.1044	4549
1.60	0.1182	5149
1.70	0.1337	5824
1.80	0.1526	6649
1.90	0.1796	7824
2.00	0.2158	9399
2.10	0.2611	11373
2.20	0.3294	14348
2.30	0.4155	18098
2.40	0.5239	22822
2.50	0.6347	27646
2.60	0.7712	33596
2.70	0.9164	39920
2.80	1.0576	46069
2.90	1.2171	53018
3.00	1.3692	59642
3.10	1.5482	67441
3.20	1.7410	75840
3.30	1.9436	84664
3.40	2.1622	94187

Stage [ft]	Area [ac]	Area [ft2]
3.50	2.3820	103761
3.60	2.6093	113660
3.70	2.8325	123384
3.80	3.0649	133507
3.90	3.2864	143156
4.00	3.5326	153879
4.10	3.7994	165503
4.20	4.0336	175702
4.30	4.2912	186925
4.40	4.5615	198698
4.50	4.8432	210972
4.59	5.0602	220421
4.69	5.3230	231869
4.79	5.5508	241793
4.89	5.7780	251691
4.99	6.0047	261565
5.09	6.2285	271314
5.19	6.4230	279788
5.29	6.6411	289286
5.39	6.8603	298835
5.49	7.0721	308059
5.59	7.2729	316808
5.69	7.5099	327131
5.79	7.7142	336030
5.89	7.9156	344804
5.99	8.1509	355053
6.09	8.4017	365976
6.19	8.6536	376950
6.29	8.9416	389498
6.39	9.2814	404296
6.49	9.6498	420344
6.59	10.0641	438391
6.69	10.4887	456889
6.79	10.9891	478686
6.89	11.5699	503983
6.99	12.2349	532954
7.09	13.0435	568174
7.19	13.7792	600220
7.29	14.5642	634415
7.39	15.3521	668736
7.49	16.1158	702006
7.59	16.8091	732202
7.69	17.5384	763973
7.79	18.3045	797344
7.89	19.1572	834489
7.99	20.0926	875233
8.09	21.0848	918452
8.19	22.0758	961622
8.29	23.1449	1008190

Stage [ft]	Area [ac]	Area [ft2]
8.39	24.2059	1054409
8.49	25.3955	1106227
8.59	26.5277	1155546
8.69	27.5394	1199615
8.79	28.4925	1241134
8.89	29.4399	1282404
8.99	30.5073	1328898
9.09	31.7565	1383315
9.19	32.9708	1436208
9.29	34.0565	1483502
9.39	34.9821	1523822
9.49	35.8154	1560117
9.59	36.4678	1588538
9.69	36.9935	1611435
9.79	37.4393	1630857
9.89	37.7968	1646430
9.99	38.1457	1661628
10.09	38.4711	1675801
10.19	38.7523	1688050
10.29	39.0111	1699323
10.39	39.2596	1710147
10.49	39.4966	1720470
10.59	39.7209	1730244
10.69	39.9356	1739593
10.79	40.1112	1747242
10.89	40.2741	1754341
10.99	40.4434	1761715
11.09	40.6379	1770189
11.19	40.8089	1777638
11.29	40.9868	1785387
11.39	41.1670	1793236
11.49	41.3082	1799385
11.59	41.4591	1805959
11.69	41.6204	1812983
11.79	41.7506	1818657
11.89	41.8992	1825131
11.99	42.0358	1831080
12.09	42.1621	1836580
12.19	42.2963	1842429
12.29	42.4151	1847603
12.39	42.5362	1852878
12.49	42.6504	1857852
12.59	42.7749	1863276
12.69	42.9023	1868825
12.79	43.0314	1874450
12.89	43.1560	1879874
12.99	43.2684	1884773
13.09	43.4039	1890673
13.19	43.5227	1895847

Stage [ft]	Area [ac]	Area [ft2]
13.29	43.6443	1901146
13.39	43.7597	1906170
13.49	43.8836	1911570
13.59	44.0007	1916669
13.69	44.1103	1921443
13.79	44.2227	1926343
13.89	44.3467	1931742
13.99	44.4666	1936966
14.09	44.5923	1942441
14.19	44.7157	1947815
14.29	44.8413	1953289
14.39	44.9584	1958388
14.49	45.0893	1964088
14.59	45.2057	1969162
14.69	45.3291	1974536
14.79	45.4370	1979236
14.89	45.5409	1983760
14.99	45.6264	1987485
15.09	45.7182	1991484
15.19	45.8111	1995534
15.29	45.9144	2000033
15.39	46.0189	2004582
15.49	46.1118	2008632
15.59	46.2060	2012731
15.69	46.3110	2017306
15.79	46.4022	2021280
15.89	46.5055	2025779
15.99	46.6008	2029929
16.09	46.7006	2034278
16.19	46.7982	2038528
16.29	46.9003	2042977
16.39	47.0099	2047752
16.49	47.1132	2052251
16.59	47.1993	2056000
16.69	47.3008	2060425
16.79	47.3823	2063974
16.89	47.4736	2067949
16.99	47.5677	2072048
17.09	47.6566	2075923
17.19	47.7364	2079397
17.29	47.8230	2083172
17.39	47.9028	2086646
17.49	47.9831	2090146
17.59	48.0635	2093645
17.69	48.1547	2097620
17.79	48.2356	2101144
17.89	48.3217	2104894
17.99	48.3969	2108168
18.09	48.4887	2112168

Stage [ft]	Area [ac]	Area [ft2]
18.19	48.5736	2115867
18.29	48.6454	2118992
18.39	48.7326	2122792
18.49	48.8141	2126341
18.59	48.9053	2130316
18.69	49.0281	2135665
18.79	49.1303	2140114
18.89	49.2290	2144414
19.00	49.3179	2148288
19.10	49.3891	2151388
19.20	49.4539	2154212
19.30	49.5314	2157587
19.40	49.5997	2160561
19.50	49.6685	2163561
19.60	49.7288	2166186
19.70	49.7976	2169185
19.80	49.8562	2171735
19.90	49.9176	2174410
20.00	49.9801	2177134
20.10	50.0484	2180109
20.20	50.1121	2182884
20.30	50.1712	2185458
20.40	50.2384	2188383
20.50	50.2917	2190707
20.60	50.3583	2193607
20.70	50.4237	2196457
20.80	50.4880	2199256
20.90	50.5459	2201781
21.00	50.6102	2204581
21.10	50.6739	2207355
21.20	50.7456	2210480
21.30	50.8099	2213279
21.40	50.8782	2216254
21.50	50.9362	2218779
21.60	51.0159	2222253
21.70	51.0664	2224453
21.80	51.1318	2227303
21.90	51.1972	2230152
22.00	51.2764	2233602
22.10	51.3442	2236551
22.20	51.4119	2239501
22.30	51.4813	2242526
22.40	51.5439	2245250
22.50	51.6064	2247975
22.60	51.6684	2250674
22.70	51.7464	2254074
22.80	51.8107	2256874
22.90	51.8738	2259623
23.00	51.9387	2262448

Stage [ft]	Area [ac]	Area [ft2]
23.10	52.0001	2265123
23.20	52.0672	2268047
23.30	52.1366	2271072
23.40	52.2141	2274446
23.50	52.2824	2277421
23.60	52.3581	2280720
23.70	52.4304	2283870
23.80	52.4982	2286820
23.90	52.5751	2290169
24.00	52.6491	2293394
24.10	52.7139	2296218
24.20	52.7971	2299843
24.30	52.8660	2302842
24.40	52.9394	2306042
24.50	53.0152	2309342
24.60	53.0915	2312666
24.70	53.1621	2315741
24.80	53.2413	2319190
24.90	53.3176	2322515
25.00	53.3847	2325439
25.10	53.4588	2328664
25.20	53.5362	2332039
25.30	53.6137	2335413
25.40	53.6963	2339013
25.50	53.7681	2342137
25.60	53.8444	2345462
25.70	53.9201	2348761
25.80	53.9930	2351936
25.90	54.0636	2355011
26.00	54.1371	2358210
26.10	54.2111	2361435
26.20	54.2891	2364834
26.30	54.3649	2368134
26.40	54.4429	2371533
26.50	54.5187	2374833
26.60	54.5933	2378082
26.70	54.6765	2381707
26.80	54.7666	2385631
26.90	54.8440	2389006
27.00	54.9301	2392756
27.10	55.0202	2396680
27.20	55.1069	2400454
27.30	55.1883	2404004
27.40	55.2744	2407753
27.50	55.3714	2411978
27.60	55.4649	2416052
27.70	55.5562	2420027
27.80	55.6509	2424151
27.90	55.7346	2427801

Stage [ft]	Area [ac]	Area [ft2]
28.00	55.8242	2431700
28.10	55.9252	2436100
28.20	56.0376	2440999
28.30	56.1501	2445898
28.40	56.2362	2449648
28.50	56.3469	2454472
28.60	56.4451	2458747
28.70	56.5575	2463646
28.80	56.6683	2468470
28.90	56.7676	2472795
29.00	56.8892	2478094
29.10	56.9988	2482868
29.20	57.1119	2487793
29.30	57.2295	2492917
29.40	57.3477	2498066
29.50	57.4699	2503391
29.60	57.5836	2508340
29.70	57.7006	2513439
29.80	57.8229	2518764
29.90	57.9439	2524038
30.00	58.0708	2529562
30.10	58.2033	2535336
30.20	58.3301	2540861
30.30	58.4598	2546510
30.40	58.6107	2553084
30.50	58.7479	2559058
30.60	58.8724	2564483
30.70	58.9906	2569632
30.80	59.1146	2575031
30.90	59.2093	2579156
31.00	59.3108	2583580
31.10	59.3935	2587180
31.20	59.4600	2590079
31.30	59.5409	2593604
31.40	59.5932	2595878
31.50	59.6477	2598253
31.60	59.6901	2600103
31.70	59.7452	2602502
31.80	59.7877	2604352
31.90	59.8325	2606302
32.00	59.8772	2608252
32.10	59.9203	2610126
32.20	59.9507	2611451
32.30	60.0006	2613626
32.40	60.0258	2614726
32.50	60.0597	2616201
32.60	60.0924	2617625
32.70	60.1211	2618875
32.80	60.1527	2620250

Stage [ft]	Area [ac]	Area [ft2]
32.90	60.1681	2620921
33.00	60.1681	2620921

Comment:

Node: B-7

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.83	2.0400	88863
-1.80	2.0406	88888
-1.70	2.0423	88963
-1.60	3.4543	150467
-1.49	3.4660	150980
-1.40	4.9477	215521
-1.29	4.9603	216071
-1.19	4.9672	216371
-1.09	4.9747	216696
-0.99	4.9867	217221
-0.89	4.9970	217671
-0.79	5.0108	218271
-0.69	5.0240	218846
-0.59	5.0355	219346
-0.49	5.0464	219821
-0.39	5.0596	220396
-0.29	5.0688	220796
-0.19	5.0837	221445
-0.09	5.0963	221995
0.00	5.1152	222820
0.10	5.1342	223645
0.20	5.1566	224620
0.30	5.1778	225545
0.40	5.1939	226245
0.50	5.2082	226870
0.60	5.2243	227570
0.70	5.2398	228245
0.80	5.2576	229019
0.90	5.2754	229794
1.00	5.2937	230594
1.10	5.3075	231194
1.20	5.3207	231769
1.30	5.3402	232619

Stage [ft]	Area [ac]	Area [ft2]
1.40	5.3695	233894
1.50	5.3844	234544
1.60	5.4010	235269
1.70	5.4343	236718
1.80	5.4630	237968
1.90	5.4957	239393
2.00	5.5227	240568
2.10	5.5462	241593
2.20	5.5726	242743
2.30	5.5984	243867
2.40	5.6420	245767
2.50	5.7138	248892
2.60	5.7947	252416
2.70	5.9066	257291
2.80	6.1057	265964
2.90	6.3542	276788
3.00	6.6566	289961
3.10	7.0898	308834
3.20	7.6425	332906
3.30	8.2863	360952
3.40	8.9445	389623
3.50	9.6601	420794
3.60	10.3631	451415
3.70	11.1418	485335
3.80	11.9589	520930
3.90	12.9631	564675
4.00	14.0776	613218
4.10	15.2809	665636
4.20	16.7557	729878
4.30	18.5960	810042
4.40	20.3996	888606
4.50	22.2084	967396
4.60	23.9942	1045185
4.70	25.6480	1117226
4.80	27.2806	1188341
4.89	28.6205	1246709
4.99	30.4040	1324398
5.09	32.0498	1396089
5.19	33.7248	1469054
5.29	35.3368	1539269
5.39	36.7352	1600186
5.49	37.8577	1649080
5.59	38.5520	1679326
5.69	39.0231	1699848
5.79	39.4759	1719570
5.89	39.8483	1735793
5.99	40.1863	1750516
6.09	40.4778	1763215
6.19	40.7378	1774538

Stage [ft]	Area [ac]	Area [ft2]
6.29	40.9381	1783262
6.39	41.0901	1789886
6.49	41.2147	1795310
6.59	41.3415	1800835
6.69	41.4671	1806309
6.79	41.5986	1812033
6.89	41.7449	1818407
6.99	41.8683	1823781
7.09	41.9905	1829106
7.19	42.1213	1834805
7.29	42.2556	1840654
7.39	42.3359	1844154
7.49	42.3956	1846753
7.59	42.4433	1848828
7.69	42.4811	1850478
7.79	42.5167	1852028
7.89	42.5511	1853527
7.99	42.5879	1855127
8.09	42.5933	1855365
8.19	42.5933	1855365

Comment: Normal water levels at 2.00 NGVD or 0.5 NAVD

Node: B-8

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.67 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.67	0.0006	25
3.70	0.0013	58
3.80	0.0020	87
3.90	0.0025	108
4.00	0.0034	150
4.09	0.0046	200
4.20	0.0071	308
4.30	0.0098	425
4.39	0.0121	525
4.49	0.0189	825
4.60	0.0362	1575
4.69	0.0482	2100
4.79	0.0671	2925
4.89	0.0889	3874
4.99	0.1228	5349

Stage [ft]	Area [ac]	Area [ft2]
5.09	0.1750	7624
5.19	0.2634	11473
5.29	0.3896	16973
5.39	0.5463	23797
5.49	0.7035	30646
5.59	0.8906	38795
5.69	1.1414	49718
5.79	1.4220	61942
5.89	1.7726	77215
5.99	2.1749	94737
6.09	2.5393	110610
6.19	2.8709	125058
6.29	3.2221	140356
6.39	3.5343	153954
6.49	3.8161	166228
6.59	4.0416	176051
6.69	4.2321	184350
6.79	4.3836	190949
6.89	4.4961	195849
6.99	4.5621	198723
7.09	4.5965	200223
7.19	4.6200	201248
7.30	4.6281	201598
7.40	4.6328	201806
7.50	4.6361	201948
7.60	4.6381	202036
7.70	4.6392	202083
7.80	4.6433	202263
7.90	4.6433	202263

Comment:

Node: B-9

Scenario: Future
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.33	0.0109	475
-1.30	0.0109	476
-1.20	0.0110	479
-1.10	0.0111	483
-1.00	0.0112	486
-0.90	0.0112	489

Stage [ft]	Area [ac]	Area [ft2]
-0.80	0.0113	493
-0.70	0.0114	496
-0.60	0.0115	500
-0.50	0.0117	508
-0.40	0.0119	516
-0.30	0.0121	525
-0.20	0.0125	544
-0.10	0.0129	562
0.00	0.0133	578
0.10	0.0137	595
0.20	0.0145	629
0.30	0.0150	652
0.40	0.0153	668
0.50	0.0159	694
0.60	0.0169	737
0.70	0.0177	770
0.80	0.0181	790
0.90	0.0191	830
1.00	0.0201	875
1.09	0.0207	900
1.20	0.0230	1002
1.30	0.0232	1010
1.40	0.0234	1018
1.50	0.0237	1031
1.60	0.0243	1060
1.70	0.0247	1075
1.80	0.0249	1085
1.90	0.0252	1096
2.00	0.0253	1104
2.10	0.0255	1110
2.20	0.0256	1116
2.30	0.0258	1122
2.40	0.0265	1156
2.50	0.0269	1172
2.60	0.0277	1206
2.70	0.0279	1217
2.80	0.0298	1300
2.90	0.0303	1321
3.00	0.0308	1341
3.10	0.0311	1354
3.20	0.0312	1360
3.30	0.0314	1367
3.40	0.0315	1373
3.50	0.0321	1400
3.60	0.0333	1450
3.70	0.0362	1575
3.80	0.0390	1700
3.90	0.0499	2175
4.00	0.0648	2825

Stage [ft]	Area [ac]	Area [ft2]
4.10	0.0821	3575
4.20	0.1079	4699
4.30	0.1343	5849
4.40	0.1773	7724
4.50	0.2163	9424
4.59	0.2473	10774
4.69	0.2875	12523
4.79	0.3311	14423
4.89	0.3644	15873
4.99	0.3937	17148
5.09	0.4310	18772
5.19	0.4608	20072
5.29	0.5079	22122
5.39	0.5647	24597
5.49	0.6255	27246
5.59	0.7317	31871
5.69	0.8436	36745
5.79	1.0455	45544
5.89	1.2510	54493
5.99	1.4117	61492
6.09	1.5281	66566
6.19	1.6343	71191
6.29	1.7095	74465
6.39	1.7560	76490
6.49	1.7910	78015
6.59	1.8243	79464
6.69	1.8478	80489
6.79	1.8673	81339
6.89	1.8845	82089
7.00	1.8977	82664
7.09	1.9098	83189
7.19	1.9230	83764
7.29	1.9367	84364
7.39	1.9539	85114
7.49	1.9654	85614
7.59	1.9662	85648
7.69	1.9662	85648

Comment:

Node: DISCHARGE TO GOLF COURSE

Scenario: Future
Type: Time/Stage
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Boundary Stage:

Year	Month	Day	Hour	Stage [ft]
0	0	0	0.0000	0.00
0	0	0	10.0000	0.99
0	0	0	20.0000	1.79
0	0	0	30.0000	2.15
0	0	0	40.0000	2.55
0	0	0	50.0000	2.53
0	0	0	60.0000	3.22
0	0	0	64.0000	4.81
0	0	0	70.0000	4.50
0	0	0	80.0000	3.42
0	0	0	90.0000	2.71
0	0	0	96.0000	2.50

Comment: BASED ON PREVIOUS STUDY CONDUCTED FOR THE GOLF COURSE.
USED PREVIOUS DATA AS A BASIS FOR THE TAILWATER CONDITIONS FROM HH ICPR MODEL

Node: FUTURE EXFIL - INFINITY AZURE

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.07	0.85	36852
3.13	1.69	73704

Comment: INCLUDES STORAGE FOR BOTH SW 55TH AVE AND INFINITY AZURE

Node: FUTURE EXFIL - N PARK RD

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.07	0.26	11522
3.13	0.53	23043

Comment:

Node: FUTURE EXFIL - S PARK RD

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.07	0.07	3071
3.13	0.14	6142

Comment:

Node: FUTURE EXFIL - SW 31ST AVE

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.27	0.67	29185
3.53	1.34	58370

Comment:

Node: FUTURE EXFIL - SW 36TH CT

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
3.17	0.12	5249
5.33	0.24	10498

Comment:

Node: FUTURE EXFIL - SW 52ND AVE

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
3.77	0.89	38594
6.53	1.77	77188

Comment:

Node: STORAGE ON 52ND

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.62	0.86	37462
4.23	1.72	74923

Comment: Approx. 1980 LF of 5'x5' Exfil running along SW 52nd St

1.72 ac-ft

Node: STORAGE ON SITE 19

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 2.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.66	0.11	4574

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.32	0.21	9148

Comment: SW 31ST ST DRAINAGE IMPROVEMENTS

https://dpep.broward.org/Enviros/Default.aspx?PossePresentation=SurfaceWaterLicense&PosseObjectId=33557971

0.21 AC-FT
TOP OF TRENCH: 3.32 NAVD

WT:2

BOT OF TRENCH: -0.93 NAVD

Node: STORAGE ON SITE 1

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.50	2.68	116741
4.00	4.34	189050
5.00	7.80	339768
6.00	11.37	495277
7.00	16.69	727016
8.00	25.49	1110344
9.00	37.78	1645697
10.00	53.55	2332638
11.00	71.07	3095809

Comment:

Node: STORAGE ON SITE 11

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.00	0.39	16988

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.78	33977

Comment: NEED MORE INFORMATION

Node: STORAGE ON SITE 12

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
9.20	0.04	1742
9.40	0.16	6970
9.60	0.36	15682
9.80	0.61	26572
10.00	0.93	40511
10.20	1.28	55757
10.40	1.64	71438
10.60	2.00	87120
10.80	2.36	102802

Comment:

Node: STORAGE ON SITE 13

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
4.00	0.00	0
5.00	0.09	3920
6.00	0.18	7841
7.00	0.27	11761
8.00	0.36	15682
9.00	0.49	21344
10.00	0.71	30928
11.00	1.65	71874
12.00	3.20	139392

Comment: K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2004 Apartment complex discharging to onsite retention\Calculations - Revised .pdf.pdf

Node: STORAGE ON SITE 14

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.00	0.27	11761
4.50	0.54	23522

Comment:
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=77827255&hash=1DC8E684EBA90B369411BEA9A491E7D2E453F1F2

Node: STORAGE ON SITE 15

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 2.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.50	0.16	6970
3.00	0.33	14375
3.50	0.51	22216
4.00	0.71	30928
4.50	0.93	40511
5.00	1.16	50530
5.50	1.41	61420
6.00	1.67	72745
6.50	1.72	74923
7.00	1.72	74923

Comment: STORAGE IS USED BY MULTIPLE BASINS IN THE AREA

Node: STORAGE ON SITE 17

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.00	2.52	109858
4.50	5.04	219717

Comment: USING PERMIT FROM BROWARD THAT IS FOR MUCH LARGER AREA AND ASSUMING THAT STAGE STORAGE IS 1/5 OF THAT NUMBER FOR A ROUGH ESTIMATE
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=37159263&hash=D3675B834D18CCEC4310DCD6F0656AEC0FCED9C3

Node: STORAGE ON SITE 18

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
4.50	0.00	0
5.00	3.61	157252
5.50	7.54	328442
6.00	11.79	513572
6.50	16.36	712642
7.00	21.77	948301
7.50	28.52	1242331
8.00	36.61	1594732
8.50	46.04	2005502
9.00	57.37	2499037
9.50	70.64	3077078
10.00	85.34	3717410
10.50	101.47	4420033
11.00	119.03	5184947
11.50	138.02	6012151

Comment: NEEDS MORE INFORMATION

Node: STORAGE ON SITE 2

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.02	871
4.50	0.04	1742

Comment:

Node: STORAGE ON SITE 20

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
1.50	1.29	56192
2.00	2.58	112385

Comment: 25TH ST DRAINAGE IMPROVEMENTS

2.58AC-FT STORAGE

DRAINAGE CALC:
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=71947644&hash=56720218B15DFE73AD2ACA8E756638FCF0B8E06F

PLANS:
K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Receivables\20240222 25th St Bid Plans

Node: STORAGE ON SITE 21

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.67	0.90	39204
4.33	1.80	78408

Comment: John P Lyons Phase 2:
Will be constructed after EPA clean up.

No drainage report given but from plan set have calculated exfil volume of 1.80 Ac-Ft

Node: STORAGE ON SITE 3

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
5.00	0.00	0
5.50	0.00	0
6.00	8.92	388555
6.50	18.58	809345
7.00	28.99	1262804
7.50	40.15	1748934
8.00	52.05	2267298
8.50	64.70	2818332
9.00	77.72	3385483
9.50	90.74	3952634
10.00	103.75	4519350

Comment:

Node: STORAGE ON SITE 4

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.50	7.00	304920
3.00	14.00	609840
3.50	21.00	914760
4.00	28.00	1219680
4.50	35.00	1524600
5.00	42.00	1829520
5.50	49.00	2134440
6.00	56.00	2439360
6.50	63.00	2744280
7.00	70.00	3049200
7.50	78.31	3411184
8.00	90.57	3945229
8.50	108.08	4707965
9.00	130.85	5699826
9.50	158.87	6920377
10.00	191.51	8342176

Comment:

Node: STORAGE ON SITE 5

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.16	6970
4.00	0.32	13939
4.50	0.48	20909
5.00	0.64	27878
5.50	0.79	34412
6.00	0.95	41382
6.50	1.11	48352
7.00	1.22	53143
7.50	1.49	64904
8.00	1.86	81022
8.50	2.33	101495
9.00	2.89	125888
9.50	3.56	155074
10.00	4.32	188179
10.50	5.37	233917
11.00	6.88	299693
11.50	8.86	385942
12.00	11.19	487436

Comment:

Node: STORAGE ON SITE 6

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.63	0.36	15464
5.75	0.71	30928

Comment:

https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=72592592&hash=BAF6E372B1EA46D84A6355CC91B4A7800C3A1DDA

Node: STORAGE ON SITE 8

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
6.00	0.27	11761
7.00	0.53	23087
8.00	0.66	28750

Comment:

Node: STORAGE ON SITE 9

Scenario: Future
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.01	436
3.75	0.02	871
4.00	0.03	1307
4.25	0.06	2614
4.50	0.07	3049
4.75	0.10	4356
5.00	0.13	5663
5.25	0.16	6970
5.50	0.20	8712
5.75	0.24	10454
6.00	0.28	12197
6.25	0.33	14375
6.50	0.38	16553
6.75	0.44	19166
7.00	0.50	21780
7.25	0.59	25700
7.50	0.72	31363
7.75	0.90	39204
8.00	1.13	49223
8.25	1.40	60984

Stage [ft]	Volume [ac-ft]	Volume [ft3]
8.50	1.73	75359
8.75	2.12	92347
9.00	2.63	114563
9.25	3.23	140699
9.50	3.94	171626
9.75	4.75	206910
10.00	5.66	246550

Comment: RECREATION GREEN AREA USED AS A STORAGE SITE

Node: B-1

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.60 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.60	0.0006	25
3.70	0.0024	104
3.80	0.0031	137
3.90	0.0042	183
4.00	0.0058	254
4.10	0.0075	325
4.20	0.0115	500
4.30	0.0172	750
4.40	0.0316	1375
4.50	0.0545	2375
4.60	0.1354	5899
4.70	0.3018	13148
4.80	0.4883	21272
4.90	0.7213	31421
5.00	0.9899	43119
5.10	1.2516	54518
5.20	1.5149	65991
5.30	1.8042	78590
5.40	2.0871	90913
5.50	2.3987	104486
5.60	2.7533	119934
5.70	3.1527	137332
5.80	3.6445	158754
5.90	4.0726	177401
6.00	4.4542	194024
6.10	4.8387	210772
6.20	5.2306	227845
6.30	5.6145	244567

Stage [ft]	Area [ac]	Area [ft2]
6.40	6.1080	266064
6.50	6.6537	289836
6.60	7.2936	317708
6.70	8.0069	348778
6.80	8.7649	381799
6.90	9.5631	416569
7.00	10.3171	449415
7.10	11.1240	484560
7.20	11.9618	521055
7.30	12.7353	554751
7.40	13.5094	588471
7.50	14.1877	618017
7.60	14.7673	643264
7.70	15.2947	666236
7.80	15.8226	689233
7.90	16.3861	713780
8.00	16.9628	738901
8.10	17.5223	763273
8.20	18.0818	787645
8.30	18.6580	812741
8.40	19.2341	837838
8.50	19.7890	862010
8.60	20.3325	885682
8.70	20.7846	905379
8.80	21.1571	921602
8.90	21.3705	930901
9.00	21.5157	937225
9.10	21.5978	940801
9.20	21.5978	940801

Comment:

Node: B-10

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.33	0.0184	800
-1.30	0.0196	852
-1.20	0.0203	883
-1.10	0.0224	975
-1.00	0.0230	1000
-0.90	0.0249	1083

Stage [ft]	Area [ac]	Area [ft2]
-0.80	0.0266	1158
-0.70	0.0277	1207
-0.60	0.0285	1244
-0.50	0.0302	1315
-0.40	0.0311	1355
-0.30	0.0326	1420
-0.20	0.0359	1565
-0.10	0.0413	1800
0.00	0.0494	2150
0.09	0.0545	2375
0.20	0.0625	2725
0.30	0.0660	2875
0.40	0.0708	3083
0.50	0.0729	3175
0.60	0.0760	3312
0.70	0.0792	3450
0.80	0.0834	3633
0.90	0.0867	3775
0.99	0.0895	3899
1.09	0.0941	4099
1.20	0.1012	4408
1.30	0.1062	4624
1.40	0.1106	4816
1.50	0.1159	5049
1.60	0.1217	5299
1.70	0.1261	5493
1.80	0.1314	5724
1.90	0.1343	5849
2.00	0.1400	6099
2.10	0.1458	6349
2.20	0.1538	6699
2.30	0.1618	7049
2.40	0.1681	7324
2.50	0.1762	7674
2.60	0.1854	8074
2.70	0.1917	8349
2.80	0.2014	8774
2.90	0.2129	9274
3.00	0.2196	9565
3.10	0.2304	10036
3.20	0.2381	10374
3.30	0.2479	10799
3.40	0.2663	11598
3.50	0.2863	12473
3.60	0.3162	13773
3.70	0.3483	15173
3.80	0.3954	17223
3.90	0.4470	19472
4.00	0.5050	21997

Stage [ft]	Area [ac]	Area [ft2]
4.10	0.5779	25172
4.20	0.7282	31721
4.30	0.9486	41319
4.40	1.2716	55393
4.50	1.6590	72265
4.59	2.0549	89513
4.69	2.5243	109960
4.79	3.0511	132907
4.89	3.6772	160179
4.99	4.4163	192374
5.09	5.2897	230419
5.19	6.4810	282312
5.29	8.2025	357302
5.39	10.4847	456714
5.49	13.2650	577823
5.59	16.6685	726078
5.69	20.1775	878933
5.79	23.9161	1041786
5.89	27.6937	1206339
5.99	31.1075	1355044
6.09	33.9590	1479252
6.19	36.3571	1583714
6.29	38.2680	1666952
6.39	39.9046	1738243
6.49	41.5337	1809208
6.59	43.1399	1879174
6.69	44.8040	1951664
6.79	46.2932	2016531
6.89	47.7347	2079322
6.99	49.1067	2139089
7.09	50.4145	2196057
7.19	51.7722	2255199
7.29	53.1483	2315141
7.39	54.5313	2375383
7.49	55.9372	2436625
7.59	57.3443	2497916
7.69	58.8093	2561733
7.79	60.2996	2626649
7.89	61.8369	2693615
7.99	63.3283	2758582
8.09	64.9689	2830047
8.19	66.5579	2899263
8.29	68.0063	2962354
8.39	69.3657	3021572
8.49	70.6494	3077489
8.59	71.7633	3126008
8.69	72.7376	3168452
8.79	73.6638	3208797
8.89	74.5108	3245692

Stage [ft]	Area [ac]	Area [ft2]
8.99	75.3630	3282812
9.09	76.1153	3315582
9.19	76.8624	3348128
9.29	77.6216	3381199
9.39	78.3263	3411894
9.49	79.0918	3445240
9.59	79.8315	3477461
9.69	80.5442	3508506
9.79	81.2965	3541277
9.89	82.0563	3574373
9.99	82.8276	3607968
10.09	83.6843	3645288
10.19	84.6484	3687283
10.29	85.9659	3744675
10.39	87.2536	3800767
10.49	87.7689	3823214
10.59	88.0260	3834413
10.69	88.2165	3842712
10.79	88.3634	3849111
10.89	88.5121	3855585
10.99	88.6383	3861084
11.09	88.8173	3868883
11.19	88.9614	3875158
11.29	89.0526	3879132
11.39	89.1548	3883581
11.49	89.2558	3887981
11.59	89.3459	3891905
11.69	89.4268	3895430
11.79	89.5025	3898729
11.89	89.5559	3901054
11.99	89.5903	3902554
12.09	89.6127	3903529
12.19	89.6270	3904154
12.29	89.6385	3904654
12.39	89.6431	3904854
12.50	89.6444	3904910
12.60	89.6457	3904969
12.70	89.6484	3905083
12.80	89.6488	3905104
12.90	89.6530	3905286
13.00	89.6543	3905343
13.09	89.6569	3905453
13.20	89.6589	3905540
13.29	89.6597	3905578
13.40	89.6602	3905600
13.50	89.6615	3905653
13.60	89.6619	3905671
13.70	89.6625	3905697
13.80	89.6635	3905741

Stage [ft]	Area [ac]	Area [ft2]
13.90	89.6651	3905813
14.00	89.6663	3905863
14.09	89.6672	3905903
14.20	89.6680	3905937
14.29	89.6689	3905978
14.40	89.6706	3906053
14.49	89.6729	3906153
14.60	89.6741	3906203
14.70	89.6759	3906284
14.80	89.6763	3906298
14.90	89.6774	3906347
15.00	89.6779	3906367
15.10	89.6785	3906397
15.20	89.6796	3906444
15.30	89.6816	3906531
15.40	89.6820	3906546
15.50	89.6824	3906566
15.60	89.6831	3906596
15.70	89.6838	3906628
15.80	89.6848	3906669
15.90	89.6861	3906728
16.00	89.6872	3906773
16.10	89.6883	3906823
16.20	89.6894	3906871
16.30	89.6903	3906908
16.39	89.6907	3906928
16.50	89.6909	3906937
16.60	89.6911	3906945
16.70	89.6913	3906953
16.80	89.6916	3906965
16.90	89.6918	3906976
17.00	89.6924	3907001
17.10	89.6927	3907012
17.20	89.6929	3907022
17.30	89.6934	3907043
17.40	89.6942	3907080
17.50	89.6942	3907080

Comment:

Node: B-11

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.58	19.8875	866300
4.00	23.2501	1012775
4.50	25.9642	1131002
5.00	41.6244	1813161
5.50	53.9220	2348844
6.00	58.6297	2553910
6.50	61.0130	2657725
7.00	61.0130	2657725

Comment:

Node: B-12

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.58	5.3562	233315
4.00	19.3591	843282
4.50	25.7000	1119494
5.00	29.3028	1276432
5.50	31.4405	1369549
6.00	33.8904	1476267
6.50	34.3276	1495309
7.00	34.4913	1502439
7.50	34.4913	1502439

Comment:

Node: B-13

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.66 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.66	0.0006	25
5.70	0.0008	33
5.80	0.0012	52
5.90	0.0017	76

Stage [ft]	Area [ac]	Area [ft2]
6.00	0.0020	86
6.10	0.0022	95
6.20	0.0027	116
6.30	0.0030	130
6.40	0.0032	138
6.50	0.0034	146
6.60	0.0038	166
6.69	0.0046	200
6.80	0.0054	233
6.89	0.0063	275
6.99	0.0069	300
7.10	0.0071	311
7.20	0.0074	321
7.30	0.0083	362
7.40	0.0090	393
7.50	0.0096	417
7.59	0.0109	475
7.70	0.0113	491
7.80	0.0119	520
7.90	0.0141	615
8.00	0.0149	650
8.10	0.0160	697
8.20	0.0189	825
8.29	0.0252	1100
8.39	0.0367	1600
8.49	0.0625	2725
8.59	0.1010	4399
8.69	0.1475	6424
8.79	0.1865	8124
8.89	0.2416	10524
8.99	0.2772	12073
9.09	0.3127	13623
9.19	0.3558	15498
9.29	0.3954	17223
9.39	0.4292	18698
9.49	0.4654	20272
9.59	0.5182	22572
9.69	0.5802	25272
9.79	0.6611	28796
9.89	0.7420	32321
9.99	0.8315	36220
10.09	0.9342	40695
10.19	1.0530	45869
10.29	1.2108	52743
10.39	1.3394	58342
10.49	1.4794	64441
10.59	1.6400	71440
10.69	1.8036	78565
10.79	1.9901	86688

Stage [ft]	Area [ac]	Area [ft2]
10.89	2.2018	95912
10.99	2.4211	105461
11.09	2.6948	117384
11.19	2.9955	130483
11.29	3.2617	142081
11.39	3.5435	154354
11.49	3.7713	164278
11.59	3.9383	171552
11.69	4.0617	176926
11.79	4.1650	181426
11.89	4.2533	185275
11.99	4.3239	188350
12.09	4.3911	191274
12.19	4.4484	193774
12.29	4.4840	195324
12.39	4.5173	196774
12.49	4.5305	197349
12.59	4.5437	197924
12.69	4.5489	198149
12.80	4.5525	198306
12.90	4.5540	198374
13.00	4.5540	198374

Comment:

Node: B-14

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.21	0.7816	34045
-0.20	0.7822	34070
-0.10	0.7896	34395
0.00	0.7936	34570
0.10	0.7997	34837
0.20	0.8019	34931
0.30	0.8078	35187
0.40	0.8120	35370
0.50	0.8160	35545
0.60	0.8200	35720
0.70	0.8223	35820
0.80	0.8292	36120
0.89	0.8326	36270

Stage [ft]	Area [ac]	Area [ft2]
1.00	0.8362	36425
1.09	0.8401	36595
1.20	0.8481	36945
1.30	0.8530	37158
1.40	0.8585	37395
1.50	0.8648	37670
1.60	0.8699	37895
1.70	0.8763	38170
1.80	0.8814	38395
1.90	0.8875	38657
2.00	0.8921	38861
2.10	0.8986	39145
2.20	0.9035	39355
2.30	0.9061	39470
2.40	0.9136	39795
2.50	0.9191	40036
2.60	0.9241	40253
2.70	0.9308	40545
2.80	0.9411	40995
2.90	0.9514	41444
3.00	0.9576	41714
3.10	0.9623	41919
3.20	0.9709	42294
3.30	0.9801	42694
3.40	0.9859	42944
3.50	0.9933	43269
3.60	0.9996	43544
3.70	1.0024	43663
3.80	1.0074	43882
3.90	1.0137	44157
4.00	1.0220	44519
4.10	1.0358	45119
4.20	1.0530	45869
4.30	1.0714	46669
4.40	1.0915	47544
4.50	1.1133	48494
4.59	1.1420	49743
4.69	1.1810	51443
4.79	1.2275	53468
4.89	1.2923	56293
4.99	1.3669	59542
5.09	1.4581	63517
5.19	1.5574	67841
5.29	1.6636	72465
5.39	1.7887	77915
5.49	1.9379	84414
5.59	2.1095	91888
5.69	2.3040	100362
5.79	2.5163	109610

Stage [ft]	Area [ac]	Area [ft2]
5.89	2.7659	120484
5.99	3.0483	132782
6.09	3.3065	144031
6.19	3.5969	156679
6.29	3.8614	168203
6.39	4.1007	178626
6.49	4.3383	188975
6.59	4.5730	199198
6.69	4.8094	209497
6.79	5.0734	220995
6.89	5.3763	234194
6.99	5.6679	246892
7.09	6.0225	262340
7.19	6.3203	275313
7.29	6.6118	288012
7.39	6.9051	300785
7.49	7.2058	313883
7.59	7.5065	326981
7.69	7.7991	339730
7.79	8.1159	353528
7.89	8.4309	367251
7.99	8.7615	381649
8.09	9.0931	396097
8.19	9.3519	407371
8.29	9.6194	419019
8.39	9.8581	429418
8.49	10.1186	440766
8.59	10.4313	454389
8.69	10.6712	464838
8.79	10.8371	472062
8.89	10.9530	477111
8.99	11.0637	481936
9.09	11.1716	486635
9.19	11.2984	492159
9.29	11.4367	498183
9.39	11.5475	503008
9.49	11.6152	505957
9.59	11.6927	509332
9.69	11.7598	512257
9.79	11.8332	515456
9.89	11.8860	517756
9.99	11.9406	520131
10.09	11.9945	522480
10.19	12.0318	524105
10.29	12.0593	525305
10.39	12.0731	525905
10.50	12.0770	526074
10.60	12.0792	526169
10.70	12.0792	526169

Comment:

Node: B-15

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.87	0.0006	25
1.90	0.0006	28
2.00	0.0009	39
2.10	0.0011	49
2.20	0.0021	90
2.30	0.0025	110
2.40	0.0031	135
2.50	0.0039	172
2.60	0.0062	271
2.70	0.0092	400
2.80	0.0207	900
2.90	0.0304	1325
3.00	0.0574	2500
3.10	0.1211	5274
3.20	0.1767	7699
3.30	0.2416	10524
3.40	0.3300	14373
3.50	0.4361	18997
3.60	0.5601	24397
3.70	0.6886	29996
3.80	0.8206	35745
3.90	0.9859	42944
4.00	1.1431	49793
4.10	1.3256	57742
4.20	1.5706	68416
4.30	1.8375	80039
4.40	2.1663	94362
4.50	2.4635	107311
4.59	2.7470	119659
4.69	3.1229	136032
4.79	3.5355	154004
4.89	3.9985	174177
4.99	4.5994	200348
5.09	5.2036	226670
5.19	5.8567	255116
5.29	6.5229	284137

Stage [ft]	Area [ac]	Area [ft2]
5.39	7.1381	310934
5.49	7.7125	335955
5.59	8.1911	356802
5.69	8.6519	376875
5.79	9.0679	394997
5.89	9.4656	412320
5.99	9.7927	426568
6.09	10.0469	437642
6.19	10.2500	446490
6.29	10.4319	454414
6.39	10.6259	462863
6.49	10.7952	470237
6.59	10.9610	477461
6.69	11.1263	484660
6.79	11.2904	491809
6.89	11.4643	499383
6.99	11.6158	505982
7.09	11.7638	512432
7.19	11.8975	518256
7.29	12.0381	524380
7.39	12.1385	528754
7.49	12.2252	532529
7.59	12.2940	535528
7.69	12.3474	537853
7.79	12.3910	539753
7.89	12.4323	541553
7.99	12.4708	543227
8.09	12.4995	544477
8.19	12.5236	545527
8.29	12.5465	546527
8.39	12.5683	547477
8.49	12.5781	547902
8.59	12.5884	548352
8.69	12.5924	548527
8.80	12.5976	548752
8.89	12.6022	548952
9.00	12.6051	549077
9.10	12.6062	549127
9.20	12.6068	549152
9.30	12.6139	549462
9.40	12.6139	549462

Comment:

Node: B-16

Scenario: Proposed

Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.28	2.2426	97687
-0.20	2.2489	97962
-0.10	2.2564	98287
0.00	2.2638	98612
0.10	2.2741	99062
0.20	2.2799	99312
0.30	2.2856	99562
0.40	2.2931	99887
0.50	2.3009	100228
0.60	2.3109	100662
0.70	2.3180	100974
0.80	2.3252	101286
0.89	2.3350	101711
0.99	2.3419	102011
1.09	2.3499	102361
1.20	2.3614	102861
1.30	2.3717	103311
1.40	2.3780	103586
1.50	2.3901	104111
1.60	2.4021	104636
1.70	2.4159	105236
1.80	2.4291	105811
1.90	2.4492	106686
2.00	2.4675	107486
2.10	2.4847	108236
2.20	2.5134	109485
2.30	2.5519	111160
2.40	2.5944	113010
2.50	2.6420	115085
2.60	2.7051	117834
2.70	2.7831	121234
2.80	2.8732	125158
2.90	2.9381	127983
3.00	3.0356	132232
3.10	3.1412	136832
3.20	3.2359	140956
3.30	3.3363	145331
3.40	3.4505	150305
3.50	3.5619	155154
3.60	3.7088	161553
3.70	3.8723	168677
3.80	4.0777	177626
3.90	4.3394	189025
4.00	4.7072	205048

Stage [ft]	Area [ac]	Area [ft2]
4.10	5.1520	224420
4.20	5.7235	249317
4.30	6.5034	283287
4.40	7.4577	324857
4.50	8.5227	371250
4.59	9.3824	408695
4.69	10.2213	445241
4.79	10.8979	474712
4.89	11.4052	496809
4.99	11.8028	514131
5.09	12.1644	529879
5.19	12.5253	545602
5.29	12.9264	563075
5.39	13.2874	578798
5.49	13.5737	591271
5.59	13.7493	598920
5.69	13.8847	604819
5.79	14.0047	610044
5.89	14.1177	614968
5.99	14.2365	620142
6.09	14.3507	625117
6.19	14.4729	630441
6.29	14.6112	636465
6.39	14.7771	643689
6.49	14.9102	649488
6.59	15.0296	654688
6.69	15.1334	659212
6.79	15.1839	661412
6.89	15.2097	662537
6.99	15.2402	663861
7.09	15.2826	665711
7.19	15.3166	667189
7.29	15.3166	667189

Comment: Normal water levels at 2.00 NGVD or 0.5 NAVD

Node: B-17

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.73	0.0006	25
2.80	0.0016	69

Stage [ft]	Area [ac]	Area [ft2]
2.90	0.0063	275
3.00	0.0212	925
3.10	0.0620	2700
3.20	0.1211	5274
3.30	0.2416	10524
3.40	0.4310	18772
3.50	0.6295	27421
3.60	0.8757	38145
3.70	1.1661	50793
3.80	1.4547	63367
3.90	1.7370	75665
4.00	2.0165	87838
4.10	2.3080	100537
4.20	2.5886	112760
4.30	2.8583	124508
4.39	3.0632	133432
4.49	3.2675	142331
4.59	3.5056	152705
4.69	3.8086	165903
4.79	4.1300	179901
4.89	4.4989	195974
4.99	4.9345	214946
5.09	5.4693	238243
5.19	6.0179	262140
5.29	6.6480	289586
5.39	7.2786	317058
5.49	7.7963	339605
5.59	8.2461	359202
5.69	8.5985	374550
5.79	8.9606	390323
5.89	9.2860	404496
5.99	9.5689	416819
6.09	9.8150	427543
6.19	10.0802	439091
6.29	10.3418	450490
6.39	10.5995	461713
6.49	10.8675	473387
6.59	11.1532	485835
6.69	11.4247	497659
6.79	11.7225	510632
6.89	11.9796	521830
6.99	12.2177	532204
7.09	12.4025	540253
7.19	12.5477	546577
7.29	12.6762	552176
7.39	12.7910	557176
7.49	12.8885	561425
7.59	12.9586	564475
7.69	13.0171	567024

Stage [ft]	Area [ac]	Area [ft2]
7.79	13.0727	569449
7.89	13.1152	571299
7.99	13.1428	572499
8.09	13.1500	572814
8.19	13.1500	572814

Comment:

Node: B-18

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.46	0.0006	25
1.50	0.0007	31
1.60	0.0011	47
1.70	0.0016	70
1.80	0.0022	95
1.90	0.0032	141
2.00	0.0060	262
2.10	0.0086	375
2.20	0.0143	625
2.30	0.0186	808
2.40	0.0281	1225
2.50	0.0482	2100
2.60	0.0712	3100
2.70	0.1010	4399
2.80	0.1274	5549
2.90	0.1526	6649
3.00	0.1848	8049
3.10	0.2221	9674
3.20	0.2571	11198
3.30	0.3007	13098
3.40	0.3437	14973
3.50	0.3879	16898
3.60	0.4344	18922
3.70	0.4763	20747
3.80	0.5348	23297
3.90	0.6048	26346
4.00	0.6955	30296
4.10	0.8298	36145
4.20	1.0157	44244
4.30	1.2584	54818

Stage [ft]	Area [ac]	Area [ft2]
4.40	1.5322	66741
4.50	1.7904	77990
4.59	2.0079	87463
4.69	2.2139	96437
4.79	2.4583	107086
4.89	2.7034	117759
4.99	2.9937	130408
5.09	3.3294	145031
5.19	3.6709	159904
5.29	4.0967	178451
5.39	4.5621	198723
5.49	5.1107	222620
5.59	5.4825	238818
5.69	5.7671	251216
5.79	5.9605	259640
5.89	6.1178	266489
5.99	6.2601	272689
6.09	6.4271	279963
6.19	6.5240	284187
6.29	6.6199	288361
6.39	6.7163	292561
6.49	6.8414	298010
6.59	7.1174	310034
6.69	7.2867	317408
6.79	7.3848	321682
6.89	7.4554	324757
6.99	7.5340	328181
7.09	7.6103	331506
7.19	7.6861	334805
7.29	7.7590	337980
7.39	7.8238	340805
7.49	7.8927	343804
7.59	7.9696	347154
7.69	8.0464	350503
7.79	8.1268	354003
7.89	8.2232	358202
7.99	8.2995	361527
8.09	8.3632	364301
8.19	8.4367	367501
8.29	8.5107	370725
8.39	8.6140	375225
8.49	8.7155	379649
8.59	8.7959	383149
8.69	8.8797	386798
8.79	8.9612	390348
8.89	9.0415	393847
8.99	9.1195	397247
9.09	9.1964	400596
9.19	9.2785	404171

Stage [ft]	Area [ac]	Area [ft2]
9.29	9.3606	407746
9.39	9.4386	411145
9.49	9.5252	414920
9.59	9.6234	419194
9.69	9.7169	423268
9.79	9.8162	427593
9.89	9.8977	431142
9.99	9.9780	434642
10.09	10.0515	437842
10.19	10.1393	441666
10.29	10.2265	445466
10.39	10.3315	450040
10.49	10.4422	454864
10.59	10.5519	459639
10.69	10.6563	464188
10.79	10.7447	468038
10.89	10.8204	471337
10.99	10.8853	474162
11.09	10.9501	476986
11.19	11.0333	480611
11.29	11.1372	485135
11.39	11.2255	488985
11.49	11.2944	491984
11.59	11.3661	495109
11.69	11.4350	498108
11.79	11.4884	500433
11.89	11.5257	502058
11.99	11.5589	503508
12.09	11.5968	505158
12.19	11.6427	507157
12.29	11.6760	508607
12.39	11.7179	510432
12.49	11.7451	511618
12.59	11.7451	511618

Comment:

Node: B-19

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.20	0.4700	20472

Stage [ft]	Area [ac]	Area [ft2]
0.30	1.2092	52673
0.40	1.3999	60979
0.50	1.4094	61392
0.60	1.4208	61892
0.70	1.4306	62317
0.80	1.4426	62842
0.90	1.4593	63566
1.00	1.4756	64279
1.10	1.4845	64666
1.20	1.4926	65016
1.30	1.5055	65579
1.40	1.5132	65916
1.50	1.5270	66516
1.60	1.5385	67016
1.70	1.5482	67441
1.80	1.5577	67853
1.90	1.5741	68566
2.00	1.5878	69166
2.10	1.6016	69766
2.20	1.6154	70366
2.30	1.6309	71041
2.40	1.6458	71690
2.50	1.6607	72340
2.60	1.6785	73115
2.70	1.7049	74265
2.80	1.7296	75340
2.90	1.7623	76765
3.00	1.8105	78864
3.10	1.8857	82139
3.20	1.9689	85764
3.30	2.0567	89588
3.40	2.1869	95262
3.50	2.3103	100637
3.60	2.4698	107586
3.70	2.6339	114735
3.80	2.8359	123534
3.90	3.0683	133657
4.00	3.3834	147380
4.10	3.7300	162478
4.20	4.1942	182701
4.30	4.7859	208472
4.40	5.5927	243617
4.50	6.6049	287712
4.60	7.7096	335830
4.70	8.9640	390473
4.80	10.2730	447490
4.90	11.6674	508232
5.00	13.2093	575398
5.10	14.8126	645239

Stage [ft]	Area [ac]	Area [ft2]
5.20	16.5416	720554
5.30	18.2936	796869
5.40	19.9640	869634
5.50	21.4497	934350
5.60	22.7822	992393
5.70	23.8977	1040986
5.80	24.9031	1084780
5.90	25.8305	1125175
6.00	26.5960	1158520
6.10	27.3006	1189216
6.20	27.9571	1217812
6.30	28.5694	1244484
6.40	29.1783	1271005
6.50	29.7458	1295727
6.60	30.3575	1322373
6.70	30.9555	1348420
6.80	31.6424	1378341
6.90	32.3166	1407712
7.00	33.0242	1438533
7.10	33.7392	1469679
7.20	34.3997	1498450
7.30	35.0607	1527246
7.40	35.7287	1556342
7.50	36.3863	1584988
7.60	37.0003	1611735
7.70	37.5868	1637281
7.80	38.1670	1662553
7.90	38.7448	1687725
8.00	39.2825	1711147
8.10	39.7617	1732019
8.20	40.1817	1750316
8.30	40.5869	1767964
8.40	40.9828	1785212
8.50	41.3753	1802309
8.60	41.8350	1822332
8.70	42.3377	1844229
8.80	42.7778	1863401
8.90	43.1749	1880699
9.00	43.4899	1894422
9.10	43.7413	1905371
9.20	43.9381	1913944
9.30	44.1212	1921918
9.40	44.3134	1930292
9.50	44.4942	1938166
9.60	44.6583	1945315
9.70	44.8253	1952589
9.80	44.9664	1958738
9.90	45.0893	1964088
10.00	45.1989	1968862

Stage [ft]	Area [ac]	Area [ft2]
10.10	45.3033	1973411
10.20	45.3756	1976561
10.30	45.4502	1979811
10.40	45.5334	1983435
10.50	45.6201	1987210
10.60	45.7136	1991284
10.70	45.7985	1994984
10.80	45.8892	1998933
10.90	45.9603	2002033
11.00	46.0464	2005782
11.10	46.1623	2010831
11.20	46.2513	2014706
11.30	46.3316	2018205
11.40	46.4183	2021980
11.50	46.5032	2025680
11.60	46.5835	2029179
11.70	46.5865	2029310
11.80	46.5865	2029310

Comment:

Node: B-2

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.66	0.0006	25
1.70	0.0014	59
1.80	0.0025	108
1.90	0.0092	400
2.00	0.0252	1100
2.10	0.0666	2900
2.20	0.1262	5499
2.30	0.2146	9349
2.40	0.3168	13798
2.50	0.4281	18648
2.60	0.5130	22347
2.70	0.5985	26072
2.80	0.7064	30771
2.90	0.8906	38795
3.00	1.2825	55868
3.10	1.7944	78165
3.20	2.3780	103586

Stage [ft]	Area [ac]	Area [ft2]
3.30	2.9955	130483
3.40	3.5515	154704
3.50	3.9222	170852
3.60	4.1317	179976
3.70	4.2975	187200
3.80	4.4249	192749
3.90	4.5276	197224
4.00	4.6447	202323
4.10	4.7354	206272
4.20	4.8335	210547
4.30	4.9729	216621
4.40	5.1761	225470
4.50	5.4263	236368
4.59	5.6977	248192
4.69	6.0609	264015
4.79	6.4799	282262
4.89	6.9332	302010
4.99	7.4439	324257
5.09	7.9850	347829
5.19	8.6128	375175
5.29	9.4311	410820
5.39	10.2523	446590
5.49	11.2278	489085
5.59	12.9104	562375
5.69	14.6583	638515
5.79	15.9070	692907
5.89	17.0443	742451
5.99	18.2689	795794
6.09	19.3495	842862
6.19	20.4788	892056
6.29	20.9861	914153
6.39	21.4532	934500
6.49	21.9719	957097
6.59	22.5573	982594
6.69	23.2149	1011240
6.79	23.9356	1042636
6.89	24.7074	1076256
6.99	25.5590	1113351
7.09	26.5357	1155896
7.19	27.5577	1200415
7.29	28.6153	1246484
7.39	29.7888	1297602
7.49	31.0111	1350845
7.59	32.0521	1396189
7.69	32.9783	1436533
7.79	33.8006	1472353
7.89	34.5391	1504524
7.99	35.2817	1536870
8.09	35.9990	1568116

Stage [ft]	Area [ac]	Area [ft2]
8.19	36.6675	1597237
8.29	37.2941	1624533
8.39	37.9254	1652029
8.49	38.5870	1680851
8.59	39.1402	1704947
8.69	39.6871	1728769
8.79	40.1450	1748717
8.89	40.5473	1766239
8.99	40.8950	1781387
9.09	41.1986	1794610
9.19	41.4339	1804859
9.29	41.6605	1814733
9.39	41.8832	1824431
9.49	42.0898	1833430
9.59	42.3107	1843054
9.69	42.5523	1853577
9.79	42.8381	1866026
9.89	43.1221	1878399
9.99	43.4481	1892597
10.09	43.7637	1906345
10.19	44.0179	1917419
10.29	44.2658	1928218
10.39	44.4993	1938391
10.49	44.6973	1947015
10.59	44.8982	1955764
10.69	45.1053	1964788
10.79	45.2924	1972937
10.89	45.4634	1980386
10.99	45.6401	1988085
11.09	45.8002	1995059
11.19	45.9718	2002533
11.29	46.1359	2009682
11.39	46.3121	2017356
11.49	46.4831	2024805
11.59	46.6449	2031854
11.69	46.8091	2039003
11.79	46.9629	2045702
11.89	47.1321	2053076
11.99	47.3100	2060825
12.09	47.4896	2068649
12.19	47.6790	2076898
12.29	47.8512	2084397
12.39	48.0113	2091371
12.49	48.1593	2097820
12.59	48.2712	2102694
12.69	48.4043	2108493
12.79	48.6058	2117267
12.89	48.7412	2123166
12.99	48.8525	2128016

Stage [ft]	Area [ac]	Area [ft2]
13.09	48.9352	2131615
13.19	48.9891	2133965
13.29	49.0390	2136140
13.39	49.0763	2137765
13.49	49.1176	2139564
13.59	49.1567	2141264
13.69	49.1894	2142689
13.79	49.2152	2143814
13.89	49.2445	2145089
13.99	49.2829	2146763
14.09	49.3208	2148413
14.19	49.3558	2149938
14.29	49.3982	2151788
14.39	49.4350	2153387
14.49	49.4769	2155212
14.59	49.5199	2157087
14.69	49.5647	2159037
14.79	49.6140	2161186
14.89	49.6875	2164386
14.99	49.8022	2169385
15.09	49.9118	2174160
15.19	50.0450	2179959
15.29	50.2011	2186758
15.39	50.3577	2193582
15.49	50.4685	2198406
15.59	50.5706	2202856
15.69	50.5792	2203230
15.79	50.5792	2203230

Comment:

Node: B-20

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.34	81.0865	3532128
-0.30	81.1043	3532903
-0.20	81.1456	3534703
-0.10	81.1927	3536753
0.00	81.2529	3539377
0.09	81.2942	3541177
0.20	81.3459	3543427

Stage [ft]	Area [ac]	Area [ft2]
0.30	81.3947	3545552
0.40	81.4366	3547376
0.50	81.4893	3549676
0.60	81.5358	3551701
0.70	81.5909	3554100
0.80	81.6489	3556625
0.89	81.7005	3558875
0.99	81.7596	3561449
1.09	81.8268	3564374
1.20	81.8928	3567249
1.30	81.9576	3570073
1.40	82.0225	3572898
1.50	82.0833	3575548
1.60	82.1435	3578172
1.70	82.2095	3581047
1.80	82.2772	3583996
1.90	82.3518	3587246
2.00	82.4379	3590995
2.10	82.5355	3595245
2.20	82.6307	3599394
2.30	82.7380	3604069
2.40	82.8408	3608543
2.50	82.9607	3613767
2.60	83.0755	3618767
2.70	83.2034	3624341
2.80	83.3274	3629740
2.90	83.4605	3635540
3.00	83.5925	3641289
3.10	83.7296	3647263
3.20	83.8565	3652787
3.30	83.9816	3658236
3.40	84.1124	3663936
3.50	84.2576	3670260
3.60	84.4045	3676659
3.70	84.5525	3683108
3.80	84.7069	3689832
3.90	84.8888	3697756
4.00	85.0661	3705480
4.10	85.2561	3713754
4.20	85.4540	3722378
4.30	85.6578	3731252
4.40	85.8902	3741375
4.50	86.1742	3753749
4.59	86.4795	3767047
4.69	86.8806	3784520
4.79	87.3517	3805042
4.89	87.9267	3830089
4.99	88.6722	3862559
5.09	89.7935	3911403

Stage [ft]	Area [ac]	Area [ft2]
5.19	91.3761	3980343
5.29	93.6744	4080455
5.39	96.5694	4206563
5.49	100.0337	4357468
5.59	104.2853	4542668
5.69	109.4511	4767688
5.79	115.8087	5044626
5.89	123.0013	5357935
5.99	130.1634	5669918
6.09	136.9451	5965328
6.19	143.2993	6242116
6.29	149.3528	6505806
6.39	154.8886	6746949
6.49	159.8621	6963595
6.59	164.3726	7160069
6.69	168.1272	7323622
6.79	171.3012	7461879
6.89	173.9678	7578038
6.99	176.4463	7685999
7.09	178.6842	7783486
7.19	180.4551	7860625
7.29	181.9620	7926267
7.39	183.2090	7980584
7.49	184.2953	8027903
7.59	185.2370	8068923
7.69	186.0668	8105068
7.79	186.7502	8134839
7.89	187.3768	8162135
7.99	187.8566	8183032
8.09	188.2129	8198555
8.19	188.4729	8209879
8.29	188.6864	8219177
8.39	188.8671	8227051
8.49	189.0014	8232901
8.59	189.0984	8237125
8.69	189.1770	8240550
8.79	189.2608	8244199
8.89	189.3210	8246824
8.99	189.3939	8249998
9.09	189.4794	8253723
9.19	189.5454	8256597
9.29	189.6194	8259822
9.39	189.7003	8263347
9.49	189.7457	8265321
9.59	189.7916	8267321
9.69	189.8495	8269846
9.79	189.9132	8272620
9.89	189.9695	8275070
9.99	190.0211	8277320

Stage [ft]	Area [ac]	Area [ft2]
10.09	190.0693	8279419
10.19	190.1187	8281569
10.29	190.1738	8283969
10.39	190.2277	8286319
10.49	190.3166	8290193
10.59	190.3976	8293718
10.69	190.4871	8297617
10.79	190.5680	8301142
10.89	190.6311	8303891
10.99	190.6983	8306816
11.09	190.7654	8309740
11.19	190.8429	8313115
11.29	190.9094	8316015
11.39	190.9892	8319489
11.49	191.0690	8322964
11.59	191.1533	8326638
11.69	191.2526	8330963
11.79	191.2583	8331212
11.89	191.2583	8331212

Comment:

Node: B-21

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-0.34	0.0011	50
-0.30	0.0015	67
-0.20	0.0020	88
-0.10	0.0024	103
0.00	0.0026	115
0.09	0.0029	125
0.20	0.0037	161
0.30	0.0044	191
0.40	0.0047	203
0.50	0.0048	207
0.60	0.0048	211
0.70	0.0049	215
0.80	0.0050	220
0.90	0.0051	224
1.00	0.0059	256
1.10	0.0064	280

Stage [ft]	Area [ac]	Area [ft2]
1.20	0.0068	295
1.30	0.0075	327
1.40	0.0077	335
1.50	0.0079	343
1.60	0.0080	351
1.70	0.0082	357
1.80	0.0083	363
1.90	0.0085	369
2.00	0.0086	375
2.10	0.0089	390
2.20	0.0093	404
2.30	0.0096	419
2.40	0.0108	471
2.50	0.0113	494
2.60	0.0121	527
2.70	0.0122	530
2.80	0.0123	534
2.90	0.0123	537
3.00	0.0124	541
3.10	0.0125	544
3.20	0.0126	548
3.30	0.0128	557
3.40	0.0132	575
3.50	0.0141	615
3.60	0.0147	640
3.70	0.0151	658
3.80	0.0154	672
3.90	0.0156	679
4.00	0.0157	684
4.10	0.0158	689
4.20	0.0159	694
4.30	0.0160	699
4.40	0.0165	717
4.50	0.0179	779
4.60	0.0186	809
4.69	0.0189	825
4.80	0.0194	843
4.90	0.0202	880
5.00	0.0204	889
5.10	0.0206	899
5.20	0.0216	941
5.29	0.0224	975
5.40	0.0231	1007
5.50	0.0238	1037
5.60	0.0247	1075
5.70	0.0275	1200
5.79	0.0310	1350
5.89	0.0367	1600
5.99	0.0494	2150

Stage [ft]	Area [ac]	Area [ft2]
6.09	0.0723	3150
6.19	0.0935	4074
6.29	0.1096	4774
6.39	0.1412	6149
6.49	0.1676	7299
6.59	0.2135	9299
6.69	0.2749	11973
6.79	0.3294	14348
6.89	0.4017	17498
6.99	0.4889	21297
7.09	0.6220	27096
7.19	0.7649	33321
7.29	0.9313	40570
7.39	1.1425	49768
7.49	1.4076	61317
7.59	1.7783	77465
7.69	2.2655	98687
7.79	2.7998	121959
7.89	3.2416	141206
7.99	3.6244	157879
8.09	4.0204	175127
8.19	4.6309	201723
8.29	5.0607	220446
8.39	5.5112	240068
8.49	5.9238	258041
8.59	6.3226	275413
8.69	6.7696	294886
8.79	7.2017	313708
8.89	7.6511	333280
8.99	8.1830	356452
9.09	8.7626	381699
9.19	9.3927	409145
9.29	9.9987	435542
9.39	10.5421	459214
9.49	11.0207	480061
9.59	11.4189	497409
9.69	11.7185	510457
9.79	11.9606	521005
9.89	12.1322	528479
9.99	12.2740	534654
10.09	12.4352	541678
10.19	12.5890	548377
10.29	12.7302	554526
10.39	12.8524	559850
10.49	12.9413	563725
10.59	13.0027	566399
10.69	13.0498	568449
10.79	13.0762	569599
10.89	13.0871	570074

Stage [ft]	Area [ac]	Area [ft2]
10.99	13.0916	570268
11.09	13.0916	570268

Comment:

Node: B-22

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.26 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.26	0.0006	25
3.30	0.0023	100
3.40	0.0043	187
3.50	0.0103	450
3.60	0.0241	1050
3.70	0.0637	2775
3.80	0.0987	4299
3.90	0.1199	5224
4.00	0.1475	6424
4.10	0.1716	7474
4.20	0.1934	8424
4.30	0.2117	9224
4.39	0.2267	9874
4.50	0.2389	10407
4.60	0.2445	10649
4.69	0.2525	10999
4.79	0.2617	11398
4.89	0.2686	11698
4.99	0.2732	11898
5.09	0.2800	12198
5.19	0.2875	12523
5.29	0.2944	12823
5.39	0.3036	13223
5.49	0.3214	13998
5.59	0.3449	15023
5.69	0.3873	16873
5.79	0.4660	20297
5.89	0.6031	26271
5.99	0.8355	36395
6.09	1.1936	51993
6.19	1.6429	71565
6.29	2.2064	96112
6.39	2.8859	125708

Stage [ft]	Area [ac]	Area [ft2]
6.49	3.7088	161553
6.59	4.6418	202198
6.69	5.5531	241893
6.79	6.3903	278363
6.89	7.1845	312958
6.99	7.8674	342704
7.09	8.4533	368226
7.19	9.0042	392223
7.29	9.4902	413395
7.39	9.9723	434392
7.49	10.4222	453989
7.59	10.8204	471337
7.69	11.1859	487260
7.79	11.5647	503758
7.89	11.9572	520855
7.99	12.3618	538478
8.09	12.8048	557776
8.19	13.2604	577623
8.29	13.7401	598520
8.39	14.2549	620942
8.49	14.8270	645864
8.59	15.4003	670835
8.69	16.0097	697382
8.79	16.6369	724703
8.89	17.2939	753324
8.99	18.0422	785920
9.09	18.7550	816966
9.19	19.4533	847387
9.29	20.1368	877158
9.39	20.7617	904379
9.49	21.3459	929826
9.59	21.9335	955422
9.69	22.5727	983269
9.79	23.1621	1008940
9.89	23.7331	1033812
9.99	24.2122	1054684
10.09	24.6558	1074007
10.19	25.0431	1090879
10.29	25.3897	1105977
10.39	25.6744	1118376
10.49	25.9160	1128899
10.59	26.0910	1136523
10.69	26.2321	1142672
10.79	26.3102	1146072
10.89	26.3825	1149222
10.99	26.4382	1151646
11.09	26.4829	1153596
11.19	26.5133	1154921
11.29	26.5278	1155551

Stage [ft]	Area [ac]	Area [ft2]
11.39	26.5278	1155551

Comment:

Node: B-23

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.01 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.01	0.0006	25
5.10	0.0026	112
5.20	0.0132	575
5.30	0.0390	1700
5.40	0.0666	2900
5.49	0.0970	4224
5.59	0.1360	5924
5.69	0.2026	8824
5.79	0.2932	12773
5.89	0.3845	16748
5.99	0.5021	21872
6.09	0.6840	29796
6.19	0.9675	42144
6.29	1.3009	56667
6.39	1.7313	75415
6.49	2.1295	92763
6.59	2.5111	109385
6.69	2.8755	125258
6.79	3.2032	139531
6.89	3.5091	152855
6.99	3.8379	167178
7.09	4.1988	182901
7.19	4.6298	201673
7.29	5.0854	221520
7.39	5.5284	240818
7.49	5.9479	259090
7.59	6.3358	275988
7.69	6.7077	292186
7.79	7.0824	308509
7.89	7.5013	326756
7.99	7.8554	342179
8.09	8.1905	356777
8.19	8.4619	368601
8.29	8.7276	380174

Stage [ft]	Area [ac]	Area [ft2]
8.39	8.9468	389723
8.49	9.1700	399447
8.59	9.3732	408295
8.69	9.5838	417469
8.79	9.8546	429268
8.89	10.0859	439341
8.99	10.2626	447040
9.09	10.3940	452765
9.19	10.4750	456289
9.29	10.5553	459789
9.39	10.6104	462188
9.49	10.6586	464288
9.59	10.7045	466288
9.69	10.7670	469012
9.79	10.8634	473212
9.89	10.9277	476011
9.99	10.9851	478511
10.09	11.0017	479236
10.19	11.0098	479586
10.30	11.0110	479638
10.40	11.0110	479638

Comment:

Node: B-24

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.15 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.15	0.0006	25
4.20	0.0009	39
4.30	0.0023	100
4.39	0.0052	225
4.49	0.0189	825
4.59	0.0367	1600
4.69	0.0821	3575
4.79	0.1446	6299
4.89	0.2990	13023
4.99	0.7529	32796
5.09	1.5723	68491
5.19	2.5329	110335
5.29	3.4155	148780
5.39	4.2792	186400

Stage [ft]	Area [ac]	Area [ft2]
5.49	5.3580	233394
5.59	6.7203	292736
5.69	8.5950	374400
5.79	10.9507	477011
5.89	13.4549	586097
5.99	15.5139	675785
6.09	17.0822	744101
6.19	18.2563	795244
6.29	19.0602	830264
6.39	19.7070	858435
6.49	20.2424	881757
6.59	20.7009	901730
6.69	21.1594	921702
6.79	21.6081	941249
6.89	22.2038	967196
6.99	22.9079	997867
7.09	23.6625	1030737
7.19	24.3545	1060883
7.29	25.0713	1092104
7.39	25.8569	1126325
7.49	26.7394	1164769
7.59	27.5795	1201365
7.69	28.5585	1244009
7.79	29.7269	1294902
7.89	30.9497	1348170
7.99	32.0331	1395364
8.09	33.0930	1441533
8.19	33.9762	1480002
8.29	34.9150	1520897
8.39	35.9462	1565816
8.49	37.2081	1620784
8.59	38.6157	1682100
8.69	40.1789	1750191
8.79	41.6129	1812658
8.89	42.7279	1861226
8.99	43.5404	1896622
9.09	44.0896	1920544
9.19	44.5194	1939266
9.29	44.8551	1953889
9.39	45.1288	1965812
9.49	45.3389	1974961
9.59	45.5150	1982635
9.69	45.6287	1987585
9.79	45.7526	1992984
9.89	45.8416	1996858
9.99	45.8835	1998683
10.09	45.8989	1999358
10.19	45.9133	1999983
10.29	45.9183	2000199

Stage [ft]	Area [ac]	Area [ft2]
10.39	45.9183	2000199

Comment:

Node: B-25

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.15 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.15	0.0006	25
4.20	0.0011	50
4.30	0.0040	175
4.40	0.0099	433
4.50	0.0126	550
4.59	0.0184	800
4.70	0.0218	950
4.80	0.0252	1100
4.90	0.0330	1437
4.99	0.0407	1775
5.09	0.0476	2075
5.19	0.0580	2525
5.29	0.0706	3075
5.39	0.1067	4649
5.49	0.1739	7574
5.59	0.2502	10899
5.69	0.3632	15823
5.79	0.4797	20897
5.89	0.5957	25947
5.99	0.6898	30046
6.09	0.8160	35545
6.19	0.9491	41344
6.29	1.1035	48069
6.39	1.2378	53918
6.49	1.4002	60992
6.59	1.5729	68516
6.69	1.7531	76365
6.79	1.8983	82689
6.89	2.0314	88488
6.99	2.1215	92413
7.09	2.2093	96237
7.19	2.3281	101411
7.29	2.4526	106836
7.39	2.6030	113385

Stage [ft]	Area [ac]	Area [ft2]
7.49	2.7774	120984
7.59	2.9851	130033
7.69	3.1745	138282
7.79	3.3426	145606
7.89	3.5188	153280
7.99	3.6577	159329
8.09	3.7661	164053
8.19	3.8694	168553
8.29	3.9544	172252
8.39	4.0163	174952
8.49	4.0248	175319
8.59	4.0248	175319

Comment:

Node: B-26

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.60	0.0011	50
2.70	0.0044	190
2.80	0.0080	350
2.90	0.0143	625
3.00	0.0228	994
3.10	0.0362	1575
3.20	0.0459	2000
3.30	0.0608	2650
3.40	0.0861	3750
3.50	0.1125	4899
3.60	0.1567	6824
3.70	0.2083	9074
3.80	0.2565	11173
3.90	0.3225	14048
4.00	0.4269	18598
4.10	0.5492	23922
4.20	0.6703	29196
4.30	0.8011	34895
4.40	0.9308	40545
4.50	1.0708	46644
4.60	1.1902	51843
4.70	1.3434	58517
4.80	1.5413	67141

Stage [ft]	Area [ac]	Area [ft2]
4.90	1.7629	76790
5.00	2.0056	87363
5.10	2.2655	98687
5.20	2.5226	109885
5.30	2.7728	120784
5.40	2.9846	130008
5.50	3.2095	139806
5.60	3.4614	150780
5.70	3.7036	161328
5.80	3.9664	172777
5.90	4.2516	185200
6.00	4.5167	196749
6.10	4.7715	207847
6.20	5.0085	218171
6.30	5.2501	228694
6.40	5.4750	238493
6.50	5.6948	248067
6.60	5.8779	256041
6.70	6.1160	266414
6.80	6.3553	276838
6.90	6.6296	288786
7.00	6.8620	298910
7.10	7.1271	310459
7.20	7.4020	322432
7.30	7.6304	332381
7.40	7.8548	342154
7.50	8.0585	351028
7.60	8.2720	360327
7.70	8.4631	368651
7.80	8.6323	376025
7.90	8.7867	382749
8.00	8.9187	388498
8.10	9.0421	393872
8.20	9.1442	398322
8.30	9.2395	402471
8.40	9.3301	406421
8.50	9.4065	409745
8.60	9.4707	412545
8.70	9.5207	414720
8.80	9.5723	416969
8.90	9.6308	419519
9.00	9.6779	421569
9.10	9.7261	423668
9.20	9.7577	425043
9.30	9.7918	426533
9.40	9.7918	426533

Comment:

Node: B-27

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.92 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.92	0.0006	25
4.00	0.0017	75
4.09	0.0086	375
4.19	0.0189	825
4.29	0.0362	1575
4.39	0.0677	2950
4.49	0.1085	4724
4.59	0.1555	6774
4.69	0.2049	8924
4.79	0.2519	10974
4.89	0.2944	12823
4.99	0.3391	14773
5.09	0.3793	16523
5.19	0.4390	19122
5.29	0.5170	22522
5.39	0.6261	27271
5.49	0.7494	32646
5.59	0.8545	37220
5.69	0.9796	42669
5.79	1.1190	48744
5.89	1.2550	54668
5.99	1.3767	59967
6.09	1.4725	64141
6.19	1.5586	67891
6.29	1.6596	72290
6.39	1.7227	75040
6.49	1.7505	76250
6.59	1.7505	76250

Comment:

Node: B-28

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.87 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.87	0.0006	25
3.90	0.0008	36
4.00	0.0029	125
4.09	0.0069	300
4.19	0.0235	1025
4.29	0.0534	2325
4.39	0.0809	3525
4.49	0.1222	5324
4.59	0.1481	6449
4.69	0.1888	8224
4.79	0.2238	9749
4.89	0.2622	11423
4.99	0.3082	13423
5.09	0.3472	15123
5.19	0.3937	17148
5.29	0.4321	18822
5.39	0.4740	20647
5.49	0.5182	22572
5.59	0.5538	24122
5.69	0.5997	26121
5.79	0.6576	28646
5.89	0.7368	32096
5.99	0.8568	37320
6.09	1.0323	44969
6.19	1.2458	54268
6.29	1.4455	62967
6.39	1.6263	70841
6.49	1.7583	76590
6.59	1.8529	80714
6.69	1.8736	81613
6.79	1.8736	81613

Comment:

Node: B-29

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.31 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.31	0.0006	25
4.40	0.0027	117
4.50	0.0075	325
4.60	0.0216	942

Stage [ft]	Area [ac]	Area [ft2]
4.69	0.0344	1500
4.79	0.0471	2050
4.89	0.0608	2650
4.99	0.0775	3375
5.09	0.1102	4799
5.19	0.1521	6624
5.29	0.2031	8849
5.39	0.2628	11448
5.49	0.3156	13748
5.59	0.3759	16373
5.69	0.4419	19247
5.79	0.4987	21722
5.89	0.5417	23597
5.99	0.5893	25672
6.09	0.6496	28296
6.19	0.7024	30596
6.29	0.7701	33546
6.39	0.8734	38045
6.49	0.9629	41944
6.59	1.0760	46869
6.69	1.2200	53143
6.79	1.3571	59117
6.89	1.5023	65441
6.99	1.6355	71241
7.09	1.7554	76465
7.19	1.8352	79939
7.29	1.8799	81889
7.39	1.9052	82989
7.50	1.9187	83579
7.60	1.9187	83579

Comment:

Node: B-3

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.60 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.00	0.0000	0
0.50	0.0000	0
1.00	3.8700	168577
1.50	7.8300	341075
2.00	11.8700	517057

Stage [ft]	Area [ac]	Area [ft2]
2.50	16.0000	696960
3.00	20.2200	880783
3.40	23.6600	1030630
3.90	28.0300	1220987
4.40	37.4400	1630886
4.90	52.8000	2299968
5.40	70.0800	3052685
5.90	89.2800	3889037
6.40	110.3900	4808588
6.90	132.4700	5770393

Comment:

Node: B-30

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.06 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.06	0.0006	25
4.10	0.0013	57
4.20	0.0039	169
4.30	0.0063	275
4.39	0.0103	450
4.49	0.0172	750
4.60	0.0281	1225
4.69	0.0396	1725
4.79	0.0539	2350
4.89	0.0786	3425
4.99	0.1383	6024
5.09	0.2163	9424
5.19	0.3001	13073
5.29	0.4005	17448
5.39	0.5515	24022
5.49	0.7282	31721
5.59	0.9750	42469
5.69	1.2498	54443
5.79	1.6108	70166
5.89	2.0538	89463
5.99	2.6988	117559
6.09	3.3926	147780
6.19	3.9521	172152
6.29	4.4255	192774
6.39	4.8926	213122

Stage [ft]	Area [ac]	Area [ft2]
6.49	5.3247	231944
6.59	5.6931	247992
6.69	5.9932	261065
6.79	6.2601	272689
6.89	6.4999	283137
6.99	6.6784	290911
7.09	6.8098	296635
7.19	6.9165	301285
7.29	6.9883	304409
7.39	7.0193	305759
7.50	7.0319	306309
7.59	7.0457	306909
7.69	7.0514	307159
7.80	7.0532	307238
7.90	7.0532	307238

Comment:

Node: B-31

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.05	2.5341	110385
0.10	2.5375	110535
0.20	2.5395	110623
0.30	2.5427	110760
0.40	2.5467	110935
0.50	2.5489	111030
0.60	2.5548	111285
0.70	2.5597	111502
0.80	2.5632	111653
0.90	2.5674	111835
1.00	2.5706	111977
1.10	2.5743	112135
1.20	2.5812	112435
1.30	2.5869	112685
1.40	2.5915	112885
1.50	2.5961	113085
1.60	2.6012	113310
1.70	2.6053	113485
1.80	2.6100	113693
1.90	2.6130	113820

Stage [ft]	Area [ac]	Area [ft2]
2.00	2.6156	113935
2.10	2.6210	114172
2.20	2.6290	114518
2.30	2.6328	114685
2.40	2.6365	114847
2.50	2.6407	115028
2.60	2.6471	115310
2.70	2.6556	115676
2.80	2.6601	115872
2.90	2.6695	116284
3.00	2.6758	116559
3.10	2.6821	116834
3.20	2.6879	117084
3.30	2.6976	117509
3.40	2.7080	117959
3.50	2.7180	118397
3.60	2.7286	118859
3.70	2.7499	119784
3.80	2.7682	120584
3.90	2.7831	121234
4.00	2.8084	122334
4.10	2.8273	123159
4.20	2.8457	123958
4.30	2.8732	125158
4.40	2.9002	126333
4.50	2.9306	127658
4.59	2.9668	129233
4.69	3.0201	131557
4.79	3.0706	133757
4.89	3.1424	136882
4.99	3.2428	141256
5.09	3.3358	145306
5.19	3.4362	149680
5.29	3.5492	154604
5.39	3.6801	160304
5.49	3.7960	165353
5.59	3.9297	171177
5.69	4.0525	176526
5.79	4.1896	182501
5.89	4.3526	189600
5.99	4.5500	198199
6.09	4.7377	206372
6.19	4.8995	213422
6.29	5.0693	220820
6.39	5.2403	228270
6.49	5.4234	236243
6.59	5.6007	243967
6.69	5.7717	251416
6.79	5.9290	258265

Stage [ft]	Area [ac]	Area [ft2]
6.89	6.0931	265415
6.99	6.2515	272314
7.09	6.4041	278963
7.19	6.5487	285262
7.29	6.7197	292711
7.39	6.9079	300910
7.49	7.1644	312083
7.59	7.5036	326856
7.69	7.9225	345104
7.79	8.4040	366076
7.89	8.8762	386648
7.99	9.3278	406321
8.09	9.7100	422969
8.19	10.1031	440091
8.29	10.5002	457389
8.39	10.8537	472787
8.49	11.1676	486460
8.59	11.4052	496809
8.69	11.4924	500610
8.79	11.4924	500610

Comment:

Node: B-32

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.00	0.0006	25
3.10	0.0063	275
3.21	0.0171	746
3.31	0.0267	1164
3.40	0.0344	1500
3.50	0.0689	3000
3.60	0.1222	5324
3.70	0.2077	9049
3.80	0.3001	13073
3.90	0.4005	17448
4.00	0.4792	20872
4.10	0.5693	24797
4.20	0.6565	28596
4.30	0.7431	32371
4.40	0.8464	36870

Stage [ft]	Area [ac]	Area [ft2]
4.50	0.9641	41994
4.60	1.0656	46419
4.70	1.1580	50443
4.80	1.2699	55318
4.90	1.3801	60117
5.00	1.5218	66291
5.10	1.6756	72990
5.20	1.8443	80339
5.30	2.0119	87638
5.40	2.1599	94087
5.50	2.3120	100712
5.60	2.4882	108386
5.70	2.7028	117734
5.80	3.0121	131207
5.90	3.4293	149380
6.00	3.8000	165528
6.10	4.1363	180176
6.20	4.4823	195249
6.30	4.8237	210122
6.40	5.1583	224695
6.50	5.5370	241193
6.60	5.9347	258515
6.70	6.4064	279063
6.80	6.9579	303085
6.90	7.6138	331656
7.00	8.3007	361577
7.10	8.9457	389673
7.20	9.5660	416694
7.30	10.1938	444041
7.40	10.8399	472187
7.50	11.4998	500933
7.60	12.2774	534804
7.70	13.2030	575123
7.80	14.1567	616668
7.90	15.1449	659712
8.00	16.2082	706031
8.10	17.3410	755374
8.20	18.4428	803368
8.30	19.4126	845612
8.40	20.2768	883257
8.50	21.0733	917952
8.60	21.8107	950073
8.70	22.5377	981744
8.80	23.1162	1006941
8.90	23.5598	1026263
9.00	23.8031	1036862
9.10	23.9620	1043786
9.20	24.0515	1047685
9.30	24.1187	1050610

Stage [ft]	Area [ac]	Area [ft2]
9.40	24.1726	1052959
9.50	24.2329	1055584
9.60	24.2834	1057784
9.70	24.3270	1059684
9.80	24.3643	1061308
9.90	24.4010	1062908
10.00	24.4412	1064658
10.10	24.4791	1066308
10.20	24.5164	1067932
10.30	24.5571	1069707
10.40	24.5915	1071207
10.50	24.6196	1072432
10.60	24.6437	1073481
10.70	24.6437	1073481

Comment:

Node: B-33

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.44 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.44	0.0006	25
4.50	0.0015	64
4.59	0.0046	200
4.69	0.0115	500
4.79	0.0218	950
4.89	0.0390	1700
4.99	0.0780	3400
5.09	0.1613	7024
5.19	0.3064	13348
5.29	0.5406	23547
5.39	0.8923	38870
5.49	1.3284	57867
5.59	1.8352	79939
5.69	2.2386	97512
5.79	2.6403	115010
5.89	3.0213	131607
5.99	3.3570	146230
6.09	3.6261	157954
6.19	3.8671	168452
6.29	4.0789	177676
6.39	4.3101	187750

Stage [ft]	Area [ac]	Area [ft2]
6.49	4.5552	198424
6.59	4.8341	210572
6.69	5.1009	222195
6.79	5.3270	232044
6.89	5.4997	239568
6.99	5.6661	246817
7.09	5.8148	253291
7.19	5.9479	259090
7.29	6.0673	264290
7.39	6.1843	269389
7.49	6.2727	273239
7.59	6.3616	277113
7.69	6.4236	279813
7.79	6.4477	280863
7.89	6.4644	281587
8.00	6.4705	281856
8.10	6.4705	281856

Comment:

Node: B-34

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 4.78 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
4.78	0.0006	25
4.80	0.0007	31
4.90	0.0013	56
5.00	0.0019	81
5.10	0.0027	119
5.20	0.0035	154
5.30	0.0043	189
5.40	0.0055	242
5.49	0.0080	350
5.60	0.0112	487
5.70	0.0149	650
5.79	0.0207	900
5.89	0.0281	1225
5.99	0.0350	1525
6.09	0.0465	2025
6.19	0.0625	2725
6.29	0.0872	3799
6.40	0.1171	5099

Stage [ft]	Area [ac]	Area [ft2]
6.49	0.1521	6624
6.59	0.2181	9499
6.69	0.2973	12948
6.79	0.4023	17523
6.89	0.5388	23472
6.99	0.7219	31446
7.09	0.9589	41769
7.19	1.2240	53318
7.29	1.4977	65241
7.39	1.7726	77215
7.49	2.0676	90063
7.59	2.3287	101436
7.69	2.5892	112785
7.79	2.8216	122909
7.89	3.0592	133257
7.99	3.2772	142756
8.09	3.5349	153979
8.19	3.8402	167278
8.29	4.2464	184975
8.39	4.7222	205698
8.49	5.2903	230444
8.59	5.9387	258690
8.69	6.6354	289036
8.79	6.9998	304909
8.89	7.1868	313058
8.99	7.3079	318332
9.09	7.3756	321282
9.19	7.4141	322957
9.29	7.4238	323382
9.40	7.4282	323571
9.50	7.4282	323571

Comment:

Node: B-35

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.58 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.58	0.0006	25
5.60	0.0006	28
5.70	0.0010	43
5.80	0.0016	71

Stage [ft]	Area [ac]	Area [ft2]
5.90	0.0022	94
6.00	0.0026	115
6.10	0.0036	158
6.19	0.0040	175
6.29	0.0080	350
6.39	0.0161	700
6.49	0.0344	1500
6.59	0.0666	2900
6.69	0.1027	4474
6.79	0.1704	7424
6.89	0.2743	11948
6.99	0.4539	19772
7.09	0.7024	30596
7.19	1.0610	46219
7.29	1.4742	64216
7.39	1.8966	82614
7.49	2.4193	105386
7.59	3.0764	134007
7.69	3.8792	168977
7.79	4.8702	212147
7.89	5.9944	261115
7.99	7.2689	316633
8.09	8.4281	367126
8.19	9.4879	413295
8.29	10.4233	454039
8.39	11.2049	488085
8.49	11.9142	518981
8.59	12.5351	546027
8.69	13.0762	569599
8.79	13.5571	590546
8.89	14.0466	611868
8.99	14.5510	633840
9.09	15.0875	657212
9.19	15.7296	685184
9.29	16.7224	728428
9.39	17.5017	762373
9.49	17.8976	779621
9.59	18.1846	792119
9.69	18.3607	799793
9.79	18.4795	804967
9.89	18.5644	808667
9.99	18.6293	811492
10.09	18.6597	812816
10.19	18.6827	813816
10.29	18.6913	814191
10.40	18.6993	814541
10.49	18.7022	814666
10.60	18.7062	814841
10.70	18.7071	814883

Stage [ft]	Area [ac]	Area [ft2]
10.80	18.7096	814991
10.90	18.7100	815006
11.00	18.7100	815006

Comment:

Node: B-36

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.94	0.0006	25
1.00	0.0011	50
1.10	0.0016	71
1.20	0.0041	180
1.30	0.0109	475
1.40	0.0157	683
1.50	0.0197	858
1.60	0.0250	1087
1.70	0.0293	1275
1.80	0.0339	1475
1.90	0.0407	1775
2.00	0.0488	2125
2.10	0.0614	2675
2.20	0.0729	3175
2.30	0.0835	3637
2.40	0.0935	4074
2.50	0.1010	4399
2.60	0.1044	4549
2.70	0.1096	4774
2.80	0.1136	4949
2.90	0.1166	5079
3.00	0.1199	5224
3.10	0.1245	5424
3.20	0.1262	5499
3.30	0.1328	5784
3.40	0.1360	5924
3.50	0.1377	5999
3.60	0.1417	6174
3.70	0.1475	6424
3.80	0.1547	6737
3.90	0.1584	6899
4.00	0.1611	7016

Stage [ft]	Area [ac]	Area [ft2]
4.10	0.1681	7324
4.20	0.1773	7724
4.30	0.2003	8724
4.40	0.2290	9974
4.50	0.2668	11623
4.60	0.3145	13698
4.70	0.3489	15198
4.80	0.3845	16748
4.89	0.4132	17998
4.99	0.4436	19322
5.09	0.4792	20872
5.19	0.5245	22847
5.29	0.5670	24697
5.39	0.5985	26072
5.49	0.6289	27396
5.59	0.6674	29071
5.69	0.7047	30696
5.79	0.7454	32471
5.89	0.7942	34595
5.99	0.8481	36945
6.09	0.9004	39220
6.19	0.9595	41794
6.29	1.0278	44769
6.39	1.1150	48569
6.49	1.2275	53468
6.59	1.3916	60617
6.69	1.6601	72315
6.79	2.1255	92588
6.89	2.7900	121534
6.99	3.5745	155704
7.09	4.5919	200023
7.19	5.6834	247567
7.29	6.8861	299960
7.39	8.1078	353178
7.49	9.4019	409545
7.59	10.8933	474512
7.69	12.5953	548652
7.79	14.2801	622042
7.89	15.9942	696707
7.99	17.6302	767972
8.09	19.3420	842537
8.19	21.1123	919652
8.29	22.9348	999042
8.39	24.7947	1080056
8.49	26.5885	1158195
8.59	28.4328	1238535
8.69	30.5475	1330647
8.79	32.8710	1431859
8.89	35.1365	1530546

Stage [ft]	Area [ac]	Area [ft2]
8.99	37.3722	1627933
9.09	39.3479	1713996
9.19	41.0132	1786536
9.29	42.3004	1842604
9.39	43.3212	1887073
9.49	44.1786	1924418
9.59	44.8511	1953714
9.69	45.5340	1983460
9.79	46.0900	2007682
9.89	46.5755	2028829
9.99	47.0415	2049126
10.09	47.4282	2065974
10.19	47.7295	2079097
10.29	48.0227	2091871
10.39	48.2425	2101444
10.49	48.4078	2108643
10.59	48.5782	2116067
10.69	48.7148	2122017
10.79	48.8399	2127466
10.89	48.9621	2132790
10.99	49.0511	2136665
11.09	49.1222	2139764
11.19	49.1905	2142739
11.29	49.2439	2145064
11.39	49.2772	2146513
11.49	49.3127	2148063
11.59	49.3500	2149688
11.69	49.3747	2150763
11.79	49.3879	2151338
11.89	49.4040	2152038
11.99	49.4235	2152888
12.09	49.4407	2153637
12.19	49.4505	2154062
12.29	49.4574	2154362
12.39	49.4631	2154612
12.49	49.4688	2154862
12.59	49.4728	2155037
12.70	49.4750	2155131
12.80	49.4772	2155229
12.90	49.4797	2155337
12.99	49.4815	2155412
13.09	49.4832	2155487
13.20	49.4845	2155543
13.30	49.4851	2155572
13.40	49.4859	2155607
13.50	49.4870	2155654
13.60	49.4883	2155712
13.69	49.4889	2155737
13.80	49.4898	2155776

Stage [ft]	Area [ac]	Area [ft2]
13.90	49.4904	2155802
14.00	49.4932	2155924
14.10	49.4932	2155924

Comment:

Node: B-37

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 5.85 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
5.85	0.0006	25
5.90	0.0007	29
6.00	0.0008	37
6.10	0.0010	45
6.20	0.0013	56
6.29	0.0017	75
6.39	0.0069	300
6.49	0.0344	1500
6.59	0.0763	3325
6.69	0.1343	5849
6.79	0.2186	9524
6.89	0.3701	16123
6.99	0.5601	24397
7.09	0.7902	34420
7.19	1.0438	45469
7.29	1.3003	56642
7.39	1.6073	70016
7.49	1.9763	86088
7.59	2.3671	103111
7.69	2.7866	121384
7.79	3.2250	140481
7.89	3.5860	156204
7.99	3.8884	169377
8.09	4.2040	183126
8.19	4.5248	197099
8.29	4.9224	214421
8.39	5.3040	231044
8.49	5.6725	247092
8.59	6.0380	263015
8.69	6.3559	276863
8.79	7.2511	315858
8.89	7.6287	332306

Stage [ft]	Area [ac]	Area [ft2]
8.99	7.8163	340480
9.09	7.9305	345454
9.19	8.0011	348528
9.29	8.0700	351528
9.39	8.1251	353928
9.49	8.1405	354602
9.59	8.1405	354602

Comment:

Node: B-38

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
1.80	0.0006	25
1.90	0.0029	125
2.00	0.0098	425
2.10	0.0321	1400
2.20	0.0947	4124
2.30	0.1785	7774
2.40	0.2720	11848
2.50	0.3449	15023
2.60	0.3977	17323
2.70	0.4350	18947
2.80	0.4717	20547
2.90	0.4987	21722
3.00	0.5342	23272
3.10	0.5566	24247
3.20	0.5710	24872
3.30	0.5830	25397
3.40	0.5899	25697
3.51	0.5962	25972
3.60	0.6043	26321
3.71	0.6134	26721
3.80	0.6249	27221
3.90	0.6352	27671
4.01	0.6450	28096
4.10	0.6513	28371
4.21	0.6589	28701
4.31	0.6657	28996
4.41	0.6720	29271
4.50	0.6777	29521

Stage [ft]	Area [ac]	Area [ft2]
4.61	0.6834	29771
4.70	0.6903	30071
4.80	0.6995	30471
4.90	0.7093	30896
5.00	0.7185	31296
5.10	0.7299	31796
5.20	0.7403	32246
5.30	0.7546	32871
5.40	0.7684	33471
5.50	0.7810	34020
5.60	0.7948	34620
5.70	0.8114	35345
5.80	0.8349	36370
5.90	0.8631	37595
6.00	0.8929	38895
6.10	0.9216	40145
6.20	0.9468	41244
6.30	0.9761	42519
6.40	0.9996	43544
6.50	1.0410	45344
6.60	1.0897	47469
6.70	1.1563	50368
6.80	1.2447	54218
6.90	1.3646	59442
7.00	1.5339	66816
7.10	1.7623	76765
7.20	2.0320	88513
7.30	2.3637	102961
7.40	2.7126	118159
7.50	3.1252	136132
7.60	3.6055	157054
7.70	4.1317	179976
7.80	4.6734	203573
7.90	5.2294	227795
8.00	5.7981	252566
8.10	6.3909	278388
8.20	7.0933	308984
8.30	7.8324	341179
8.40	8.5428	372125
8.50	9.2177	401521
8.60	9.9315	432617
8.70	10.7200	466963
8.80	11.6083	505657
8.90	12.5930	548552
9.00	13.6541	594771
9.10	14.8023	644789
9.20	15.9948	696732
9.30	17.2492	751375
9.40	18.3952	801293

Stage [ft]	Area [ac]	Area [ft2]
9.50	19.6444	855711
9.60	20.9097	910828
9.70	22.2307	968371
9.80	23.4611	1021964
9.90	24.6426	1073432
10.00	25.7949	1123625
10.10	26.7589	1165619
10.20	27.4481	1195640
10.30	28.1006	1224062
10.40	28.7169	1250908
10.50	29.3860	1280054
10.60	29.8646	1300901
10.70	30.1641	1313950
10.80	30.3793	1323323
10.90	30.5469	1330622
11.00	30.6760	1336247
11.10	30.7845	1340971
11.20	30.8711	1344745
11.30	30.9285	1347245
11.40	30.9698	1349045
11.50	31.0042	1350545
11.60	31.0306	1351695
11.70	31.0479	1352444
11.80	31.0679	1353319
11.90	31.0817	1353919
12.00	31.0915	1354344
12.11	31.0986	1354657
12.20	31.1035	1354869
12.30	31.1075	1355044
12.40	31.1093	1355119
12.51	31.1098	1355142
12.61	31.1104	1355169
12.71	31.1108	1355188
12.81	31.1118	1355230
12.91	31.1118	1355230

Comment:

Node: B-39

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.94 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.94	0.0006	25
4.00	0.0010	44
4.10	0.0015	64
4.20	0.0020	86
4.29	0.0046	200
4.39	0.0184	800
4.49	0.0425	1850
4.59	0.0780	3400
4.69	0.1228	5349
4.79	0.1699	7399
4.89	0.2422	10549
4.99	0.3225	14048
5.09	0.4155	18098
5.19	0.5417	23597
5.29	0.6714	29246
5.39	0.8045	35045
5.49	0.9388	40895
5.59	1.0656	46419
5.69	1.1689	50918
5.79	1.2670	55193
5.89	1.3755	59917
5.99	1.4478	63067
6.09	1.5230	66341
6.19	1.5804	68841
6.29	1.6332	71140
6.39	1.6883	73540
6.49	1.7393	75765
6.59	1.7841	77715
6.69	1.8329	79839
6.79	1.8748	81664
6.89	1.9373	84389
6.99	2.0067	87413
7.09	2.0773	90488
7.19	2.1496	93637
7.29	2.2214	96762
7.39	2.2902	99762
7.49	2.3757	103486
7.59	2.4796	108011
7.69	2.5909	112860
7.79	2.6965	117459
7.89	2.8004	121984
7.99	2.9082	126683
8.09	3.0442	132607
8.19	3.1802	138532
8.29	3.3099	144181
8.39	3.4522	150380
8.49	3.5963	156654
8.59	3.7208	162078
8.69	3.8562	167978

Stage [ft]	Area [ac]	Area [ft2]
8.79	4.0008	174277
8.89	4.1437	180501
8.99	4.2751	186225
9.09	4.3911	191274
9.19	4.4921	195674
9.29	4.5976	200273
9.39	4.7101	205173
9.49	4.8214	210022
9.59	4.9201	214321
9.69	5.0177	218571
9.79	5.1078	222495
9.89	5.1904	226095
9.99	5.2484	228619
10.09	5.3264	232019
10.19	5.3798	234344
10.29	5.4320	236618
10.39	5.4647	238043
10.49	5.4911	239193
10.59	5.5175	240343
10.69	5.5502	241768
10.79	5.5841	243243
10.89	5.6174	244692
10.99	5.6484	246042
11.09	5.6828	247542
11.19	5.7120	248817
11.29	5.7499	250467
11.39	5.7832	251916
11.49	5.8176	253416
11.59	5.8498	254816
11.69	5.8808	256166
11.79	5.9089	257391
11.89	5.9433	258890
11.99	5.9777	260390
12.09	6.0116	261865
12.19	6.0455	263340
12.29	6.0741	264590
12.39	6.1046	265915
12.49	6.1344	267214
12.59	6.1671	268639
12.69	6.1998	270064
12.79	6.2331	271514
12.89	6.2647	272889
12.99	6.2974	274313
13.09	6.3255	275538
13.19	6.3593	277013
13.29	6.3915	278413
13.39	6.4196	279638
13.49	6.4558	281212
13.59	6.4908	282737

Stage [ft]	Area [ac]	Area [ft2]
13.69	6.5229	284137
13.79	6.5567	285612
13.89	6.5889	287012
13.99	6.6296	288786
14.09	6.6623	290211
14.19	6.7128	292411
14.29	6.7570	294336
14.39	6.7909	295811
14.49	6.8259	297335
14.59	6.8683	299185
14.69	6.9102	301010
14.79	6.9366	302160
14.89	6.9693	303584
14.99	6.9940	304659
15.09	7.0204	305809
15.19	7.0480	307009
15.29	7.0703	307984
15.39	7.0841	308584
15.49	7.0884	308772
15.59	7.0884	308772

Comment:

Node: B-4

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.24	0.0006	25
2.30	0.0012	54
2.40	0.0016	68
2.50	0.0023	100
2.60	0.0036	158
2.70	0.0051	221
2.80	0.0065	284
2.90	0.0081	354
3.00	0.0098	425
3.10	0.0138	600
3.20	0.0218	950
3.30	0.0284	1237
3.40	0.0350	1525
3.50	0.0453	1975
3.60	0.0637	2775

Stage [ft]	Area [ac]	Area [ft2]
3.70	0.1021	4449
3.80	0.1492	6499
3.90	0.2324	10124
4.00	0.3208	13973
4.10	0.4304	18747
4.20	0.5595	24372
4.30	0.7185	31296
4.40	0.8963	39045
4.50	1.0897	47469
4.59	1.2745	55518
4.69	1.5345	66841
4.79	1.8197	79264
4.89	2.1422	93313
4.99	2.4939	108636
5.09	2.9140	126933
5.19	3.4098	148530
5.29	4.0169	174977
5.39	4.6413	202173
5.49	5.4946	239343
5.59	6.2463	272089
5.69	7.1581	311808
5.79	8.1176	353603
5.89	8.9485	389798
5.99	9.7140	423143
6.09	10.5255	458489
6.19	11.3237	493259
6.29	12.1150	527730
6.39	12.9092	562325
6.49	13.7327	598195
6.59	14.6170	636715
6.69	15.6309	680884
6.79	16.6753	726378
6.89	17.7869	774797
6.99	19.1291	833264
7.09	20.4145	889256
7.19	21.5536	938875
7.29	22.5722	983244
7.39	23.6034	1028163
7.49	24.5261	1068357
7.59	25.2457	1099703
7.69	25.9303	1129524
7.79	26.6235	1159720
7.89	27.3563	1191641
7.99	28.1379	1225686
8.09	28.8271	1255707
8.19	29.3940	1280404
8.29	30.0184	1307600
8.39	30.7093	1337696
8.49	31.3572	1365918

Stage [ft]	Area [ac]	Area [ft2]
8.59	31.9826	1393164
8.69	32.6265	1421210
8.79	33.1774	1445207
8.89	33.6479	1465704
8.99	34.0835	1484677
9.09	34.4674	1501400
9.19	34.7887	1515398
9.29	35.0980	1528871
9.39	35.3746	1540919
9.49	35.5399	1548118
9.59	35.5735	1549582
9.69	35.5735	1549582

Comment:

Node: B-40

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.90 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.90	0.0006	25
4.01	0.0007	32
4.11	0.0009	39
4.21	0.0011	46
4.30	0.0023	100
4.40	0.0109	475
4.50	0.0316	1375
4.60	0.0574	2500
4.70	0.1148	4999
4.80	0.1813	7899
4.90	0.2542	11074
5.00	0.3277	14273
5.10	0.4040	17598
5.20	0.4992	21747
5.30	0.6352	27671
5.40	0.8395	36570
5.50	1.2395	53993
5.60	1.8495	80564
5.70	2.6311	114610
5.80	3.3742	146980
5.90	4.0358	175802
6.00	4.6430	202248
6.10	5.2690	229519

Stage [ft]	Area [ac]	Area [ft2]
6.20	5.9594	259590
6.30	6.6623	290211
6.40	7.3992	322307
6.50	8.3276	362752
6.60	9.5166	414545
6.70	10.8336	471912
6.80	12.3101	536228
6.90	13.8142	601745
7.00	15.1581	660287
7.10	16.2036	705831
7.20	17.0019	740601
7.30	17.5562	764748
7.40	17.9298	781021
7.50	18.1920	792444
7.60	18.4261	802643
7.70	18.6431	812092
7.80	18.8187	819741
7.90	18.9960	827464
8.00	19.1389	833689
8.10	19.2226	837338
8.20	19.3001	840713
8.30	19.3632	843462
8.40	19.4183	845862
8.50	19.4301	846373
8.60	19.4301	846373

Comment: This basin doesn't belong in this Town's model.

Node: B-5

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
2.66	0.0011	50
2.70	0.0029	125
2.80	0.0075	325
2.90	0.0115	500
3.00	0.0218	950
3.10	0.0379	1650
3.20	0.0511	2225
3.30	0.0620	2700
3.40	0.0717	3125
3.50	0.0809	3525

Stage [ft]	Area [ac]	Area [ft2]
3.60	0.0901	3924
3.70	0.0998	4349
3.80	0.1165	5074
3.90	0.1380	6012
4.00	0.1561	6799
4.10	0.1871	8149
4.20	0.2192	9549
4.30	0.2611	11373
4.39	0.3214	13998
4.49	0.3954	17223
4.59	0.4786	20847
4.69	0.5767	25122
4.79	0.6748	29396
4.89	0.7976	34745
4.99	0.9371	40820
5.09	1.0524	45844
5.19	1.1815	51468
5.29	1.3319	58017
5.39	1.5052	65566
5.49	1.6888	73565
5.59	1.8989	82714
5.69	2.1358	93038
5.79	2.4365	106136
5.89	2.7717	120734
5.99	3.1780	138432
6.09	3.7386	162853
6.19	4.3916	191299
6.29	5.0475	219871
6.39	5.8171	253391
6.49	6.5103	283587
6.59	7.2006	313658
6.69	7.8783	343179
6.79	8.5153	370925
6.89	9.1253	397497
6.99	9.7100	422969
7.09	10.2282	445541
7.19	10.7297	467388
7.29	11.2261	489010
7.39	11.7793	513106
7.49	12.4077	540478
7.59	13.0934	570349
7.69	13.8010	601170
7.79	14.7289	641589
7.89	15.4158	671510
7.99	15.9420	694432
8.09	16.3833	713655
8.19	16.7718	730577
8.29	17.1229	745875
8.39	17.3909	757549

Stage [ft]	Area [ac]	Area [ft2]
8.49	17.6681	769622
8.59	17.9338	781196
8.69	18.2041	792969
8.79	18.4795	804967
8.89	18.7653	817416
8.99	19.0918	831639
9.09	19.3982	844987
9.19	19.6909	857735
9.29	19.9554	869259
9.39	20.1752	878833
9.49	20.3887	888131
9.59	20.6842	901005
9.69	21.1295	920402
9.79	21.4784	935600
9.89	21.6529	943199
9.99	21.7028	945374
10.09	21.7344	946749
10.19	21.7539	947598
10.29	21.7705	948323
10.39	21.7741	948481
10.49	21.7741	948481

Comment:

Node: B-6

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
0.28	0.0006	25
0.30	0.0007	29
0.40	0.0011	49
0.50	0.0016	69
0.60	0.0033	146
0.70	0.0046	200
0.80	0.0075	325
0.89	0.0132	575
1.00	0.0207	900
1.09	0.0310	1350
1.20	0.0511	2225
1.30	0.0683	2975
1.40	0.0844	3675
1.50	0.1044	4549

Stage [ft]	Area [ac]	Area [ft2]
1.60	0.1182	5149
1.70	0.1337	5824
1.80	0.1526	6649
1.90	0.1796	7824
2.00	0.2158	9399
2.10	0.2611	11373
2.20	0.3294	14348
2.30	0.4155	18098
2.40	0.5239	22822
2.50	0.6347	27646
2.60	0.7712	33596
2.70	0.9164	39920
2.80	1.0576	46069
2.90	1.2171	53018
3.00	1.3692	59642
3.10	1.5482	67441
3.20	1.7410	75840
3.30	1.9436	84664
3.40	2.1622	94187
3.50	2.3820	103761
3.60	2.6093	113660
3.70	2.8325	123384
3.80	3.0649	133507
3.90	3.2864	143156
4.00	3.5326	153879
4.10	3.7994	165503
4.20	4.0336	175702
4.30	4.2912	186925
4.40	4.5615	198698
4.50	4.8432	210972
4.59	5.0602	220421
4.69	5.3230	231869
4.79	5.5508	241793
4.89	5.7780	251691
4.99	6.0047	261565
5.09	6.2285	271314
5.19	6.4230	279788
5.29	6.6411	289286
5.39	6.8603	298835
5.49	7.0721	308059
5.59	7.2729	316808
5.69	7.5099	327131
5.79	7.7142	336030
5.89	7.9156	344804
5.99	8.1509	355053
6.09	8.4017	365976
6.19	8.6536	376950
6.29	8.9416	389498
6.39	9.2814	404296

Stage [ft]	Area [ac]	Area [ft2]
6.49	9.6498	420344
6.59	10.0641	438391
6.69	10.4887	456889
6.79	10.9891	478686
6.89	11.5699	503983
6.99	12.2349	532954
7.09	13.0435	568174
7.19	13.7792	600220
7.29	14.5642	634415
7.39	15.3521	668736
7.49	16.1158	702006
7.59	16.8091	732202
7.69	17.5384	763973
7.79	18.3045	797344
7.89	19.1572	834489
7.99	20.0926	875233
8.09	21.0848	918452
8.19	22.0758	961622
8.29	23.1449	1008190
8.39	24.2059	1054409
8.49	25.3955	1106227
8.59	26.5277	1155546
8.69	27.5394	1199615
8.79	28.4925	1241134
8.89	29.4399	1282404
8.99	30.5073	1328898
9.09	31.7565	1383315
9.19	32.9708	1436208
9.29	34.0565	1483502
9.39	34.9821	1523822
9.49	35.8154	1560117
9.59	36.4678	1588538
9.69	36.9935	1611435
9.79	37.4393	1630857
9.89	37.7968	1646430
9.99	38.1457	1661628
10.09	38.4711	1675801
10.19	38.7523	1688050
10.29	39.0111	1699323
10.39	39.2596	1710147
10.49	39.4966	1720470
10.59	39.7209	1730244
10.69	39.9356	1739593
10.79	40.1112	1747242
10.89	40.2741	1754341
10.99	40.4434	1761715
11.09	40.6379	1770189
11.19	40.8089	1777638
11.29	40.9868	1785387

Stage [ft]	Area [ac]	Area [ft2]
11.39	41.1670	1793236
11.49	41.3082	1799385
11.59	41.4591	1805959
11.69	41.6204	1812983
11.79	41.7506	1818657
11.89	41.8992	1825131
11.99	42.0358	1831080
12.09	42.1621	1836580
12.19	42.2963	1842429
12.29	42.4151	1847603
12.39	42.5362	1852878
12.49	42.6504	1857852
12.59	42.7749	1863276
12.69	42.9023	1868825
12.79	43.0314	1874450
12.89	43.1560	1879874
12.99	43.2684	1884773
13.09	43.4039	1890673
13.19	43.5227	1895847
13.29	43.6443	1901146
13.39	43.7597	1906170
13.49	43.8836	1911570
13.59	44.0007	1916669
13.69	44.1103	1921443
13.79	44.2227	1926343
13.89	44.3467	1931742
13.99	44.4666	1936966
14.09	44.5923	1942441
14.19	44.7157	1947815
14.29	44.8413	1953289
14.39	44.9584	1958388
14.49	45.0893	1964088
14.59	45.2057	1969162
14.69	45.3291	1974536
14.79	45.4370	1979236
14.89	45.5409	1983760
14.99	45.6264	1987485
15.09	45.7182	1991484
15.19	45.8111	1995534
15.29	45.9144	2000033
15.39	46.0189	2004582
15.49	46.1118	2008632
15.59	46.2060	2012731
15.69	46.3110	2017306
15.79	46.4022	2021280
15.89	46.5055	2025779
15.99	46.6008	2029929
16.09	46.7006	2034278
16.19	46.7982	2038528

Stage [ft]	Area [ac]	Area [ft2]
16.29	46.9003	2042977
16.39	47.0099	2047752
16.49	47.1132	2052251
16.59	47.1993	2056000
16.69	47.3008	2060425
16.79	47.3823	2063974
16.89	47.4736	2067949
16.99	47.5677	2072048
17.09	47.6566	2075923
17.19	47.7364	2079397
17.29	47.8230	2083172
17.39	47.9028	2086646
17.49	47.9831	2090146
17.59	48.0635	2093645
17.69	48.1547	2097620
17.79	48.2356	2101144
17.89	48.3217	2104894
17.99	48.3969	2108168
18.09	48.4887	2112168
18.19	48.5736	2115867
18.29	48.6454	2118992
18.39	48.7326	2122792
18.49	48.8141	2126341
18.59	48.9053	2130316
18.69	49.0281	2135665
18.79	49.1303	2140114
18.89	49.2290	2144414
19.00	49.3179	2148288
19.10	49.3891	2151388
19.20	49.4539	2154212
19.30	49.5314	2157587
19.40	49.5997	2160561
19.50	49.6685	2163561
19.60	49.7288	2166186
19.70	49.7976	2169185
19.80	49.8562	2171735
19.90	49.9176	2174410
20.00	49.9801	2177134
20.10	50.0484	2180109
20.20	50.1121	2182884
20.30	50.1712	2185458
20.40	50.2384	2188383
20.50	50.2917	2190707
20.60	50.3583	2193607
20.70	50.4237	2196457
20.80	50.4880	2199256
20.90	50.5459	2201781
21.00	50.6102	2204581
21.10	50.6739	2207355

Stage [ft]	Area [ac]	Area [ft2]
21.20	50.7456	2210480
21.30	50.8099	2213279
21.40	50.8782	2216254
21.50	50.9362	2218779
21.60	51.0159	2222253
21.70	51.0664	2224453
21.80	51.1318	2227303
21.90	51.1972	2230152
22.00	51.2764	2233602
22.10	51.3442	2236551
22.20	51.4119	2239501
22.30	51.4813	2242526
22.40	51.5439	2245250
22.50	51.6064	2247975
22.60	51.6684	2250674
22.70	51.7464	2254074
22.80	51.8107	2256874
22.90	51.8738	2259623
23.00	51.9387	2262448
23.10	52.0001	2265123
23.20	52.0672	2268047
23.30	52.1366	2271072
23.40	52.2141	2274446
23.50	52.2824	2277421
23.60	52.3581	2280720
23.70	52.4304	2283870
23.80	52.4982	2286820
23.90	52.5751	2290169
24.00	52.6491	2293394
24.10	52.7139	2296218
24.20	52.7971	2299843
24.30	52.8660	2302842
24.40	52.9394	2306042
24.50	53.0152	2309342
24.60	53.0915	2312666
24.70	53.1621	2315741
24.80	53.2413	2319190
24.90	53.3176	2322515
25.00	53.3847	2325439
25.10	53.4588	2328664
25.20	53.5362	2332039
25.30	53.6137	2335413
25.40	53.6963	2339013
25.50	53.7681	2342137
25.60	53.8444	2345462
25.70	53.9201	2348761
25.80	53.9930	2351936
25.90	54.0636	2355011
26.00	54.1371	2358210

Stage [ft]	Area [ac]	Area [ft2]
26.10	54.2111	2361435
26.20	54.2891	2364834
26.30	54.3649	2368134
26.40	54.4429	2371533
26.50	54.5187	2374833
26.60	54.5933	2378082
26.70	54.6765	2381707
26.80	54.7666	2385631
26.90	54.8440	2389006
27.00	54.9301	2392756
27.10	55.0202	2396680
27.20	55.1069	2400454
27.30	55.1883	2404004
27.40	55.2744	2407753
27.50	55.3714	2411978
27.60	55.4649	2416052
27.70	55.5562	2420027
27.80	55.6509	2424151
27.90	55.7346	2427801
28.00	55.8242	2431700
28.10	55.9252	2436100
28.20	56.0376	2440999
28.30	56.1501	2445898
28.40	56.2362	2449648
28.50	56.3469	2454472
28.60	56.4451	2458747
28.70	56.5575	2463646
28.80	56.6683	2468470
28.90	56.7676	2472795
29.00	56.8892	2478094
29.10	56.9988	2482868
29.20	57.1119	2487793
29.30	57.2295	2492917
29.40	57.3477	2498066
29.50	57.4699	2503391
29.60	57.5836	2508340
29.70	57.7006	2513439
29.80	57.8229	2518764
29.90	57.9439	2524038
30.00	58.0708	2529562
30.10	58.2033	2535336
30.20	58.3301	2540861
30.30	58.4598	2546510
30.40	58.6107	2553084
30.50	58.7479	2559058
30.60	58.8724	2564483
30.70	58.9906	2569632
30.80	59.1146	2575031
30.90	59.2093	2579156

Stage [ft]	Area [ac]	Area [ft2]
31.00	59.3108	2583580
31.10	59.3935	2587180
31.20	59.4600	2590079
31.30	59.5409	2593604
31.40	59.5932	2595878
31.50	59.6477	2598253
31.60	59.6901	2600103
31.70	59.7452	2602502
31.80	59.7877	2604352
31.90	59.8325	2606302
32.00	59.8772	2608252
32.10	59.9203	2610126
32.20	59.9507	2611451
32.30	60.0006	2613626
32.40	60.0258	2614726
32.50	60.0597	2616201
32.60	60.0924	2617625
32.70	60.1211	2618875
32.80	60.1527	2620250
32.90	60.1681	2620921
33.00	60.1681	2620921

Comment:

Node: B-7

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 0.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.83	2.0400	88863
-1.80	2.0406	88888
-1.70	2.0423	88963
-1.60	3.4543	150467
-1.49	3.4660	150980
-1.40	4.9477	215521
-1.29	4.9603	216071
-1.19	4.9672	216371
-1.09	4.9747	216696
-0.99	4.9867	217221
-0.89	4.9970	217671
-0.79	5.0108	218271
-0.69	5.0240	218846
-0.59	5.0355	219346

Stage [ft]	Area [ac]	Area [ft2]
-0.49	5.0464	219821
-0.39	5.0596	220396
-0.29	5.0688	220796
-0.19	5.0837	221445
-0.09	5.0963	221995
0.00	5.1152	222820
0.10	5.1342	223645
0.20	5.1566	224620
0.30	5.1778	225545
0.40	5.1939	226245
0.50	5.2082	226870
0.60	5.2243	227570
0.70	5.2398	228245
0.80	5.2576	229019
0.90	5.2754	229794
1.00	5.2937	230594
1.10	5.3075	231194
1.20	5.3207	231769
1.30	5.3402	232619
1.40	5.3695	233894
1.50	5.3844	234544
1.60	5.4010	235269
1.70	5.4343	236718
1.80	5.4630	237968
1.90	5.4957	239393
2.00	5.5227	240568
2.10	5.5462	241593
2.20	5.5726	242743
2.30	5.5984	243867
2.40	5.6420	245767
2.50	5.7138	248892
2.60	5.7947	252416
2.70	5.9066	257291
2.80	6.1057	265964
2.90	6.3542	276788
3.00	6.6566	289961
3.10	7.0898	308834
3.20	7.6425	332906
3.30	8.2863	360952
3.40	8.9445	389623
3.50	9.6601	420794
3.60	10.3631	451415
3.70	11.1418	485335
3.80	11.9589	520930
3.90	12.9631	564675
4.00	14.0776	613218
4.10	15.2809	665636
4.20	16.7557	729878
4.30	18.5960	810042

Stage [ft]	Area [ac]	Area [ft2]
4.40	20.3996	888606
4.50	22.2084	967396
4.60	23.9942	1045185
4.70	25.6480	1117226
4.80	27.2806	1188341
4.89	28.6205	1246709
4.99	30.4040	1324398
5.09	32.0498	1396089
5.19	33.7248	1469054
5.29	35.3368	1539269
5.39	36.7352	1600186
5.49	37.8577	1649080
5.59	38.5520	1679326
5.69	39.0231	1699848
5.79	39.4759	1719570
5.89	39.8483	1735793
5.99	40.1863	1750516
6.09	40.4778	1763215
6.19	40.7378	1774538
6.29	40.9381	1783262
6.39	41.0901	1789886
6.49	41.2147	1795310
6.59	41.3415	1800835
6.69	41.4671	1806309
6.79	41.5986	1812033
6.89	41.7449	1818407
6.99	41.8683	1823781
7.09	41.9905	1829106
7.19	42.1213	1834805
7.29	42.2556	1840654
7.39	42.3359	1844154
7.49	42.3956	1846753
7.59	42.4433	1848828
7.69	42.4811	1850478
7.79	42.5167	1852028
7.89	42.5511	1853527
7.99	42.5879	1855127
8.09	42.5933	1855365
8.19	42.5933	1855365

Comment: Normal water levels at 2.00 NGVD or 0.5 NAVD

Node: B-8

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs

Initial Stage: 3.67 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
3.67	0.0006	25
3.70	0.0013	58
3.80	0.0020	87
3.90	0.0025	108
4.00	0.0034	150
4.09	0.0046	200
4.20	0.0071	308
4.30	0.0098	425
4.39	0.0121	525
4.49	0.0189	825
4.60	0.0362	1575
4.69	0.0482	2100
4.79	0.0671	2925
4.89	0.0889	3874
4.99	0.1228	5349
5.09	0.1750	7624
5.19	0.2634	11473
5.29	0.3896	16973
5.39	0.5463	23797
5.49	0.7035	30646
5.59	0.8906	38795
5.69	1.1414	49718
5.79	1.4220	61942
5.89	1.7726	77215
5.99	2.1749	94737
6.09	2.5393	110610
6.19	2.8709	125058
6.29	3.2221	140356
6.39	3.5343	153954
6.49	3.8161	166228
6.59	4.0416	176051
6.69	4.2321	184350
6.79	4.3836	190949
6.89	4.4961	195849
6.99	4.5621	198723
7.09	4.5965	200223
7.19	4.6200	201248
7.30	4.6281	201598
7.40	4.6328	201806
7.50	4.6361	201948
7.60	4.6381	202036
7.70	4.6392	202083
7.80	4.6433	202263
7.90	4.6433	202263

Comment:

Node: B-9

Scenario: Proposed
Type: Stage/Area
Base Flow: 0.00 cfs
Initial Stage: 3.09 ft
Warning Stage: 0.00 ft

Stage [ft]	Area [ac]	Area [ft2]
-1.33	0.0109	475
-1.30	0.0109	476
-1.20	0.0110	479
-1.10	0.0111	483
-1.00	0.0112	486
-0.90	0.0112	489
-0.80	0.0113	493
-0.70	0.0114	496
-0.60	0.0115	500
-0.50	0.0117	508
-0.40	0.0119	516
-0.30	0.0121	525
-0.20	0.0125	544
-0.10	0.0129	562
0.00	0.0133	578
0.10	0.0137	595
0.20	0.0145	629
0.30	0.0150	652
0.40	0.0153	668
0.50	0.0159	694
0.60	0.0169	737
0.70	0.0177	770
0.80	0.0181	790
0.90	0.0191	830
1.00	0.0201	875
1.09	0.0207	900
1.20	0.0230	1002
1.30	0.0232	1010
1.40	0.0234	1018
1.50	0.0237	1031
1.60	0.0243	1060
1.70	0.0247	1075
1.80	0.0249	1085
1.90	0.0252	1096
2.00	0.0253	1104
2.10	0.0255	1110
2.20	0.0256	1116
2.30	0.0258	1122
2.40	0.0265	1156
2.50	0.0269	1172
2.60	0.0277	1206
2.70	0.0279	1217

Stage [ft]	Area [ac]	Area [ft2]
2.80	0.0298	1300
2.90	0.0303	1321
3.00	0.0308	1341
3.10	0.0311	1354
3.20	0.0312	1360
3.30	0.0314	1367
3.40	0.0315	1373
3.50	0.0321	1400
3.60	0.0333	1450
3.70	0.0362	1575
3.80	0.0390	1700
3.90	0.0499	2175
4.00	0.0648	2825
4.10	0.0821	3575
4.20	0.1079	4699
4.30	0.1343	5849
4.40	0.1773	7724
4.50	0.2163	9424
4.59	0.2473	10774
4.69	0.2875	12523
4.79	0.3311	14423
4.89	0.3644	15873
4.99	0.3937	17148
5.09	0.4310	18772
5.19	0.4608	20072
5.29	0.5079	22122
5.39	0.5647	24597
5.49	0.6255	27246
5.59	0.7317	31871
5.69	0.8436	36745
5.79	1.0455	45544
5.89	1.2510	54493
5.99	1.4117	61492
6.09	1.5281	66566
6.19	1.6343	71191
6.29	1.7095	74465
6.39	1.7560	76490
6.49	1.7910	78015
6.59	1.8243	79464
6.69	1.8478	80489
6.79	1.8673	81339
6.89	1.8845	82089
7.00	1.8977	82664
7.09	1.9098	83189
7.19	1.9230	83764
7.29	1.9367	84364
7.39	1.9539	85114
7.49	1.9654	85614
7.59	1.9662	85648

Stage [ft]	Area [ac]	Area [ft2]
7.69	1.9662	85648

Comment:

Node: DISCHARGE TO GOLF COURSE

Scenario: Proposed
Type: Time/Stage
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft
Boundary Stage:

Year	Month	Day	Hour	Stage [ft]
0	0	0	0.0000	0.00
0	0	0	10.0000	0.99
0	0	0	20.0000	1.79
0	0	0	30.0000	2.15
0	0	0	40.0000	2.55
0	0	0	50.0000	2.53
0	0	0	60.0000	3.22
0	0	0	64.0000	4.81
0	0	0	70.0000	4.50
0	0	0	80.0000	3.42
0	0	0	90.0000	2.71
0	0	0	96.0000	2.50

Comment: BASED ON PREVIOUS STUDY CONDUCTED FOR THE GOLF COURSE.
USED PREVIOUS DATA AS A BASIS FOR THE TAILWATER CONDITIONS FROM HH ICPR MODEL

Node: STORAGE ON 52ND

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.62	0.86	37462
4.23	1.72	74923

Comment: Approx. 1980 LF of 5'x5' Exfil running along SW 52nd St

1.72 ac-ft

Node: STORAGE ON SITE 19

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 2.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.66	0.11	4574
3.32	0.21	9148

Comment: SW 31ST ST DRAINAGE IMPROVEMENTS

https://dpep.broward.org/Enviros/Default.aspx?PossePresentation=SurfaceWaterLicense&PosseObjectId=33557971

0.21 AC-FT
TOP OF TRENCH: 3.32 NAVD

WT:2

BOT OF TRENCH: -0.93 NAVD

Node: STORAGE ON SITE 1

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.50	2.68	116741
4.00	4.34	189050
5.00	7.80	339768
6.00	11.37	495277
7.00	16.69	727016
8.00	25.49	1110344
9.00	37.78	1645697
10.00	53.55	2332638
11.00	71.07	3095809

Comment:

Node: STORAGE ON SITE 11

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.00	0.39	16988
3.50	0.78	33977

Comment: NEED MORE INFORMATION

Node: STORAGE ON SITE 12

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
9.20	0.04	1742
9.40	0.16	6970
9.60	0.36	15682
9.80	0.61	26572
10.00	0.93	40511
10.20	1.28	55757
10.40	1.64	71438
10.60	2.00	87120
10.80	2.36	102802

Comment:

Node: STORAGE ON SITE 13

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
4.00	0.00	0
5.00	0.09	3920
6.00	0.18	7841
7.00	0.27	11761

Stage [ft]	Volume [ac-ft]	Volume [ft3]
8.00	0.36	15682
9.00	0.49	21344
10.00	0.71	30928
11.00	1.65	71874
12.00	3.20	139392

Comment: K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2004 Apartment complex discharging to onsite retention\Calculations - Revised .pdf.pdf

Node: STORAGE ON SITE 14

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.00	0.27	11761
4.50	0.54	23522

Comment:
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=77827255&hash=1DC8E684EBA90B369411BEA9A491E7D2E453F1F2

Node: STORAGE ON SITE 15

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 2.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.50	0.16	6970
3.00	0.33	14375
3.50	0.51	22216
4.00	0.71	30928
4.50	0.93	40511
5.00	1.16	50530
5.50	1.41	61420
6.00	1.67	72745
6.50	1.72	74923
7.00	1.72	74923

Comment: STORAGE IS USED BY MULTIPLE BASINS IN THE AREA

Node: STORAGE ON SITE 17

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.00	2.52	109858
4.50	5.04	219717

Comment: USING PERMIT FROM BROWARD THAT IS FOR MUCH LARGER AREA AND ASSUMING THAT STAGE STORAGE IS 1/5 OF THAT NUMBER FOR A ROUGH ESTIMATE
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=37159263&hash=D3675B834D18CCEC4310DCD6F0656AEC0FCED9C3

Node: STORAGE ON SITE 18

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
4.50	0.00	0
5.00	3.61	157252
5.50	7.54	328442
6.00	11.79	513572
6.50	16.36	712642
7.00	21.77	948301
7.50	28.52	1242331
8.00	36.61	1594732
8.50	46.04	2005502
9.00	57.37	2499037
9.50	70.64	3077078
10.00	85.34	3717410
10.50	101.47	4420033
11.00	119.03	5184947
11.50	138.02	6012151

Comment: NEEDS MORE INFORMATION

Node: STORAGE ON SITE 2

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.50	0.00	0
3.50	0.02	871
4.50	0.04	1742

Comment:

Node: STORAGE ON SITE 20

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
1.50	1.29	56192
2.00	2.58	112385

Comment: 25TH ST DRAINAGE IMPROVEMENTS

2.58AC-FT STORAGE

DRAINAGE CALC:
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=71947644&hash=56720218B15DFE73AD2ACA8E756638FCF0B8E06F

PLANS:
K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Receivables\20240222 25th St Bid Plans

Node: STORAGE ON SITE 21

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 1.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
1.00	0.00	0
2.67	0.90	39204
4.33	1.80	78408

Comment: John P Lyons Phase 2:
Will be constructed after EPA clean up.

No drainage report given but from plan set have calculated exfil volume of 1.80 Ac-Ft

Node: STORAGE ON SITE 3

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 0.00 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
5.00	0.00	0
5.50	0.00	0
6.00	8.92	388555
6.50	18.58	809345
7.00	28.99	1262804
7.50	40.15	1748934
8.00	52.05	2267298
8.50	64.70	2818332
9.00	77.72	3385483
9.50	90.74	3952634
10.00	103.75	4519350

Comment:

Node: STORAGE ON SITE 4

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
2.00	0.00	0
2.50	7.00	304920
3.00	14.00	609840
3.50	21.00	914760
4.00	28.00	1219680

Stage [ft]	Volume [ac-ft]	Volume [ft3]
4.50	35.00	1524600
5.00	42.00	1829520
5.50	49.00	2134440
6.00	56.00	2439360
6.50	63.00	2744280
7.00	70.00	3049200
7.50	78.31	3411184
8.00	90.57	3945229
8.50	108.08	4707965
9.00	130.85	5699826
9.50	158.87	6920377
10.00	191.51	8342176

Comment:

Node: STORAGE ON SITE 5

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.16	6970
4.00	0.32	13939
4.50	0.48	20909
5.00	0.64	27878
5.50	0.79	34412
6.00	0.95	41382
6.50	1.11	48352
7.00	1.22	53143
7.50	1.49	64904
8.00	1.86	81022
8.50	2.33	101495
9.00	2.89	125888
9.50	3.56	155074
10.00	4.32	188179
10.50	5.37	233917
11.00	6.88	299693
11.50	8.86	385942
12.00	11.19	487436

Comment:

Node: STORAGE ON SITE 6

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.00	0
4.63	0.36	15464
5.75	0.71	30928

Comment:
https://dpep.broward.org/Enviros/download.aspx?PosseObjectId=72592592&hash=BAF6E372B1EA46D84A6355CC91B4A7800C3A1DDA

Node: STORAGE ON SITE 8

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
6.00	0.27	11761
7.00	0.53	23087
8.00	0.66	28750

Comment:

Node: STORAGE ON SITE 9

Scenario: Proposed
Type: Stage/Volume
Base Flow: 0.00 cfs
Initial Stage: 3.50 ft
Warning Stage: 0.00 ft

Stage [ft]	Volume [ac-ft]	Volume [ft3]
3.50	0.01	436
3.75	0.02	871
4.00	0.03	1307
4.25	0.06	2614
4.50	0.07	3049
4.75	0.10	4356
5.00	0.13	5663

Stage [ft]	Volume [ac-ft]	Volume [ft3]
5.25	0.16	6970
5.50	0.20	8712
5.75	0.24	10454
6.00	0.28	12197
6.25	0.33	14375
6.50	0.38	16553
6.75	0.44	19166
7.00	0.50	21780
7.25	0.59	25700
7.50	0.72	31363
7.75	0.90	39204
8.00	1.13	49223
8.25	1.40	60984
8.50	1.73	75359
8.75	2.12	92347
9.00	2.63	114563
9.25	3.23	140699
9.50	3.94	171626
9.75	4.75	206910
10.00	5.66	246550

Comment: RECREATION GREEN AREA USED AS A STORAGE SITE

Weir Link: L-0010W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0020W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-12	Op Table:	
Link Count:	1	Ref Node:	

Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Broad Crested Vertical
Geometry Type:	Irregular
Invert:	-0.29 ft
Control Elevation:	-0.29 ft
Cross Section:	1

Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients	
Weir Default:	2.800
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Comment:

Weir Link: L-0030W

Scenario:	Existing
From Node:	B-12
To Node:	B-11
Link Count:	1
Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Broad Crested Vertical
Geometry Type:	Irregular
Invert:	6.76 ft
Control Elevation:	6.76 ft
Cross Section:	4

Bottom Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients	
Weir Default:	2.800
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Comment:

Weir Link: L-0040W

Scenario:	Existing
From Node:	B-2
To Node:	B-12
Link Count:	1
Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Broad Crested Vertical
Geometry Type:	Irregular
Invert:	3.44 ft
Control Elevation:	3.44 ft
Cross Section:	3

Bottom Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients	
Weir Default:	2.800
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Comment:

Weir Link: L-0050W

Scenario:	Existing	Bottom Clip	
From Node:	B-11	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	Discharge Coefficients	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0060W

Scenario:	Existing	Bottom Clip	
From Node:	B-11	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	Discharge Coefficients	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0070W

Scenario:	Existing	Bottom Clip	
From Node:	B-10	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.44 ft	Discharge Coefficients	
Control Elevation:	3.44 ft	Weir Default:	2.800
Cross Section:	3	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0080W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-10	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	**Discharge Coefficients**	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0090W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-11	Default:	0.00 ft
To Node:	B-13	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	**Discharge Coefficients**	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0100W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-13	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.76 ft	Ref Node:	
Control Elevation:	6.76 ft	Discharge Coefficients	
Cross Section:	4	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0110W

Scenario:	Existing	Bottom Clip	
From Node:	B-14	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	Discharge Coefficients	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0120W

Scenario:	Existing	Bottom Clip	
From Node:	B-15	Default:	0.00 ft
To Node:	B-14	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	Discharge Coefficients	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0130W

Scenario:	Existing	Bottom Clip	
From Node:	B-15	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	Discharge Coefficients	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	6	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0140W

Scenario:	Existing	Bottom Clip	
From Node:	B-14	Default:	0.00 ft
To Node:	B-17	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	Discharge Coefficients	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0150W

Scenario:	Existing	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-15	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	Discharge Coefficients	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0160W

Scenario:	Existing	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.04 ft	Discharge Coefficients	
Control Elevation:	4.04 ft	Weir Default:	2.800
Cross Section:	8	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0170W

Scenario:	Existing	Bottom Clip	
From Node:	B-15	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.04 ft	Discharge Coefficients	
Control Elevation:	4.04 ft	Weir Default:	2.800
Cross Section:	8	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0180W

Scenario:	Existing	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	8.19 ft	Ref Node:	
Control Elevation:	8.19 ft	Discharge Coefficients	
Cross Section:	15	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0190W

Scenario:	Existing	Bottom Clip	
From Node:	B-16	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	Discharge Coefficients	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0200W

Scenario:	Existing	Bottom Clip	
From Node:	B-9	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.97 ft	Discharge Coefficients	
Control Elevation:	4.97 ft	Weir Default:	2.800
Cross Section:	12	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0210W

Scenario:	Existing	Bottom Clip	
From Node:	B-8	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	Discharge Coefficients	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0220W

Scenario:	Existing	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	Discharge Coefficients	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0230W

Scenario:	Existing	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-8	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0240W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-7	Default:	0.00 ft
To Node:	B-15	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.47 ft	**Discharge Coefficients**	
Control Elevation:	4.47 ft	Weir Default:	2.800
Cross Section:	10	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0250W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-7	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	**Discharge Coefficients**	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0260W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-7	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	8.19 ft	Ref Node:	
Control Elevation:	8.19 ft	Discharge Coefficients	
Cross Section:	15	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0270W

Scenario:	Existing	Bottom Clip	
From Node:	B-5	Default:	0.00 ft
To Node:	B-6	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.27 ft	Discharge Coefficients	
Control Elevation:	3.27 ft	Weir Default:	2.800
Cross Section:	16	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0280W

Scenario:	Existing	Bottom Clip	
From Node:	B-5	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.17 ft	Discharge Coefficients	
Control Elevation:	6.17 ft	Weir Default:	2.800
Cross Section:	24	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0290W

Scenario:	Existing	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.34 ft	Discharge Coefficients	
Control Elevation:	3.34 ft	Weir Default:	2.800
Cross Section:	14	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0300W

Scenario:	Existing	Bottom Clip	
From Node:	B-3	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0310W

Scenario:	Existing	Bottom Clip	
From Node:	B-4	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0320W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-5	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	**Discharge Coefficients**	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0330W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-3	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	**Discharge Coefficients**	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0340W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-2	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	4.40 ft	Ref Node:	
Control Elevation:	4.40 ft	Discharge Coefficients	
Cross Section:	2	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0350W

Scenario:	Existing	Bottom Clip	
From Node:	B-1	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	Discharge Coefficients	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0360W

Scenario:	Existing	Bottom Clip	
From Node:	B-5	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	Discharge Coefficients	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0370W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-17	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0380W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-14	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0390W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-10	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	9.48 ft	**Discharge Coefficients**	
Control Elevation:	9.48 ft	Weir Default:	2.800
Cross Section:	5	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0400W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-13	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	9.48 ft	**Discharge Coefficients**	
Control Elevation:	9.48 ft	Weir Default:	2.800
Cross Section:	5	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0410W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-21	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	**Discharge Coefficients**	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0420W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-21	Default:	0.00 ft
To Node:	B-19	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	7.04 ft	Ref Node:	
Control Elevation:	7.04 ft	Discharge Coefficients	
Cross Section:	20	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0430W

Scenario:	Existing	Bottom Clip	
From Node:	B-6	Default:	0.00 ft
To Node:	B-18	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.43 ft	Discharge Coefficients	
Control Elevation:	3.43 ft	Weir Default:	2.800
Cross Section:	17	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0440W

Scenario:	Existing	Bottom Clip	
From Node:	B-18	Default:	0.00 ft
To Node:	B-19	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	Discharge Coefficients	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0450W

Scenario:	Existing	Bottom Clip	
From Node:	B-18	Default:	0.00 ft
To Node:	B-20	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	Discharge Coefficients	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0460W

Scenario:	Existing	Bottom Clip	
From Node:	B-21	Default:	0.00 ft
To Node:	B-23	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	Discharge Coefficients	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0470W

Scenario:	Existing	Bottom Clip	
From Node:	B-23	Default:	0.00 ft
To Node:	B-33	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	Discharge Coefficients	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0480W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-23	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	**Discharge Coefficients**	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0490W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-33	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	**Discharge Coefficients**	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0500W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-33	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.07 ft	Ref Node:	
Control Elevation:	6.07 ft	Discharge Coefficients	
Cross Section:	23	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0510W

Scenario:	Existing	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	Discharge Coefficients	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0520W

Scenario:	Existing	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-35	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.17 ft	Discharge Coefficients	
Control Elevation:	7.17 ft	Weir Default:	2.800
Cross Section:	25	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0530W

Scenario:	Existing	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-34	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.17 ft	Discharge Coefficients	
Control Elevation:	6.17 ft	Weir Default:	2.800
Cross Section:	24	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0540W

Scenario:	Existing	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.70 ft	Discharge Coefficients	
Control Elevation:	7.70 ft	Weir Default:	2.800
Cross Section:	29	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0550W

Scenario:	Existing	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-30	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0560W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-26	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.15 ft	**Discharge Coefficients**	
Control Elevation:	5.15 ft	Weir Default:	2.800
Cross Section:	33	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0570W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-35	Default:	0.00 ft
To Node:	B-36	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	**Discharge Coefficients**	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0580W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-35	Default:	0.00 ft
To Node:	B-34	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	7.17 ft	Ref Node:	
Control Elevation:	7.17 ft	Discharge Coefficients	
Cross Section:	25	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0590W

Scenario:	Existing	Bottom Clip	
From Node:	B-34	Default:	0.00 ft
To Node:	B-36	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	Discharge Coefficients	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0610W

Scenario:	Existing	Bottom Clip	
From Node:	B-36	Default:	0.00 ft
To Node:	B-37	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.64 ft	Discharge Coefficients	
Control Elevation:	6.64 ft	Weir Default:	2.800
Cross Section:	28	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0620W

Scenario:	Existing	Bottom Clip	
From Node:	B-36	Default:	0.00 ft
To Node:	B-38	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.99 ft	Discharge Coefficients	
Control Elevation:	6.99 ft	Weir Default:	2.800
Cross Section:	27	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0640W

Scenario:	Existing	Bottom Clip	
From Node:	B-38	Default:	0.00 ft
To Node:	B-37	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.64 ft	Discharge Coefficients	
Control Elevation:	6.64 ft	Weir Default:	2.800
Cross Section:	28	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0650W

Scenario:	Existing	Bottom Clip	
From Node:	B-29	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0660W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-28	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	**Discharge Coefficients**	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0670W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-27	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	**Discharge Coefficients**	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0680W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-27	Default:	0.00 ft
To Node:	B-30	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.39 ft	Ref Node:	
Control Elevation:	6.39 ft	Discharge Coefficients	
Cross Section:	30	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0690W

Scenario:	Existing	Bottom Clip	
From Node:	B-30	Default:	0.00 ft
To Node:	B-26	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.15 ft	Discharge Coefficients	
Control Elevation:	5.15 ft	Weir Default:	2.800
Cross Section:	33	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0700W

Scenario:	Existing	Bottom Clip	
From Node:	B-26	Default:	0.00 ft
To Node:	B-27	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.55 ft	Discharge Coefficients	
Control Elevation:	5.55 ft	Weir Default:	2.800
Cross Section:	34	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0710W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-27	Default:	0.00 ft
To Node:	B-28	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.59 ft	**Discharge Coefficients**	
Control Elevation:	4.59 ft	Weir Default:	2.800
Cross Section:	32	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0720W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-28	Default:	0.00 ft
To Node:	B-29	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.64 ft	**Discharge Coefficients**	
Control Elevation:	5.64 ft	Weir Default:	2.800
Cross Section:	31	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0730W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-26	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.43 ft	**Discharge Coefficients**	
Control Elevation:	5.43 ft	Weir Default:	2.800
Cross Section:	35	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0740W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-24	Default:	0.00 ft
To Node:	B-40	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.67 ft	**Discharge Coefficients**	
Control Elevation:	5.67 ft	Weir Default:	2.800
Cross Section:	38	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0750W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-40	Default:	0.00 ft
To Node:	B-25	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.92 ft	**Discharge Coefficients**	
Control Elevation:	5.92 ft	Weir Default:	2.800
Cross Section:	37	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0760W

Scenario:	Existing	**Bottom Clip**	
From Node:	B-24	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.14 ft	Ref Node:	
Control Elevation:	6.14 ft	Discharge Coefficients	
Cross Section:	36	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0770W

Scenario:	Existing	Bottom Clip	
From Node:	B-40	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	Discharge Coefficients	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0780W

Scenario:	Existing	Bottom Clip	
From Node:	B-25	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	Discharge Coefficients	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0790W			
Scenario:	Existing	Bottom Clip	
From Node:	B-20	Default:	0.00 ft
To Node:	B-21	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.34 ft	Discharge Coefficients	
Control Elevation:	-0.34 ft	Weir Default:	2.800
Cross Section:	19	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0820W			
Scenario:	Existing	Bottom Clip	
From Node:	B-1	Default:	0.00 ft
To Node:	STORAGE ON SITE 2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	Discharge Coefficients	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-0830P		Upstream		Downstream	
Scenario:	Existing	Invert:	-0.72 ft	Invert:	-8.91 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-12	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.50 ft	Max Depth:	4.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1462.61 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	

Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: Outfall leading from Basin 1 to Basin 12. Unknown pipe material so assuming CMP. Other drainage infrastructure modeled with stage storage nodes as it is held mostly on site (sourced from drainage reports)

Pipe Link: L-0840P		Upstream		Downstream	
Scenario:	Existing	Invert:	8.18 ft	Invert:	8.44 ft
From Node:	B-1	Manning's N:	0.0120	Manning's N:	0.0120
To Node:	B-39	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.50 ft	Max Depth:	4.50 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2870.39 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: connection between basin 1 and pembroke rd (basin 39) (1 of 2 outfalls)

Pipe Link: L-0850P		Upstream		Downstream	
Scenario:	Existing	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-39	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2648.59 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: connection between basin 1 and pembroke rd (basin 39) (2 of 2 outfalls) assuming bituminous coated pipe like other latteral on property

Weir Link: L-0860W		
Scenario:	Existing	Bottom Clip

From Node:	B-3		
To Node:	STORAGE ON SITE 3	Default:	0.00 ft
Link Count:	1	Op Table:	
Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	-1.33 ft	Ref Node:	
Control Elevation:	-1.33 ft	**Discharge Coefficients**	
Cross Section:	11	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-0880P		Upstream		Downstream	
Scenario:	Existing	Invert:	-1.40 ft	Invert:	-3.40 ft
From Node:	B-7	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-3	**Geometry: Circular**		**Geometry: Circular**	
Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both	**Bottom Clip**			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1537.48 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	**Top Clip**			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf
Unknown material assuming HDPE due to being connected to a pump station

Rating Curve Link: L-0890RC

Scenario:	Existing
From Node:	B-3
To Node:	B-11
Link Count:	1
Flow Direction:	Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP3CFS	1.50	B-3	0.50	B-3

Comment: 3 CFS PUMP FOUND K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf PAGE 107

Pipe Link: L-0910P		Upstream		Downstream	
Scenario:	Existing	Invert:	-1.11 ft	Invert:	-3.22 ft
From Node:	B-9	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-15	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	715.54 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0930P		Upstream		Downstream	
Scenario:	Existing	Invert:	-1.92 ft	Invert:	-2.12 ft
From Node:	B-10	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-9	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	872.92 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0940P		Upstream		Downstream	
Scenario:	Existing	Invert:	-1.90 ft	Invert:	-2.22 ft
From Node:	B-15	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-17	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	910.18 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	

Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00		Top Clip		
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0990P		Upstream		Downstream	
Scenario:	Existing	Invert:	0.43 ft	Invert:	0.12 ft
From Node:	B-17	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-18	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.25 ft	Max Depth:	1.25 ft
Flow Direction:	None		Bottom Clip		
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2490.01 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00		Top Clip		
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1020P		Upstream		Downstream	
Scenario:	Existing	Invert:	2.60 ft	Invert:	1.60 ft
From Node:	B-39	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-6	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both		Bottom Clip		
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	7099.35 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00		Top Clip		
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: pembroke park road feeding into DOT system assuming same material as previous pipes in system (Bitumous Coated Pipe)

Pipe Link: L-1060P		Upstream		Downstream	
Scenario:	Existing	Invert:	7.40 ft	Invert:	6.40 ft
From Node:	B-4	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-5	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	1.90 ft	Max Depth:	0.90 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2152.81 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: LOCAL SYSTEM FEEDS INTO BASIN 5 AND THEN SITS IN A RETENTION AREA BEFORE GOING INTO THE DOT SYSTEM PAST A CONTROL STRUCTURE

Pipe Link: L-1080P		Upstream		Downstream	
Scenario:	Existing	Invert:	-1.33 ft	Invert:	-1.33 ft
From Node:	B-9	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	B-3	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	12473.45 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1120P		Upstream		Downstream	
Scenario:	Existing	Invert:	8.18 ft	Invert:	2.90 ft
From Node:	B-10	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-11	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	7.42 ft	Max Depth:	7.42 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1956.83 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000

Exit Loss Coef:	0.00		Top Clip		
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: TWO OUTLETS LEADING INTO LAKE COMBINED INTO ONE PIPE (BOTH PVC ONE 77" THE SECOND 12")

Weir Link: L-1130W

Scenario:	Existing	Bottom Clip	
From Node:	B-13	Default:	0.00 ft
To Node:	STORAGE ON SITE 5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	Discharge Coefficients	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-1140P		Upstream		Downstream	
Scenario:	Existing	Invert:	1.25 ft	Invert:	-1.70 ft
From Node:	B-15	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-14	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	798.60 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1150P		Upstream		Downstream	
Scenario:	Existing	Invert:	-0.17 ft	Invert:	-4.15 ft

From Node:	B-17	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	19	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	1576.14 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.50	Top Clip			
Exit Loss Coef:	1.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment: PIPE CONNECTING BASINS B-17 B-16 B-6 AND B-3 MOVING FROM SW 31ST AVE CAROLINA ST AND S PARK ROAD INTO LARGE LAKE WITH PUMP STATION

Pipe Link: L-1200P		Upstream		Downstream	
Scenario:	Existing	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-6	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-18	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1953.70 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING HDPE

Weir Link: L-1210W			
Scenario:	Existing	Bottom Clip	
From Node:	B-18	Default:	0.00 ft
To Node:	STORAGE ON SITE 6	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	Discharge Coefficients	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	

Orifice Default:	0.600
Orifice Table:	

Comment:

Pipe Link: L-1250P		Upstream		Downstream	
Scenario:	Existing	Invert:	0.01 ft	Invert:	-1.11 ft
From Node:	B-33	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-32	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	692.87 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING PIPE MATERIAL AND SIZE IS 1" AND HDPE

Pipe Link: L-1260P		Upstream		Downstream	
Scenario:	Existing	Invert:	2.49 ft	Invert:	2.47 ft
From Node:	B-32	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-35	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1629.83 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Weir Link: L-1270W			
Scenario:	Existing	Bottom Clip	
From Node:	B-32	Default:	0.00 ft

To Node:	STORAGE ON SITE 9		
Link Count:	1	Op Table:	
Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.99 ft	Ref Node:	
Control Elevation:	6.99 ft	Discharge Coefficients	
Cross Section:	27	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-1290W

Scenario:	Existing	Bottom Clip	
From Node:	B-35	Default:	0.00 ft
To Node:	STORAGE ON SITE 11	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	Discharge Coefficients	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-1300W

Scenario:	Existing	Bottom Clip	
From Node:	B-36	Default:	0.00 ft
To Node:	STORAGE ON SITE 12	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	Discharge Coefficients	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-1310P		Upstream		Downstream	
Scenario:	Existing	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-35	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-36	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1532.73 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1320P		Upstream		Downstream	
Scenario:	Existing	Invert:	4.79 ft	Invert:	4.69 ft
From Node:	B-36	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-38	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1068.86 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Weir Link: L-1330W			
Scenario:	Existing	Bottom Clip	
From Node:	B-38	Default:	0.00 ft
To Node:	STORAGE ON SITE 13	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.99 ft	Discharge Coefficients	
Control Elevation:	6.99 ft	Weir Default:	2.800

Cross Section: 27

Weir Table:
Orifice Default: 0.600
Orifice Table:

Comment:

Pipe Link: L-1340P		Upstream		Downstream	
Scenario:	Existing	Invert:	2.10 ft	Invert:	7.05 ft
From Node:	B-38	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-34	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2528.34 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1400P		Upstream		Downstream	
Scenario:	Existing	Invert:	2.01 ft	Invert:	0.21 ft
From Node:	B-34	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-31	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	936.01 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1410P		Upstream		Downstream	
Scenario:	Existing	Invert:	-0.40 ft	Invert:	-1.30 ft

From Node:	B-31	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-30	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	396.60 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1420P		Upstream		Downstream	
Scenario:	Existing	Invert:	0.54 ft	Invert:	-0.40 ft
From Node:	B-29	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-28	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	283.66 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING 1" CMP

Pipe Link: L-1430P		Upstream		Downstream	
Scenario:	Existing	Invert:	-0.40 ft	Invert:	-0.70 ft
From Node:	B-28	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-27	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	261.31 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	

Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1440P		Upstream		Downstream	
Scenario:	Existing	Invert:	-0.13 ft	Invert:	-1.00 ft
From Node:	B-27	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-30	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	696.58 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1450P		Upstream		Downstream	
Scenario:	Existing	Invert:	0.90 ft	Invert:	-0.84 ft
From Node:	B-30	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-26	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	374.43 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1500P		Upstream		Downstream	
Scenario:	Existing	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-40	Geometry:	Circular	Geometry:	Circular

Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	821.13 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1510P		Upstream		Downstream	
Scenario:	Existing	Invert:	1.26 ft	Invert:	-0.98 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-26	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	937.41 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: POTENTIAL DISCHARGE INTO LAKE AREA. WILL NEED FURTHER RESEARCH

Drop Structure Link: L-1580DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	297.21 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000

Bend Loss Coef:	0.00
Bend Location:	0.00 dec
Energy Switch:	Energy

Pipe Comment:

Weir Component	
Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	8.78 ft
Control Elevation:	8.78 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Bottom Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment: assumed invert and control elevation as catch basin data was not available. assumption based on raster elevations for general area

Drop Structure Comment: drop structure used to model the flow of water into a drainage structure and into the local drainage system. the following stage volume node represents the designed storage for the site from previous reports for permits.

Drop Structure Link: L-1590DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE 2	Geometry: Circular		Geometry: Circular	
		Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	288.51 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component	
Weir:	1

Bottom Clip

Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	8.78 ft
Control Elevation:	8.78 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1600DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-2	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	18	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	262.15 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	8.78 ft
Control Elevation:	8.78 ft
Max Depth:	999.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Max Width:	10.00 ft		
Fillet:	0.00 ft	Weir Default:	3.200
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1610DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	-1.40 ft	Invert:	-3.40 ft
From Node:	B-3	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	3	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	767.89 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.40 ft	Op Table:	
Control Elevation:	5.40 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1620DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	-1.92 ft	Invert:	-2.12 ft
From Node:	B-10	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	4	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	371.12 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	4.08 ft	Ref Node:	
Control Elevation:	4.08 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1630DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-18	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	6	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	

Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	254.22 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.40 ft	Op Table:	
Control Elevation:	7.40 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1640DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-13	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	5	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	277.27 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.00 ft	Ref Node:	
Control Elevation:	5.00 ft	**Discharge Coefficients**	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1650DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-22	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	8	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	445.58 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular		

Invert:	7.40 ft
Control Elevation:	7.40 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Op Table:	
Ref Node:	
Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1660DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	17	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	889.88 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.48 ft	Op Table:	
Control Elevation:	5.48 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1670DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-40	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	17	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	308.92 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.48 ft	Op Table:	
Control Elevation:	5.48 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1680DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	-0.40 ft	Invert:	-1.30 ft
From Node:	B-30	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	

	15	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	239.04 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.10 ft	Op Table:	
Control Elevation:	5.10 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1690DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	-0.40 ft	Invert:	-1.30 ft
From Node:	B-31	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	15	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	622.33 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	

Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.10 ft	Ref Node:	
Control Elevation:	5.10 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1700DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	2.01 ft	Invert:	0.21 ft
From Node:	B-34	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE 15	Geometry: Circular		Geometry: Circular	
		Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	984.42 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip
Weir:	1	

Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	7.01 ft
Control Elevation:	7.01 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1710DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	2.49 ft	Invert:	2.47 ft
From Node:	B-32	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	9	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	261.51 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	7.49 ft
Control Elevation:	7.49 ft
Max Depth:	999.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Max Width:	10.00 ft		
Fillet:	0.00 ft	Weir Default:	3.200
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1720DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	2.10 ft	Invert:	2.01 ft
From Node:	B-37	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	14	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	441.61 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.10 ft	Op Table:	
Control Elevation:	7.10 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1730DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-35	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	11	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	449.58 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	7.96 ft	Ref Node:	
Control Elevation:	7.96 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1740DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	2.10 ft	Invert:	2.01 ft
From Node:	B-38	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	13	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	

Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	385.31 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.10 ft	Op Table:	
Control Elevation:	7.10 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1750DS		Upstream Pipe		Downstream Pipe	
Scenario:	Existing	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-36	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	12	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	732.41 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	7.96 ft	Ref Node:	
Control Elevation:	7.96 ft	**Discharge Coefficients**	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Rating Curve Link: L-1820RC

Scenario: Existing
From Node: B-3
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: None

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP7CFS	2.00	B-3	0.50	

Comment: Has a 7cfs limit to Pembroke Road/golf course based on permitting but has two pumps inside that can pump 11cfs (not allowed to run at the same time due to permit)
- From Stefano's meeting with the town 10/25/2023

Rating Curve Link: L-1830RC

Scenario: Existing
From Node: B-3
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Both

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP 80CFS	1.00	B-3	0.50	B-3

Comment: Set of 3, one out for repair (still included)
VERIFY

Rating Curve Link: L-1850RC

Scenario: Existing
From Node: B-7
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Both

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP3CFS	1.00	B-7	0.50	

Comment:

Pipe Link: L-1890P		Upstream		Downstream	
Scenario:	Existing	Invert:	-2.50 ft	Invert:	-2.50 ft
From Node:	B-12	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	B-11	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.00 ft	Max Depth:	4.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1071.21 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1900P		Upstream		Downstream	
Scenario:	Existing	Invert:	2.50 ft	Invert:	2.50 ft
From Node:	STORAGE ON SITE 15	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	STORAGE 52ND ST	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	162.09 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Weir Link: L-0010W

Scenario:	Future	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0020W

Scenario:	Future	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-12	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0030W

Scenario:	Future	**Bottom Clip**	
From Node:	B-12	Default:	0.00 ft
To Node:	B-11	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	**Discharge Coefficients**	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0040W

Scenario:	Future	**Bottom Clip**	
From Node:	B-2	Default:	0.00 ft
To Node:	B-12	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.44 ft	**Discharge Coefficients**	
Control Elevation:	3.44 ft	Weir Default:	2.800
Cross Section:	3	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0050W

Scenario:	Future	**Bottom Clip**	
From Node:	B-11	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	**Discharge Coefficients**	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0060W

Scenario:	Future	**Bottom Clip**	
From Node:	B-11	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	-0.29 ft	Ref Node:	
Control Elevation:	-0.29 ft	Discharge Coefficients	
Cross Section:	1	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0070W

Scenario:	Future	Bottom Clip	
From Node:	B-10	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.44 ft	Discharge Coefficients	
Control Elevation:	3.44 ft	Weir Default:	2.800
Cross Section:	3	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0080W

Scenario:	Future	Bottom Clip	
From Node:	B-10	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	Discharge Coefficients	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0090W

Scenario:	Future	**Bottom Clip**	
From Node:	B-11	Default:	0.00 ft
To Node:	B-13	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	**Discharge Coefficients**	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0100W

Scenario:	Future	**Bottom Clip**	
From Node:	B-13	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	**Discharge Coefficients**	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0110W

Scenario:	Future	**Bottom Clip**	
From Node:	B-14	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0120W

Scenario:	Future	**Bottom Clip**	
From Node:	B-15	Default:	0.00 ft
To Node:	B-14	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0130W

Scenario:	Future	**Bottom Clip**	
From Node:	B-15	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	6	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0140W

Scenario:	Future	**Bottom Clip**	
From Node:	B-14	Default:	0.00 ft
To Node:	B-17	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	7.43 ft	Ref Node:	
Control Elevation:	7.43 ft	Discharge Coefficients	
Cross Section:	7	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0150W

Scenario:	Future	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-15	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	Discharge Coefficients	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0160W

Scenario:	Future	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.04 ft	Discharge Coefficients	
Control Elevation:	4.04 ft	Weir Default:	2.800
Cross Section:	8	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0170W

Scenario:	Future	Bottom Clip	
From Node:	B-15	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.04 ft	Discharge Coefficients	
Control Elevation:	4.04 ft	Weir Default:	2.800
Cross Section:	8	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0180W

Scenario:	Future	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	8.19 ft	Discharge Coefficients	
Control Elevation:	8.19 ft	Weir Default:	2.800
Cross Section:	15	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0190W

Scenario:	Future	Bottom Clip	
From Node:	B-16	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	Discharge Coefficients	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0200W

Scenario:	Future	**Bottom Clip**	
From Node:	B-9	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.97 ft	**Discharge Coefficients**	
Control Elevation:	4.97 ft	Weir Default:	2.800
Cross Section:	12	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0210W

Scenario:	Future	**Bottom Clip**	
From Node:	B-8	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	**Discharge Coefficients**	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0220W

Scenario:	Future	**Bottom Clip**	
From Node:	B-7	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	-1.33 ft	Ref Node:	
Control Elevation:	-1.33 ft	Discharge Coefficients	
Cross Section:	11	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0230W

Scenario:	Future	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-8	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0240W

Scenario:	Future	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-15	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.47 ft	Discharge Coefficients	
Control Elevation:	4.47 ft	Weir Default:	2.800
Cross Section:	10	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0250W

Scenario:	Future	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	Discharge Coefficients	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0260W

Scenario:	Future	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	8.19 ft	Discharge Coefficients	
Control Elevation:	8.19 ft	Weir Default:	2.800
Cross Section:	15	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0270W

Scenario:	Future	Bottom Clip	
From Node:	B-5	Default:	0.00 ft
To Node:	B-6	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.27 ft	Discharge Coefficients	
Control Elevation:	3.27 ft	Weir Default:	2.800
Cross Section:	16	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0280W

Scenario:	Future	**Bottom Clip**	
From Node:	B-5	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.17 ft	**Discharge Coefficients**	
Control Elevation:	6.17 ft	Weir Default:	2.800
Cross Section:	24	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0290W

Scenario:	Future	**Bottom Clip**	
From Node:	B-7	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.34 ft	**Discharge Coefficients**	
Control Elevation:	3.34 ft	Weir Default:	2.800
Cross Section:	14	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0300W

Scenario:	Future	**Bottom Clip**	
From Node:	B-3	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	5.04 ft	Ref Node:	
Control Elevation:	5.04 ft	Discharge Coefficients	
Cross Section:	13	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0310W

Scenario:	Future	Bottom Clip	
From Node:	B-4	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0320W

Scenario:	Future	Bottom Clip	
From Node:	B-5	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	Discharge Coefficients	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0330W

Scenario:	Future	**Bottom Clip**	
From Node:	B-3	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	**Discharge Coefficients**	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0340W

Scenario:	Future	**Bottom Clip**	
From Node:	B-2	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	**Discharge Coefficients**	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0350W

Scenario:	Future	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0360W

Scenario:	Future	**Bottom Clip**	
From Node:	B-5	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0370W

Scenario:	Future	**Bottom Clip**	
From Node:	B-17	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0380W

Scenario:	Future	**Bottom Clip**	
From Node:	B-14	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	7.43 ft	Ref Node:	
Control Elevation:	7.43 ft	Discharge Coefficients	
Cross Section:	7	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0390W

Scenario:	Future	Bottom Clip	
From Node:	B-10	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	9.48 ft	Discharge Coefficients	
Control Elevation:	9.48 ft	Weir Default:	2.800
Cross Section:	5	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0400W

Scenario:	Future	Bottom Clip	
From Node:	B-13	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	9.48 ft	Discharge Coefficients	
Control Elevation:	9.48 ft	Weir Default:	2.800
Cross Section:	5	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0410W

Scenario:	Future	**Bottom Clip**	
From Node:	B-21	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	**Discharge Coefficients**	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0420W

Scenario:	Future	**Bottom Clip**	
From Node:	B-21	Default:	0.00 ft
To Node:	B-19	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.04 ft	**Discharge Coefficients**	
Control Elevation:	7.04 ft	Weir Default:	2.800
Cross Section:	20	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0430W

Scenario:	Future	**Bottom Clip**	
From Node:	B-6	Default:	0.00 ft
To Node:	B-18	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.43 ft	**Discharge Coefficients**	
Control Elevation:	3.43 ft	Weir Default:	2.800
Cross Section:	17	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0440W

Scenario:	Future	**Bottom Clip**	
From Node:	B-18	Default:	0.00 ft
To Node:	B-19	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	**Discharge Coefficients**	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0450W

Scenario:	Future	**Bottom Clip**	
From Node:	B-18	Default:	0.00 ft
To Node:	B-20	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	**Discharge Coefficients**	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0460W

Scenario:	Future	**Bottom Clip**	
From Node:	B-21	Default:	0.00 ft
To Node:	B-23	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.96 ft	Ref Node:	
Control Elevation:	6.96 ft	Discharge Coefficients	
Cross Section:	21	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0470W

Scenario:	Future	Bottom Clip	
From Node:	B-23	Default:	0.00 ft
To Node:	B-33	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	Discharge Coefficients	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0480W

Scenario:	Future	Bottom Clip	
From Node:	B-23	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	Discharge Coefficients	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0490W

Scenario:	Future	**Bottom Clip**	
From Node:	B-33	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	**Discharge Coefficients**	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0500W

Scenario:	Future	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-33	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.07 ft	**Discharge Coefficients**	
Control Elevation:	6.07 ft	Weir Default:	2.800
Cross Section:	23	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0510W

Scenario:	Future	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	**Discharge Coefficients**	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0520W

Scenario:	Future	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-35	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.17 ft	**Discharge Coefficients**	
Control Elevation:	7.17 ft	Weir Default:	2.800
Cross Section:	25	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0530W

Scenario:	Future	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-34	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.17 ft	**Discharge Coefficients**	
Control Elevation:	6.17 ft	Weir Default:	2.800
Cross Section:	24	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0540W

Scenario:	Future	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	7.70 ft	Ref Node:	
Control Elevation:	7.70 ft	Discharge Coefficients	
Cross Section:	29	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0550W

Scenario:	Future	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-30	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0560W

Scenario:	Future	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-26	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.15 ft	Discharge Coefficients	
Control Elevation:	5.15 ft	Weir Default:	2.800
Cross Section:	33	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0570W

Scenario:	Future	**Bottom Clip**	
From Node:	B-35	Default:	0.00 ft
To Node:	B-36	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	**Discharge Coefficients**	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0580W

Scenario:	Future	**Bottom Clip**	
From Node:	B-35	Default:	0.00 ft
To Node:	B-34	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.17 ft	**Discharge Coefficients**	
Control Elevation:	7.17 ft	Weir Default:	2.800
Cross Section:	25	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0590W

Scenario:	Future	**Bottom Clip**	
From Node:	B-34	Default:	0.00 ft
To Node:	B-36	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	**Discharge Coefficients**	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0610W

Scenario:	Future	**Bottom Clip**	
From Node:	B-36	Default:	0.00 ft
To Node:	B-37	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.64 ft	**Discharge Coefficients**	
Control Elevation:	6.64 ft	Weir Default:	2.800
Cross Section:	28	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0620W

Scenario:	Future	**Bottom Clip**	
From Node:	B-36	Default:	0.00 ft
To Node:	B-38	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.99 ft	**Discharge Coefficients**	
Control Elevation:	6.99 ft	Weir Default:	2.800
Cross Section:	27	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0640W

Scenario:	Future	**Bottom Clip**	
From Node:	B-38	Default:	0.00 ft
To Node:	B-37	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.64 ft	Ref Node:	
Control Elevation:	6.64 ft	Discharge Coefficients	
Cross Section:	28	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0650W

Scenario:	Future	Bottom Clip	
From Node:	B-29	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0660W

Scenario:	Future	Bottom Clip	
From Node:	B-28	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0670W

Scenario:	Future	**Bottom Clip**	
From Node:	B-27	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	**Discharge Coefficients**	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0680W

Scenario:	Future	**Bottom Clip**	
From Node:	B-27	Default:	0.00 ft
To Node:	B-30	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	**Discharge Coefficients**	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0690W

Scenario:	Future	**Bottom Clip**	
From Node:	B-30	Default:	0.00 ft
To Node:	B-26	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.15 ft	**Discharge Coefficients**	
Control Elevation:	5.15 ft	Weir Default:	2.800
Cross Section:	33	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0700W

Scenario:	Future	**Bottom Clip**	
From Node:	B-26	Default:	0.00 ft
To Node:	B-27	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.55 ft	**Discharge Coefficients**	
Control Elevation:	5.55 ft	Weir Default:	2.800
Cross Section:	34	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0710W

Scenario:	Future	**Bottom Clip**	
From Node:	B-27	Default:	0.00 ft
To Node:	B-28	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.59 ft	**Discharge Coefficients**	
Control Elevation:	4.59 ft	Weir Default:	2.800
Cross Section:	32	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0720W

Scenario:	Future	**Bottom Clip**	
From Node:	B-28	Default:	0.00 ft
To Node:	B-29	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	5.64 ft	Ref Node:	
Control Elevation:	5.64 ft	Discharge Coefficients	
Cross Section:	31	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0730W

Scenario:	Future	Bottom Clip	
From Node:	B-26	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.43 ft	Discharge Coefficients	
Control Elevation:	5.43 ft	Weir Default:	2.800
Cross Section:	35	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0740W

Scenario:	Future	Bottom Clip	
From Node:	B-24	Default:	0.00 ft
To Node:	B-40	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.67 ft	Discharge Coefficients	
Control Elevation:	5.67 ft	Weir Default:	2.800
Cross Section:	38	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0750W

Scenario:	Future	**Bottom Clip**	
From Node:	B-40	Default:	0.00 ft
To Node:	B-25	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.92 ft	**Discharge Coefficients**	
Control Elevation:	5.92 ft	Weir Default:	2.800
Cross Section:	37	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0760W

Scenario:	Future	**Bottom Clip**	
From Node:	B-24	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	**Discharge Coefficients**	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0770W

Scenario:	Future	**Bottom Clip**	
From Node:	B-40	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	**Discharge Coefficients**	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0780W

Scenario:	Future	**Bottom Clip**	
From Node:	B-25	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	**Discharge Coefficients**	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0790W

Scenario:	Future	**Bottom Clip**	
From Node:	B-20	Default:	0.00 ft
To Node:	B-21	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.34 ft	**Discharge Coefficients**	
Control Elevation:	-0.34 ft	Weir Default:	2.800
Cross Section:	19	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0820W

Scenario:	Future	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	STORAGE ON SITE 2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	-0.29 ft	Ref Node:	
Control Elevation:	-0.29 ft	Discharge Coefficients	
Cross Section:	1	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-0830P		Upstream		Downstream	
Scenario:	Future	Invert:	-0.72 ft	Invert:	-8.91 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-12	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.50 ft	Max Depth:	4.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1462.61 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: Outfall leading from Basin 1 to Basin 12. Unknown pipe material so assuming CMP. Other drainage infrastructure modeled with stage storage nodes as it is held mostly on site (sourced from drainage reports)

Pipe Link: L-0840P		Upstream		Downstream	
Scenario:	Future	Invert:	8.18 ft	Invert:	8.44 ft
From Node:	B-1	Manning's N:	0.0120	Manning's N:	0.0120
To Node:	B-39	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.50 ft	Max Depth:	4.50 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2870.39 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: connection between basin 1 and pembroke rd (basin 39) (1 of 2 outfalls)

Pipe Link: L-0850P		Upstream		Downstream	
Scenario:	Future	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-39	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2648.59 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: connection between basin 1 and pembroke rd (basin 39) (2 of 2 outfalls) assuming bituminous coated pipe like other latteral on property

Weir Link: L-0860W			
Scenario:	Future	Bottom Clip	
From Node:	B-3	Default:	0.00 ft
To Node:	STORAGE ON SITE 3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	Discharge Coefficients	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-0880P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.40 ft	Invert:	-3.40 ft
From Node:	B-7	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-3	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1537.48 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			

Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf
Unknown material assuming HDPE due to being connected to a pump station

Rating Curve Link: L-0890RC

Scenario:	Future
From Node:	B-3
To Node:	B-11
Link Count:	1
Flow Direction:	Both

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP3CFS	1.50	B-3	0.50	B-3

Comment: 3 CFS PUMP FOUND K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf PAGE 107

Pipe Link: L-0910P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.11 ft	Invert:	-3.22 ft
From Node:	B-9	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE 20	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	715.54 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0930P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.92 ft	Invert:	-2.12 ft
From Node:	B-10	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-9	Geometry: Circular		Geometry: Circular	

Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	872.92 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0940P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.90 ft	Invert:	-2.22 ft
From Node:	B-15	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-17	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	910.18 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0990P		Upstream		Downstream	
Scenario:	Future	Invert:	0.43 ft	Invert:	0.12 ft
From Node:	B-17	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-18	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.25 ft	Max Depth:	1.25 ft
Flow Direction:	None	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2490.01 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	

Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1020P		Upstream		Downstream	
Scenario:	Future	Invert:	2.60 ft	Invert:	1.60 ft
From Node:	B-39	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-6	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	7099.35 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: pembroke park road feeding into DOT system assuming same material as previous pipes in system (Bitumous Coated Pipe)

Pipe Link: L-1060P		Upstream		Downstream	
Scenario:	Future	Invert:	7.40 ft	Invert:	6.40 ft
From Node:	B-4	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-5	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.90 ft	Max Depth:	0.90 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2152.81 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: LOCAL SYSTEM FEEDS INTO BASIN 5 AND THEN SITS IN A RETENTION AREA BEFORE GOING INTO THE DOT SYSTEM PAST A CONTROL STRUCTURE

Pipe Link: L-1080P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.33 ft	Invert:	-1.33 ft

From Node:	B-9	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	B-3	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	300.00 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1120P		Upstream		Downstream	
Scenario:	Future	Invert:	8.18 ft	Invert:	2.90 ft
From Node:	B-10	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-11	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	7.42 ft	Max Depth:	7.42 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1956.83 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: TWO OUTLETS LEADING INTO LAKE COMBINED INTO ONE PIPE (BOTH PVC ONE 77" THE SECOND 12")

Weir Link: L-1130W			
Scenario:	Future	Bottom Clip	
From Node:	B-13	Default:	0.00 ft
To Node:	STORAGE ON SITE 5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	Discharge Coefficients	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600

Orifice Table:

Comment:

Pipe Link: L-1140P		Upstream		Downstream	
Scenario:	Future	Invert:	1.25 ft	Invert:	-1.70 ft
From Node:	STORAGE ON SITE 20	Manning's N:	0.0100	Manning's N:	0.0100
		Geometry: Circular		Geometry: Circular	
To Node:	B-14	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	798.60 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.50	Top Clip			
Exit Loss Coef:	1.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1150P		Upstream		Downstream	
Scenario:	Future	Invert:	-0.17 ft	Invert:	-4.15 ft
From Node:	B-17	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE 19	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	1576.14 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.50	Top Clip			
Exit Loss Coef:	1.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment: PIPE CONNECTING BASINS B-17 B-16 B-6 AND B-3 MOVING FROM SW 31ST AVE CAROLINA ST AND S PARK ROAD INTO LARGE LAKE WITH PUMP STATION

Pipe Link: L-1200P		Upstream		Downstream	
Scenario:	Future	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-6	Manning's N:	0.0100	Manning's N:	0.0100

To Node:	B-18	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1953.70 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING HDPE

Weir Link: L-1210W			
Scenario:	Future	Bottom Clip	
From Node:	B-18	Default:	0.00 ft
To Node:	STORAGE ON SITE 6	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	Discharge Coefficients	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-1250P		Upstream		Downstream	
Scenario:	Future	Invert:	0.01 ft	Invert:	-1.11 ft
From Node:	B-33	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-32	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	692.87 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING PIPE MATERIAL AND SIZE IS 1" AND HDPE

Pipe Link: L-1260P		Upstream		Downstream	
Scenario:	Future	Invert:	2.49 ft	Invert:	2.47 ft
From Node:	B-32	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-35	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1629.83 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Weir Link: L-1270W			
Scenario:	Future	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	STORAGE ON SITE 9	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.99 ft	Discharge Coefficients	
Control Elevation:	6.99 ft	Weir Default:	2.800
Cross Section:	27	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-1290W			
Scenario:	Future	Bottom Clip	
From Node:	B-35	Default:	0.00 ft
To Node:	STORAGE ON SITE 11	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft

Weir Type:	Horizontal
Geometry Type:	Irregular
Invert:	7.93 ft
Control Elevation:	7.93 ft
Cross Section:	26

Op Table:	
Ref Node:	
Discharge Coefficients	
Weir Default:	2.800
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Comment:

Weir Link: L-1300W

Scenario:	Future
From Node:	B-36
To Node:	STORAGE ON SITE 12
Link Count:	1
Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Irregular
Invert:	7.93 ft
Control Elevation:	7.93 ft
Cross Section:	26

Bottom Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	
Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	
Discharge Coefficients	
Weir Default:	2.800
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Comment:

Pipe Link: L-1310P

Scenario:	Future
From Node:	B-35
To Node:	B-36
Link Count:	1
Flow Direction:	Both
Damping:	0.0000 ft
Length:	1532.73 ft
FHWA Code:	0
Entr Loss Coef:	0.50
Exit Loss Coef:	1.00
Bend Loss Coef:	0.00
Bend Location:	0.00 dec
Energy Switch:	Energy

Upstream		Downstream	
Invert:	2.96 ft	Invert:	2.87 ft
Manning's N:	0.0100	Manning's N:	0.0100
Geometry: Circular		Geometry: Circular	
Max Depth:	1.00 ft	Max Depth:	1.00 ft
Bottom Clip			
Default:	0.00 ft	Default:	0.00 ft
Op Table:		Op Table:	
Ref Node:		Ref Node:	
Manning's N:	0.0000	Manning's N:	0.0000
Top Clip			
Default:	0.00 ft	Default:	0.00 ft
Op Table:		Op Table:	
Ref Node:		Ref Node:	
Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1320P		Upstream		Downstream	
Scenario:	Future	Invert:	4.79 ft	Invert:	4.69 ft
From Node:	B-36	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-38	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1068.86 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Weir Link: L-1330W			
Scenario:	Future	Bottom Clip	
From Node:	B-38	Default:	0.00 ft
To Node:	STORAGE ON SITE 13	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.99 ft	Discharge Coefficients	
Control Elevation:	6.99 ft	Weir Default:	2.800
Cross Section:	27	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-1340P		Upstream		Downstream	
Scenario:	Future	Invert:	2.10 ft	Invert:	7.05 ft
From Node:	B-38	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-34	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2528.34 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft

Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1400P		Upstream		Downstream	
Scenario:	Future	Invert:	2.01 ft	Invert:	0.21 ft
From Node:	B-34	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-31	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	936.01 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1410P		Upstream		Downstream	
Scenario:	Future	Invert:	-0.40 ft	Invert:	-1.30 ft
From Node:	B-31	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-30	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	396.60 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1420P		Upstream		Downstream	
Scenario:	Future	Invert:	0.54 ft	Invert:	-0.40 ft
From Node:	B-29	Manning's N:	0.0240	Manning's N:	0.0240

To Node:	B-28	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	283.66 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING 1" CMP

Pipe Link: L-1430P		Upstream		Downstream	
Scenario:	Future	Invert:	-0.40 ft	Invert:	-0.70 ft
From Node:	B-28	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-27	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	261.31 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1440P		Upstream		Downstream	
Scenario:	Future	Invert:	-0.13 ft	Invert:	-1.00 ft
From Node:	B-27	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-30	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	696.58 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	

		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1450P		Upstream		Downstream	
Scenario:	Future	Invert:	0.90 ft	Invert:	-0.84 ft
From Node:	B-30	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-26	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	374.43 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1500P		Upstream		Downstream	
Scenario:	Future	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-40	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	821.13 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1510P		Upstream		Downstream	
Scenario:	Future	Invert:	1.26 ft	Invert:	-0.98 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-26	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft

Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	937.41 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: POTENTIAL DISCHARGE INTO LAKE AREA. WILL NEED FURTHER RESEARCH

Drop Structure Link: L-1580DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	297.21 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	8.78 ft	Op Table:	
Control Elevation:	8.78 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment: assumed invert and control elevation as catch basin data was not available. assumption based on raster

elevations for general area

Drop Structure Comment: drop structure used to model the flow of water into a drainage structure and into the local drainage system. the following stage volume node represents the designed storage for the site from previous reports for permits.

Drop Structure Link: L-1590DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE 2	Geometry: Circular		Geometry: Circular	
		Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	288.51 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	8.78 ft	Ref Node:	
Control Elevation:	8.78 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1600DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	3.28 ft	Invert:	2.90 ft

From Node:	B-2	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	18	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	262.15 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	8.78 ft	Op Table:	
Control Elevation:	8.78 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1610DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	-1.40 ft	Invert:	-3.40 ft
From Node:	B-3	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	3	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			

Length:	767.89 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	5.40 ft
Control Elevation:	5.40 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1620DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	-1.92 ft	Invert:	-2.12 ft
From Node:	B-10	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	4	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	371.12 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	4.08 ft	Ref Node:	
Control Elevation:	4.08 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1630DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-18	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	6	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	254.22 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	7.40 ft	Ref Node:	
Control Elevation:	7.40 ft		

Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1640DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-13	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	5	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	277.27 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.00 ft	Ref Node:	
Control Elevation:	5.00 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1650DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-22	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	8	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	445.58 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	7.40 ft	Ref Node:	
Control Elevation:	7.40 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1660DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	17	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	

Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	889.88 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.48 ft	Op Table:	
Control Elevation:	5.48 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1670DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-40	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	17	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	308.92 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.48 ft	Ref Node:	
Control Elevation:	5.48 ft	**Discharge Coefficients**	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1680DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	-0.40 ft	Invert:	-1.30 ft
From Node:	B-30	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	15	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	239.04 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular		

Invert:	5.10 ft
Control Elevation:	5.10 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Op Table:	
Ref Node:	
Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1690DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	-0.40 ft	Invert:	-1.30 ft
From Node:	B-31	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	15	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	622.33 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.10 ft	Op Table:	
Control Elevation:	5.10 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1700DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	2.01 ft	Invert:	0.21 ft
From Node:	B-34	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	15	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	984.42 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.01 ft	Op Table:	
Control Elevation:	7.01 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1710DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	2.49 ft	Invert:	2.47 ft
From Node:	B-32	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	

	9	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	261.51 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.49 ft	Op Table:	
Control Elevation:	7.49 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1720DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	2.10 ft	Invert:	2.01 ft
From Node:	B-37	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	14	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	441.61 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	

Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	7.10 ft	Ref Node:	
Control Elevation:	7.10 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1730DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-35	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	11	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	449.58 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip
Weir:	1	

Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	7.96 ft
Control Elevation:	7.96 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1740DS

Scenario:	Future
From Node:	B-38
To Node:	STORAGE ON SITE 13
Link Count:	1
Flow Direction:	Both
Solution:	Combine
Increments:	0
Pipe Count:	1
Damping:	0.0000 ft
Length:	385.31 ft
FHWA Code:	0
Entr Loss Coef:	0.50
Exit Loss Coef:	1.00
Bend Loss Coef:	0.00
Bend Location:	0.00 dec
Energy Switch:	Energy

Upstream Pipe

Invert:	2.10 ft
Manning's N:	0.0100

Geometry: Circular

Max Depth:	1.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Downstream Pipe

Invert:	2.01 ft
Manning's N:	0.0100

Geometry: Circular

Max Depth:	1.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	7.10 ft
Control Elevation:	7.10 ft
Max Depth:	999.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Max Width:	10.00 ft		
Fillet:	0.00 ft	Weir Default:	3.200
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1750DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-36	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	12	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	732.41 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.96 ft	Op Table:	
Control Elevation:	7.96 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Rating Curve Link: L-1820RC

Scenario: Future
From Node: B-3
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Both

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP7CFS	2.00	B-3	0.50	

Comment: Has a 7cfs limit to Pembroke Road/golf course based on permitting but has two pumps inside that can pump 11cfs (not allowed to run at the same time due to permit)
- From Stefano's meeting with the town 10/25/2023

Rating Curve Link: L-1830RC

Scenario: Future
From Node: B-3
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP 80CFS	0.80	B-3	0.40	B-3

Comment: Set of 3, one out for repair (still included)
VERIFY

Rating Curve Link: L-1850RC

Scenario: Future
From Node: B-7
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP3CFS	0.50	B-7	0.00	B-7

Comment:

Pipe Link: L-1870P

Scenario: Future
From Node: B-15
To Node: STORAGE ON SITE 20
Link Count: 1

Upstream	Downstream
Invert: -1.11 ft	Invert: -3.22 ft
Manning's N: 0.0240	Manning's N: 0.0240
Geometry: Circular	Geometry: Circular
Max Depth: 2.00 ft	Max Depth: 2.00 ft
Bottom Clip	

Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	127.02 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000
Comment:					

Pipe Link: L-1890P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.20 ft	Invert:	1.20 ft
From Node:	B-16	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	21	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	1278.76 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000
Comment:					

Pipe Link: L-1900P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.20 ft	Invert:	-1.20 ft
From Node:	STORAGE ON SITE	Manning's N:	0.0200	Manning's N:	0.0200
	19	Geometry: Circular		Geometry: Circular	
To Node:	STORAGE ON SITE	Max Depth:	2.00 ft	Max Depth:	2.00 ft
	21	Bottom Clip			
Link Count:	1	Default:	0.00 ft	Default:	0.00 ft
Flow Direction:	Both	Op Table:		Op Table:	
Damping:	0.0000 ft	Ref Node:		Ref Node:	
Length:	1628.18 ft	Manning's N:	0.0000	Manning's N:	0.0000
FHWA Code:	0	Top Clip			
Entr Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Exit Loss Coef:	0.00	Op Table:		Op Table:	
Bend Loss Coef:	0.00	Ref Node:		Ref Node:	
Bend Location:	0.00 dec	Manning's N:	0.0000	Manning's N:	0.0000
Energy Switch:	Energy				
Comment:					

Pipe Link: L-1910P		Upstream		Downstream	
Scenario:	Future	Invert:	-1.20 ft	Invert:	-1.20 ft
From Node:	B-7	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	STORAGE ON SITE 21	Geometry: Circular		Geometry: Circular	
		Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	495.35 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Rating Curve Link: L-1920RC

Scenario: Future
From Node: STORAGE ON SITE 21
To Node: B-3
Link Count: 1
Flow Direction: Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP 4CFS	1.66	STORAGE ON SITE 21	0.51	STORAGE ON SITE 21

Comment: John P Lyons Phase 2

Pipe Link: L-1930P		Upstream		Downstream	
Scenario:	Future	Invert:	0.00 ft	Invert:	0.00 ft
From Node:	STORAGE ON SITE 20	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	B-8	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	680.78 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1940P		Upstream		Downstream	
Scenario:	Future	Invert:	-2.50 ft	Invert:	-2.50 ft
From Node:	B-11	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	B-12	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.00 ft	Max Depth:	4.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1091.90 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1950P		Upstream		Downstream	
Scenario:	Future	Invert:	2.50 ft	Invert:	2.50 ft
From Node:	STORAGE ON SITE 15	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	STORAGE ON 52ND	Max Depth:	3.00 ft	Max Depth:	3.00 ft
		Bottom Clip			
Link Count:	1	Default:	0.00 ft	Default:	0.00 ft
Flow Direction:	Both	Op Table:		Op Table:	
Damping:	0.0000 ft	Ref Node:		Ref Node:	
Length:	150.54 ft	Manning's N:	0.0000	Manning's N:	0.0000
FHWA Code:	0	Top Clip			
Entr Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Exit Loss Coef:	0.00	Op Table:		Op Table:	
Bend Loss Coef:	0.00	Ref Node:		Ref Node:	
Bend Location:	0.00 dec	Manning's N:	0.0000	Manning's N:	0.0000
Energy Switch:	Energy				

Comment:

Drop Structure Link: L-1970DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-3	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - N PARK RD	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	11	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000

Damping:	0.0000 ft	Top Clip			
Length:	840.75 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	4.20 ft	Ref Node:	
Control Elevation:	4.20 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1980DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-7	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - N PARK RD	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	4	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	496.61 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.00 ft	Ref Node:	
Control Elevation:	5.00 ft	**Discharge Coefficients**	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1990DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-8	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - N	Geometry: Circular		Geometry: Circular	
	PARK RD	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	573.18 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	4.80 ft		

Control Elevation:	4.80 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2000DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-4	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - N	Geometry: Circular		Geometry: Circular	
	PARK RD	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	4	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	1244.57 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	5.40 ft
Control Elevation:	5.40 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2010DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	STORAGE ON SITE 20	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	FUTURE EXFIL - N PARK RD	Max Depth:	3.00 ft	Max Depth:	3.00 ft
		Bottom Clip			
Link Count:	4	Default:	0.00 ft	Default:	0.00 ft
Flow Direction:	Both	Op Table:		Op Table:	
Solution:	Combine	Ref Node:		Ref Node:	
Increments:	0	Manning's N:	0.0000	Manning's N:	0.0000
Pipe Count:	1	Top Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1190.28 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00				
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	3.50 ft	Op Table:	
Control Elevation:	3.50 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2020DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-14	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - S	Geometry: Circular		Geometry: Circular	

	PARK RD	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	11	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	305.78 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.70 ft	Ref Node:	
Control Elevation:	5.70 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2030DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	STORAGE ON SITE 20	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	FUTURE EXFIL - S PARK RD	Max Depth:	3.00 ft	Max Depth:	3.00 ft
		Bottom Clip			
Link Count:	10	Default:	0.00 ft	Default:	0.00 ft
Flow Direction:	Both	Op Table:		Op Table:	
Solution:	Combine	Ref Node:		Ref Node:	
Increments:	0	Manning's N:	0.0000	Manning's N:	0.0000
Pipe Count:	1	Top Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	505.40 ft	Op Table:		Op Table:	

FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00				
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	3.80 ft
Control Elevation:	3.80 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2040DS

Scenario:	Future
From Node:	B-27
To Node:	FUTURE EXFIL - INFINITY AZURE
Link Count:	4
Flow Direction:	Both
Solution:	Combine
Increments:	0
Pipe Count:	1
Damping:	0.0000 ft
Length:	235.84 ft
FHWA Code:	0
Entr Loss Coef:	0.00
Exit Loss Coef:	0.00
Bend Loss Coef:	0.00
Bend Location:	0.00 dec
Energy Switch:	Energy

Upstream Pipe

Invert:	1.00 ft
Manning's N:	0.0200

Geometry: Circular

Max Depth:	3.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Downstream Pipe

Invert:	1.00 ft
Manning's N:	0.0200

Geometry: Circular

Max Depth:	3.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	4.80 ft
Control Elevation:	4.80 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Bottom Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2050DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-28	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - INFINITY AZURE	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	5	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	180.25 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component	
Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	4.80 ft
Control Elevation:	4.80 ft

Bottom Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2060DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-29	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - INFINITY AZURE	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	386.59 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	4.80 ft	Ref Node:	
Control Elevation:	4.80 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2070DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-31	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - INFINITY AZURE	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	18	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	323.35 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	4.80 ft	Ref Node:	
Control Elevation:	4.80 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Rating Curve Link: L-2080RC

Scenario: Future
From Node: STORAGE ON SITE 20
To Node: B-3
Link Count: 1
Flow Direction: Both

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP 5.76CFS	2.00	B-15	0.00	B-15

Comment: 25th street
5.76CFS from plans

Drop Structure Link: L-2090DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-35	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL - SW 36TH CT	Geometry: Circular		Geometry: Circular	
		Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	9	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	20.00 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.00 ft	Op Table:	
Control Elevation:	7.00 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2100DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	1.00 ft	Invert:	1.00 ft
From Node:	B-4	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL -	Geometry: Circular		Geometry: Circular	

	SW 31ST AVE	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	25	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	20.00 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.20 ft	Op Table:	
Control Elevation:	5.20 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2110DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	2.00 ft	Invert:	2.00 ft
From Node:	B-38	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL -	Geometry: Circular		Geometry: Circular	
	SW 52ND AVE	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	17	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	30.00 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	

Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	8.20 ft	Ref Node:	
Control Elevation:	8.20 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-2120DS		Upstream Pipe		Downstream Pipe	
Scenario:	Future	Invert:	2.00 ft	Invert:	2.00 ft
From Node:	B-36	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	FUTURE EXFIL -	Geometry: Circular		Geometry: Circular	
	SW 52ND AVE	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	17	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	30.00 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.00	Ref Node:		Ref Node:	
Exit Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip
Weir:	1	

Weir Count:	1		
Weir Flow Direction:	Both	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:	
Weir Type:	Horizontal	Ref Node:	
Geometry Type:	Rectangular	**Top Clip**	
Invert:	8.20 ft	Default:	0.00 ft
Control Elevation:	8.20 ft	Op Table:	
Max Depth:	999.00 ft	Ref Node:	
Max Width:	10.00 ft	**Discharge Coefficients**	
Fillet:	0.00 ft	Weir Default:	3.200
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Weir Link: L-0010W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0020W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-12	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	

Orifice Default:	0.600
Orifice Table:	

Comment:

Weir Link: L-0030W

Scenario:	Proposed
From Node:	B-12
To Node:	B-11
Link Count:	1
Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Broad Crested Vertical
Geometry Type:	Irregular
Invert:	6.76 ft
Control Elevation:	6.76 ft
Cross Section:	4

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	2.800
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Comment:

Weir Link: L-0040W

Scenario:	Proposed
From Node:	B-2
To Node:	B-12
Link Count:	1
Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Broad Crested Vertical
Geometry Type:	Irregular
Invert:	3.44 ft
Control Elevation:	3.44 ft
Cross Section:	3

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	2.800
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Comment:

Weir Link: L-0050W

Scenario:	Proposed
From Node:	B-11
To Node:	B-10
Link Count:	1

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Flow Direction:	Both		
Damping:	0.0000 ft	Top Clip	
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.76 ft	Ref Node:	
Control Elevation:	6.76 ft	Discharge Coefficients	
Cross Section:	4	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0060W

Scenario:	Proposed	Bottom Clip	
From Node:	B-11	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	Discharge Coefficients	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0070W

Scenario:	Proposed	Bottom Clip	
From Node:	B-10	Default:	0.00 ft
To Node:	B-2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.44 ft	Discharge Coefficients	
Control Elevation:	3.44 ft	Weir Default:	2.800
Cross Section:	3	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0080W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-10	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	**Discharge Coefficients**	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0090W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-11	Default:	0.00 ft
To Node:	B-13	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	**Discharge Coefficients**	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0100W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-13	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	**Discharge Coefficients**	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0110W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-14	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0120W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-15	Default:	0.00 ft
To Node:	B-14	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0130W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-15	Default:	0.00 ft
To Node:	B-10	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	-0.29 ft	Ref Node:	
Control Elevation:	-0.29 ft	Discharge Coefficients	
Cross Section:	6	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0140W

Scenario:	Proposed	Bottom Clip	
From Node:	B-14	Default:	0.00 ft
To Node:	B-17	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	Discharge Coefficients	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0150W

Scenario:	Proposed	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-15	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	Discharge Coefficients	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0160W

Scenario:	Proposed	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.04 ft	Discharge Coefficients	
Control Elevation:	4.04 ft	Weir Default:	2.800
Cross Section:	8	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0170W

Scenario:	Proposed	Bottom Clip	
From Node:	B-15	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.04 ft	Discharge Coefficients	
Control Elevation:	4.04 ft	Weir Default:	2.800
Cross Section:	8	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0180W

Scenario:	Proposed	Bottom Clip	
From Node:	B-17	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	8.19 ft	Discharge Coefficients	
Control Elevation:	8.19 ft	Weir Default:	2.800
Cross Section:	15	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0190W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-16	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	**Discharge Coefficients**	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0200W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-9	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.97 ft	**Discharge Coefficients**	
Control Elevation:	4.97 ft	Weir Default:	2.800
Cross Section:	12	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0210W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-8	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	-1.33 ft	Ref Node:	
Control Elevation:	-1.33 ft	Discharge Coefficients	
Cross Section:	11	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0220W

Scenario:	Proposed	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	Discharge Coefficients	
Control Elevation:	-1.33 ft	Weir Default:	2.800
Cross Section:	11	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0230W

Scenario:	Proposed	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-8	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0240W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-15	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.47 ft	Discharge Coefficients	
Control Elevation:	4.47 ft	Weir Default:	2.800
Cross Section:	10	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0250W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-16	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.86 ft	Discharge Coefficients	
Control Elevation:	3.86 ft	Weir Default:	2.800
Cross Section:	9	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0260W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-7	Default:	0.00 ft
To Node:	B-5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	8.19 ft	Discharge Coefficients	
Control Elevation:	8.19 ft	Weir Default:	2.800
Cross Section:	15	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0270W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-5	Default:	0.00 ft
To Node:	B-6	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.27 ft	**Discharge Coefficients**	
Control Elevation:	3.27 ft	Weir Default:	2.800
Cross Section:	16	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0280W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-5	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.17 ft	**Discharge Coefficients**	
Control Elevation:	6.17 ft	Weir Default:	2.800
Cross Section:	24	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0290W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-7	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	3.34 ft	Ref Node:	
Control Elevation:	3.34 ft	Discharge Coefficients	
Cross Section:	14	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0300W

Scenario:	Proposed	Bottom Clip	
From Node:	B-3	Default:	0.00 ft
To Node:	B-4	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0310W

Scenario:	Proposed	Bottom Clip	
From Node:	B-4	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.04 ft	Discharge Coefficients	
Control Elevation:	5.04 ft	Weir Default:	2.800
Cross Section:	13	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0320W

Scenario:	Proposed	Bottom Clip	
From Node:	B-5	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	Discharge Coefficients	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0330W

Scenario:	Proposed	Bottom Clip	
From Node:	B-3	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	Discharge Coefficients	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0340W

Scenario:	Proposed	Bottom Clip	
From Node:	B-2	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	4.40 ft	Discharge Coefficients	
Control Elevation:	4.40 ft	Weir Default:	2.800
Cross Section:	2	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0350W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	B-39	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0360W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-5	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	**Discharge Coefficients**	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0370W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-17	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	7.43 ft	Ref Node:	
Control Elevation:	7.43 ft	Discharge Coefficients	
Cross Section:	7	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0380W

Scenario:	Proposed	Bottom Clip	
From Node:	B-14	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.43 ft	Discharge Coefficients	
Control Elevation:	7.43 ft	Weir Default:	2.800
Cross Section:	7	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0390W

Scenario:	Proposed	Bottom Clip	
From Node:	B-10	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	9.48 ft	Discharge Coefficients	
Control Elevation:	9.48 ft	Weir Default:	2.800
Cross Section:	5	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0400W

Scenario:	Proposed	Bottom Clip	
From Node:	B-13	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	9.48 ft	Discharge Coefficients	
Control Elevation:	9.48 ft	Weir Default:	2.800
Cross Section:	5	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0410W

Scenario:	Proposed	Bottom Clip	
From Node:	B-21	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	Discharge Coefficients	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0420W

Scenario:	Proposed	Bottom Clip	
From Node:	B-21	Default:	0.00 ft
To Node:	B-19	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.04 ft	Discharge Coefficients	
Control Elevation:	7.04 ft	Weir Default:	2.800
Cross Section:	20	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0430W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-6	Default:	0.00 ft
To Node:	B-18	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	3.43 ft	**Discharge Coefficients**	
Control Elevation:	3.43 ft	Weir Default:	2.800
Cross Section:	17	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0440W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-18	Default:	0.00 ft
To Node:	B-19	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	**Discharge Coefficients**	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0450W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-18	Default:	0.00 ft
To Node:	B-20	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.93 ft	Ref Node:	
Control Elevation:	6.93 ft	Discharge Coefficients	
Cross Section:	18	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0460W

Scenario:	Proposed	Bottom Clip	
From Node:	B-21	Default:	0.00 ft
To Node:	B-23	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	Discharge Coefficients	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0470W

Scenario:	Proposed	Bottom Clip	
From Node:	B-23	Default:	0.00 ft
To Node:	B-33	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	Discharge Coefficients	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0480W

Scenario:	Proposed	Bottom Clip	
From Node:	B-23	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.96 ft	Discharge Coefficients	
Control Elevation:	6.96 ft	Weir Default:	2.800
Cross Section:	21	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0490W

Scenario:	Proposed	Bottom Clip	
From Node:	B-33	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	Discharge Coefficients	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0500W

Scenario:	Proposed	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-33	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.07 ft	Discharge Coefficients	
Control Elevation:	6.07 ft	Weir Default:	2.800
Cross Section:	23	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0510W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.62 ft	**Discharge Coefficients**	
Control Elevation:	6.62 ft	Weir Default:	2.800
Cross Section:	22	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0520W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-35	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.17 ft	**Discharge Coefficients**	
Control Elevation:	7.17 ft	Weir Default:	2.800
Cross Section:	25	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0530W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-32	Default:	0.00 ft
To Node:	B-34	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.17 ft	Ref Node:	
Control Elevation:	6.17 ft	Discharge Coefficients	
Cross Section:	24	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0540W

Scenario:	Proposed	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.70 ft	Discharge Coefficients	
Control Elevation:	7.70 ft	Weir Default:	2.800
Cross Section:	29	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0550W

Scenario:	Proposed	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-30	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0560W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-32	Default:	0.00 ft
To Node:	B-26	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.15 ft	Discharge Coefficients	
Control Elevation:	5.15 ft	Weir Default:	2.800
Cross Section:	33	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0570W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-35	Default:	0.00 ft
To Node:	B-36	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	Discharge Coefficients	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0580W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-35	Default:	0.00 ft
To Node:	B-34	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.17 ft	Discharge Coefficients	
Control Elevation:	7.17 ft	Weir Default:	2.800
Cross Section:	25	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0590W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-34	Default:	0.00 ft
To Node:	B-36	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	**Discharge Coefficients**	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0610W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-36	Default:	0.00 ft
To Node:	B-37	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.64 ft	**Discharge Coefficients**	
Control Elevation:	6.64 ft	Weir Default:	2.800
Cross Section:	28	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0620W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-36	Default:	0.00 ft
To Node:	B-38	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.99 ft	Ref Node:	
Control Elevation:	6.99 ft	Discharge Coefficients	
Cross Section:	27	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0640W

Scenario:	Proposed	Bottom Clip	
From Node:	B-38	Default:	0.00 ft
To Node:	B-37	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.64 ft	Discharge Coefficients	
Control Elevation:	6.64 ft	Weir Default:	2.800
Cross Section:	28	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0650W

Scenario:	Proposed	Bottom Clip	
From Node:	B-29	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0660W

Scenario:	Proposed	Bottom Clip	
From Node:	B-28	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0670W

Scenario:	Proposed	Bottom Clip	
From Node:	B-27	Default:	0.00 ft
To Node:	B-31	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0680W

Scenario:	Proposed	Bottom Clip	
From Node:	B-27	Default:	0.00 ft
To Node:	B-30	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.39 ft	Discharge Coefficients	
Control Elevation:	6.39 ft	Weir Default:	2.800
Cross Section:	30	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0690W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-30	Default:	0.00 ft
To Node:	B-26	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.15 ft	**Discharge Coefficients**	
Control Elevation:	5.15 ft	Weir Default:	2.800
Cross Section:	33	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0700W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-26	Default:	0.00 ft
To Node:	B-27	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.55 ft	**Discharge Coefficients**	
Control Elevation:	5.55 ft	Weir Default:	2.800
Cross Section:	34	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0710W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-27	Default:	0.00 ft
To Node:	B-28	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	4.59 ft	Ref Node:	
Control Elevation:	4.59 ft	Discharge Coefficients	
Cross Section:	32	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0720W

Scenario:	Proposed	Bottom Clip	
From Node:	B-28	Default:	0.00 ft
To Node:	B-29	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.64 ft	Discharge Coefficients	
Control Elevation:	5.64 ft	Weir Default:	2.800
Cross Section:	31	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0730W

Scenario:	Proposed	Bottom Clip	
From Node:	B-26	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.43 ft	Discharge Coefficients	
Control Elevation:	5.43 ft	Weir Default:	2.800
Cross Section:	35	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0740W

Scenario:	Proposed	Bottom Clip	
From Node:	B-24	Default:	0.00 ft
To Node:	B-40	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.67 ft	Discharge Coefficients	
Control Elevation:	5.67 ft	Weir Default:	2.800
Cross Section:	38	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0750W

Scenario:	Proposed	Bottom Clip	
From Node:	B-40	Default:	0.00 ft
To Node:	B-25	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	5.92 ft	Discharge Coefficients	
Control Elevation:	5.92 ft	Weir Default:	2.800
Cross Section:	37	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0760W

Scenario:	Proposed	Bottom Clip	
From Node:	B-24	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	Discharge Coefficients	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600

	Orifice Table:

Comment:

Weir Link: L-0770W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-40	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	**Discharge Coefficients**	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0780W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-25	Default:	0.00 ft
To Node:	B-22	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Broad Crested Vertical	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.14 ft	**Discharge Coefficients**	
Control Elevation:	6.14 ft	Weir Default:	2.800
Cross Section:	36	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0790W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-20	Default:	0.00 ft
To Node:	B-21	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	

Damping:	0.0000 ft		
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	-0.34 ft	Ref Node:	
Control Elevation:	-0.34 ft	**Discharge Coefficients**	
Cross Section:	19	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-0820W

Scenario:	Proposed	**Bottom Clip**	
From Node:	B-1	Default:	0.00 ft
To Node:	STORAGE ON SITE 2	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	**Top Clip**	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-0.29 ft	**Discharge Coefficients**	
Control Elevation:	-0.29 ft	Weir Default:	2.800
Cross Section:	1	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-0830P

		Upstream		Downstream	
Scenario:	Proposed	Invert:	-0.72 ft	Invert:	-8.91 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-12	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.50 ft	Max Depth:	4.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1462.61 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: Outfall leading from Basin 1 to Basin 12. Unknown pipe material so assuming CMP. Other drainage infrastructure modeled with stage storage nodes as it is held mostly on site (sourced from drainage reports)

Pipe Link: L-0840P		Upstream		Downstream	
Scenario:	Proposed	Invert:	8.18 ft	Invert:	8.44 ft
From Node:	B-1	Manning's N:	0.0120	Manning's N:	0.0120
To Node:	B-39	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.50 ft	Max Depth:	4.50 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2870.39 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: connection between basin 1 and pembroke rd (basin 39) (1 of 2 outfalls)

Pipe Link: L-0850P		Upstream		Downstream	
Scenario:	Proposed	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-39	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2648.59 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: connection between basin 1 and pembroke rd (basin 39) (2 of 2 outfalls) assuming bituminous coated pipe like other latteral on property

Weir Link: L-0860W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-3	Default:	0.00 ft
To Node:	STORAGE ON SITE 3	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	-1.33 ft	Discharge Coefficients	

Control Elevation: -1.33 ft
Cross Section: 11

Weir Default: 2.800
Weir Table:
Orifice Default: 0.600
Orifice Table:

Comment:

Pipe Link: L-0880P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.40 ft	Invert:	-3.40 ft
From Node:	B-7	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-3	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1537.48 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf
Unknown material assuming HDPE due to being connected to a pump station

Future: upsized from 24" pipe to 36" pipe

Rating Curve Link: L-0890RC

Scenario: Proposed
From Node: B-3
To Node: B-11
Link Count: 1
Flow Direction: Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP3CFS	1.50	B-3	0.50	B-3

Comment: 3 CFS PUMP FOUND K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf PAGE 107

Pipe Link: L-0910P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.11 ft	Invert:	-3.22 ft

From Node:	B-9	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	20	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	715.54 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0930P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.92 ft	Invert:	-2.12 ft
From Node:	B-10	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-9	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	872.92 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0940P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.90 ft	Invert:	-2.22 ft
From Node:	B-15	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-17	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	910.18 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			

Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: CONNECTED BASED ON OLD SWMP FOUND HERE K:\FTL_Civil\143 Jobs\143586100 Pembroke Pk Stormwater MP Update\Data Collection\Permits\2014 New proposed lake and drainage system\0102167.pdf.pdf

Pipe Link: L-0990P		Upstream		Downstream	
Scenario:	Proposed	Invert:	0.43 ft	Invert:	0.12 ft
From Node:	B-17	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-18	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.25 ft	Max Depth:	1.25 ft
Flow Direction:	None	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2490.01 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1020P		Upstream		Downstream	
Scenario:	Proposed	Invert:	2.60 ft	Invert:	1.60 ft
From Node:	B-39	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-6	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	7099.35 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: pembroke park road feeding into DOT system assuming same material as previous pipes in system (Bitumous Coated Pipe)

Pipe Link: L-1060P		Upstream		Downstream	
Scenario:	Proposed	Invert:	7.40 ft	Invert:	6.40 ft
From Node:	B-4	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-5	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	1.90 ft	Max Depth:	0.90 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2152.81 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: LOCAL SYSTEM FEEDS INTO BASIN 5 AND THEN SITS IN A RETENTION AREA BEFORE GOING INTO THE DOT SYSTEM PAST A CONTROL STRUCTURE

Pipe Link: L-1080P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.33 ft	Invert:	-1.33 ft
From Node:	B-9	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	B-3	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Flow Direction:	Positive	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	300.00 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1120P		Upstream		Downstream	
Scenario:	Proposed	Invert:	8.18 ft	Invert:	2.90 ft
From Node:	B-10	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-11	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	7.42 ft	Max Depth:	7.42 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1956.83 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000

Exit Loss Coef:	0.00			Top Clip	
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: TWO OUTLETS LEADING INTO LAKE COMBINED INTO ONE PIPE (BOTH PVC ONE 77" THE SECOND 12")

Weir Link: L-1130W

Scenario:	Proposed	Bottom Clip	
From Node:	B-13	Default:	0.00 ft
To Node:	STORAGE ON SITE 5	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.76 ft	Discharge Coefficients	
Control Elevation:	6.76 ft	Weir Default:	2.800
Cross Section:	4	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-1140P		Upstream		Downstream	
Scenario:	Proposed	Invert:	1.25 ft	Invert:	-1.70 ft
From Node:	STORAGE ON SITE 20	Manning's N:	0.0100	Manning's N:	0.0100
		Geometry: Circular		Geometry: Circular	
To Node:	B-14	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	798.60 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.50	Top Clip			
Exit Loss Coef:	1.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1150P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-0.17 ft	Invert:	-4.15 ft

From Node:	B-17	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	19	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	1576.14 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.50	Top Clip			
Exit Loss Coef:	1.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment: PIPE CONNECTING BASINS B-17 B-16 B-6 AND B-3 MOVING FROM SW 31ST AVE CAROLINA ST AND S PARK ROAD INTO LARGE LAKE WITH PUMP STATION

Pipe Link: L-1200P		Upstream		Downstream	
Scenario:	Proposed	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-6	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-18	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1953.70 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING HDPE

Weir Link: L-1210W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-18	Default:	0.00 ft
To Node:	STORAGE ON SITE 6	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.93 ft	Discharge Coefficients	
Control Elevation:	6.93 ft	Weir Default:	2.800
Cross Section:	18	Weir Table:	

Orifice Default:	0.600
Orifice Table:	

Comment:

Pipe Link: L-1250P		Upstream		Downstream	
Scenario:	Proposed	Invert:	0.01 ft	Invert:	-1.11 ft
From Node:	B-33	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-32	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	692.87 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING PIPE MATERIAL AND SIZE IS 1" AND HDPE

Pipe Link: L-1260P		Upstream		Downstream	
Scenario:	Proposed	Invert:	2.49 ft	Invert:	2.47 ft
From Node:	B-32	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-35	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1629.83 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Weir Link: L-1270W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-32	Default:	0.00 ft

To Node:	STORAGE ON SITE 9		
Link Count:	1	Op Table:	
Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Broad Crested Vertical	Default:	0.00 ft
Geometry Type:	Irregular	Op Table:	
Invert:	6.99 ft	Ref Node:	
Control Elevation:	6.99 ft	Discharge Coefficients	
Cross Section:	27	Weir Default:	2.800
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-1290W

Scenario:	Proposed	Bottom Clip	
From Node:	B-35	Default:	0.00 ft
To Node:	STORAGE ON SITE 11	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	Discharge Coefficients	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Weir Link: L-1300W

Scenario:	Proposed	Bottom Clip	
From Node:	B-36	Default:	0.00 ft
To Node:	STORAGE ON SITE 12	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	7.93 ft	Discharge Coefficients	
Control Elevation:	7.93 ft	Weir Default:	2.800
Cross Section:	26	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Comment:

Pipe Link: L-1310P		Upstream		Downstream	
Scenario:	Proposed	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-35	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-36	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1532.73 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1320P		Upstream		Downstream	
Scenario:	Proposed	Invert:	4.79 ft	Invert:	4.69 ft
From Node:	B-36	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-38	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1068.86 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Weir Link: L-1330W			
Scenario:	Proposed	Bottom Clip	
From Node:	B-38	Default:	0.00 ft
To Node:	STORAGE ON SITE 13	Op Table:	
Link Count:	1	Ref Node:	
Flow Direction:	Both	Top Clip	
Damping:	0.0000 ft	Default:	0.00 ft
Weir Type:	Horizontal	Op Table:	
Geometry Type:	Irregular	Ref Node:	
Invert:	6.99 ft	Discharge Coefficients	
Control Elevation:	6.99 ft	Weir Default:	2.800

Cross Section: 27

Weir Table:
Orifice Default: 0.600
Orifice Table:

Comment:

Pipe Link: L-1340P		Upstream		Downstream	
Scenario:	Proposed	Invert:	2.10 ft	Invert:	7.05 ft
From Node:	B-38	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-34	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	2528.34 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1400P		Upstream		Downstream	
Scenario:	Proposed	Invert:	2.01 ft	Invert:	0.21 ft
From Node:	B-34	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-31	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	936.01 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1410P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-0.40 ft	Invert:	-1.30 ft

From Node:	B-31	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-30	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	396.60 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1420P		Upstream		Downstream	
Scenario:	Proposed	Invert:	0.54 ft	Invert:	-0.40 ft
From Node:	B-29	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-28	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	283.66 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: ASSUMING 1" CMP

Pipe Link: L-1430P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-0.40 ft	Invert:	-0.70 ft
From Node:	B-28	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-27	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	261.31 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	

Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1440P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-0.13 ft	Invert:	-1.00 ft
From Node:	B-27	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-30	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	696.58 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1450P		Upstream		Downstream	
Scenario:	Proposed	Invert:	0.90 ft	Invert:	-0.84 ft
From Node:	B-30	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	B-26	Geometry:	Circular	Geometry:	Circular
Link Count:	1	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	374.43 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.50	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1500P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-40	Geometry:	Circular	Geometry:	Circular

Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	821.13 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1510P		Upstream		Downstream	
Scenario:	Proposed	Invert:	1.26 ft	Invert:	-0.98 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	B-26	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	937.41 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.90	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	1.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000

Comment: POTENTIAL DISCHARGE INTO LAKE AREA. WILL NEED FURTHER RESEARCH

Drop Structure Link: L-1580DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	1	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	297.21 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000

Bend Loss Coef:	0.00
Bend Location:	0.00 dec
Energy Switch:	Energy

Pipe Comment:

Weir Component	
Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	8.78 ft
Control Elevation:	8.78 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Bottom Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip	
Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment: assumed invert and control elevation as catch basin data was not available. assumption based on raster elevations for general area

Drop Structure Comment: drop structure used to model the flow of water into a drainage structure and into the local drainage system. the following stage volume node represents the designed storage for the site from previous reports for permits.

Drop Structure Link: L-1590DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	3.28 ft	Invert:	2.90 ft
From Node:	B-1	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	2	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	288.51 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component	
Weir:	1

Bottom Clip

Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	8.78 ft
Control Elevation:	8.78 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1600DS

Scenario:	Proposed
From Node:	B-2
To Node:	STORAGE ON SITE 18
Link Count:	1
Flow Direction:	Both
Solution:	Combine
Increments:	0
Pipe Count:	1
Damping:	0.0000 ft
Length:	262.15 ft
FHWA Code:	0
Entr Loss Coef:	0.90
Exit Loss Coef:	1.00
Bend Loss Coef:	0.00
Bend Location:	0.00 dec
Energy Switch:	Energy

Upstream Pipe

Invert:	3.28 ft
Manning's N:	0.0240

Geometry: Circular

Max Depth:	1.50 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Downstream Pipe

Invert:	2.90 ft
Manning's N:	0.0240

Geometry: Circular

Max Depth:	1.50 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	8.78 ft
Control Elevation:	8.78 ft
Max Depth:	999.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Max Width:	10.00 ft		
Fillet:	0.00 ft	Weir Default:	3.200
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1610DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	-1.40 ft	Invert:	-3.40 ft
From Node:	B-3	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	3	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	767.89 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.40 ft	Op Table:	
Control Elevation:	5.40 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1620DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	-1.92 ft	Invert:	-2.12 ft
From Node:	B-10	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	4	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	371.12 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	4.08 ft	Ref Node:	
Control Elevation:	4.08 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1630DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-18	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	6	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	

Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	254.22 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.40 ft	Op Table:	
Control Elevation:	7.40 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1640DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-13	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	5	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	277.27 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.00 ft	Ref Node:	
Control Elevation:	5.00 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1650DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	1.90 ft	Invert:	-1.75 ft
From Node:	B-22	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	8	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	445.58 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular		

Invert:	7.40 ft
Control Elevation:	7.40 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Op Table:	
Ref Node:	
Discharge Coefficients	
Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1660DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-25	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	17	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	889.88 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.48 ft	Op Table:	
Control Elevation:	5.48 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1670DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	-0.02 ft	Invert:	-0.22 ft
From Node:	B-40	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	17	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	308.92 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.48 ft	Op Table:	
Control Elevation:	5.48 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1680DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	-0.40 ft	Invert:	-1.30 ft
From Node:	B-30	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	

	15	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	239.04 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	5.10 ft	Op Table:	
Control Elevation:	5.10 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1690DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	-0.40 ft	Invert:	-1.30 ft
From Node:	B-31	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	15	Max Depth:	1.50 ft	Max Depth:	1.50 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	622.33 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	

Entr Loss Coef:	0.90	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	5.10 ft	Ref Node:	
Control Elevation:	5.10 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1700DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	2.01 ft	Invert:	0.21 ft
From Node:	B-34	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE 15	Geometry: Circular		Geometry: Circular	
		Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	984.42 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip
Weir:	1	

Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	7.01 ft
Control Elevation:	7.01 ft
Max Depth:	999.00 ft
Max Width:	10.00 ft
Fillet:	0.00 ft

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Weir Default:	3.200
Weir Table:	
Orifice Default:	0.600
Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1710DS

Scenario:	Proposed
From Node:	B-32
To Node:	STORAGE ON SITE
	9
Link Count:	1
Flow Direction:	Both
Solution:	Combine
Increments:	0
Pipe Count:	1
Damping:	0.0000 ft
Length:	261.51 ft
FHWA Code:	0
Entr Loss Coef:	0.50
Exit Loss Coef:	1.00
Bend Loss Coef:	0.00
Bend Location:	0.00 dec
Energy Switch:	Energy

Upstream Pipe

Invert:	2.49 ft
Manning's N:	0.0100

Geometry: Circular

Max Depth:	1.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Downstream Pipe

Invert:	2.47 ft
Manning's N:	0.0100

Geometry: Circular

Max Depth:	1.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	
Manning's N:	0.0000

Pipe Comment:

Weir Component

Weir:	1
Weir Count:	1
Weir Flow Direction:	Both
Damping:	0.0000 ft
Weir Type:	Horizontal
Geometry Type:	Rectangular
Invert:	7.49 ft
Control Elevation:	7.49 ft
Max Depth:	999.00 ft

Bottom Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Top Clip

Default:	0.00 ft
Op Table:	
Ref Node:	

Discharge Coefficients

Max Width:	10.00 ft		
Fillet:	0.00 ft	Weir Default:	3.200
		Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1720DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	2.10 ft	Invert:	2.01 ft
From Node:	B-37	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	14	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	441.61 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.10 ft	Op Table:	
Control Elevation:	7.10 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1730DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-35	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	11	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	449.58 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	Top Clip	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	7.96 ft	Ref Node:	
Control Elevation:	7.96 ft	Discharge Coefficients	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1740DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	2.10 ft	Invert:	2.01 ft
From Node:	B-38	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	13	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	

Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	385.31 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component			
Weir:	1	Bottom Clip	
Weir Count:	1	Default:	0.00 ft
Weir Flow Direction:	Both	Op Table:	
Damping:	0.0000 ft	Ref Node:	
Weir Type:	Horizontal	Top Clip	
Geometry Type:	Rectangular	Default:	0.00 ft
Invert:	7.10 ft	Op Table:	
Control Elevation:	7.10 ft	Ref Node:	
Max Depth:	999.00 ft	Discharge Coefficients	
Max Width:	10.00 ft	Weir Default:	3.200
Fillet:	0.00 ft	Weir Table:	
		Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Drop Structure Link: L-1750DS		Upstream Pipe		Downstream Pipe	
Scenario:	Proposed	Invert:	2.96 ft	Invert:	2.87 ft
From Node:	B-36	Manning's N:	0.0100	Manning's N:	0.0100
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	12	Max Depth:	1.00 ft	Max Depth:	1.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Solution:	Combine	Op Table:		Op Table:	
Increments:	0	Ref Node:		Ref Node:	
Pipe Count:	1	Manning's N:	0.0000	Manning's N:	0.0000
Damping:	0.0000 ft	Top Clip			
Length:	732.41 ft	Default:	0.00 ft	Default:	0.00 ft
FHWA Code:	0	Op Table:		Op Table:	
Entr Loss Coef:	0.50	Ref Node:		Ref Node:	
Exit Loss Coef:	1.00	Manning's N:	0.0000	Manning's N:	0.0000
Bend Loss Coef:	0.00				
Bend Location:	0.00 dec				
Energy Switch:	Energy				

Pipe Comment:

Weir Component		Bottom Clip	
Weir:	1	Default:	0.00 ft
Weir Count:	1	Op Table:	
Weir Flow Direction:	Both	Ref Node:	
Damping:	0.0000 ft	**Top Clip**	
Weir Type:	Horizontal	Default:	0.00 ft
Geometry Type:	Rectangular	Op Table:	
Invert:	7.96 ft	Ref Node:	
Control Elevation:	7.96 ft	**Discharge Coefficients**	
Max Depth:	999.00 ft	Weir Default:	3.200
Max Width:	10.00 ft	Weir Table:	
Fillet:	0.00 ft	Orifice Default:	0.600
		Orifice Table:	

Weir Comment:

Drop Structure Comment:

Rating Curve Link: L-1820RC

Scenario: Proposed
From Node: B-3
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Both

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP7CFS	2.00	B-3	0.50	

Comment: Has a 7cfs limit to Pembroke Road/golf course based on permitting but has two pumps inside that can pump 11cfs (not allowed to run at the same time due to permit)
- From Stefano's meeting with the town 10/25/2023

Rating Curve Link: L-1830RC

Scenario: Proposed
From Node: B-3
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP 80CFS	1.00	B-3	0.50	B-3

Comment: Set of 3, one out for repair (still included)
VERIFY

Rating Curve Link: L-1850RC

Scenario: Proposed
From Node: B-7
To Node: DISCHARGE TO GOLF COURSE
Link Count: 1
Flow Direction: Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP3CFS	1.00	B-7	0.50	B-7

Comment:

Pipe Link: L-1870P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.11 ft	Invert:	-3.22 ft
From Node:	B-15	Manning's N:	0.0240	Manning's N:	0.0240
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	20	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	127.02 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1890P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.20 ft	Invert:	1.20 ft
From Node:	B-16	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	STORAGE ON SITE	Geometry: Circular		Geometry: Circular	
	21	Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	1278.76 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Pipe Link: L-1900P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.20 ft	Invert:	-1.20 ft
From Node:	STORAGE ON SITE 19	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	STORAGE ON SITE 21	Max Depth:	2.00 ft	Max Depth:	2.00 ft
		Bottom Clip			
Link Count:	1	Default:	0.00 ft	Default:	0.00 ft
Flow Direction:	Both	Op Table:		Op Table:	
Damping:	0.0000 ft	Ref Node:		Ref Node:	
Length:	1628.18 ft	Manning's N:	0.0000	Manning's N:	0.0000
FHWA Code:	0	Top Clip			
Entr Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Exit Loss Coef:	0.00	Op Table:		Op Table:	
Bend Loss Coef:	0.00	Ref Node:		Ref Node:	
Bend Location:	0.00 dec	Manning's N:	0.0000	Manning's N:	0.0000
Energy Switch:	Energy				

Comment:

Pipe Link: L-1910P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-1.20 ft	Invert:	-1.20 ft
From Node:	B-7	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	STORAGE ON SITE 21	Geometry: Circular		Geometry: Circular	
		Max Depth:	2.00 ft	Max Depth:	2.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	495.35 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000

Comment:

Rating Curve Link: L-1920RC

Scenario: Proposed
From Node: STORAGE ON SITE 21
To Node: B-3
Link Count: 1
Flow Direction: Positive

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP 4CFS	1.66	STORAGE ON SITE 21	0.51	STORAGE ON SITE 21

Comment: John P Lyons Phase 2

Pipe Link: L-1930P		Upstream		Downstream	
Scenario:	Proposed	Invert:	0.00 ft	Invert:	0.00 ft
From Node:	STORAGE ON SITE 20	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	B-8	Max Depth:	3.00 ft	Max Depth:	3.00 ft
Link Count:	1	Bottom Clip			
Flow Direction:	Both	Default:	0.00 ft	Default:	0.00 ft
Damping:	0.0000 ft	Op Table:		Op Table:	
Length:	680.78 ft	Ref Node:		Ref Node:	
FHWA Code:	0	Manning's N:	0.0000	Manning's N:	0.0000
Entr Loss Coef:	0.00	Top Clip			
Exit Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Loss Coef:	0.00	Op Table:		Op Table:	
Bend Location:	0.00 dec	Ref Node:		Ref Node:	
Energy Switch:	Energy	Manning's N:	0.0000	Manning's N:	0.0000
Comment:					

Pipe Link: L-1940P		Upstream		Downstream	
Scenario:	Proposed	Invert:	-2.50 ft	Invert:	-2.50 ft
From Node:	B-11	Manning's N:	0.0200	Manning's N:	0.0200
To Node:	B-12	Geometry: Circular		Geometry: Circular	
Link Count:	1	Max Depth:	4.00 ft	Max Depth:	4.00 ft
Flow Direction:	Both	Bottom Clip			
Damping:	0.0000 ft	Default:	0.00 ft	Default:	0.00 ft
Length:	1091.90 ft	Op Table:		Op Table:	
FHWA Code:	0	Ref Node:		Ref Node:	
Entr Loss Coef:	0.00	Manning's N:	0.0000	Manning's N:	0.0000
Exit Loss Coef:	0.00	Top Clip			
Bend Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Bend Location:	0.00 dec	Op Table:		Op Table:	
Energy Switch:	Energy	Ref Node:		Ref Node:	
		Manning's N:	0.0000	Manning's N:	0.0000
Comment:					

Pipe Link: L-1950P		Upstream		Downstream	
Scenario:	Proposed	Invert:	2.50 ft	Invert:	2.50 ft
From Node:	STORAGE ON SITE 15	Manning's N:	0.0200	Manning's N:	0.0200
		Geometry: Circular		Geometry: Circular	
To Node:	STORAGE ON 52ND	Max Depth:	3.00 ft	Max Depth:	3.00 ft
		Bottom Clip			
Link Count:	1	Default:	0.00 ft	Default:	0.00 ft
Flow Direction:	Both	Op Table:		Op Table:	
Damping:	0.0000 ft	Ref Node:		Ref Node:	
Length:	167.62 ft	Manning's N:	0.0000	Manning's N:	0.0000
FHWA Code:	0	Top Clip			

Entr Loss Coef:	0.00	Default:	0.00 ft	Default:	0.00 ft
Exit Loss Coef:	0.00	Op Table:		Op Table:	
Bend Loss Coef:	0.00	Ref Node:		Ref Node:	
Bend Location:	0.00 dec	Manning's N:	0.0000	Manning's N:	0.0000
Energy Switch:	Energy				

Comment:

Rating Curve Link: L-1960RC

Scenario: Proposed
From Node: B-15
To Node: B-3
Link Count: 1
Flow Direction: Both

Table	Elev On [ft]	Elev On Node	Elev Off [ft]	Elev Off Node
PUMP 5.76CFS	2.00	B-15	0.00	B-15

Comment: 25th street
5.76CFS from plans

Simulation: 10 yr 24 hr

Scenario: Existing
Run Date/Time: 4/15/2024 4:20:54 PM
Program Version: ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	36.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:
Conductivity Set:
Leakage Set:

Tolerances & Options

Time Marching: SAOR
Max Iterations: 6
Over-Relax Weight Fact: 0.5 dec
dZ Tolerance: 0.0001 ft
Max dZ: 100.0000 ft
Link Optimizer Tol: 0.0000 ft
Edge Length Option: Automatic
Dflt Damping (2D): 0.0100 ft
Min Node Srf Area (2D): 100 ft2
Energy Switch (2D): Energy

IA Recovery Time: 24.0000 hr
ET for Manual Basins: False
Smp/Man Basin Rain Opt: Global
OF Region Rain Opt: Global
Rainfall Name: ~SFWMD-72
Rainfall Amount: 8.85 in
Storm Duration: 24.0000 hr
Dflt Damping (1D): 0.0100 ft
Min Node Srf Area (1D): 100 ft2
Energy Switch (1D): Energy

Comment:

Simulation: 100 yr 72 hr

Scenario: Existing
Run Date/Time: 4/15/2024 4:22:27 PM
Program Version: ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	96.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:

Conductivity Set:	
Leakage Set:	

Tolerances & Options

Time Marching:	SAOR	IA Recovery Time:	24.0000 hr
Max Iterations:	6	ET for Manual Basins:	False
Over-Relax Weight Fact:	0.5 dec		
dZ Tolerance:	0.0001 ft	Smp/Man Basin Rain Opt:	Global
Max dZ:	100.0000 ft	OF Region Rain Opt:	Global
Link Optimizer Tol:	0.0000 ft	Rainfall Name:	~SFWMD-72
		Rainfall Amount:	18.00 in
Edge Length Option:	Automatic	Storm Duration:	72.0000 hr
Dflt Damping (2D):	0.0100 ft	Dflt Damping (1D):	0.0100 ft
Min Node Srf Area (2D):	100 ft2	Min Node Srf Area (1D):	100 ft2
Energy Switch (2D):	Energy	Energy Switch (1D):	Energy

Comment:

Simulation: 25 yr 72 hr

Scenario:	Existing
Run Date/Time:	4/15/2024 4:26:30 PM
Program Version:	ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	96.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:
Conductivity Set:
Leakage Set:

Tolerances & Options

Time Marching: SAOR
Max Iterations: 6
Over-Relax Weight Fact: 0.5 dec
dZ Tolerance: 0.0001 ft
Max dZ: 100.0000 ft
Link Optimizer Tol: 0.0000 ft
Edge Length Option: Automatic
Dflt Damping (2D): 0.0100 ft
Min Node Srf Area (2D): 100 ft2
Energy Switch (2D): Energy

IA Recovery Time: 24.0000 hr
ET for Manual Basins: False
Smp/Man Basin Rain Opt: Global
OF Region Rain Opt: Global
Rainfall Name: ~SFWMD-72
Rainfall Amount: 13.30 in
Storm Duration: 72.0000 hr
Dflt Damping (1D): 0.0100 ft
Min Node Srf Area (1D): 100 ft2
Energy Switch (1D): Energy

Comment:

Simulation: 10 yr 24 hr

Scenario: Future
Run Date/Time: 5/14/2024 12:00:22 PM
Program Version: ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	36.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:

Conductivity Set:	
Leakage Set:	

Tolerances & Options

Time Marching:	SAOR	IA Recovery Time:	24.0000 hr
Max Iterations:	6	ET for Manual Basins:	False
Over-Relax Weight Fact:	0.5 dec		
dZ Tolerance:	0.0001 ft	Smp/Man Basin Rain Opt:	Global
Max dZ:	100.0000 ft	OF Region Rain Opt:	Global
Link Optimizer Tol:	0.0000 ft	Rainfall Name:	~SFWMD-72
		Rainfall Amount:	8.85 in
Edge Length Option:	Automatic	Storm Duration:	24.0000 hr
Dflt Damping (2D):	0.0100 ft	Dflt Damping (1D):	0.0100 ft
Min Node Srf Area (2D):	100 ft2	Min Node Srf Area (1D):	100 ft2
Energy Switch (2D):	Energy	Energy Switch (1D):	Energy

Comment:

Simulation: 100 yr 72 hr

Scenario:	Future
Run Date/Time:	5/14/2024 12:03:38 PM
Program Version:	ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	96.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:
Conductivity Set:
Leakage Set:

Tolerances & Options

Time Marching: SAOR
Max Iterations: 6
Over-Relax Weight Fact: 0.5 dec
dZ Tolerance: 0.0001 ft
Max dZ: 100.0000 ft
Link Optimizer Tol: 0.0000 ft
Edge Length Option: Automatic
Dflt Damping (2D): 0.0100 ft
Min Node Srf Area (2D): 100 ft2
Energy Switch (2D): Energy

IA Recovery Time: 24.0000 hr
ET for Manual Basins: False
Smp/Man Basin Rain Opt: Global
OF Region Rain Opt: Global
Rainfall Name: ~SFWMD-72
Rainfall Amount: 18.00 in
Storm Duration: 72.0000 hr
Dflt Damping (1D): 0.0100 ft
Min Node Srf Area (1D): 100 ft2
Energy Switch (1D): Energy

Comment:

Simulation: 25 yr 72 hr

Scenario: Future
Run Date/Time: 5/14/2024 12:10:11 PM
Program Version: ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	96.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:

Conductivity Set:	
Leakage Set:	

Tolerances & Options

Time Marching:	SAOR	IA Recovery Time:	24.0000 hr
Max Iterations:	6	ET for Manual Basins:	False
Over-Relax Weight Fact:	0.5 dec		
dZ Tolerance:	0.0001 ft	Smp/Man Basin Rain Opt:	Global
Max dZ:	100.0000 ft	OF Region Rain Opt:	Global
Link Optimizer Tol:	0.0000 ft	Rainfall Name:	~SFWMD-72
		Rainfall Amount:	13.30 in
Edge Length Option:	Automatic	Storm Duration:	72.0000 hr
Dflt Damping (2D):	0.0100 ft	Dflt Damping (1D):	0.0100 ft
Min Node Srf Area (2D):	100 ft2	Min Node Srf Area (1D):	100 ft2
Energy Switch (2D):	Energy	Energy Switch (1D):	Energy

Comment:

Simulation: 10 yr 24 hr

Scenario:	Proposed
Run Date/Time:	4/15/2024 4:47:02 PM
Program Version:	ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	36.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:
Conductivity Set:
Leakage Set:

Tolerances & Options

Time Marching: SAOR
Max Iterations: 6
Over-Relax Weight Fact: 0.5 dec
dZ Tolerance: 0.0001 ft
Max dZ: 100.0000 ft
Link Optimizer Tol: 0.0000 ft
Edge Length Option: Automatic
Dflt Damping (2D): 0.0100 ft
Min Node Srf Area (2D): 100 ft2
Energy Switch (2D): Energy

IA Recovery Time: 24.0000 hr
ET for Manual Basins: False
Smp/Man Basin Rain Opt: Global
OF Region Rain Opt: Global
Rainfall Name: ~SFWMD-72
Rainfall Amount: 8.85 in
Storm Duration: 24.0000 hr
Dflt Damping (1D): 0.0100 ft
Min Node Srf Area (1D): 100 ft2
Energy Switch (1D): Energy

Comment:

Simulation: 100 yr 72 hr

Scenario: Proposed
Run Date/Time: 4/15/2024 4:50:02 PM
Program Version: ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	96.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:

Conductivity Set:	
Leakage Set:	

Tolerances & Options

Time Marching:	SAOR	IA Recovery Time:	24.0000 hr
Max Iterations:	6	ET for Manual Basins:	False
Over-Relax Weight Fact:	0.5 dec		
dZ Tolerance:	0.0001 ft	Smp/Man Basin Rain Opt:	Global
Max dZ:	100.0000 ft	OF Region Rain Opt:	Global
Link Optimizer Tol:	0.0000 ft	Rainfall Name:	~SFWMD-72
		Rainfall Amount:	18.00 in
Edge Length Option:	Automatic	Storm Duration:	72.0000 hr
Dflt Damping (2D):	0.0100 ft	Dflt Damping (1D):	0.0100 ft
Min Node Srf Area (2D):	100 ft2	Min Node Srf Area (1D):	100 ft2
Energy Switch (2D):	Energy	Energy Switch (1D):	Energy

Comment:

Simulation: 25 yr 72 hr

Scenario:	Proposed
Run Date/Time:	4/15/2024 4:57:00 PM
Program Version:	ICPR4 4.07.04

General

Run Mode: Normal

	Year	Month	Day	Hour [hr]
Start Time:	0	0	0	0.0000
End Time:	0	0	0	96.0000

	Hydrology [sec]	Surface Hydraulics [sec]	Groundwater [sec]
Min Calculation Time:	60.0000	0.0500	900.0000
Max Calculation Time:		10.0000	

Output Time Increments

Hydrology

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Surface Hydraulics

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	15.0000

Groundwater

Year	Month	Day	Hour [hr]	Time Increment [min]
0	0	0	0.0000	60.0000

Restart File

Save Restart: False

Resources & Lookup Tables

Resources

Rainfall Folder:
Reference ET Folder:
Unit Hydrograph Folder:

Lookup Tables

Boundary Stage Set:
Extern Hydrograph Set:
Curve Number Set: Site
Green-Ampt Set:
Vertical Layers Set:
Impervious Set: site
Roughness Set:
Crop Coef Set:
Fillable Porosity Set:
Conductivity Set:
Leakage Set:

Tolerances & Options

Time Marching: SAOR
Max Iterations: 6
Over-Relax Weight Fact: 0.5 dec
dZ Tolerance: 0.0001 ft
Max dZ: 100.0000 ft
Link Optimizer Tol: 0.0000 ft
Edge Length Option: Automatic
Dflt Damping (2D): 0.0100 ft
Min Node Srf Area (2D): 100 ft2
Energy Switch (2D): Energy

IA Recovery Time: 24.0000 hr
ET for Manual Basins: False
Smp/Man Basin Rain Opt: Global
OF Region Rain Opt: Global
Rainfall Name: ~SFWMD-72
Rainfall Amount: 13.30 in
Storm Duration: 72.0000 hr
Dflt Damping (1D): 0.0100 ft
Min Node Srf Area (1D): 100 ft2
Energy Switch (1D): Energy

Comment:

Scenario	Sim	Node Name	Maximum Stage [ft]
Existing	10 yr 24 hr	B-1	4.69
Existing	10 yr 24 hr	B-10	4.87
Existing	10 yr 24 hr	B-11	4.69
Existing	10 yr 24 hr	B-12	4.69
Existing	10 yr 24 hr	B-13	6.87
Existing	10 yr 24 hr	B-14	4.71
Existing	10 yr 24 hr	B-15	4.76
Existing	10 yr 24 hr	B-16	4.59
Existing	10 yr 24 hr	B-17	4.70
Existing	10 yr 24 hr	B-18	4.60
Existing	10 yr 24 hr	B-19	5.53
Existing	10 yr 24 hr	B-2	4.69
Existing	10 yr 24 hr	B-20	4.35
Existing	10 yr 24 hr	B-21	4.35
Existing	10 yr 24 hr	B-22	6.71
Existing	10 yr 24 hr	B-23	6.85
Existing	10 yr 24 hr	B-24	6.71
Existing	10 yr 24 hr	B-25	6.70
Existing	10 yr 24 hr	B-26	6.71
Existing	10 yr 24 hr	B-27	6.71
Existing	10 yr 24 hr	B-28	6.71
Existing	10 yr 24 hr	B-29	6.70
Existing	10 yr 24 hr	B-3	5.23
Existing	10 yr 24 hr	B-30	6.71
Existing	10 yr 24 hr	B-31	6.70
Existing	10 yr 24 hr	B-32	6.71
Existing	10 yr 24 hr	B-33	6.71
Existing	10 yr 24 hr	B-34	6.71
Existing	10 yr 24 hr	B-35	7.49
Existing	10 yr 24 hr	B-36	8.01
Existing	10 yr 24 hr	B-37	8.01
Existing	10 yr 24 hr	B-38	8.01
Existing	10 yr 24 hr	B-39	4.69
Existing	10 yr 24 hr	B-4	5.28
Existing	10 yr 24 hr	B-40	6.70
Existing	10 yr 24 hr	B-5	4.60
Existing	10 yr 24 hr	B-6	4.60
Existing	10 yr 24 hr	B-7	4.59
Existing	10 yr 24 hr	B-8	5.22
Existing	10 yr 24 hr	B-9	4.59
Future	10 yr 24 hr	B-1	4.65
Future	10 yr 24 hr	B-10	4.45

Scenario	Sim	Node Name	Maximum Stage [ft]
Future	10 yr 24 hr	B-11	4.65
Future	10 yr 24 hr	B-12	4.65
Future	10 yr 24 hr	B-13	6.87
Future	10 yr 24 hr	B-14	4.49
Future	10 yr 24 hr	B-15	4.46
Future	10 yr 24 hr	B-16	4.46
Future	10 yr 24 hr	B-17	4.46
Future	10 yr 24 hr	B-18	4.47
Future	10 yr 24 hr	B-19	5.53
Future	10 yr 24 hr	B-2	4.64
Future	10 yr 24 hr	B-20	4.35
Future	10 yr 24 hr	B-21	4.35
Future	10 yr 24 hr	B-22	6.64
Future	10 yr 24 hr	B-23	6.85
Future	10 yr 24 hr	B-24	6.64
Future	10 yr 24 hr	B-25	6.64
Future	10 yr 24 hr	B-26	6.64
Future	10 yr 24 hr	B-27	6.64
Future	10 yr 24 hr	B-28	6.64
Future	10 yr 24 hr	B-29	6.64
Future	10 yr 24 hr	B-3	4.45
Future	10 yr 24 hr	B-30	6.64
Future	10 yr 24 hr	B-31	6.64
Future	10 yr 24 hr	B-32	6.65
Future	10 yr 24 hr	B-33	6.65
Future	10 yr 24 hr	B-34	6.65
Future	10 yr 24 hr	B-35	7.48
Future	10 yr 24 hr	B-36	8.01
Future	10 yr 24 hr	B-37	8.01
Future	10 yr 24 hr	B-38	8.01
Future	10 yr 24 hr	B-39	4.65
Future	10 yr 24 hr	B-4	5.21
Future	10 yr 24 hr	B-40	6.64
Future	10 yr 24 hr	B-5	4.46
Future	10 yr 24 hr	B-6	4.46
Future	10 yr 24 hr	B-7	4.45
Future	10 yr 24 hr	B-8	4.45
Future	10 yr 24 hr	B-9	4.45
Proposed	10 yr 24 hr	B-1	4.65
Proposed	10 yr 24 hr	B-10	4.49
Proposed	10 yr 24 hr	B-11	4.65
Proposed	10 yr 24 hr	B-12	4.65

Scenario	Sim	Node Name	Maximum Stage [ft]
Proposed	10 yr 24 hr	B-13	6.87
Proposed	10 yr 24 hr	B-14	4.54
Proposed	10 yr 24 hr	B-15	4.49
Proposed	10 yr 24 hr	B-16	4.50
Proposed	10 yr 24 hr	B-17	4.49
Proposed	10 yr 24 hr	B-18	4.51
Proposed	10 yr 24 hr	B-19	5.53
Proposed	10 yr 24 hr	B-2	4.65
Proposed	10 yr 24 hr	B-20	4.35
Proposed	10 yr 24 hr	B-21	4.35
Proposed	10 yr 24 hr	B-22	6.71
Proposed	10 yr 24 hr	B-23	6.85
Proposed	10 yr 24 hr	B-24	6.71
Proposed	10 yr 24 hr	B-25	6.70
Proposed	10 yr 24 hr	B-26	6.71
Proposed	10 yr 24 hr	B-27	6.71
Proposed	10 yr 24 hr	B-28	6.71
Proposed	10 yr 24 hr	B-29	6.70
Proposed	10 yr 24 hr	B-3	4.49
Proposed	10 yr 24 hr	B-30	6.71
Proposed	10 yr 24 hr	B-31	6.70
Proposed	10 yr 24 hr	B-32	6.71
Proposed	10 yr 24 hr	B-33	6.71
Proposed	10 yr 24 hr	B-34	6.71
Proposed	10 yr 24 hr	B-35	7.49
Proposed	10 yr 24 hr	B-36	8.01
Proposed	10 yr 24 hr	B-37	8.01
Proposed	10 yr 24 hr	B-38	8.01
Proposed	10 yr 24 hr	B-39	4.65
Proposed	10 yr 24 hr	B-4	5.28
Proposed	10 yr 24 hr	B-40	6.70
Proposed	10 yr 24 hr	B-5	4.50
Proposed	10 yr 24 hr	B-6	4.50
Proposed	10 yr 24 hr	B-7	4.49
Proposed	10 yr 24 hr	B-8	4.49
Proposed	10 yr 24 hr	B-9	4.49
Existing	100 yr 72 hr	B-1	5.52
Existing	100 yr 72 hr	B-10	5.52
Existing	100 yr 72 hr	B-11	5.52
Existing	100 yr 72 hr	B-12	5.52
Existing	100 yr 72 hr	B-13	6.92
Existing	100 yr 72 hr	B-14	6.13

Scenario	Sim	Node Name	Maximum Stage [ft]
Existing	100 yr 72 hr	B-15	5.52
Existing	100 yr 72 hr	B-16	5.52
Existing	100 yr 72 hr	B-17	5.52
Existing	100 yr 72 hr	B-18	5.53
Existing	100 yr 72 hr	B-19	6.72
Existing	100 yr 72 hr	B-2	5.52
Existing	100 yr 72 hr	B-20	6.91
Existing	100 yr 72 hr	B-21	6.91
Existing	100 yr 72 hr	B-22	7.37
Existing	100 yr 72 hr	B-23	7.36
Existing	100 yr 72 hr	B-24	7.37
Existing	100 yr 72 hr	B-25	7.37
Existing	100 yr 72 hr	B-26	7.38
Existing	100 yr 72 hr	B-27	7.38
Existing	100 yr 72 hr	B-28	7.38
Existing	100 yr 72 hr	B-29	7.39
Existing	100 yr 72 hr	B-3	5.52
Existing	100 yr 72 hr	B-30	7.38
Existing	100 yr 72 hr	B-31	7.38
Existing	100 yr 72 hr	B-32	7.38
Existing	100 yr 72 hr	B-33	7.37
Existing	100 yr 72 hr	B-34	7.39
Existing	100 yr 72 hr	B-35	7.78
Existing	100 yr 72 hr	B-36	8.17
Existing	100 yr 72 hr	B-37	8.17
Existing	100 yr 72 hr	B-38	8.18
Existing	100 yr 72 hr	B-39	5.52
Existing	100 yr 72 hr	B-4	5.52
Existing	100 yr 72 hr	B-40	7.37
Existing	100 yr 72 hr	B-5	5.52
Existing	100 yr 72 hr	B-6	5.53
Existing	100 yr 72 hr	B-7	5.52
Existing	100 yr 72 hr	B-8	5.52
Existing	100 yr 72 hr	B-9	5.52
Future	100 yr 72 hr	B-1	5.53
Future	100 yr 72 hr	B-10	5.53
Future	100 yr 72 hr	B-11	5.53
Future	100 yr 72 hr	B-12	5.53
Future	100 yr 72 hr	B-13	6.92
Future	100 yr 72 hr	B-14	5.71
Future	100 yr 72 hr	B-15	5.53
Future	100 yr 72 hr	B-16	5.53

Scenario	Sim	Node Name	Maximum Stage [ft]
Future	100 yr 72 hr	B-17	5.53
Future	100 yr 72 hr	B-18	5.54
Future	100 yr 72 hr	B-19	6.72
Future	100 yr 72 hr	B-2	5.53
Future	100 yr 72 hr	B-20	6.88
Future	100 yr 72 hr	B-21	6.88
Future	100 yr 72 hr	B-22	7.36
Future	100 yr 72 hr	B-23	7.35
Future	100 yr 72 hr	B-24	7.36
Future	100 yr 72 hr	B-25	7.36
Future	100 yr 72 hr	B-26	7.36
Future	100 yr 72 hr	B-27	7.37
Future	100 yr 72 hr	B-28	7.37
Future	100 yr 72 hr	B-29	7.37
Future	100 yr 72 hr	B-3	5.52
Future	100 yr 72 hr	B-30	7.37
Future	100 yr 72 hr	B-31	7.37
Future	100 yr 72 hr	B-32	7.37
Future	100 yr 72 hr	B-33	7.36
Future	100 yr 72 hr	B-34	7.37
Future	100 yr 72 hr	B-35	7.78
Future	100 yr 72 hr	B-36	8.17
Future	100 yr 72 hr	B-37	8.17
Future	100 yr 72 hr	B-38	8.18
Future	100 yr 72 hr	B-39	5.53
Future	100 yr 72 hr	B-4	5.53
Future	100 yr 72 hr	B-40	7.36
Future	100 yr 72 hr	B-5	5.53
Future	100 yr 72 hr	B-6	5.53
Future	100 yr 72 hr	B-7	5.53
Future	100 yr 72 hr	B-8	5.52
Future	100 yr 72 hr	B-9	5.52
Proposed	100 yr 72 hr	B-1	5.54
Proposed	100 yr 72 hr	B-10	5.54
Proposed	100 yr 72 hr	B-11	5.54
Proposed	100 yr 72 hr	B-12	5.54
Proposed	100 yr 72 hr	B-13	6.92
Proposed	100 yr 72 hr	B-14	6.05
Proposed	100 yr 72 hr	B-15	5.54
Proposed	100 yr 72 hr	B-16	5.54
Proposed	100 yr 72 hr	B-17	5.54
Proposed	100 yr 72 hr	B-18	5.55

Scenario	Sim	Node Name	Maximum Stage [ft]
Proposed	100 yr 72 hr	B-19	6.72
Proposed	100 yr 72 hr	B-2	5.54
Proposed	100 yr 72 hr	B-20	6.91
Proposed	100 yr 72 hr	B-21	6.91
Proposed	100 yr 72 hr	B-22	7.37
Proposed	100 yr 72 hr	B-23	7.36
Proposed	100 yr 72 hr	B-24	7.37
Proposed	100 yr 72 hr	B-25	7.37
Proposed	100 yr 72 hr	B-26	7.38
Proposed	100 yr 72 hr	B-27	7.38
Proposed	100 yr 72 hr	B-28	7.38
Proposed	100 yr 72 hr	B-29	7.39
Proposed	100 yr 72 hr	B-3	5.54
Proposed	100 yr 72 hr	B-30	7.38
Proposed	100 yr 72 hr	B-31	7.38
Proposed	100 yr 72 hr	B-32	7.38
Proposed	100 yr 72 hr	B-33	7.37
Proposed	100 yr 72 hr	B-34	7.39
Proposed	100 yr 72 hr	B-35	7.78
Proposed	100 yr 72 hr	B-36	8.17
Proposed	100 yr 72 hr	B-37	8.17
Proposed	100 yr 72 hr	B-38	8.18
Proposed	100 yr 72 hr	B-39	5.54
Proposed	100 yr 72 hr	B-4	5.54
Proposed	100 yr 72 hr	B-40	7.37
Proposed	100 yr 72 hr	B-5	5.54
Proposed	100 yr 72 hr	B-6	5.55
Proposed	100 yr 72 hr	B-7	5.54
Proposed	100 yr 72 hr	B-8	5.54
Proposed	100 yr 72 hr	B-9	5.54
Existing	25 yr 72 hr	B-1	4.81
Existing	25 yr 72 hr	B-10	4.87
Existing	25 yr 72 hr	B-11	4.81
Existing	25 yr 72 hr	B-12	4.81
Existing	25 yr 72 hr	B-13	6.90
Existing	25 yr 72 hr	B-14	5.18
Existing	25 yr 72 hr	B-15	4.76
Existing	25 yr 72 hr	B-16	4.74
Existing	25 yr 72 hr	B-17	4.74
Existing	25 yr 72 hr	B-18	4.75
Existing	25 yr 72 hr	B-19	6.14
Existing	25 yr 72 hr	B-2	4.81

Scenario	Sim	Node Name	Maximum Stage [ft]
Existing	25 yr 72 hr	B-20	5.70
Existing	25 yr 72 hr	B-21	5.70
Existing	25 yr 72 hr	B-22	7.14
Existing	25 yr 72 hr	B-23	7.14
Existing	25 yr 72 hr	B-24	7.15
Existing	25 yr 72 hr	B-25	7.14
Existing	25 yr 72 hr	B-26	7.15
Existing	25 yr 72 hr	B-27	7.15
Existing	25 yr 72 hr	B-28	7.15
Existing	25 yr 72 hr	B-29	7.15
Existing	25 yr 72 hr	B-3	5.23
Existing	25 yr 72 hr	B-30	7.15
Existing	25 yr 72 hr	B-31	7.15
Existing	25 yr 72 hr	B-32	7.15
Existing	25 yr 72 hr	B-33	7.15
Existing	25 yr 72 hr	B-34	7.15
Existing	25 yr 72 hr	B-35	7.65
Existing	25 yr 72 hr	B-36	8.11
Existing	25 yr 72 hr	B-37	8.12
Existing	25 yr 72 hr	B-38	8.12
Existing	25 yr 72 hr	B-39	4.81
Existing	25 yr 72 hr	B-4	5.31
Existing	25 yr 72 hr	B-40	7.14
Existing	25 yr 72 hr	B-5	4.75
Existing	25 yr 72 hr	B-6	4.75
Existing	25 yr 72 hr	B-7	4.74
Existing	25 yr 72 hr	B-8	5.22
Existing	25 yr 72 hr	B-9	4.74
Future	25 yr 72 hr	B-1	4.91
Future	25 yr 72 hr	B-10	4.91
Future	25 yr 72 hr	B-11	4.91
Future	25 yr 72 hr	B-12	4.91
Future	25 yr 72 hr	B-13	6.90
Future	25 yr 72 hr	B-14	5.13
Future	25 yr 72 hr	B-15	4.91
Future	25 yr 72 hr	B-16	4.91
Future	25 yr 72 hr	B-17	4.91
Future	25 yr 72 hr	B-18	4.92
Future	25 yr 72 hr	B-19	6.14
Future	25 yr 72 hr	B-2	4.91
Future	25 yr 72 hr	B-20	5.65
Future	25 yr 72 hr	B-21	5.65

Scenario	Sim	Node Name	Maximum Stage [ft]
Future	25 yr 72 hr	B-22	7.13
Future	25 yr 72 hr	B-23	7.13
Future	25 yr 72 hr	B-24	7.13
Future	25 yr 72 hr	B-25	7.13
Future	25 yr 72 hr	B-26	7.13
Future	25 yr 72 hr	B-27	7.14
Future	25 yr 72 hr	B-28	7.14
Future	25 yr 72 hr	B-29	7.14
Future	25 yr 72 hr	B-3	4.90
Future	25 yr 72 hr	B-30	7.13
Future	25 yr 72 hr	B-31	7.14
Future	25 yr 72 hr	B-32	7.14
Future	25 yr 72 hr	B-33	7.13
Future	25 yr 72 hr	B-34	7.14
Future	25 yr 72 hr	B-35	7.65
Future	25 yr 72 hr	B-36	8.11
Future	25 yr 72 hr	B-37	8.12
Future	25 yr 72 hr	B-38	8.12
Future	25 yr 72 hr	B-39	4.91
Future	25 yr 72 hr	B-4	5.21
Future	25 yr 72 hr	B-40	7.13
Future	25 yr 72 hr	B-5	4.91
Future	25 yr 72 hr	B-6	4.92
Future	25 yr 72 hr	B-7	4.91
Future	25 yr 72 hr	B-8	4.90
Future	25 yr 72 hr	B-9	4.90
Proposed	25 yr 72 hr	B-1	4.94
Proposed	25 yr 72 hr	B-10	4.94
Proposed	25 yr 72 hr	B-11	4.95
Proposed	25 yr 72 hr	B-12	4.95
Proposed	25 yr 72 hr	B-13	6.90
Proposed	25 yr 72 hr	B-14	5.09
Proposed	25 yr 72 hr	B-15	4.94
Proposed	25 yr 72 hr	B-16	4.94
Proposed	25 yr 72 hr	B-17	4.94
Proposed	25 yr 72 hr	B-18	4.95
Proposed	25 yr 72 hr	B-19	6.14
Proposed	25 yr 72 hr	B-2	4.94
Proposed	25 yr 72 hr	B-20	5.70
Proposed	25 yr 72 hr	B-21	5.70
Proposed	25 yr 72 hr	B-22	7.14
Proposed	25 yr 72 hr	B-23	7.14


Scenario	Sim	Node Name	Maximum Stage [ft]
Proposed	25 yr 72 hr	B-24	7.15
Proposed	25 yr 72 hr	B-25	7.14
Proposed	25 yr 72 hr	B-26	7.15
Proposed	25 yr 72 hr	B-27	7.15
Proposed	25 yr 72 hr	B-28	7.15
Proposed	25 yr 72 hr	B-29	7.15
Proposed	25 yr 72 hr	B-3	4.93
Proposed	25 yr 72 hr	B-30	7.15
Proposed	25 yr 72 hr	B-31	7.15
Proposed	25 yr 72 hr	B-32	7.15
Proposed	25 yr 72 hr	B-33	7.15
Proposed	25 yr 72 hr	B-34	7.15
Proposed	25 yr 72 hr	B-35	7.65
Proposed	25 yr 72 hr	B-36	8.11
Proposed	25 yr 72 hr	B-37	8.12
Proposed	25 yr 72 hr	B-38	8.12
Proposed	25 yr 72 hr	B-39	4.94
Proposed	25 yr 72 hr	B-4	5.31
Proposed	25 yr 72 hr	B-40	7.14
Proposed	25 yr 72 hr	B-5	4.94
Proposed	25 yr 72 hr	B-6	4.95
Proposed	25 yr 72 hr	B-7	4.94
Proposed	25 yr 72 hr	B-8	4.94
Proposed	25 yr 72 hr	B-9	4.94

Agenda Item Report

Subject:	Vulnerability Assessment - Kimley-Horn and Associates, Inc.
Meeting Date:	Agenda for Special Commission Meeting - February 1, 2025
Prepared For:	Town Commission
Staff Contact:	Stanley Merantus, Public Services Director
Dept/Group:	Public Works
Recommendation for Counsel to consider:	
Background Information:	Presentation of the Vulnerability Assessment
Staff Recommendations:	
Financial Implications:	There is no financial impact.
Alternatives:	

ATTACHMENTS:

Pembroke Park VA - Workshop Commission Meeting
Pembroke Park_Final Vulnerability Assessment 112024 Update

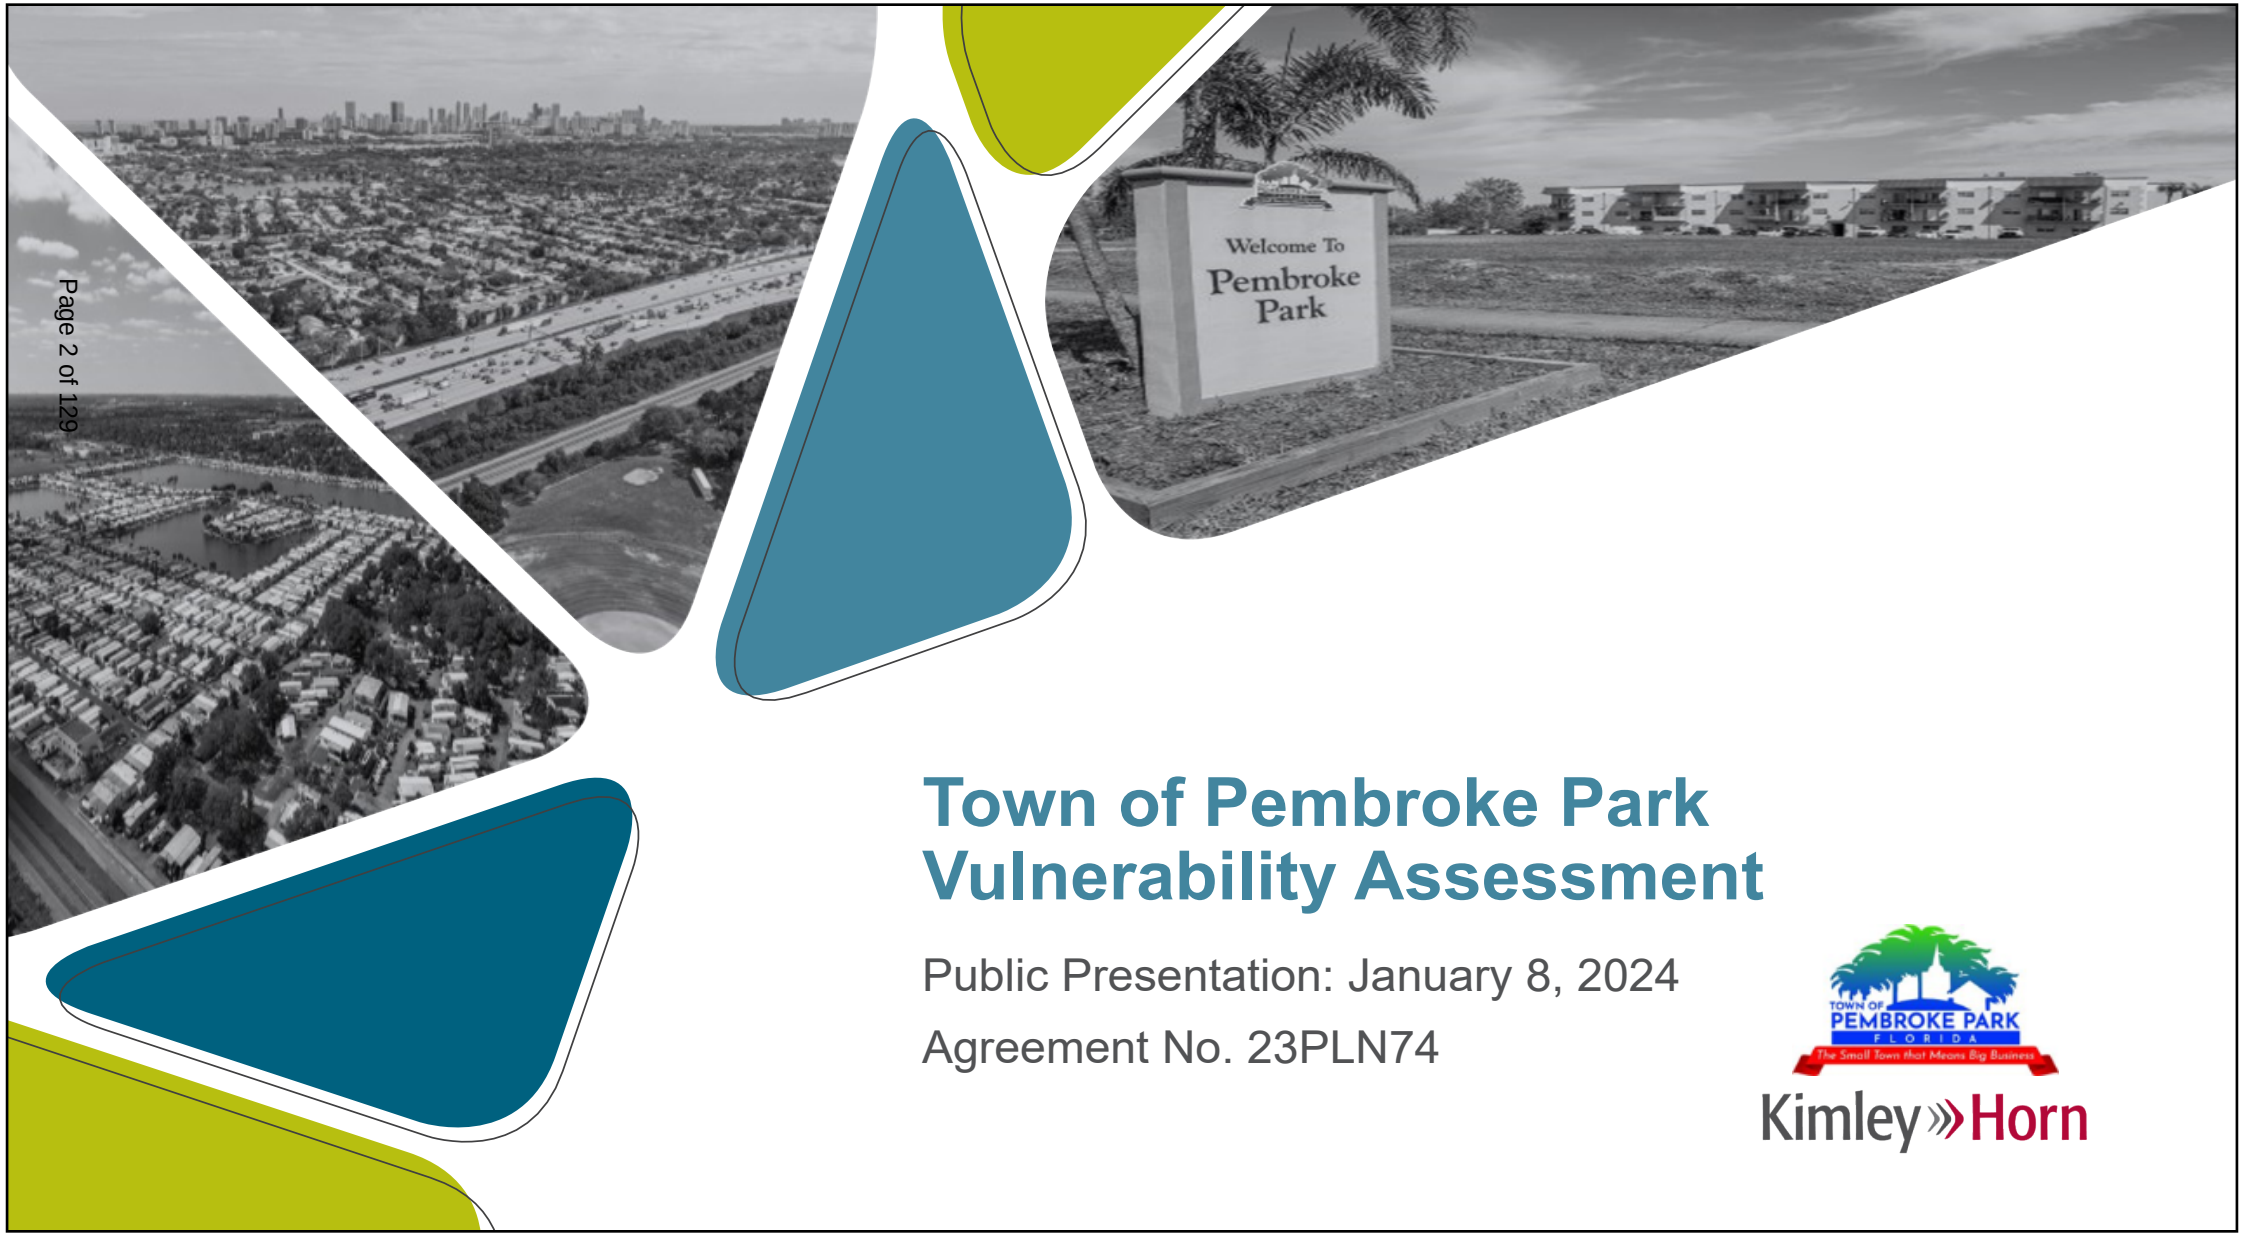

Town of Pembroke Park Vulnerability Assessment

Public Presentation: January 8, 2024

Agreement No. 23PLN74

TOWN OF PEMBROKE PARK FLORIDA
The Small Town that Means Big Business

Kimley»Horn

Introduction

This project has been collaboratively funded by the Town of Pembroke Park and the Florida Department of Environmental Protection's Resilient Florida Grant Program.

Project Objective

- Conduct a Vulnerability Assessment which identifies flooding risks due to rainfall, storm surge, and sea-level rise in the Town of Pembroke Park.
- Analyze available data to:

Identify Flood Depth for Various Scenarios

Evaluate Flood Severity


Assign Risk Levels per Scenario

Identify Focus Areas

Summary of Project

1. Data Collection, Review, and Data Gap Analysis
2. Exposure Analysis
3. Sensitivity Analysis
4. Identify Focus Areas
5. Final Vulnerability Assessment Report

Data Collection & Data Gap Analysis

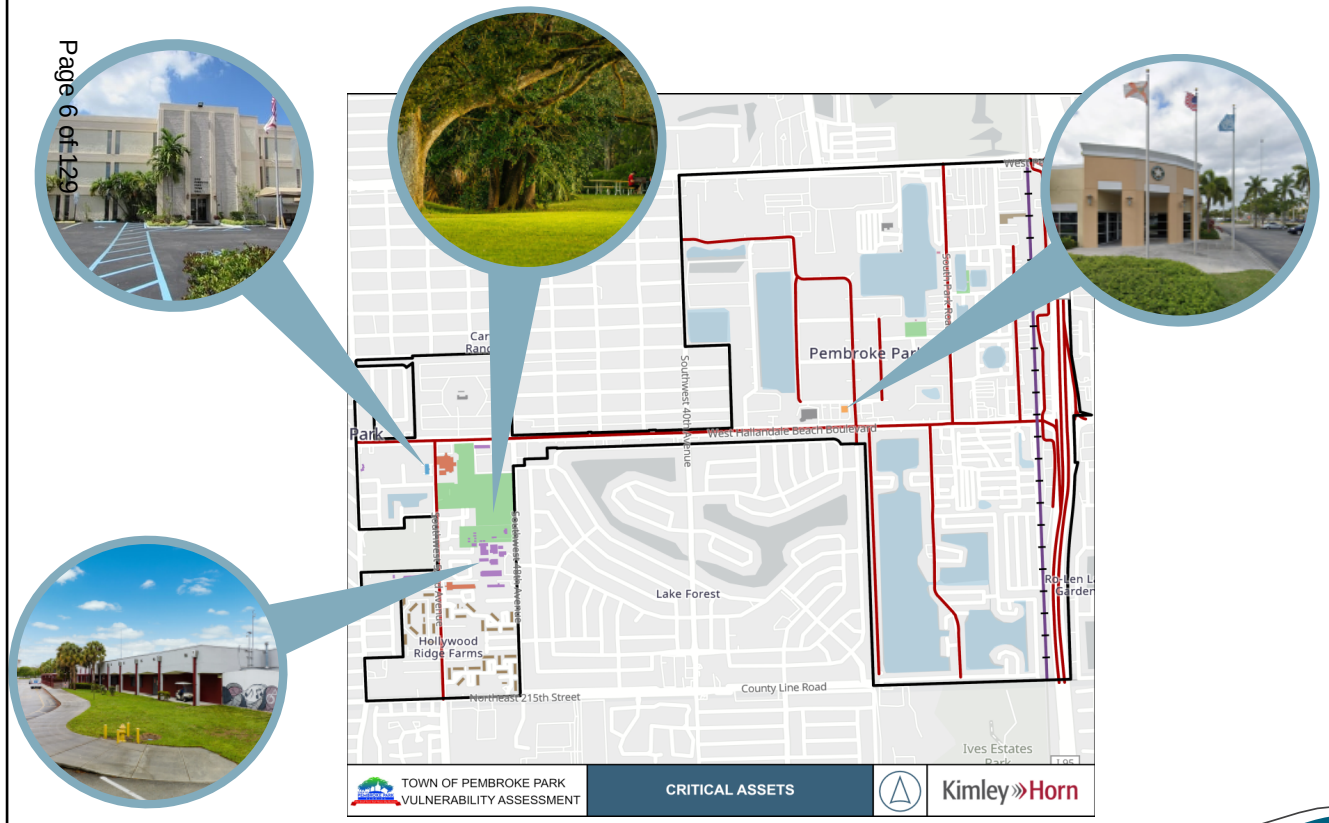

Asset Inventory

- Transportation and Evacuation Routes
- Critical Infrastructure
- Critical Community and Emergency Facilities
- Natural, Cultural, and Historical Assets


Topographic Data

Flood Scenario Data


- Rainfall
- Sea Level Rise
- Storm Surge

Exposure Analysis

- Tidal Flooding
- Storm Surge
- Rainfall-Induced Flooding

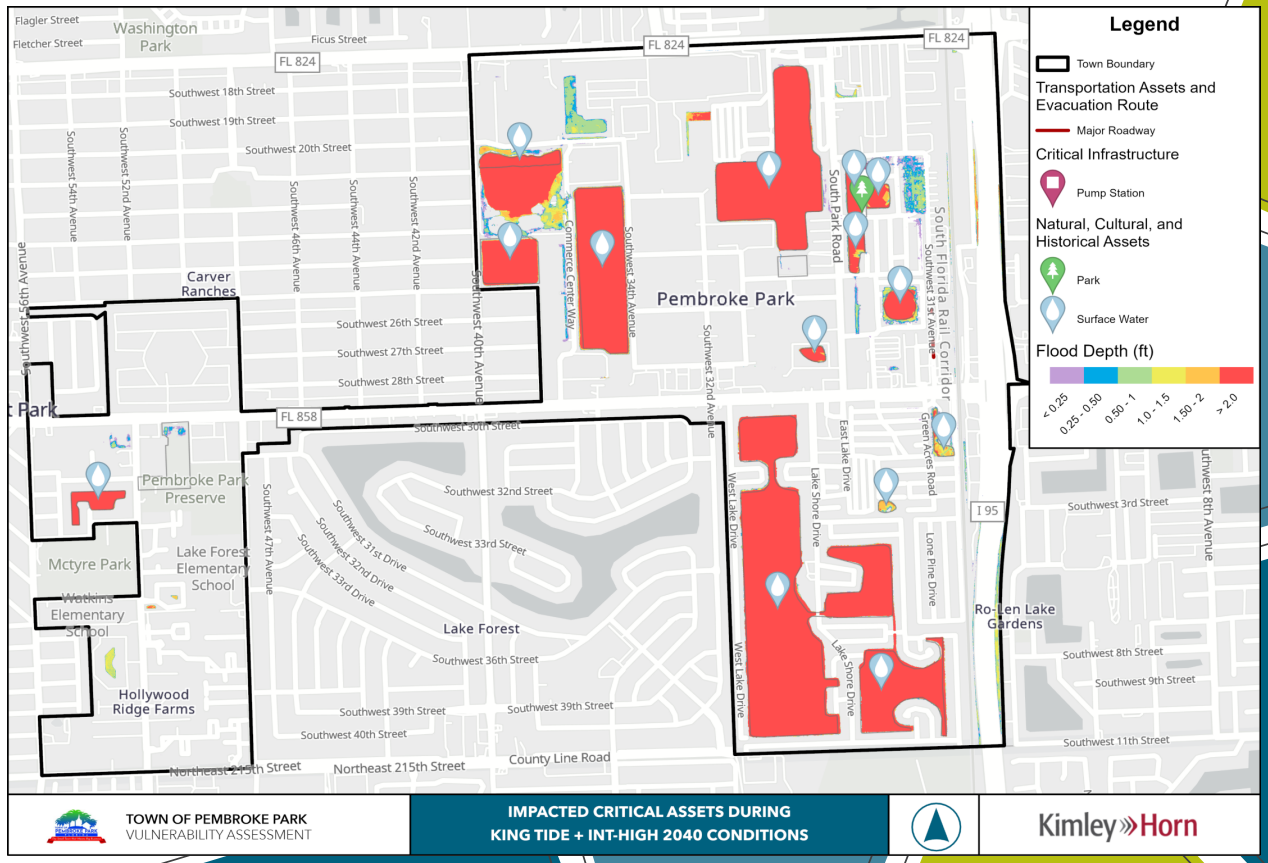

Exposure Analysis Results

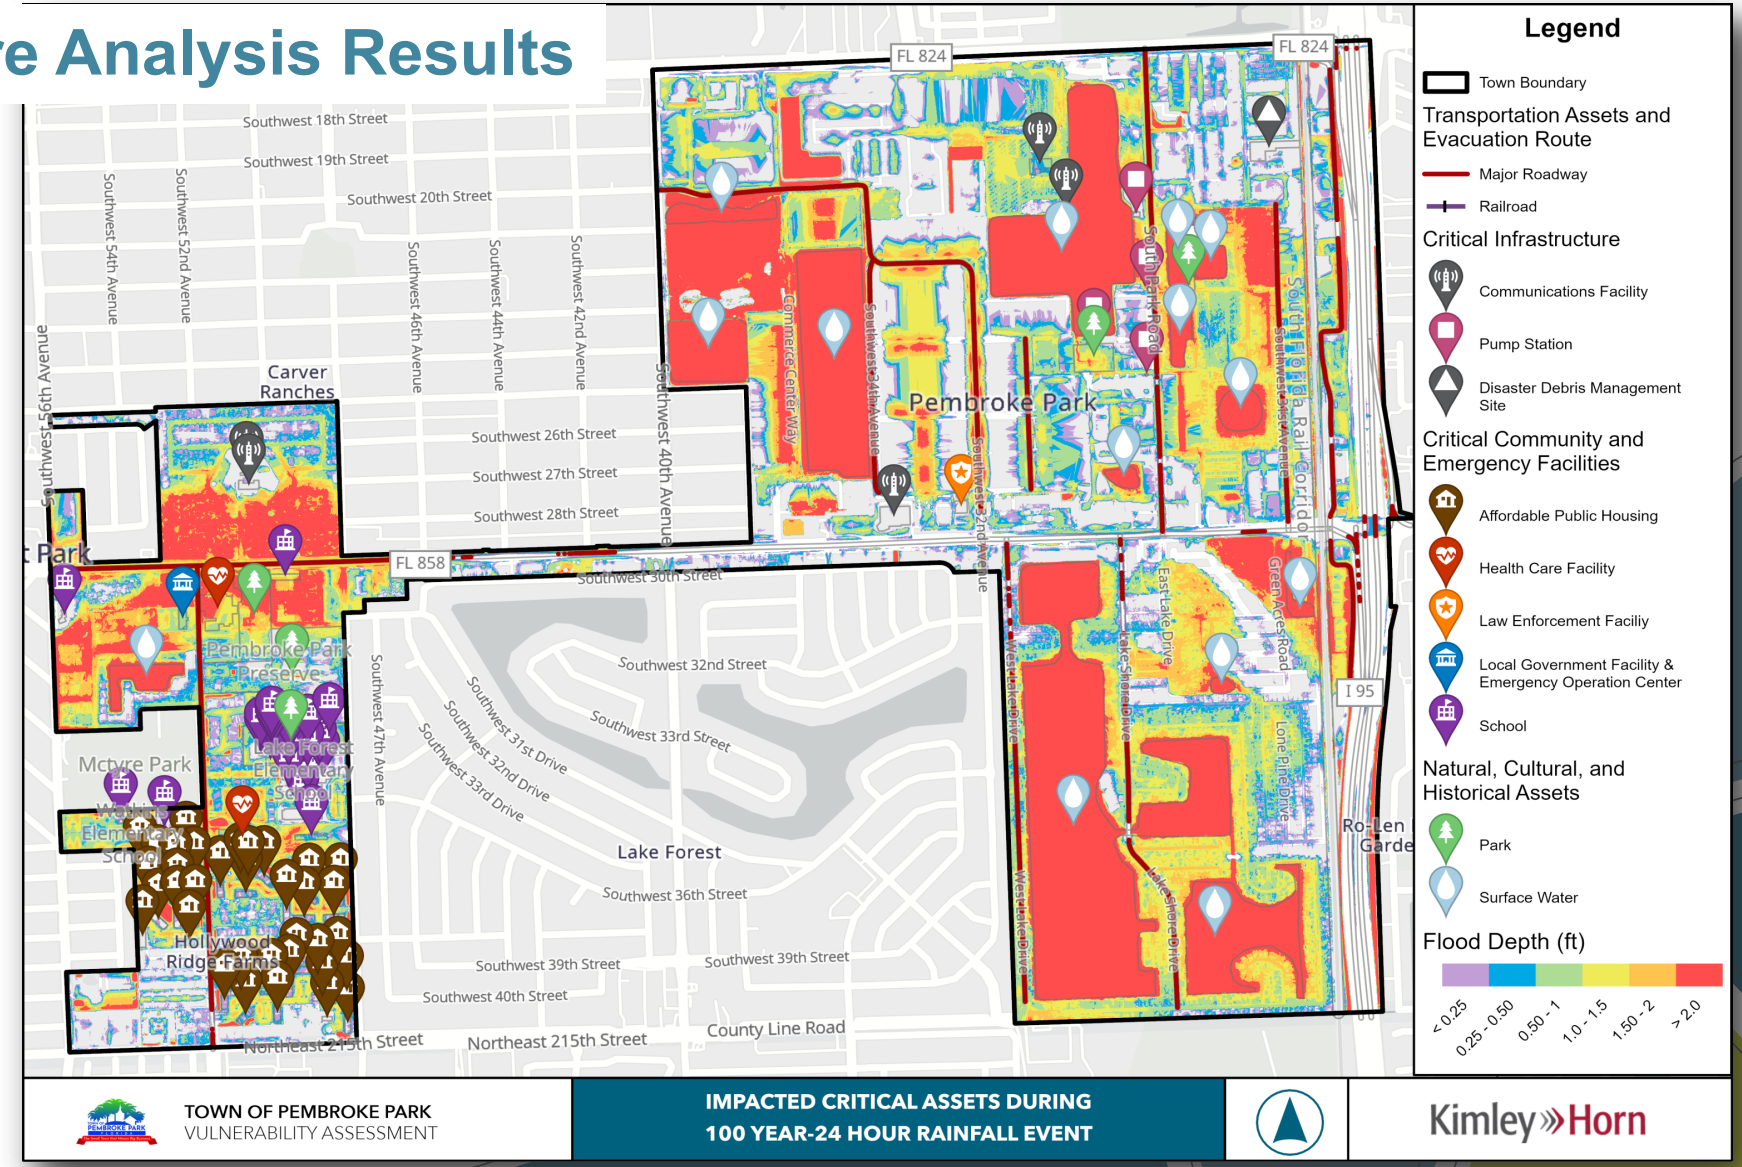


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

IMPACTED CRITICAL ASSETS DURING 100 YEAR-24 HOUR RAINFALL EVENT


Kimley»Horn

7

Exposure Analysis Results

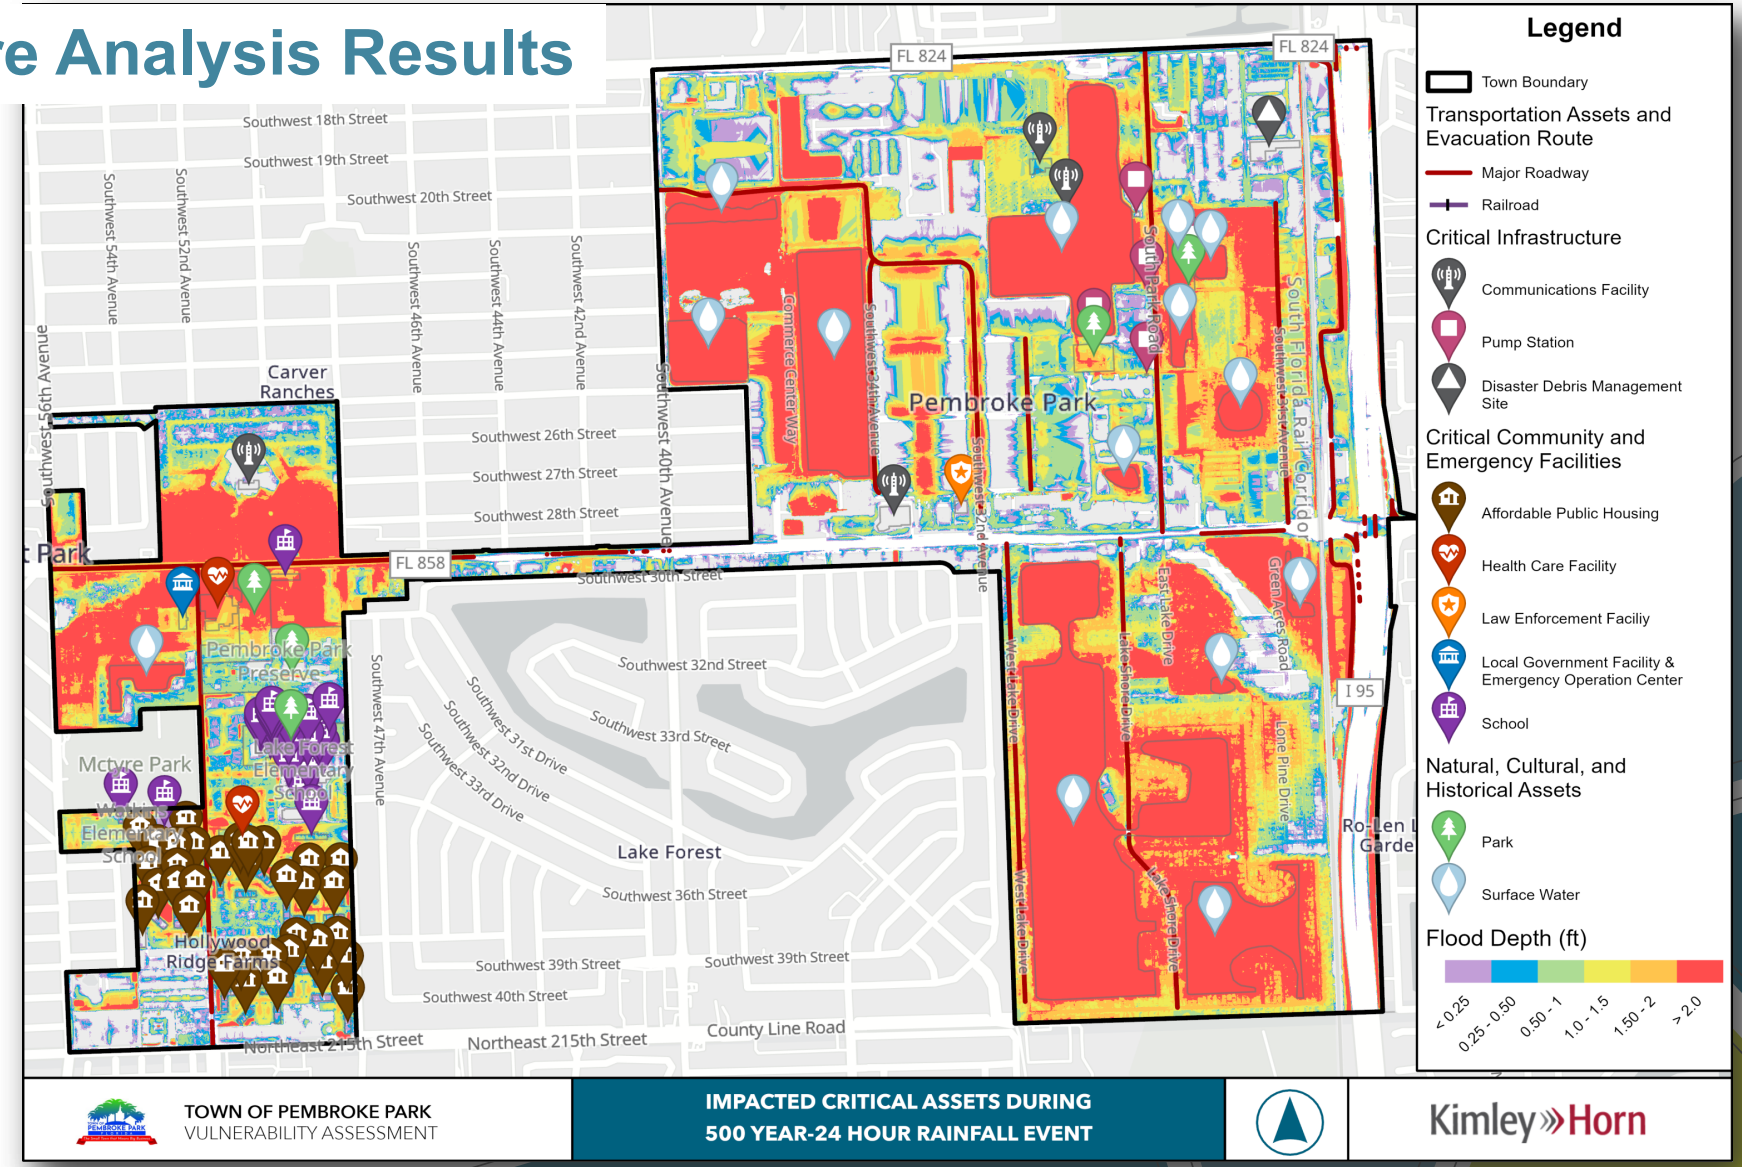

Exposure Analysis Results

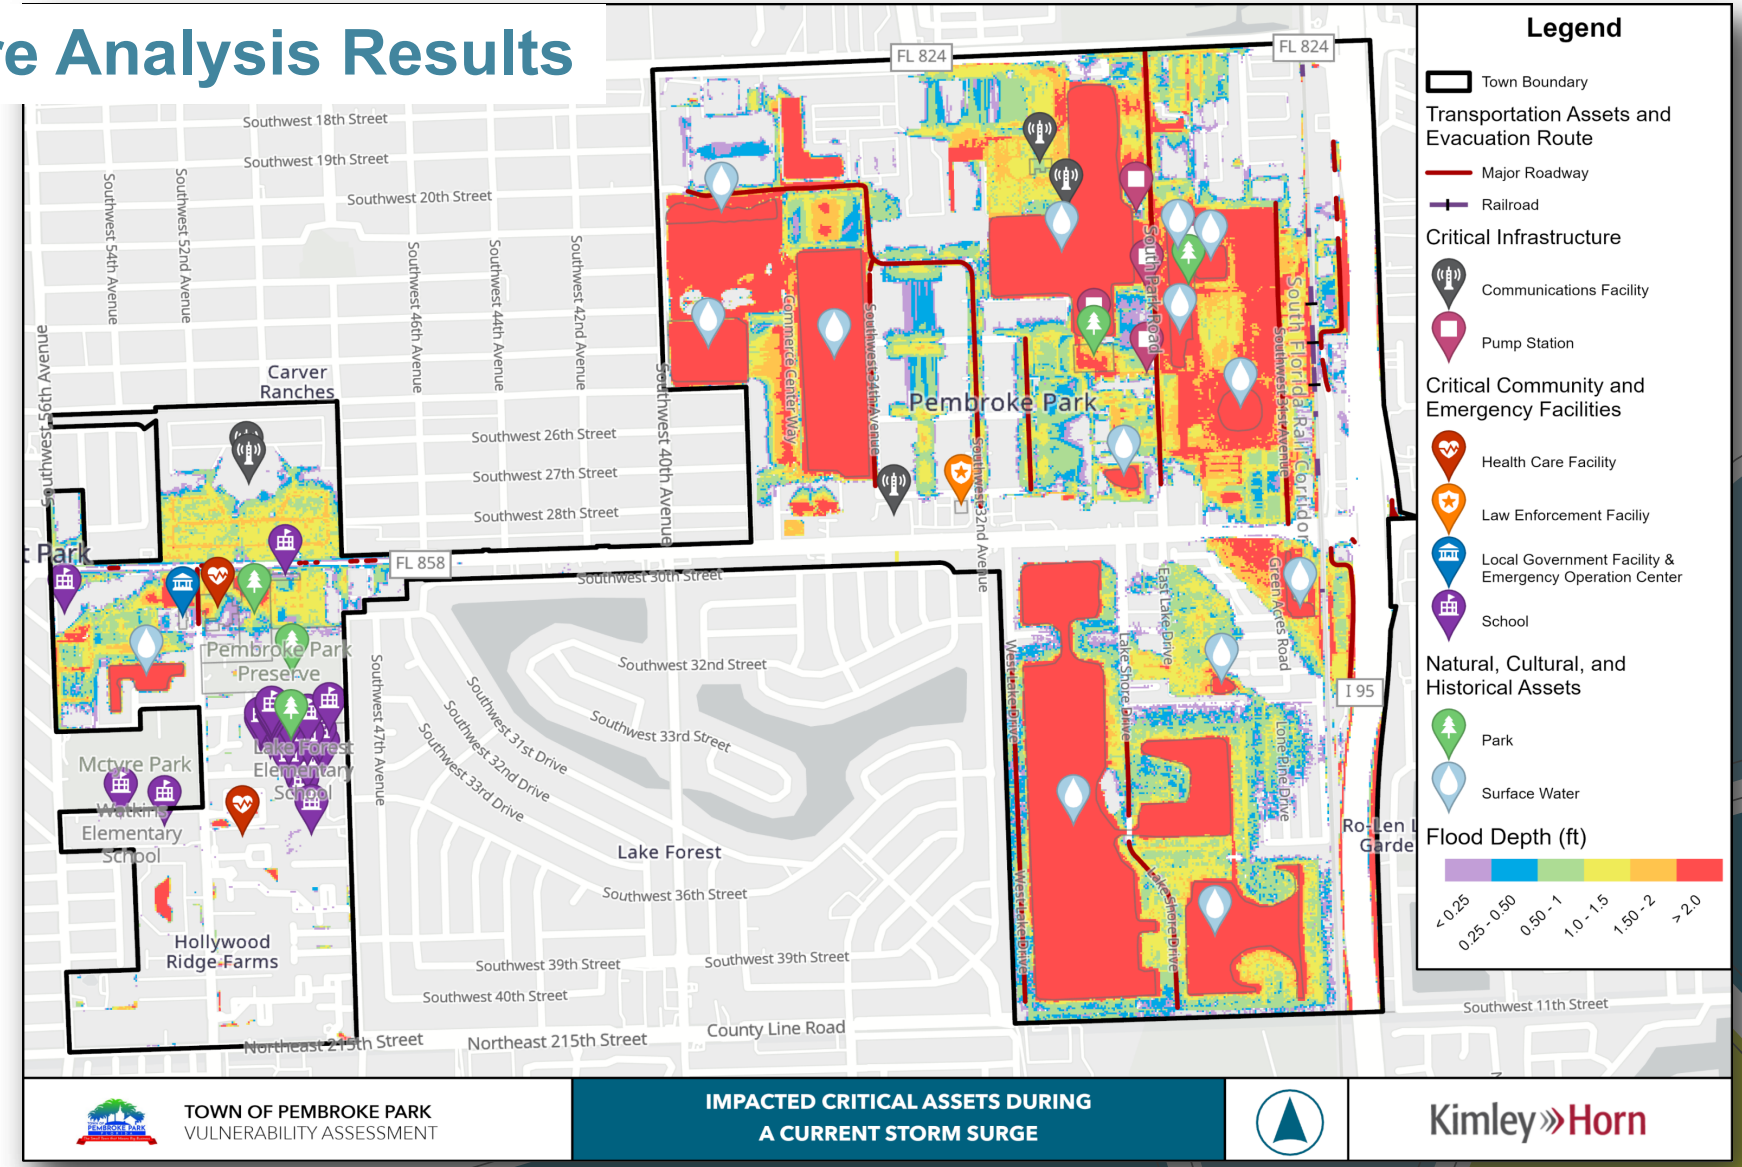

Sensitivity Analysis


Objective:

Measure the impact of flooding on assets and assign a risk level

Legend (Critical Infrastructure)	
Low	Flooding < 0.5-ft
Medium	Flood depths greater than 0.5-ft and less than 2-ft
High	Permanent (SLR) flooding, flood depths >2-ft

Asset Name	Scenario Criticality															
	100Y72H	Projected - 100Y72H IL2040	Projected - 100Y72H IH2040	Projected - 100Y72H IL2070	Projected - 100Y72H IH2070	500Y72H	Projected - 500Y72H IL2040	Projected - 500Y72H IH2040	Projected - 500Y72H IL2070	Projected - 500Y72H IH2070	CURRENT STORM SURGE	STORM SURGE + IL2040	STORM SURGE + IH2040	STORM SURGE + IL2070	STORM SURGE + IH2070	CURRENT KING TIDE
Communications Facility	L	L	L	L	L	L	L	L	L	L	-	-	-	-	M	-
Communications Facility	L	L	L	L	L	L	L	L	L	L	-	-	-	-	L	-
Solid and Hazardous Waste Facility, Disaster D	L	L	L	L	L	L	L	L	L	L	-	-	M	L	H	-
Pump Station	M	M	M	M	M	M	M	M	M	M	H	H	H	H	H	-
Pump Station	M	M	M	M	H	H	M	H	H	H	H	H	H	H	H	-
Pump Station	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-
Pump Station	M	M	M	M	M	M	M	M	M	M	M	H	H	H	H	-
Pump Station	M	M	M	M	H	H	M	H	H	H	H	H	H	H	H	-
Communications Facility	H	H	H	H	H	H	H	H	H	H	M	M	H	H	H	-
Communications Facility	M	M	M	M	M	M	M	M	M	M	M	H	H	H	H	-
Communications Facility	-	-	-	-	-	-	-	-	-	-	-	-	-	-	M	-

Sensitivity Analysis Results

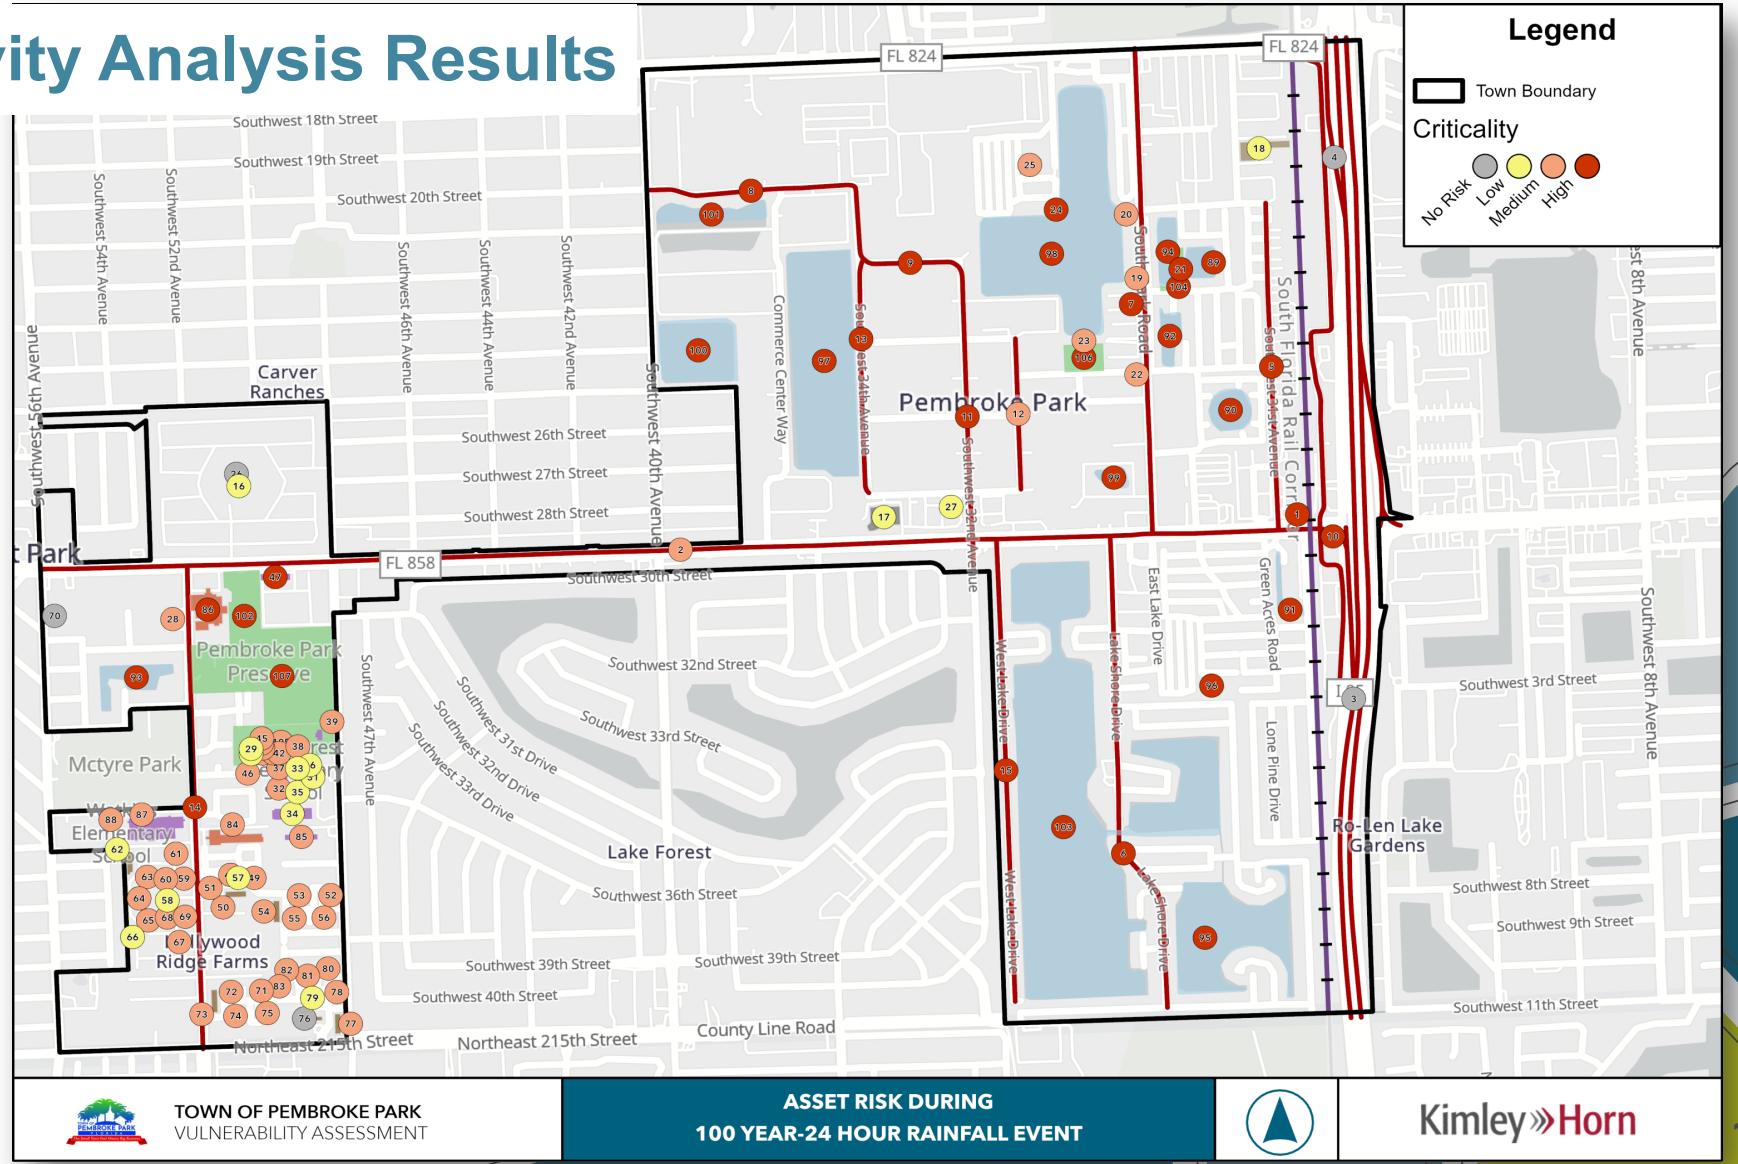


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

ASSET RISK DURING
100 YEAR-24 HOUR RAINFALL EVENT

Kimley»Horn

11

Sensitivity Analysis Results

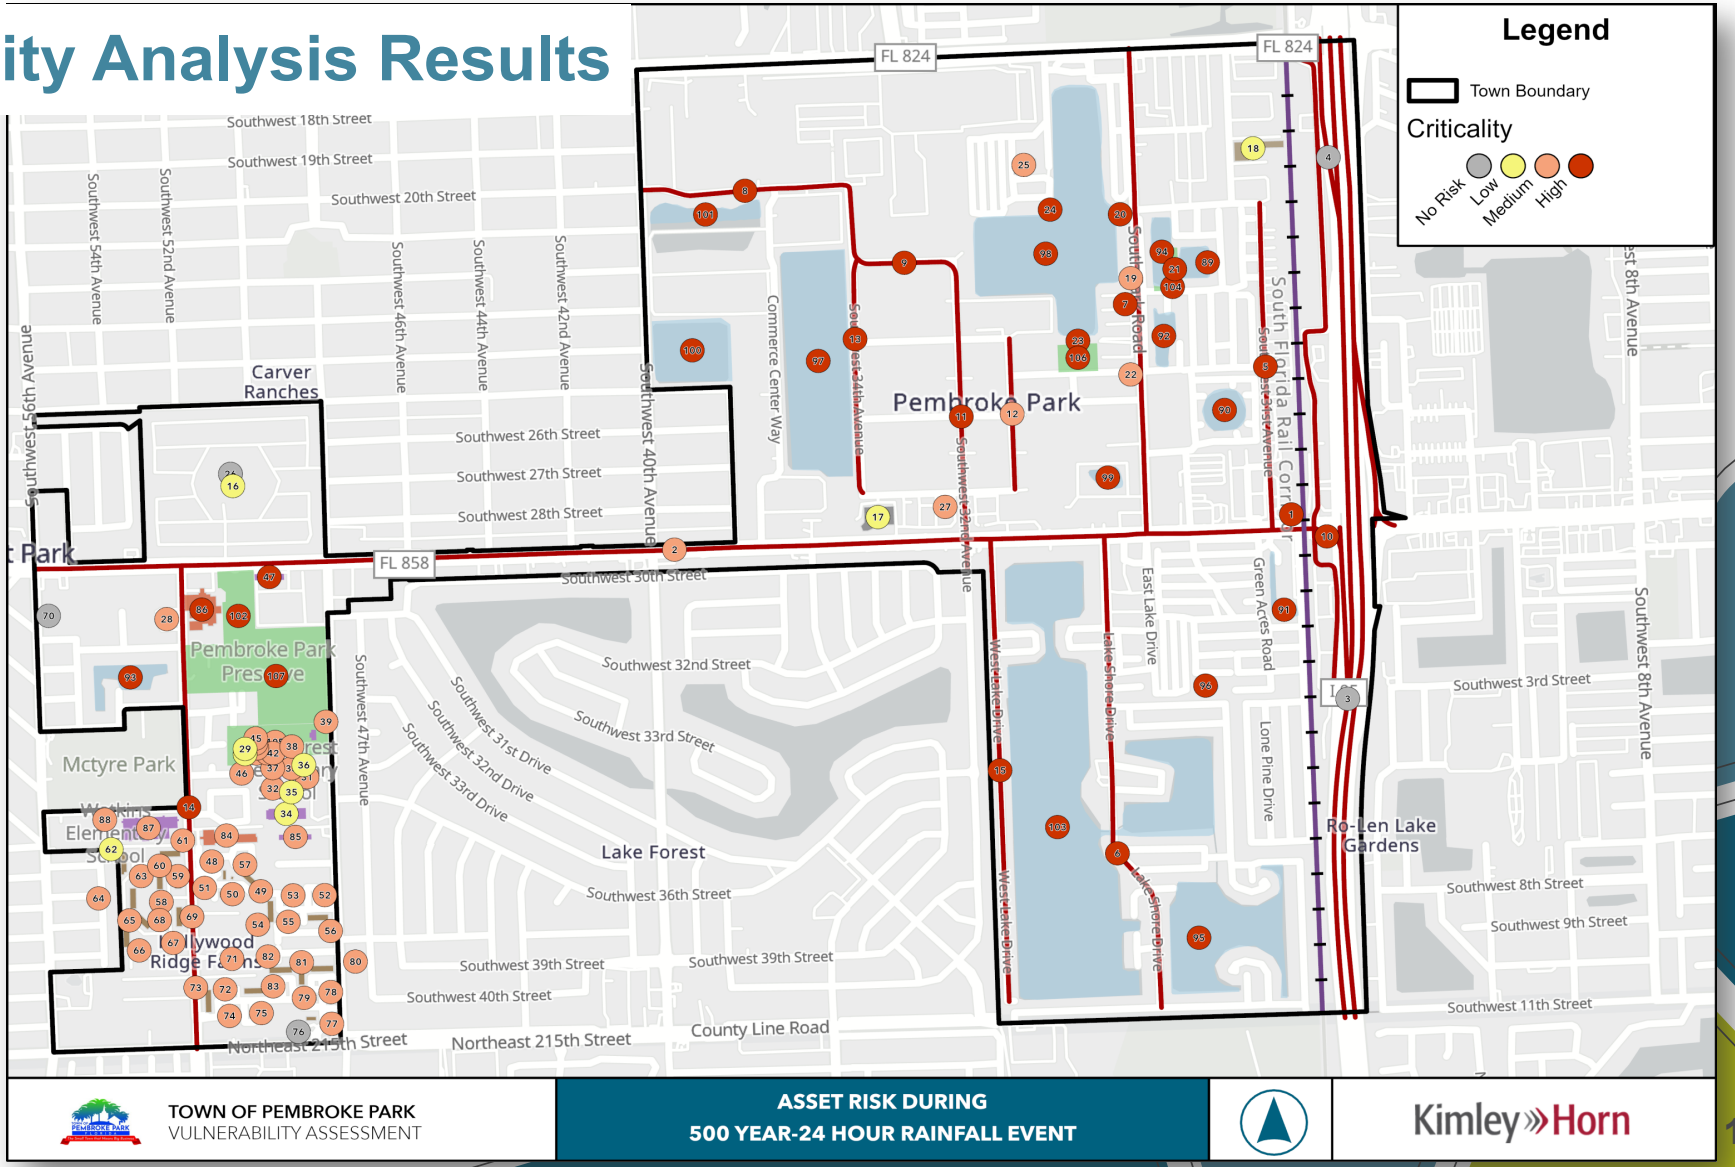


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

ASSET RISK DURING
500 YEAR-24 HOUR RAINFALL EVENT

Kimley»Horn

Sensitivity Analysis Results

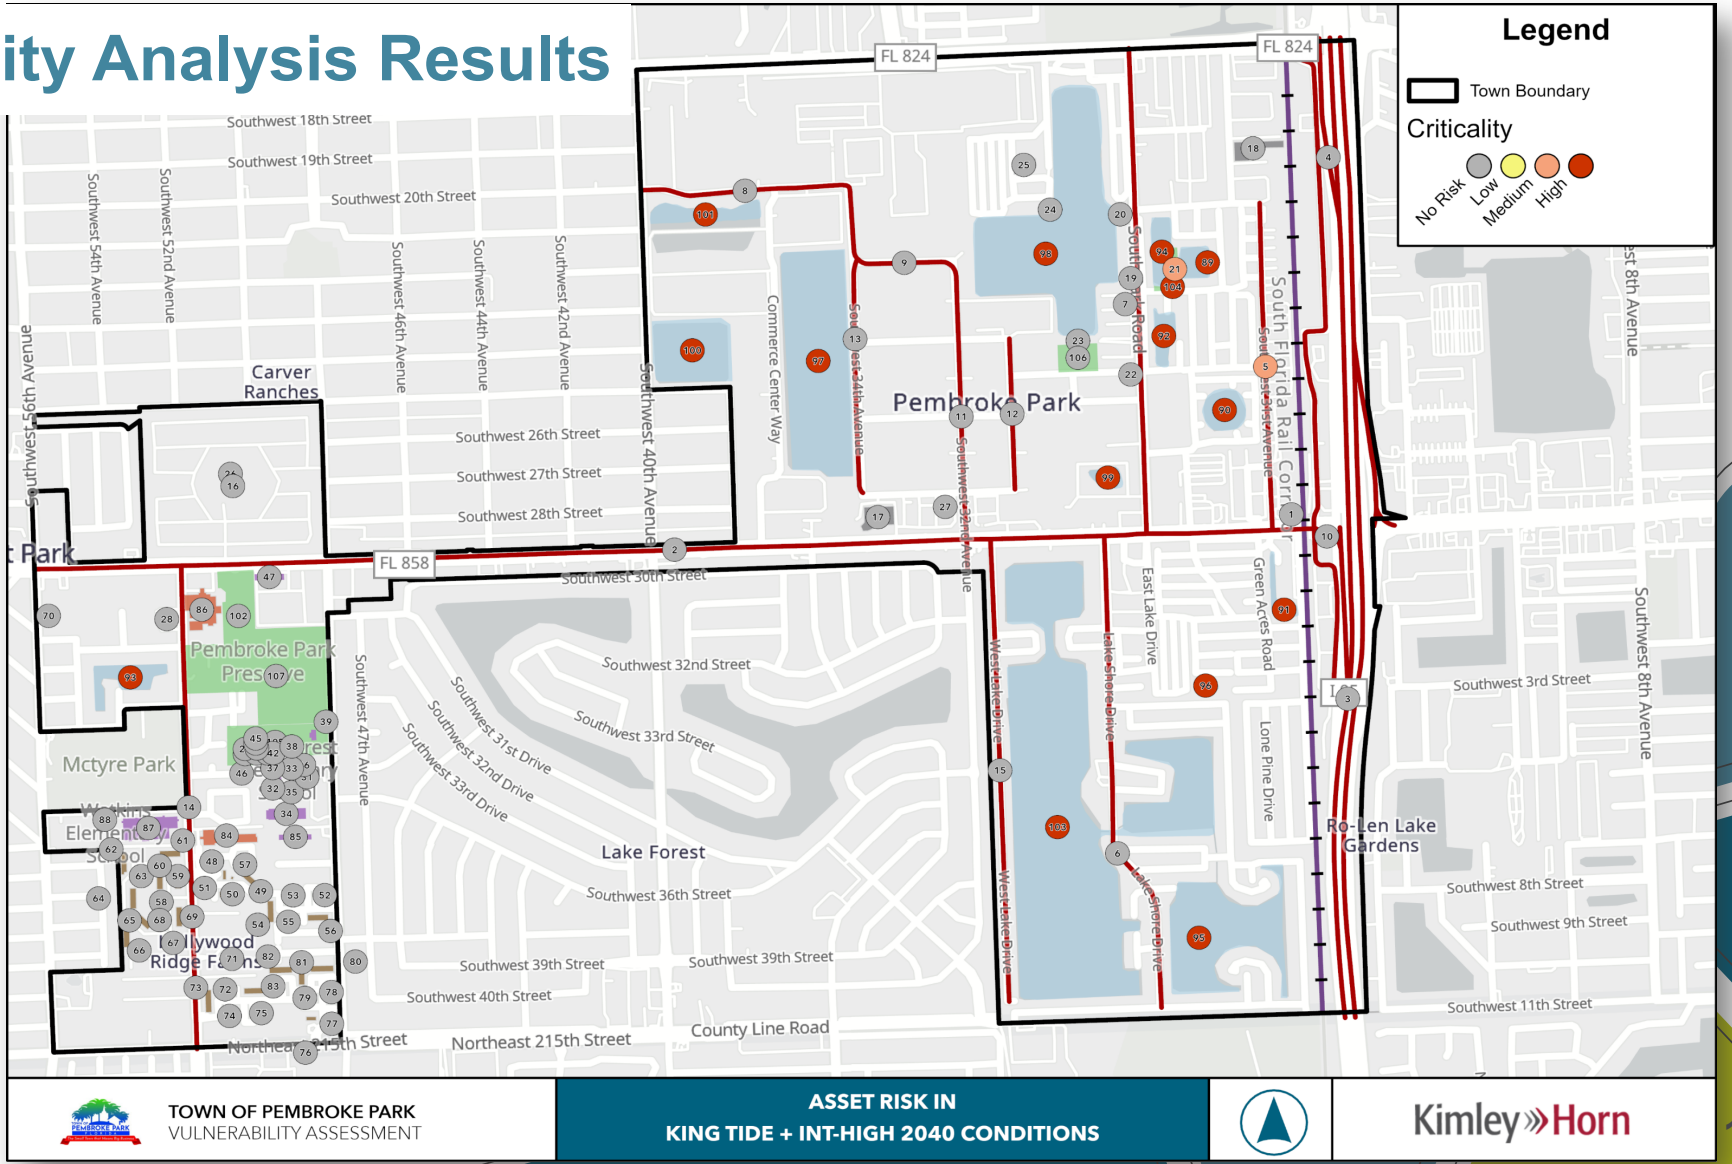


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

ASSET RISK IN
KING TIDE + INT-HIGH 2040 CONDITIONS

Kimley»Horn

Identify Focus Areas

Identify highly vulnerable focus areas within the Town which can benefit from future adaptation strategies.

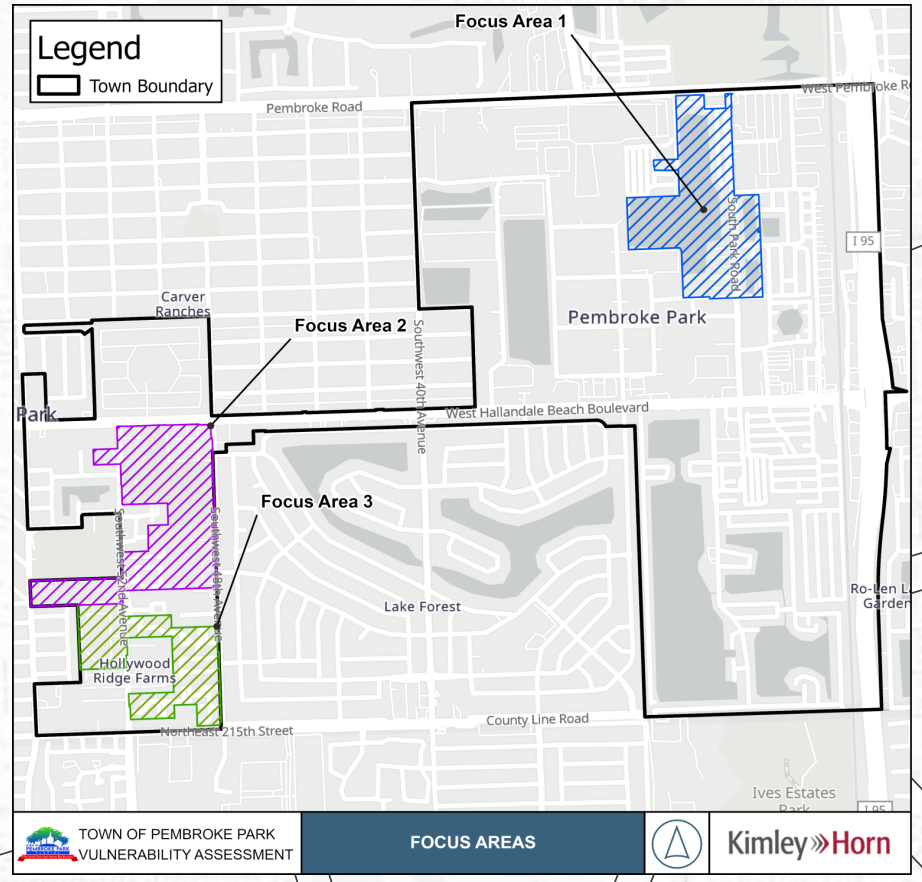

Adaptation Strategies

Short Term



Deployable Flood Barriers



Dry Floodproofing



Backflow Preventors



Stormwater Maintenance Program Update

Long Term




Enhanced Green and Grey Stormwater Infrastructure

Business Case Evaluation

FFE Ordinance

Elevate Infrastructure

Final Vulnerability Assessment

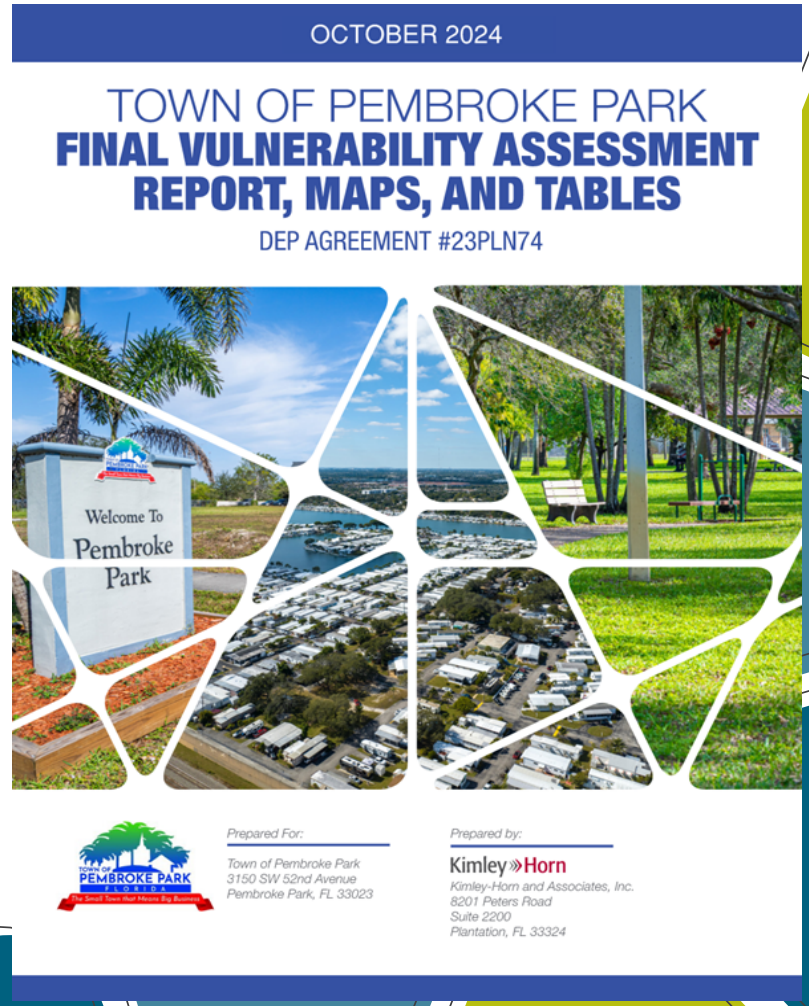



Thank you!

TOWN OF PEMBROKE PARK
FLORIDA
The Small Town that Means Big Business

Kimley»Horn

NOVEMBER 2024

TOWN OF PEMBROKE PARK
FINAL VULNERABILITY ASSESSMENT REPORT, MAPS, AND TABLES

DEP AGREEMENT #23PLN74



Prepared For:

Town of Pembroke Park
3150 SW 52nd Avenue
Pembroke Park, FL 33023

Prepared by:

Kimley»Horn

Kimley-Horn and Associates, Inc.
8201 Peters Road
Suite 2200
Plantation, FL 33324

Revision Date: 11/2024

The Town of Pembroke Park Vulnerability Assessment

Task 6 – Final Vulnerability Assessment

Prepared for:

Town of Pembroke Park
3150 SW 52nd Avenue
Pembroke Park, Florida 33023

Prepared by:

Kimley-Horn and Associates, Inc.
8201 Peters Road, Suite 2200
Plantation, FL 33324

© Kimley-Horn and Associates, Inc.
Registry No. 696

Plantation, Florida 143586004

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purposes and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley- Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

TABLE OF CONTENTS

1. PROJECT BACKGROUND 5
2. GOALS AND OBJECTIVES 5
3. TOWN OF PEMBROKE PARK BACKGROUND INFORMATION 5
U.S. CENSUS DATA 6
4. METHODOLOGY 7
TASK 1 – KICK-OFF MEETING 7
TASK 2 & 3 – BACKGROUND DATA AND CRITICAL ASSET INVENTORY 7
DIGITAL ELEVATION MODEL (DEM) 8
NOAA ATLAS RAINFALL DATA 9
SEA LEVEL RISE DATA 9
NOAA TIDES AND CURRENTS GAUGE DATA 11
STORM SURGE DATA 11
CRITICAL ASSETS INVENTORY 11
TASK 4 – EXPOSURE ANALYSIS 12
RAINFALL-INDUCED FLOODING 13
TIDAL FLOODING 16
STORM SURGE FLOODING 18
COMPOUND FLOODING SCENARIOS 21
SUMMARY TABLES 22
TASK 5 – SENSITIVITY ANALYSIS 25
METHODOLOGY 25
TRANSPORTATION AND EVACUATION ROUTES 27
CRITICAL INFRASTRUCTURE 28
CRITICAL COMMUNITY AND EMERGENCY FACILITIES 31
NATURAL, CULTURAL, AND RESOURCES 32
RESULTS AND DISCUSSION 34
IDENTIFY FOCUS AREAS 35
FOCUS AREA 1 – NORTHEAST REGION OF TOWN BETWEEN SOUTH PARK ROAD AND SW 32ND AVENUE 35
FOCUS AREA 2 – BETWEEN HALLANDALE BEACH BOULEVARD AND SW 54TH AVENUE 36
FOCUS AREA 3 – HOLLYWOOD RIDGE FARMS 37
ADAPTATION STRATEGIES 37
SHORT TERM ADAPTATION STRATEGIES 37
LONG TERM ADAPTATION STRATEGIES 37
TASK 6 – FINAL VULNERABILITY ASSESSMENT REPORT, MAPS, AND TABLES 38

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

LIST OF FIGURES

Figure 1: Project Location Map 6
Figure 2. U.S. Census Demographics Data 7
Figure 3: Elevation in Pembroke Park 9
Figure 4: NOAA 2017 Intermediate-Low SLR Projection Used (circled in red) 10
Figure 5: Flooding in the 500-Year, 24-Hour Event 14
Figure 6: Flooding in the Future Rainfall / Int-High 2040 Compound Scenario 16
Figure 7: Flooding in the Current Tidal Scenario 17
Figure 8: Flooding in the Future High Tide Int-High 2070 Scenario 18
Figure 9: Flooding in the Current Storm Surge Scenario 19
Figure 10: Flooding in the Future Storm Surge Int-High 2070 Scenario 20
Figure 11: Flooding in the Compound Scenario of 100-Year, 24-Hour Storm with Future King-Tide Conditions - Int-High 2070 Scenario 22
Figure 12. Focus Areas Identified within the Town 35

LIST OF TABLES

Table 1: Methodology Steps 7
Table 2: NOAA Atlas 14 Rainfall Depths 9
Table 3: SLR Data 10
Table 4: Tidal Flooding Data 11
Table 5: Storm Surge Scenarios 11
Table 6: Town Critical Assets 12
Table 7. Scenarios Evaluated with Associated Baseline Flood Elevation 13
Table 8: Rainfall-Induced Flooding Events 14
Table 9. Exposure Analysis Legend 22
Table 10: Transportation Assets and Evacuation Routes Impacted by Scenarios 22
Table 11: Critical Infrastructure Assets Impacted by Scenarios 23
Table 12: Critical Community and Emergency Facilities Assets Impacted by Scenarios 24
Table 13: Natural, Cultural, and Historical Assets Impacted by Scenarios 25
Table 14: Transportation Assets and Evacuation Routes 27
Table 15: Critical Elevations for Major Roads 27
Table 16: Critical Elevations for Rail Facilities 28
Table 17: Critical Infrastructure 29
Table 18: Critical Elevations of Stormwater Pump Stations 29
Table 19: Critical Elevations of Communication Facilities 30
Table 20: Critical Elevations of Disaster Debris Management Site 30
Table 21: Critical Community and Emergency Facilities 31
Table 22: Critical Elevations of Community And Emergency Facilities 32
Table 23: Natural, Cultural, And Historical Resources 33
Table 24: Parks, Total Area 33
Table 25: Surface Water Critical Elevations 33
Table 26. Focus Area 1 Critical Assets 36
Table 27. Focus Area 2 Critical Assets 36
Table 28. Focus Area 3 Critical Assets 37

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.
November 2024

LIST OF APPENDICES

APPENDIX A – Kick Off Meeting Minutes
APPENDIX B – Data Collection Technical Memorandum
APPENDIX C – FEMA Firm Panels
APPENDIX D – Exposure Analysis Inundation Maps
APPENDIX E – Sensitivity Analysis Paired Asset-Threat Matrices
APPENDIX F – Sensitivity Analysis Paired Asset-Threat Maps

ABBREVIATIONS

BFE	Base Flood Elevations
DEM	Digital Elevation Model
FDEM	Florida Department of Emergency Management
FDEP	Florida Department of Environmental Protection
FEMA	Federal Emergency Management Agency
FFE	Finished Floor Elevation
FIRM	Flood Insurance Rate Map
FIS	Flood Insurance Study
F.S.	Florida Statute
IH	Intermediate-High
IL	Intermediate-Low
LiDAR	Light Detection and Ranging
MEOW	Maximum of the Maximum Envelope
MHHW	Mean Higher High Water
MOM	Maximum of Maximum
NAVD 88	North American Vertical Datum of 1988
NOAA	National Oceanographic and Atmospheric Administration
NWS	National Weather Service
SFWMD	South Florida Water Management District
SLR	Sea Level Rise
SLOSH	Sea, Lake, and Overland Surges from Hurricanes
SLS	Sea Level Scenario
USACE	U.S. Army Corps of Engineers

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

1. PROJECT BACKGROUND

Kimley-Horn was retained under an Agreement for Continuing Consulting Engineering Services for the Town of Pembroke Park Vulnerability Assessment Study on November 17, 2023. Pursuant to F.S. 380.093, a Vulnerability Assessment for critical infrastructure and community assets in the Town of Pembroke Park (hereinafter referred to as "Town") was completed to ultimately prepare a comprehensive Town-wide flood vulnerability and sea level rise assessment to address risk of impacts from sea level rise (SLR), storm surge, and rainfall-induced flooding.

The Town of Pembroke Park received funding from the Florida Department of Environmental Protection through the Resilient Florida Program to conduct a Townwide Vulnerability Assessment. The objective of the Town of Pembroke Park Vulnerability Assessment Project is to identify critical assets as classified in s. 390.093(2) 1-4, F.S. and assess risk of flooding and sea level rise within the Town and specify the scenarios in which these areas are vulnerable.

This project was made possible through grant funding provided by the Florida Department of Environmental Protection (FDEP) Resilient Coastlines Program. This draft vulnerability assessment report provides a summary of all tasks completed for this vulnerability assessment.

2. GOALS AND OBJECTIVES

The main objections of this study were:

- To conduct a vulnerability assessment pursuant to s. 380.093, F.S.
- To present a list of critical and regionally significant assets impacted by each flood scenario ranked by risk.
- To provide all electronic mapping data used to illustrate flooding and sea level rise impacts identified in the VA.
- To provide a signed Vulnerability Assessment Compliance Checklist Certification.

3. TOWN OF PEMBROKE PARK BACKGROUND INFORMATION

The Town of Pembroke Park is an intercoastal municipality located in southeast Broward County, Florida, approximately 1.7 square miles in area. The Town is bounded by I-95 to the east, the Town of Ives Estates Park to the south, the City of Hollywood to the North, and the City of West Park to the west. The estimated population is 6,240 residents per the July 1, 2022, United States Census Bureau.

Coastal proximity, low-lying topography and a high groundwater table make the Town vulnerable to the impacts of SLR, storm surge, extreme weather, and other flooding shocks and stressors. These impacts tax the Town's built and natural environments and require a concerted approach to devise an actionable resilience plan that sustains the quality of life, aligns policies and programs, balances life-cycle costs, and ultimately adapts to change. The Vulnerability Assessment presented in this report is one part of the overall path to resilience planning.

Figure 1 shows the project location map for the Town of Pembroke Park Vulnerability Assessment.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

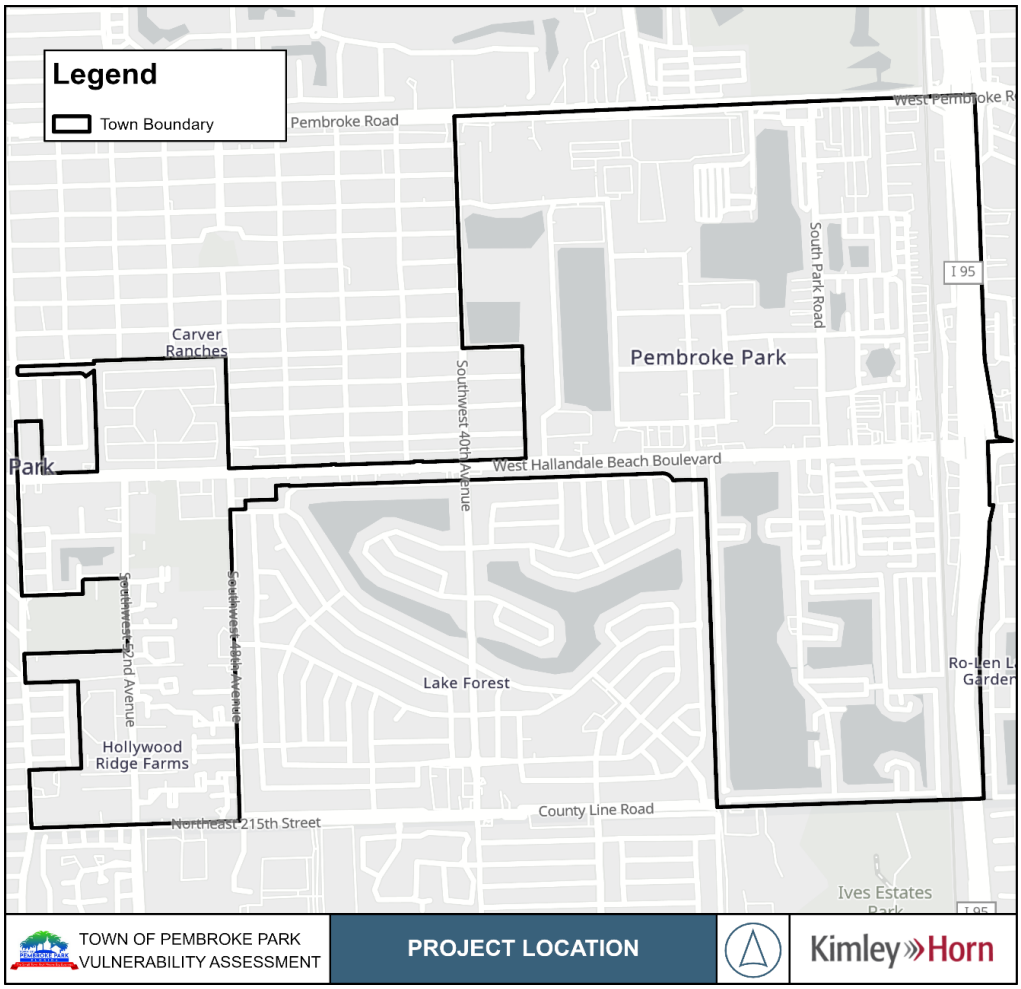


FIGURE 1: PROJECT LOCATION MAP

U.S. CENSUS DATA

The demographics of the Town of Pembroke Park can be comprehensively outlined in this section, encompassing a wide range of data related to various aspects of the community. This includes detailed information about the population size and distribution, elderly population, housing characteristics, and economic factors such as employment and income levels that contribute to a deeper understanding of the Town's overall profile. A sample of this data is provided below in **Figure 2.**

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

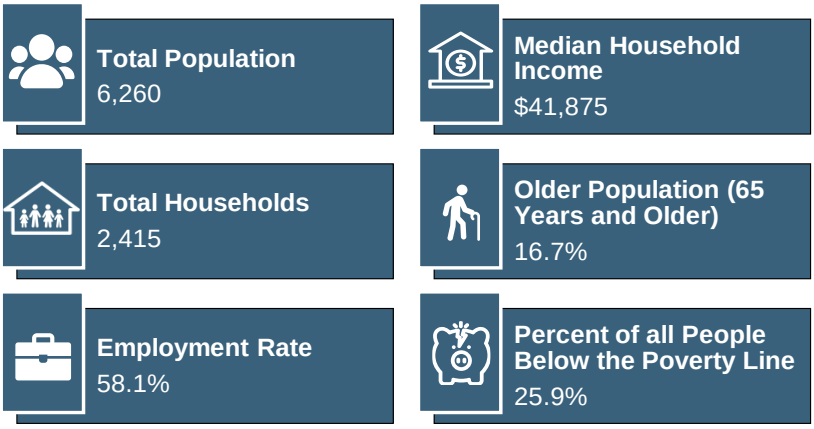


FIGURE 2. U.S. CENSUS DEMOGRAPHICS DATA

4. METHODOLOGY

This study methodology follows a six-step process following state guidelines as summarized in **Table 1**. The focus of steps 1 to 6 was to acquire background data, take inventory of critical and regionally significant assets, conduct an exposure analysis, conduct a sensitivity analysis, and provide a final vulnerability assessment.

TABLE 1: METHODOLOGY STEPS

Task	Description
Task 1	Kick-Off Meeting and Project Management
Task 2	Acquire Background Data
Task 3	Critical and Regionally Significant Asset Inventory
Task 4	Exposure Analysis
Task 5	Sensitivity Analysis
Task 6	Final Vulnerability Assessment Report, Maps, and Tables

TASK 1 – KICK-OFF MEETING

The first step in this project included a kick-off meeting held on January 11, 2024, during which the team members were introduced, and project goals, objectives, and schedule were discussed.

During the kick-off meeting, project stakeholders and their role in the project were identified. A formal steering committee was not assembled for this vulnerability assessment. The meeting minutes from the project kick-off meeting are included in **APPENDIX A**.

TASK 2 & 3 – BACKGROUND DATA AND CRITICAL ASSET INVENTORY

The following data was compiled for use in this vulnerability assessment:

- 2018 USDA NRCS/USGS Southeast Florida 1-m DEM
- FEMA Flood Insurance Rate Maps (FIRMs)
- NOAA Atlas 14 Rainfall Data

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

- NOAA Sea, Lake, and Overland Surges from Hurricanes (SLOSH) model
- Southeast FL Regional Climate Change Compact Unified SLR Projections Guidance Report
- NOAA 2017 SLR Projections
- NOAA Tides and Gauges Data
- Critical Asset Inventory

The data collection technical memorandum containing a log of all data collected for this task and their sources can be found in **APPENDIX B.**

DIGITAL ELEVATION MODEL (DEM)

The 2018 U.S. Department of Agriculture National Resource Conservation Service (USDA NRCS)/ U.S. Geological Survey (USGS) Southeast Florida dataset was used as the basis of terrain for this vulnerability assessment. All elevations are relative to vertical datum NAVD 88. All conversions of data from NGVD29 to NAVD88 reported in this project were standardized at a difference of 1.6-feet. No changes in topography required rectification in this analysis.

The study area contains a ridge along I-95 with a peak elevation of approximately 30-feet. Elevations within the Town's boundary are generally the highest in the southwest region, containing Lake Forest Elementary School, with a peak elevation of approximately 9.0-feet, and Watkins Elementary School, with a peak elevation of approximately 8.5-feet.

Relative lows exist around all surface waters ranging in elevation from 3.0-feet to 7.0-feet.

Figure 3 shows the Digital Elevation Map for the Town.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

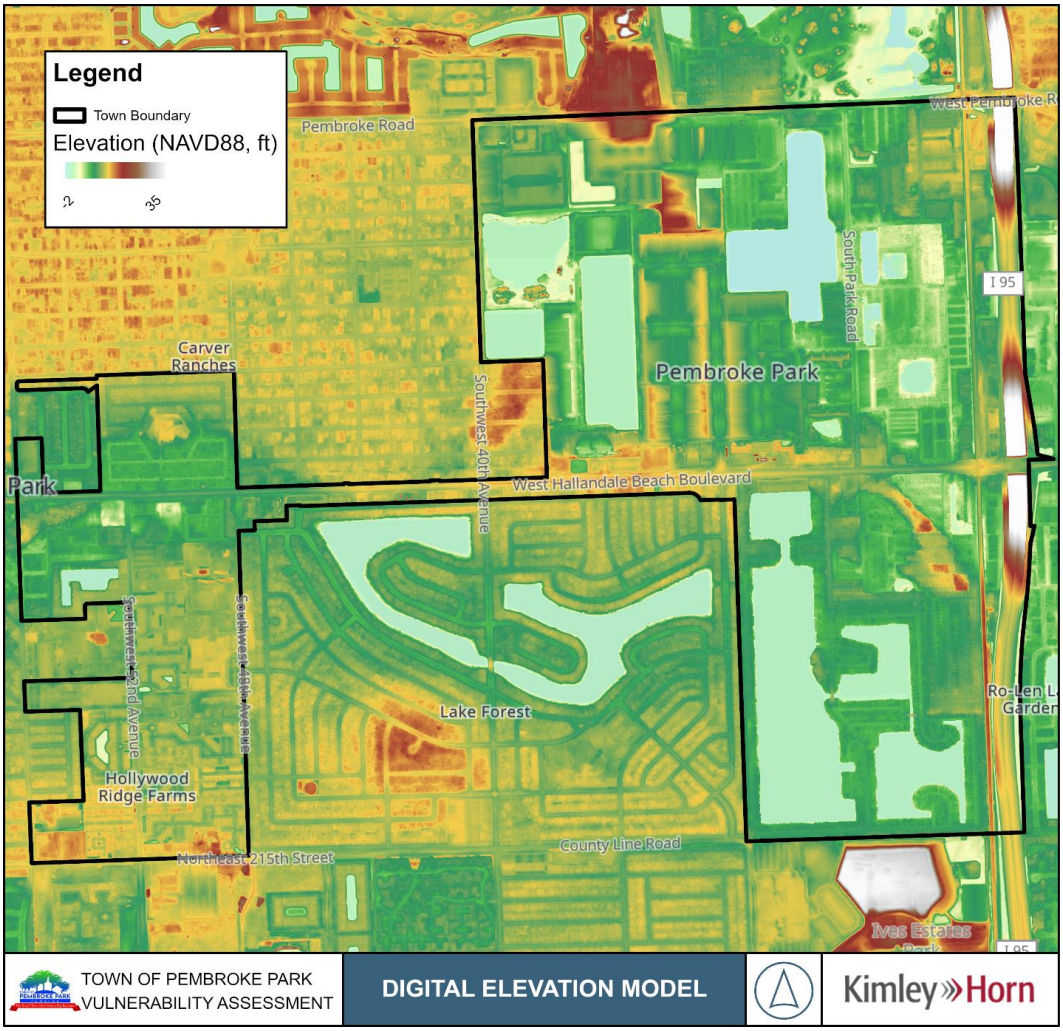


FIGURE 3: ELEVATION IN PEMBROKE PARK

NOAA ATLAS RAINFALL DATA

The 100-year, 24-hour and 500-year, 24-hour rainfall events were collected from the NOAA Atlas 14 tool. Table 2 shows the rainfall depths evaluated in this analysis.

TABLE 2: NOAA ATLAS 14 RAINFALL DEPTHS

Rainfall Event	Rainfall Depth (in)
100-year, 24-hour	15.4
500-year, 24-hour	21.1

SEA LEVEL RISE DATA

Per s. 380.093, F.S., SLR vulnerability assessments must include the 2017 NOAA SLR intermediate-low and intermediate-high projections for the years 2040 and 2070 as modeled scenarios. The 2017 NOAA SLR projections were pulled from the Miami Beach and Virginia Key gauges. Upon review of both gauges, it was determined that the reported SLR projections were the same for all SLR scenarios

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

included in this assessment. The 2017 NOAA SLR intermediate-low projections were ultimately pulled from the Miami Beach gauge, the closest gauge with SLR data to Pembroke Park, with approval from FDEP. **Figure 4** shows the 2017 NOAA SLR projection data collected from the Miami Beach gauge.

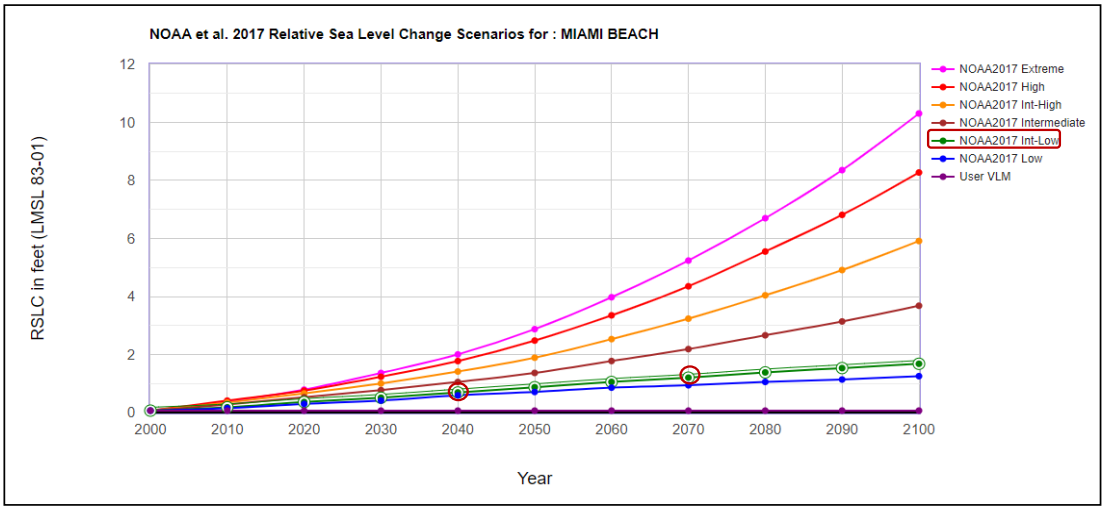


FIGURE 4: NOAA 2017 INTERMEDIATE-LOW SLR PROJECTION USED (CIRCLED IN RED)

In 2019, the Southeast Florida Regional Climate Change Compact (SEFRCCC) released an update of the Unified SLR Projections Guidance Report which summarizes observed SLR trends and recommended regional SLR projections through the year 2120. This update was intended to support local governments and regional entities in the development of science-based adaptation strategies, policies, and infrastructure design. The Guidance Report discusses three curves for application: the NOAA High Curve, the NOAA Intermediate High Curve, and the curve corresponding to the median of the Intergovernmental Panel on Climate Change (IPCC). The IPCC median curve is recommended for short-term, flexible projects with low risk and limited connections to other infrastructure. For projects ending before 2070, it is advised to consider values along the NOAA Intermediate-High curve and thus, were used for this analysis.

While the High SLR projections were not included in this vulnerability assessment, it is suggested that these conditions be evaluated prior to the design phase of any project to evaluate the effectiveness and assumed planning horizon of any adaptive infrastructure.

The SLR projection data used in this vulnerability assessment are outlined in **Table 3**.

TABLE 3: SLR DATA

Scenario	Data Source	Projected Elevation (NAVD88, ft)
Intermediate-Low 2040 (IL2040)	2017 NOAA SLR Projections	0.76
Intermediate-High 2040 (IH2040)	SERFCCC Unified SLR Projections Guidance	1.38
Intermediate-Low 2070 (IL2070)	2017 NOAA SLR Projections	1.31
Intermediate-High 2070 (IH2070)	SERFCCC Unified SLR Projections Guidance	3.31

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

NOAA TIDES AND CURRENTS GAUGE DATA

Tidal flooding data, such as mean higher high water (MHHW) and flood thresholds, were collected from the NOAA Tides and Currents database and published National Weather Service flooding thresholds. NOAA has determined three coastal flood severity levels, informed by years of monitoring tide gauge data. Variations in flood thresholds exist among NOAA tide gauges due to differences in infrastructure vulnerabilities influenced by factors like topography, land cover, and flood defenses. A flood threshold of 1.74 feet above MHHW is identified by NOAA as the minor flood threshold at the closest tide gauge to the Town (Virginia Key, Biscayne Bay, FL station). Using the MHHW elevation and the NOAA minor flood threshold value, the value of 2.31 feet NAVD88 was used to assess the vulnerability to the current King Tide scenario.

Table 4 shows the current tidal flooding elevation in Pembroke Park.

TABLE 4: TIDAL FLOODING DATA

Scenario	Elevation (NAVD88, ft)
Current Tidal Flooding Threshold	1.74
Mean Higher High Water (MHHW)	0.57

STORM SURGE DATA

Storm surge data was sourced from the National Hurricane Center's Sea, Lake, and Overland Surges from Hurricanes (SLOSH) model. The data collected is the maximum of the maximum envelope of high water (MEOW), or (MOM), which provides a worst-case scenario for each category storm under "perfect" storm conditions. A Category Five – High water surface elevation of 6.70 feet NAVD88 was obtained for this assessment.

Table 5 shows the current storm surge elevation in the Town on Pembroke Park.

TABLE 5: STORM SURGE SCENARIOS

Scenario	Surge Elevation (NAVD88, ft)
Current Storm Surge – Category Five	6.70

CRITICAL ASSETS INVENTORY

An integral part of the vulnerability assessment was identifying, locating, and categorizing Town assets that may be exposed to threats due to flooding hazards. Asset data was collected using the Broward County GeoHub GIS portal and additional data was provided by the Town. A list of all inventoried Town assets evaluated as a part of this vulnerability assessment is provided in **Table 6**. This inventory is organized by asset category as defined in s. 380.093, F.S. and only includes assets that are owned or maintained by Pembroke Park.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 6: TOWN CRITICAL ASSETS

Asset Category	Asset Type	Quantity
Transportation Assets and Evacuation Routes	Major Roadways	14
	Rail Facilities	1
Critical Infrastructure	Stormwater Treatment Facilities (Pump Stations)	5
	Communication Facilities	5
	Solid and Hazardous Waste Facilities	1
	Affordable Public Housing	35
Critical Community and Emergency Facilities	Schools (including all facilities)	23
	Health Care Facilities	2
	Law Enforcement Facilities	1
	Local Government Facilities	1
Natural, Cultural, and Historic Resources	Parks	5
	Surface Waters	14

TASK 4 – EXPOSURE ANALYSIS

An exposure analysis was performed to assess the extent of flooding experienced by an asset due to various flooding scenarios in present-day and projected to occur in the future including rainfall, sea level rise, and storm surge. The following sections outline the methodology used to perform the exposure analysis for the Town of Pembroke Park.

APPENDIX D contains the inundation maps for all flooding scenarios evaluated in the exposure analysis.

All evaluated scenarios in this analysis and the baseline flood elevation associated with each scenario are outlined below.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 7. SCENARIOS EVALUATED WITH ASSOCIATED BASELINE FLOOD ELEVATION

Scenario	Baseline Flood Elevation (ft)
100-year, 24-hour	-
Projected Rainfall – 100-year, 24-hour + SLRIL2040	0.76
Projected Rainfall – 100-year, 24-hour + SLRIH2040	1.38
Projected Rainfall – 100-year, 24-hour + SLRIL2070	1.31
Projected Rainfall – 100-year, 24-hour + SLRIH2070	3.31
500-year, 24-hour	-
Projected Rainfall – 500-year, 24-hour + SLRIL2040	0.76
Projected Rainfall – 500-year, 24-hour + SLRIH2040	1.38
Projected Rainfall – 500-year, 24-hour + SLRIL2070	1.31
Projected Rainfall – 500-year, 24-hour + SLRIH2070	3.31
Current King Tide Conditions with NOAA Minor Flood Threshold	2.31
Future King Tidal Flooding with IL2040	3.07
Future King Tidal Flooding with IH2040	3.69
Future King Tidal Flooding with IL2070	3.62
Future King Tidal Flooding with IH2070	5.62
Current Storm Surge	6.70
Storm Surge with SLRIL2040	7.46
Storm Surge with SLRIH2040	8.08
Storm Surge with SLRIL2070	8.01
Storm Surge with SLRIH2070	10.01
Compound Flooding – 100-year, 24-hour + Current King Tide Conditions with NOAA Minor Flood Threshold	2.31
Compound Flooding – 100-year, 24-hour + Future King Tidal Flooding with IL2040	3.07
Compound Flooding – 100-year, 24-hour + Future King Tidal Flooding with IH2040	3.69
Compound Flooding – 100-year, 24-hour + Future King Tidal Flooding with IL2070	3.62
Compound Flooding – 100-year, 24-hour + Future King Tidal Flooding with IL2070	5.62

RAINFALL-INDUCED FLOODING

Rainfall-induced flooding maps were generated using rapid inundation modeling. This technology works by routing water over the terrain for the duration of a specified storm event using a set of rules based on water level response to topography and existing water levels. This analysis did not consider stormwater infrastructure (i.e., pipes) or infiltration and because of this, results as presented may be overstated. It is important to note that while all models used in this analysis show the extents of inundation due to low elevation, the rapid inundation model also identifies area where standing water may occur due to *relatively* low elevation (areas bounded by ridges) in a given region.

The 100-year,24-hour and 500-year,24-hour-rainfall events were modelled to evaluate potential rainfall-induced flooding within the study area. This analysis was based on data collected from the NOAA Atlas 14 tool and is consistent with guidelines set forth in s. 380.093 F.S. for this evaluation. **Table 8** shows the rainfall data used to generate the flood extents of the rainfall scenarios.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 8: RAINFALL-INDUCED FLOODING EVENTS

Rainfall Event	Rainfall Depth (in)
100-year, 24-hour	15.4
500-year, 24-hour	21.1

Within the results of the rainfall-induced flooding scenarios, the following areas experienced higher flood depths due to being at the lowest elevation relative to their surroundings:

- Northwest region of the Town, including some residential streets, Mimi's Learning Center, and The Peninsula Assisted Living & Memory Care
- Northeastern region of the Town, east South Park Road
- Region around Desoto Lakes and neighboring residential properties and roadways

Figure 5 shows the extents of flooding in the 500-year, 24-hour storm event.

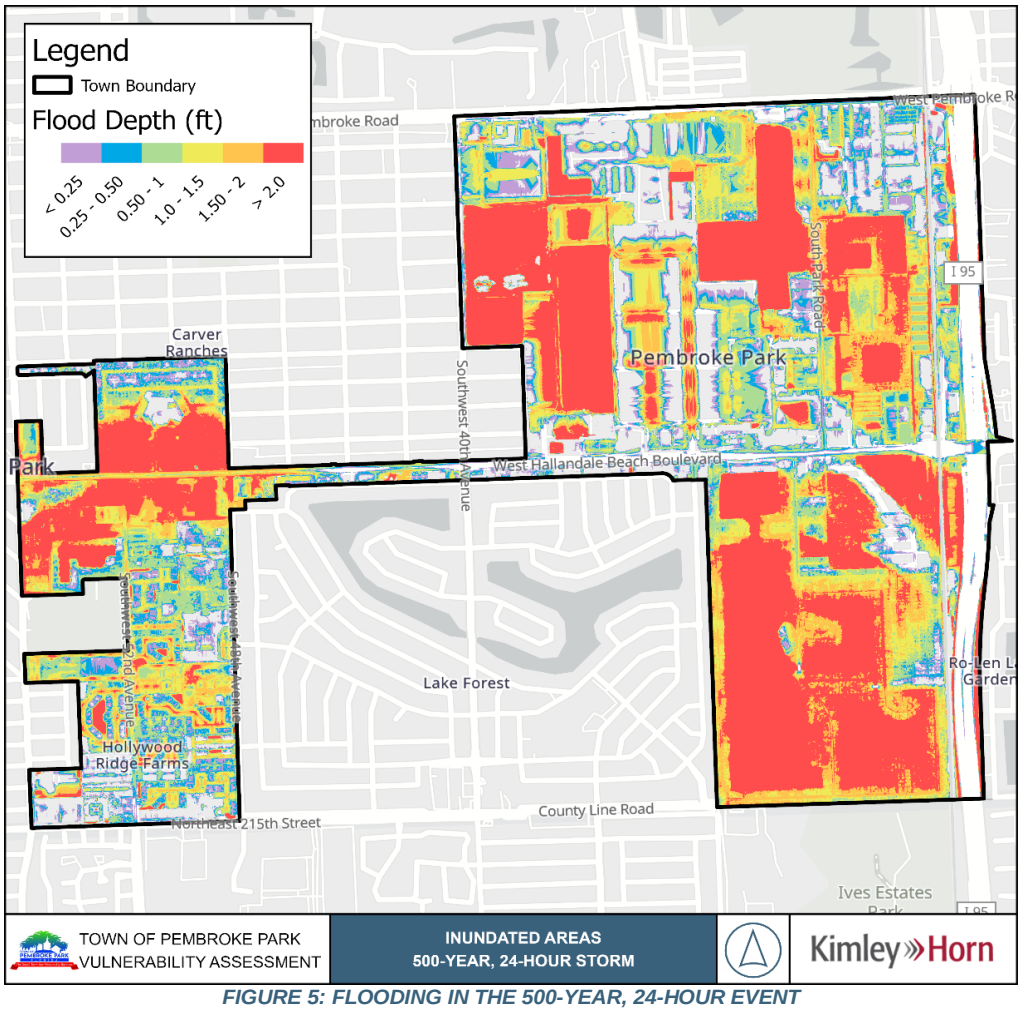


FIGURE 5: FLOODING IN THE 500-YEAR, 24-HOUR EVENT

In the rainfall-induced scenarios, all critical assets experience Low to High Flood Exposure. In the 100-year and 500-year, 24-hour storm event, all parks and surface waters in the Town were exposed to

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

flooding, a low percentage of community and emergency facilities experienced flooding, and a medium percentage of critical infrastructure were impacted. A medium and high percentage of transportation assets and evacuation routes were exposed to rainfall-induced flooding in the 100-year and 500-year, 24-hour storm event, respectively. Please refer to **Table 10-Table 13 and APPENDIX D** for the results of the exposure analysis as it relates to critical assets.

Projected Rainfall-Induced Flooding with SLR

Projected rainfall-induced flooding inundation extents were evaluated using data collected for the 100- and 500-year, 24-hour Rainfall and SLR scenarios. Results of the projected rainfall flooding indicate significant flooding within the municipal boundary throughout the whole Town, with highest flooding being on the eastern side of the Town's area. The regions of Pembroke Park impacted by the projected rainfall and SLR scenarios are similar to the current rainfall scenarios with increased flood depths. More specifically, the areas impacted by both compound rainfall and SLR can be described as

- Northeast region between W Hallandale Beach Blvd and north limits of Town
- Southeast region of Town including Desoto Lakes and major roadways
- Western region of Town including W Hallandale Beach Blvd, public schools, major roadways, and affordable public housing

Flooding may not occur in these areas if appropriate stormwater infrastructure exists to properly route the water away from these areas.

Figure 6 shows the extents of the projected 100-year, 24-hour rainfall, and Intermediate-High 2040 flooding scenario.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

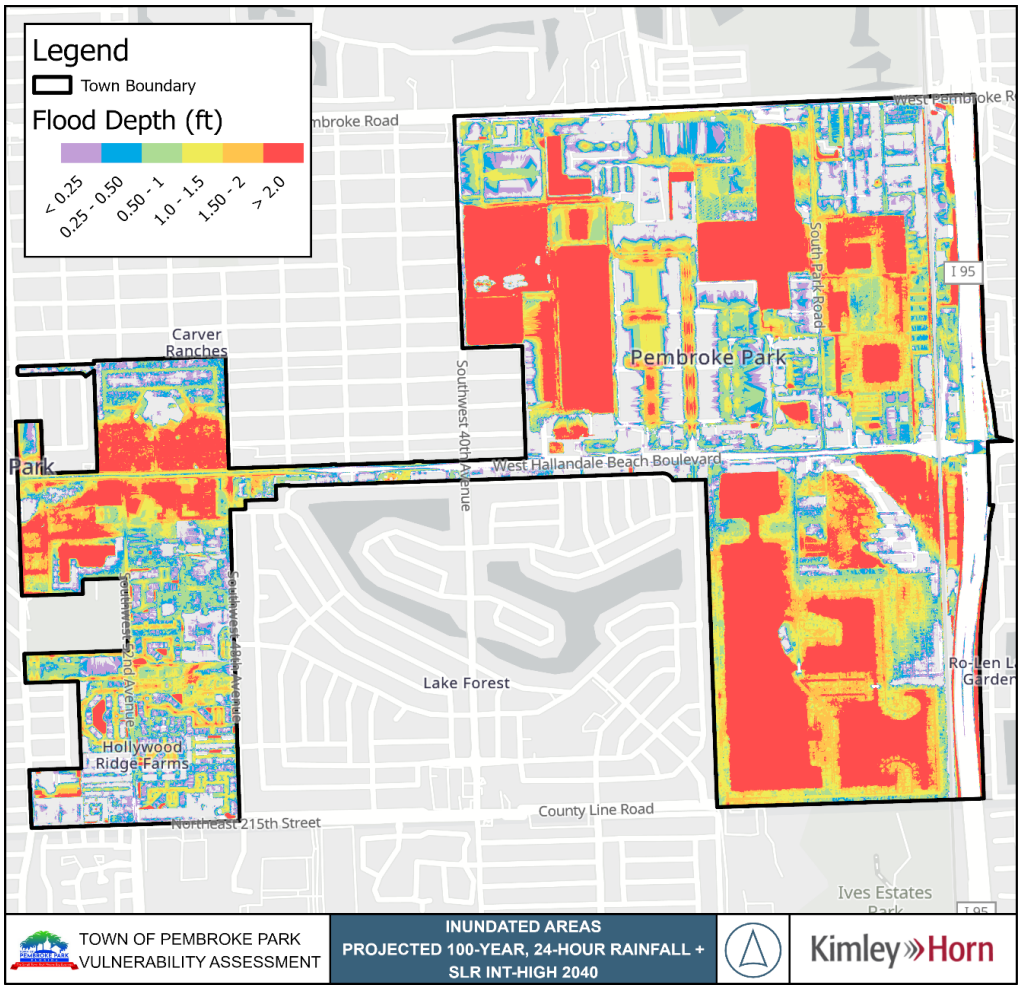


FIGURE 6: FLOODING IN THE FUTURE RAINFALL / INT-HIGH 2040 COMPOUND SCENARIO

In the compound scenarios of rainfall and sea level rise, all critical community and emergency facilities were found to be resilient. A low to medium percentage of transportation assets and natural, cultural, and historical assets were found to be exposed in all compound rainfall and SLR flooding scenarios, with the exception of the Intermediate-High 2070 scenario which found a high percentage of natural, cultural, and historical exposed. For detailed critical asset exposure of each compound scenario, refer to **Table 10-Table 13 and APPENDIX D**.

TIDAL FLOODING

Tidal inundation extents were generated using a bathtub modelling technique. This analysis did not consider stormwater infrastructure (i.e., pipes) or infiltration and because of this, results as presented may be overstated.

The results of the current tidal flooding evaluations show that there are limited tidal flooding impacts to the Town as seen in **Figure 7**. All transportation assets and evacuation routes, critical infrastructure,

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

and critical community and emergency facilities were found to be resilient to current tidal flooding conditions. A majority of parks and surface waters were exposed in current tidal conditions.

Refer to **Table 10-Table 13 and APPENDIX D** for results as it relates to critical assets.

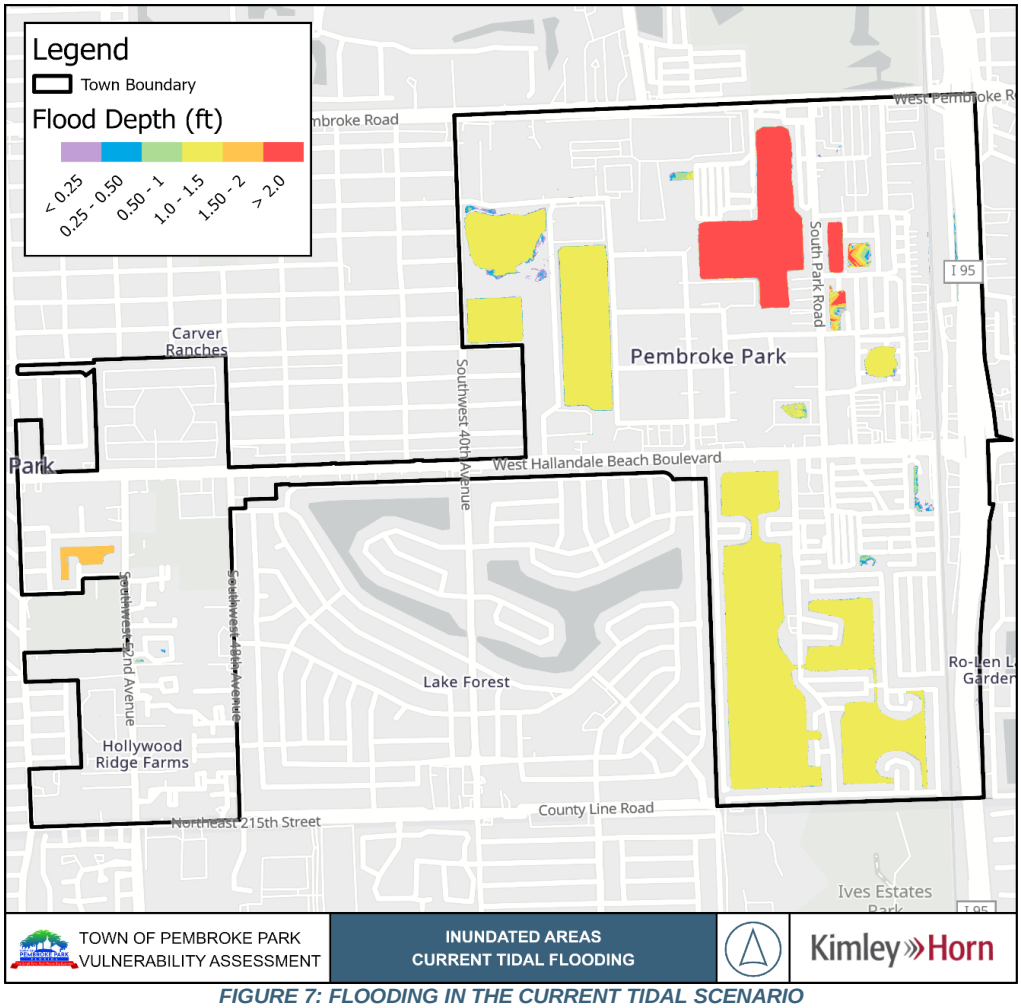


FIGURE 7: FLOODING IN THE CURRENT TIDAL SCENARIO

Future King Tidal Flooding

Results of the future high tide flooding analysis indicate moderate flooding within the municipal boundary in localized areas. The regions of Pembroke Park impacted by future tidal flooding are similar to the current tidal flooding scenario and include:

- Areas surrounding all surface waters
- Northeast region of Town including surface waters, segments of major roadways, and pump stations

Figure 8 shows the future tidal flooding extents for the Intermediate-High 2070 SLR scenario.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

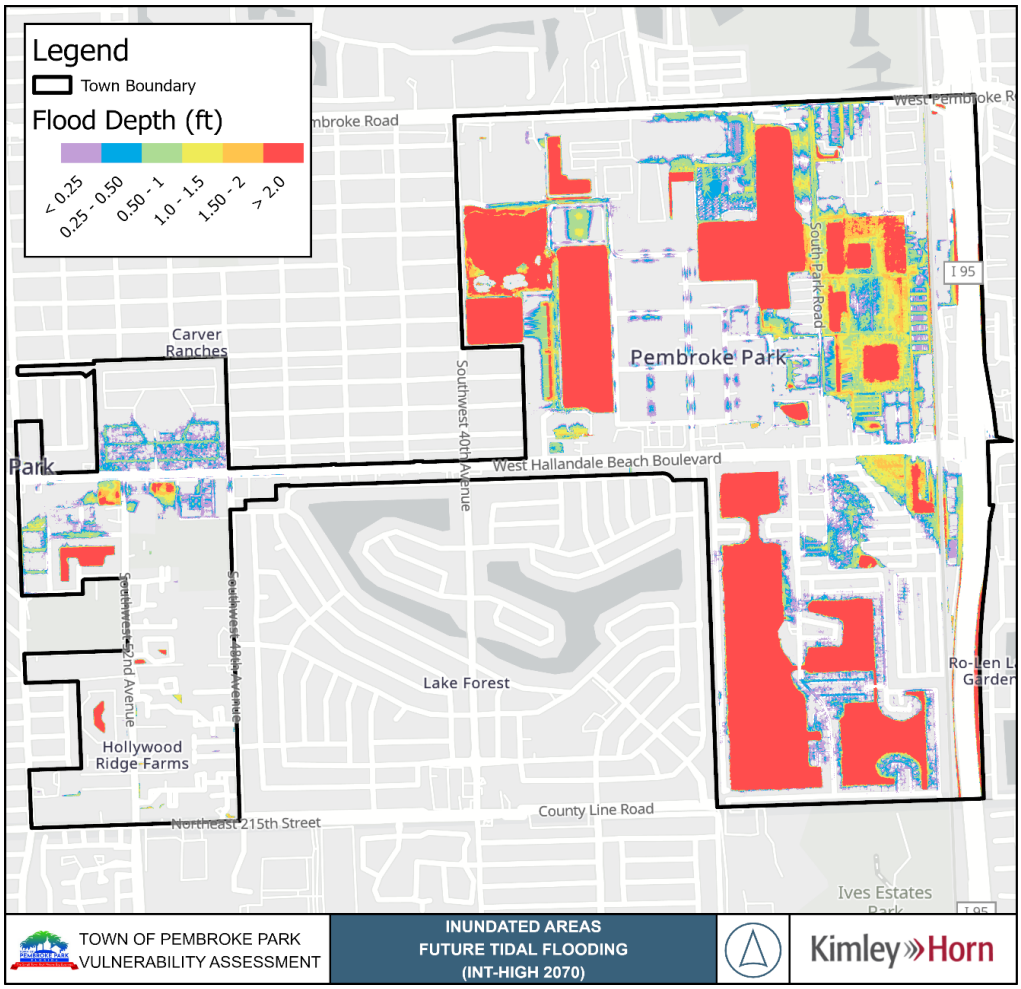


FIGURE 8: FLOODING IN THE FUTURE HIGH TIDE INT-HIGH 2070 SCENARIO

In almost all future tidal scenarios, all critical community and emergency facilities experienced zero exposure, the exception being the Intermediate-High 2070 event where a medium percentage of assets were exposed. A range of low to high percentage of transportation, natural, and critical infrastructure assets were exposed in all projected tidal scenarios as a result of proximity to surface waters and localized topography. For a detailed exposure percentage by critical asset type, refer to **Table 10-Table 13 and APPENDIX D**.

STORM SURGE FLOODING

Current storm surge inundation extents were generated using a bathtub modelling technique. The analysis did not consider stormwater infrastructure (i.e., pipes) or infiltration and because of this, results as presented may be overstated. It should be noted that storm surge modelling for this analysis did not include wave propagation or wind speeds.

Results of the current storm surge scenario show flooding in the following areas and can be also seen in **Figure 9.**

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

- All areas surrounding surface waters of which include pump stations
- Patrick Behan Park and Howard Clark Sr. Linear Trail
- Surrounding areas of Desoto Lakes
- Northwest region of Town including Mimi's Learning Center, W Hallandale Beach Blvd, and Town Hall

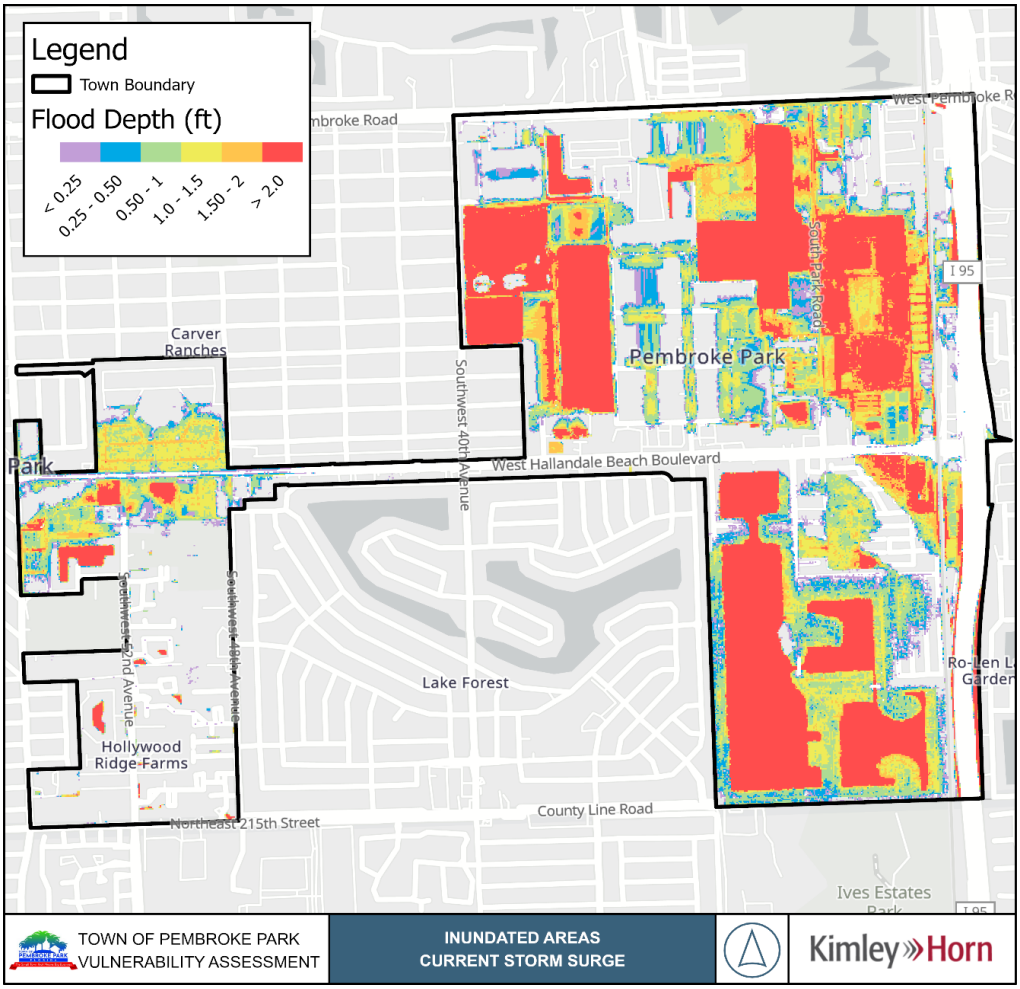


FIGURE 9: FLOODING IN THE CURRENT STORM SURGE SCENARIO

In the current storm surge scenario, a medium percentage of critical infrastructure and critical community and emergency facilities are impacted. Additionally, a high percentage of transportation assets and evacuation routes and natural assets are impacted in flooding resulted from current storm surge conditions. Refer to **Table 10-Table 13 and APPENDIX D** for the results of the exposure analysis as it relates to critical assets.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

Future Storm Surge Flooding

Results of future storm scenarios show increased flood extents and more severe flood depths within the Town. The surface water ponds and the areas surrounding them, experience the most flooding. In the IH 2070 scenario, almost all the Town is inundated with at least 0.3-feet of water.

Figure 10 shows the extents of future storm surge flooding in the Intermediate-High 2070 SLR scenario.

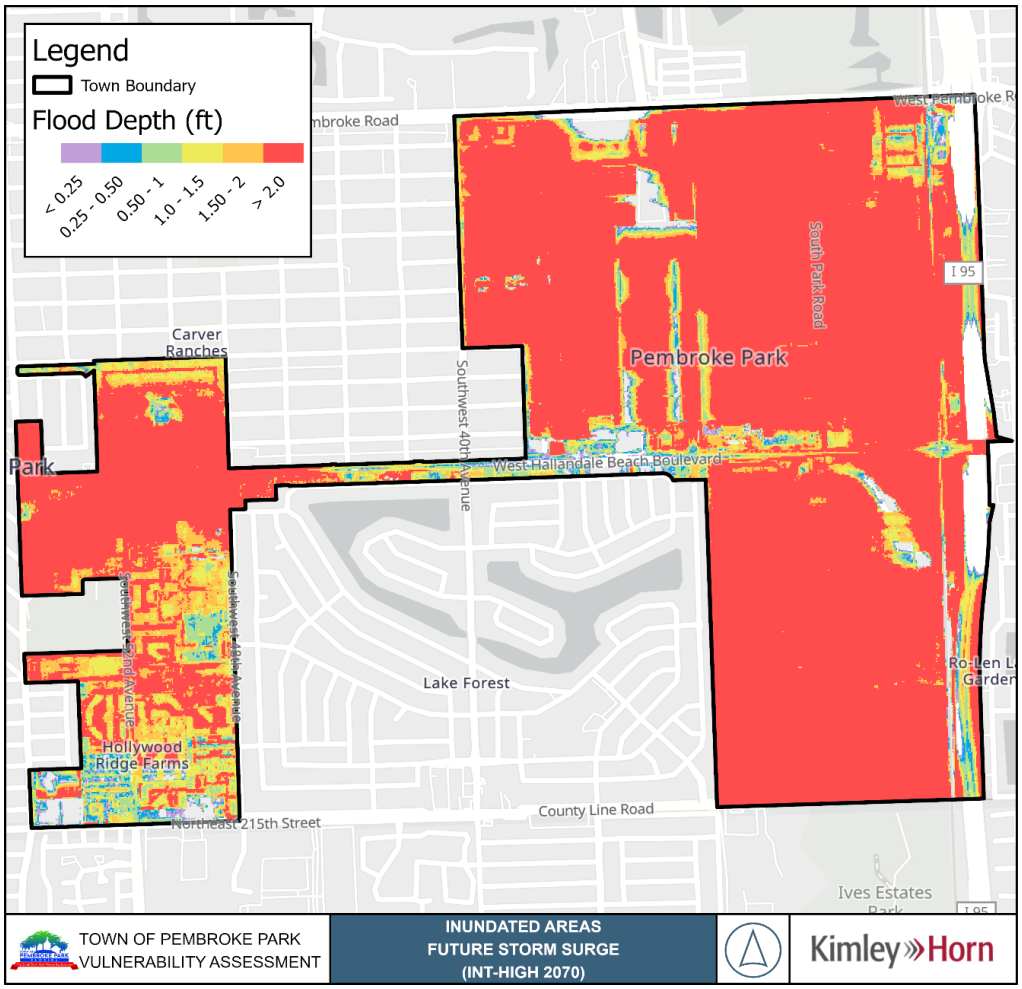


FIGURE 10: FLOODING IN THE FUTURE STORM SURGE INT-HIGH 2070 SCENARIO

In most of all projected storm surge scenarios, critical community and emergency facilities were found to be resilient and received no flood exposure, the exception is the Intermediate-High 2070 scenario where there were a medium percentage exposed. In the projected compound storm surge scenarios, a range of low to medium percentage of transportation assets and critical infrastructure were found to be exposed. Lastly, a high percentage of natural, cultural, and historical assets were exposed in all compound storm surge scenarios. For a detailed breakdown of exposure by asset type, refer to **Table 10-Table 13 and APPENDIX D**.


This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

Compound Flooding Scenarios

Compound flooding inundation extents were evaluated using data collected for the 100-year/24-hour Rainfall and King Tide scenarios in current conditions and projected conditions with SLR. Compound flooding extents were generated using bathtub modelling hybrid bathtub techniques. The assessment does not consider the potential for storm intensification due to climate change.

King Tides and 100-Year, 24-Hour Flooding

Results of the compound flooding indicate significant flooding within the municipal boundary throughout the whole town, with highest flooding being on the road centerlines and adjacent neighborhoods. The regions of Miami Lakes impacted by the compound rainfall and king scenarios are similar to the current rainfall scenarios with increased flood depths. The areas impacted by both rainfall and SLR, include almost the entire area of the Town's area. Flooding may not occur in these areas if appropriate stormwater infrastructure exists to properly route the water away from these areas.

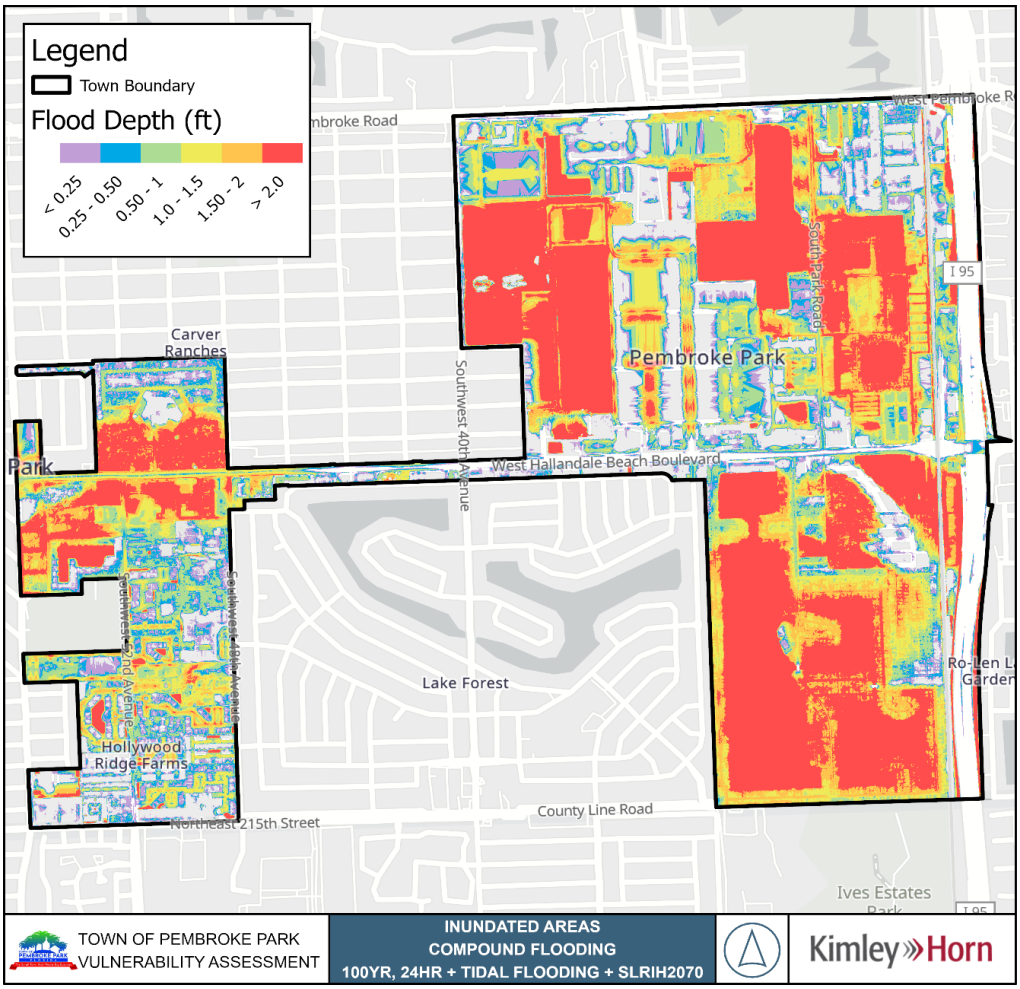

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

FIGURE 11: FLOODING IN THE COMPOUND SCENARIO OF 100-YEAR, 24-HOUR STORM WITH FUTURE KING-TIDE CONDITIONS - INT-HIGH 2070 SCENARIO

SUMMARY TABLES

To assess the extent of flooding by asset type in each scenario, the following criteria was used:

TABLE 9. EXPOSURE ANALYSIS LEGEND

Flood Exposure	Criteria
No Risk	No critical assets impacted
Low	25% or less of critical assets impacted
Medium	Between 25% and 75% of critical assets impacted
High	More than 75% of critical assets impacted

The results of the exposure analysis have been summarized by the percentage each storm impacts each asset class in **Table 10-13.**

TABLE 10: TRANSPORTATION ASSETS AND EVACUATION ROUTES IMPACTED BY SCENARIOS

Asset Class	Asset Owner (s)	Scenario	Percent of Total Assets Impacted
Transportation Assets and Evacuation Routes	Town of Pembroke Park and FDOT	100YR,24HR	93.3%
		Projected Rainfall – 100YR, 24HR + SLRIL2040	93.3%
		Projected Rainfall – 100YR, 24HR + SLRIH2040	93.3%
		Projected Rainfall – 100YR, 24HR + SLRIL2070	93.3%
		Projected Rainfall – 100YR, 24HR + SLRIH2070	93.3%
		500YR,24HR	93.3%
		Projected Rainfall – 500YR, 24HR + SLRIL2040	93.3%
		Projected Rainfall – 500YR, 24HR + SLRIH2040	93.3%
		Projected Rainfall – 500YR, 24HR + SLRIL2070	93.3%
		Projected Rainfall – 500YR, 24HR + SLRIH2070	93.3%
		Current King Tide Conditions	0.0%
		Future King Tidal (IL2040)	0.0%
		Future King Tidal (IH2040)	6.7%
		Future King Tidal (IL2070)	33.3%
		Future King Tidal (IH2070)	86.7%
		Current Storm Surge	93.3%
		Storm Surge with SLRIL2040	93.3%
		Storm Surge with SLRIH2040	93.3%
		Storm Surge with SLRIL2070	93.3%
		Storm Surge with SLRIH2070	93.3%
		Compound Flooding – 100YR, 24HR + Current King Tide	93.3%
		Compound Flooding – 100YR, 24HR + King Tide IL2040	93.3%
		Compound Flooding – 100YR, 24HR + King Tide IH2040	93.3%
		Compound Flooding – 100YR, 24HR + King Tide IL2070	93.3%
		Compound Flooding – 100YR, 24HR + King Tide IH2070	93.3%

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 11: CRITICAL INFRASTRUCTURE ASSETS IMPACTED BY SCENARIOS

Asset Class	Asset Owner (s)	Scenario	Percent of Total Assets Impacted
Critical Infrastructure	Town of Pembroke Park	100YR,24HR	90.9%
		Projected Rainfall – 100YR, 24HR + SLRIL2040	90.9%
		Projected Rainfall – 100YR, 24HR + SLRIH2040	90.9%
		Projected Rainfall – 100YR, 24HR + SLRIL2070	90.9%
		Projected Rainfall – 100YR, 24HR + SLRIH2070	90.9%
		500YR,24HR	90.9%
		Projected Rainfall – 500YR, 24HR + SLRIL2040	90.9%
		Projected Rainfall – 500YR, 24HR + SLRIH2040	90.9%
		Projected Rainfall – 500YR, 24HR + SLRIL2070	90.9%
		Projected Rainfall – 500YR, 24HR + SLRIH2070	90.9%
		Current King Tide Conditions	0.0%
		Future King Tidal (IL2040)	0.0%
		Future King Tidal (IH2040)	0.0%
		Future King Tidal (IL2070)	0.0%
		Future King Tidal (IH2070)	3.1%
		Current Storm Surge	4.7%
		Storm Surge with SLRIL2040	14.1%
		Storm Surge with SLRIH2040	50.0%
		Storm Surge with SLRIL2070	40.6%
		Storm Surge with SLRIH2070	100.0%
		Compound Flooding – 100YR, 24HR + Current King Tide	90.9%
		Compound Flooding – 100YR, 24HR + King Tide IL2040	90.9%
		Compound Flooding – 100YR, 24HR + King Tide IH2040	90.9%
		Compound Flooding – 100YR, 24HR + King Tide IL2070	90.9%
		Compound Flooding – 100YR, 24HR + King Tide IH2070	90.9%

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 12: CRITICAL COMMUNITY AND EMERGENCY FACILITIES ASSETS IMPACTED BY SCENARIOS

Asset Class	Asset Owner (s)	Scenario	Percent of Total Assets Impacted
Critical Community and Emergency Facilities	Town of Pembroke Park	100YR,24HR	96.9%
		Projected Rainfall – 100YR, 24HR + SLRIL2040	96.9%
		Projected Rainfall – 100YR, 24HR + SLRIH2040	96.9%
		Projected Rainfall – 100YR, 24HR + SLRIL2070	96.9%
		Projected Rainfall – 100YR, 24HR + SLRIH2070	96.9%
		500YR,24HR	96.9%
		Projected Rainfall – 500YR, 24HR + SLRIL2040	96.9%
		Projected Rainfall – 500YR, 24HR + SLRIH2040	96.9%
		Projected Rainfall – 500YR, 24HR + SLRIL2070	96.9%
		Projected Rainfall – 500YR, 24HR + SLRIH2070	96.9%
		Current King Tide Conditions	0.0%
		Future King Tidal (IL2040)	0.0%
		Future King Tidal (IH2040)	0.0%
		Future King Tidal (IL2070)	0.0%
		Future King Tidal (IH2070)	3.1%
		Current Storm Surge	4.7%
		Storm Surge with SLRIL2040	14.1%
		Storm Surge with SLRIH2040	50.0%
		Storm Surge with SLRIL2070	40.6%
		Storm Surge with SLRIH2070	100.0%
		Compound Flooding – 100YR, 24HR + Current King Tide	96.9%
		Compound Flooding – 100YR, 24HR + King Tide IL2040	96.9%
		Compound Flooding – 100YR, 24HR + King Tide IH2040	96.9%
		Compound Flooding – 100YR, 24HR + King Tide IL2070	96.9%
		Compound Flooding – 100YR, 24HR + King Tide IH2070	96.9%

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 13: NATURAL, CULTURAL, AND HISTORICAL ASSETS IMPACTED BY SCENARIOS

Asset Class	Asset Owner (s)	Scenario	Percent of Total Assets Impacted by Type
Natural, Cultural, and Historical Assets	Town of Pembroke Park	100YR,24HR	100%
		Projected Rainfall – 100YR, 24HR + SLRIL2040	100%
		Projected Rainfall – 100YR, 24HR + SLRIH2040	100%
		Projected Rainfall – 100YR, 24HR + SLRIL2070	100%
		Projected Rainfall – 100YR, 24HR + SLRIH2070	100%
		500YR,24HR	100%
		Projected Rainfall – 500YR, 24HR + SLRIL2040	100%
		Projected Rainfall – 500YR, 24HR + SLRIH2040	100%
		Projected Rainfall – 500YR, 24HR + SLRIL2070	100%
		Projected Rainfall – 500YR, 24HR + SLRIH2070	100%
		Current King Tide Conditions	78.9%
		Future King Tidal (IL2040)	84.2%
		Future King Tidal (IH2040)	89.5%
		Future King Tidal (IL2070)	89.5%
		Future King Tidal (IH2070)	89.5%
		Current Storm Surge	94.7%
		Storm Surge with SLRIL2040	100%
		Storm Surge with SLRIH2040	100%
		Storm Surge with SLRIL2070	100%
		Storm Surge with SLRIH2070	100%
		Compound Flooding – 100YR, 24HR + Current King Tide	100%
		Compound Flooding – 100YR, 24HR + King Tide IL2040	100%
		Compound Flooding – 100YR, 24HR + King Tide IH2040	100%
		Compound Flooding – 100YR, 24HR + King Tide IL2070	100%
		Compound Flooding – 100YR, 24HR + King Tide IH2070	100%

The spatial extent of all flooding scenarios analyzed are in **APPENDIX D.**

TASK 5 – SENSITIVITY ANALYSIS

A sensitivity analysis was performed to assess the risk posed to each critical asset and rank their vulnerability due to flooding from each of the various storm scenarios that were modelled in the exposure analysis. This section of the vulnerability assessment builds on the previously completed exposure analysis in which flood extents for each scenario were generated for the Town. The following sections outline the methodology used to perform the sensitivity analysis for the Town of Pembroke Park.

METHODOLOGY

Defining Critical Elevation

Critical assets evaluated in vulnerability assessments funded by the Resilient Coastlines Grant Program are prescribed within s. 380.093, F.S. and are subdivided into four (4) categories including:

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

- Transportation Assets and Evacuation Routes
- Critical Infrastructure
- Critical Community and Emergency Facilities
- Natural, Cultural, and Historical Resources

The following sections further define asset types within these categories, outline the assets found within the Town, and indicate the data source used to identify location and critical elevation of each asset in this vulnerability assessment.

The critical elevation of an asset is this study was defined as the elevation at which floodwater would disrupt service of the structure. The structures analyzed in this project are unique with regard to level of service; this resulted in varied definitions of critical elevation for each asset class.

Three different methods were used to define critical elevation in this study including:

1. Finished Floor Elevation (FFE) – Data was pulled directly from the as-builts or other survey documentation, such as GIS attribute tables provided by the Town. This method was preferred, when available. Any additional assumptions made using the FFE method are defined when used in the following sections of this report.
2. Cut Profile – Method in which a line feature was used to cut a profile from the DEM and determine lowest elevation along the feature. This method was used for major roadways and rail tracks.
3. Zonal Statistics – Method in which the footprint of an asset was defined and the minimum elevation from the DEM within the footprint was extracted. For any finished structure, the slab-on-grade elevation was assumed to be minimum DEM elevation plus 1-foot.
4. Percent Inundation by Area – Method in which the total area and the total flooded area of an asset are compared to determine the amount of flooding impacting the asset. Results are reported as a percent area.

Assigning Risk Sensitivity

Critical elevations for each asset were evaluated against flood depths to identify asset vulnerability in each storm event. The degree of flooding was defined by the inundation depth relative to the critical elevation of storm event. The degree of flooding was defined by the inundation depth relative to the critical elevation of the structure. For structures with less concretely defined critical elevation (parks, roads, etc.), flood impacts were evaluated using unique methodology described on a case-by-case basis in the following sections.

The final phase of the analysis was to assign a risk level, or criticality, to each asset in the paired asset-threat matrices. Critical assets were grouped into paired asset-threat matrices for each scenario and a degree of criticality was assigned. Within this analysis, risk considerations were made for the direct impacts of flooding to the asset and the more general operational impacts on the community. For the purposes of this vulnerability assessment, criticality was defined as follows:

- **Low -** flooding occurs but would cause minimum impact; asset is able to function during or after the event.
- **Medium -** flooding would cause moderate impact; asset may have limited or impaired function during or after flooding event; repairs may be needed.
- **High -** flooding would cause complete asset loss; complete shutdown of operation is likely to occur with high cost associated with repair or replacement; potential impact to health and safety.

Paired asset-threat matrices for all critical assets reviewed in the sensitivity analysis can be found in **APPENDIX E and APPENDIX F**.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

The following sections outline the methodology and results of this analysis, broken down by asset group.

TRANSPORTATION AND EVACUATION ROUTES

Per s. 380.093, F.S. (2)(a) 1., Transportation and Evacuation Routes shall include airports, bridges, bus terminals, ports, major roadways, marinas, rail facilities, and railroad bridges owned and/or maintained emergency response.

All major roads and bridges in the project area were evaluated using data from the Broward County and Pembroke Park GIS Data Hub. Additional information from the same source was used to identify primary evacuation routes to refine major roads for analysis and define road and bridge centerlines.

The data collected for critical assets defined as "Transportation Assets and Evacuation Routes" per s. 380.093(2)(a), F.S. are outlined in **Table 14.**

TABLE 14: TRANSPORTATION ASSETS AND EVACUATION ROUTES

Asset Type	Source	Critical Elevation Method
Airports	N/A	N/A
Bridges	N/A	N/A
Bus Terminals	N/A	N/A
Ports	N/A	N/A
Major Roadways	Town of Pembroke Park	Cut Profile
Marinas	N/A	N/A
Rail Facilities	ArcGIS Enterprise	Cut Profile
Railroad Bridges	N/A	N/A

Major Roads

Major roads were evaluated using a cut profile method in which road centerlines were used to identify the elevation at stations along the route as it passes through the Town. A uniform cross-section across the road centerline was assumed. It should be noted that all overpass elevations were previously processed out of the DEM, creating voids in the road elevation data. Unless otherwise noted, it is assumed flooding of these roads does not occur at the locations. Critical elevations for all critical infrastructure in Pembroke Park are reported in **Table 15.**

TABLE 15: CRITICAL ELEVATIONS FOR MAJOR ROADS

Asset Name	Asset Class	Critical Elevation (NAVD88, ft)
I-95 Ramp	Major Road	5.5
S Park Road	Major Road	4.2
I-95	Major Road	9.0
SW 20th Street	Major Road	5.0
W Lake Drive	Major Road	5.2
Lake Shore Drive	Major Road	5.0
SW 30th Avenue	Major Road	3.9
John P Lyons Lane	Major Road	3.5
SW 32nd Avenue	Major Road	5.3
SW 34th Avenue	Major Road	4.9
SW 32nd Terrace	Major Road	5.1
SW 22nd Street	Major Road	5.4
SW 52nd Avenue	Major Road	5.5
Hallandale Beach Boulevard	Major Road	6.7

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

Criticality for major roads considered the following factors in assigning risk:

- Rainfall flooding is temporary – likelihood of complete asset loss is unlikely.
- Any flood depths greater than 0.5-feet would incur limited function of the road during and after the event.
- SLR flooding would cause permanent inundation and would therefore render the road asset a complete loss.
- Saltwater corrosion and significant wave action caused by storm surge may require evaluation following a storm event.

Rail Facilities

Rail facilities were evaluated using the cut-profile method using the rail track centerlines to identify the elevation at stations along the track as it bisects the Town on the east. A uniform cross-section across the track centerline was assumed.

TABLE 16: CRITICAL ELEVATIONS FOR RAIL FACILITIES

Asset Name	Asset Class	Critical Elevation (NAVD88, ft)
Amtrak & Commuter Track	Rail Facility	7.1

Criticality for rail tracks considered the following factors in assigning risk:

- Rainfall flooding is temporary – likelihood of complete asset loss is unlikely.
- Any flood depths greater than 0.5-feet would incur limited function of the rail track during and after the event.
- SLR flooding would cause permanent inundation and would therefore render the rail track asset a complete loss.
- Saltwater corrosion and significant wave action caused by storm surge may require evaluation following a storm event.

CRITICAL INFRASTRUCTURE

Per s. 380.093, F.S. (2)(a) 2., Critical Infrastructure shall include wastewater treatment facilities and lift stations, stormwater treatment facilities and pump stations, drinking water facilities, water utility conveyance systems, electric production and supply facilities, solid and hazardous waste facilities, military installations, communications facilities, and disaster debris management sites owned and/or maintained by the Town.

There were no wastewater treatment facilities, stormwater treatment facilities, drinking water facilities, water utility conveyance systems, electric production and supply facilities, or military installations located within the Town of Pembroke Park jurisdiction.

Stormwater Pump Stations, Communications Facilities, and Disaster Debris Management Sites were identified as Critical Infrastructure assets within the Town of Pembroke Park.

The data collected on critical assets defined as “Critical Infrastructure” per s. 380.093(2)(a), F.S. are outlined in **Table 17.**

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 17: CRITICAL INFRASTRUCTURE

Asset Type	Source	Critical Elevation Method
Wastewater Treatment Facilities	N/A	N/A
Wastewater Lift Stations	N/A	N/A
Stormwater Treatment Facilities (Stormwater Pump Stations)	Town of Pembroke Park	Zonal Statistics
Stormwater Treatment Facilities (Injection Wells)	N/A	N/A
Stormwater Treatment Facilities (Pollution Control Boxes)	N/A	N/A
Drinking Water Facilities	N/A	N/A
Drinking Water Pump Stations	N/A	N/A
Water Utility Conveyance Systems (Water Mains)	N/A	N/A
Electric Productions and Supply Facilities	N/A	N/A
Military Installations	N/A	N/A
Communications Facilities	Town of Pembroke Park	Zonal Statistics
Disaster Debris Management Sites	Broward County	Zonal Statistics

Stormwater Pump Stations

Critical elevations for stormwater pump stations were determined using the Zonal Statistics tool to extract the lowest elevation around the structure from the DEM and adding 1-foot. The reported value was assumed to be in the critical elevation for these structures and the assumed elevation at which flooding of the system and loss of functionality occurs.

Critical elevations for all critical infrastructure in Pembroke Park are reported in **Table 18**.

TABLE 18: CRITICAL ELEVATIONS OF STORMWATER PUMP STATIONS

Asset Name	Asset Class	Critical Elevation (NAVD88, ft)
Pump 1	Pump Station	5.3
Pump 2	Pump Station	4.1
Pump 3	Pump Station	2.5
Pump 4	Pump Station	5.1
Pump 5	Pump Station	4.2

Criticality for stormwater pump stations considered the following factors in assigning risk:

- Rainfall flooding is temporary – likelihood of complete asset loss is unlikely but may affect the functionality of the structures during and following the event.
- Structure flooding is estimated when flood waters are at rim elevation.
- SLR flooding would cause permanent inundation and would therefore render the asset a complete loss.
- Saltwater infiltration and significant wave action caused by storm surge will require evaluation following a storm event.

Communication Facilities

Critical elevations for communication facilities were determined using the Zonal Statistics tool to extract the lowest elevation around the facility from the DEM and adding 1-foot. The reported value was

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

assumed to be in the critical elevation for these structures and the assumed elevation at which flooding of the system and loss of functionality occurs.

Critical elevations for all communication facilities within the Town are reported in **Table 19.**

TABLE 19: CRITICAL ELEVATIONS OF COMMUNICATION FACILITIES

Asset Name	Asset Class	Critical Elevation (NAVD88, ft)
Trinity Broadcasting- Miami	Communication Facilities	4.8
WHFT TV Transmitter Tower	Communication Facilities	6.0
Local 10	Communication Facilities	10.5
Wimp TV UHF Channel 25	Communication Facilities	10.4
Dale Village	Communication Facilities	8.4

Criticality for communication facilities considered the following factors in assigning risk:

- Any flooding greater than 0.5-feet would likely incur damage, accessibility concerns, and limited function of the facility during and after the event.
- SLR flooding would cause permanent inundation and would therefore render the asset a complete loss.
- Saltwater corrosion and significant wave action caused by storm surge will require evaluation following a storm event.

Disaster Debris Management Site

Critical elevations for the disaster debris management site within the Town was determined using the Zonal Statistics tool to extract the lowest elevation around the facility from the DEM and adding 1-foot. The reported value was assumed to be in the critical elevation for the structure and the assumed elevation at which flooding of the system and loss of functionality occurs.

The critical elevation of the disaster debris management site within the Town is reported in **Table 20***TABLE 19***.**

TABLE 20: CRITICAL ELEVATIONS OF DISASTER DEBRIS MANAGEMENT SITE

Asset Name	Asset Class	Critical Elevation (NAVD88, ft)
Utility – Solid Waste Transfer Station, Pembroke Park Recycling Center	Disaster Debris Management Site	8.4

Criticality for the disaster debris management site considered the following factors in assigning risk:

- Any flooding greater than 0.5-feet would likely incur damage, accessibility concerns, and limited function of the facility during and after the event.
- SLR flooding would cause permanent inundation and would therefore render the asset a complete loss.
- Saltwater corrosion and significant wave action caused by storm surge will require evaluation following a storm event.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.
November 2024

CRITICAL COMMUNITY AND EMERGENCY FACILITIES

Per s. 380.093, F.S. (2)(a) 3., Critical Community and Emergency Facilities shall include schools, colleges, universities, community centers, correctional facilities, disaster recovery centers, emergency medical service facilities, emergency operation centers, fire stations, health care facilities, hospitals, law enforcement facilities, local government facilities, logical staging areas, affordable public housing, risk shelter inventory, and state government facilities owned and/or maintained by the Town.

There were no colleges, universities, correctional facilities, logistical staging areas, fire stations, hospitals, risk shelter inventory, and state government facilities located within the Town of Pembroke Park.

The data collected on critical assets defined as "Critical Community and Emergency Facilities" per s. 380.093(2)(a), F.S. are outlined in **Table 21.**

TABLE 21: CRITICAL COMMUNITY AND EMERGENCY FACILITIES

Asset Type	Source	Critical Elevation Method
Schools	Town of Pembroke Park	Zonal Statistics
Colleges	N/A	N/A
Universities	N/A	N/A
Community Centers	N/A	N/A
Correctional Facilities	N/A	N/A
Disaster Recovery Centers	Broward County	Zonal Statistics
Emergency Medical Service Facilities	N/A	N/A
Emergency Operation Centers	N/A	N/A
Fire Stations	N/A	N/A
Health Care Facilities	Town of Pembroke Park	Zonal Statistics
Hospitals	N/A	N/A
Law Enforcement Facilities	Town of Pembroke Park	Zonal Statistics
Local Government Facilities	Town of Pembroke Park	Zonal Statistics
Logistical Staging Areas	N/A	N/A
Affordable Public Housing	Broward County	As-Builts & Zonal Statistics
Risk Shelter Inventory	N/A	N/A
State Government Facilities	N/A	N/A

The FFE was identified as the critical elevation at which buildings would be considered vulnerable to flooding. Critical elevation for all Town facilities with unreported FFEs were determined using the Zonal Statistics tool to extract the lowest elevation within the building footprint. This value was assumed to be at grade and 1-foot was added to define the slab-on-grade elevation used to determine asset risk.

Critical elevations for all critical community and emergency facilities in Pembroke Park are reported in **Table 22.** Values marked with an (*) indicated elevations were pulled from existing survey or as-built data.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 22: CRITICAL ELEVATIONS OF COMMUNITY AND EMERGENCY FACILITIES

Asset Name	Asset Class	Critical Elevation (NAVD88, ft)	Source
Pembroke Gardens Apartments (includes 10 facilities)	Affordable Public Housing	9.2*	As-Built Survey (1998)
Pembroke Park Apartments (includes 12 facilities)	Affordable Public Housing	8.9 – 9.9*	As-Built Survey (1998)
Pembroke Villas (includes 13 facilities)	Affordable Public Housing	9.4*	As-Built Survey (2001)
The Peninsula Assisted Living & Memory Care	Health Care Facility	5.4	Zonal Statistics
Plaza of Hallandale Beach Assisted Living	Health Care Facility	8.0	
Watkins Elementary	School	9.0*	As-Built Survey (1996)
Lake Forest Elementary School	School	8.0*	As-Built Survey (2002)
Mimi's Learning Center	School	6.1	Zonal Statistics
Pembroke Park Montessori School	School	8.5	
ST2589	Law Enforcement Facility	9.4	
Government - Town Hall	Local Government Facility	8.2	

Criticality for Town buildings and facilities considered the following factors in assigning low, medium, or high risk:

- Any flooding greater than 0.5-feet would likely incur damage, accessibility concerns, and limited function of the facility during and after the event.
- SLR flooding would cause permanent inundation and would therefore render the asset a complete loss.
- Saltwater corrosion and significant wave action caused by storm surge will require evaluation following a storm event.

NATURAL, CULTURAL, AND RESOURCES

Per s. 380.093, F.S. (2)(a) 4., Natural, Cultural, and Historical Resources shall include conservation lands, parks, shorelines, surface waters, wetlands, and historical and cultural assets owned and/or maintained by the Town.

The data collected on critical assets defined as "Natural, Cultural, and Historical Resources" per s. 380.093(2)(a), F.S. are outlined in **Table 23.**

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

TABLE 23: NATURAL, CULTURAL, AND HISTORICAL RESOURCES

Asset Type	Source	Critical Elevation Method
Conservation Lands	N/A	N/A
Parks	Broward County	Zonal Statistics
Shorelines	N/A	N/A
Surface Waters	Broward County	Zonal Statistics
Wetlands	N/A	N/A
Historical and Cultural Assets	N/A	N/A

Parks

In lieu of the critical elevation method, an assessment of percent flooding area was made for parks to evaluate criticality. This assessment utilized the Zonal Statistics method to identify total park area. Total acreage for all parks evaluated can be found in **Table 24.**

TABLE 24: PARKS, TOTAL AREA

Asset Name	Asset Class	Total Area (Acres)
Patrick Behan Park	Park	1.7
Lake Forest Park	Park	5.4
Pembroke Park Preserve	Park	14.3
AJ Ryan Park	Park	5.7
Howard Clark Sr Linear Walkway	Park	0.5

Criticality for parks considered the following factors in assigning low, medium, or high risk:

- Rainfall flooding is temporary – likelihood of complete asset loss is unlikely.
- Any flooding greater than 75% by area would likely to incur significantly limited function of the area during and after the event.
- Significant SLR flooding would cause permanent inundation and would therefore render the park asset a complete loss.

Surface Waters

Critical elevations for surface waters in Pembroke Park were identified using the maximum elevation pulled from the Zonal Statistics tool as the top of bank and, therefore, the critical elevation for surface waters. **Table 25** shows the critical elevation of surface waters in Pembroke Park.

TABLE 25: SURFACE WATER CRITICAL ELEVATIONS

Asset Name	Asset Class	Critical Elevation (NAVD88, ft)
840436	Surface Water	1.5
700013	Surface Water	1.5
699824	Surface Water	1.5
840440	Surface Water	1.5
840441	Surface Water	1.5
697749	Surface Water	1.5
840434	Surface Water	1.5
700506	Surface Water	1.5
700039	Surface Water	1.5
840438	Surface Water	1.5
700787	Surface Water	1.5
698034	Surface Water	1.5
Desoto Lakes	Surface Water	1.5
698255	Surface Water	1.5

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

Criticality for surface waters considered the following factors in assigning low, medium, or high risk:

- Many of these waters are designed to provide storage for rainfall – an increase in flood elevation overtopping the top of bank of the structure is where flooding affects the surrounding area.
- SLR flooding would cause permanent inundation and would therefore permanently change the storage volume of the pond.
- Saltwater infiltration is a designated high-risk event for all systems.
- Location of surface waters relative to the built environment was considered in assigning criticality.

RESULTS AND DISCUSSION

The sensitivity analysis conducted for the Town of Pembroke Park reveals significant vulnerabilities among various assets to flooding, particularly in scenarios involving storm surges and compound flooding. This discussion provides a general overview of the findings, highlighting the most affected areas and suggesting potential improvements to enhance the Town's resiliency. Refer to **APPENDIX E** and **APPENDIX F** for a summary of results of the sensitivity analysis per Critical Asset Class.

The sensitivity analysis indicates that the majority of assets in Pembroke Park are highly susceptible to flooding during storm surge and compound flooding scenarios. These scenarios demonstrated the most widespread impact, with the notable exception of several major roads, railroads, and communication facilities.

The analysis performed on Transportation Assets and Evacuation Route assets (major roads) identified targeted locations at which road improvements may be focused to improve the Town's resiliency. More specifically, John P. Lyons Lane, Lake Shore Drive, and SW 30th Avenue are all susceptible to flooding in all compound scenarios in current and projected events and storm surge scenarios. Most major roads and evacuation routes, including Hallandale Beach Boulevard, were found to be resilient across all evaluated scenarios. The accuracy of these results could be further improved by obtaining actual lane cross-slopes.

Critical infrastructure within the Town generally demonstrated higher resilience compared to other asset classes analyzed, including communication facilities. However, Pumps 1 – 5 were found to vary in criticality in each evaluated scenario. More specifically, Pump 3 was identified as vulnerable in the 100-year, 24-hour, 500-year, 24-hour, compound flooding scenarios, future tidal-intermediate high 2070, and all current and projected storm scenarios.

All critical community and emergency facilities, except for Pembroke Park Montessori School, were found to be vulnerable in scenarios involving rainfall-induced flooding, compound flooding, and storm surges. Pembroke Park Montessori School's vulnerability was limited to the storm surge intermediate scenario for 2070. Additional hydraulic routing is recommended to provide additional protection at all schools and health care facilities. Lake Forest Elementary School and Watkins Elementary Schools are not recommended to be used as emergency staging locations, as they are at risk of flooding and accessibility concerns during and following storm events. All affordable public housing varied in criticality in all evaluated scenarios, with the exception of tidal flooding in current and projected conditions.

All Natural, Cultural, and Historical assets were found to be at risk in all analyzed scenarios due to low elevations and proximity to the groundwater table. Overall, the result of this analysis is limited by the estimations made in defining critical elevation for various assets.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

IDENTIFY FOCUS AREAS

Focus areas for the Town of Pembroke Park were identified to highlight particularly vulnerable areas within the Town. Focus areas were identified based on the results of the Exposure and Sensitivity Analyses and results of the updated Stormwater Master Plan developed by Kimley-Horn (2024). Three focus areas were identified based on the above. The following sections detail the justification behind the selection of the focus areas as well as the assets contained within each area.

Refer to **Figure 12** for a map of the focus areas.

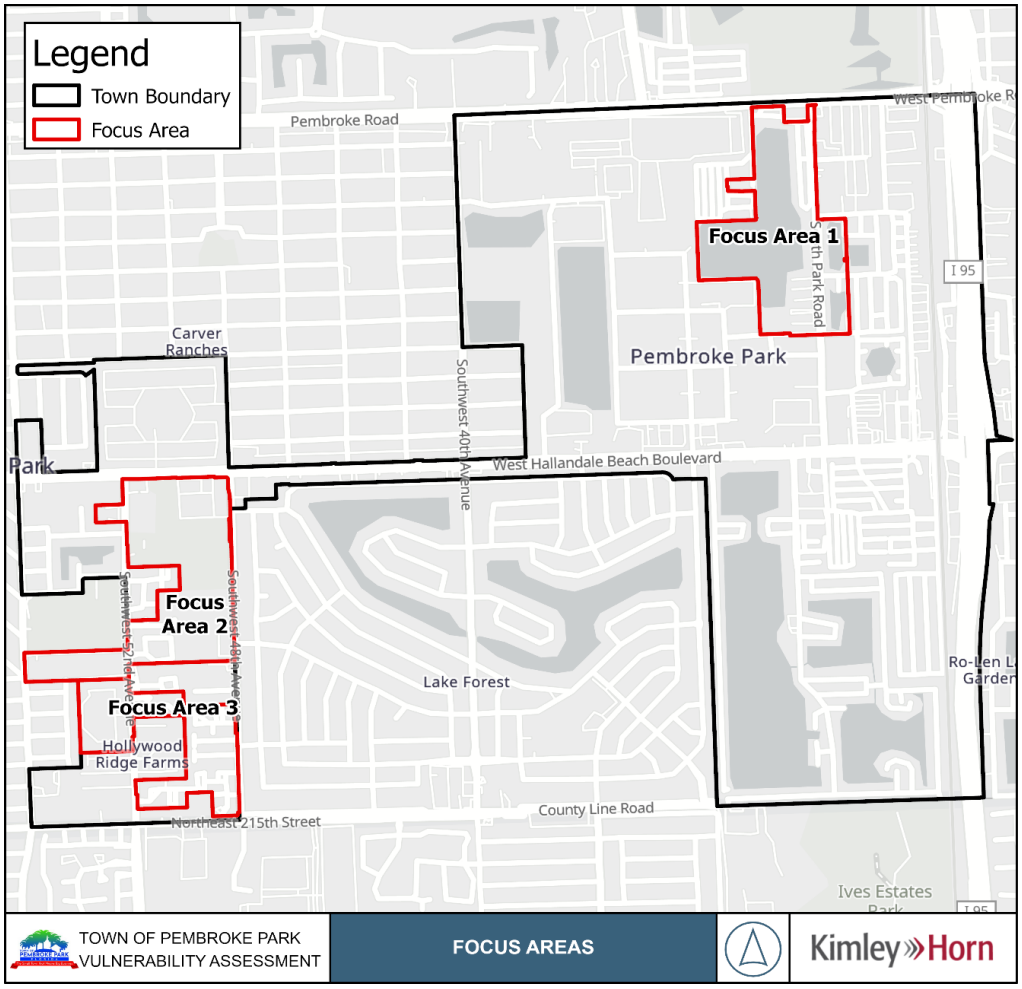


FIGURE 12. FOCUS AREAS IDENTIFIED WITHIN THE TOWN

FOCUS AREA 1 – NORTHEAST REGION OF TOWN BETWEEN SOUTH PARK ROAD AND SW 32ND AVENUE

The northeastern section of the Town was selected as a focus area because it was shown to flood during all reviewed scenarios. The area contains fourteen critical assets defined as a result of the

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

exposure and sensitivity analyses. **Table 26.** Focus Area 1 Critical Assets lists all of the critical assets within Focus Area 1.

TABLE 26. FOCUS AREA 1 CRITICAL ASSETS

Asset Name	Asset Type	Asset Class
South Park Road	Major Roadway	Transportation Assets and Evacuation Routes
Pump 1	Stormwater Pump Station	Critical Infrastructure
Pump 2	Stormwater Pump Station	Critical Infrastructure
Pump 3	Stormwater Pump Station	Critical Infrastructure
Pump 4	Stormwater Pump Station	Critical Infrastructure
Pump 5	Stormwater Pump Station	Critical Infrastructure
Trinity Broadcasting – Miami	Communication Facility	Critical Infrastructure
Pembroke Park Recycling and Transfer Center	Disaster Debris Management Site	Critical Infrastructure
697749	Surface Water	Natural, Cultural, and Historical Assets
700039	Surface Water	Natural, Cultural, and Historical Assets
699824	Surface Water	Natural, Cultural, and Historical Assets
840436	Surface Water	Natural, Cultural, and Historical Assets
Howard Clark Sr Linear Walkway	Park	Natural, Cultural, and Historical Assets
Patrick Behan Park	Park	Natural, Cultural, and Historical Assets

FOCUS AREA 2 – BETWEEN HALLANDALE BEACH BOULEVARD AND SW 54TH AVENUE

The area between Hallandale Beach Boulevard and SW 54th Avenue was selected as a focus area as it is low-lying and is consistently flooding in all scenarios analyzed. The region contains an overall total of thirty critical assets defined as result of the exposure and sensitivity analyses. **Table 27** lists all of the critical assets within Focus Area 2.

TABLE 27. FOCUS AREA 2 CRITICAL ASSETS

Asset Name	Asset Type	Asset Class
SW 52nd Avenue	Major Roadway	Transportation Assets and Evacuation Routes
Government Town Hall	Local Government Facility	Community and Emergency Facilities
Lake Forest Elementary School (includes 18 facilities)	School	Community and Emergency Facilities
Watkins Elementary School (includes 2 facilities)	School	Community and Emergency Facilities
Mimi's Learning Center	School	Community and Emergency Facilities
The Peninsula Assisted Living & Memory Care	Assisted Living Facility	Community and Emergency Facilities
Pembroke Park Reserve	Park	Natural, Cultural, and Historical Assets

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

Focus Area 3 – Hollywood Ridge Farms

The southwestern area of the Town was selected as a focus area as it is consistently flooding in all scenarios analyzed. The region contains an overall total of thirty-five critical assets defined as result of the exposure and sensitivity analyses. **Table 27** lists all of the critical assets within Focus Area 3.

TABLE 28. FOCUS AREA 3 CRITICAL ASSETS

Asset Name	Asset Type	Asset Class
Pembroke Gardens Apartments (includes 10 facilities)	Affordable Public Housing	Community and Emergency Facilities
Pembroke Park Apartments (includes 12 facilities)	Affordable Public Housing	Community and Emergency Facilities
Pembroke Villas (includes 13 facilities)	Affordable Public Housing	Community and Emergency Facilities

ADAPTATION STRATEGIES

Adaptation strategies may be defined as either as adaptive strategies, projects, plans, or policies that target current and future threats to critical infrastructure due to tidal or rainfall-induced flooding. Such adaptive measures may implement green and/or gray infrastructure to increase resiliency. Short-term and long-term adaptation strategies were defined to address the Town's current and future concerns and are summarized below.

Short Term Adaptation Strategies

Drainage Maintenance Program Update

Evaluate current drainage maintenance practices and adjust prioritization of the cleaning, inspection, and repair of piping and structures. Keeping the drainage system clear will alleviate operational issues during rainfall of tidal events by moving water more efficiently to stormwater outfalls.

Deployable Flood Barriers

Portable flood barriers to be utilized before major predicted events, in areas such as in front of critical buildings or electrical control rooms. They can come in the form of temporary walls, inflatable barriers, and modular systems. Beyond their effectiveness in preventing inundation, these barriers can be easy to store and deploy for critical assets located around project corridor improvements.

Dry Floodproofing

Dry floodproofing is aimed at protecting structures and assets from flood damage without preventing water from entering the building. Common techniques include installing flood-resistant doors and windows, applying waterproof coating, sealing every utility, temporary flood panels, and installing backflow preventors, check valves, and tide gates.

Long Term Adaptation Strategies

Raising Roadways

Increasing the elevation of roadways above the 100-year, 24-hour rainfall event or 2050 Intermediate SLR projection. Although this strategy is utilized to combat major rainfall events or future sea level rise, the Town would need to study drainage throughout the area to prevent additional flooding issues that new runoff could cause.

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

FFE Ordinance

Town to increase the minimum FFE above the combined SLR scenarios so that any home, business or Town building after the policy is in place, for a certain amount of time, must be brought up to a minimum standard elevation.

Business Case Evaluation

An analysis performed to consider costs of an adaptation measure and other quantifiable information within the Town such as, insurance rates, economy, and property values, to support or oppose an investment decision to implement a specific adaptation measure.

Utilization of Gray and Green Stormwater Infrastructure

To manage both the current and projected flood depths, it is recommended that gray and green stormwater infrastructure implemented. Gray and green infrastructure can capture, store, and filter rainwater where it falls, helping to control excess water flow and improve water quality by removing pollutants. In addition to addressing flooding and runoff, urban aesthetics may be enhanced, local ecosystems will be supported, and public health may improve. Examples of such solutions include bioswales, rain gardens, and permeable pavement.

TASK 6 – FINAL VULNERABILITY ASSESSMENT REPORT, MAPS, AND TABLES

This report contains summaries of all tasks completed for this vulnerability assessment. Maps of all flooding scenarios can be found in **APPENDIX D.** Sensitivity analysis tables can be found in **APPENDIX F.**

This report was funded, in part, through a grant agreement from the Florida Department of Environmental Protection, Florida Resilient Coastlines Program, by a grant provided by the Florida Coastal Office. The views, statements, findings, conclusions, and recommendations expressed herein are those of the author(s) and do not necessarily reflect the views of the State of Florida or any of its sub agencies.

APPENDIX A

KICK-OFF MEETING MINUTES

Kimley»Horn

Town of Pembroke Park Vulnerability Assessment

KICK-OFF MEETING AGENDA

PROJECT: Vulnerability Assessment

DATE: January 11, 2024 TIME OF MEETING: 2:00 PM

PLACE OF MEETING: Virtual KH Proj No.: 143586004

A. Introduction

Attendees:

Town of Pembroke Park (Town): Aleem Ghany (Public Services Director), Tom Positano
CAS Governmental Services: Connie Vanassche (Vice President and Managing Member)
DC Strategies LLC: Desinda Wood-Carper (Municipal Administration/Grants Consultant)

Kimley-Horn (KH): Matt Brosman, Stefano Viola, Gisselle Gutierrez

B. Presentation

C. Questions/ Discussion

a. Historical/ Cultural Assets?
   i. The Town confirmed there are no historic sites.
   ii. Pembroke Park Reserve is a preserved park but still classifies as a critical asset.

b. Additional critical infrastructure assets?
   i. The Town noted of a Superfund site to consider as part of assessment.
   ii. The Town noted some lakes will be filled as development continues (Desoto and 20th St Lake).

c. Final Project Team?
   i. Team will consist of Connie, Aleem, Tom, and Desinda.

d. For what projects do you envision applying for Resilient Florida grants?
   i. In conjunction with the Stormwater Master Plan, the Assessment will be used to prioritize projects and will be submitted for grants.

e. Data gap review – our next meeting
   i. Next meeting will be scheduled to be after March 10th.

D. Action Items

a. KH will begin data acquisition of critical assets.
b. KH will send meeting minutes and copy of presentation.
c. Town staff to provide KH with 2023 CIP. *(Complete)*

APPENDIX B

DATA COLLECTION TECHNICAL MEMORANDUM

Revision Date: 04/2024

Task 2: Acquire Background Data

Prepared for:

Town of Pembroke Park
3150 SW 52nd Avenue
Pembroke Park, Florida 33023

Prepared by:

Kimley-Horn and Associates, Inc.
8201 Peters Road, Suite 2200
Plantation, FL 33324

© Kimley-Horn and Associates, Inc.
Registry No. 696
Plantation, Florida 145083000

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purposes and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley- Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Kimley»Horn

TABLE OF CONTENTS

TABLE OF CONTENTS **2**
LIST OF APPENDICES **2**
1. INTRODUCTION **3**
2. OBJECTIVE **3**
3. BACKGROUND **3**
4. DATA COLLECTION **4**
4.1. PROJECT KICKOFF 4
4.2. ACQUIRE BACKGROUND DATA 4
4.2.1 Critical/Regionally Significant Assets Inventory 4
4.2.2 Topographic Data 4
4.2.3 Flood-Scenario Related Data 5
Precipitation Data **5**
Groundwater Level Data **5**
Sea Level Rise (SLR) Projections **5**
Tidal Datums and Tidal Flooding **6**
Storm Surge **6**
Land Use Data **6**
FEMA FIRM Information **6**
4.3 DATA GAP ANALYSIS 7
APPENDIX A **8**
APPENDIX B **9**

LIST OF APPENDICES

APPENDIX A – KICK-OFF MEETING AGENDA APPENDIX
APPENDIX B – DATASET REGISTER

Kimley»Horn

1. INTRODUCTION

The Town of Pembroke Park (referred to as the "Town") received funding from the Florida Department of Environmental Protection through the Resilient Coastlines Program to conduct a Townwide Vulnerability Assessment. In support of this project, the Town contracted on November 17,2023, with Kimley-Horn and Associates Inc. (herein referred to as Kimley-Horn) to deliver the Vulnerability Assessment pursuant to Florida Statute 380.093. The first deliverable under this project is a Technical Memorandum for Task 2 - Acquire Background Data and is included herein.

This technical report provided by Kimley-Horn shall contain a review of the actions taken to collect data for this project as well as provide recommendations to address data gaps and actions taken to rectify them, where applicable. The collected data will provide Kimley-Horn with the information necessary to understand the area of interest and proceed with the assessment and analysis of exposure and sensitivity related to flooding extents and critical infrastructure within the Town.

2. OBJECTIVE

The objective of the Town of Pembroke Park Vulnerability Assessment Project is to identify and prioritize regionally significant areas at risk of flooding within the Town and specify the scenarios in which these areas are vulnerable.

3. BACKGROUND

The Town of Pembroke Park is an intercoastal municipality located in southeast Broward County, Florida, approximately 1.7 square miles in area. The Town is bounded by I-95 to the east, the Town of Ives Estates Park to the south, the City of Hollywood to the North, and the City of West Park to the west. Refer to ***Figure 1*** for a site map.

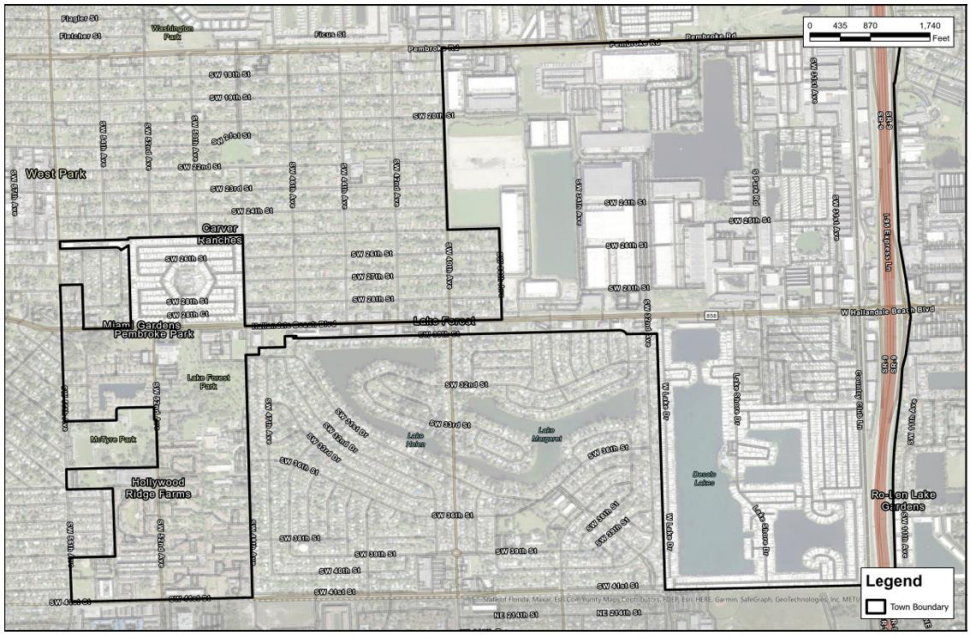


Figure 1. Pembroke Park Vulnerability Assessment Project Area

4. DATA COLLECTION

4.1. PROJECT KICKOFF

Kimley-Horn met virtually with employees of the Town of Pembroke Park to commence the project kick-off meeting on January 11, 2024. During this meeting, the project scope and schedule was reviewed. Kickoff meeting notes can be found in **Appendix A.**

4.2. ACQUIRE BACKGROUND DATA

Kimley-Horn, in coordination with the Town when applicable, researched and compiled the data needed to perform the vulnerability assessment based on the requirements defined in s. 380.093, F.S. The three main categories required to perform the assessment are as follows:

1. Critical/regionally significant assets
2. Topographic data
3. Flood scenario-related data

4.2.1 Critical/Regionally Significant Assets Inventory

Kimley-Horn requested and reviewed available information such as existing Town asset inventories, including:

- Municipal Boundary
- Town Stormwater Utility Inventory
- Town Water and Wastewater Utility Inventory
- Town Natural and Cultural Assets (Parks, Surface Water)
- Town Critical Infrastructure (Comm. Facilities, Lift Stations, Waste Facility, etc.)
- Transportation Assets (Roads, Rail, Bus Stops, Bridges)

Kimley-Horn developed a dataset register to summarize all data collected. The dataset register is included in **Appendix B.**

4.2.2 Topographic Data

Topographic data was sourced from the 2018 U.S. Department of Agriculture National Resource Conservation Service (USDA NRCS)/ U.S Geological Survey (USGS) Southeast Florida dataset with a one-meter cell size in NAVD88. ***Figure 2*** shows the elevation map for the Town.



Figure 2. Elevation in Town Boundary

4.2.3 Flood-Scenario Related Data

As applicable, the following flood-scenario related data was included.

Precipitation Data

Precipitation values from the National Oceanic and Atmospheric Administration (NOAA) Atlas 14 tool was collected to be used for the rainfall induced scenario. ***Table 1*** shows the rainfall-depths for the 100-year and 500-year, 24-hour events that will be evaluated in this analysis.

Table 1. NOAA Atlas 14 Rainfall-Depths

Rainfall Event	Depth (ft)
100-year, 24-hour	15.4
500-year, 24-hour	21.1

Groundwater Level Data

Groundwater flooding can be prevalent in low communities where sea-level rise has raised the groundwater level in the topmost aquifer. Groundwater levels determine an aquifer's storage capacity and can impact soil infiltration rates and should be studied where there are shallow water table conditions, as it is in the Town.

Groundwater level data was collected from the USGS National Water Information System (NWIS) which provides access to sites where current and historical groundwater data has been collected.

Sea Level Rise (SLR) Projections

The Southeast Florida Climate Compact (SEFLCC) publishes a Sea Level Rise Projection and Guidance Report every five years to ensure a regionally unified projection of sea level rise for adaptation planning. The latest version, published in 2019, abides NOAA's 2017 projection updates. The Unified Sea Level Rise Projection includes three curves for application: the NOAA High Curve, the NOAA Intermediate High Curve, and the curve corresponding to the median of

the intergovernmental panel on Climate Change (IPCC). For this assessment, the NOAA Intermediate High Curve was used for the planning year of 2040 and 2070.

Table 2. Sea Level Rise Projections.

Datum: Feet NAVD88		
Year	NOAA2017 INT-LOW(FT)	NOAA2017 INT-HIGH (FT)
2040	0.76	1.38
2070	1.31	3.31

Tidal Datums and Tidal Flooding

Tidal datums and tidal flooding data was obtained for the South Port Everglades station (ID: 8722956) from the NOAA Tides and Currents website. A mean higher high water (MHHW) level of 0.57 feet NAVD88 was obtained from the station. A flood threshold of 1.74 feet above MHHW is identified by NOAA as the minor flood threshold at the Virginia Key, Biscayne Bay, FL and was assumed for the Town.

Storm Surge

Storm surge data was sourced from the National Hurricane Center's Sea, Lake, and Overland Surges from Hurricanes (SLOSH) model. The data collected is the maximum of the maximum envelope of high water (MEOW), or (MOM), which provides a worst-case scenario for each category storm under "perfect" storm conditions. A Category Five – High water surface elevation of 6.70 feet NAVD88 was obtained for this assessment.

Land Use Data

To account for current and future land use changes, data was collected from the South Florida Water Management District (SFWMD). By using for future land use, potential changes to inundation depths can be accounted for.

FEMA FIRM Information

FEMA flood insurance rate maps (FIRMs) were obtained for the Town and show Special Flood Hazard Areas (SFHAs) – areas that will be inundated by the flood event having a 1-percent chance of being equaled or exceeded in any given year. ***Figure 3*** shows the FEMA SFHAs within the Town.

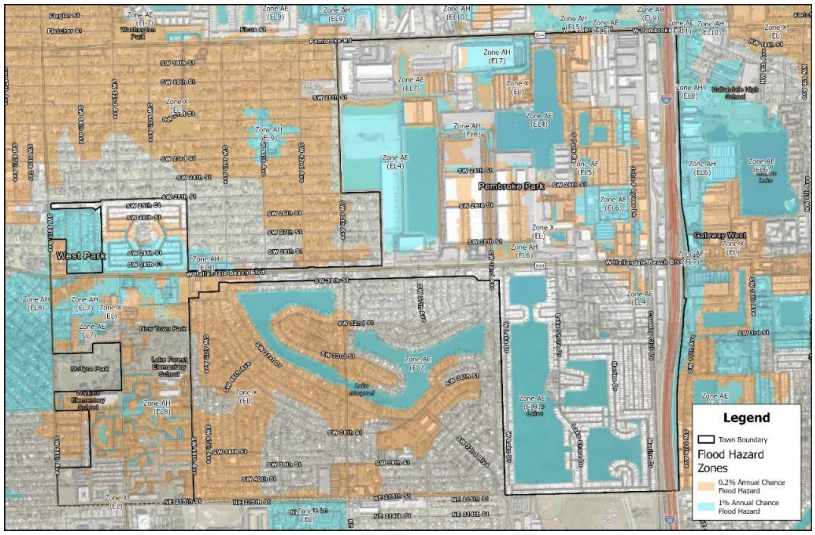


Figure 3. FEMA FIRM 100-Year Floodplain, Effective August 2014

4.3 DATA GAP ANALYSIS

Kimley-Horn conducted a data gap analysis of the provided information to check for completeness and applicability of the data. The data gap analysis performed indicated that missing data includes:

- Finished floor elevation for Town buildings.
    - In lieu of this data from as-builts or survey, the minimum elevation from the 2018 Digital Elevation Model within the asset footprint will be extracted using the Zonal Statistics GIS tool. For any finished structure, the slab-on-grade elevation will be assumed to be the minimum DEM elevation plus 1-foot. An example is shown in the figure below.

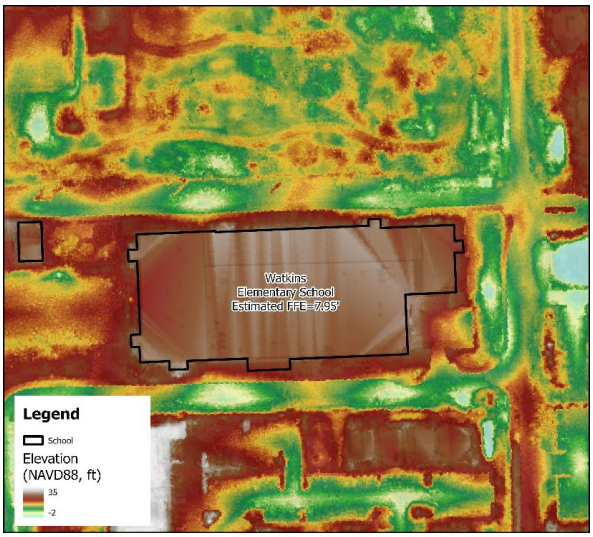


Figure 4. Estimated FFE for Watkins Elementary School using Zonal Statistics method.

Kimley»Horn

1. Critical/ Regionally Significant Assets Inventory								
Ref No.	Data Type	Asset Category	Name	Description	From	Data Received/ Data Downloaded	File Name	File Location
1.1	SHP	Transportation Assets and Evacuation Routes	MajorRoadways	Line feature class of roads in Pembroke Park including SW 52nd Ave, W Hallandale Beach Blvd, I95, Lake Shore Dr, SW 32nd Ave, W Lake Ave, John P Lyons Lane, SW 30th Ave	Town of Pembroke Park	1/30/2024	Streets	" K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection \1.Transportation Assets and Evacuation Routes\Streets"
1.2	SHP		BusStops	Point shapefiles for all 30 bus stops locations in Pembroke Park	Town of Pembroke Park	1/30/2024	Bus_stops	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\1.Transportation Assets and Evacuation Routes\bus_stops.shp"
1.3	SHP		Bridges	A point shapefile of the I-95 bridge within Pembroke Park boundary	FDOT	1/30/2024	Bridge	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\1.Transportation Assets and Evacuation Routes\Bridge.shp"
1.4	SHP		Railroad	SOL Railroad	ArcGIS Enterprise	1/30/2024	Railroad	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\1.Transportation Assets and Evacuation Routes\ Railroad"
1.5	SHP		Evacuation Route	A line feature class of Broward County Evacuation Routes	Broward County	1/30/2024	Broward_County_Evacuation_Routes	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\1.Transportation Assets and Evacuation Routes\ Broward_County_Evacuation_Routes"
2.1	SHP	Critical Infrastructure	Water Utility Conveyance Systems	A line feature class of sewer lines within Pembroke Park	Town of Pembroke Park	1/30/2024	WaterUtilityConvSyst	" K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\From_Others \2.Critical Infrastructure\WaterUtilityConvSyst"
2.2	SHP		Lift Stations	Point files of locations of lift stations around Pembroke Park	Town of Pembroke Park	1/30/2024	Lift Station	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\2.Critical Infrastructure\Lift Station "
2.3	SHP		DisasterDebrisManagementSite	A point shapefile including the solid waste disaster debris management sites	Broward County	1/30/2024	DisasterDebrisManagementSites	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\2.Critical Infrastructure\ DisasterDebrisManagementSites"
2.4	SHP		DisasterDebrisManagementSite(Poly)	A polygon shapefile that includes solid waste disaster debris management site buildings	Broward County	1/30/2024	DisasterDebrisManagementSitesPoly	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\2.Critical Infrastructure\ DisasterDebrisManagementSitePoly"
2.5	SHP		CommunicationFacilities(BroadcastingStudio)	A polygon shapefile of existingTV Broadcasting Studio	Town of Pembroke Park	1/30/2024	CommunicationFaciliies	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\2.Critical Infrastructure\Structures.shp"
3.1	SHP	Critical Community and Emergency Facility	EmergencyOperationCenters	Point files of the locations of EOCs in Broward County	Broward County	1/30/2024	Emergency_Operation_Centers	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\3.Critical Community and Emergency Facility\Emergency_Operation_Centers"

3.3	SHP		LawEnforcementFacility	Polygon shapefile of the sheriffs building in Town of Pembroke Park	Town of Pembroke Park	1/30/2024	Law Enforcement Facility	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\3.Critical Community and Emergency Facility\Law Enforcment Facility"
3.4	SHP		Schools	A polygon shapefile of schools within the Town of Pembroke Park	Town of Pembroke Park	1/30/2024	Schools	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\3.Critical Community and Emergency Facility\Schools"
3.5	SHP		LocalGovernmentFacility	A polygon shapefile of City Hall	Town of Pembroke Park	1/30/2024	Local Government Facility	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\3.Critical Community and Emergency Facility\LocalGovernmentFacility"
3.6	SHP		Assisted Living Facility	A polygon feature class of the Assisted Living Facility within the Town limits	Town of Pembroke Park	2/19/2024	AssistedLivingFacility	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\3.Critical Community and Emergency Facility\AssistedLivingFacility"
4.1	SHP	Natural, Cultural, and Historical Assets	Parks	Polygon shapefile of parks in Broward County	Broward County	1/30/2024	Broward_County_City_Parks	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\4.Natural, Cultural, & Historical Assets\Broward_County_City_Parks"
4.2	SHP		Surface Water	Polygon shapefile of the surface waterbodies in Broward County	Broward County	1/30/2024	Waterbody	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\4.Natural, Cultural, & Historical Assets\Waterbody"
5.1	SHP	Boundary	PembrokePark_Boundary	Polygon shapefile of the Town boundary	Pembroke Park GIS	1/30/2024	PembrokePark_Boundary	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\5.Boundary\PembrokePark_Boundary "
2. Topographic Data								
6.1	TIF	2018 USGS/NRCS Lidar 1m DEM: Southeast Florida dataset		Lidar collected from 2018	NOAA	1/30/2024	mosaic_ft	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\6.DEM "

3. Flood-Scenario Related Data

Scenario	100YR,24HR	500YR,24HR	Current Condition	Intermediate-Low (IL2040)	Intermediate-High (IH) 2040	IL2070	IH2070	From	Data Downloaded	File Name	File Location
Precipitation Data	15.4	21.1	-	-	-	-	-	NOAA Atlas 14	2/8/2024	Precipitation Frequency Data Server	K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\7.Scenarios
Groundwater level data	-	-	-	-	-	-	-	USGS NWIS Mapper	2/19/2024	NWISMapperExport.shp	K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\8. Groundwater Data
Sea Level Rise Projections	-	-	-	0.76	1.38	1.31	3.31	NOAA/Southeast Florida Regional Climate Compact	2/8/2024	SEFRCCC_Unified SLR Projection.pdf	K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\7.Scenarios
Tidal Flooding	-	-	2.31	3.07	3.69	3.62	5.62	NOAA Tides and Datums	2/8/2024	NOAATidal.pdf	K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\7.Scenarios
Storm Surge	-	-	6.70	7.46	8.08	8.01	10.01	SLOSH	2/8/2024	SLOSH	"K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\7.Scenarios\SLOSH"
Land Use	-	-	-	-	-	-	-	SFWMD	2/13/2024	SFWMD_LCLU_2017_2019	K:\FTL_GIS\00_Project_Files\HH_143586004 - Pembroke Park VA\Data\Data Collection\9. LULC

APPENDIX C

FEMA FIRM PANELS

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The **community map repository** should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations** (BFEs) and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded tenth-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations (BFEs) shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD 88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to Section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in preparation of this map was Transverse Mercator State Plane Florida East FIPS 0901. The **horizontal datum** was NAD83 HARN, GRS1980 spheroid. Differences in datum, spheroid, projection or State Plane zones used in preparation of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the North American Vertical Datum of 1988. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at http://www.ngs.noaa.gov/ or contact the National Geodetic Survey at the following address:

NGS Information Services
NOAA, N/NGS12
National Geodetic Survey
SSMC-3, #9202
1315 East-West Highway
Silver Spring, Maryland 20910-3282
(301) 713-3242

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey **at (301) 713-3242** or visit its website at http://www.ngs.noaa.gov/.

Base map information shown on this FIRM was provided in digital format by Broward County. The original orthophotographic base imagery was provided in color with a one-foot pixel resolution at a scale of 1" = 300' from photography flown in 2008.


This map reflects more detailed and up-to-date **stream channel configurations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products, or the National Flood Insurance Program in general, please call the **FEMA Map Information eXchange** at 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA Map Service Center website at http://msc.fema.gov. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report, and/or digital versions of this map. Many of these products can be ordered or obtained directly from the website. Users may determine the current map date for each FIRM panel by visiting the FEMA Map Service Center website or by calling the FEMA Map Information eXchange.

The **"profile base lines"** depicted on this map represent the hydraulic modeling baselines that match the flood profiles in the FIS report. As a result of improved topographic data, the profile base line, in some cases, may deviate significantly from the channel centerline or appear outside the SFHA.

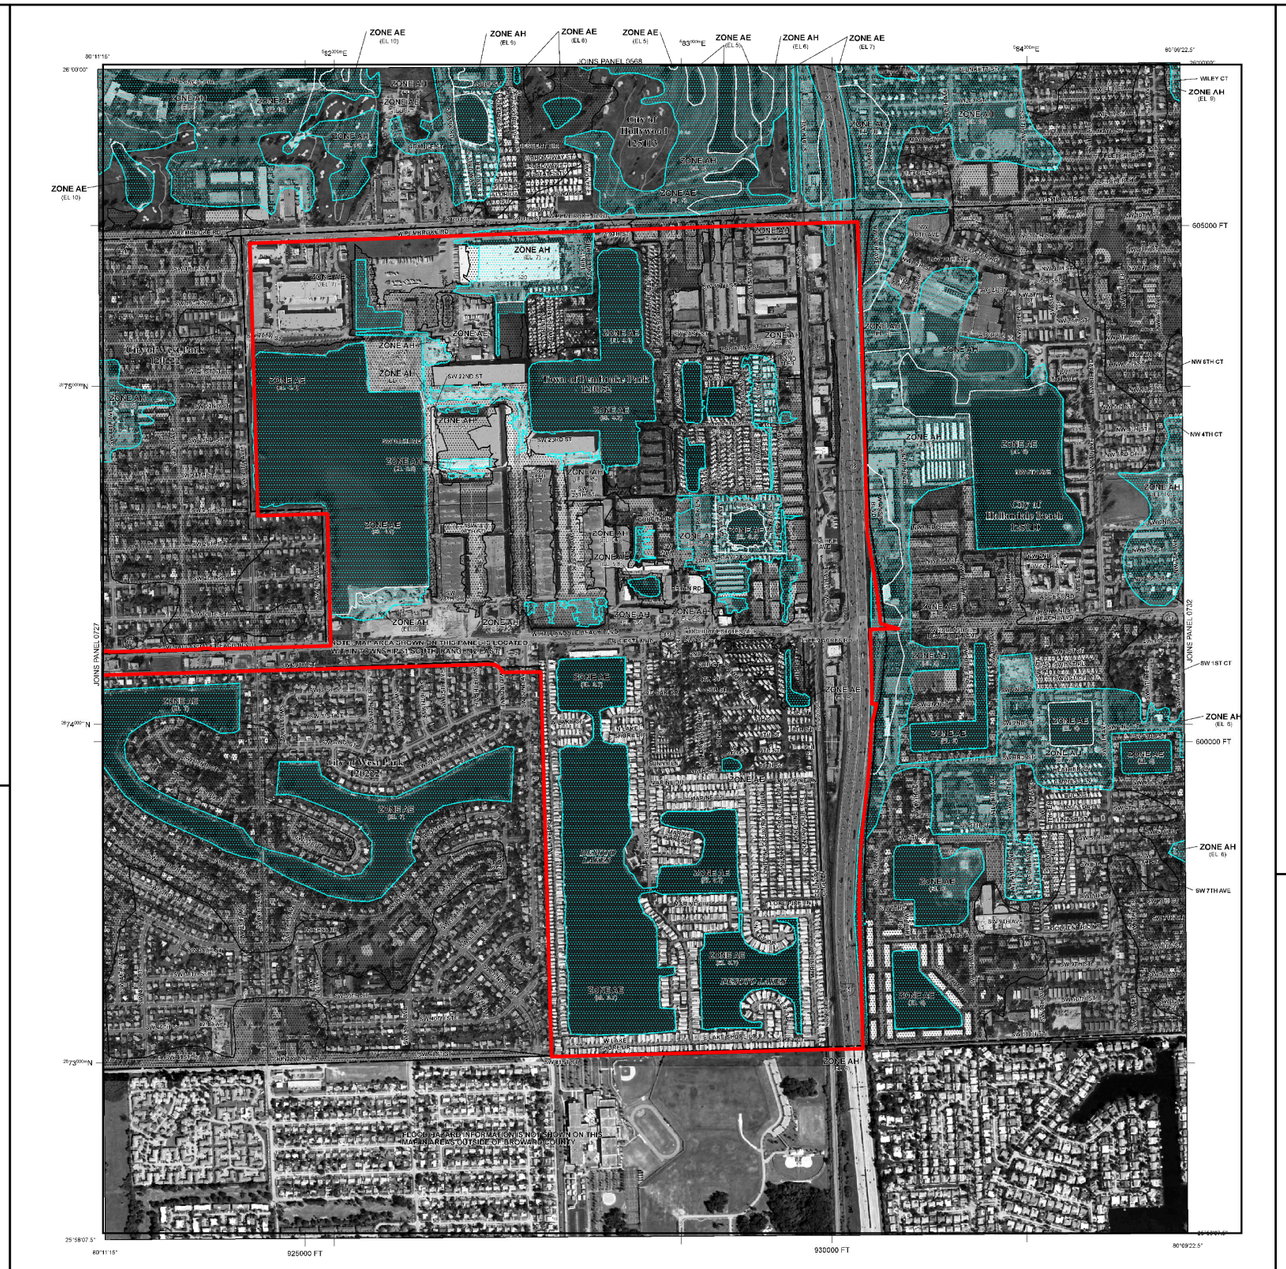

LEGEND

SPECIAL FLOOD HAZARD AREAS SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equaled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

ZONE A	No Base Flood Elevations determined.
ZONE AE	Base Flood Elevations determined.
ZONE AH	Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
ZONE AO	Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
ZONE AR	Special Flood Hazard Area formerly protected from the 1% annual chance flood by a flood control system that was subsequently decertified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
ZONE A99	Areas to be protected from 1% annual chance flood event by a Federal flood protection system under construction; no Base Flood Elevations determined.
ZONE V	Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
ZONE VE	Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

ZONE X	Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

ZONE X	Areas determined to be outside the 0.2% annual chance floodplain.
ZONE D	Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

1% annual chance floodplain boundary
0.2% annual chance floodplain boundary
Floodway boundary
Zone D boundary
CBRS and OPA boundary
Boundary dividing Special Flood Hazard Area Zones and boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths, or flood velocities
513 — Base Flood Elevation line and value; elevation in feet*
(EL 987) — Base Flood Elevation value where uniform within zone; elevation in feet*

* Referenced to the North American Vertical Datum of 1988

A — A — Cross section line
23 — 23 — Transect line
97°07'30", 32°22'30" — Geographic coordinates referenced to the North American Datum of 1983 (NAD 83), Western Hemisphere
4775000mE — 1000-meter Universal Transverse Mercator grid ticks, zone 17
6000000 FT — 5000-foot grid values: Florida State Plane coordinate system, East Zone (FIPSZONE = 0901), Transverse Mercator projection
DX5510 — Bench mark (see explanation in Notes to Users section of this FIRM panel)
M1.5 — River Mile

MAP REPOSITORIES
Refer to Map Repositories List on Map Index

EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP
August 18, 2014

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL

For community map revision history prior to countywide mapping, refer to the Community Map History table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

MAP SCALE 1" = 500'

250 0 250 500 750 1,000 FEET
150 0 150 300 METERS

NFIP
NATIONAL FLOOD INSURANCE PROGRAM

PANEL 0731H

FIRM

FLOOD INSURANCE RATE MAP
BROWARD COUNTY, FLORIDA
AND INCORPORATED AREAS

PANEL 731 OF 751
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
HALLANDALE BEACH, CITY OF	125105	0731	H
HOLLYWOOD, CITY OF	125113	0731	H
PEMBROKE PARK, TOWN OF	170051	0731	H
WEST PARK, CITY OF	170701	0731	H

Notice to User: the **Map Number** shown below should be used when placing map orders; the **Community Number** shown above should be used on insurance applications for the subject community.

MAP NUMBER
12011C0731H
EFFECTIVE DATE
AUGUST 18, 2014

Federal Emergency Management Agency

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The **community map repository** should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations** (BFEs) and/or **floodways** have been determined, users are encouraged to consult the Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations (BFEs) shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD 88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to Section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The **projection** used in preparation of this map was Transverse Mercator State Plane Florida East FIPS 0901. The **horizontal datum** was NAD83 HARN, GRS1980 spheroid. Differences in datum, spheroid, projection or State Plane zones used in production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the North American Vertical Datum of 1988. These flood elevations must be compared to structure and ground elevations referenced to the **same vertical datum**. For information regarding **conversion between** National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at http://www.ngs.noaa.gov/ or contact the National Geodetic Survey at the following address:

NGS Information Services
NOAA, NNGS12
National Geodetic Survey
SSMC-3, #9202
1315 East-West Highway
Silver Spring, Maryland 20910-3282
(301) 713-3242

To obtain current **elevation, description, and/or location information for bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at http://www.ngs.noaa.gov/.

Base map information shown on this FIRM was provided in digital format by Broward County. The original orthophotographic base imagery was provided in color with a one-foot pixel resolution at a scale of 1" = 400' from photography flown in 2008.


This map reflects more detailed and up-to-date **stream channel configurations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

For information and questions about this map, available products associated with this FIRM including historic versions of this FIRM, how to order products, or the National Flood Insurance Program in general, please call the FEMA Map Information eXchange at 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA Map Service Center website at http://msc.fema.gov. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report, and/or digital versions of this map. Many of these products can be ordered or obtained directly from this website. Users may determine the current map date for each FIRM panel by visiting the FEMA Map Service Center website or by calling the FEMA Map Information eXchange.

The **"profile base lines"** depicted on this map represent the hydraulic modeling baselines that match the flood profiles in the FIS report. As a result of improved topographic data, the profile base line, in some cases, may deviate significantly from the channel centerline or appear outside the SFHA.

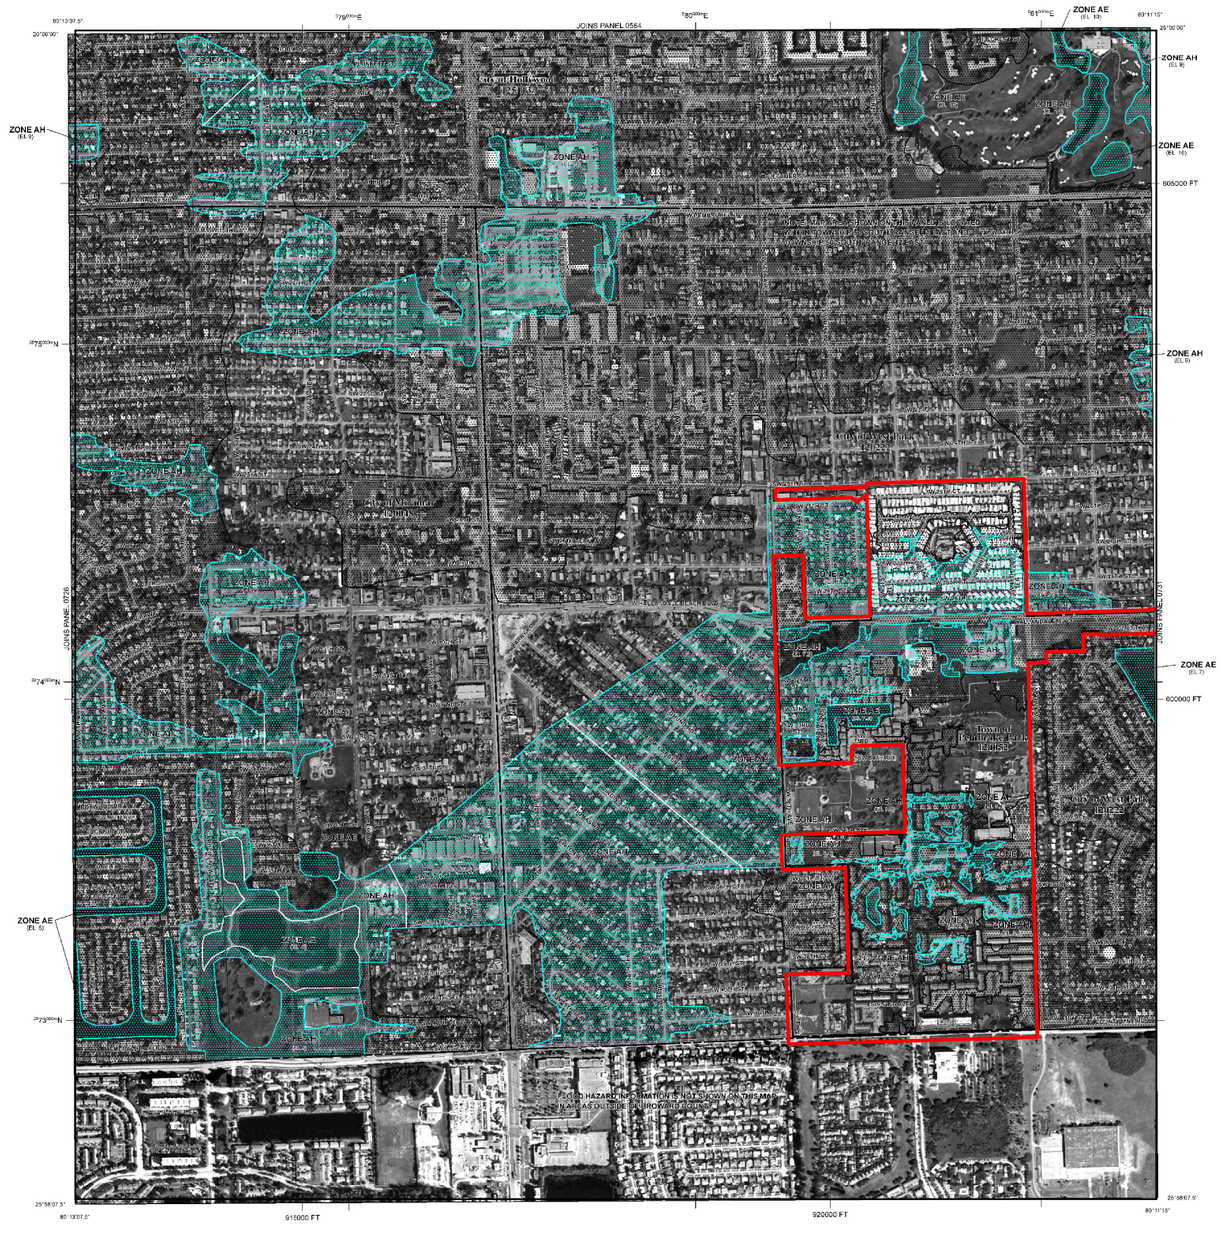

LEGEND

SPECIAL FLOOD HAZARD AREAS SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equaled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zones A, AE, AH, AO, AR, A99, V, and VE. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

- **ZONE A** No Base Flood Elevations determined.
- **ZONE AE** Base Flood Elevations determined.
- **ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- **ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- **ZONE AR** Special Flood Hazard Area formerly protected from the 1% annual chance flood by a flood control system that was subsequently decertified. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- **ZONE A99** Areas to be protected from 1% annual chance flood event by a Federal flood protection system under construction; no Base Flood Elevations determined.
- **ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- **ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

- **ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.

OTHER AREAS

- **ZONE X** Areas determined to be outside the 0.2% annual chance floodplain.
- **ZONE D** Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

- 1% annual chance floodplain boundary
- 0.2% annual chance floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary dividing Special Flood Hazard Area Zones and boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths, or flood velocities
- 513 (EL 987) — Base Flood Elevation line and value; elevation in feet*
- Base Flood Elevation value where uniform within zone; elevation in feet*

* Referenced to the North American Vertical Datum of 1988

- (A) — (A) Cross section line
- (23) — (23) Transect line
- 97°07'30", 32°22'30" — Geographic coordinates referenced to the North American Datum of 1983 (NAD 83), Western Hemisphere
- 4275000 E — 1000-meter Universal Transverse Mercator grid ticks, zone 17
- 6000000 FT — 5000-foot grid values: Florida State Plane coordinate system, East Zone (FIPSZONE = 0901), Transverse Mercator projection
- DX5510 — Bench mark (see explanation in Notes to Users section of this FIRM panel)
- M1.5 — River Mile

MAP REPOSITORIES
Refer to Map Repositories List on Map Index

EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP
August 18, 2014

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL

For community map revision history prior to countywide mapping, refer to the Community Map History table located in the Flood Insurance Study report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-638-6620.

MAP SCALE 1" = 500'

PANEL 0727H

FIRM

FLOOD INSURANCE RATE MAP
BROWARD COUNTY, FLORIDA
AND INCORPORATED AREAS

PANEL 727 OF 751
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
HOLLYWOOD, CITY OF	125113	0727	H
MIRAMAR, CITY OF	120048	0727	H
PEMBROKE PARK, TOWN OF	120052	0727	H
WEST PARK, CITY OF	120222	0727	H

Notice to User: The **Map Number** shown below should be used when placing flood insurance. The **Community Number** shown above should be used on insurance applications for the subject community.

MAP NUMBER
12011C0727H


EFFECTIVE DATE
AUGUST 18, 2014

Federal Emergency Management Agency

NATIONAL FLOOD INSURANCE PROGRAM

APPENDIX D

EXPOSURE ANALYSIS INUNDATION MAPS



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Facility
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

RAINFALL-INDUCED FLOODING
100-YEAR/24-HOUR EVENT

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-1



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

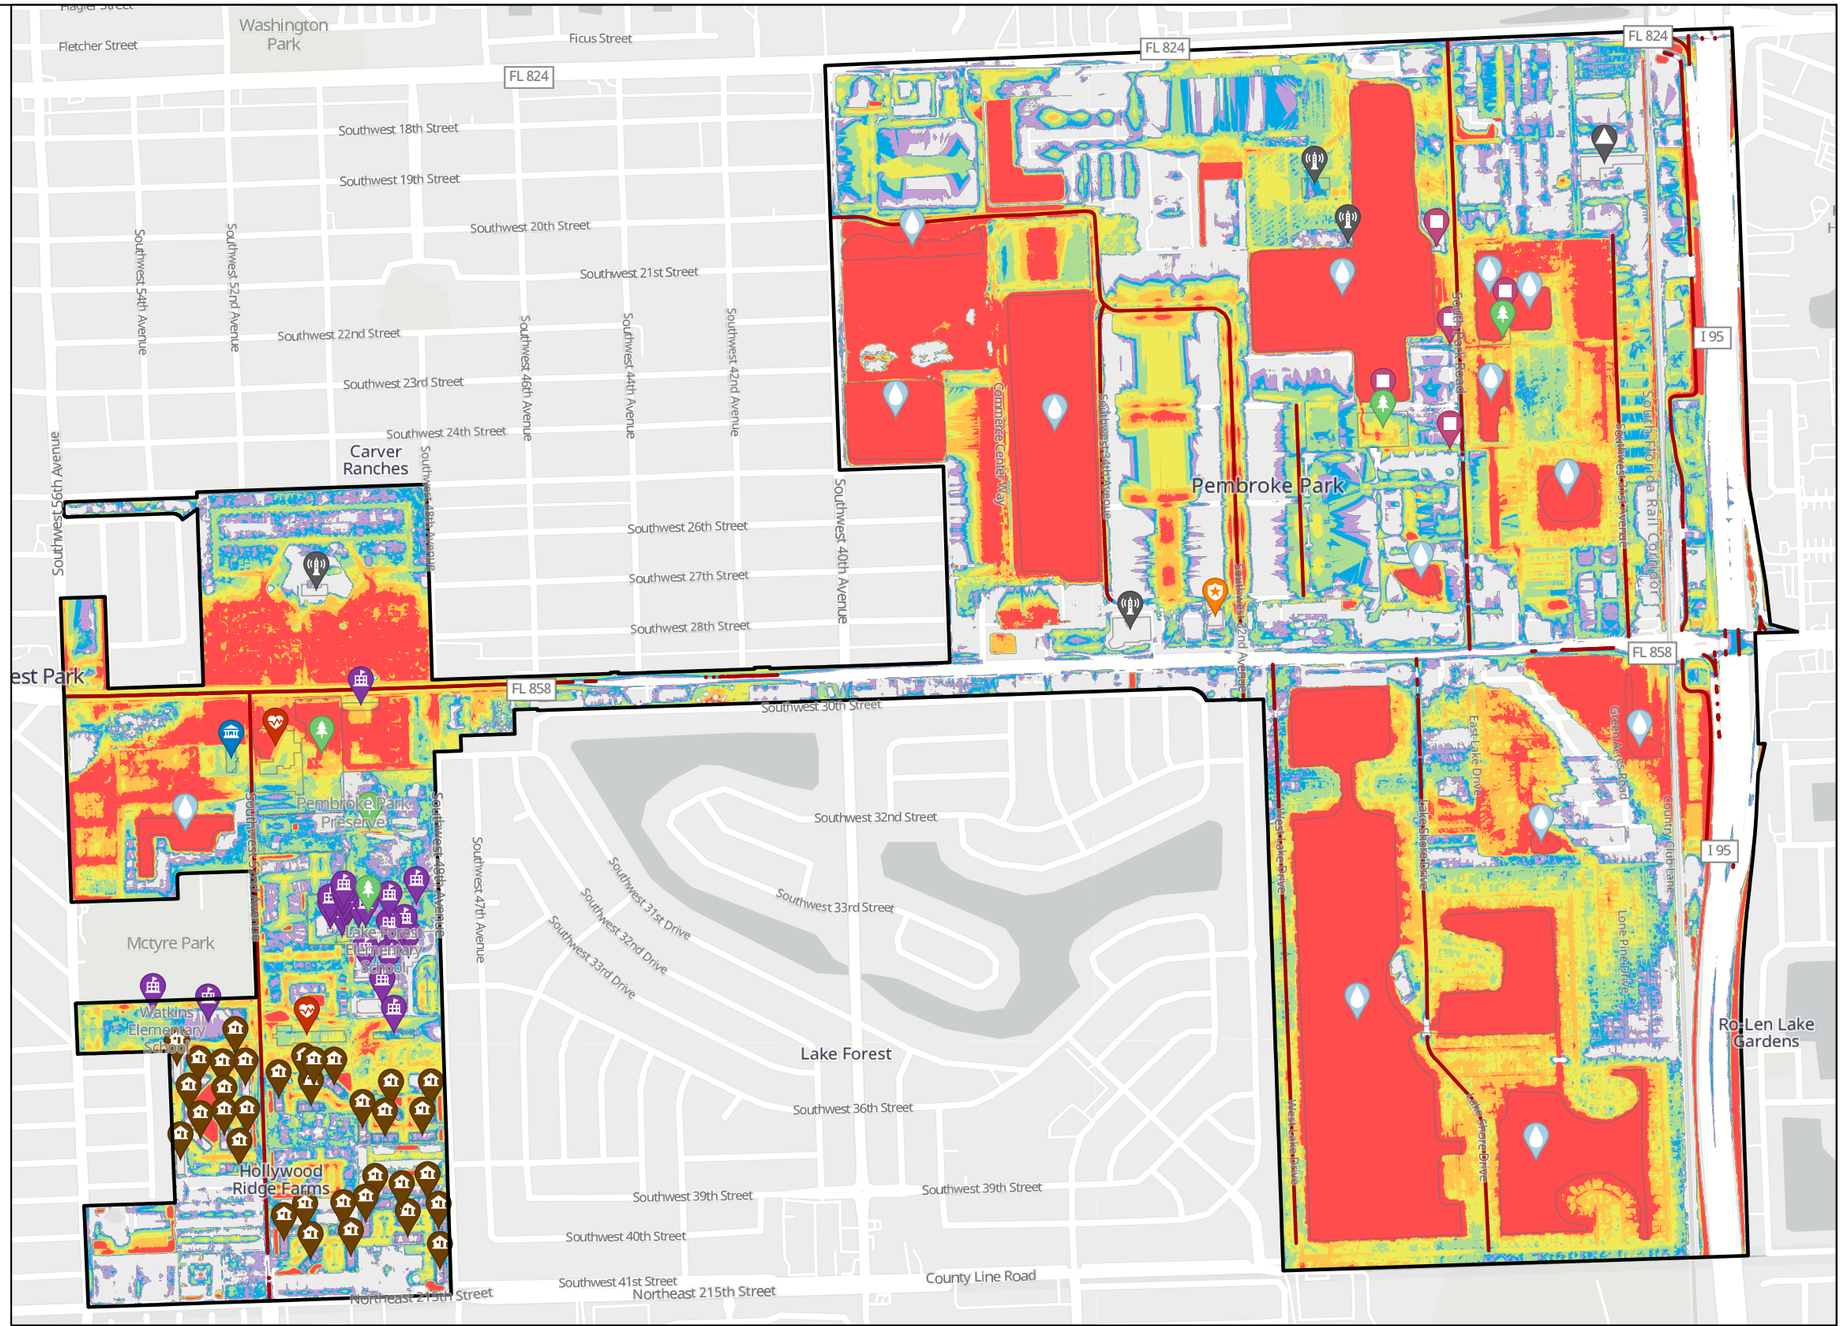


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100YR24HR + INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-2



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

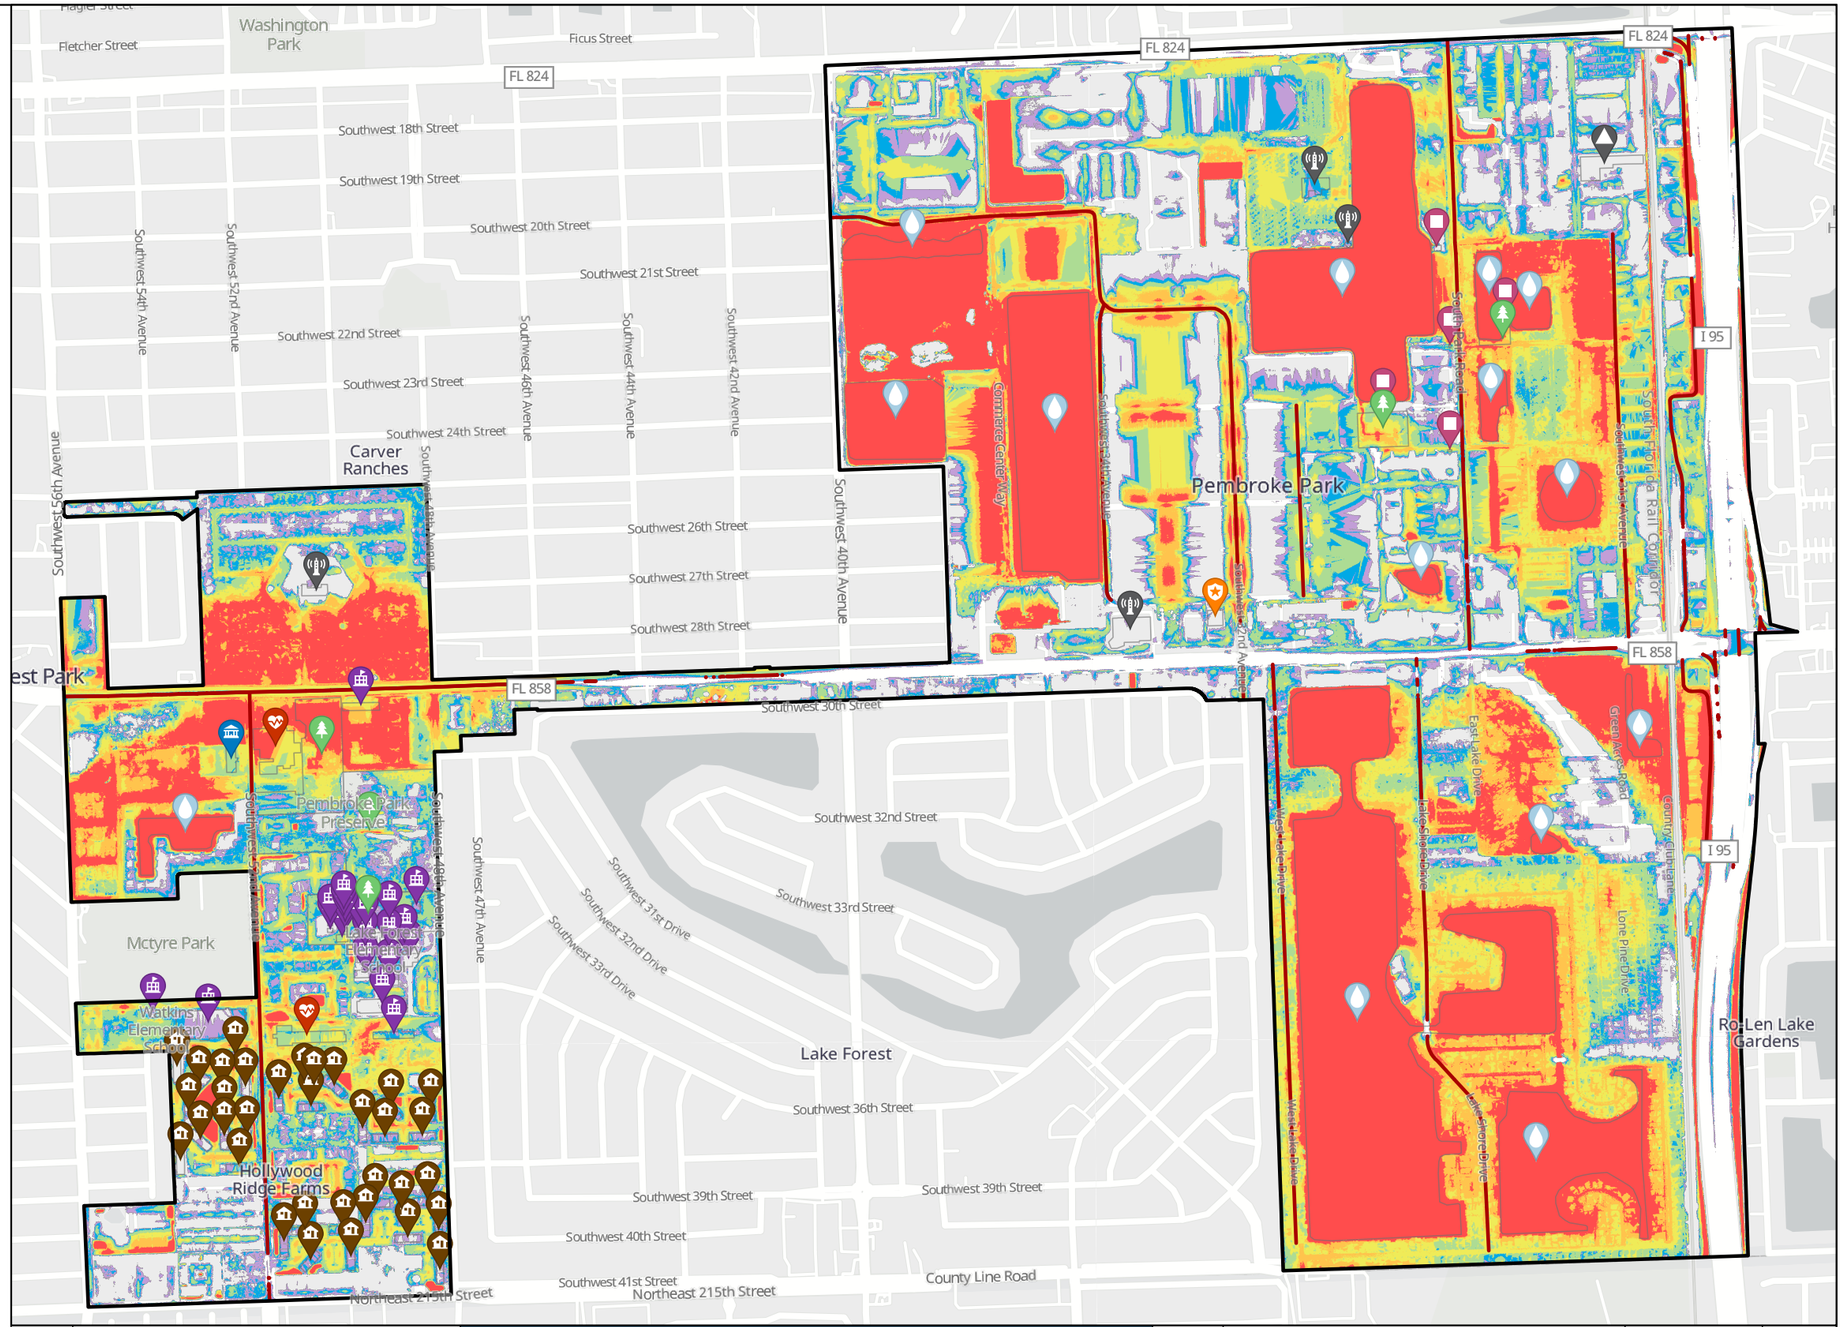


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100YR24HR + INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-3



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

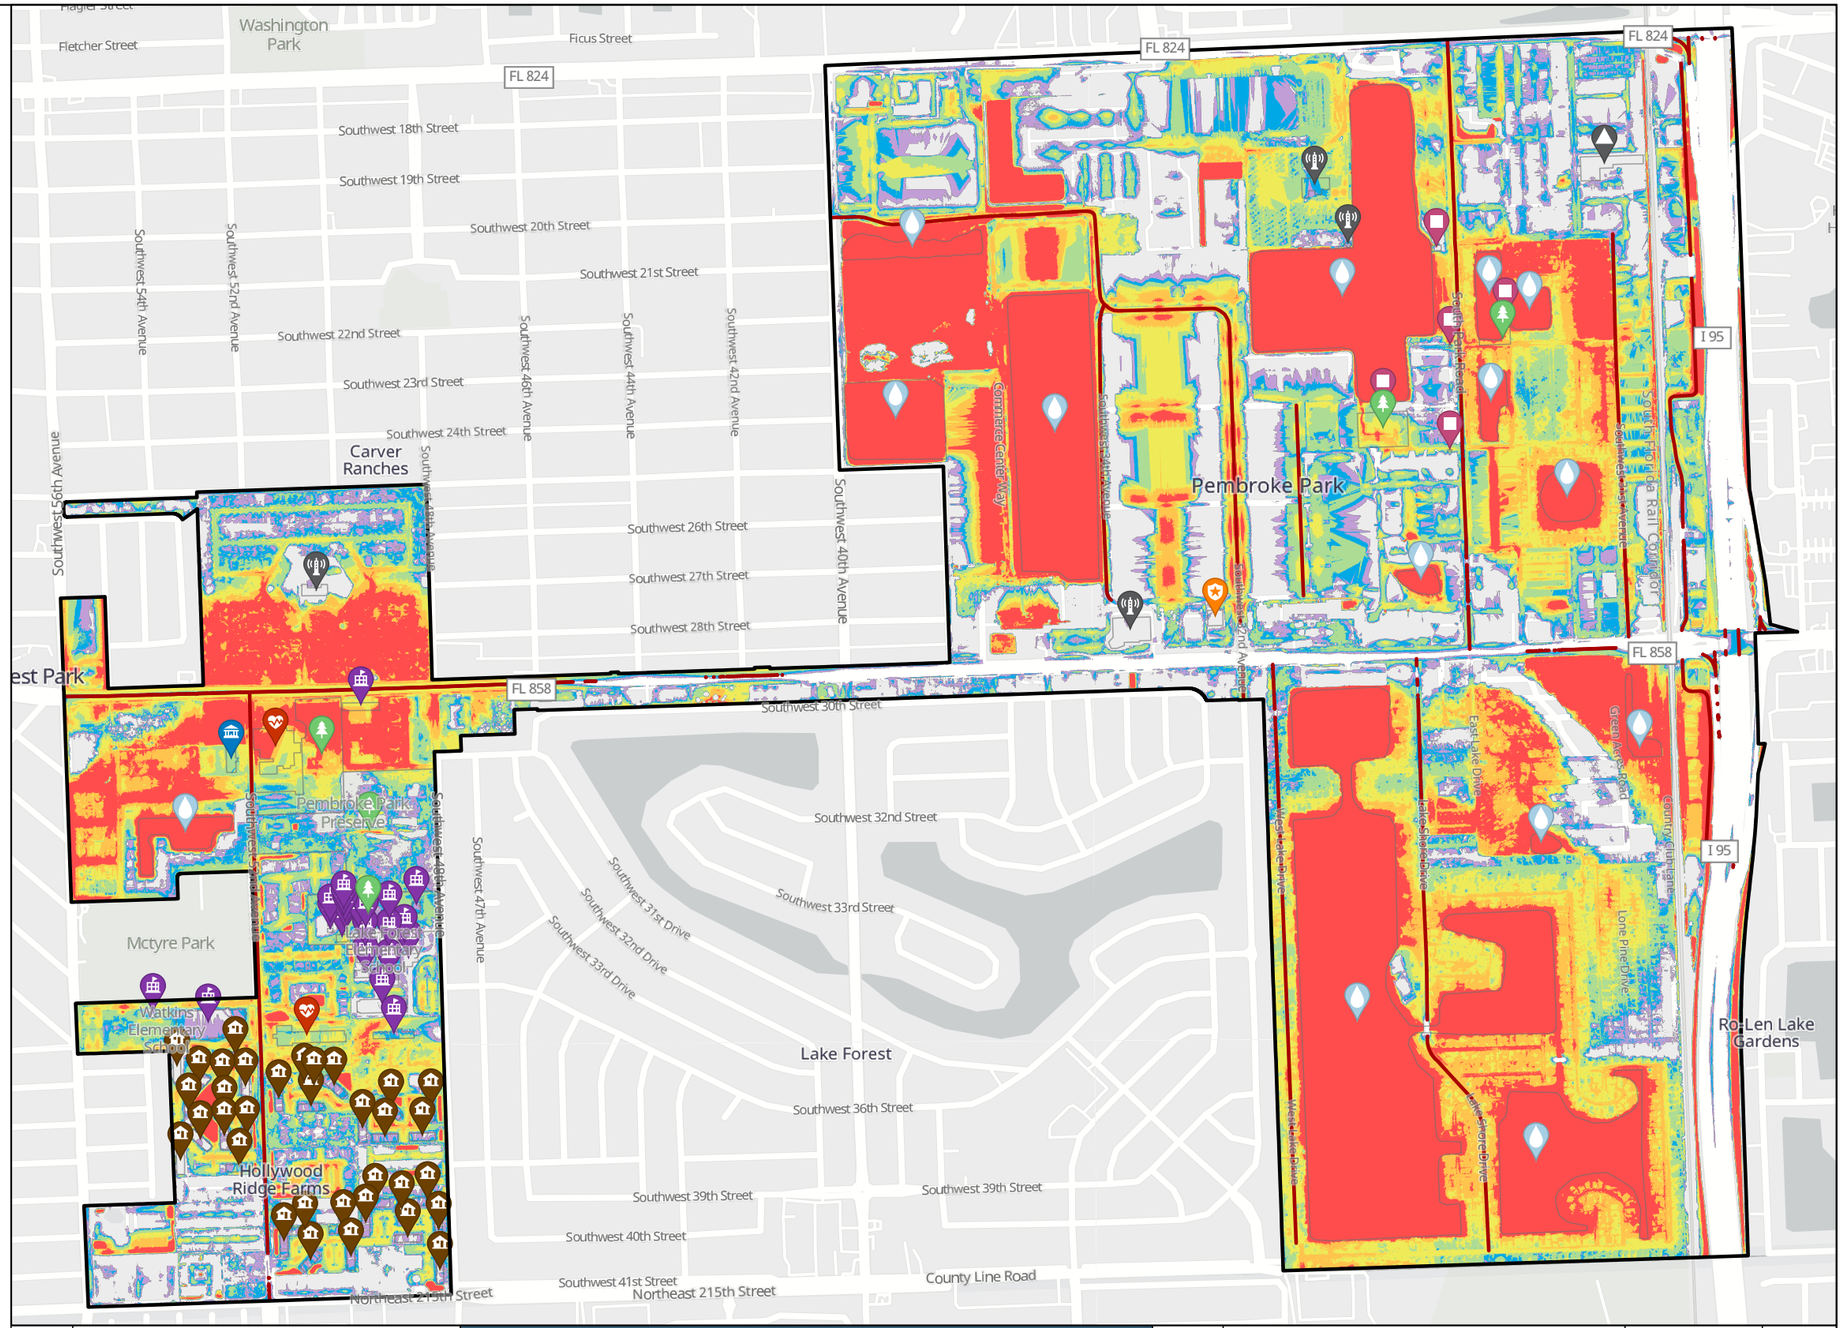


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100YR24HR + INT-LOW 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-4



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Facility
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100YR24HR + INT-HIGH 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-5



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

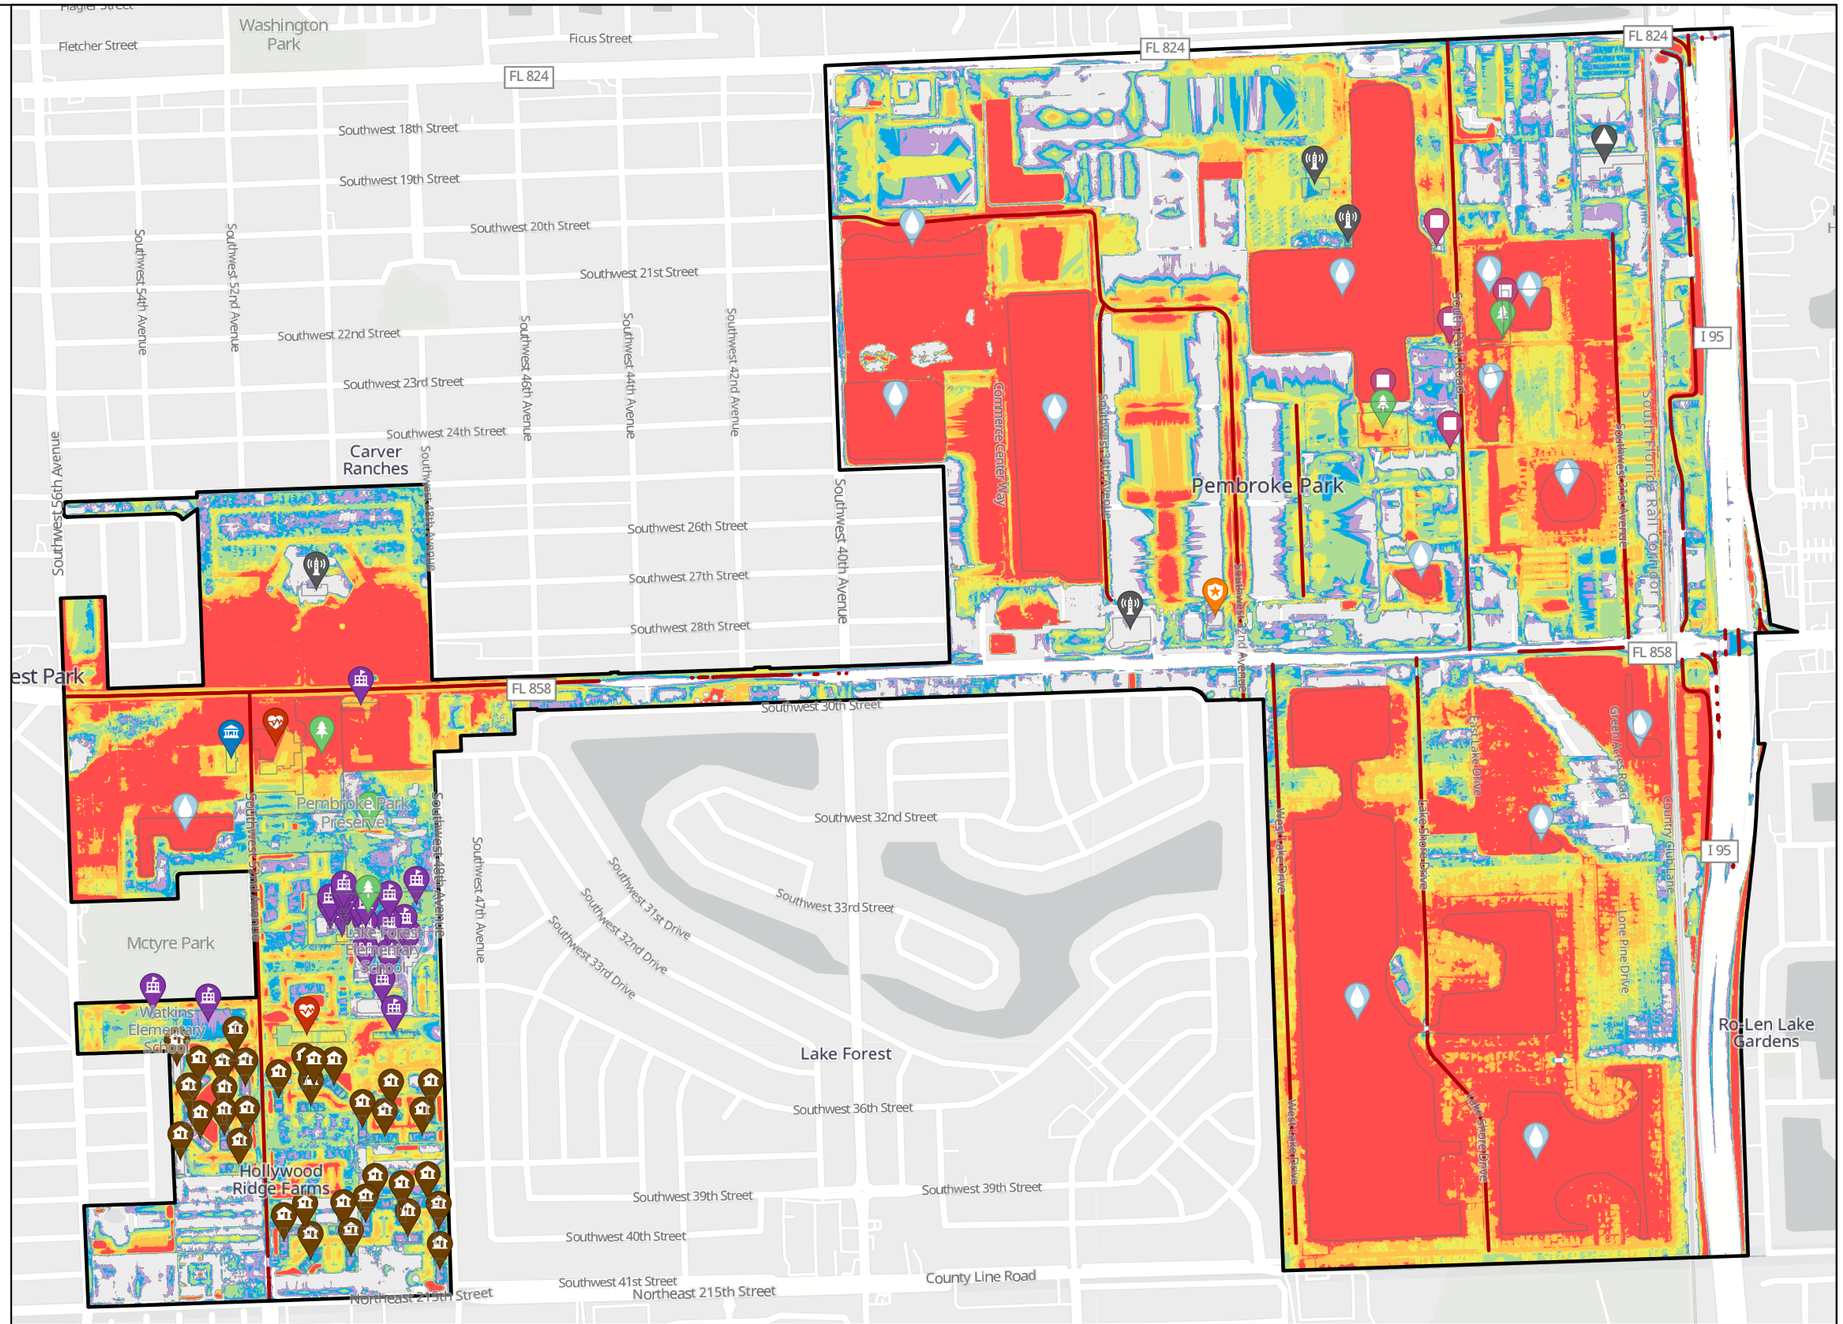


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

RAINFALL-INDUCED FLOODING
500-YEAR/24-HOUR EVENT

Kimley»Horn

FIGURE
A-6



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

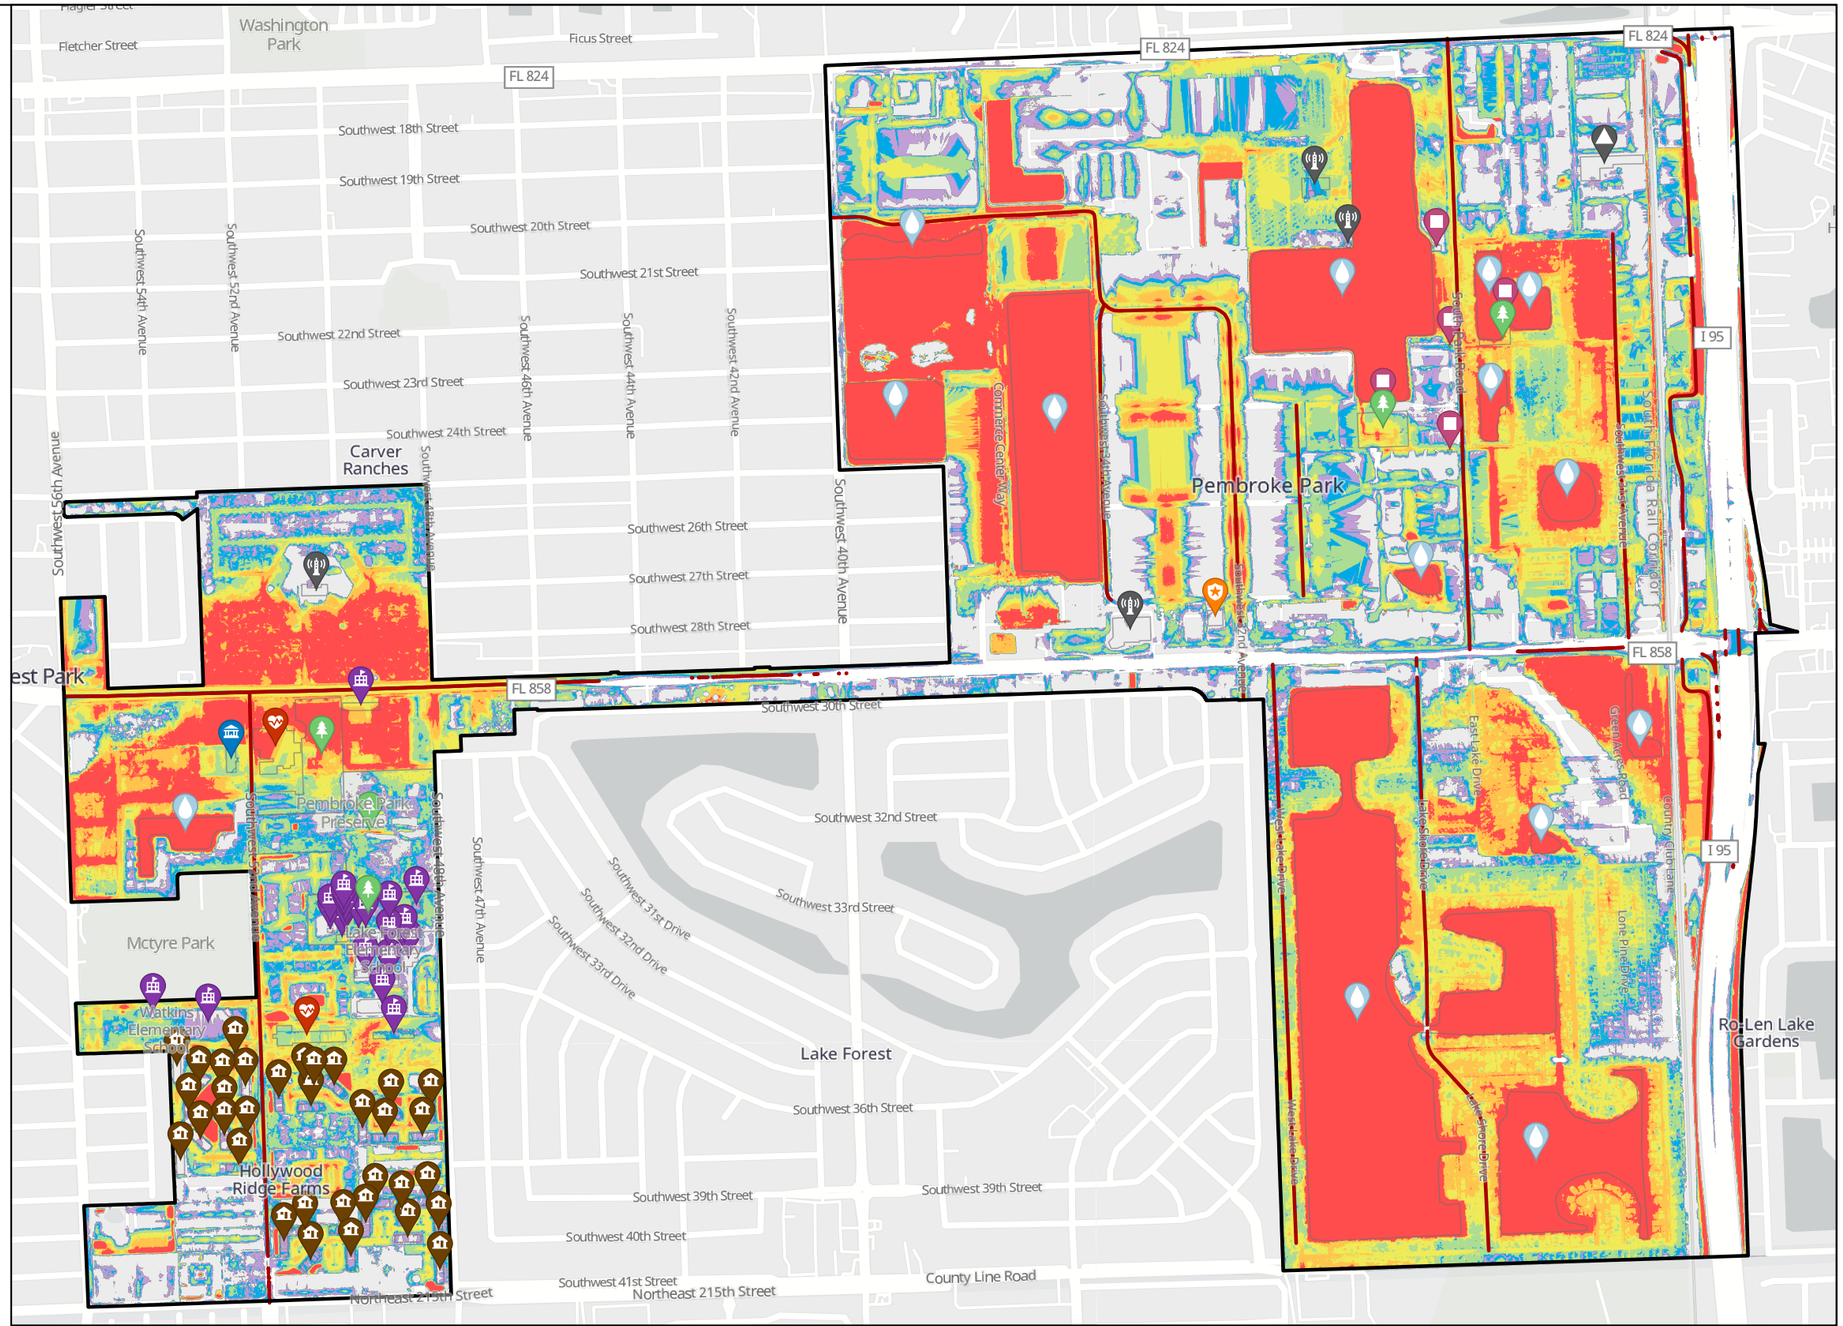


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500YR24HR + INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-7



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

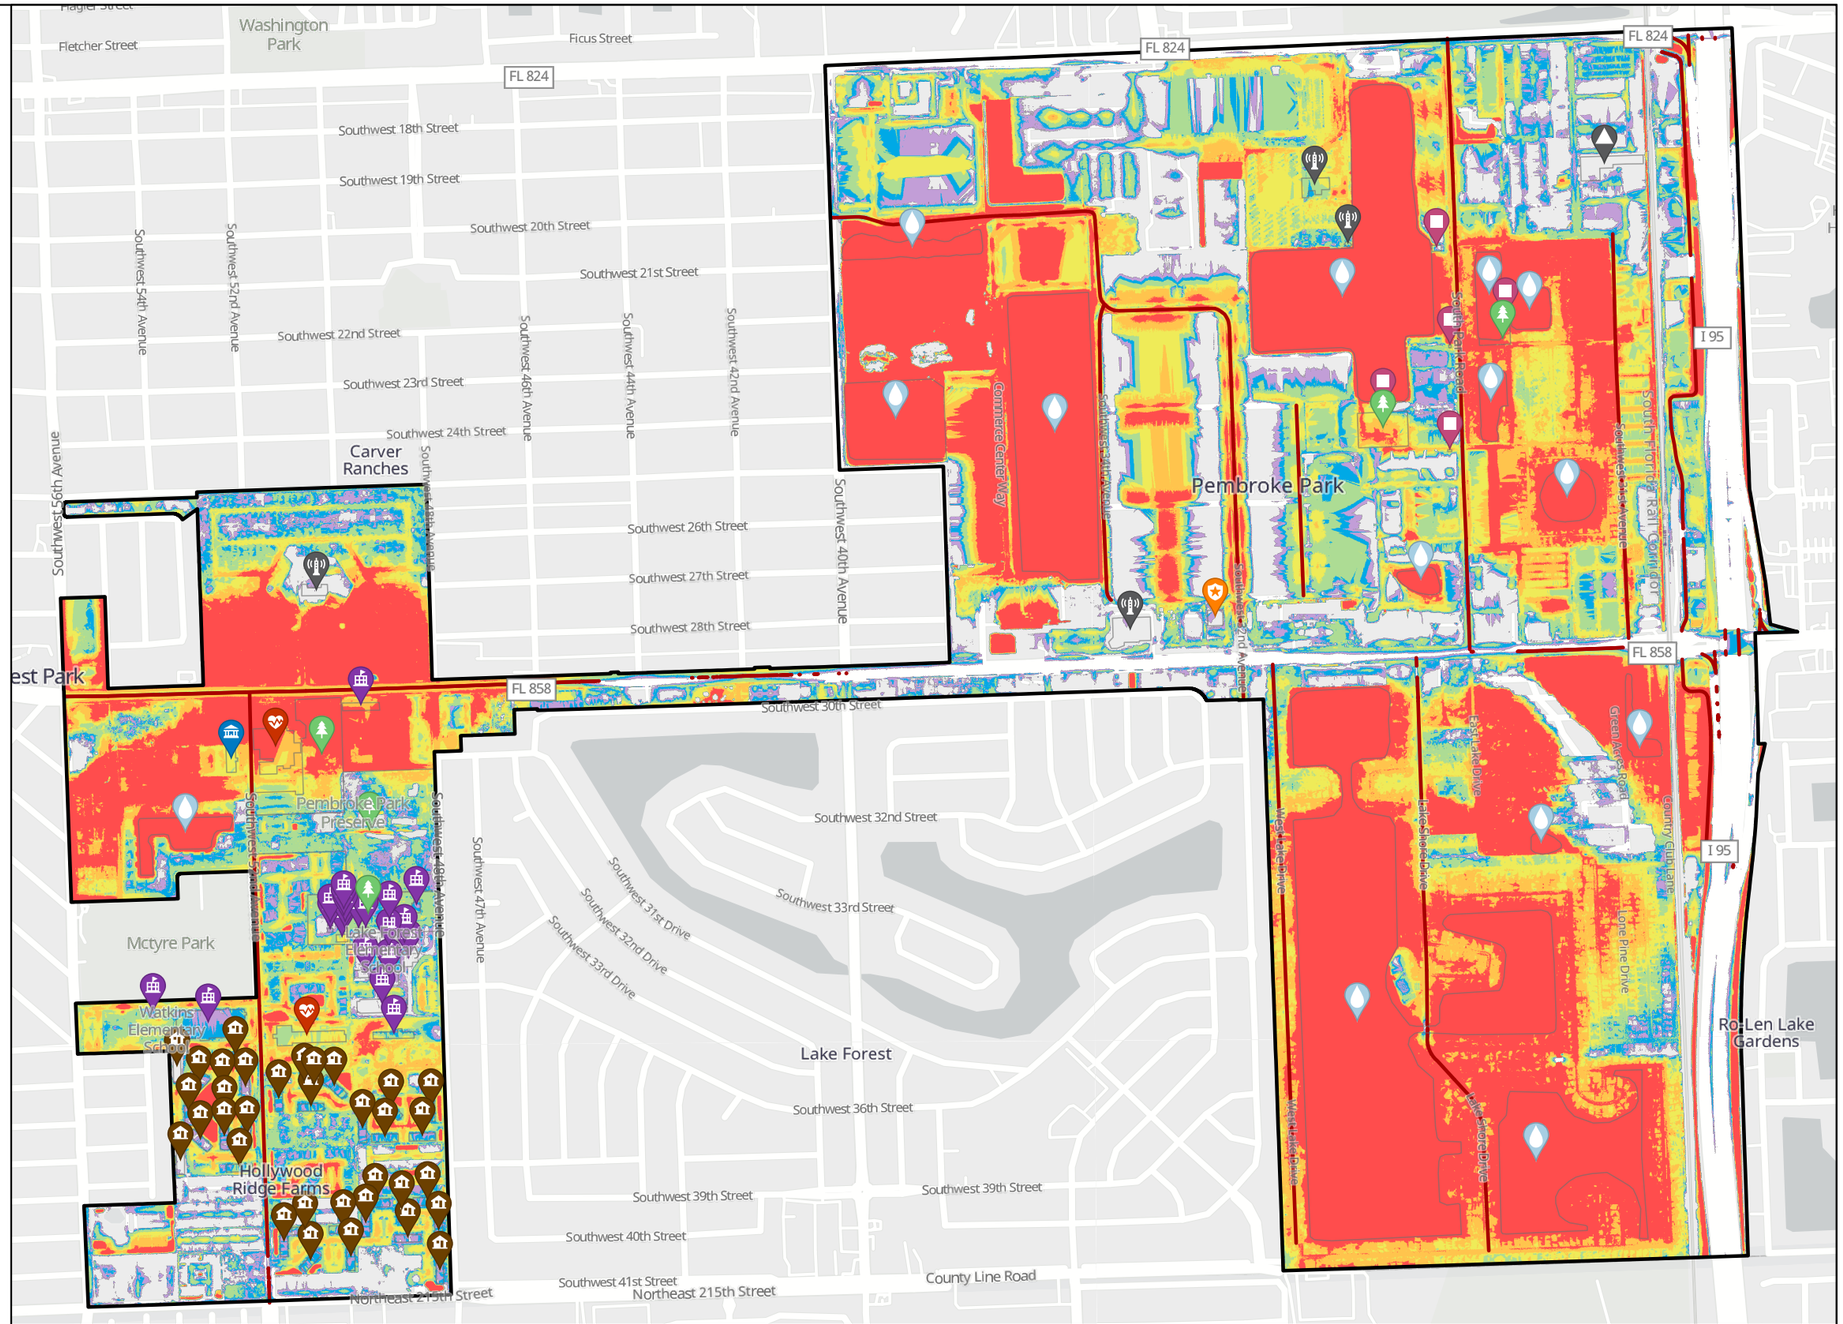


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500YR24HR + INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-8



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

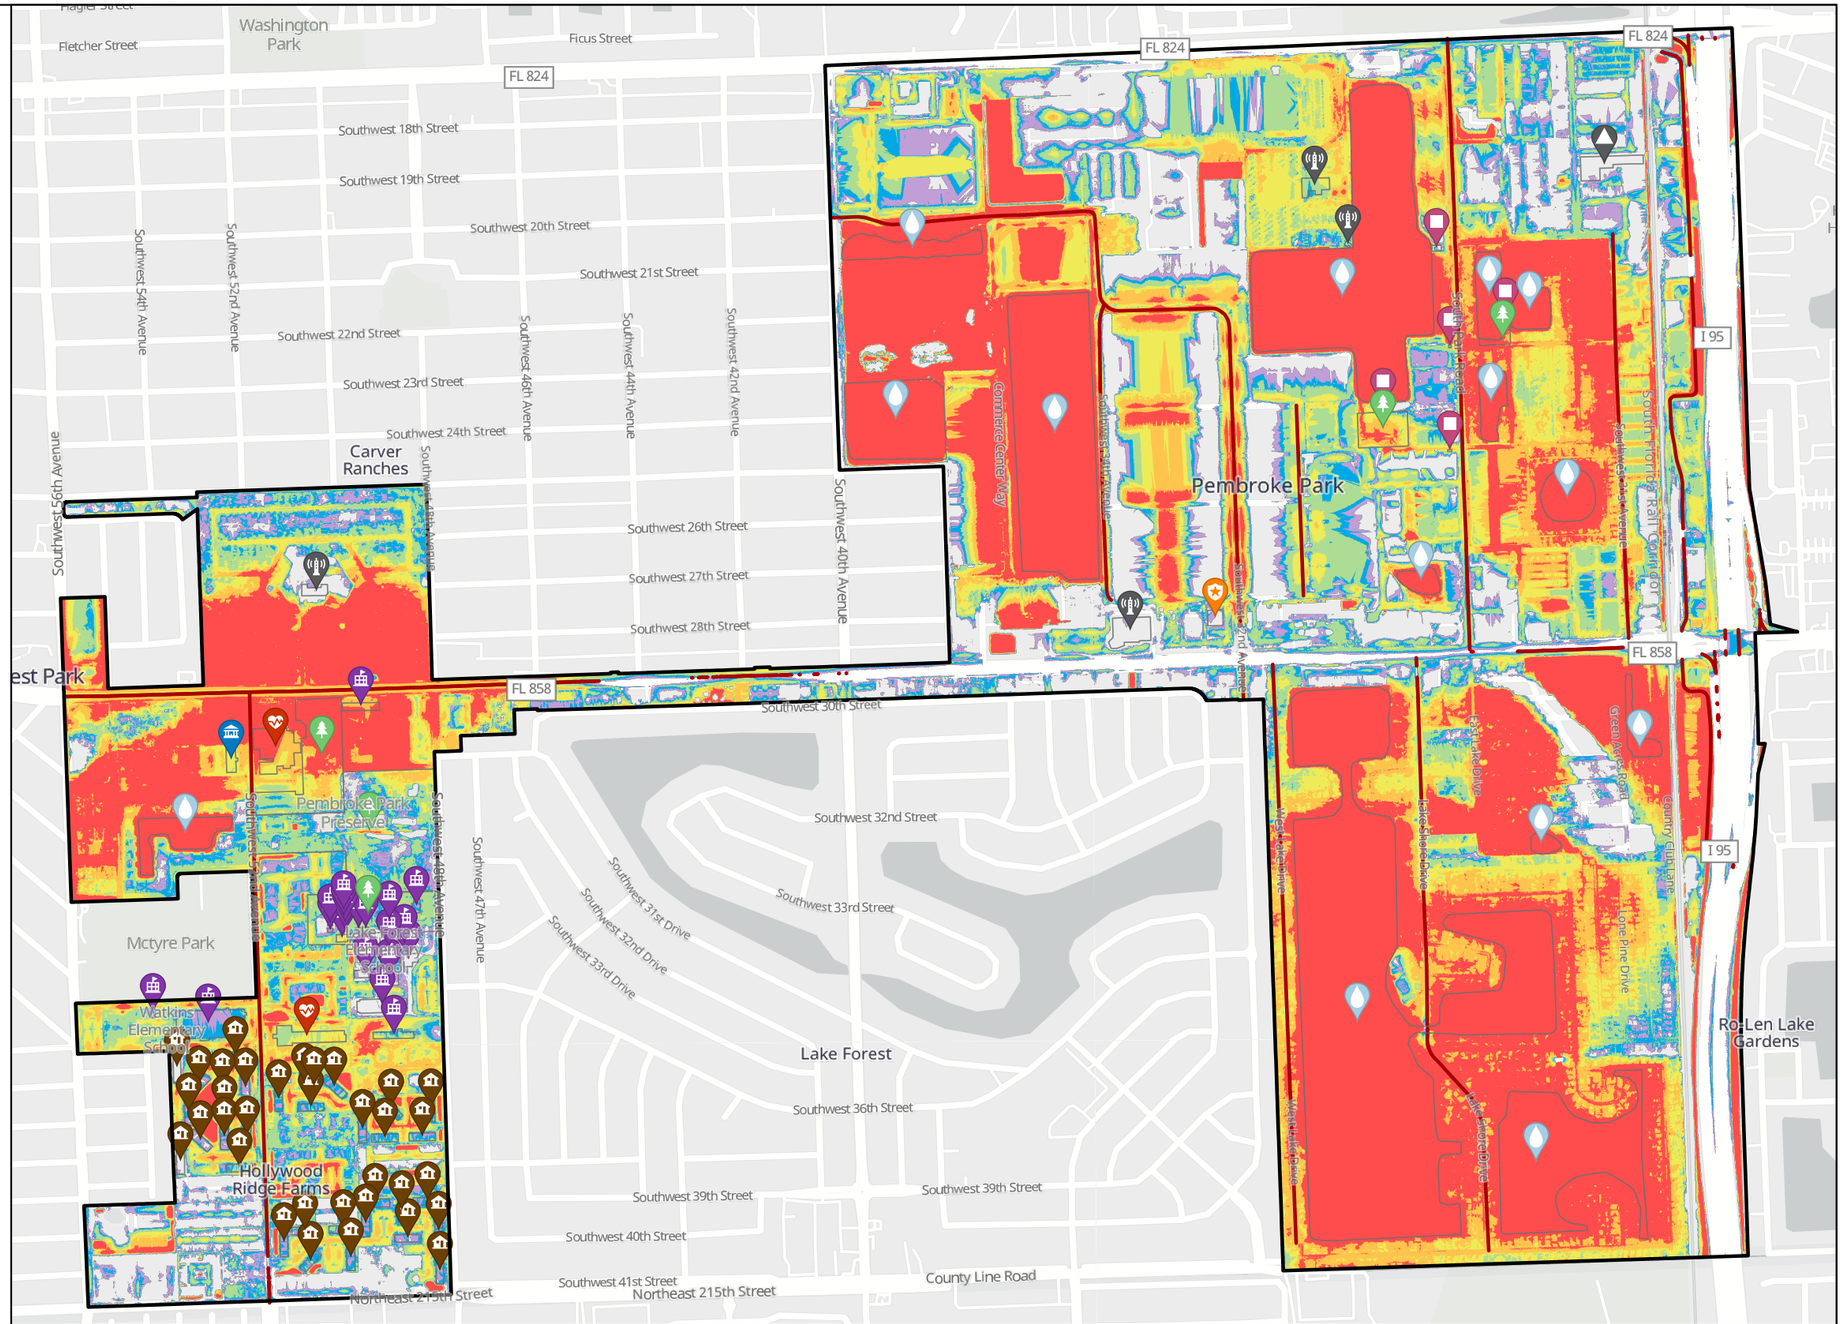


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500YR24HR + INT-LOW 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-9



Legend

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

Washington Park
Fletcher Street
Ficus Street
FL 824
Southwest 18th Street
Southwest 19th Street
Southwest 20th Street
Southwest 21st Street
Southwest 22nd Street
Southwest 23rd Street
Southwest 24th Street
Southwest 26th Street
Southwest 27th Street
Southwest 28th Street
Southwest 30th Street
Southwest 32nd Street
Southwest 33rd Street
Southwest 36th Street
Southwest 39th Street
Southwest 40th Street
Southwest 41st Street
Northeast 215th Street
Southwest 54th Avenue
Southwest 52nd Avenue
Southwest 56th Avenue
Southwest 46th Avenue
Southwest 44th Avenue
Southwest 42nd Avenue
Southwest 40th Avenue
Southwest 47th Avenue
Carver Ranches
Pembroke Park
Commerce Center Way
Southwest 72nd Avenue
South Flamingo Road
Southwest 62nd Avenue
FL 858
I 95
Pembroke Park Preserve
Mctyre Park
Lake Forest Elementary School
Watkins Elementary School
Hollywood Ridge Farms
Lake Forest
Ro-Len Lake Gardens
Lake Shore Drive
Green Acres Road
Long Pine Drive
County Line Road


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500YR24HR + INT-HIGH 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE
A-10



Legend

- Town Boundary

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

Washington Park
Fletcher Street
Ficus Street
FL 824
Southwest 18th Street
Southwest 19th Street
Southwest 20th Street
Southwest 21st Street
Southwest 22nd Street
Southwest 23rd Street
Southwest 24th Street
Southwest 54th Avenue
Southwest 52nd Avenue
Southwest 46th Avenue
Southwest 44th Avenue
Southwest 42nd Avenue
Southwest 40th Avenue
Carver Ranches
Southwest 26th Street
Southwest 27th Street
Southwest 28th Street
Commerce Center Way
Southwest 34th Avenue
Pembroke Park
South Park Road
Southwest 31st Avenue
South Florida Rail Corridor
I 95
FL 858
Southwest 30th Street
Southwest 32nd Avenue
East Lake Drive
Green Acres Road
Country Club Lane
Southwest 32nd Street
Southwest 31st Drive
Southwest 32nd Drive
Southwest 33rd Drive
Southwest 33rd Street
West Lake Drive
Lake Shore Drive
Lone Pine Drive
Ro-Len Lake Gardens
Pembroke Park Preserve
Southwest 47th Avenue
Mctyre Park
Lake Forest Elementary School
Watkins Elementary School
Lake Forest
Southwest 36th Street
Hollywood Ridge Farms
Southwest 39th Street
Southwest 40th Street
Southwest 41st Street
Northeast 215th Street
County Line Road


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

CURRENT KING TIDE WITH NOAA MINOR FLOODING THRESHOLD

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-1



Legend

- Town Boundary

Critical Infrastructure

- Pump Station

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

Washington Park
Fletcher Street
Ficus Street
FL 824
Southwest 18th Street
Southwest 19th Street
Southwest 20th Street
Southwest 21st Street
Southwest 22nd Street
Southwest 23rd Street
Southwest 24th Street
Southwest 54th Avenue
Southwest 52nd Avenue
Southwest 46th Avenue
Southwest 44th Avenue
Southwest 42nd Avenue
Southwest 40th Avenue
Carver Ranches
Southwest 26th Street
Southwest 27th Street
Southwest 28th Street
Commerce Center Way
Southwest 34th Avenue
Pembroke Park
South Park Road
Southwest 31st Avenue
South Florida Rail Corridor
I 95
FL 858
Southwest 30th Street
Southwest 32nd Avenue
Pembroke Park Preserve
Southwest 32nd Street
Southwest 31st Drive
Southwest 32nd Drive
Southwest 33rd Drive
Southwest 33rd Street
Southwest 47th Avenue
Mctyre Park
Lake Forest Elementary School
Watkins Elementary School
Lake Forest
Southwest 36th Street
Hollywood Ridge Farms
Southwest 39th Street
Southwest 40th Street
Southwest 41st Street
Northeast 215th Street
County Line Road
East Lake Drive
Green Acres Road
Lake Shore Drive
West Lake Drive
Country Club Lane
Lone Pine Drive
Ro-Len Lake Gardens


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-2



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway

Critical Infrastructure


- Pump Station

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

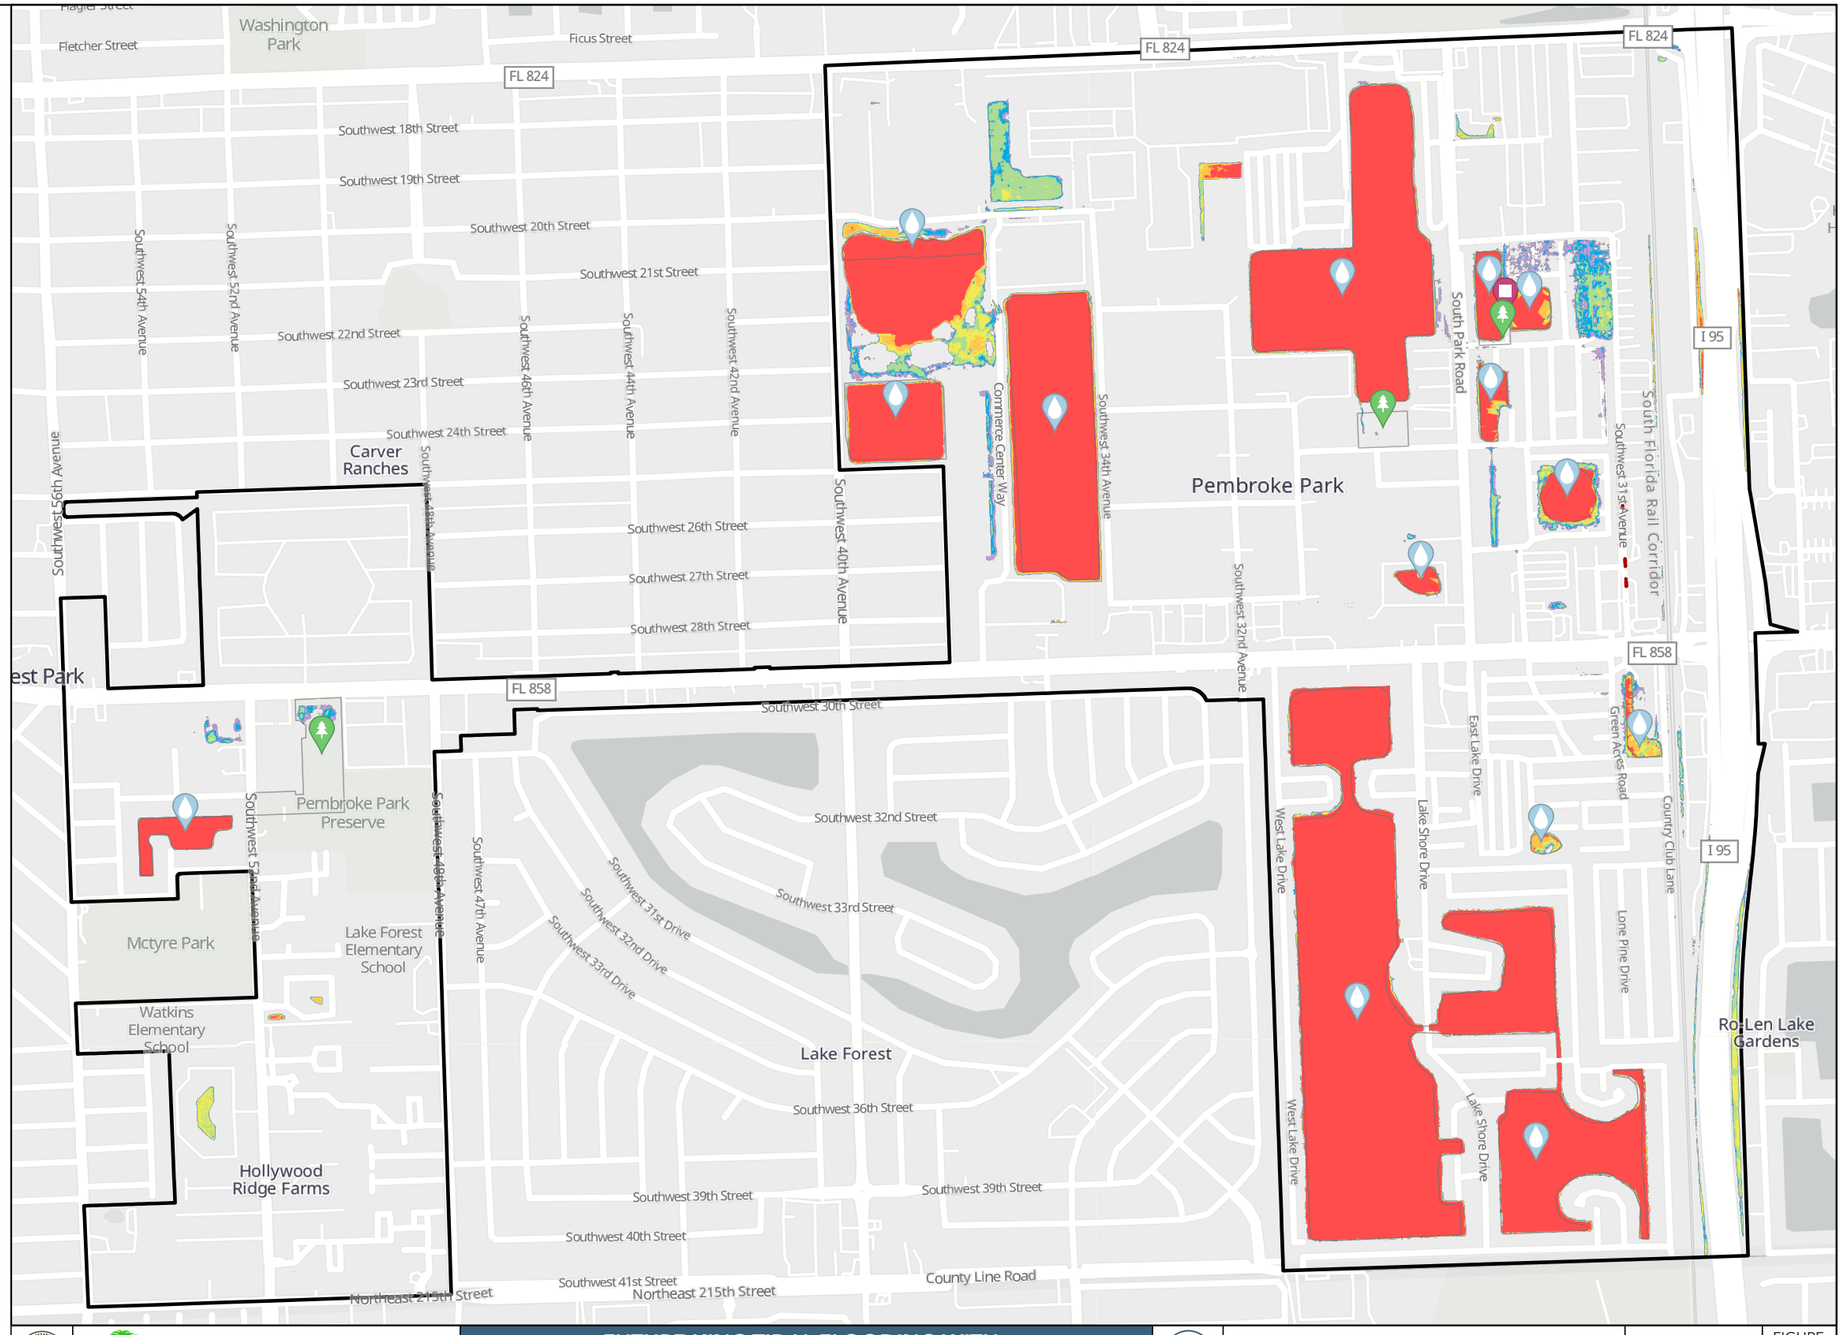


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-3



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway

Critical Infrastructure

- Pump Station

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

Washington Park
Fletcher Street
Ficus Street
FL 824
Southwest 18th Street
Southwest 19th Street
Southwest 20th Street
Southwest 21st Street
Southwest 22nd Street
Southwest 23rd Street
Southwest 24th Street
Southwest 26th Street
Southwest 27th Street
Southwest 28th Street
Southwest 30th Street
Southwest 32nd Street
Southwest 33rd Street
Southwest 36th Street
Southwest 39th Street
Southwest 40th Street
Southwest 41st Street
Northeast 215th Street
Southwest 54th Avenue
Southwest 52nd Avenue
Southwest 46th Avenue
Southwest 44th Avenue
Southwest 42nd Avenue
Southwest 40th Avenue
Southwest 47th Avenue
Carver Ranches
Commerce Center Way
Southwest 34th Avenue
Pembroke Park
South Park Road
Southwest 31st Avenue
South Florida Rail Corridor
I 95
FL 858
Southwest 32nd Avenue
East Lake Drive
Green Acres Road
Country Club Lane
Lake Shore Drive
West Lake Drive
Lone Pine Drive
Ro-Len Lake Gardens
Pembroke Park Preserve
Southwest 31st Drive
Southwest 32nd Drive
Southwest 33rd Drive
Mctyre Park
Lake Forest Elementary School
Watkins Elementary School
Lake Forest
Hollywood Ridge Farms
Southwest 39th Street
County Line Road
Northeast 215th Street


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-LOW 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-4



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway

Critical Infrastructure

- Communications Facility
- Pump Station

Critical Community and Emergency Facilities


- Health Care Facility
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

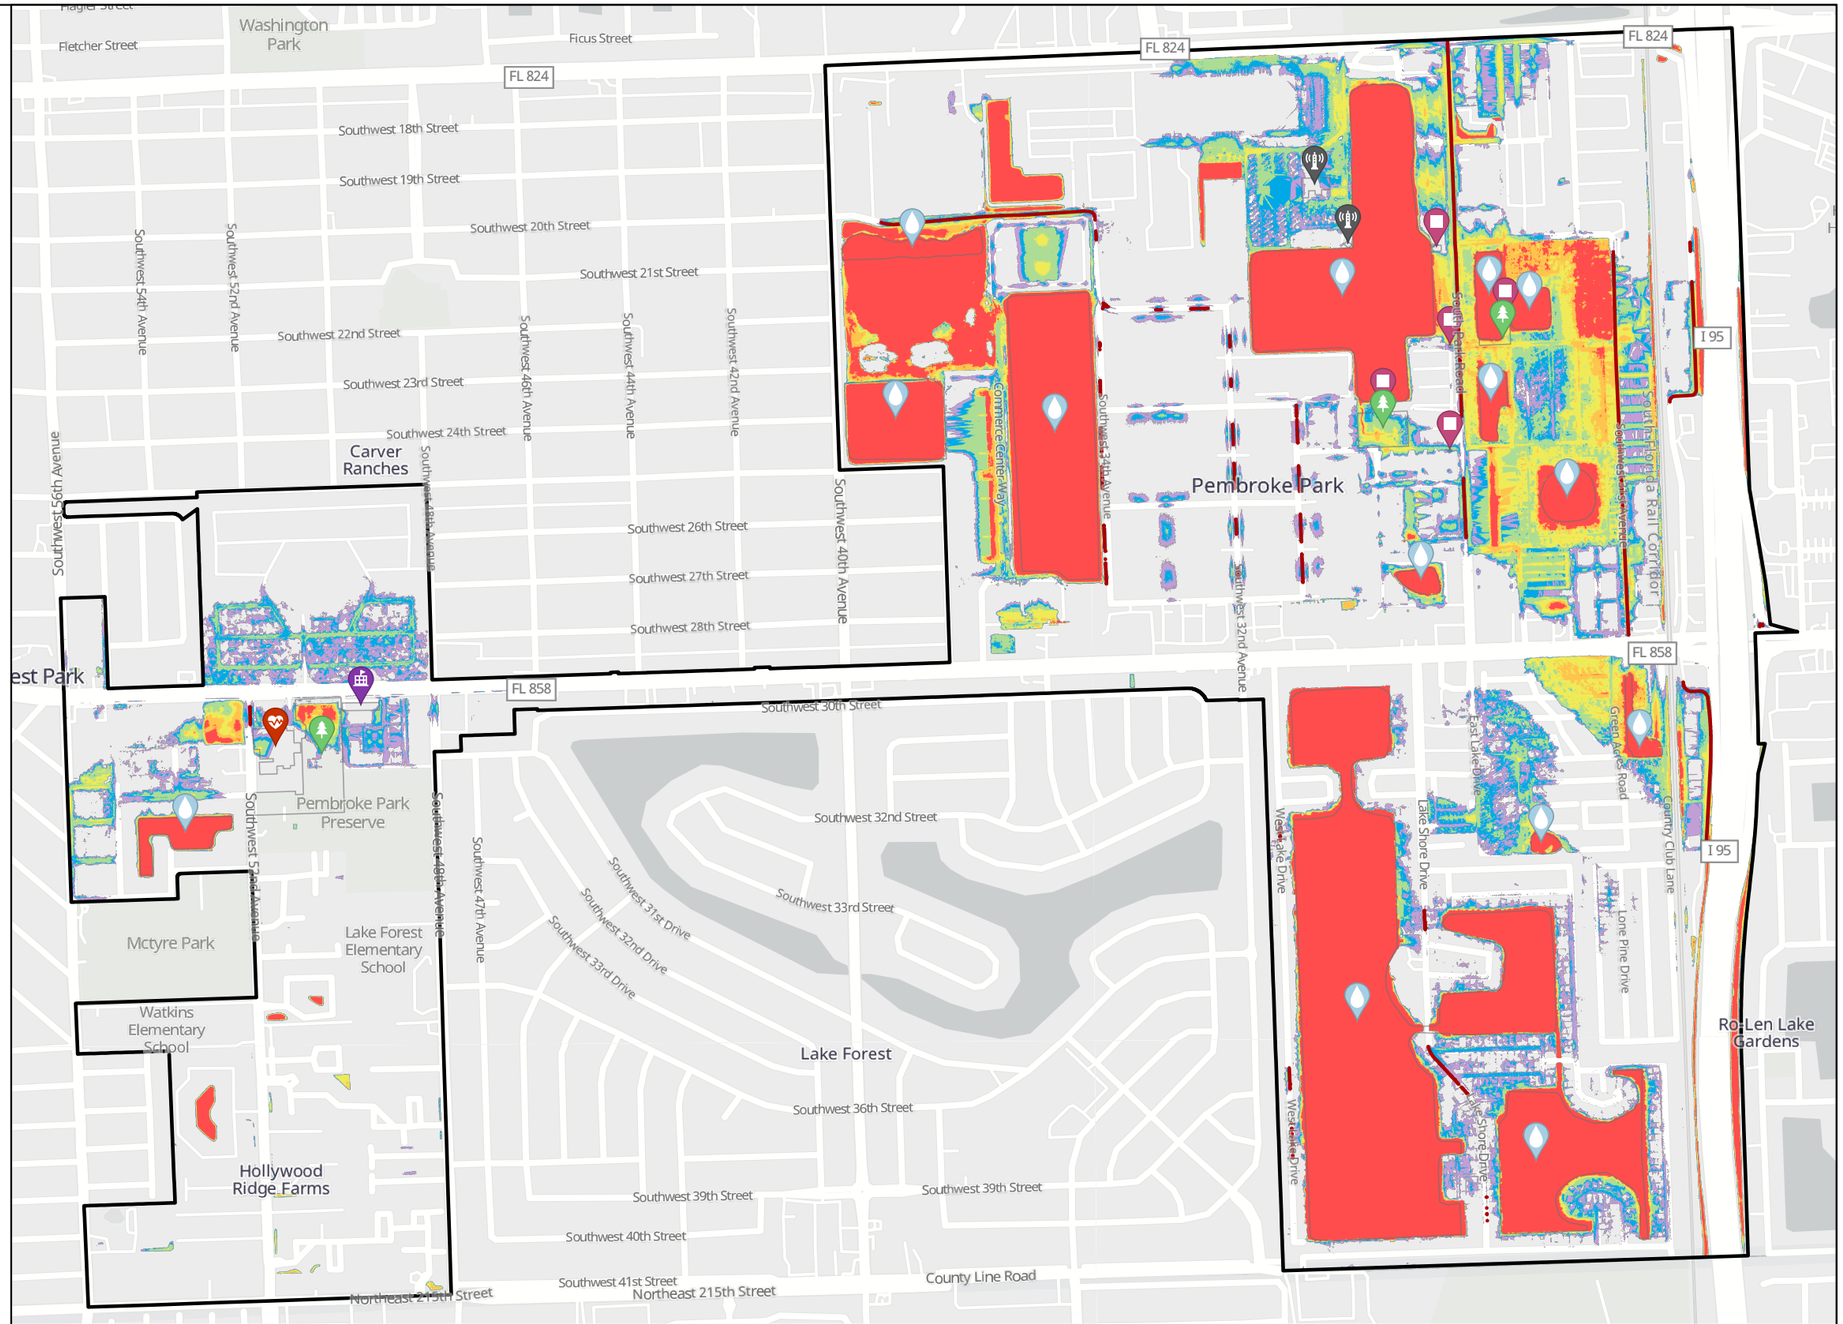


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-HIGH 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-5



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station

Critical Community and Emergency Facilities

- Health Care Facility
- Law Enforcement Facility
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

Washington Park
Fletcher Street
Ficus Street
FL 824
Southwest 18th Street
Southwest 19th Street
Southwest 20th Street
Southwest 21st Street
Southwest 22nd Street
Southwest 23rd Street
Southwest 24th Street
Southwest 26th Street
Southwest 27th Street
Southwest 28th Street
Southwest 30th Street
Southwest 32nd Street
Southwest 33rd Street
Southwest 36th Street
Southwest 39th Street
Southwest 40th Street
Southwest 41st Street
Northeast 215th Street
Southwest 54th Avenue
Southwest 52nd Avenue
Southwest 56th Avenue
Southwest 46th Avenue
Southwest 44th Avenue
Southwest 42nd Avenue
Southwest 40th Avenue
Southwest 47th Avenue
Carver Ranches
Pembroke Park
Commerce Center Way
Southwest 32nd Avenue
South Florida Rail Corridor
I 95
FL 858
Pembroke Park Preserve
Southwest Sandy Avenue
Mctyre Park
Lake Forest Elementary School
Watkins Elementary School
Hollywood Ridge Farms
Lake Forest
Southwest 31st Drive
Southwest 32nd Drive
Southwest 33rd Drive
Lake Shore Drive
Green River Road
County Club Lane
Ro-Len Lake Gardens
County Line Road


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

CURRENT STORM SURGE

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-1



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Facility
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

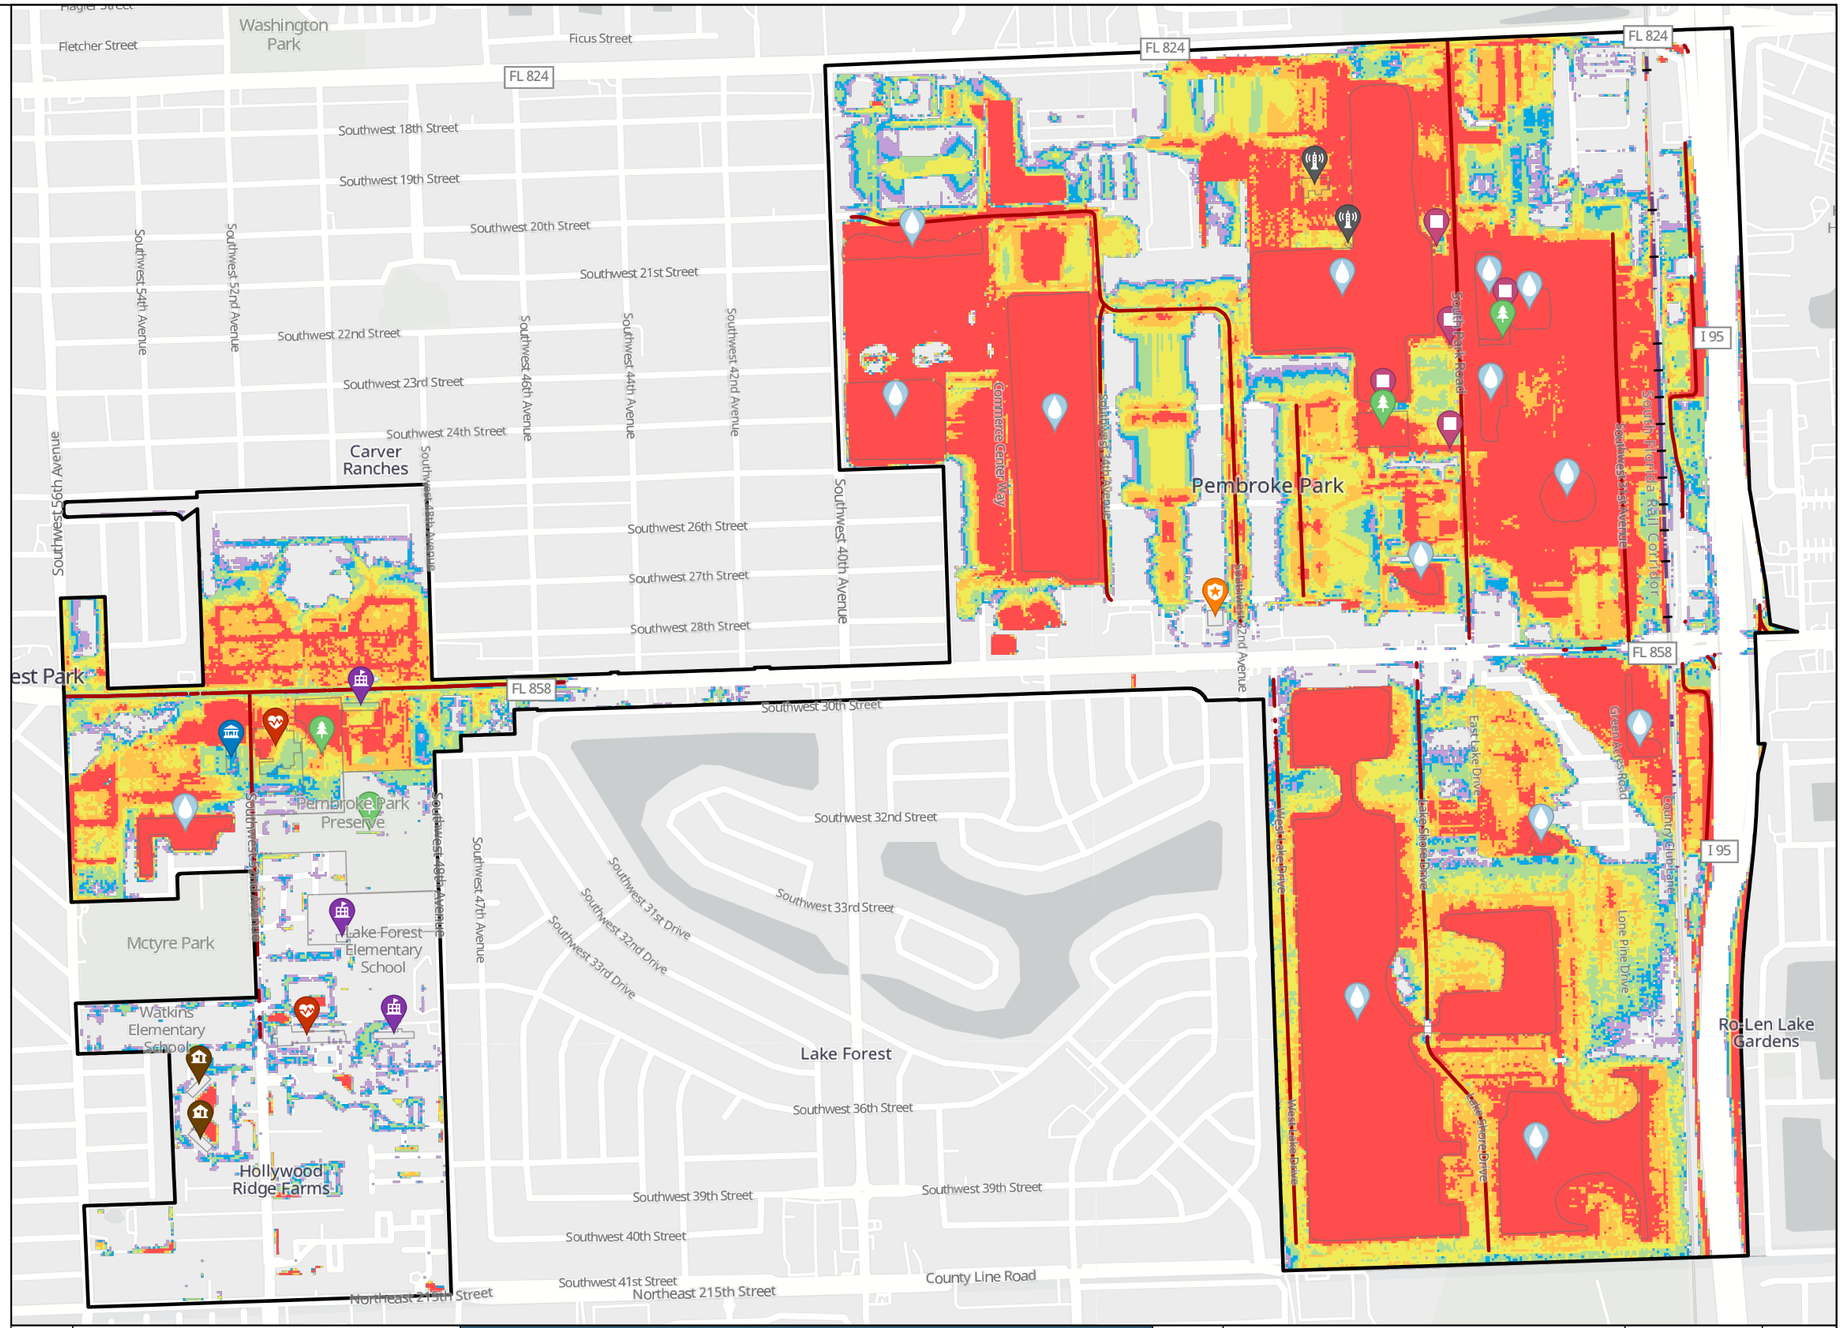


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

STORM SURGE WITH SLR INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-2



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Facility
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

STORM SURGE WITH SLR INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-3



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Facility
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Facility
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

STORM SURGE WITH SLR INT-HIGH 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-5



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR24HR + CURRENT KING TIDE

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-1



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

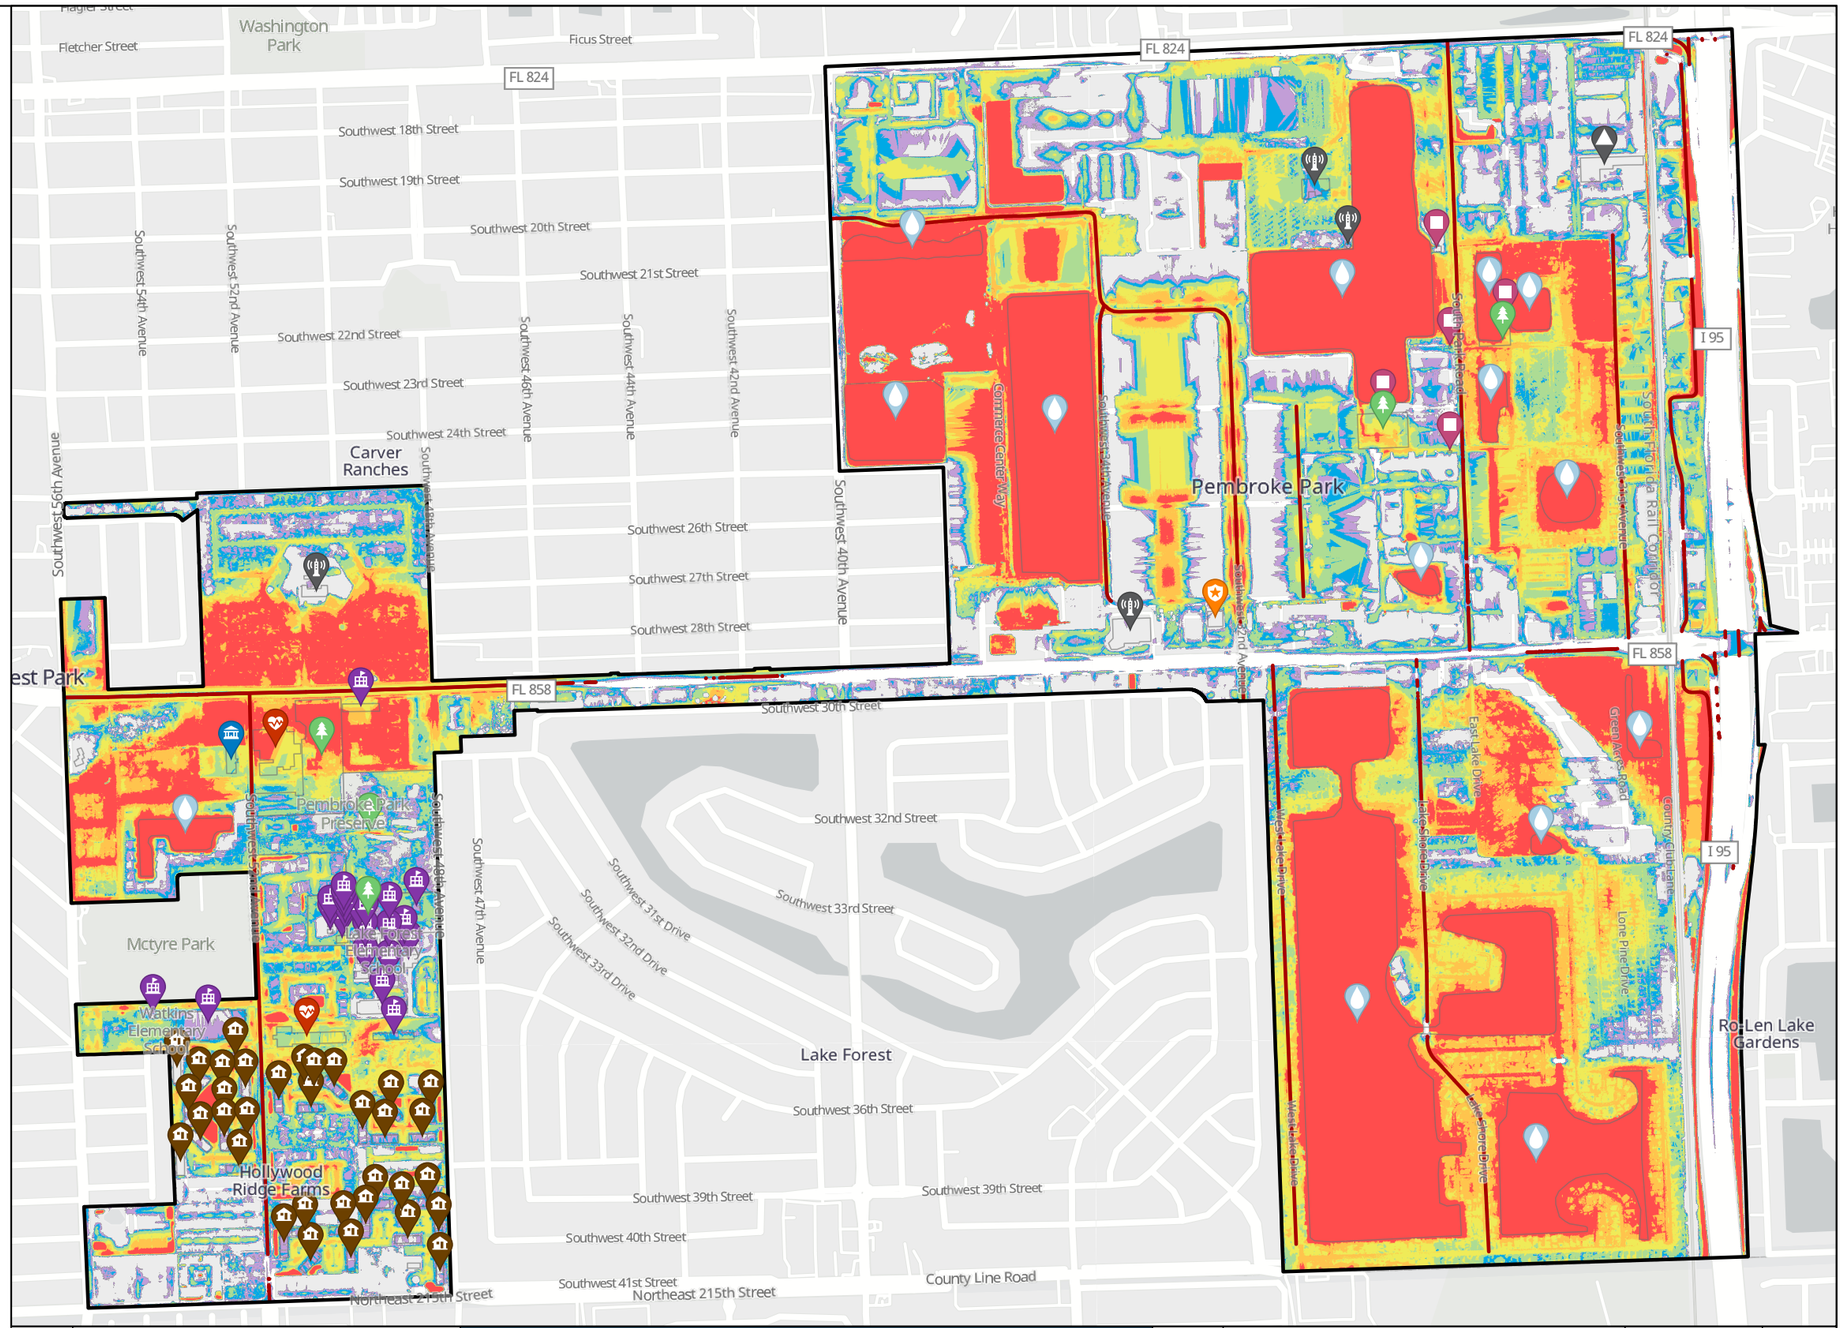


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-LOW 2040)

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-2



Legend

- Town Boundary


Transportation Assets and Evacuation Route
- Major Roadway
- Railroad

Critical Infrastructure
- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities
- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets
- Park
- Surface Water

Flood Depth (ft)
- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

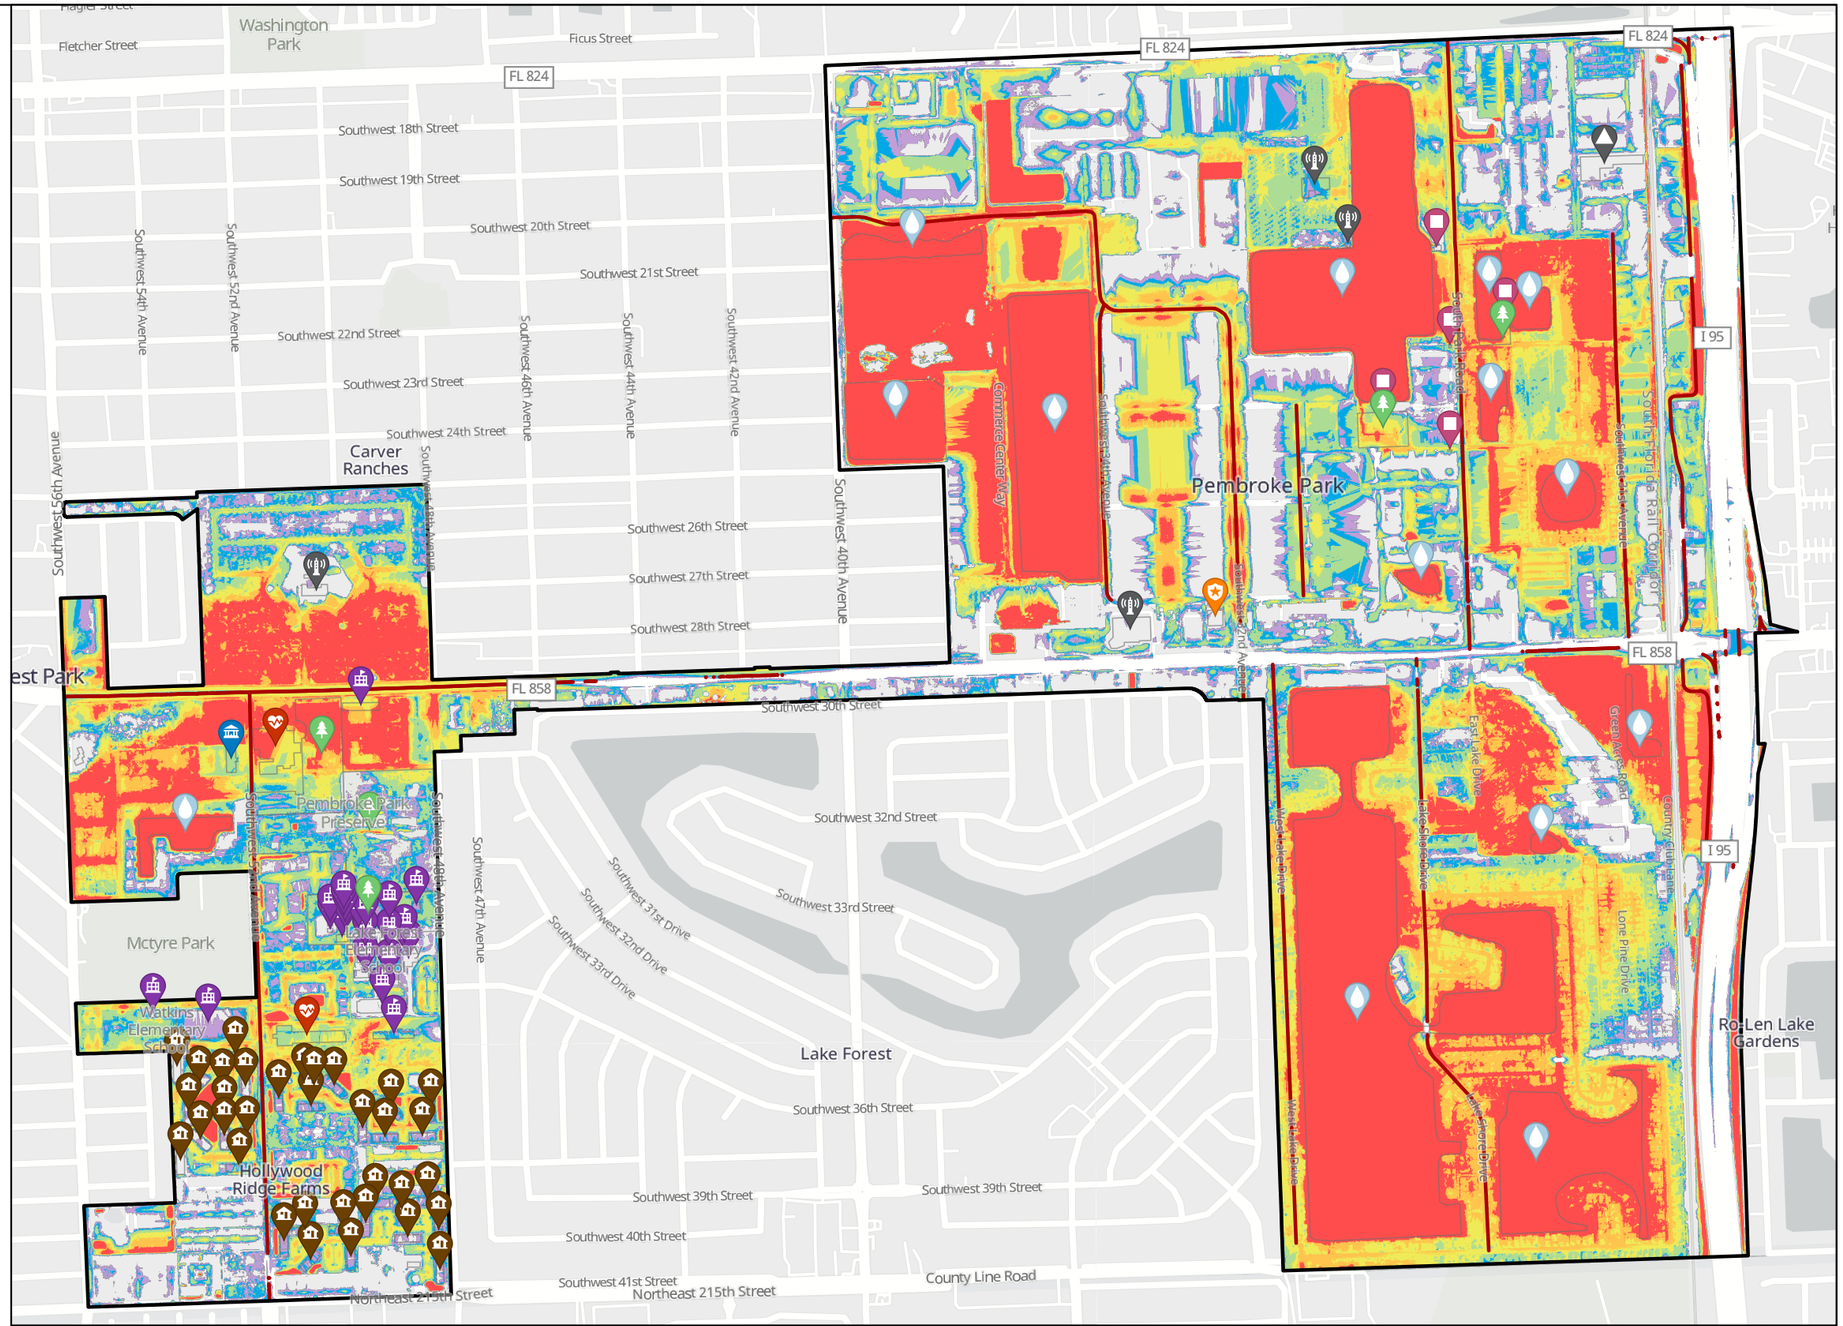


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-HIGH 2040)

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-3



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

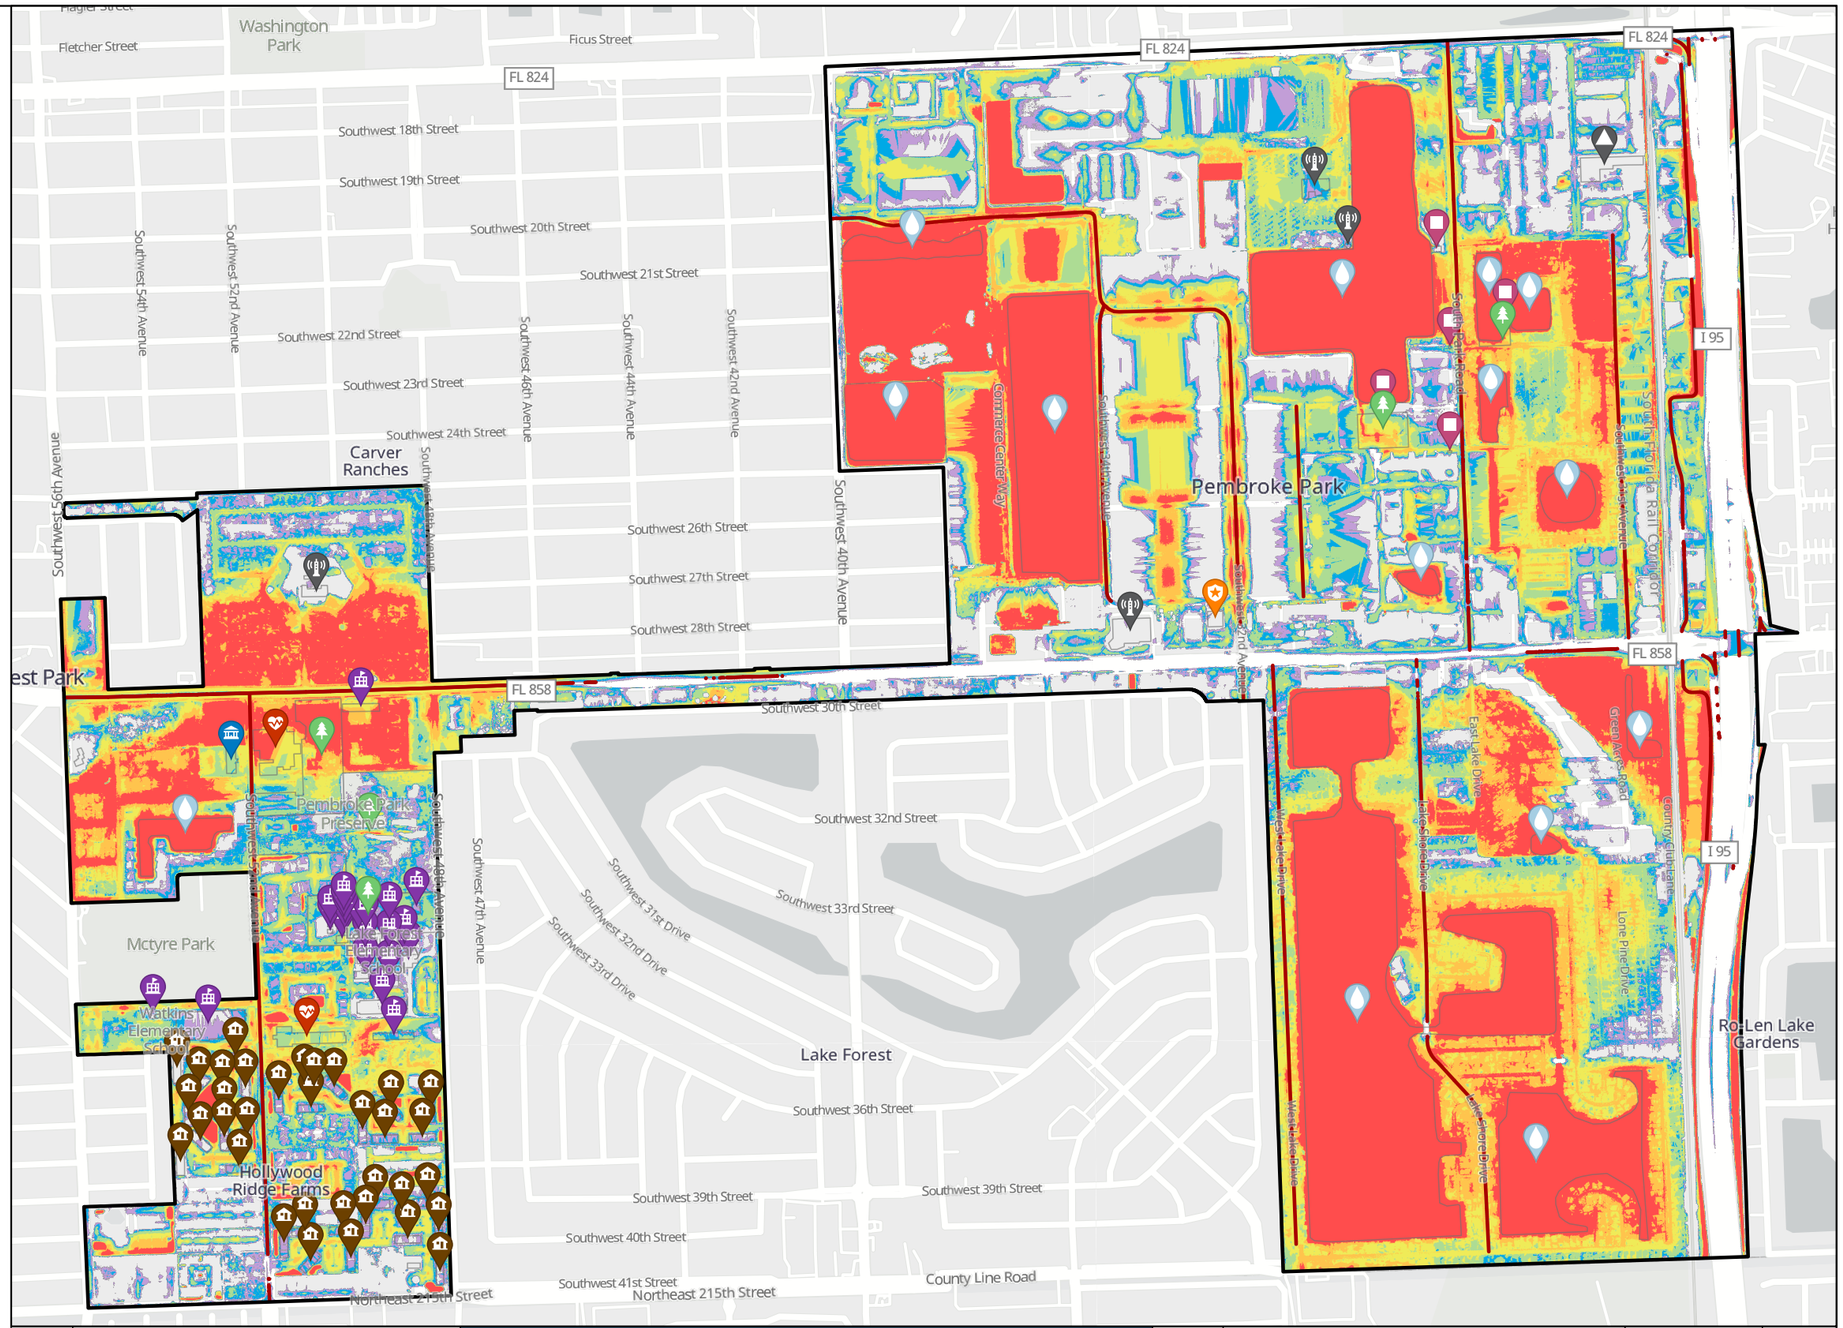


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-LOW 2070)

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-4



Legend

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities


- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility & Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Flood Depth (ft)

- < 0.25
- 0.25 - 0.50
- 0.50 - 1
- 1.0 - 1.5
- 1.50 - 2
- > 2.0

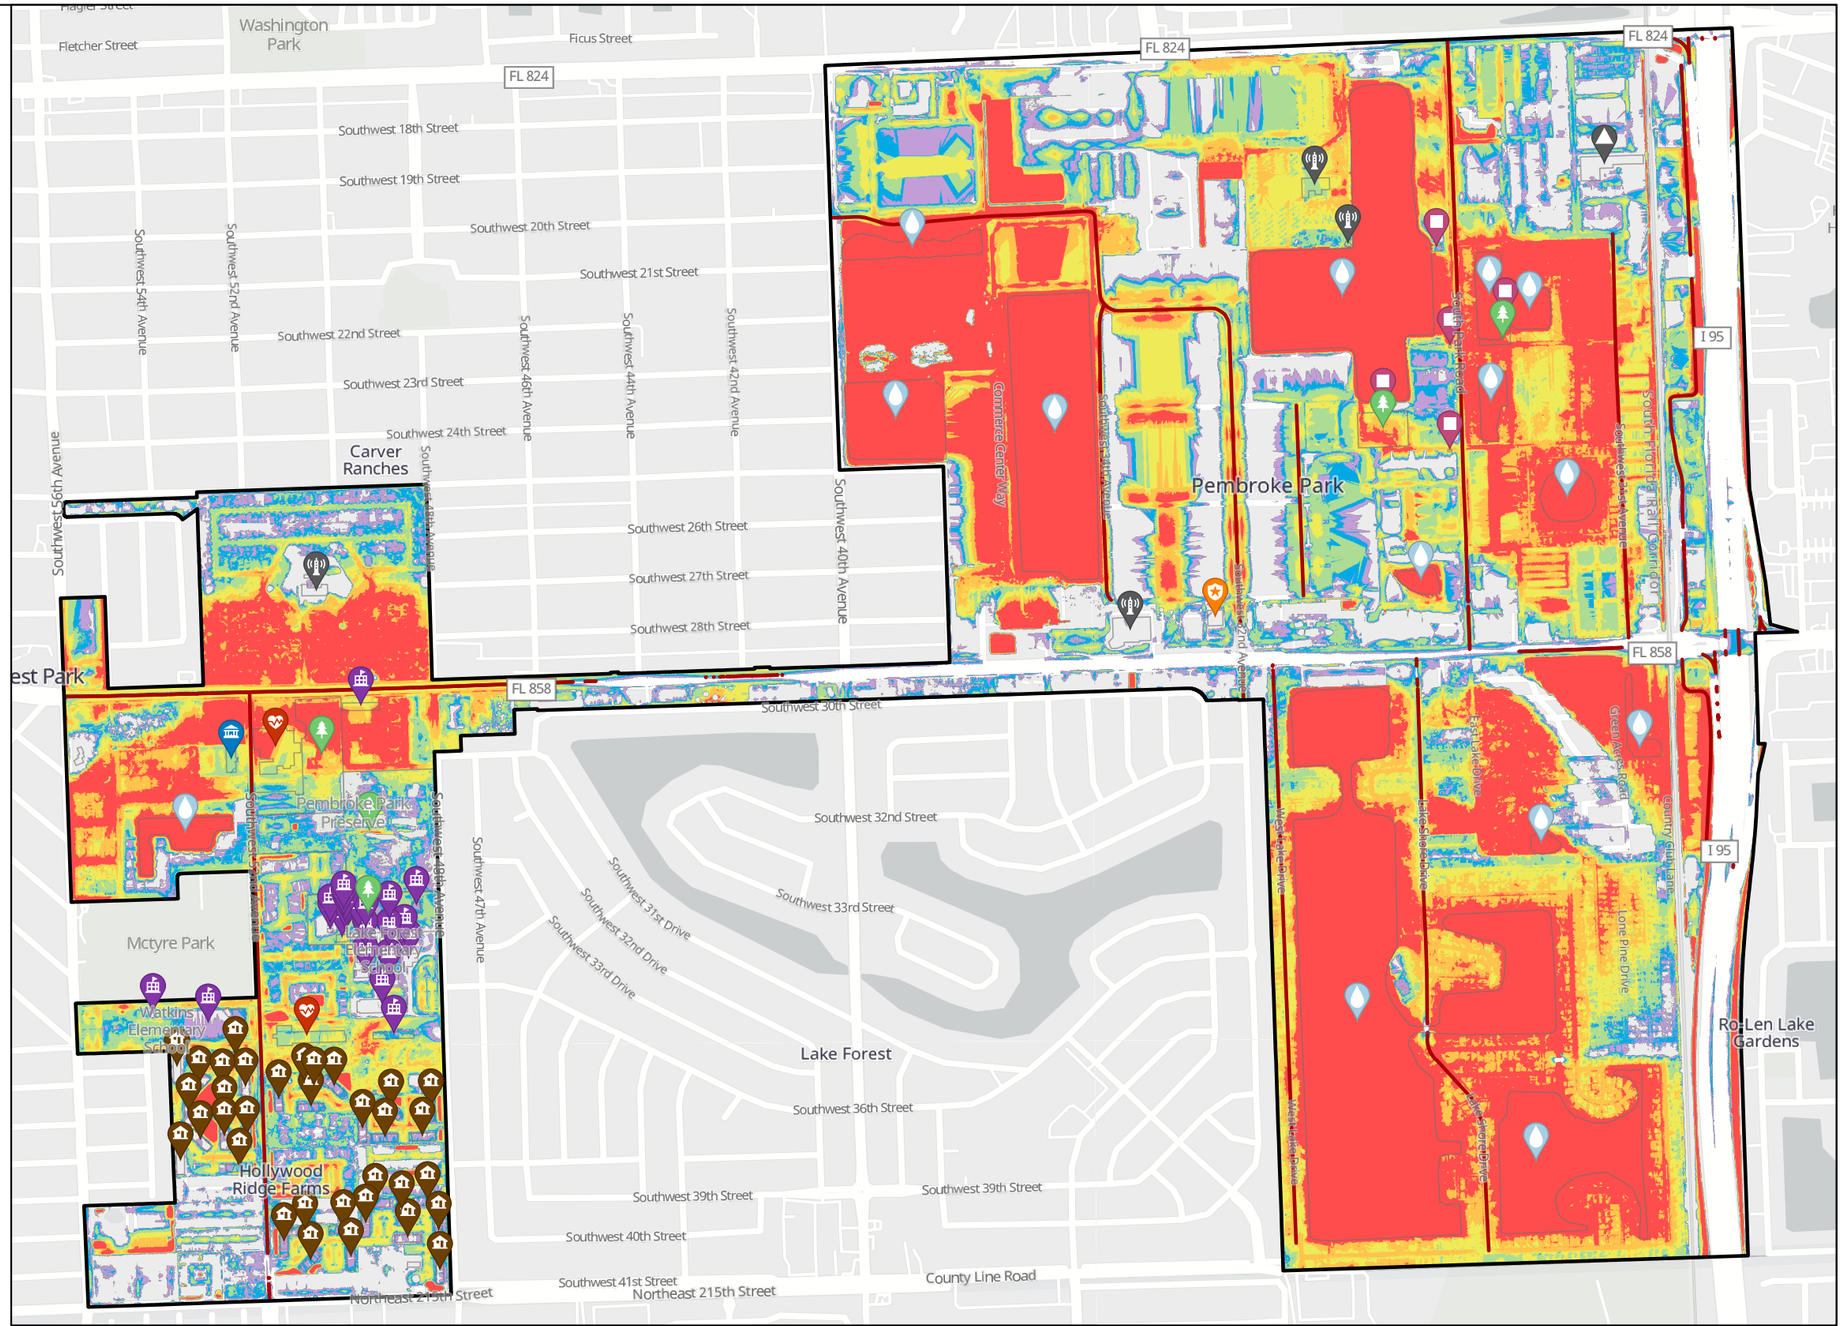

TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-HIGH 2070)

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-5

APPENDIX E

SENSITIVITY ANALYSIS PAIRED ASSET-THREAT MATRICES

Legend (Transportation Assets and Evacuation Routes)	
Low	Flooding < 0.5-ft
Medium	Flood depths greater than 0.5-ft and less than 2-ft
High	Permanent (SLR) flooding, flood depths >2-ft

Table E-1. Paired Asset-Threat Matrix for Tranportation Assets and Evacuation Routes

Asset Name	Asset Type	Scenario Criticality																								
		100Y72H	Projected - 100Y72H IL2040	Projected - 100Y72H IH2040	Projected - 100Y72H IL2070	Projected - 100Y72H IH2070	500Y72H	Projected - 500Y72H IL2040	Projected - 500Y72H IH2040	Projected - 500Y72H IL2070	Projected - 500Y72H IH2070	CURRENT STORM SURGE	STORM SURGE + IL2040	STORM SURGE + IH2040	STORM SURGE + IL2070	STORM SURGE + IH2070	CURRENT KING TIDE	FUTURE KING TIDE IL2040	FUTURE KING TIDE IH2040	FUTURE KING TIDE IL2070	FUTURE KING TIDE IH2070	COMPOUND - 100YR + CURRENT KING TIDE	COMPOUND - 100YR + FUTURE KING TIDE IL2040	COMPOUND - 100YR + FUTURE KING TIDE IH2040	COMPOUND - 100YR + FUTURE KING TIDE IL2070	COMPOUND - 100YR + FUTURE KING TIDE IH2070
I95 RAMP	Major Roadways	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
S PARK RD	Major Roadways	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	-	H	H	H	H	H
I95	Major Roadways	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
SW 20TH ST	Major Roadways	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	H	H	H	H	H	H
W LAKE DR	Major Roadways	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	-	-	-	-	M	H	H	H	H	H
LAKE SHORE DR	Major Roadways	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	-	-	-	-	H	H	H	H	H	H
SW 30TH AVE	Major Roadways	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	H	H	H	H	H	H
JOHN P LYONS LN	Major Roadways	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	M	M	H	H	H	H	H	H
SW 32ND AVE	Major Roadways	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	-	-	-	-	M	H	H	H	H	H
SW 34TH AVE	Major Roadways	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	M	H	H	H	H	H
SW 32ND TER	Major Roadways	M	M	M	M	M	M	M	M	M	M	M	H	H	H	H	-	-	-	-	M	M	M	M	M	M
SW 22ND ST	Major Roadways	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	-	-	-	-	L	H	H	H	H	H
SW 52ND AVE	Major Roadways	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	-	-	-	-	L	H	H	H	H	H
HALLANDALE BEACH BLVD	Major Roadways	M	M	M	M	M	M	M	M	M	M	M	M	H	M	H	-	-	-	-	-	M	M	M	M	M
Amtrak & Commuter	Rail Facilities	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	-	H	H	H	H	H

Legend (Critical Infrastructure)	
Low	Flooding < 0.5-ft
Medium	Flood depths greater than 0.5-ft and less than 2-ft
High	Permanent (SLR) flooding, flood depths >2-ft

Table E-2. Paired Asset-Threat Matrix for Critical Infrastructure

Asset Name	Asset Type	Scenario Criticality																							
		100Y72H	Projected - 100Y72H IL2040	Projected - 100Y72H IH2040	Projected - 100Y72H IL2070	Projected - 100Y72H IH2070	500Y72H	Projected - 500Y72H IL2040	Projected - 500Y72H IH2040	Projected - 500Y72H IL2070	Projected - 500Y72H IH2070	CURRENT STORM SURGE	STORM SURGE + IL2040	STORM SURGE + IH2040	STORM SURGE + IL2070	STORM SURGE + IH2070	CURRENT KING TIDE	FUTURE KING TIDE IL2040	FUTURE KING TIDE IH2040	FUTURE KING TIDE IL2070	FUTURE KING TIDE IH2070	COMPOUND - 100YR + CURRENT KING TIDE	COMPOUND - 100YR + FUTURE KING TIDE IL2040	COMPOUND - 100YR + FUTURE KING TIDE IH2040	COMPOUND - 100YR + FUTURE KING TIDE IL2070	COMPOUND - 100YR + FUTURE KING TIDE IH2070
Communications Facility	Critical Infrastructure	L	L	L	L	L	L	L	L	L	L	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Communications Facility	Critical Infrastructure	L	L	L	L	L	L	L	L	L	L	-	-	-	-	L	-	-	-	-	-	L	L	L	L	L
Solid and Hazardous Waste Facility, Disaster Dr	Critical Infrastructure	L	L	L	L	L	L	L	L	L	L	-	-	M	L	H	-	-	-	-	-	L	L	L	L	L
Pump Station	Critical Infrastructure	M	M	M	M	M	M	M	M	M	M	H	H	H	H	H	-	-	-	-	L	M	M	M	M	M
Pump Station	Critical Infrastructure	M	M	M	M	H	H	M	H	H	H	H	H	H	H	H	-	-	-	-	M	M	M	M	M	H
Pump Station	Critical Infrastructure	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	M	M	M	H	H	H	H	H	H
Pump Station	Critical Infrastructure	M	M	M	M	M	M	M	M	M	M	M	H	H	H	H	-	-	-	-	M	M	M	M	M	M
Pump Station	Critical Infrastructure	M	M	M	M	H	H	M	H	H	H	H	H	H	H	H	-	-	-	-	M	M	M	M	M	H
Communications Facility	Critical Infrastructure	H	H	H	H	H	H	H	H	H	H	M	M	H	H	H	-	-	-	-	L	H	H	H	H	H
Communications Facility	Critical Infrastructure	M	M	M	M	M	M	M	M	M	M	M	H	H	H	H	-	-	-	-	M	M	M	M	M	M
Communications Facility	Critical Infrastructure	-	-	-	-	-	-	-	-	-	-	-	-	-	-	M	-	-	-	-	-	-	-	-	-	-

Legend (Critical Community and Emergency Facilities)	
Low	Flooding < 0.5-ft
Medium	Flood depths greater than 0.5-ft and less than 2-ft
High	Permanent (SLR) flooding, flood depths >2-ft

Table E-3. Paired Asset-Threat Matrix for Critical Community and Emergency Facilities

Asset Name	Asset Type	Scenario Criticality																								
		100Y72H	Projected - 100Y72H IL2040	Projected - 100Y72H IH2040	Projected - 100Y72H IL2070	Projected - 100Y72H IH2070	500Y72H	Projected - 500Y72H IL2040	Projected - 500Y72H IH2040	Projected - 500Y72H IL2070	Projected - 500Y72H IH2070	CURRENT STORM SURGE	STORM SURGE + IL2040	STORM SURGE + IH2040	STORM SURGE + IL2070	STORM SURGE + IH2070	CURRENT KING TIDE	FUTURE KING TIDE IL2040	FUTURE KING TIDE IH2040	FUTURE KING TIDE IL2070	FUTURE KING TIDE IH2070	COMPOUND - 100YR + CURRENT KING TIDE	COMPOUND - 100YR + FUTURE KING TIDE IL2040	COMPOUND - 100YR + FUTURE KING TIDE IH2040	COMPOUND - 100YR + FUTURE KING TIDE IL2070	COMPOUND - 100YR + FUTURE KING TIDE IH2070
The Peninsula Assisted Living & Memory Care	Health Care Facility	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	M	H	H	H	H	H
Plaza of Hallendale Beach Assisted Living	Health Care Facility	M	M	M	M	M	M	M	M	M	M	-	M	M	M	H	-	-	-	-	-	M	M	M	M	M
Mimis Learning Center	School	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	-	-	-	-	-	H	H	H	H	H
Pembroke Park Montessori School	School	-	-	-	-	-	-	-	-	-	-	-	-	-	-	M	-	-	-	-	-	-	-	-	-	-
Broward County Sheriff's Dept. District 1	Law Enforcement Facility	L	L	L	L	L	M	L	M	M	M	-	-	M	M	H	-	-	-	-	-	L	L	L	L	L
Government - City Hall	Local Government Facilities, Emergency Operation Center	M	M	M	M	M	M	M	M	M	M	L	M	M	M	H	-	-	-	-	-	M	M	M	M	M
Watkins Elementary - P.E. Building	School	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Watkins Elementary - Main Building	School	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Building 4	School	L	L	L	L	L	L	L	L	L	L	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Lake Forest Elementary School - Building 5	School	L	L	L	L	L	L	L	L	L	L	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Lake Forest Elementary School - Building 12	School	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Building 1	School	L	L	L	L	L	M	L	M	M	M	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Lake Forest Elementary School - Building 6	School	L	L	L	L	L	L	L	L	L	L	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Lake Forest Elementary School - Building 2	School	L	L	L	L	L	M	L	M	M	M	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Lake Forest Elementary School - Portable Class	School	M	M	M	M	M	M	M	M	M	M	-	L	M	M	H	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Building 9	School	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Portable Class	School	L	L	L	L	L	L	L	L	L	L	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Lake Forest Elementary School - Portable Class	School	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Portable Class	School	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Portable Class	School	M	M	M	M	M	M	M	M	M	M	-	-	L	-	M	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Portable Class	School	L	L	L	L	L	L	L	L	L	L	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Lake Forest Elementary School - Portable Class	School	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - E of Gazebo	School	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Portable Class	School	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - Portable Class	School	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Lake Forest Elementary School - NE of Playgro	School	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Point of Grace Christian Academy	School	M	M	M	M	M	M	M	M	M	M	-	L	M	M	H	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4803	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4805	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	-	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4801	Affordable Public Housing	-	-	-	-	-	-	-	-	-	-	-	-	-	-	M	-	-	-	-	-	-	-	-	-	-
Pembroke Villas - 4807	Affordable Public Housing	L	L	L	L	L	M	L	M	M	M	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Pembroke Villas - 4809	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4811	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4813	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4815	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4001	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4009	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4007	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4003	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Villas - 4005	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3730	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3770	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3740	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3760	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3750	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3703	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3705	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3707	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - 3701	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Pembroke Gardens - Poolhouse	Affordable Public Housing	L	L	L	L	L	M	L	M	M	M	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Pembroke Park Apts - 3706	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3708	Affordable Public Housing	L	L	L	L	L	L	L	L	L	L	-	-	L	L	H	-	-	-	-	-	L	L	L	L	L
Pembroke Park Apts - 3710	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	L	M	M	H	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3712	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3714	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	L	M	M	H	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3702	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	-	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3704	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	M	M	H	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3700	Affordable Public Housing	L	L	L	L	L	M	L	M	M	M	-	-	-	-	M	-	-	-	-	-	L	L	L	L	L
Pembroke Park Apts - 3720	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 5734	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	-	M	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3718	Affordable Public Housing	M	M	M	M	M	M	M	M	M	M	-	-	L	L	H	-	-	-	-	-	M	M	M	M	M
Pembroke Park Apts - 3716	Affordable Public Housing	L	L	L	L	L	M	L	M	M	M	-	-	L	L	H	-	-	-	-	-	L	L	L	L	L

Legend (Parks)	
Low	Flooding up to 25% by land area
Medium	Flooding greater than 25% and less than 75% by land area
High	Flooding greater than 75% by land area

Table E-4. Paired Asset-Threat Matrix for Natural, Cultural, and Historical Assets (Parks)

Asset Name	Asset Type	Scenario Criticality																							
		100Y72H	Projected - 100Y72H IL2040	Projected - 100Y72H IH2040	Projected - 100Y72H IL2070	Projected - 100Y72H IH2070	500Y72H	Projected - 500Y72H IL2040	Projected - 500Y72H IH2040	Projected - 500Y72H IL2070	Projected - 500Y72H IH2070	CURRENT STORM SURGE	STORM SURGE + IL2040	STORM SURGE + IH2040	STORM SURGE + IL2070	STORM SURGE + IH2070	CURRENT KING TIDE	FUTURE KING TIDE IL2040	FUTURE KING TIDE IH2040	FUTURE KING TIDE IL2070	FUTURE KING TIDE IH2070	COMPOUND - 100YR + CURRENT KING TIDE	COMPOUND - 100YR + FUTURE KING TIDE IL2040	COMPOUND - 100YR + FUTURE KING TIDE IH2040	COMPOUND - 100YR + FUTURE KING TIDE IL2070	COMPOUND - 100YR + FUTURE KING TIDE IH2070
Patrick Behan Park	Park	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	-	H	H	H	H	H
Lake Forest Park	Park	M	M	M	M	M	M	M	M	M	M	-	L	M	M	H	-	-	-	-	-	M	M	M	M	M
Pembroke Park Preserve	Park	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	-	-	-	-	M	H	H	H	H	H
AJ Ryan Park	Park	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	-	-	-	H	H	H	H	H	H
Howard Clark Sr Linear Walkway	Park	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	-	M	H	H	H	H	H	H	H	H


Legend (Surface Waters and Cultural/Historical Assets)	
Low	Flooding < 0.5-ft
Medium	Flood depths greater than 0.5-ft and less than 2-ft
High	Permanent (SLR) flooding, flood depths >2-ft

Table E-5. Paired Asset-Threat Matrix for Natural, Cultural, and Historical Assets (Surface Waters and Cultural/Historical Assets)

Asset Name	Asset Type	Scenario Criticality																							
		100Y72H	Projected - 100Y72H IL2040	Projected - 100Y72H IH2040	Projected - 100Y72H IL2070	Projected - 100Y72H IH2070	500Y72H	Projected - 500Y72H IL2040	Projected - 500Y72H IH2040	Projected - 500Y72H IL2070	Projected - 500Y72H IH2070	CURRENT STORM SURGE	STORM SURGE + IL2040	STORM SURGE + IH2040	STORM SURGE + IL2070	STORM SURGE + IH2070	CURRENT KING TIDE	FUTURE KING TIDE IL2040	FUTURE KING TIDE IH2040	FUTURE KING TIDE IL2070	FUTURE KING TIDE IH2070	COMPOUND - 100YR + CURRENT KING TIDE	COMPOUND - 100YR + FUTURE KING TIDE IL2040	COMPOUND - 100YR + FUTURE KING TIDE IH2040	COMPOUND - 100YR + FUTURE KING TIDE IL2070	COMPOUND - 100YR + FUTURE KING TIDE IH2070
840436	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H
700013	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	H	H	H	H	H
699824	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H
840440	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	H	H	H	H	H
840441	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	M	H	H	H	H	H	H	H	H
697749	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H
840434	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	H	H	H	H	H
700506	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	H	H	H	H	H
700039	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H
840438	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	H	H	H	H	H
700787	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	M	H	H	H	H	H	H	H	H
698034	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	H	H	H	H	H
Desoto Lakes	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	H	H	H	H	H	H	H	H	H
698255	Surface Water	H	H	H	H	H	H	H	H	H	H	H	H	H	H	H	M	M	H	H	H	H	H	H	H	H

APPENDIX F

SENSITIVITY ANALYSIS PAIRED ASSET-THREAT MAPS



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimi's Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

RAINFALL-INDUCED FLOODING
100-YEAR/24-HOUR EVENT

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-1



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

Major Roadway

Railroad

Critical Infrastructure

Communications Facility

Pump Station

Disaster Debris Management Site

Critical Community and Emergency Facilities

Affordable Public Housing

Health Care Facility

Law Enforcement Faciliy

Local Government Facility, Emergency Operation Center

School

Natural, Cultural, and Historical Assets

Park

Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100-YEAR/24-HOUR EVENT +INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-2



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100-YEAR/24-HOUR EVENT +INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-3



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

Major Roadway

Railroad

Critical Infrastructure

Communications Facility

Pump Station

Disaster Debris Management Site

Critical Community and Emergency Facilities

Affordable Public Housing

Health Care Facility

Law Enforcement Faciliy

Local Government Facility, Emergency Operation Center

School

Natural, Cultural, and Historical Assets

Park

Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100-YEAR/24-HOUR EVENT +INT-LOW 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-4



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

Major Roadway

Railroad

Critical Infrastructure

Communications Facility

Pump Station

Disaster Debris Management Site

Critical Community and Emergency Facilities

Affordable Public Housing

Health Care Facility

Law Enforcement Faciliy

Local Government Facility, Emergency Operation Center

School

Natural, Cultural, and Historical Assets

Park

Surface Water

Transportation Assets and Evacuation Routes
1. Amtrak & Commuter
2. HALLANDALE BEACH BLVD
3. I95
4. I95 RAMP
5. JOHN P LYONS LN
6. LAKE SHORE DR
7. S PARK RD
8. SW 20TH ST
9. SW 22ND ST
10. SW 30TH AVE
11. SW 32ND AVE
12. SW 32ND TER
13. SW 34TH AVE
14. SW 52ND AVE
15. W LAKE DR

Critical Infrastructure
16. Dale Village
17. Local 10
18. Pembroke Park Recycling and Transfer Center
19. Pump 1
20. Pump 2
21. Pump 3
22. Pump 4
23. Pump 5
24. Trinity Broadcasting - Miami
25. WHFT TV Transit Tower
26. WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27. Broward County Sheriff's Dept. District 1
28. Government - City Hall
29. Lake Forest Elementary School - Portable Classroom 5
30. Lake Forest Elementary School - Portable Classroom 7
31. Lake Forest Elementary School - Building 1
32. Lake Forest Elementary School - Building 12
33. Lake Forest Elementary School - Building 2
34. Lake Forest Elementary School - Building 4
35. Lake Forest Elementary School - Building 5
36. Lake Forest Elementary School - Building 6
37. Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38. Lake Forest Elementary School - E of Gazebo
39. Lake Forest Elementary School - NE of Playground
40. Lake Forest Elementary School - Portable Classroom 1
41. Lake Forest Elementary School - Portable Classroom 2
42. Lake Forest Elementary School - Portable Classroom 3
43. Lake Forest Elementary School - Portable Classroom 4
44. Lake Forest Elementary School - Portable Classroom 6
45. Lake Forest Elementary School - Portable Classroom 8
46. Lake Forest Elementary School - Portable Classroom 9
47. Mimis Learning Center
48. Pembroke Gardens - 3701
49. Pembroke Gardens - 3703
50. Pembroke Gardens - 3705
51. Pembroke Gardens - 3707
52. Pembroke Gardens - 3730
53. Pembroke Gardens - 3740
54. Pembroke Gardens - 3750
55. Pembroke Gardens - 3760
56. Pembroke Gardens - 3770
57. Pembroke Gardens - Poolhouse
58. Pembroke Park Apts - 3700
59. Pembroke Park Apts - 3702
60. Pembroke Park Apts - 3704
61. Pembroke Park Apts - 3706
62. Pembroke Park Apts - 3708
63. Pembroke Park Apts - 3710
64. Pembroke Park Apts - 3712
65. Pembroke Park Apts - 3714
66. Pembroke Park Apts - 3716
67. Pembroke Park Apts - 3718
68. Pembroke Park Apts - 3720
69. Pembroke Park Apts - 5734
70. Pembroke Park Montessori School
71. Pembroke Villas - 4001
72. Pembroke Villas - 4003
73. Pembroke Villas - 4005
74. Pembroke Villas - 4007
75. Pembroke Villas - 4009

Critical Community and Emergency Facilities
76. Pembroke Villas - 4801
77. Pembroke Villas - 4803
78. Pembroke Villas - 4805
79. Pembroke Villas - 4807
80. Pembroke Villas - 4809
81. Pembroke Villas - 4811
82. Pembroke Villas - 4813
83. Pembroke Villas - 4815
84. Plaza of Hallendale Beach Assisted Living
85. Point of Grace Christian Academy
86. The Peninsula Assisted Living & Memory Care
87. Watkins Elementary - Main Building
88. Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89. 697749
90. 698034
91. 698255
92. 699824
93. 700013
94. 700039
95. 700506
96. 700787
97. 840434
98. 840436
99. 840438
100. 840440
101. 840441
102. AJ Ryan Park
103. Desoto Lakes
104. Howard Clark Sr Linear Walkway
105. Lake Forest Park
106. Patrick Behan Park
107. Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
100-YEAR/24-HOUR EVENT +INT-HIGH 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-5



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building


Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve

TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

RAINFALL-INDUCED FLOODING
500-YEAR/24-HOUR EVENT

Kimley»Horn

FIGURE
A-6



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500-YEAR/24-HOUR EVENT +INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE
A-7



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500-YEAR/24-HOUR EVENT +INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE A-8



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

Major Roadway

Railroad

Critical Infrastructure

Communications Facility

Pump Station

Disaster Debris Management Site

Critical Community and Emergency Facilities

Affordable Public Housing

Health Care Facility

Law Enforcement Faciliy

Local Government Facility, Emergency Operation Center

School

Natural, Cultural, and Historical Assets

Park

Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500-YEAR/24-HOUR EVENT +INT-LOW 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-4



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

PROJECTED RAINFALL-INDUCED FLOODING
500-YEAR/24-HOUR EVENT +INT-HIGH 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE
B-5

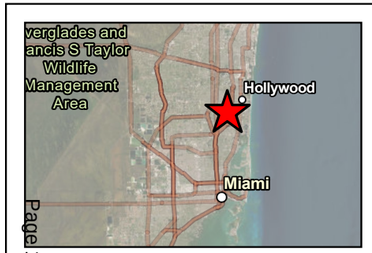

Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve

Carver Ranches
Pembroke Park
Pembroke Park Preserve
Mctyre Park
Watkins Elementary School
Hollywood Ridge Farms
Lake Forest
Ro-Len Lake Gardens
FL 824
FL 858
I 95
Southwest 56th Avenue
Southwest 52nd Avenue
Southwest 46th Avenue
Southwest 42nd Avenue
Southwest 40th Avenue
Southwest 47th Avenue
Southwest 24th Street
Southwest 26th Street
Southwest 27th Street
Southwest 28th Street
Southwest 30th Street
Southwest 32nd Street
Southwest 33rd Street
Southwest 31st Drive
Southwest 32nd Drive
Southwest 33rd Drive
Southwest 36th Street
Southwest 39th Street
Southwest 40th Street
Southwest 41st Street
Northeast 215th Street
Commerce Center Way
Southwest 34th Avenue
Southwest 32nd Avenue
South Park Road
South Florida Rail Corridor
East Lake Drive
Green Acres Road
Country Club Lane
Lone Pine Drive
Westlake Drive
Lake Shore Drive
County Line Road


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

CURRENT KING TIDE WITH NOAA MINOR FLOODING THRESHOLD

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-1

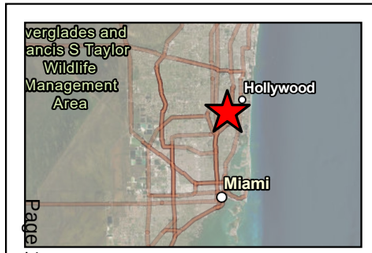

Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve

Carver Ranches
Pembroke Park
Pembroke Park Preserve
Mctyre Park
Watkins Elementary School
Hollywood Ridge Farms
Lake Forest
Ro-Len Lake Gardens
FL 824
FL 858
I 95
Southwest 56th Avenue
Southwest 52nd Avenue
Southwest 48th Avenue
Southwest 46th Avenue
Southwest 42nd Avenue
Southwest 40th Avenue
Southwest 47th Avenue
Commerce Center Way
Southwest 24th Avenue
Southwest 23rd Avenue
South Park Road
South Florida Rail Corridor
Southwest 24th Street
Southwest 26th Street
Southwest 27th Street
Southwest 28th Street
Southwest 30th Street
Southwest 32nd Street
Southwest 33rd Street
Southwest 31st Drive
Southwest 32nd Drive
Southwest 33rd Drive
Southwest 36th Street
Southwest 39th Street
Southwest 40th Street
Southwest 41st Street
Northeast 215th Street
County Line Road
East Lake Drive
Green Acres Road
Country Club Lane
Lone Pine Drive
Westlake Drive
Lake Shore Drive


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-2

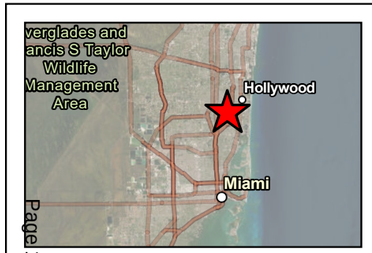

Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

Major Roadway

Railroad

Critical Infrastructure

Communications Facility

Pump Station

Disaster Debris Management Site

Critical Community and Emergency Facilities

Affordable Public Housing

Health Care Facility

Law Enforcement Faciliy

Local Government Facility, Emergency Operation Center

School

Natural, Cultural, and Historical Assets

Park

Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-3

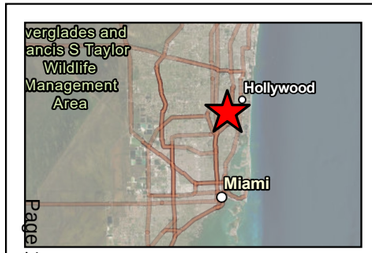

Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

Major Roadway

Railroad

Critical Infrastructure

Communications Facility

Pump Station

Disaster Debris Management Site

Critical Community and Emergency Facilities

Affordable Public Housing

Health Care Facility

Law Enforcement Faciliy

Local Government Facility, Emergency Operation Center

School

Natural, Cultural, and Historical Assets

Park

Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-LOW 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-4

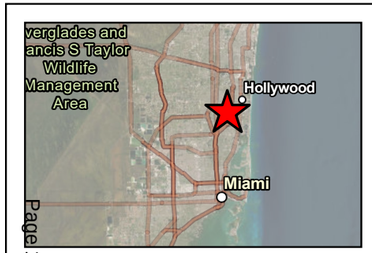

Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

FUTURE KING TIDAL FLOODING WITH INT-HIGH 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE B-5



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

CURRENT STORM SURGE

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-1



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

STORM SURGE WITH SLR INT-LOW 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-2



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

STORM SURGE WITH SLR INT-HIGH 2040

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-3



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

STORM SURGE WITH SLR INT-LOW 2070

0 425 850 1,700 Feet

Kimley»Horn

FIGURE C-4



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building


Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve

TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

STORM SURGE WITH SLR INT-HIGH 2070

Kimley»Horn

FIGURE C-5



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR24HR + CURRENT KING TIDE

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-1



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building


Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve

TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-LOW 2040)

Kimley»Horn

FIGURE
D-2



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-HIGH 2040)

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-3



Legend

Criticality

No Risk · Low · Medium · High

- Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve


TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-LOW 2070)

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-4



Legend

Criticality

No Risk, Low, Medium, High

Town Boundary

Transportation Assets and Evacuation Route

- Major Roadway
- Railroad

Critical Infrastructure

- Communications Facility
- Pump Station
- Disaster Debris Management Site

Critical Community and Emergency Facilities

- Affordable Public Housing
- Health Care Facility
- Law Enforcement Faciliy
- Local Government Facility, Emergency Operation Center
- School

Natural, Cultural, and Historical Assets

- Park
- Surface Water

Transportation Assets and Evacuation Routes
1 Amtrak & Commuter
2 HALLANDALE BEACH BLVD
3 I95
4 I95 RAMP
5 JOHN P LYONS LN
6 LAKE SHORE DR
7 S PARK RD
8 SW 20TH ST
9 SW 22ND ST
10 SW 30TH AVE
11 SW 32ND AVE
12 SW 32ND TER
13 SW 34TH AVE
14 SW 52ND AVE
15 W LAKE DR

Critical Infrastructure
16 Dale Village
17 Local 10
18 Pembroke Park Recycling and Transfer Center
19 Pump 1
20 Pump 2
21 Pump 3
22 Pump 4
23 Pump 5
24 Trinity Broadcasting - Miami
25 WHFT TV Transit Tower
26 WIMP TV UHF Channel 25

Critical Community and Emergency Facilities
27 Broward County Sheriff's Dept. District 1
28 Government - City Hall
29 Lake Forest Elementary School - Portable Classroom 5
30 Lake Forest Elementary School - Portable Classroom 7
31 Lake Forest Elementary School - Building 1
32 Lake Forest Elementary School - Building 12
33 Lake Forest Elementary School - Building 2
34 Lake Forest Elementary School - Building 4
35 Lake Forest Elementary School - Building 5
36 Lake Forest Elementary School - Building 6
37 Lake Forest Elementary School - Building 9

Critical Community and Emergency Facilities
38 Lake Forest Elementary School - E of Gazebo
39 Lake Forest Elementary School - NE of Playground
40 Lake Forest Elementary School - Portable Classroom 1
41 Lake Forest Elementary School - Portable Classroom 2
42 Lake Forest Elementary School - Portable Classroom 3
43 Lake Forest Elementary School - Portable Classroom 4
44 Lake Forest Elementary School - Portable Classroom 6
45 Lake Forest Elementary School - Portable Classroom 8
46 Lake Forest Elementary School - Portable Classroom 9
47 Mimis Learning Center
48 Pembroke Gardens - 3701
49 Pembroke Gardens - 3703
50 Pembroke Gardens - 3705
51 Pembroke Gardens - 3707
52 Pembroke Gardens - 3730
53 Pembroke Gardens - 3740
54 Pembroke Gardens - 3750
55 Pembroke Gardens - 3760
56 Pembroke Gardens - 3770
57 Pembroke Gardens - Poolhouse
58 Pembroke Park Apts - 3700
59 Pembroke Park Apts - 3702
60 Pembroke Park Apts - 3704
61 Pembroke Park Apts - 3706
62 Pembroke Park Apts - 3708
63 Pembroke Park Apts - 3710
64 Pembroke Park Apts - 3712
65 Pembroke Park Apts - 3714
66 Pembroke Park Apts - 3716
67 Pembroke Park Apts - 3718
68 Pembroke Park Apts - 3720
69 Pembroke Park Apts - 5734
70 Pembroke Park Montessori School
71 Pembroke Villas - 4001
72 Pembroke Villas - 4003
73 Pembroke Villas - 4005
74 Pembroke Villas - 4007
75 Pembroke Villas - 4009

Critical Community and Emergency Facilities
76 Pembroke Villas - 4801
77 Pembroke Villas - 4803
78 Pembroke Villas - 4805
79 Pembroke Villas - 4807
80 Pembroke Villas - 4809
81 Pembroke Villas - 4811
82 Pembroke Villas - 4813
83 Pembroke Villas - 4815
84 Plaza of Hallendale Beach Assisted Living
85 Point of Grace Christian Academy
86 The Peninsula Assisted Living & Memory Care
87 Watkins Elementary - Main Building
88 Watkins Elementary - P.E. Building

Natural, Cultural, and Historical Assets
89 697749
90 698034
91 698255
92 699824
93 700013
94 700039
95 700506
96 700787
97 840434
98 840436
99 840438
100 840440
101 840441
102 AJ Ryan Park
103 Desoto Lakes
104 Howard Clark Sr Linear Walkway
105 Lake Forest Park
106 Patrick Behan Park
107 Pembroke Park Preserve

TOWN OF PEMBROKE PARK
VULNERABILITY ASSESSMENT

COMPOUND FLOODING
100YR + FUTURE KING TIDAL FLOODING (INT-HIGH 2070)

0 425 850 1,700 Feet

Kimley»Horn

FIGURE D-5